

FIRE ALARM NOTES	
A	FIRE ALARM SYSTEM DESIGN (DEVICES AND LAYOUT) ARE UNDER SEPARATE PERMIT BY THE FIRE ALARM CONTRACTOR.
B	FIRE ALARM SYSTEM CONSTRUCTION DOCUMENTS FOR THE SCOPE OF WORK INDICATED IN THIS PROJECT SHALL BE SUBMITTED TO PUEBLO COUNTY FOR APPROVAL PRIOR TO COMMENCING FIRE ALARM WORK AND THE INSTALLATION MUST BE APPROVED BY PUEBLO COUNTY AND LOCAL AUTHORITY HAVING JURISDICTION AFTER COMPLETION.
C	THE FIRE ALARM SYSTEM MODIFICATIONS FOR THIS PROJECT SHALL BE DESIGNED BY A LICENSED FIRE ALARM CONTRACTOR AND BE IN ACCORDANCE WITH NFPA 72 & 101 AND PUEBLO COUNTY BUILDING CODE. CONTRACTOR IS RESPONSIBLE FOR SUBMISSION OF PLANS TO THE COUNTY FOR APPROVAL AND ALL ASSOCIATED FEES.
D	ALL 120V CIRCUITS REQUIRED FOR THE OPERATION OF THE FIRE ALARM SYSTEM SHALL BE INCLUDED. LOCATIONS OF ALL PANELS AND BOOSTERS SHALL BE COORDINATED WITH ARCHITECT. CONTRACTOR SHALL TEST THE SYSTEM IN THE PRESENCE OF LOCAL AUTHORITIES AND MAKE ALL REQUIRED MODIFICATIONS AND ADDITIONS TO THE DESIGN AT NO ADDITIONAL COST.

GENERAL NOTES	
A	REFER TO ARCHITECTURAL DRAWINGS FOR EXACT LOCATION AND MOUNTING HEIGHTS OF ALL DEVICES. REFER TO I.T. REPRESENTATIVE FOR EXACT LOCATION OF IT DEVICES. REFER TO AV DRAWINGS FOR A DETAILED LAYOUT OF CONDUIT AND CABLE FOR AV DEVICES.
B	PROVIDE RECESSED CLOCK TYPE BOX FOR ALL WALL MOUNTED TV POWER AND AV DEVICES.
C	CONTRACTOR SHALL TRACE EXISTING CIRCUITS FOR ALL PANELS IN SCOPE AND REUSE THOSE THAT ARE NOT CURRENTLY BEING USED OR BECOME AVAILABLE DUE TO DEMO. CIRCUIT NUMBERS SHOWN ARE DIAGRAMMATIC AND MAY NEED TO BE MODIFIED FOR FIELD CONDITIONS. CONTRACTOR SHALL COORDINATE ALL WORK WITH BUILDING ENGINEER AND MAY NEED TO SCHEDULE WORK AFTER HOURS. CONTRACTOR SHALL CHECK ALL PANELS FOR ELECTRICAL LOAD. IF SUFFICIENT NUMBER OF CIRCUITS CANNOT BE LOCATED AND REUSED, ENGINEER SHALL BE NOTIFIED IMMEDIATELY.

KEYNOTES	
KEYNOTE	DESCRIPTION
1	HOMERUN CP-1 VIA PLUMBING CONTRACTOR PROVIDED TIMECLOCK. COORDINATE EXACT SCHEDULE WITH OWNER.
2	PROVIDE 120V POWER FOR HAND DRYER.
3	PROVIDE 30A/600V/3P/1NF DISCONNECT SWITCH.
4	120V POWER FOR SUMP PUMP.
5	FURNISH 480V, 100A/3P/70AF FUSED DISCONNECT WITH SHUNT TRIP MODULE FOR CONNECTION TO ELEVATOR.
6	FURNISH AND INSTALL 30A/1P/15AF FUSED DISCONNECT SWITCH FOR 120V CONNECTION TO ELEVATOR CAB LIGHTING. FURNISH AND INSTALL GFI CIRCUIT BREAKER SERVING BRANCH CIRCUIT.
7	PROVIDE POWER FOR GENERATOR AUXILIARY POWER CIRCUITS. PROVIDE ADDITIONAL 1" CONDUIT TO ATS FOR CONTROLS.



Date Issued:

2022/07/27 IFP
2022/08/26 OWNER REV 1
2023/10/20 IFC SET
2023/11/08 IFC ADDENDUM 1

INFINITY
MEP CONSULTANTS

10260 Westheimer Road., Suite 250
Houston, Tx 77042
713-429-4949
www.InfinityMEP.com

**PALMER RAIL MILL 2
OPERATIONS & MAINTENANCE BUILDING**

Project Address:
PUEBLO, CO



Copyright 2022
MBA Energy & Industrial
Drawings and Specifications are instruments of service and shall remain the property of MBA Energy & Industrial. They are not to be used on other projects or extensions to this project except by agreement in writing and with appropriate compensation to MBA Energy & Industrial.


Sheet Content:
POWER PLAN - LEVEL 1

SCALE: 1/8" = 1'-0"

Drawn By: GL
Checked By: AH
Plot Date: 07/27/22
Project Number: 1493-00

Sheet:

E2.01

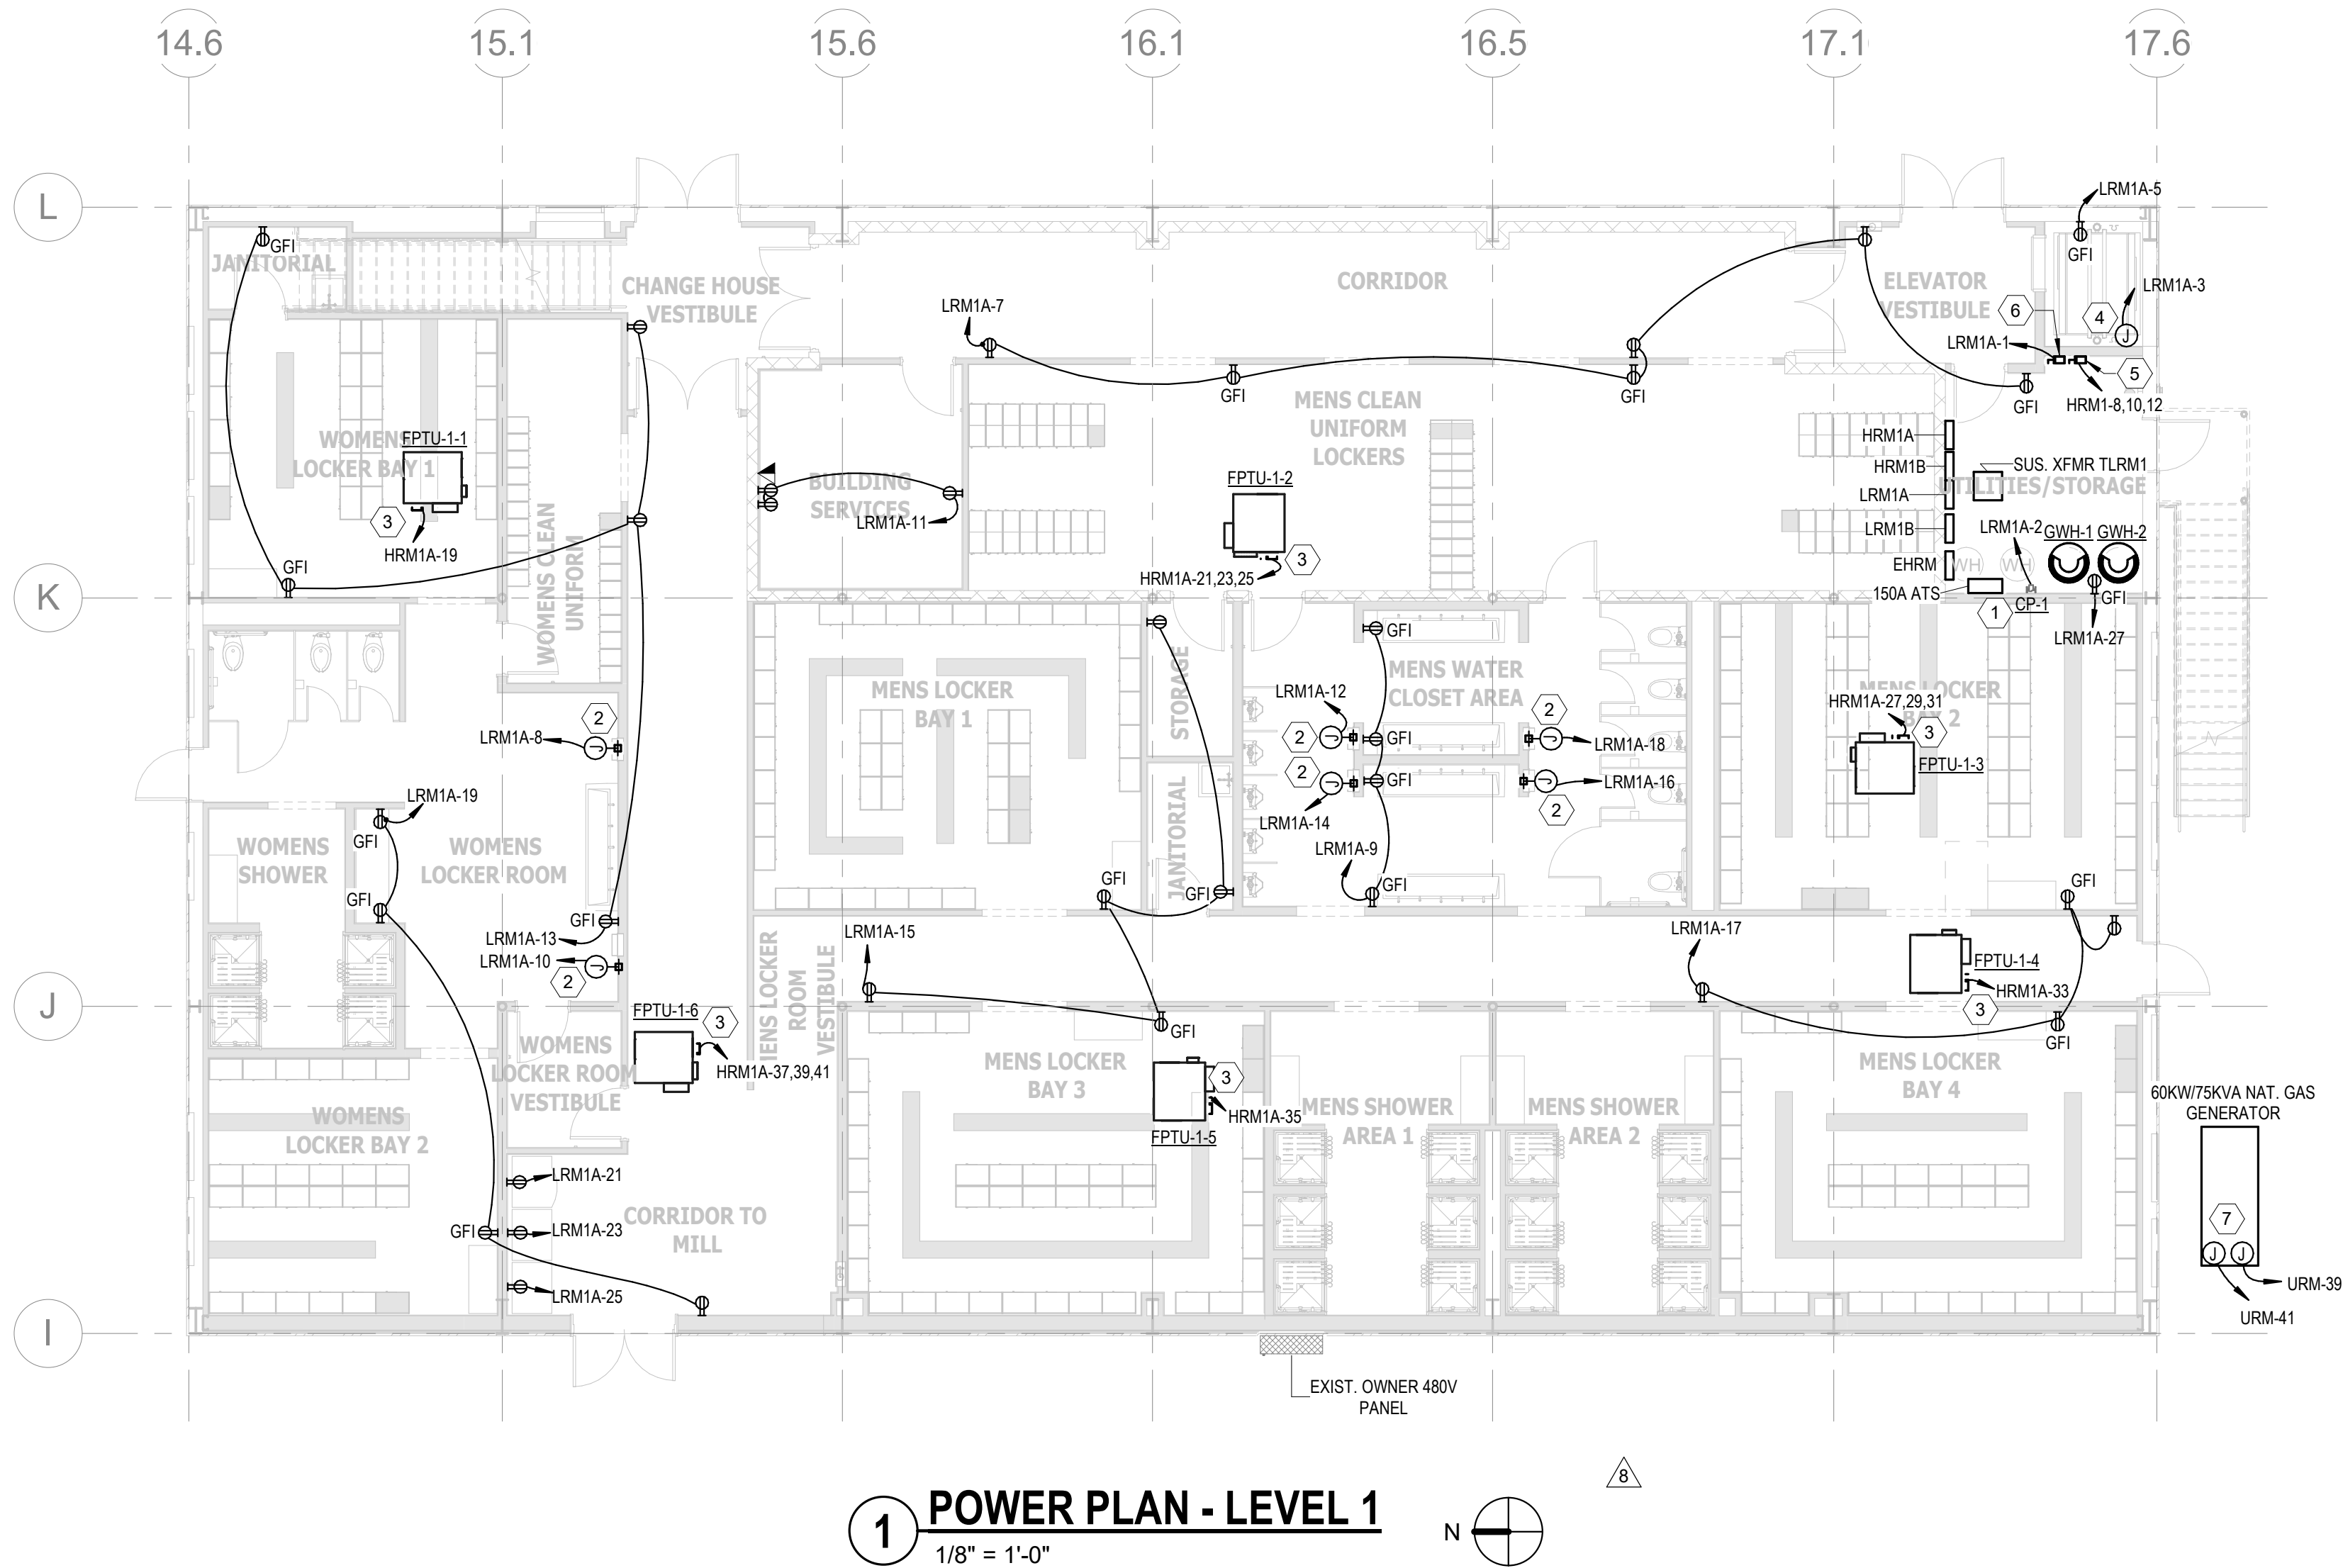

1 POWER PLAN - LEVEL 1
1/8" = 1'-0"