



OPSU Student Union Renovation

Goodwell, Oklahoma

PROJECT SPECIFICATIONS

March 15, 2024

Architecture

Studio Architecture, P.C.

Structural Engineering

360 Engineering Group

MEP Engineering

Guernsey

Fire Protection Engineering

Rated Engineering

**SECTION 00 0110
TABLE OF CONTENTS**

PROCUREMENT AND CONTRACTING REQUIREMENTS

1.01 DIVISION 00 -- PROCUREMENT AND CONTRACTING REQUIREMENTS

- A. 00 0110 - Table of Contents
 - 1. Studio Architecture
 - 2. 360 Engineering Group, PLLC
 - 3. Guernsey and Rated Engineering
- B. 00 7300 - Supplementary Conditions

SPECIFICATIONS

2.01 DIVISION 01 -- GENERAL REQUIREMENTS

- A. 01 1000 - Summary
- B. 01 2000 - Price and Payment Procedures
- C. 01 2100 - Allowances
- D. 01 2500 - Substitution Procedures
- E. 01 3000 - Administrative Requirements
- F. 01 4000 - Quality Requirements
- G. 01 6000 - Product Requirements
- H. 01 7000 - Execution and Closeout Requirements
- I. 01 7800 - Closeout Submittals

2.02 DIVISION 02 -- EXISTING CONDITIONS

- A. 02 4100 - Demolition

2.03 DIVISION 03 -- CONCRETE

- A. 03 3000 - Cast-in-Place Concrete

2.04 DIVISION 04 -- MASONRY

- A. 04 2000 - Unit Masonry
- B. 04 4313 - Stone Masonry Veneer

2.05 DIVISION 05 -- METALS


- A. 05 1200 - Structural Steel Framing
- B. 05 4000 - Cold-Formed Metal Framing
- C. 05 5000 - Metal Fabrications
- D. 05 5213 - Pipe and Tube Railings

2.06 DIVISION 06 -- WOOD, PLASTICS, AND COMPOSITES

- A. 06 1000 - Rough Carpentry
- B. 06 2000 - Finish Carpentry
- C. 06 4100 - Architectural Wood Casework
- D. 06 8316 - Fiberglass Reinforced Paneling

2.07 DIVISION 07 -- THERMAL AND MOISTURE PROTECTION

- A. 07 2100 - Thermal Insulation
- B. 07 2500 - Weather Barriers, Fluid-Applied Membrane Air Barriers, Vapor Permeable
- C. 07 4646 - Fiber-Cement Siding
- D. 07 6200 - Sheet Metal Flashing and Trim

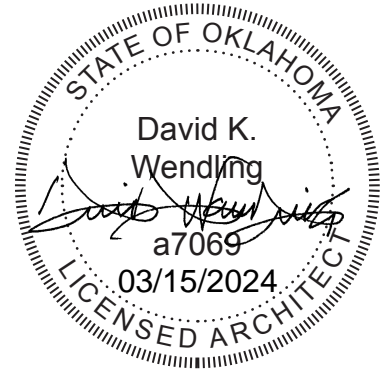

- E. 07 8400 - Firestopping
- F. 07 9200 - Joint Sealants

2.08 DIVISION 08 -- OPENINGS

- A. 08 1113 - Hollow Metal Doors and Frames
- B. 08 1416 - Flush Wood Doors
- C. 08 3100 - Access Doors and Panels
- D. 08 3313 - Coiling Counter Doors
- E. 08 3330 - Security Grilles
- F. 08 3800 - Traffic Doors
- G. 08 4313 - Aluminum-Framed Storefronts
- H. 08 5113 - Aluminum Windows
- I. 08 7100 - Door Hardware
- J. 08 8000 - Glazing

2.09 DIVISION 09 -- FINISHES

- A. 09 2116 - Gypsum Board Assemblies
- B. 09 2236 - Lath
09 2523 - Lime Based Plastering
- C. 09 3000 - Tiling
- D. 09 5100 - Acoustical Ceilings
- E. 09 6500 - Resilient Flooring
- F. 09 6813 - Tile Carpeting
- G. 09 7260 - Tackable Wallcovering
- H. 09 8430 - Sound-Absorbing Wall and Ceiling Units
- I. 09 9113 - Exterior Painting
- J. 09 9123 - Interior Painting

2.10 DIVISION 10 -- SPECIALTIES

- A. 10 1419 - Dimensional Letter Signage
- B. 10 1423 - Panel Signage
- C. 10 2113.17 - Phenolic Toilet Compartments
- D. 10 2600 - Wall and Door Protection
- E. 10 2800 - Toilet, Bath, and Laundry Accessories
- F. 10 4400 - Fire Protection Specialties

2.11 DIVISION 11 -- EQUIPMENT

2.12 DIVISION 12 -- FURNISHINGS

- A. 12 2400 - Window Shades
- B. 12 3600 - Countertops

2.13 DIVISION 13 -- SPECIAL CONSTRUCTION

2.14 DIVISION 14 -- CONVEYING EQUIPMENT

2.15 DIVISION 21 -- FIRE SUPPRESSION

- A. 21 1310 - Fire Sprinkler System, Wet and Dry Pipe Types

2.16 DIVISION 22 -- PLUMBING

- A. 22 0523.12 - Ball Valves for Plumbing Legend
- B. 22 0523.13 - Butterfly Valves for Plumbing Legend
- C. 22 0719 - Plumbing Piping Insulation
- D. 22 1116 - Domestic Water Piping
- E. 22 1316 - Sanitary Waste and Vent Piping
- F. 22 1319 - Sanitary Waste Piping Specialties
- G. 22 1319.13 Sanitary Drains
- H. 22 4213.13 - Commercial Water Closets
- I. 22 4213.16 Commercial Urinals
- J. 22 4216.13 - Commercial Lavatories
- K. 22 4713 - Drinking Fountains

2.17 DIVISION 23 -- HEATING, VENTILATING, AND AIR-CONDITIONING (HVAC)

- A. 23 0529 - Hangers and Supports for HVAC Piping and Equipment
- B. 23 0593 - Testing, Adjusting, and Balancing for HVAC
- C. 23 0713 - Duct Insulation
- D. 23 0719 - HVAC Piping Insulation
- E. 23 1123 - Facility Natural-Gas Piping
- F. 23 2300 - Refrigerant Piping
- G. 23 3113 - Metal Ducts
- H. 23 3300 - Air Duct Accessories
- I. 23 3346 - Flexible Ducts
- J. 23 3400 - HVAC Fans
- K. 23 3713.13 - Air Diffusers
- L. 23 3713.23 - Registers and Grilles
- M. 23 7416.13 - Packaged, Large-Capacity, Rooftop Air-Conditioning Units
- N. 23 8126 - Split-System Air Conditioners
- O. 23 8219 - Fan Coil Units

2.18 DIVISION 25 -- INTEGRATED AUTOMATION

2.19 DIVISION 26 -- ELECTRICAL

- A. 26 0519 - Low-Voltage Electrical Power Conductors and Cables
- B. 26 0526 - Grounding and Bonding for Electrical Systems
- C. 26 0529 - Hangers and Supports for Electrical Systems
- D. 26 0533 - Raceway and Boxes for Electrical Systems
- E. 26 0544 - Sleeves and Sleeve Seals for Electrical Raceways and Cabling
- F. 26 0553 - Identification for Electrical Systems
- G. 26 0923 - Lighting Control Devices
- H. 26 2413 - Switchboards
- I. 26 2416 - Panelboards
- J. 26 2726 - Wiring Devices
- K. 26 4313 - Surge Protective Devices for Low-Voltage Electrical Power Circuits

- L. 26 5119 - LED Interior Lighting
- M. 26 5213 - Emergency and Exit Lighting
- 2.20 DIVISION 27 -- COMMUNICATIONS**
 - A. 27 0528 - Pathways for Communication Systems
 - B. 27 1513 Communications Copper Horizontal Cabling
- 2.21 DIVISION 28 -- ELECTRONIC SAFETY AND SECURITY**
 - A. 28 3111 - Fire Alarm System, Voice Evacuation Type
- 2.22 DIVISION 31 -- EARTHWORK**
- 2.23 DIVISION 32 -- EXTERIOR IMPROVEMENTS**
- 2.24 DIVISION 33 -- UTILITIES**
- 2.25 DIVISION 34 -- TRANSPORTATION**
- 2.26 DIVISION 40 -- PROCESS INTEGRATION**
- 2.27 DIVISION 46 -- WATER AND WASTEWATER EQUIPMENT**
- END OF SECTION**

**SECTION 00 0110.01
TABLE OF CONTENTS - STUDIO ARCHITECTURE**

PROCUREMENT AND CONTRACTING REQUIREMENTS

1.01 DIVISION 00 -- PROCUREMENT AND CONTRACTING REQUIREMENTS

- A. 00 0110 - Table of Contents
- B. 00 0110.01 - Table of Contents - Studio Architecture
- C. 00 7300 - Supplementary Conditions

SPECIFICATIONS

2.01 DIVISION 01 -- GENERAL REQUIREMENTS

- A. 01 1000 - Summary
- B. 01 2000 - Price and Payment Procedures
- C. 01 2100 - Allowances
- D. 01 2500 - Substitution Procedures
- E. 01 3000 - Administrative Requirements
- F. 01 4000 - Quality Requirements
- G. 01 6000 - Product Requirements
- H. 01 7000 - Execution and Closeout Requirements
- I. 01 7800 - Closeout Submittals

2.02 DIVISION 02 -- EXISTING CONDITIONS

- A. 02 4100 - Demolition

2.03 DIVISION 03 -- CONCRETE

2.04 DIVISION 04 -- MASONRY

- A. 04 4313 - Stone Masonry Veneer

2.05 DIVISION 05 -- METALS

- A. 05 5000 - Metal Fabrications
- B. 05 5213 - Pipe and Tube Railings

2.06 DIVISION 06 -- WOOD, PLASTICS, AND COMPOSITES

- A. 06 1000 - Rough Carpentry
- B. 06 2000 - Finish Carpentry
- C. 06 4100 - Architectural Wood Casework
- D. 06 8316 - Fiberglass Reinforced Paneling

2.07 DIVISION 07 -- THERMAL AND MOISTURE PROTECTION

- A. 07 2100 - Thermal Insulation
- B. 07 2500 - Weather Barriers, Fluid-Applied Membrane Air Barriers, Vapor Permeable
- C. 07 4646 - Fiber-Cement Siding
- D. 07 6200 - Sheet Metal Flashing and Trim
- E. 07 8400 - Firestopping
- F. 07 9200 - Joint Sealants

2.08 DIVISION 08 -- OPENINGS

- A. 08 1113 - Hollow Metal Doors and Frames
- B. 08 1416 - Flush Wood Doors
- C. 08 3100 - Access Doors and Panels

- D. 08 3313 - Coiling Counter Doors
- E. 08 3330 - Security Grilles
- F. 08 3800 - Traffic Doors
- G. 08 4313 - Aluminum-Framed Storefronts
- H. 08 5113 - Aluminum Windows
- I. 08 8000 - Glazing

2.09 DIVISION 09 -- FINISHES

- A. 09 2116 - Gypsum Board Assemblies
- B. 09 3000 - Tiling
- C. 09 5100 - Acoustical Ceilings
- D. 09 6500 - Resilient Flooring
- E. 09 6813 - Tile Carpeting
- F. 09 7260 - Tackable Wallcovering
- G. 09 8430 - Sound-Absorbing Wall and Ceiling Units
- H. 09 9113 - Exterior Painting
- I. 09 9123 - Interior Painting

2.10 DIVISION 10 -- SPECIALTIES

- A. 10 1419 - Dimensional Letter Signage
- B. 10 1423 - Panel Signage
- C. 10 2113.17 - Phenolic Toilet Compartments
- D. 10 2600 - Wall and Door Protection
- E. 10 2800 - Toilet, Bath, and Laundry Accessories

2.11 DIVISION 11 -- EQUIPMENT

2.12 DIVISION 12 -- FURNISHINGS

- A. 12 2400 - Window Shades
- B. 12 3600 - Countertops

2.13 DIVISION 13 -- SPECIAL CONSTRUCTION

- 2.14 DIVISION 14 -- CONVEYING EQUIPMENT**
- 2.15 DIVISION 21 -- FIRE SUPPRESSION**
- 2.16 DIVISION 22 -- PLUMBING**
- 2.17 DIVISION 23 -- HEATING, VENTILATING, AND AIR-CONDITIONING (HVAC)**
- 2.18 DIVISION 25 -- INTEGRATED AUTOMATION**
- 2.19 DIVISION 26 -- ELECTRICAL**
- 2.20 DIVISION 27 -- COMMUNICATIONS**
- 2.21 DIVISION 28 -- ELECTRONIC SAFETY AND SECURITY**
- 2.22 DIVISION 31 -- EARTHWORK**
- 2.23 DIVISION 32 -- EXTERIOR IMPROVEMENTS**
- 2.24 DIVISION 33 -- UTILITIES**
- 2.25 DIVISION 34 -- TRANSPORTATION**
- 2.26 DIVISION 40 -- PROCESS INTEGRATION**
- 2.27 DIVISION 46 -- WATER AND WASTEWATER EQUIPMENT**
- END OF SECTION**

This page intentionally left blank

**SECTION 00 0110.02
TABLE OF CONTENTS – 360 ENGINEERING GROUP, PLLC**

PROCUREMENT AND CONTRACTING REQUIREMENTS

1.01 DIVISION 00 -- PROCUREMENT AND CONTRACTING REQUIREMENTS

- A. 00 0110 - Table of Contents
- B. 00 0110.02 - Table of Contents – 360 Engineering Group, PLLC.

SPECIFICATIONS

2.01 DIVISION 01 -- GENERAL REQUIREMENTS

2.02 DIVISION 02 -- EXISTING CONDITIONS

2.03 DIVISION 03 -- CONCRETE

- A. 03 3000 – Cast-in-Place Concrete

2.04 DIVISION 04 -- MASONRY

2.05 DIVISION 05 -- METALS

- A. 05 1200 – Structural Steel Framing
- B. 05 4000 – Cold-formed Metal Framing

2.06 DIVISION 06 -- WOOD, PLASTICS, AND COMPOSITES

2.07 DIVISION 07 -- THERMAL AND MOISTURE PROTECTION

2.08 DIVISION 08 -- OPENINGS

2.09 DIVISION 09 -- FINISHES

2.10 DIVISION 10 -- SPECIALTIES

2.11 DIVISION 11 -- EQUIPMENT

2.12 DIVISION 12 -- FURNISHINGS

2.13 DIVISION 13 -- SPECIAL CONSTRUCTION

2.14 DIVISION 14 -- CONVEYING EQUIPMENT

2.15 DIVISION 21 -- FIRE SUPPRESSION

2.16 DIVISION 22 -- PLUMBING

2.17 DIVISION 23 -- HEATING, VENTILATING, AND AIR-CONDITIONING (HVAC)

2.18 DIVISION 25 -- INTEGRATED AUTOMATION

2.19 DIVISION 26 -- ELECTRICAL

2.20 DIVISION 27 -- COMMUNICATIONS

2.21 DIVISION 28 -- ELECTRONIC SAFETY AND SECURITY

2.22 DIVISION 31 -- EARTHWORK

2.23 DIVISION 32 -- EXTERIOR IMPROVEMENTS

2.24 DIVISION 33 -- UTILITIES

2.25 DIVISION 34 -- TRANSPORTATION

2.26 DIVISION 40 -- PROCESS INTEGRATION

2.27 DIVISION 46 -- WATER AND WASTEWATER EQUIPMENT

END OF SECTION

03/15/2024



This page intentionally left blank

SECTION 00 0110.03

TABLE OF CONTENTS

PROCUREMENT AND CONTRACTING REQUIREMENTS

DIVISION 21 - FIRE SUPPRESSION

21 1310 WATER-BASED FIRE-SUPPRESSION SYSTEMS

DIVISION 22 - PLUMBING

22 0523.12 BALL VALVES FOR PLUMBING PIPING
22 0523.13 BUTTERFLY VALVES FOR PLUMBING PIPING
22 0719 PLUMBING PIPING INSULATION
22 1116 DOMESTIC WATER PIPING
22 1316 SANITARY WASTE AND VENT PIPING
22 1319 SANITARY WASTE PIPING SPECIALTIES
22 1319.13 SANITARY DRAINS
22 4213.13 COMMERCIAL WATER CLOSETS
22 4213.16 COMMERCIAL URINALS
22 4216.13 COMMERCIAL LAVATORIES
22 4713 DRINKING FOUNTAINS

DIVISION 23 - HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)

23 0529 HANGERS AND SUPPORTS FOR HVAC PIPING AND EQUIPMENT
23 0593 TESTING, ADJUSTING, AND BALANCING FOR HVAC
23 0713 DUCT INSULATION
23 0719 HVAC PIPING INSULATION
23 1123 FACILITY NATURAL-GAS PIPING
23 2300 REFRIGERANT PIPING
23 3113 METAL DUCTS
23 3300 AIR DUCT ACCESSORIES
23 3346 FLEXIBLE DUCTS
23 3400 HVAC FANS
23 3713.13 AIR DIFFUSERS
23 3713.23 REGISTERS AND GRILLES
23 7416.13 PACKAGED, LARGE-CAPACITY, ROOFTOP AIR-CONDITIONING UNITS
23 8126 SPLIT-SYSTEM AIR-CONDITIONERS
23 8219 FAN COIL UNITS

DIVISION 26 - ELECTRICAL

26 0519 LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES
26 0526 GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS
26 0529 HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS
26 0533 RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS
26 0544 SLEEVES AND SLEEVE SEALS FOR ELECTRICAL RACEWAYS AND
CABLING
26 0553 IDENTIFICATION FOR ELECTRICAL SYSTEMS
26 0923 LIGHTING CONTROL DEVICES
26 2413 SWITCHBOARDS

| | |
|---------|--|
| 26 2416 | PANELBOARDS |
| 26 2726 | WIRING DEVICES |
| 26 4313 | SURGE PROTECTIVE DEVICES FOR LOW-VOLTAGE ELECTRICAL POWER CIRCUITS |
| 26 5119 | LED INTERIOR LIGHTING |
| 26 5213 | EMERGENCY AND EXIT LIGHTING |

DIVISION 27 - COMMUNICATIONS


| | |
|---------|--|
| 27 0528 | PATHWAYS FOR COMMUNICATIONS SYSTEMS |
| 27 1513 | COMMUNICATIONS COPPER HORIZONTAL CABLING |

DIVISION 28 - ELECTRONIC SAFETY AND SECURITY

| | |
|---------|--------------------------------|
| 28 3111 | ADDRESSABLE FIRE-ALARM SYSTEMS |
|---------|--------------------------------|



DIVISION 22 & 23

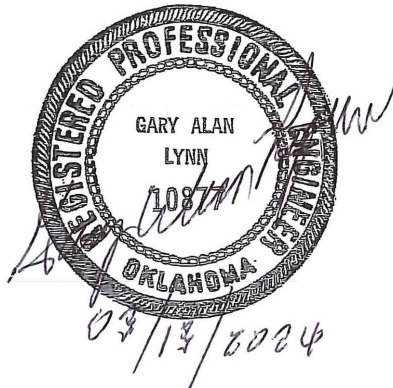

DIVISION 26 & 27



DIVISION 21 & 28

END OF TABLE OF CONTENTS

**SECTION 00 7300
SUPPLEMENTARY CONDITIONS**

PART 1 GENERAL

1.01 SUMMARY

- A. These Supplementary Conditions amend and supplement the General Conditions defined in Document 00 7200 - General Conditions and other provisions of Contract Documents as indicated below. Provisions that are not so amended or supplemented remain in full force and effect.
- B. The terms used in these Supplementary Conditions that are defined in the General Conditions have the meanings assigned to them in the General Conditions.

1.02 MODIFICATIONS TO GENERAL CONDITIONS

- A. Weather Days
 - 1. If adverse weather conditions are the basis for a claim for additional time, such claim shall be documented by data substantiating that weather conditions were abnormal for the period of time, could not have been reasonably anticipated and had an adverse effect on the scheduled construction.
 - 2. Adverse weather conditions include abnormal precipitation, temperature, and wind conditions. Claims for additional time may be made when the actual weather conditions at the project site exceed the normal weather conditions indicated on the following charts. These charts of historical data were generated by the Oklahoma Climatological Survey MESONET, <http://climate.mesonet.org/coop.php>.
 - 3. Calculation of days for adverse weather exceeding historical data:
 - a. of rain = $\frac{1}{2}$ day for the rain plus $\frac{1}{2}$ day for drying time.
 - b. 1" of rain = 1 day for the rain plus 1 day for drying time.
 - c. snow = $\frac{1}{2}$ day for the snow plus $\frac{1}{2}$ day for melting time.
 - d. 1" snow = 1 day for snow plus 1 day for melting time plus an additional day for every day snow remains on the ground. Documentation must be provided demonstrating the length of time snow remains on the ground.
 - 4. Any adverse weather event that prevents critical path construction activities from taking place, must be documented daily for any claim for additional time.
 - 5. All claims for additional days that exceed the work days lost as indicated shall be submitted with documentation from the Oklahoma Climatological Survey (www.mesonet.ou.edu).
 - 6. All claims for additional time due to adverse weather conditions that exceed the days indicated on the chart shall be submitted with the next monthly payment application.
 - 7. Weather conditions and lost work days shall be recorded daily by the Contractor and submitted to the Architect with the monthly payment applications.
 - 8. Unused lost weather days included in the Contract time shall be used by the Owner to offset lost time for other approved delay claims.
 - 9. In order to claim weather days over a weekend, the Architect and Owner must be notified in the two week look ahead.
 - 10. A list of activities scheduled to be performed on the requested lost day for weather must be submitted. This list must include and specify what critical path activity was directly affected.
 - 11. The Owner must sign off on all weather days granted per payment application.
 - 12. Claims for additional weather days must be made within 21 days after occurrence of the event given rise to such claims or with the application for payment in which the event occurred, whichever is later.
 - 13. Failure to submit claims for additional time caused by adverse weather within the time frame listed above shall constitute a waiver of any claim for time extension.
 - 14. No additional compensation for cost associated with adverse weather time extensions will be allowed. These costs are to be part of the Guaranteed Maximum Price.

PART 2 PRODUCTS - NOT USED
PART 3 EXECUTION - NOT USED

END OF SECTION

SECTION 01 1000 SUMMARY

PART 1 GENERAL

1.01 PROJECT

- A. Project Name: OPSU Student Union Renovation
- B. Owner's Name: Long Range Facilities Planning.
- C. Architect's Name: Studio Architecture, P.C..
- D. The Project consists of the alteration of 323 Eagle Blvd. Goodwell, OK.

1.02 CONTRACT DESCRIPTION

1.03 DESCRIPTION OF ALTERATIONS WORK

- A. Scope of demolition and removal work is indicated on drawings and specified in Section 02 4100.

1.04 OWNER OCCUPANCY

- A. Owner intends to occupy the Project upon Substantial Completion.
- B. Owner intends to occupy a certain portion of the Project prior to the completion date for the conduct of normal operations.
- C. Cooperate with Owner to minimize conflict and to facilitate Owner's operations.
- D. Schedule the Work to accommodate Owner occupancy.

1.05 CONTRACTOR USE OF SITE AND PREMISES

- A. Provide access to and from site as required by law and by Owner:
 - 1. Emergency Building Exits During Construction: Keep all exits required by code open during construction period; provide temporary exit signs if exit routes are temporarily altered.
 - 2. Do not obstruct roadways, sidewalks, or other public ways without permit.
- B. Utility Outages and Shutdown:
 - 1. Prevent accidental disruption of utility services to other facilities.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

This page intentionally left blank

**SECTION 01 2000
PRICE AND PAYMENT PROCEDURES**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Procedures for preparation and submittal of applications for progress payments.
- B. Documentation of changes in Contract Sum and Contract Time.
- C. Change procedures.
- D. Procedures for preparation and submittal of application for final payment.

1.02 RELATED REQUIREMENTS

- A. Section 01 2100 - Allowances: Payment procedures relating to allowances.
- B. Section 01 7800 - Closeout Submittals: Project record documents.

1.03 SCHEDULE OF VALUES

- A. Use Schedule of Values Form: AIA G703, edition stipulated in the Agreement.
- B. Electronic media printout including equivalent information will be considered in lieu of standard form specified; submit draft to Architect for approval.
- C. Forms filled out by hand will not be accepted.
- D. Include separately from each line item, a direct proportional amount of Contractor's overhead and profit.
- E. Revise schedule to list approved Change Orders, with each Application For Payment.

1.04 APPLICATIONS FOR PROGRESS PAYMENTS

- A. Electronic media printout including equivalent information will be considered in lieu of standard form specified; submit sample to Architect for approval.
- B. Forms filled out by hand will not be accepted.
- C. For each item, provide a column for listing each of the following:
 - 1. Item Number.
 - 2. Description of work.
 - 3. Scheduled Values.
 - 4. Previous Applications.
 - 5. Work in Place and Stored Materials under this Application.
 - 6. Authorized Change Orders.
 - 7. Total Completed and Stored to Date of Application.
 - 8. Percentage of Completion.
 - 9. Balance to Finish.
 - 10. Retainage.
- D. Execute certification by signature of authorized officer.
- E. Use data from approved Schedule of Values. Provide dollar value in each column for each line item for portion of work performed and for stored products.
- F. List each authorized Change Order as a separate line item, listing Change Order number and dollar amount as for an original item of work.
- G. Submit an electronic copy of each Application for Payment.
- H. Include the following with the application:
 - 1. Transmittal letter as specified for submittals in Section 01 3000.
 - 2. Construction progress schedule, revised and current as specified in Section 01 3000.
 - 3. Current construction photographs specified in Section 01 3000.

1.05 MODIFICATION PROCEDURES

- A. For minor changes not involving an adjustment to the Contract Sum or Contract Time, Architect will issue instructions directly to Contractor.
- B. For other required changes, Architect will issue a document signed by Owner instructing Contractor to proceed with the change, for subsequent inclusion in a Change Order.
 - 1. The document will describe the required changes and will designate method of determining any change in Contract Sum or Contract Time.
 - 2. Promptly execute the change.
- C. For changes for which advance pricing is desired, Architect will issue a document that includes a detailed description of a proposed change with supplementary or revised drawings and specifications, a change in Contract Time for executing the change with a stipulation of any overtime work required and the period of time during which the requested price will be considered valid. Contractor shall prepare and submit a fixed price quotation within 10 working days.
- D. Computation of Change in Contract Amount: As specified in the Agreement and Conditions of the Contract.
- E. Execution of Change Orders: Contractor will issue Change Orders for signatures of parties as provided in the Conditions of the Contract.

1.06 APPLICATION FOR FINAL PAYMENT

END OF SECTION

**SECTION 01 2100
ALLOWANCES**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Contingency allowance.

1.02 CONTINGENCY ALLOWANCE

- A. Contractor's costs for products, delivery, installation, labor, insurance, payroll, taxes, bonding, equipment rental, overhead and profit will be included in Change Orders authorizing expenditure of funds from this Contingency Allowance.
- B. Funds will be drawn from the Contingency Allowance only by Change Order.
- C. At closeout of Contract, funds remaining in Contingency Allowance will be credited to Owner by Change Order.

1.03 ALLOWANCES SCHEDULE

- A. Contingency Allowance: Include a minimum stipulated sum/price of \$25,000 for use upon Owner's instructions.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION - NOT USED

END OF SECTION

This page intentionally left blank

SECTION 01 2500 SUBSTITUTION PROCEDURES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Procedural requirements for proposed substitutions.

1.02 RELATED REQUIREMENTS

- A. Section 01 6000 - Product Requirements: Fundamental product requirements, product options, delivery, storage, and handling.

1.03 DEFINITIONS

- A. Substitutions: Changes from Contract Documents requirements proposed by Contractor to materials, products, assemblies, and equipment.
 - 1. Substitutions for Cause: Proposed due to changed Project circumstances beyond Contractor's control.
 - a. Unavailability.
 - b. Regulatory changes.
 - 2. Substitutions for Convenience: Proposed due to possibility of offering substantial advantage to the Project.
 - a. Substitution requests offering advantages solely to the Contractor will not be considered.

1.04 REFERENCE STANDARDS

- A. CSI/CSC Form 1.5C - Substitution Request (During the Bidding/Negotiating Stage); Current Edition.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 GENERAL REQUIREMENTS

- A. A Substitution Request for products, assemblies, materials, and equipment constitutes a representation that the submitter:
 - 1. Has investigated proposed product and determined that it meets or exceeds the quality level of the specified product, equipment, assembly, or system.
 - 2. Agrees to provide the same warranty for the substitution as for the specified product.
 - 3. Agrees to provide same or equivalent maintenance service and source of replacement parts, as applicable.
 - 4. Agrees to coordinate installation and make changes to other work that may be required for the work to be complete, with no additional cost to Owner.
 - 5. Waives claims for additional costs or time extension that may subsequently become apparent.
- B. Document each request with complete data substantiating compliance of proposed substitution with Contract Documents. Burden of proof is on proposer.
 - 1. Note explicitly any non-compliant characteristics.
- C. Content: Include information necessary for tracking the status of each Substitution Request, and information necessary to provide an actionable response.
 - 1. Forms indicated in the Project Manual are adequate for this purpose, and must be used.
- D. Limit each request to a single proposed substitution item.
 - 1. Submit an electronic document, combining the request form with supporting data into single document.

3.02 SUBSTITUTION PROCEDURES DURING PROCUREMENT

- A. Submittal Time Restrictions:
 - 1. Owner will consider requests for substitutions only if submitted at least 10 days prior to the date for receipt of bids.

- B. Submittal Form (before award of contract):
 - 1. Submit substitution requests by completing CSI/CSC Form 1.5C - Substitution Request. See this form for additional information and instructions. Use only this form; other forms of submission are unacceptable.

3.03 SUBSTITUTION PROCEDURES DURING CONSTRUCTION

- A. Submit request for Substitution for Cause within 14 days of discovery of need for substitution, but not later than 14 days prior to time required for review and approval by Architect, in order to stay on approved project schedule.
- B. Submit request for Substitution for Convenience within 14 days of discovery of its potential advantage to the project, but not later than 14 days prior to time required for review and approval by Architect, in order to stay on approved project schedule.
 - 1. In addition to meeting general documentation requirements, document how the requested substitution benefits the Owner through cost savings, time savings, greater energy conservation, or in other specific ways.
 - 2. Document means of coordinating of substitution item with other portions of the work, including work by affected subcontractors.
 - 3. Bear the costs engendered by proposed substitution of:
 - a. Owner's compensation to the Architect for any required redesign, time spent processing and evaluating the request.
- C. Substitutions will not be considered under one or more of the following circumstances:
 - 1. When they are indicated or implied on shop drawing or product data submittals, without having received prior approval.
 - 2. Without a separate written request.

3.04 RESOLUTION

- A. Architect may request additional information and documentation prior to rendering a decision. Provide this data in an expeditious manner.
- B. Architect will notify Contractor in writing of decision to accept or reject request.
 - 1. Architect's decision following review of proposed substitution will be noted on the submitted form.

3.05 ACCEPTANCE

- A. Accepted substitutions change the work of the Project. They will be documented and incorporated into work of the project by Change Order, Construction Change Directive, Architectural Supplementary Instructions, or similar instruments provided for in the Conditions of the Contract.

END OF SECTION

**SECTION 01 3000
ADMINISTRATIVE REQUIREMENTS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. General administrative requirements.
- B. Progress meetings.
- C. Construction progress schedule.
- D. Progress photographs.
- E. Submittals for review, information, and project closeout.
- F. Requests for Interpretation (RFI) procedures.
- G. Submittal procedures.

1.02 GENERAL ADMINISTRATIVE REQUIREMENTS

- A. Comply with requirements of Section 01 7000 - Execution and Closeout Requirements for coordination of execution of administrative tasks with timing of construction activities.

1.03 PROJECT COORDINATOR

- A. Project Coordinator: Construction Manager.
- B. Cooperate with the Project Coordinator in allocation of mobilization areas of site; for field offices and sheds, for jobsite access, traffic, and parking facilities.
- C. During construction, coordinate use of site and facilities through the Project Coordinator.
- D. Comply with Project Coordinator's procedures for intra-project communications; submittals, reports and records, schedules, coordination drawings, and recommendations; and resolution of ambiguities and conflicts.
- E. Comply with instructions of the Project Coordinator for use of temporary utilities and construction facilities. Responsibility for providing temporary utilities and construction facilities is identified in Section 01 1000 - Summary.
- F. Coordinate field engineering and layout work under instructions of the Project Coordinator.
- G. Make the following types of submittals to Architect through the Project Coordinator:
 - 1. Requests for Interpretation.
 - 2. Requests for substitution.
 - 3. Shop drawings, product data, and samples.
 - 4. Test and inspection reports.
 - 5. Design data.
 - 6. Manufacturer's instructions and field reports.
 - 7. Applications for payment and change order requests.
 - 8. Progress schedules.
 - 9. Coordination drawings.
 - 10. Correction Punch List and Final Correction Punch List for Substantial Completion.
 - 11. Closeout submittals.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 PROGRESS MEETINGS

- A. Project Coordinator will make arrangements for meetings, prepare agenda with copies for participants, preside at meetings.
- B. Attendance Required:
 - 1. Contractor.
 - 2. Owner.
 - 3. Architect.

- C. Agenda:
1. Review minutes of previous meetings.
 2. Review of work progress.
 3. Field observations, problems, and decisions.
 4. Identification of problems that impede, or will impede, planned progress.
 5. Review of submittals schedule and status of submittals.
 6. Review of RFIs log and status of responses.
 7. Review of off-site fabrication and delivery schedules.
 8. Maintenance of progress schedule.
 9. Corrective measures to regain projected schedules.
 10. Planned progress during succeeding work period.
 11. Maintenance of quality and work standards.
 12. Effect of proposed changes on progress schedule and coordination.
 13. Other business relating to work.
- D. Record minutes and distribute copies within two days after meeting to participants, with copies to Architect, Owner, participants, and those affected by decisions made.

3.02 CONSTRUCTION PROGRESS SCHEDULE

- A. Within 10 days after date established in Notice to Proceed, submit preliminary schedule defining planned operations for the first 60 days of work, with a general outline for remainder of work.
- B. If preliminary schedule requires revision after review, submit revised schedule within 10 days.
- C. Within 20 days after review of preliminary schedule, submit draft of proposed complete schedule for review.
1. Include written certification that major contractors have reviewed and accepted proposed schedule.
- D. Within 10 days after joint review, submit complete schedule.
- E. Submit updated schedule with each Application for Payment.

3.03 PROGRESS PHOTOGRAPHS

- A. Submit photographs with each application for payment, taken not more than 3 days prior to submission of application for payment.
- B. Photography Type: Digital; electronic files.
- C. Provide photographs of site and construction throughout progress of work.
- D. In addition to periodic, recurring views, take photographs of each of the following events:
1. Completion of site clearing.
 2. Completion of demolition phase.
 3. Structural framing in progress and upon completion.
 4. Enclosure of building, upon completion.
- E. Views:
1. Provide views of all in-progress and completed work listed on application for payment.
 2. Provide factual presentation.
 3. Provide correct exposure and focus, high resolution and sharpness, maximum depth of field, and minimum distortion.
- F. Digital Photographs: 24 bit color, minimum resolution of 1024 by 768, in JPG format; provide files unaltered by photo editing software.
1. Delivery Medium: Via email.
 2. File Naming: Include project identification, date and time of view, and view identification.
 3. PDF File: Assemble all photos into printable pages in PDF format, with 2 to 3 photos per page, each photo labeled with file name; one PDF file per submittal.

3.04 REQUESTS FOR INFORMATION (RFI)

- A. Preparation: Prepare an RFI immediately upon discovery of a need for interpretation of Contract Documents. Failure to submit a RFI in a timely manner is not a legitimate cause for claiming additional costs or delays in execution of the work.
 - 1. Prepare a separate RFI for each specific item.
 - 2. Prepare in a format and with content acceptable to Owner.
 - 3. Combine RFI and its attachments into a single electronic file. PDF format is preferred.
- B. Reason for the RFI: Prior to initiation of an RFI, carefully study all Contract Documents to confirm that information sufficient for their interpretation is definitely not included.
 - 1. Include in each request Contractor's signature attesting to good faith effort to determine from Contract Documents information requiring interpretation.
- C. RFI Log: Prepare and maintain a tabular log of RFIs for the duration of the project.
 - 1. Indicate current status of every RFI. Update log promptly and on a regular basis.
 - 2. Note dates of when each request is made, and when a response is received.
 - 3. Highlight items requiring priority or expedited response.
 - 4. Highlight items for which a timely response has not been received to date.
- D. Review Time: Architect will respond and return RFIs to Contractor within 10 calendar days of receipt. For the purpose of establishing the start of the mandated response period, RFIs received after 12:00 noon will be considered as having been received on the following regular working day.
 - 1. Response period may be shortened or lengthened for specific items, subject to mutual agreement, and recorded in a timely manner in progress meeting minutes.
- E. Responses: Content of answered RFIs will not constitute in any manner a directive or authorization to perform extra work or delay the project. If in Contractor's belief it is likely to lead to a change to Contract Sum or Contract Time, promptly issue a notice to this effect, and follow up with an appropriate Change Order request to Owner.
 - 1. Response may include a request for additional information, in which case the original RFI will be deemed as having been answered, and an amended one is to be issued forthwith. Identify the amended RFI with an R suffix to the original number.
 - 2. Do not extend applicability of a response to specific item to encompass other similar conditions, unless specifically so noted in the response.
 - 3. Upon receipt of a response, promptly review and distribute it to all affected parties, and update the RFI Log.
 - 4. Notify Architect within 10 calendar days if an additional or corrected response is required by submitting an amended version of the original RFI, identified as specified above.

3.05 SUBMITTAL SCHEDULE

- A. Submit to Architect for review a schedule for submittals in tabular format.
 - 1. Submit at the same time as the preliminary schedule specified in Section - 01 3216 - Construction Progress Schedule.
 - 2. Coordinate with Contractor's construction schedule and schedule of values.
 - 3. Format schedule to allow tracking of status of submittals throughout duration of construction.
 - 4. Account for time required for preparation, review, manufacturing, fabrication and delivery when establishing submittal delivery and review deadline dates.
 - a. For assemblies, equipment, systems comprised of multiple components and/or requiring detailed coordination with other work, allow for additional time to make corrections or revisions to initial submittals, and time for their review.

3.06 SUBMITTALS FOR REVIEW

- A. When the following are specified in individual sections, submit them for review:
 - 1. Product data.
 - 2. Shop drawings.
 - 3. Samples for selection.

4. Samples for verification.
- B. Submit to Architect for review for the limited purpose of checking for compliance with information given and the design concept expressed in Contract Documents.
- C. Samples will be reviewed for aesthetic, color, or finish selection.
- D. After review, provide copies and distribute in accordance with SUBMITTAL PROCEDURES article below and for record documents purposes described in Section 01 7800 - Closeout Submittals.

3.07 SUBMITTALS FOR INFORMATION

- A. When the following are specified in individual sections, submit them for information:
 1. Design data.
 2. Certificates.
 3. Test reports.
 4. Inspection reports.
 5. Manufacturer's instructions.
 6. Manufacturer's field reports.
 7. Other types indicated.
- B. Submit for Architect's knowledge as contract administrator or for Owner.

3.08 SUBMITTALS FOR PROJECT CLOSEOUT

- A. Submit Correction Punch List for Substantial Completion.
- B. Submit Final Correction Punch List for Substantial Completion.
- C. When the following are specified in individual sections, submit them at project closeout in compliance with requirements of Section 01 7800 - Closeout Submittals:
 1. Project record documents.
 2. Operation and maintenance data.
 3. Warranties.
 4. Bonds.
 5. Other types as indicated.
- D. Submit for Owner's benefit during and after project completion.

3.09 SUBMITTAL PROCEDURES

- A. General Requirements:
 1. Use a single transmittal for related items.
 2. Sequentially identify each item. For revised submittals use original number and a sequential numerical suffix.
 3. Apply Contractor's stamp, signed or initialed certifying that review, approval, verification of products required, field dimensions, adjacent construction work, and coordination of information is in accordance with the requirements of the work and Contract Documents.
 - a. Submittals from sources other than the Contractor, or without Contractor's stamp will not be acknowledged, reviewed, or returned.
 4. Deliver each submittal on date noted in submittal schedule, unless an earlier date has been agreed to by all affected parties, and is of the benefit to the project.
 - a. Send submittals in electronic format via email to Architect.
 5. Schedule submittals to expedite the Project, and coordinate submission of related items.
 - a. For each submittal for review, allow 15 days excluding delivery time to and from the Contractor.
 - b. For sequential reviews involving Architect's consultants, Owner, or another affected party, allow an additional 7 days.
 - c. For sequential reviews involving approval from authorities having jurisdiction (AHJ), in addition to Architect's approval, allow an additional 30 days.
 6. Identify variations from Contract Documents and product or system limitations that may be detrimental to successful performance of the completed work.
 7. When revised for resubmission, identify all changes made since previous submission.

8. Distribute reviewed submittals. Instruct parties to promptly report inability to comply with requirements.
 9. Submittals not requested will be recognized, and will be returned "Not Reviewed",
- B. Product Data Procedures:
1. Submit only information required by individual specification sections.
 2. Collect required information into a single submittal.
 3. Submit concurrently with related shop drawing submittal.
 4. Do not submit (Material) Safety Data Sheets for materials or products.
- C. Shop Drawing Procedures:
1. Prepare accurate, drawn-to-scale, original shop drawing documentation by interpreting Contract Documents and coordinating related work.
 2. Generic, non-project-specific information submitted as shop drawings do not meet the requirements for shop drawings.
- D. Samples Procedures:
1. Transmit related items together as single package.
 2. Identify each item to allow review for applicability in relation to shop drawings showing installation locations.
 3. Include with transmittal high-resolution image files of samples to facilitate electronic review and approval. Provide separate submittal page for each item image.

3.10 SUBMITTAL REVIEW

- A. Submittals for Review: Architect will review each submittal, and approve, or take other appropriate action.
- B. Submittals for Information: Architect will acknowledge receipt, but will take no other action.
- C. Architect's actions will be reflected by marking each returned submittal using virtual stamp on electronic submittals.
1. Notations may be made directly on submitted items and/or listed on appended Submittal Review cover sheet.
- D. Architect's and consultants' actions on items submitted for review:
1. Authorizing purchasing, fabrication, delivery, and installation:
 - a. "Approved", or language with same legal meaning.
 - b. "Approved as Noted, Resubmission not required", or language with same legal meaning.
 2. Not Authorizing fabrication, delivery, and installation:
 - a. "Revise and Resubmit".
 - 1) Resubmit revised item, with review notations acknowledged and incorporated.
 - b. "Rejected".
 - 1) Submit item complying with requirements of Contract Documents.
- E. Architect's and consultants' actions on items submitted for information:
1. Items for which no action was taken:
 - a. "Received" - to notify the Contractor that the submittal has been received for record only.

END OF SECTION

This page intentionally left blank

**SECTION 01 4000
QUALITY REQUIREMENTS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Testing and inspection agencies and services.
- B. Control of installation.
- C. Mock-ups.
- D. Defect Assessment.

1.02 TESTING AND INSPECTION AGENCIES AND SERVICES

PART 3 EXECUTION

2.01 CONTROL OF INSTALLATION

- A. Monitor quality control over suppliers, manufacturers, products, services, site conditions, and workmanship, to produce work of specified quality.
- B. Comply with manufacturers' instructions, including each step in sequence.
- C. Should manufacturers' instructions conflict with Contract Documents, request clarification from Architect before proceeding.
- D. Comply with specified standards as minimum quality for the work except where more stringent tolerances, codes, or specified requirements indicate higher standards or more precise workmanship.
- E. Have work performed by persons qualified to produce required and specified quality.
- F. Verify that field measurements are as indicated on shop drawings or as instructed by the manufacturer.
- G. Secure products in place with positive anchorage devices designed and sized to withstand stresses, vibration, physical distortion, and disfigurement.

2.02 MOCK-UPS

- A. Tests shall be performed under provisions identified in this section and identified in the respective product specification sections.
- B. Assemble and erect specified items with specified attachment and anchorage devices, flashings, seals, and finishes.
- C. Architect will use accepted mock-ups as a comparison standard for the remaining Work.
- D. Where mock-up has been accepted by Architect and is specified in product specification sections to be removed, protect mock-up throughout construction, remove mock-up and clear area when directed to do so by Architect.

2.03 TESTING AND INSPECTION

- A. Testing Agency Duties:
 - 1. Provide qualified personnel at site. Cooperate with Architect and Contractor in performance of services.
 - 2. Perform specified sampling and testing of products in accordance with specified standards.
 - 3. Ascertain compliance of materials and mixes with requirements of Contract Documents.
 - 4. Promptly notify Architect and Contractor of observed irregularities or non-compliance of Work or products.
 - 5. Perform additional tests and inspections required by Architect.
 - 6. Submit reports of all tests/inspections specified.
- B. Limits on Testing/Inspection Agency Authority:
 - 1. Agency may not release, revoke, alter, or enlarge on requirements of Contract Documents.

2. Agency may not approve or accept any portion of the Work.
 3. Agency may not assume any duties of Contractor.
 4. Agency has no authority to stop the Work.
- C. Contractor Responsibilities:
1. Deliver to agency at designated location, adequate samples of materials proposed to be used that require testing, along with proposed mix designs.
 2. Cooperate with laboratory personnel, and provide access to the Work and to manufacturers' facilities.
 3. Provide incidental labor and facilities:
 - a. To provide access to Work to be tested/inspected.
 - b. To obtain and handle samples at the site or at source of Products to be tested/inspected.
 - c. To facilitate tests/inspections.
 - d. To provide storage and curing of test samples.
 4. Notify Architect and laboratory 24 hours prior to expected time for operations requiring testing/inspection services.
 5. Employ services of an independent qualified testing laboratory and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.
 6. Arrange with Owner's agency and pay for additional samples, tests, and inspections required by Contractor beyond specified requirements.
- D. Re-testing required because of non-compliance with specified requirements shall be performed by the same agency on instructions by Architect.
- E. Re-testing required because of non-compliance with specified requirements shall be paid for by Contractor.

2.04 DEFECT ASSESSMENT

- A. Replace Work or portions of the Work not complying with specified requirements.

END OF SECTION

**SECTION 01 6000
PRODUCT REQUIREMENTS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Re-use of existing products.
- B. Transportation, handling, storage and protection.
- C. Product option requirements.
- D. Substitution limitations.
- E. Maintenance materials, including extra materials, spare parts, tools, and software.

1.02 RELATED REQUIREMENTS

- A. Section 01 2500 - Substitution Procedures: Substitutions made during procurement and/or construction phases.
- B. Section 01 7419 - Construction Waste Management and Disposal: Waste disposal requirements potentially affecting product selection, packaging and substitutions.

1.03 REFERENCE STANDARDS

1.04 SUBMITTALS

- A. Product Data Submittals: Submit manufacturer's standard published data. Mark each copy to identify applicable products, models, options, and other data. Supplement manufacturers' standard data to provide information specific to this Project.
- B. Shop Drawing Submittals: Prepared specifically for this Project; indicate utility and electrical characteristics, utility connection requirements, and location of utility outlets for service for functional equipment and appliances.
- C. Sample Submittals: Illustrate functional and aesthetic characteristics of the product, with integral parts and attachment devices. Coordinate sample submittals for interfacing work.
 - 1. For selection from standard finishes, submit samples of the full range of the manufacturer's standard colors, textures, and patterns.

PART 2 PRODUCTS

2.01 EXISTING PRODUCTS

- A. Do not use materials and equipment removed from existing premises unless specifically required or permitted by Contract Documents.
- B. Existing materials and equipment indicated to be removed, but not to be re-used, relocated, reinstalled, delivered to the Owner, or otherwise indicated as to remain the property of the Owner, become the property of the Contractor; remove from site.
- C. Reused Products: Reused products include materials and equipment previously used in this or other construction, salvaged and refurbished as specified.

2.02 NEW PRODUCTS

- A. Provide new products unless specifically required or permitted by Contract Documents.
- B. Use of products having any of the following characteristics is not permitted:
 - 1. Made using or containing CFC's or HCFC's.
 - 2. Containing lead, cadmium, or asbestos.

2.03 PRODUCT OPTIONS

- A. Products Specified by Reference Standards or by Description Only: Use any product meeting those standards or description.
- B. Products Specified by Naming One or More Manufacturers: Use a product of one of the manufacturers named and meeting specifications, no options or substitutions allowed.

- C. Products Specified by Naming One or More Manufacturers with a Provision for Substitutions:
Submit a request for substitution for any manufacturer not named.

2.04 MAINTENANCE MATERIALS

- A. Furnish extra materials, spare parts, tools, and software of types and in quantities specified in individual specification sections.
- B. Deliver to Project site; obtain receipt prior to final payment.

PART 3 EXECUTION

3.01 SUBSTITUTION LIMITATIONS

- A. See Section 01 2500 - Substitution Procedures.

3.02 TRANSPORTATION AND HANDLING

- A. Package products for shipment in manner to prevent damage; for equipment, package to avoid loss of factory calibration.
- B. If special precautions are required, attach instructions prominently and legibly on outside of packaging.
- C. Coordinate schedule of product delivery to designated prepared areas in order to minimize site storage time and potential damage to stored materials.
- D. Transport and handle products in accordance with manufacturer's instructions.
- E. Transport materials in covered trucks to prevent contamination of product and littering of surrounding areas.
- F. Promptly inspect shipments to ensure that products comply with requirements, quantities are correct, and products are undamaged.
- G. Provide equipment and personnel to handle products by methods to prevent soiling, disfigurement, or damage, and to minimize handling.
- H. Arrange for the return of packing materials, such as wood pallets, where economically feasible.

3.03 STORAGE AND PROTECTION

- A. Designate receiving/storage areas for incoming products so that they are delivered according to installation schedule and placed convenient to work area in order to minimize waste due to excessive materials handling and misapplication. See Section 01 7419.
- B. Store and protect products in accordance with manufacturers' instructions.
- C. Store with seals and labels intact and legible.
- D. Store sensitive products in weathertight, climate-controlled enclosures in an environment favorable to product.
- E. For exterior storage of fabricated products, place on sloped supports above ground.
- F. Protect products from damage or deterioration due to construction operations, weather, precipitation, humidity, temperature, sunlight and ultraviolet light, dirt, dust, and other contaminants.
- G. Comply with manufacturer's warranty conditions, if any.
- H. Cover products subject to deterioration with impervious sheet covering. Provide ventilation to prevent condensation and degradation of products.
- I. Prevent contact with material that may cause corrosion, discoloration, or staining.
- J. Provide equipment and personnel to store products by methods to prevent soiling, disfigurement, or damage.
- K. Arrange storage of products to permit access for inspection. Periodically inspect to verify products are undamaged and are maintained in acceptable condition.

END OF SECTION

**SECTION 01 7000
EXECUTION AND CLOSEOUT REQUIREMENTS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Examination, preparation, and general installation procedures.
- B. Requirements for alterations work, including selective demolition.
- C. Pre-installation meetings.
- D. Cutting and patching.
- E. Cleaning and protection.
- F. Demonstration and instruction of Owner personnel.
- G. Closeout procedures, including Contractor's Correction Punch List, except payment procedures.
- H. General requirements for maintenance service.

1.02 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Cutting and Patching: For work not defined in the drawings, submit written request in advance of cutting or alteration that affects:
 - 1. Structural integrity of any element of Project.
 - 2. Integrity of weather exposed or moisture resistant element.
 - 3. Efficiency, maintenance, or safety of any operational element.
 - 4. Visual qualities of sight exposed elements.
 - 5. Work of Owner or separate Contractor.
 - 6. Include in request:
 - a. Identification of Project.
 - b. Location and description of affected work.
 - c. Necessity for cutting or alteration.
 - d. Description of proposed work and products to be used.
 - e. Alternatives to cutting and patching.
 - f. Effect on work of Owner or separate Contractor.
 - g. Written permission of affected separate Contractor.
- C. Project Record Documents: Accurately record actual locations of capped and active utilities.

1.03 PROJECT CONDITIONS

- A. Grade site to drain. Maintain excavations free of water. Provide, operate, and maintain pumping equipment.
- B. Ventilate enclosed areas to assist cure of materials, to dissipate humidity, and to prevent accumulation of dust, fumes, vapors, or gases.
- C. Dust Control: Execute work by methods to minimize raising dust from construction operations. Provide positive means to prevent air-borne dust from dispersing into atmosphere and over adjacent property.
 - 1. Provide dust-proof barriers between construction areas and areas continuing to be occupied by Owner.
- D. Erosion and Sediment Control: Plan and execute work by methods to control surface drainage from cuts and fills, from borrow and waste disposal areas. Prevent erosion and sedimentation.
- E. Noise Control: Provide methods, means, and facilities to minimize noise produced by construction operations.
 - 1. Outdoors: Limit conduct of especially noisy exterior work to the hours of 6 pm to 7 am.
- F. Pest and Rodent Control: Provide methods, means, and facilities to prevent pests and insects from damaging the work.

- G. Pollution Control: Provide methods, means, and facilities to prevent contamination of soil, water, and atmosphere from discharge of noxious, toxic substances, and pollutants produced by construction operations. Comply with federal, state, and local regulations.

1.04 COORDINATION

- A. Coordinate scheduling, submittals, and work of the various sections of the Project Manual to ensure efficient and orderly sequence of installation of interdependent construction elements, with provisions for accommodating items installed later.
- B. Notify affected utility companies and comply with their requirements.
- C. Verify that utility requirements and characteristics of new operating equipment are compatible with building utilities. Coordinate work of various sections having interdependent responsibilities for installing, connecting to, and placing in service, such equipment.
- D. Coordinate space requirements, supports, and installation of mechanical and electrical work that are indicated diagrammatically on drawings. Follow routing indicated for pipes, ducts, and conduit, as closely as practicable; place runs parallel with lines of building. Utilize spaces efficiently to maximize accessibility for other installations, for maintenance, and for repairs.
- E. In finished areas except as otherwise indicated, conceal pipes, ducts, and wiring within the construction. Coordinate locations of fixtures and outlets with finish elements.
- F. Coordinate completion and clean-up of work of separate sections.
- G. After Owner occupancy of premises, coordinate access to site for correction of defective work and work not in accordance with Contract Documents, to minimize disruption of Owner's activities.

PART 2 PRODUCTS

2.01 PATCHING MATERIALS

- A. New Materials: As specified in product sections; match existing products and work for patching and extending work.
- B. Type and Quality of Existing Products: Determine by inspecting and testing products where necessary, referring to existing work as a standard.
- C. Product Substitution: For any proposed change in materials, submit request for substitution described in Section 01 6000 - Product Requirements.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that existing site conditions and substrate surfaces are acceptable for subsequent work. Start of work means acceptance of existing conditions.
- B. Verify that existing substrate is capable of structural support or attachment of new work being applied or attached.
- C. Examine and verify specific conditions described in individual specification sections.
- D. Take field measurements before confirming product orders or beginning fabrication, to minimize waste due to over-ordering or misfabrication.
- E. Verify that utility services are available, of the correct characteristics, and in the correct locations.
- F. Prior to Cutting: Examine existing conditions prior to commencing work, including elements subject to damage or movement during cutting and patching. After uncovering existing work, assess conditions affecting performance of work. Beginning of cutting or patching means acceptance of existing conditions.

3.02 PREPARATION

- A. Clean substrate surfaces prior to applying next material or substance.
- B. Seal cracks or openings of substrate prior to applying next material or substance.

- C. Apply manufacturer required or recommended substrate primer, sealer, or conditioner prior to applying any new material or substance in contact or bond.

3.03 PREINSTALLATION MEETINGS

- A. When required in individual specification sections, convene a preinstallation meeting on-site and online prior to commencing work of the section.
- B. Require attendance of parties directly affecting, or affected by, work of the specific section.
- C. Notify Architect 10 days in advance of meeting date.
- D. Prepare agenda and preside at meeting:
 - 1. Review conditions of examination, preparation and installation procedures.
 - 2. Review coordination with related work.
- E. Record minutes and distribute copies within two days after meeting to participants, with one copy to Architect, Owner, participants, and those affected by decisions made.

3.04 GENERAL INSTALLATION REQUIREMENTS

- A. Install products as specified in individual sections, in accordance with manufacturer's instructions and recommendations, and so as to avoid waste due to necessity for replacement.
- B. Make vertical elements plumb and horizontal elements level, unless otherwise indicated.
- C. Install equipment and fittings plumb and level, neatly aligned with adjacent vertical and horizontal lines, unless otherwise indicated.
- D. Make consistent texture on surfaces, with seamless transitions, unless otherwise indicated.
- E. Make neat transitions between different surfaces, maintaining texture and appearance.

3.05 ALTERATIONS

- A. Drawings showing existing construction and utilities are based on casual field observation and existing record documents only.
 - 1. Verify that construction and utility arrangements are as indicated.
 - 2. Report discrepancies to Architect before disturbing existing installation.
 - 3. Beginning of alterations work constitutes acceptance of existing conditions.
- B. Maintain weatherproof exterior building enclosure except for interruptions required for replacement or modifications; take care to prevent water and humidity damage.
 - 1. Where openings in exterior enclosure exist, provide construction to make exterior enclosure weatherproof.
 - 2. Insulate existing ducts or pipes that are exposed to outdoor ambient temperatures by alterations work.
- C. Remove existing work as indicated and as required to accomplish new work.
 - 1. Remove rotted wood, corroded metals, and deteriorated masonry and concrete; replace with new construction specified.
 - 2. Remove items indicated on drawings.
 - 3. Relocate items indicated on drawings.
 - 4. Where new surface finishes are to be applied to existing work, perform removals, patch, and prepare existing surfaces as required to receive new finish; remove existing finish if necessary for successful application of new finish.
 - 5. Where new surface finishes are not specified or indicated, patch holes and damaged surfaces to match adjacent finished surfaces as closely as possible.
- D. Services (Including but not limited to HVAC, Plumbing, Fire Protection, Electrical, and Telecommunications): Remove, relocate, and extend existing systems to accommodate new construction.
 - 1. Maintain existing active systems that are to remain in operation; maintain access to equipment and operational components; if necessary, modify installation to allow access or provide access panel.
 - 2. Where existing systems or equipment are not active and Contract Documents require reactivation, put back into operational condition; repair supply, distribution, and equipment

- as required.
3. Where existing active systems serve occupied facilities but are to be replaced with new services, maintain existing systems in service until new systems are complete and ready for service.
 - a. Disable existing systems only to make switchovers and connections; minimize duration of outages.
 - b. Provide temporary connections as required to maintain existing systems in service.
 4. Verify that abandoned services serve only abandoned facilities.
 5. Remove abandoned pipe, ducts, conduits, and equipment, including those above accessible ceilings; remove back to source of supply where possible, otherwise cap stub and tag with identification; patch holes left by removal using materials specified for new construction.
- E. Protect existing work to remain.
1. Prevent movement of structure; provide shoring and bracing if necessary.
 2. Perform cutting to accomplish removals neatly and as specified for cutting new work.
 3. Repair adjacent construction and finishes damaged during removal work.
- F. Adapt existing work to fit new work: Make as neat and smooth transition as possible.
1. When existing finished surfaces are cut so that a smooth transition with new work is not possible, terminate existing surface along a straight line at a natural line of division and make recommendation to Architect.
 2. Where removal of partitions or walls results in adjacent spaces becoming one, rework floors, walls, and ceilings to a smooth plane without breaks, steps, or bulkheads.
 3. Where a change of plane of 1/4 inch (6 mm) or more occurs in existing work, submit recommendation for providing a smooth transition for Architect review and request instructions.
 4. Trim existing wood doors as necessary to clear new floor finish. Refinish trim as required.
- G. Patching: Where the existing surface is not indicated to be refinished, patch to match the surface finish that existed prior to cutting. Where the surface is indicated to be refinished, patch so that the substrate is ready for the new finish.
- H. Refinish existing surfaces as indicated:
1. Where rooms or spaces are indicated to be refinished, refinish all visible existing surfaces to remain to the specified condition for each material, with a neat transition to adjacent finishes.
 2. If mechanical or electrical work is exposed accidentally during the work, re-cover and refinish to match.
- I. Clean existing systems and equipment.
- J. Remove demolition debris and abandoned items from alterations areas and dispose of off-site; do not burn or bury.
- K. Do not begin new construction in alterations areas before demolition is complete.
- L. Comply with all other applicable requirements of this section.

3.06 CUTTING AND PATCHING

- A. Whenever possible, execute the work by methods that avoid cutting or patching.
- B. See Alterations article above for additional requirements.
- C. Perform whatever cutting and patching is necessary to:
 1. Complete the work.
 2. Fit products together to integrate with other work.
 3. Provide openings for penetration of mechanical, electrical, and other services.
 4. Match work that has been cut to adjacent work.
 5. Repair areas adjacent to cuts to required condition.
 6. Repair new work damaged by subsequent work.
 7. Remove samples of installed work for testing when requested.

8. Remove and replace defective and non-complying work.
- D. Execute work by methods that avoid damage to other work and that will provide appropriate surfaces to receive patching and finishing. In existing work, minimize damage and restore to original condition.
- E. Employ original installer to perform cutting for weather exposed and moisture resistant elements, and sight exposed surfaces.
- F. Cut rigid materials using masonry saw or core drill. Pneumatic tools not allowed without prior approval.
- G. Restore work with new products in accordance with requirements of Contract Documents.
- H. Fit work air tight to pipes, sleeves, ducts, conduit, and other penetrations through surfaces.
- I. At penetrations of fire rated walls, partitions, ceiling, or floor construction, completely seal voids with fire rated material in accordance with Section 07 8400, to full thickness of the penetrated element.
- J. Patching:
 1. Finish patched surfaces to match finish that existed prior to patching. On continuous surfaces, refinish to nearest intersection or natural break. For an assembly, refinish entire unit.
 2. Match color, texture, and appearance.
 3. Repair patched surfaces that are damaged, lifted, discolored, or showing other imperfections due to patching work. If defects are due to condition of substrate, repair substrate prior to repairing finish.

3.07 PROGRESS CLEANING

- A. Maintain areas free of waste materials, debris, and rubbish. Maintain site in a clean and orderly condition.
- B. Remove debris and rubbish from pipe chases, plenums, attics, crawl spaces, and other closed or remote spaces, prior to enclosing the space.
- C. Broom and vacuum clean interior areas prior to start of surface finishing, and continue cleaning to eliminate dust.
- D. Collect and remove waste materials, debris, and trash/rubbish from site periodically and dispose off-site; do not burn or bury.

3.08 PROTECTION OF INSTALLED WORK

- A. Protect installed work from damage by construction operations.
- B. Provide special protection where specified in individual specification sections.
- C. Provide temporary and removable protection for installed products. Control activity in immediate work area to prevent damage.
- D. Provide protective coverings at walls, projections, jambs, sills, and soffits of openings.
- E. Protect finished floors, stairs, and other surfaces from traffic, dirt, wear, damage, or movement of heavy objects, by protecting with durable sheet materials.
- F. Prohibit traffic or storage upon waterproofed or roofed surfaces. If traffic or activity is necessary, obtain recommendations for protection from waterproofing or roofing material manufacturer.
- G. Remove protective coverings when no longer needed; reuse or recycle coverings if possible.

3.09 DEMONSTRATION AND INSTRUCTION

- A. Demonstrate start-up, operation, control, adjustment, trouble-shooting, servicing, maintenance, and shutdown of each item of equipment at scheduled time, at equipment location.
- B. For equipment or systems requiring seasonal operation, perform demonstration for other season within six months.

- C. Provide a qualified person who is knowledgeable about the Project to perform demonstration and instruction of Owner's personnel.
- D. Utilize operation and maintenance manuals as basis for instruction. Review contents of manual with Owner's personnel in detail to explain all aspects of operation and maintenance.
- E. Prepare and insert additional data in operations and maintenance manuals when need for additional data becomes apparent during instruction.

3.10 ADJUSTING

- A. Adjust operating products and equipment to ensure smooth and unhindered operation.

3.11 FINAL CLEANING

- A. Execute final cleaning prior to final project assessment.
 - 1. Clean areas to be occupied by Owner prior to final completion before Owner occupancy.
- B. Use cleaning materials that are nonhazardous.
- C. Clean interior and exterior glass, surfaces exposed to view; remove temporary labels, stains and foreign substances, polish transparent and glossy surfaces, vacuum carpeted and soft surfaces.
- D. Remove all labels that are not permanent. Do not paint or otherwise cover fire test labels or nameplates on mechanical and electrical equipment.
- E. Clean equipment and fixtures to a sanitary condition with cleaning materials appropriate to the surface and material being cleaned.
- F. Clean filters of operating equipment.
- G. Clean debris from roofs and drainage systems.
- H. Clean site; sweep paved areas, rake clean landscaped surfaces.
- I. Remove waste, surplus materials, trash/rubbish, and construction facilities from the site; dispose of in legal manner; do not burn or bury.

3.12 CLOSEOUT PROCEDURES

- A. Make submittals that are required by governing or other authorities.
 - 1. Provide copies to Architect and Owner.
- B. Accompany Project Coordinator on preliminary inspection to determine items to be listed for completion or correction in the Contractor's Correction Punch List for Contractor's Notice of Substantial Completion.
- C. Notify Architect when work is considered ready for Architect's Substantial Completion inspection.
- D. Submit written certification containing Contractor's Correction Punch List, that Contract Documents have been reviewed, work has been inspected, and that work is complete in accordance with Contract Documents and ready for Architect's Substantial Completion inspection.
- E. Conduct Substantial Completion inspection and create Final Correction Punch List containing Architect's and Contractor's comprehensive list of items identified to be completed or corrected and submit to Architect.
- F. Correct items of work listed in Final Correction Punch List and comply with requirements for access to Owner-occupied areas.
- G. Notify Architect when work is considered finally complete and ready for Architect's Substantial Completion final inspection.
- H. Complete items of work determined by Architect listed in executed Certificate of Substantial Completion.

3.13 MAINTENANCE

- A. Provide service and maintenance of components indicated in specification sections.

- B. Maintenance Period: As indicated in specification sections or, if not indicated, not less than one year from the Date of Substantial Completion or the length of the specified warranty, whichever is longer.
- C. Examine system components at a frequency consistent with reliable operation. Clean, adjust, and lubricate as required.
- D. Include systematic examination, adjustment, and lubrication of components. Repair or replace parts whenever required. Use parts produced by the manufacturer of the original component.
- E. Maintenance service shall not be assigned or transferred to any agent or subcontractor without prior written consent of the Owner.

END OF SECTION

This page intentionally left blank

**SECTION 01 7800
CLOSEOUT SUBMITTALS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Project record documents.
- B. Operation and maintenance data.
- C. Warranties and bonds.

1.02 RELATED REQUIREMENTS

- A. Section 01 3000 - Administrative Requirements: Submittals procedures, shop drawings, product data, and samples.
- B. Individual Product Sections: Specific requirements for operation and maintenance data.
- C. Individual Product Sections: Warranties required for specific products or Work.

1.03 SUBMITTALS

- A. Project Record Documents: Submit documents to Architect with claim for final Application for Payment.
- B. Operation and Maintenance Data:
 - 1. For equipment, or component parts of equipment put into service during construction and operated by Owner, submit completed documents within ten days after acceptance.
- C. Warranties and Bonds:
 - 1. For equipment or component parts of equipment put into service during construction with Owner's permission, submit documents within 10 days after acceptance.
 - 2. Make other submittals within 10 days after Date of Substantial Completion, prior to final Application for Payment.
 - 3. For items of Work for which acceptance is delayed beyond Date of Substantial Completion, submit within 10 days after acceptance, listing the date of acceptance as the beginning of the warranty period.

PART 2 PRODUCTS - NOT USED

PART 3 EXECUTION

3.01 PROJECT RECORD DOCUMENTS

- A. Maintain on site one set of the following record documents; record actual revisions to the Work:
 - 1. Drawings.
 - 2. Specifications.
 - 3. Addenda.
 - 4. Change Orders and other modifications to the Contract.
- B. Ensure entries are complete and accurate, enabling future reference by Owner.
- C. Store record documents separate from documents used for construction.
- D. Record information concurrent with construction progress.
- E. Specifications: Legibly mark and record at each product section description of actual products installed, including the following:
 - 1. Manufacturer's name and product model and number.
 - 2. Product substitutions or alternates utilized.
 - 3. Changes made by Addenda and modifications.
- F. Record Drawings: Legibly mark each item to record actual construction including:
 - 1. Field changes of dimension and detail.
 - 2. Details not on original Contract drawings.

3.02 OPERATION AND MAINTENANCE DATA

- A. Source Data: For each product or system, list names, addresses and telephone numbers of Subcontractors and suppliers, including local source of supplies and replacement parts.
- B. Product Data: Mark each sheet to clearly identify specific products and component parts, and data applicable to installation. Delete inapplicable information.

3.03 OPERATION AND MAINTENANCE DATA FOR MATERIALS AND FINISHES

- A. For Each Product, Applied Material, and Finish:
 - 1. Product data, with catalog number, size, composition, and color and texture designations.
 - 2. Information for re-ordering custom manufactured products.
- B. Additional information as specified in individual product specification sections.
- C. Where additional instructions are required, beyond the manufacturer's standard printed instructions, have instructions prepared by personnel experienced in the operation and maintenance of the specific products.

3.04 OPERATION AND MAINTENANCE DATA FOR EQUIPMENT AND SYSTEMS

- A. For Each Item of Equipment and Each System:
 - 1. Description of unit or system, and component parts.
 - 2. Identify function, normal operating characteristics, and limiting conditions.
 - 3. Include performance curves, with engineering data and tests.
 - 4. Complete nomenclature and model number of replaceable parts.
- B. Where additional instructions are required, beyond the manufacturer's standard printed instructions, have instructions prepared by personnel experienced in the operation and maintenance of the specific products.
- C. Operating Procedures: Include start-up, break-in, and routine normal operating instructions and sequences. Include regulation, control, stopping, shut-down, and emergency instructions. Include summer, winter, and any special operating instructions.
- D. Maintenance Requirements: Include routine procedures and guide for preventative maintenance and trouble shooting; disassembly, repair, and reassembly instructions; and alignment, adjusting, balancing, and checking instructions.
- E. Provide servicing and lubrication schedule, and list of lubricants required.
- F. Include manufacturer's printed operation and maintenance instructions.
- G. Include sequence of operation by controls manufacturer.
- H. Provide original manufacturer's parts list, illustrations, assembly drawings, and diagrams required for maintenance.
- I. Include test and balancing reports.

3.05 ASSEMBLY OF OPERATION AND MAINTENANCE MANUALS

- A. Assemble operation and maintenance data into durable manuals for Owner's personnel use, with data arranged in the same sequence as, and identified by, the specification sections.
- B. Cover: Identify each binder with typed or printed title OPERATION AND MAINTENANCE INSTRUCTIONS; identify title of Project; identify subject matter of contents.
- C. Project Directory: Title and address of Project; names, addresses, and telephone numbers of Architect, Consultants, Contractor and subcontractors, with names of responsible parties.
- D. Tables of Contents: List every item separated by a divider, using the same identification as on the divider tab; where multiple volumes are required, include all volumes Tables of Contents in each volume, with the current volume clearly identified.
- E. Arrangement of Contents: Organize each volume in parts as follows:
 - 1. Project Directory.
 - 2. Table of Contents, of all volumes, and of this volume.
 - 3. Operation and Maintenance Data: Arranged by system, then by product category.

- a. Source data.
- b. Product data, shop drawings, and other submittals.
- c. Operation and maintenance data.
- d. Field quality control data.
- e. Photocopies of warranties and bonds.

3.06 WARRANTIES AND BONDS

- A. Obtain warranties and bonds, executed in duplicate by responsible Subcontractors, suppliers, and manufacturers, within 10 days after completion of the applicable item of work. Except for items put into use with Owner's permission, leave date of beginning of time of warranty until Date of Substantial completion is determined.
- B. Verify that documents are in proper form, contain full information, and are notarized.
- C. Co-execute submittals when required.
- D. Retain warranties and bonds until time specified for submittal.

END OF SECTION

This page intentionally left blank

SECTION 02 4100 DEMOLITION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Selective demolition of building elements for alteration purposes.

PART 2 PRODUCTS -- NOT USED

PART 3 EXECUTION

3.01 GENERAL PROCEDURES AND PROJECT CONDITIONS

- A. Comply with applicable codes and regulations for demolition operations and safety of adjacent structures and the public.
 - 1. Obtain required permits.
 - 2. Take precautions to prevent catastrophic or uncontrolled collapse of structures to be removed; do not allow worker or public access within range of potential collapse of unstable structures.
 - 3. Provide, erect, and maintain temporary barriers and security devices.
 - 4. Use physical barriers to prevent access to areas that could be hazardous to workers or the public.
 - 5. Conduct operations to minimize effects on and interference with adjacent structures and occupants.
 - 6. Do not close or obstruct roadways or sidewalks without permits from authority having jurisdiction.
 - 7. Conduct operations to minimize obstruction of public and private entrances and exits. Do not obstruct required exits at any time. Protect persons using entrances and exits from removal operations.
 - 8. Obtain written permission from owners of adjacent properties when demolition equipment will traverse, infringe upon, or limit access to their property.
- B. Do not begin removal until receipt of notification to proceed from Owner.
- C. Protect existing structures and other elements to remain in place and not removed.
 - 1. Provide bracing and shoring.
 - 2. Prevent movement or settlement of adjacent structures.
 - 3. Stop work immediately if adjacent structures appear to be in danger.
- D. Hazardous Materials:
 - 1. If hazardous materials are discovered during removal operations, stop work and notify Architect and Owner; hazardous materials include regulated asbestos containing materials, lead, PCBs, and mercury.

3.02 EXISTING UTILITIES

- A. Coordinate work with utility companies. Notify utilities before starting work, comply with their requirements, and obtain required permits.
- B. Protect existing utilities to remain from damage.
- C. Do not disrupt public utilities without permit from authority having jurisdiction.
- D. Do not close, shut off, or disrupt existing life safety systems that are in use without at least 7 days prior written notification to Owner.
- E. Do not close, shut off, or disrupt existing utility branches or take-offs that are in use without at least 3 days prior written notification to Owner.
- F. Locate and mark utilities to remain; mark using highly visible tags or flags, with identification of utility type; protect from damage due to subsequent construction, using substantial barricades if necessary.
- G. Remove exposed piping, valves, meters, equipment, supports, and foundations of disconnected and abandoned utilities.

- H. Prepare building demolition areas by disconnecting and capping utilities outside the demolition zone. Identify and mark, in same manner as other utilities to remain, utilities to be reconnected.

3.03 SELECTIVE DEMOLITION FOR ALTERATIONS

- A. Existing construction and utilities indicated on drawings are based on casual field observation and existing record documents only.
 - 1. Verify construction and utility arrangements are as indicated.
 - 2. Report discrepancies to Architect before disturbing existing installation.
 - 3. Beginning of demolition work constitutes acceptance of existing conditions that would be apparent upon examination prior to starting demolition.
- B. Separate areas in which demolition is being conducted from areas that remain occupied.
 - 1. Provide, erect, and maintain temporary dustproof partitions of construction as required to provide concurrent use of the building by owner. .
- C. Maintain weatherproof exterior building enclosure, except for interruptions required for replacement or modifications; prevent water and humidity damage.
- D. Remove existing work as indicated and required to accomplish new work.
 - 1. Remove rotted wood, corroded metals, and deteriorated masonry and concrete; replace with new construction indicated.
 - 2. Remove items indicated on drawings.
- E. Services including, but not limited to, HVAC, Plumbing, Fire Protection, Electrical, and Telecommunications: Remove existing systems and equipment as indicated.
 - 1. Maintain existing active systems to remain in operation, and maintain access to equipment and operational components.
 - 2. Where existing active systems serve occupied facilities but are to be replaced with new services, maintain existing systems in service until new systems are complete and ready for service.
 - 3. Verify that abandoned services serve only abandoned facilities before removal.
 - 4. Remove abandoned pipe, ducts, conduits, and equipment, including those above accessible ceilings. Remove back to source of supply where possible, otherwise cap stub and tag with identification.
- F. Protect existing work to remain.
 - 1. Prevent movement of structure. Provide shoring and bracing as required.
 - 2. Perform cutting to accomplish removal work neatly and as specified for cutting new work.
 - 3. Repair adjacent construction and finishes damaged during removal work.
 - 4. Patch to match new work.

3.04 DEBRIS AND WASTE REMOVAL

- A. Remove debris, junk, and trash from site.
- B. Leave site in clean condition, ready for subsequent work.
- C. Clean up spillage and wind-blown debris from public and private lands.

END OF SECTION

SECTION 03 3000
CAST-IN-PLACE CONCRETE

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.02 SUMMARY

- A. This Section specifies cast-in place concrete, including formwork, reinforcement, concrete materials, mixture design, placement procedures, and finishes, for the following:
 - 1. Footings.
 - 2. Slabs-on-grade.
 - 3. Sidewalks.
- B. Related Sections include the following:
 - 1. Division 32 Section "Concrete Paving" for concrete pavement and walks.
 - 2. Section 033511 – Concrete Floor Finishes.

1.03 DEFINITIONS

- A. Cementitious Materials: Portland cement alone or in combination with one or more of the following: blended hydraulic cement, fly ash and other pozzolans, ground granulated blast-furnace slag, and silica fume; subject to compliance with requirements.

1.04 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Design Mixtures: For each concrete mixture. Submit alternate design mixtures when characteristics of materials, Project conditions, weather, test results, or other circumstances warrant adjustments.
 - 1. Indicate amounts of mixing water to be withheld for later addition at Project site.
- C. Steel Reinforcement Shop Drawings: Placing drawings that detail fabrication, bending, and placement. Include bar sizes, lengths, material, grade, bar schedules, stirrup spacing, bent bar diagrams, bar arrangement, splices and laps, mechanical connections, tie spacing, hoop spacing, and supports for concrete reinforcement.
- D. Samples: For waterstops and vapor retarder.
- E. Qualification Data: For installer, manufacturer and testing agency.
- F. Material Test Reports: For the following, from a qualified testing agency, indicating compliance with requirements:
 - 1. Aggregates. Include service record data indicating absence of deleterious expansion of concrete due to alkali aggregate reactivity.

- G. Material Certificates: For each of the following, signed by manufacturers:
1. Cementitious materials.
 2. Admixtures.
 3. Form materials and form-release agents.
 4. Steel reinforcement and accessories.
 5. Fiber reinforcement.
 6. Waterstops.
 7. Curing compounds.
 8. Floor and slab treatments.
 9. Bonding agents.
 10. Adhesives.
 11. Vapor retarders.
 12. Semi-rigid joint filler.
 13. Joint-filler strips.
 14. Repair materials.
- H. Floor surface flatness and levelness measurements to determine compliance with specified tolerances.
- I. Field quality-control test and inspection reports.
- J. Minutes of pre-installation conference.

1.05 ALLOWANCE

- A. Include an allowance in bid price for 2,000 pounds of reinforcing steel to be fabricated and placed as directed by Architect or Engineer. Allowance is to include, but not limited to, material, detailing, fabrication, shipping, installation, overhead and profit.

1.06 QUALITY ASSURANCE

- A. Installer Qualifications: A qualified installer who employs on Project personnel qualified as ACI-certified Flatwork Technician and Finisher and a supervisor who is an ACI-certified Concrete Flatwork Technician.
- B. Manufacturer Qualifications: A firm experienced in manufacturing ready-mixed concrete products and that complies with ASTM C 94/C 94M requirements for production facilities and equipment.
1. Manufacturer certified according to NRMCA's "Certification of Ready Mixed Concrete Production Facilities."
- C. Testing Agency Qualifications: An independent agency, acceptable to authorities having jurisdiction, qualified according to ASTM C 1077 and ASTM E 329 for testing indicated, as documented according to ASTM E 548.
1. Personnel conducting field tests shall be qualified as ACI Concrete Field Testing Technician, Grade 1, according to ACI CP-01 or an equivalent certification program.
 2. Personnel performing laboratory tests shall be ACI-certified Concrete Strength Testing Technician and Concrete Laboratory Testing Technician - Grade I. Testing Agency laboratory supervisor shall be an ACI-certified Concrete Laboratory Testing Technician - Grade II.

- D. Source Limitations: Obtain each type or class of cementitious material of the same brand from the same manufacturer's plant, obtain aggregate from one source, and obtain admixtures through one source from a single manufacturer.
- E. ACI Publications: Comply with the following unless modified by requirements in the Contract Documents:
 - 1. ACI 301, "Specification for Structural Concrete," Sections 1 through 5.
 - 2. ACI 117, "Specifications for Tolerances for Concrete Construction and Materials."
- F. Concrete Testing Service: Engage a qualified independent testing agency to perform material evaluation tests and to design concrete mixtures.
- G. Pre-Installation Conference: Conduct conference at Project site to comply with requirements in Division 01 Section "Project Management and Coordination."
 - 1. Before submitting design mixtures, review concrete design mixture and examine procedures for ensuring quality of concrete materials. Require representatives of each entity directly concerned with cast-in-place concrete to attend, including the following:
 - a. Contractor's superintendent.
 - b. Independent testing agency responsible for concrete design mixtures.
 - c. Ready-mix concrete manufacturer.
 - d. Concrete subcontractor.
 - 2. Review special inspection and testing and inspecting agency procedures for field quality control, concrete finishes and finishing, cold- and hot-weather concreting procedures, curing procedures, construction contraction and isolation joints, and joint-filler strips, semi-rigid joint fillers, forms and form removal limitations, vapor-retarder installation, anchor rod and anchorage device installation tolerances, steel reinforcement installation, floor and slab flatness and levelness measurement, and concrete protection.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Steel Reinforcement: Deliver, store, and handle steel reinforcement to prevent bending and damage.
- B. Waterstops: Store waterstops under cover to protect from moisture, sunlight, dirt, oil, and other contaminants.

PART 2 - PRODUCTS

2.01 MANUFACTURERS

- A. In other Part 2 articles where titles below introduce lists, the following requirements apply to product selection:
 - 1. Products: Subject to compliance with requirements, provide one of the products specified.
 - 2. Manufacturers: Subject to compliance with requirements, provide products by one of the manufacturers specified.

2.02 FORM-FACING MATERIALS

- A. Smooth-Formed Finished Concrete: Form-facing panels that will provide continuous, true, and smooth concrete surfaces. Furnish in largest practicable sizes to minimize number of joints.
 - 1. Plywood, metal, or other approved panel materials.
 - 2. Exterior-grade plywood panels, suitable for concrete forms, complying with DOC PS 1, and as follows:
 - a. High-density overlay, Class 1 or better.
 - b. Medium-density overlay, Class 1 or better; mill-release agent treated and edge sealed.
 - c. Structural 1, B-B or better; mill oiled and edge sealed.
 - d. B-B (Concrete Form), Class 1 or better; mill oiled and edge sealed.
- B. Rough-Formed Finished Concrete: Plywood, lumber, metal, or another approved material. Provide lumber dressed on at least two edges and one side for tight fit.
- C. Forms for Cylindrical Columns, Pedestals, and Supports: Metal, glass-fiber-reinforced plastic, paper, or fiber tubes that will produce surfaces with gradual or abrupt irregularities not exceeding specified formwork surface class. Provide units with sufficient wall thickness to resist plastic concrete loads without detrimental deformation.
- D. Void Forms: Biodegradable paper surface, treated for moisture resistance, structurally sufficient to support weight of plastic concrete and other superimposed loads.
- E. Chamfer Strips: Wood, metal, PVC, or rubber strips, 3/4 by 3/4 inch, minimum.
- F. Rustication Strips: Wood, metal, PVC, or rubber strips, kerfed for ease of form removal.
- G. Form-Release Agent: Commercially formulated form-release agent containing VOC's less than 250 grams per liter that will not bond with stain, or adversely affect concrete surfaces and will not impair subsequent treatments of concrete surfaces.
 - 1. Formulate form-release agent with rust inhibitor for steel form-facing materials.
- H. Form Ties: Factory-fabricated, removable or snap-off metal or glass-fiber-reinforced plastic form ties designed to resist lateral pressure of fresh concrete on forms and to prevent spalling of concrete on removal.
 - 1. Furnish units that will leave no corrodible metal closer than 1 inch to the plane of exposed concrete surface.
 - 2. Furnish ties that, when removed, will leave holes no larger than 1 inch in diameter in concrete surface.
 - 3. Furnish ties with integral water-barrier plates to walls indicated to receive dampproofing or waterproofing.

2.03 STEEL REINFORCEMENT

- A. Reinforcing Bars: ASTM A 615/A 615M, Grade 60, deformed.
- B. Low-Alloy-Steel Reinforcing Bars: ASTM A 706/A 706M, deformed.
- C. Plain-Steel Welded Wire Reinforcement: ASTM A 185, plain, fabricated from as-drawn steel wire into flat sheets.

- D. Deformed-Steel Welded Wire Reinforcement: ASTM A 497, flat sheet.

2.04 REINFORCEMENT ACCESSORIES

- A. Joint Dowel Bars: ASTM A 615/A 615M, Grade 60, plain-steel bars, cut bars true to length with ends square and free of burrs.
- B. Zinc Repair Material: ASTM A 780, zinc-based solder, paint containing zinc dust, or sprayed zinc.
- C. Bar Supports: Use only concrete bricks as supports under rebars (regular rebar chairs not permitted)

2.05 CONCRETE MATERIALS

- A. Cementitious Material: Use the following cementitious materials, of the same type, brand, and source, throughout Project:
 - 1. Portland Cement: ASTM C 150, Type I/II gray. Supplement with the following:
 - a. Fly Ash: ASTM C 618, Class C or F.
 - b. Ground Granulated Blast-Furnace Slag: ASTM C 989, Grade 100 or 120.
- B. Normal-Weight Aggregates: ASTM C 33, Class 3M coarse aggregate or better, graded. Provide aggregates from a single source with documented service record data of at least 10 years' satisfactory service in similar applications and service conditions using similar aggregates and cementitious materials.
 - 1. Maximum Coarse-Aggregate Size: 1-1/2 inch nominal for foundations, stem walls and slabs on grade; 1 inch nominal for elevated slabs.
 - 2. Fine Aggregate: Free of materials with deleterious reactivity to alkali in cement.
- C. Lightweight Aggregate: ASTM C330, 3/4-inch nominal maximum aggregate size.
- D. Water: ASTM C 94/C 94M and potable.

2.06 ADMIXTURES

- A. Air-Entraining Admixture: ASTM C 260.
- B. Chemical Admixtures: Provide admixtures certified by manufacturer to be compatible with other admixtures and that will not contribute water-soluble chloride ions exceeding those permitted in hardened concrete. Do not use calcium chloride or admixtures containing calcium chloride.
 - 1. Water-Reducing Admixture: ASTM C 494/C 494M, Type A.
 - 2. Retarding Admixture: ASTM C 494/C 494M, Type B.
 - 3. Water-Reducing and Retarding Admixture: ASTM C 494/C 494M, Type D.
 - 4. High-Range, Water-Reducing Admixture: ASTM C 494/C 494M, Type F.
 - 5. High-Range, Water-Reducing and Retarding Admixture: ASTM C 494/C 494M, Type G.
 - 6. Plasticizing and Retarding Admixture: ASTM C 1017/C 1017M, Type II.

2.07 WATERSTOPS

- A. Self-Expanding Butyl Strip Waterstops: Manufactured rectangular or trapezoidal strip, butyl rubber with sodium bentonite or other hydrophilic polymers, for adhesive bonding to concrete, 3/4 by 1 inch.
 - 1. Available Products:
 - a. Colloid Environmental Technologies Company; Volclay Waterstop-RX.
 - b. Concrete Sealants Inc.; Conseal CS-231.
 - c. Greenstreak; Swellstop.
 - d. Henry Company, Sealants Division; Hydro-Flex.
 - e. JP Specialties, Inc.; Earthshield Type 20.
 - f. Progress Unlimited, Inc.; Superstop.
 - g. TCMiraDRI; Mirastop.

2.08 VAPOR BARRIERS

- A. Vapor barrier shall have all the following qualities:
 - 1. Maintain permeance of less than 0.01 Perms [grains/(ft²·hr·inHg)] as tested in accordance with mandatory conditioning tests per ASTM E1745 Section 7.1 (7.1.1-7.1.5).
 - 2. Other performance criteria:
 - a. Strength: ASTM E1745 Class A.
 - b. Thickness: 15 mils minimum
 - 3. Provide third party documentation that all testing was performed on a single production roll per ASTM E1745 Section 8.1.
 - 4. Vapor barrier products:
 - a. Basis of Design: Stego Wrap Vapor Barrier (15-mil) by Stego Industries LLC., (877) 464-7834 www.stegoindustries.com.
 - b. Penetrations:
 - 1) Single penetrations: Manufacturer's recommended tape or mastic.
 - 2) Multiple penetrations: Manufacturer's recommended mastic. Tape is not allowed.
 - c. Edges: Seal vapor barrier at terminations edges to the foundation wall, slab, or grade beam with mastic. Tape is now allowed.

2.09 CURING MATERIALS

- A. Absorptive Cover: AASHTO M 182, Class 2, burlap cloth made from jute or kenaf, weighing approximately 9 oz./sq. yd. when dry.
- B. Moisture-Retaining Cover: ASTM C 171, polyethylene film or white burlap-polyethylene sheet.
- C. Water: Potable.

2.10 FLOOR AND SLAB TREATMENTS

- A. Penetrating Liquid Floor Treatment: Clear, chemically reactive, waterborne solution of inorganic silicate or silicate materials and proprietary components; odorless; colorless; that penetrates, hardens, and densifies concrete surfaces. Apply only to areas scheduled for 'sealed concrete' floor finish. Refer to drawings for location. Protect slab from discoloration prior to applying floor

treatment. Clean slab as recommended by floor treatment manufacturer if necessary prior to floor treatment application.

1. Products:
 - a. ChemMasters; Chemsil Plus.
 - b. ChemTec International; ChemTec One.
 - c. Conspec Marketing & Manufacturing Co., Inc., a Dayton Superior Company; Intraseal.
 - d. Curecrete Distribution Inc.; Ashford Formula.
 - e. Dayton Superior Corporation; Day-Chem Sure Hard.
 - f. Euclid Chemical Company (The); Euco Diamond Hard.
 - g. Kaufman Products, Inc.; SureHard.
 - h. L&M Construction Chemicals, Inc.; Seal Hard.
 - i. SpecChem; SpecHard.

2.11 RELATED MATERIALS

- A. Expansion- and Isolation-Joint-Filler Strips: ASTM D 1751, asphalt-saturated cellulosic fiber.
- B. Bonding Agent: ASTM C 1059, Type II, non-redispersible, acrylic emulsion or styrene butadiene.
- C. Epoxy Bonding Adhesive: ASTM C 881, two-component epoxy resin, capable of humid curing and bonding to damp surfaces, of class suitable for application temperature and of grade to suit requirements, and as follows:
 1. Types I and II, non-load bearing, for bonding hardened or freshly mixed concrete to hardened concrete.
- D. Reglets: Fabricate reglets of not less than 0.0217-inch- thick, galvanized steel sheet. Temporarily fill or cover face opening of reglet to prevent intrusion of concrete or debris.
- E. Dovetail Anchor Slots: Hot-dip galvanized steel sheet, not less than 0.0336 inch thick, with bent tab anchors. Temporarily fill or cover face opening of slots to prevent intrusion of concrete or debris.

2.12 REPAIR MATERIALS

- A. Repair Overlayment: Cement-based, polymer-modified, self-leveling product that can be applied in thicknesses from 1/8 inch and that can be feathered at edges to match adjacent floor elevations.
 1. Cement Binder: ASTM C 150, portland cement or hydraulic or blended hydraulic cement as defined in ASTM C 219.
 2. Primer: Product of topping manufacturer recommended for substrate, conditions, and application.
 3. Aggregate: Well-graded, washed gravel, 1/8 to 1/4 inch or coarse sand as recommended by topping manufacturer.
 4. Compressive Strength: Not less than 5000 psi at 28 days when tested according to ASTM C 109/C 109M.

2.13 CONCRETE MIXTURES, GENERAL

- A. Prepare design mixtures for each type and strength of concrete, proportioned on the basis of laboratory trial mixture or field test data, or both, according to ACI 301.
 - 1. Use a qualified independent testing agency for preparing and reporting proposed mixture designs based on laboratory trial mixtures.
- B. Cementitious Materials: Limit percentage, by weight, of cementitious materials other than portland cement in concrete as follows:
 - 1. Fly Ash: 20 percent.
 - 2. Combined Fly Ash and Pozzolan: 25 percent.
- C. Limit water-soluble, chloride-ion content in hardened concrete to 0.15 percent by weight of cement.
- D. Admixtures: Use admixtures according to manufacturer's written instructions.
 - 1. Use water-reducing, high-range water-reducing or plasticizing admixture in concrete, as required, for placement and workability.
 - 2. Use water-reducing and retarding admixture when required by high temperatures, low humidity, or other adverse placement conditions.
 - 3. Use water-reducing admixture in pumped concrete, concrete for heavy-use industrial slabs and parking structure slabs, concrete required to be watertight, and concrete with a water-cementitious materials ratio below 0.50.

2.14 CONCRETE MIXTURES FOR BUILDING ELEMENTS

- A. Proportion normal-weight concrete mixture for Footings as follows:
 - 1. Refer to Concrete Mix Design Requirements in the structural general notes.
- B. Proportion normal-weight concrete mixture for Interior Slabs-on-Grade as follows:
 - 1. Refer to Concrete Mix Design Requirements in the structural general notes.
- C. Proportion normal-weight concrete mixture for Sidewalks as follows:
 - 1. Refer to Concrete Mix Design Requirements in the structural general notes.

2.15 FABRICATING REINFORCEMENT

- A. Fabricate steel reinforcement according to CRSI's "Manual of Standard Practice."

2.16 CONCRETE MIXING

- A. Ready-Mixed Concrete: Measure, batch, mix, and deliver concrete according to ASTM C 94/C 94M, and furnish batch ticket information.
 - 1. When air temperature is between 85 and 90 deg F, reduce mixing and delivery time from 1-1/2 hours to 75 minutes; when air temperature is above 90 deg F, reduce mixing and delivery time to 60 minutes.

PART 3 - EXECUTION

3.01 EMBEDDED ITEMS

- A. Place and secure anchorage devices and other embedded items required for adjoining work that is attached to or supported by cast-in-place concrete. Use setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
 - 1. Install anchor rods, accurately located, to elevations required and complying with tolerances in Section 7.5 of AISC's "Code of Standard Practice for Steel Buildings and Bridges."
 - 2. Install reglets to receive waterproofing and to receive through-wall flashings in outer face of concrete frame at exterior walls, where flashing is shown at lintels, shelf angles, and other conditions.
 - 3. Install dovetail anchor slots in concrete structures as indicated.

3.02 STEEL REINFORCEMENT

- A. General: Comply with CRSI's "Manual of Standard Practice" for placing reinforcement.
 - 1. Do not cut or puncture vapor retarder. Repair damage and reseal vapor retarder before placing concrete.
- B. Clean reinforcement of loose rust and mill scale, earth, ice, and other foreign materials that would reduce bond to concrete.
- C. Accurately position, support, and secure reinforcement against displacement. Locate and support reinforcement with bar supports to maintain minimum concrete cover. Do not tack weld crossing reinforcing bars.
 - 1. Weld reinforcing bars according to AWS D1.4, where indicated.
- D. Set wire ties with ends directed into concrete, not toward exposed concrete surfaces.
- E. Install welded wire reinforcement in longest practicable lengths on bar supports spaced to minimize sagging. Lap edges and ends of adjoining sheets at least one mesh spacing. Offset laps of adjoining sheet widths to prevent continuous laps in either direction. Lace overlaps with wire.

3.03 JOINTS

- A. General: Construct joints true to line with faces perpendicular to surface plane of concrete.
- B. Construction Joints: Install so strength and appearance of concrete are not impaired, at locations indicated or as approved by Architect.
 - 1. Place joints perpendicular to main reinforcement. Continue reinforcement across construction joints, unless otherwise indicated. Do not continue reinforcement through sides of strip placements of floors and slabs.
 - 2. Form keyed joints as indicated. Embed keys at least 1-1/2 inches into concrete.
 - 3. Locate joints for beams, slabs, joists, and girders in the middle third of spans. Offset joints in girders a minimum distance of twice the beam width from a beam-girder intersection.
 - 4. Locate horizontal joints in walls and columns at underside of floors, slabs, beams, and girders and at the top of footings or floor slabs.

5. Space vertical joints in walls as indicated. Locate joints beside piers integral with walls, near corners, and in concealed locations where possible.
 6. Use a bonding agent at locations where fresh concrete is placed against hardened or partially hardened concrete surfaces.
 7. Use epoxy-bonding adhesive at locations where fresh concrete is placed against hardened or partially hardened concrete surfaces.
- C. Contraction Joints in Slabs-on-Grade: See drawings for locations. Form weakened-plane contraction joints, sectioning concrete into areas as indicated. Construct contraction joints for a depth equal to at least one-fourth of concrete thickness as follows:
1. Grooved Joints: Form contraction joints after initial floating by grooving and finishing each edge of joint to a radius of 1/8 inch. Repeat grooving of contraction joints after applying surface finishes. Eliminate groover tool marks on concrete surfaces.
 2. Sawed Joints: Form contraction joints with power saws equipped with shatterproof abrasive or diamond-rimmed blades. Cut 1/8-inch wide joints into concrete when cutting action will not tear, abrade, or otherwise damage surface and before concrete develops random contraction cracks.
- D. Isolation Joints in Slabs-on-Grade: After removing formwork, install joint-filler strips at slab junctions with vertical surfaces, such as column pedestals, foundation walls, grade beams, and other locations, as indicated.
1. Extend joint-filler strips full width and depth of joint, terminating flush with finished concrete surface, unless otherwise indicated.
 2. Terminate full-width joint-filler strips not less than 1/2 inch or more than 1 inch below finished concrete surface where joint sealants, specified in Division 07 Section "Joint Sealants," are indicated.
 3. Install joint-filler strips in lengths as long as practicable. Where more than one length is required, lace or clip sections together.
- E. Doweled Joints: Install dowel bars and support assemblies at joints where indicated. Lubricate or asphalt coat one-half of dowel length to prevent concrete bonding to one side of joint.

3.04 WATERSTOPS

- A. Self-Expanding Strip Waterstops: Install in construction joints and at other locations indicated, according to manufacturer's written instructions, adhesive bonding, mechanically fastening, and firmly pressing into place. Install in longest lengths practicable.

3.05 CONCRETE PLACEMENT

- A. Before placing concrete, verify that installation of formwork, reinforcement, and embedded items is complete and that required inspections have been performed.
- B. Do not add water to concrete during delivery, at Project site, or during placement unless approved by Architect.
- C. Before test sampling and placing concrete, water may be added at Project site, subject to limitations of ACI 301.
1. Do not add water to concrete after adding high-range water-reducing admixtures to mixture.

- D. Deposit concrete continuously in one layer or in horizontal layers of such thickness that no new concrete will be placed on concrete that has hardened enough to cause seams or planes of weakness. If a section cannot be placed continuously, provide construction joints as indicated. Deposit concrete to avoid segregation.
1. Deposit concrete in horizontal layers of depth to not exceed formwork design pressures and in a manner to avoid inclined construction joints.
 2. Consolidate placed concrete with mechanical vibrating equipment according to ACI 301.
 3. Do not use vibrators to transport concrete inside forms. Insert and withdraw vibrators vertically at uniformly spaced locations to rapidly penetrate placed layer and at least 6 inches into preceding layer. Do not insert vibrators into lower layers of concrete that have begun to lose plasticity. At each insertion, limit duration of vibration to time necessary to consolidate concrete and complete embedment of reinforcement and other embedded items without causing mixture constituents to segregate.
- E. Deposit and consolidate concrete for floors and slabs in a continuous operation, within limits of construction joints, until placement of a panel or section is complete.
1. Consolidate concrete during placement operations so concrete is thoroughly worked around reinforcement and other embedded items and into corners.
 2. Maintain reinforcement in position on chairs during concrete placement.
 3. Screed slab surfaces with a straightedge and strike off to correct elevations.
 4. Slope surfaces uniformly to drains where required.
 5. Begin initial floating using bull floats or darbies to form a uniform and open-textured surface plane, before excess bleedwater appears on the surface. Do not further disturb slab surfaces before starting finishing operations.
- F. Cold-Weather Placement: Comply with ACI 306.1 and as follows. Protect concrete work from physical damage or reduced strength that could be caused by frost, freezing actions, or low temperatures.
1. When average high and low temperature is expected to fall below 40 deg F for three successive days, maintain delivered concrete mixture temperature within the temperature range required by ACI 301.
 2. Do not use frozen materials or materials containing ice or snow. Do not place concrete on frozen subgrade or on subgrade containing frozen materials.
 3. Do not use calcium chloride, salt, or other materials containing antifreeze agents or chemical accelerators unless otherwise specified and approved in mixture designs.
- G. Hot-Weather Placement: Comply with ACI 301 and as follows:
1. Maintain concrete temperature below 90 deg F at time of placement. Chilled mixing water or chopped ice may be used to control temperature, provided water equivalent of ice is calculated to total amount of mixing water. Using liquid nitrogen to cool concrete is Contractor's option.
 2. Fog-spray forms, steel reinforcement, and subgrade just before placing concrete. Keep subgrade uniformly moist without standing water, soft spots, or dry areas.
- H. After a rain event, the contractor must delay concrete placement for slabs on grade until the subgrade is dry. The contractor may use commercial air blowers to remove accumulated water.

3.06 FINISHING FORMED SURFACES

- A. Rough-Formed Finish: As-cast concrete texture imparted by form-facing material with tie holes and defects repaired and patched. Remove fins and other projections that exceed specified limits on formed-surface irregularities.
 - 1. Apply to concrete surfaces not exposed to public view.
- B. Smooth-Formed Finish: As-cast concrete texture imparted by form-facing material, arranged in an orderly and symmetrical manner with a minimum of seams. Repair and patch tie holes and defects. Remove fins and other projections that exceed specified limits on formed-surface irregularities.
 - 1. Apply to concrete surfaces exposed to public view or to be covered with a coating or covering material applied directly to concrete, such as waterproofing, dampproofing, veneer plaster, or painting.
- C. Rubbed Finish: Apply the following to smooth-formed finished as-cast concrete where indicated:
 - 1. Smooth-Rubbed Finish: Not later than one day after form removal, moisten concrete surfaces and rub with carborundum brick or another abrasive until producing a uniform color and texture. Do not apply cement grout other than that created by the rubbing process.
 - 2. Grout-Cleaned Finish: Wet concrete surfaces and apply grout of a consistency of thick paint to coat surfaces and fill small holes. Mix one part portland cement to one and one-half parts fine sand with a 1:1 mixture of bonding admixture and water. Add white portland cement in amounts determined by trial patches so color of dry grout will match adjacent surfaces. Scrub grout into voids and remove excess grout. When grout whitens, rub surface with clean burlap and keep surface damp by fog spray for at least 36 hours.
- D. Related Unformed Surfaces: At tops of walls, horizontal offsets, and similar unformed surfaces adjacent to formed surfaces, strike off smooth and finish with a texture matching adjacent formed surfaces. Continue final surface treatment of formed surfaces uniformly across adjacent unformed surfaces, unless otherwise indicated.

3.07 FINISHING FLOORS AND SLABS

- A. General: Comply with ACI 302.1R recommendations for screeding, re-straightening, and finishing operations for concrete surfaces. Do not wet concrete surfaces.
- B. Scratch Finish: While still plastic, texture concrete surface that has been screeded and bull-floated or darbied. Use stiff brushes, brooms, or rakes to produce a profile amplitude of 1/4 inch in 1 direction.
 - 1. Apply scratch finish to surfaces indicated and to receive concrete floor toppings or to receive mortar setting beds for ceramic or quarry tile, Portland cement terrazzo, and other bonded cementitious floor finishes.
- C. Float Finish: Consolidate surface with power-driven floats or by hand floating if area is small or inaccessible to power driven floats. Re-straighten, cut down high spots, and fill low spots. Repeat float passes and re-straightening until surface is left with a uniform, smooth, granular texture.

1. Apply float finish to surfaces indicated, to receive trowel finish, and to floor and slab surfaces to be covered with fluid-applied or sheet waterproofing, built-up or membrane roofing, or sand-bed terrazzo.
- D. Trowel Finish: After applying float finish, apply first troweling and consolidate concrete by hand or power-driven trowel. Continue troweling passes and re-straighten until surface is free of trowel marks and uniform in texture and appearance. Grind smooth any surface defects that would telegraph through applied coatings or floor coverings.
1. Apply a trowel finish to surfaces indicated and to floor and slab surfaces to be exposed to view or to be covered with resilient flooring, carpet, ceramic or quarry tile set over a cleavage membrane, paint, or another thin-film-finish coating system.
 2. Finish surfaces to the following tolerances, according to ASTM E 1155 for a randomly trafficked floor surface:
 - a. Specified overall values of flatness, F(F) 35; and of levelness, F(L) 25; with minimum local values of flatness, F(F) 24; and of levelness, F(L) 17; for slabs-on-grade.
 - b. Specified overall values of flatness, F(F) 45; and of levelness, F(L) 35; with minimum local values of flatness, F(F) 31; and of levelness, F(L) 24; for slab-on-grade in atrium lobby.
- E. Trowel and Fine-Broom Finish: Apply a first trowel finish to surfaces indicated or where ceramic or quarry tile is to be installed by either thickset or thin-set method. While concrete is still plastic, slightly scarify surface with a fine broom.
1. Comply with flatness and levelness tolerances for trowel finished floor surfaces.
- F. Broom Finish: Apply a broom finish to exterior concrete platforms, steps, and ramps, and elsewhere as indicated.
1. Immediately after float finishing, slightly roughen trafficked surface by brooming with fiber-bristle broom perpendicular to main traffic route. Coordinate required final finish with Architect before application.

3.08 MISCELLANEOUS CONCRETE ITEMS

- A. Filling In: Fill in holes and openings left in concrete structures, unless otherwise indicated, after work of other trades is in place. Mix, place, and cure concrete, as specified, to blend with in-place construction. Provide other miscellaneous concrete filling indicated or required to complete the Work.
- B. Curbs: Provide monolithic finish to interior curbs by stripping forms while concrete is still green and by steel-troweling surfaces to a hard, dense finish with corners, intersections, and terminations slightly rounded.
- C. Equipment Bases and Foundations: Provide machine and equipment bases and foundations as shown on Drawings. Set anchor bolts for machines and equipment at correct elevations, complying with diagrams or templates from manufacturer furnishing machines and equipment.
- D. Steel Pan Stairs: Provide concrete fill for steel pan stair treads, landings, and associated items. Cast-in inserts and accessories as shown on Drawings. Screed, tamp, and trowel-finish concrete surfaces.

3.09 CONCRETE PROTECTING AND CURING

- A. General: Protect freshly placed concrete from premature drying and excessive cold or hot temperatures. Comply with ACI 306.1 for cold-weather protection and ACI 301 for hot-weather protection during curing.
- B. Evaporation Retarder: Apply evaporation retarder to unformed concrete surfaces if hot, dry, or windy conditions cause moisture loss approaching 0.2 lb/sq. ft. x h before and during finishing operations. Apply according to manufacturer's written instructions after placing, screeding, and bull floating or darbying concrete, but before float finishing.
- C. Formed Surfaces: Cure formed concrete surfaces, including underside of beams, supported slabs, and other similar surfaces. If forms remain during curing period, moist cure after loosening forms. If removing forms before end of curing period, continue curing for the remainder of the curing period.
- D. Unformed Surfaces: Begin curing immediately after finishing concrete. Cure unformed surfaces, including floors and slabs, concrete floor toppings, and other surfaces.
- E. Cure concrete according to ACI 308.1, by one or a combination of the following methods:
 - 1. Moisture Curing: Keep surfaces continuously moist for not less than seven days with the following materials:
 - a. Water.
 - b. Continuous water-fog spray.
 - c. Absorptive cover, water saturated, and kept continuously wet. Cover concrete surfaces and edges with 12-inch lap over adjacent absorptive covers.
 - 2. Moisture-Retaining-Cover Curing: Cover concrete surfaces with moisture-retaining cover for curing concrete, placed in widest practicable width, with sides and ends lapped at least 12 inches and sealed by waterproof tape or adhesive. Cure for not less than seven days. Immediately repair any holes or tears during curing period using cover material and waterproof tape.
 - a. Moisture cure or use moisture-retaining covers to cure concrete surfaces to receive floor coverings.
 - b. Moisture cure or use moisture-retaining covers to cure concrete surfaces to receive penetrating liquid floor treatments.
 - c. Cure concrete surfaces to receive floor coverings with either a moisture-retaining cover or a curing compound that the manufacturer certifies will not interfere with bonding of floor covering used on Project.

3.10 JOINT FILLING

- A. Prepare, clean, and install joint filler according to manufacturer's written instructions.
 - 1. Defer joint filling until concrete has aged at least **six** months. Do not fill joints until construction traffic has permanently ceased.
- B. Remove dirt, debris, saw cuttings, curing compounds, and sealers from joints; leave contact faces of joint clean and dry.
- C. Install semi-rigid joint filler full depth in saw-cut joints and at least 2 inches deep in formed joints. Overfill joint and trim joint filler flush with top of joint after hardening.

3.11 CONCRETE SURFACE REPAIRS

- A. Defective Concrete: Repair and patch defective areas when approved by Architect. Remove and replace concrete that cannot be repaired and patched to Architect's approval.
- B. Patching Mortar: Mix dry-pack patching mortar, consisting of one part portland cement to two and one-half parts fine aggregate passing a No. 16 sieve, using only enough water for handling and placing.
- C. Repairing Formed Surfaces: Surface defects include color and texture irregularities, cracks, spalls, air bubbles, honeycombs, rock pockets, fins and other projections on the surface, and stains and other discolorations that cannot be removed by cleaning.
 - 1. Immediately after form removal, cut out honeycombs, rock pockets, and voids more than 1/2 inch in any dimension in solid concrete, but not less than 1 inch in depth. Make edges of cuts perpendicular to concrete surface. Clean, dampen with water, and brush-coat holes and voids with bonding agent. Fill and compact with patching mortar before bonding agent has dried. Fill form-tie voids with patching mortar or cone plugs secured in place with bonding agent.
 - 2. Repair defects on surfaces exposed to view by blending white portland cement and standard portland cement so that, when dry, patching mortar will match surrounding color. Patch a test area at inconspicuous locations to verify mixture and color match before proceeding with patching. Compact mortar in place and strike off slightly higher than surrounding surface.
 - 3. Repair defects on concealed formed surfaces that affect concrete's durability and structural performance as determined by Architect.
- D. Repairing Unformed Surfaces: Test unformed surfaces, such as floors and slabs, for finish and verify surface tolerances specified for each surface. Correct low and high areas. Test surfaces sloped to drain for trueness of slope and smoothness; use a sloped template.
 - 1. Repair finished surfaces containing defects. Surface defects include spalls, pop-outs, honeycombs, rock pockets, crazing and cracks in excess of 0.01 inch wide or that penetrate to reinforcement or completely through unreinforced sections regardless of width, and other objectionable conditions.
 - 2. After concrete has cured at least 14 days, correct high areas by grinding.
 - 3. Correct localized low areas during or immediately after completing surface finishing operations by cutting out low areas and replacing with patching mortar. Finish repaired areas to blend into adjacent concrete.
 - 4. Correct other low areas scheduled to receive floor coverings with a repair underlayment. Prepare, mix, and apply repair underlayment and primer according to manufacturer's written instructions to produce a smooth, uniform, plane, and level surface. Feather edges to match adjacent floor elevations.
 - 5. Correct other low areas scheduled to remain exposed with a repair topping. Cut out low areas to ensure a minimum repair topping depth of 1/4 inch to match adjacent floor elevations. Prepare, mix, and apply repair topping and primer according to manufacturer's written instructions to produce a smooth, uniform, plane, and level surface.
 - 6. Repair defective areas, except random cracks and single holes 1 inch or less in diameter, by cutting out and replacing with fresh concrete. Remove defective areas with clean, square cuts and expose steel reinforcement with at least a 3/4-inch clearance all around.

Dampen concrete surfaces in contact with patching concrete and apply bonding agent. Mix patching concrete of same materials and mixture as original concrete except without coarse aggregate. Place, compact, and finish to blend with adjacent finished concrete. Cure in same manner as adjacent concrete.

7. Repair random cracks and single holes 1 inch or less in diameter with patching mortar. Groove top of cracks and cut out holes to sound concrete and clean off dust, dirt, and loose particles. Dampen cleaned concrete surfaces and apply bonding agent. Place patching mortar before bonding agent has dried. Compact patching mortar and finish to match adjacent concrete. Keep patched area continuously moist for at least 72 hours.
- E. Perform structural repairs of concrete, subject to Architect's approval, using epoxy adhesive and patching mortar.
- F. Repair materials and installation not specified above may be used, subject to Architect's approval.

3.12 FIELD QUALITY CONTROL

- A. Testing and Inspecting: Owner will engage a qualified testing and inspecting agency to perform field tests and inspections, sample materials and prepare test reports.
- B. Inspections:
 1. Steel reinforcement placement.
 2. Steel reinforcement welding.
 3. Headed bolts and studs, hooked anchor bolts and other embedded steel anchors
 4. Monitor addition of water to concrete at job site and length of time concrete is allowed to remain in truck during pour.
 5. Certify each delivery ticket indicating class of concrete delivered (or poured), amount of water added and time at which cement and aggregate were discharged into truck, and time at which concrete was discharged from truck.
 6. Verification of use of required design mixture.
 7. Concrete placement, including conveying and depositing.
 8. Curing procedures and maintenance of curing temperature.
 9. Verification of concrete strength before removal of shores and forms from beams and slabs.
- C. Contractors Responsibilities:
 1. Furnish necessary labor to assist testing agency in obtaining and handling samples at job-site.
 2. Advise testing agency in advance of operations to allow for assignment of testing personnel and testing.
 3. Provide and maintain for use of testing agency adequate facilities for proper curing of concrete test specimens on project site in accordance with ASTM C31
- D. Concrete Tests: Testing of composite samples of fresh concrete obtained according to ASTM C 172 shall be performed according to the following requirements:
 1. Testing Frequency: Obtain one composite sample for each day's pour of each concrete mixture exceeding 5 cu. yd. but less than 25 cu. yd. plus one set for each additional 75 cu. yd. or fraction thereof.

- a. When frequency of testing will provide fewer than five compressive-strength tests for each concrete mixture, testing shall be conducted from at least five randomly selected batches or from each batch if fewer than five are used.
2. Slump: ASTM C 143/C 143M; one test at point of placement for each composite sample, but not less than one test for each day's pour of each concrete mixture. Test to be taken from sample at point of discharge from hose. Perform additional tests when concrete consistency appears to change.
3. Air Content: ASTM C 231, pressure method, for normal-weight concrete: one test for each composite sample, but not less than one test for each day's pour of each concrete mixture.
4. Concrete Temperature: ASTM C 1064/C 1064M; one test hourly when air temperature is 40 deg F and below and when 80 deg F and above, and one test for each composite sample.
5. Unit Weight: ASTM C 567, fresh unit weight of structural lightweight concrete; one test for each composite sample, but not less than one test for each day's pour of each concrete mixture.
6. Compression Test Specimens: ASTM C 31/C 31M.
 - a. Cast and laboratory cure two sets of two standard cylinder specimens for each composite sample.
 - b. Cast and field cure two sets of two standard cylinder specimens for each composite sample.
7. Compressive-Strength Tests: ASTM C 39/C 39M; test one set of two laboratory-cured specimens at 7 days and one set of two specimens at 28 days.
 - a. Test one set of two field-cured specimens at 7 days and one set of two specimens at 28 days.
 - b. A compressive-strength test shall be the average compressive strength from a set of two specimens obtained from same composite sample and tested at age indicated.
8. When strength of field-cured cylinders is less than 85 percent of companion laboratory-cured cylinders, Contractor shall evaluate operations and provide corrective procedures for protecting and curing in-place concrete.
9. Strength of each concrete mixture will be satisfactory if every average of any three consecutive compressive-strength tests equals or exceeds specified compressive strength and no compressive-strength test value falls below specified compressive strength by more than 500 psi
10. Test results shall be reported in writing to Architect, concrete manufacturer, and Contractor within 48 hours of testing. Reports of compressive-strength tests shall contain Project identification name and number, date of concrete placement, name of concrete testing and inspecting agency, location of concrete batch in Work, design compressive strength at 28 days, concrete mixture proportions and materials, compressive breaking strength, and type of break for both 7- and 28-day tests.
11. Concrete for which strength tests do not meet criteria for acceptance shall be considered inadequate until proven otherwise.
12. Completed concrete work will be accepted when the requirements of ACI 301, Chapter 18 have been complied with.
13. In any case, where strength tests of concrete fail to meet criteria specified herein, Architect shall be sole judge of structural adequacy of concrete. In such case, burden of proof of structural adequacy shall be responsibility of Contractor. Strength evaluation

shall conform to requirements of ACI 318. If strength evaluation testing indicates, in opinion of Architect, that structure is of inadequate strength; portions of structure in question shall be repaired or removed and replaced as directed by Architect at no additional expense to Owner. If strength tests fall below specified strength, but not so low as to cause concern for structural adequacy, Architect may request improved conditions of curing or modification of design mixes to improve strength.

14. Nondestructive Testing: Impact hammer, sonoscope, or other nondestructive device may be permitted by Architect but will not be used as sole basis for approval or rejection of concrete.
 15. Additional Tests: Testing and inspecting agency shall make additional tests of concrete when test results indicate that slump, air entrainment, compressive strengths, or other requirements have not been met, as directed by Architect. Testing and inspecting agency may conduct tests to determine adequacy of concrete by cored cylinders complying with ASTM C 42/C 42M or by other methods as directed by Architect.
 16. Additional testing and inspecting, at Contractor's expense, will be performed to determine compliance of replaced or additional work with specified requirements.
 17. Correct deficiencies in the Work that test reports and inspections indicate does not comply with the Contract Documents.
- E. Measure floor and slab flatness and levelness according to ASTM E 1155 within 48 hours of finishing.

END OF SECTION

PART 2 PRODUCTS

**SECTION 04 2000
UNIT MASONRY**

END OF SECTION

This page intentionally left blank

**SECTION 04 4313
STONE MASONRY VENEER**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Anchored cut stone veneer at exterior walls.
- B. Metal anchors and accessories for anchored veneer.
- C. Setting mortar.

1.02 RELATED REQUIREMENTS

- A. Section 04 2000 - Unit Masonry: Joint reinforcement, Ties, Anchors, and Through-wall flashing.
- B. Section 07 2500 - Weather Barriers: Water-resistive barrier over sheathing.
- C. Section 07 6200 - Sheet Metal Flashing and Trim: Flashings.
- D. Section 07 9200 - Joint Sealants: Sealing joints indicated to be left open for sealant.

1.03 REFERENCE STANDARDS

- A. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products; 2017.
- B. ASTM A580/A580M - Standard Specification for Stainless Steel Wire; 2023.
- C. ASTM A666 - Standard Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar; 2023.
- D. ASTM C119 - Standard Terminology Relating to Dimension Stone; 2022.
- E. ASTM C270 - Standard Specification for Mortar for Unit Masonry; 2019a, with Editorial Revision.
- F. ASTM C568/C568M - Standard Specification for Limestone Dimension Stone; 2022.
- G. ASTM C1242 - Standard Guide for Selection, Design, and Installation of Dimension Stone Attachment Systems; 2022a.
- H. ASTM C1515 - Standard Guide for Cleaning of Exterior Dimension Stone, Vertical And Horizontal Surfaces, New or Existing; 2020.
- I. ASTM C1528/C1528M - Standard Guide for Selection of Dimension Stone; 2020.
- J. ASTM C1714/C1714M - Standard Specification for Preblended Dry Mortar Mix for Unit Masonry; 2019a.
- K. ASTM E2556/E2556M - Standard Specification for Vapor Permeable Flexible Sheet Water-Resistive Barriers Intended for Mechanical Attachment; 2010 (Reapproved 2016).
- L. ICC (IBC) - International Building Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- M. TMS 402/602 - Building Code Requirements and Specification for Masonry Structures; 2022, with Errata.

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Preinstallation Meeting: Convene one week before starting work of this section.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data on stone units, mortar, and reinforcement.
- C. Samples: Submit two stone samples illustrating color range, texture, and markings.
- D. Samples: Submit mortar color samples.
- E. Stone Fabricator's Qualification Statement.
- F. Installer's Qualification Statement.

1.06 QUALITY ASSURANCE

- A. Stone Fabricator Qualifications: Company specializing in fabricating cut stone with minimum ten years of documented experience.
- B. Installer Qualifications: Company specializing in performing work of the type required by this section, with minimum five years of documented experience.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Protect stone from discoloration during storage on site.
- B. Provide ventilation to prevent condensation from forming on stone.

1.08 FIELD CONDITIONS

- A. Cold Weather Requirements: Comply with requirements of TMS 402/602 or applicable building code, whichever is more stringent.
- B. Maintain materials and ambient air at minimum of 40 degrees F (5 degrees C) prior to, during, and for 48 hours after completion of work.

PART 2 PRODUCTS

2.01 STONE

- A. Oolitic Limestone; complying with ASTM C568/C568M Classification II - Medium Density.
 - 1. Grade: ILI Standard.
 - 2. Color: to match existing.
 - 3. Grain Direction: to match existing.
 - 4. Surface Finish: to match existing.
 - 5. Acceptable Producers:
 - a. Alabama Stone Co; Veneer: www.vetterstone.com/#sle.
 - b. Continental Cut Stone, Inc: www.continentalcutstone.com/#sle.
 - c. Indiana Limestone Company: www.indianalimestonecompany.com/#sle.
 - d. Mezger Enterprises Ltd: www.mezger.com/#sle.
 - e. Substitutions: See Section 01 6000 - Product Requirements.

2.02 MORTAR APPLICATIONS

- A. At Contractor's option, mortar may be field-mixed from packaged dry materials, made from factory premixed dry materials with addition of water only, or ready-mixed.
- B. Mortar Color: to match existing.

2.03 MORTAR MIXES

- A. Packaged Dry Material for Mortar for Unit Masonry: Premixed Portland cement, hydrated lime, and sand; complying with ASTM C1714/C1714M and capable of producing mortar of the specified strength in accordance with ASTM C270 with the addition of water only.
 - 1. Type: Type S.
 - 2. Color: Mineral pigments added as required to produce approved color sample.
 - 3. Manufacturers:
 - a. Amerimix, an Oldcastle brand: www.amerimix.com/#sle.
 - b. The QUIKRETE Companies: www.quikrete.com/#sle.
 - c. Substitutions: See Section 01 6000 - Product Requirements.

2.04 ACCESSORIES - ANCHORED VENEER

- A. Anchors in Direct Contact with Stone: ASTM A666 Type 304, stainless steel, of sizes and configurations required for support of stone and applicable superimposed loads.
- B. Flashings: See Section 04 2000.
- C. Weeps: Molded PVC grille, insect resistant.
- D. Cavity Vents:
 - 1. Type: Polyester mesh.
 - 2. Color(s): As selected by architect from manufacturer's full range.

3. Manufacturers:
 - a. Hohmann & Barnard, Inc.: www.h-b.com/#sle.
 - b. Substitutions: See Section 01 6000 - Product Requirements.
- E. Cavity Mortar Control: Semi-rigid polyethylene or polyester mesh panels, sized to thickness of wall cavity, and designed to prevent mortar droppings from clogging weeps and cavity vents and allow proper cavity drainage.
 1. Mortar Diverter: Panels installed at flashing locations.
 - a. Manufacturers:
 - 1) Advanced Building Products, Inc.: www.advancebuildingproducts.com/#sle.
 - 2) CavClear/Archovations, Inc.: www.cavclear.com/#sle.
 - 3) Mortar Net Solutions; MortarNet: www.mortarnet.com/#sle.
 - 4) Substitutions: See Section 01 6000 - Product Requirements.
- F. Cleaning Solution: Type that will not harm stone, joint materials, or adjacent surfaces.

2.05 STONE FABRICATION - ANCHORED VENEER

- A. Pattern and Coursing: As indicated on drawings.
- B. Fabricate for 3/4 inch (19.05 mm) beds and joints.
- C. Bed and Joint Surfaces:
 1. Cut or sawn full square for full thickness of unit.
- D. Form stone corners to mitered joint profile. Clean jagged corners from stone in preparation for setting.
- E. Cut drip slot in bottom surface of work projecting more than 1/2 inch (13 mm) past face of wall or window frame. Size slot not less than 3/8 inch (10 mm) wide and 1/4 inch (6 mm) deep for full width of projection.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that support work and site conditions are ready to receive work of this section.
 1. Per ASTM C1242, exterior walls to receive thin natural stone veneers should be designed with a stiffness ratio of L/1000 minimum.
- B. Verify that items built-in under other sections are properly located and sized.

3.02 PREPARATION - ANCHORED VENEER

- A. Establish lines, levels, and coursing. Protect from disturbance.
- B. Clean stone prior to installation. Do not use wire brushes or implements that mark or damage exposed surfaces.
- C. Clean sawn surfaces of rust stains and iron particles.

3.03 INSTALLATION - ANCHORED VENEER

- A. Install flashings of longest practical length and seal watertight to back-up. Lap end joints minimum 6 inches (150 mm) and seal watertight.
- B. Size stone units to fit opening dimensions and perimeter conditions.
- C. Wet absorptive stone in preparation for placement to minimize moisture suction from mortar.
- D. Arrange stone pattern to provide color uniformity and minimize visual variations, and provide a uniform blend of stone unit sizes.
- E. Fill dowel holes in stone units with mortar.
- F. Set stone in full mortar setting bed to fully support stone over bearing surface. Use setting buttons or shims to maintain correct joint width.
- G. Install weep/cavity vents in vertical stone joints at 24 inches (609.6 mm) on center horizontally; immediately above horizontal flashings, above shelf angles and supports, and at top of each cavity space; do not permit mortar accumulation in cavity space.

3.04 REINFORCEMENT AND ANCHORAGE - ANCHORED VENEER

- A. Place horizontal joint reinforcement in first and second horizontal joints above and below openings. Extend minimum 16 inches (400 mm) each side of opening.
- B. Place joint reinforcement continuous in first and second joint below top of walls.
- C. Embed longitudinal wires of joint reinforcement in mortar joint with at least 5/8 inch mortar cover on each side.
- D. Lap joint reinforcement ends minimum 6 inches (150 mm).
- E. Attach wall ties to back-up to bond veneer to back-up at maximum 16 inches (400 mm) on center vertically and 36 inches (900 mm) on center horizontally.
- F. Reinforce stack bonded unit joint corners and intersections with strap anchors 16 inches (400 mm) on center.

3.05 JOINTS - ANCHORED VENEER

- A. Leave the following joints open for sealant; see Section 07 9200:
 - 1. Head joints in top courses, including copings, parapets, cornices, sills, and steps.
 - 2. Joints in projecting units.
 - 3. Joints between rigidly anchored units, including soffits, panels, and column covers.
 - 4. Joints below lugged sills and stair treads.
 - 5. Joints below ledge and relieving angles.
 - 6. Joints labeled "expansion joint".
- B. Pack mortar into joints and work into voids. Neatly tool surface to concave joint.
- C. At joints to be sealed, clean mortar out of joint before it sets. Brush joints clean.

3.06 INSTALLATION - WATER-RESISTIVE BARRIER

- A. Where required by thin stone veneer fabricator's instructions or by local codes, install two layers of water-resistive barrier in accordance with water-resistive barrier manufacturer's instructions. Integrate water-resistive barrier with all flashing accessories, adjacent water-resistive barriers, doors, windows, penetrations, and cladding transitions.
- B. Lap water-resistive barrier minimum 6 inches (152 mm) at vertical joints.

3.07 INSTALLATION - MASONRY FLASHINGS

- A. Whether or not specifically indicated, install masonry flashing to divert water to exterior at all locations where downward flow of water will be interrupted.
- B. Terminate flashing up 8 inches minimum on vertical surface of backing:
 - 1. Install vertical leg of flashing over fluid-applied or self-adhered air/vapor barriers over backing or per manufacturers directions.
 - 2. Anchor vertical leg of flashing into backing with a termination bar and sealant.
- C. Extend metal flashings through exterior face of stone and terminate in an angled drip with hemmed edge. Install joint sealer below drip edge to prevent moisture migration under flashing.
- D. Extend laminated flashings to within 1/2 inch (12 mm) of exterior face of stone and adhere to top of stainless steel angled drip with hemmed edge.
- E. Lap end joints of flashings at least 6 inches (152 mm), minimum, and seal watertight with flashing sealant/adhesive.

3.08 CAVITY MORTAR CONTROL

- A. Do not permit mortar to drop or accumulate into cavity air space or to plug weep/cavity vents.
- B. Install cavity mortar diverter at base of cavity and at other flashing locations as recommended by manufacturer to prevent mortar droppings from blocking weep/cavity vents.

3.09 CONTROL AND EXPANSION JOINTS

- A. Form joints as detailed on drawings.

3.10 TOLERANCES

- A. Maximum Variation From Unit to Adjacent Unit: 1/16 inch (1.6 mm).
- B. Maximum Variation from Plumb: 1/4 inch (6 mm) per story non-cumulative; 1/2 inch (13 mm) in two stories or more.
- C. Maximum Variation from Level Coursing: 1/8 inch in 3 feet (3 mm in 1 m) and 1/4 inch in 10 feet (6 mm in 3 m); 1/2 inch in 30 feet (13 mm in 9 m).
- D. Maximum Variation of Joint Thickness: 1/8 inch in 3 feet (3 mm in 1 m).

3.11 CLEANING

- A. Remove excess mortar as work progresses, and upon completion of work.
- B. Replace defective mortar. Match adjacent work.
- C. Clean soiled surfaces with cleaning solution.
- D. Use non-metallic tools in cleaning operations.

3.12 PROTECTION

- A. During temporary storage on site, at the end of working day, and during rainy weather, cover stone work exposed to weather with non-staining waterproof coverings, securely anchored.

END OF SECTION

This page intentionally left blank

**SECTION 05 1200
STRUCTURAL STEEL FRAMING**

PART 1 - GENERAL

1.01 SUMMARY

- A. Section includes structural steel and grout.

1.02 DEFINITIONS

- A. Structural Steel: Elements of structural-steel frame, as classified by AISC 303, "Code of Standard Practice for Steel Buildings and Bridges."

1.03 PERFORMANCE REQUIREMENTS

- A. Connections: Fabricator to design connections not designed or fully detailed on Contract Documents. Provide details of connections required by the Contract Documents to be selected or completed by structural-steel fabricator to withstand loads indicated and comply with other information and restrictions indicated.
 - 1. Select and complete connections using schematic details indicated and AISC's "Manual of Steel Construction, Load and Resistance Factor Design," Volume 2, Part 9 or AISC's "Manual of Steel Construction, Allowable Stress Design," Part 4.
 - 2. Engineering Responsibility: Fabricator's responsibilities include using a qualified professional engineer to prepare structural analysis data for structural-steel connections.

1.04 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: Show fabrication of structural-steel components.
- C. Qualification Data: For Installer, fabricator and testing agency.
- D. Welding certificates.
- E. Mill test reports for structural steel, including chemical and physical properties.
- F. Source quality-control reports.

1.05 QUALITY ASSURANCE

- A. Installer Qualifications: Not less than 10 years of experience in erection of structural steel for projects of similar size and complexity.
- B. Fabricator Qualifications: Not less than 10 years of experience in erection of structural steel for projects of similar size and complexity.
- C. Welding Qualifications: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."
- D. Comply with applicable provisions of the following specifications and documents:

1. AISC 303.
2. AISC 360.
3. RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts."

PART 2 - PRODUCTS

2.01 STRUCTURAL-STEEL MATERIALS

- A. W-Shapes: ASTM A 992/A 992M (Grade 50).
- B. Channels and Angles: ASTM A 36/A 36M.
- C. Plate and Bar: ASTM A 36/A 36M.
- D. Cold-Formed Hollow Structural Sections: ASTM A 500, Grade B, structural tubing.
- E. Steel Pipe: ASTM A 53/A 53M, Type E or S, Grade B.
- F. Welding Electrodes: Comply with AWS requirements.

2.02 BOLTS, CONNECTORS, AND ANCHORS

- A. High-Strength Bolts, Nuts, and Washers: Unless noted otherwise on Contract Documents, ASTM A 325, Type 1, heavy hex steel structural bolts; ASTM A 563 heavy hex carbon-steel nuts; and ASTM F 436 hardened carbon-steel washers. Plain finish.
- B. High-Strength Bolts, Nuts, and Washers: ASTM A 490, Type 1, heavy hex steel structural bolts; ASTM A 563 heavy hex carbon-steel nuts; and ASTM F 436 hardened carbon-steel washers, plain.
- C. Tension-Control, High-Strength Bolt-Nut-Washer Assemblies: ASTM F 1852, Type 1, heavy-hex head assemblies consisting of steel structural bolts with splined ends, heavy-hex carbon-steel nuts, and hardened carbon-steel washers.
 1. Finish: Plain.
- D. Shear Connectors: ASTM A 108, Grades 1015 through 1020, headed-stud type, cold-finished carbon steel; AWS D1.1/D1.1M, Type B.
- E. Un-headed Anchor Rods: ASTM F 1554, Grade as indicated on Contract Documents
- F. Headed Anchor Rods: ASTM F 1554, Grade 36, straight.
 1. Nuts: ASTM A 563 heavy hex carbon steel.
 2. Plate Washers: ASTM A 36/A 36M carbon steel.
 3. Washers: ASTM F 436 hardened carbon steel.
 4. Finish: Plain unless noted otherwise on the Contract Documents.
- G. Threaded Rods: ASTM A 36/A 36M.
 1. Nuts: ASTM A 563 heavy hex carbon steel.
 2. Washers: ASTM F 436 hardened carbon steel.
 3. Finish: Plain unless noted otherwise on the Contract Documents.

- H. Eye Bolts and Nuts: ASTM A 108, Grade 1030, cold-finished carbon steel.
- I. Sleeve Nuts: ASTM A 108, Grade 1018, cold-finished carbon steel.

2.03 PRIMER

- A. Universal Shop Primer: Fast-curing, lead- and chromate-free, universal modified-alkyd primer complying with MPI#79 and compatible with topcoat.
 - 1. Use primer containing pigments that make it easily distinguishable from zinc-rich primer.
- B. Shop Primer for Galvanized Steel: Primer formulated for exterior use over zinc-coated metal and compatible with finish paint systems indicated.

2.04 GROUT

- A. Metallic, Shrinkage-Resistant Grout: ASTM C 1107, factory-packaged, metallic aggregate grout, mixed with water to consistency suitable for application and a 30-minute working time.
- B. Nonmetallic, Shrinkage-Resistant Grout: ASTM C 1107, factory-packaged, nonmetallic aggregate grout, noncorrosive and nonstaining, mixed with water to consistency suitable for application and a 30-minute working time.

2.05 FABRICATION

- A. Structural Steel: Fabricate and assemble in shop to greatest extent possible. Fabricate according to AISC's "Code of Standard Practice for Steel Buildings and Bridges" and AISC 360.
- B. Shear Connectors: Prepare steel surfaces as recommended by manufacturer of shear connectors. Use automatic end welding of headed-stud shear connectors according to AWS D1.1/D1.1M and manufacturer's written instructions.

2.06 SHOP CONNECTIONS

- A. High-Strength Bolts: Shop install high-strength bolts according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts" for type of bolt and type of joint specified.
 - 1. Joint Type: Snug tightened.
- B. Weld Connections: Comply with AWS D1.1/D1.1M for tolerances, appearances, welding procedure specifications, weld quality, and methods used in correcting welding work.

2.07 SHOP PRIMING

- A. Shop prime steel surfaces except the following:
 - 1. Surfaces embedded in concrete or mortar. Extend priming of partially embedded members to a depth of 2 inches.
 - 2. Surfaces to be field welded.
 - 3. Surfaces to be high-strength bolted with slip-critical connections.
 - 4. Surfaces to receive sprayed fire-resistive materials (applied fireproofing).
 - 5. Galvanized surfaces.

- B. Surface Preparation: Clean surfaces to be painted. Remove loose rust and mill scale and spatter, slag, or flux deposits. Prepare surfaces according to the following specifications and standards:
 - 1. SSPC-SP 2, "Hand Tool Cleaning."
 - 2. SSPC-SP 3, "Power Tool Cleaning."
- C. Priming: Immediately after surface preparation, apply primer according to manufacturer's written instructions and at rate recommended by SSPC to provide a minimum dry film thickness of 1.5 mils. Use priming methods that result in full coverage of joints, corners, edges, and exposed surfaces.

2.08 GALVANIZING

- A. Hot-Dip Galvanized Finish: Apply zinc coating by the hot-dip process to structural steel according to ASTM A 123/ A 123M.
 - 1. Fill vent holes and grind smooth after galvanizing
 - 2. Galvanize lintels and shelf angles attached to structural-steel frame and located in exterior walls.

2.09 SOURCE QUALITY CONTROL

- A. Testing Agency: Owner will engage an independent testing and inspecting agency to perform shop tests and inspections and prepare test reports.
 - 1. Provide testing agency with access to places where structural-steel work is being fabricated or produced to perform tests and inspections.
- B. Correct deficiencies in Work that test reports and inspections indicate does not comply with the Contract Documents.
- C. Bolted Connections: Shop-bolted connections will be inspected according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts."
- D. Welded Connections: In addition to visual inspection, shop-welded connections will be tested and inspected according to AWS D1.1/D1.1M and the following inspection procedures, at testing agency's option:
 - 1. Liquid Penetrant Inspection: ASTM E 165.
 - 2. Magnetic Particle Inspection: ASTM E 709; performed on root pass and on finished weld. Cracks or zones of incomplete fusion or penetration will not be accepted.
 - 3. Ultrasonic Inspection: ASTM E 164.
 - 4. Radiographic Inspection: ASTM E 94.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify, with steel Erector present, elevations of concrete- and masonry-bearing surfaces and locations of anchor rods, bearing plates, and other embedments for compliance with requirements.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.02 ERECTION

- A. Set structural steel accurately in locations and to elevations indicated and according to AISC 303 and AISC 360.
- B. Base and Bearing Plates: Clean concrete- and masonry-bearing surfaces of bond-reducing materials, and roughen surfaces prior to setting plates. Clean bottom surface of plates.
 - 1. Set plates for structural members on wedges, shims, or setting nuts as required.
 - 2. Weld plate washers to top of baseplate.
 - 3. Snug-tighten anchor rods after supported members have been positioned and plumbed. Do not remove wedges or shims but, if protruding, cut off flush with edge of plate before packing with grout.
 - 4. Promptly pack grout solidly between bearing surfaces and plates so no voids remain. Neatly finish exposed surfaces; protect grout and allow to cure. Comply with manufacturer's written installation instructions for shrinkage-resistant grouts.
- C. Maintain erection tolerances of structural steel within AISC's "Code of Standard Practice for Steel Buildings and Bridges."

3.03 FIELD CONNECTIONS

- A. High-Strength Bolts: Install high-strength bolts according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts" for type of bolt and type of joint specified.
 - 1. Joint Type: Snug tightened.
- B. Weld Connections: Comply with AWS D1.1 for tolerances, appearances, welding procedure specifications, weld quality, and methods used in correcting welding work.
 - 1. Comply with AISC 303 and AISC 360 for bearing, alignment, adequacy of temporary connections, and removal of paint on surfaces adjacent to field welds.

3.04 FIELD QUALITY CONTROL

- A. Testing Agency: Owner will engage a qualified independent testing and inspecting agency to inspect field welds and high-strength bolted connections.
- B. Bolted Connections: Bolted connections will be tested and inspected according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts."
- C. Welded Connections: Field welds will be visually inspected according to AWS D1.1/D1.1M.
 - 1. In addition to visual inspection, field welds will be tested and inspected according to AWS D1.1/D1.1M and the following inspection procedures, at testing agency's option:
 - a. Liquid Penetrant Inspection: ASTM E 165.
 - b. Magnetic Particle Inspection: ASTM E 709; performed on root pass and on finished weld. Cracks or zones of incomplete fusion or penetration will not be accepted.
 - c. Ultrasonic Inspection: ASTM E 164.
 - d. Radiographic Inspection: ASTM E 94.
- D. Correct deficiencies in Work that test reports and inspections indicate does not comply with the Contract Documents.

END OF SECTION

**SECTION 05 4000
COLD-FORMED METAL FRAMING**

PART 1 - GENERAL

1.01 SUMMARY

- A. This Section includes the following:
 - 1. Exterior non-load-bearing wall framing.
 - 2. Exterior soffit framing.
 - 3. Interior locations as indicated on drawings.
 - a. Reference Architectural drawings for specific locations.

1.02 SUBMITTALS

- A. Product Data: For each type of product and accessory indicated.
- B. Submit design criteria prepared by the manufacturer/supplier for approval by the Architect/Structural Engineer. Design criteria shall include, but not be limited to the following:
 - 1. Wind speed and exposure as indicated in Structural Notes.
- C. Shop Drawings: Show layout, spacings, sizes, thicknesses, and types of cold-formed metal framing; fabrication; and fastening and anchorage details, including mechanical fasteners.
 - 1. For cold-formed metal framing indicated to comply with design loads, include structural analysis data signed and sealed by the qualified professional engineer responsible for their preparation.
- D. Submit calculations signed and sealed by licensed Professional Engineer in the state for which work is being performed.
- E. Welding certificates.
- F. Qualification data.
- G. Product test reports.
- H. Research/evaluation reports.

1.03 QUALITY ASSURANCE

- A. Testing Agency Qualifications: An independent testing agency, acceptable to authorities having jurisdiction, qualified according to ASTM E 329 to conduct the testing indicated.
- B. Product Tests: Mill certificates or data from a qualified independent testing agency indicating steel sheet complies with requirements.
- C. Welding: Qualify procedures and personnel according to AWS D1.3, "Structural Welding Code-Sheet Steel."

- D. Fire-Test-Response Characteristics: Where indicated, provide cold-formed metal framing identical to that of assemblies tested for fire resistance per ASTM E 119 by a testing and inspecting agency acceptable to authorities having jurisdiction.
- E. AISI Specifications and Standards: Comply with AISI's "North American Specification for the Design of Cold-Formed Steel Structural Members" and its "Standard for Cold-Formed Steel Framing - General Provisions."
 - 1. Comply with AISI's "Standard for Cold-Formed Steel Framing - Truss Design."
 - 2. Comply with AISI's "Standard for Cold-Formed Steel Framing - Header Design."

PART 2 - PRODUCTS

2.01 MANUFACTURERS

- A. Available Manufacturers: Subject to compliance with requirements, manufacturers offering cold-formed metal framing that may be incorporated into the Work include, but are not limited to, the following:
 - 1. Studs Unlimited
 - 2. California Expanded Metal Products Company.
 - 3. Clark Steel Framing.
 - 4. Consolidated Fabricators Corp.; Building Products Division.
 - 5. Dietrich Metal Framing; a Worthington Industries Company.
 - 6. MarinoWare; a division of Ware Industries.
 - 7. Quail Run Building Materials, Inc.
 - 8. SCAFCO Corporation.
 - 9. United Metal Products, Inc

2.02 MATERIALS

- A. Steel Sheet: ASTM A 1003/A 1003M, Structural Grade, Type H, metallic coated, of grade and coating weight as follows:
 - 1. Grade: ASTM A653. Minimum yield strength of 33 ksi (33,000 psi) with the exception that 16 gauge and heavier studs and joists shall have a minimum yield strength of 50 ksi.
 - 2. Coating: G60

2.03 EXTERIOR NON-LOAD-BEARING WALL FRAMING

- A. Steel Studs: Manufacturer's standard C-shaped steel studs, of web depths indicated, punched, with stiffened flanges, and as follows:
 - 1. Minimum Base-Metal Thickness: As indicated on Contract Documents and minimum of 18 gauge where masonry veneer occurs.
 - 2. Section Properties: As indicated on Contract Documents
- B. Steel Track: Manufacturer's standard U-shaped steel track, of web depths indicated, unpunched, with un-stiffened flanges, and as follows:
 - 1. Minimum Base-Metal Thickness: As indicated on the Contract Documents. Flange Width: 1-1/4.
- C. Vertical Deflection Clips: Manufacturer's standard bypass or head clips, capable of accommodating upward and downward vertical displacement of primary structure through positive mechanical attachment to stud web.

- D. Single Deflection Track: Manufacturer's single, deep-leg, U-shaped steel track; unpunched, with unstiffened flanges, of web depth to contain studs while allowing free vertical movement, with flanges designed to support horizontal and lateral loads.
- E. Double Deflection Tracks: Manufacturer's double, deep-leg, U-shaped steel tracks, consisting of nested inner and outer tracks; unpunched, with unstiffened flanges.

2.04 SOFFIT FRAMING

- A. Exterior Soffit Frame: Manufacturer's standard C-shaped steel sections, of web depths indicated, with stiffened flanges, and as follows:
- B. Minimum Base-Metal Thickness: As indicated on Contract Documents
- C. Section Properties: As indicated on Contract Documents.

2.05 FRAMING ACCESSORIES

- A. Fabricate steel-framing accessories from steel sheet, ASTM A 1003/A 1003M, Structural Grade, Type H, metallic coated, of same grade and coating weight used for framing members, unless otherwise indicated.
- B. Steel Shapes and Clips: ASTM A 36/A 36M, zinc coated by hot-dip process according to ASTM A 123/A 123M.
- C. Anchor Bolts: ASTM F 1554, Grade 36, threaded carbon-steel hex-headed bolts and carbon-steel nuts; and flat, hardened-steel washers; zinc coated by hot-dip process according to ASTM A 153/A 153M, Class C.
- D. Expansion Anchors: Fabricated from corrosion-resistant materials, with capability to sustain, without failure, a load equal to 5 times design load, as determined by testing per ASTM E 488 conducted by a qualified independent testing agency.
- E. Power-Actuated Anchors: Fastener system of type suitable for application indicated, fabricated from corrosion-resistant materials, with capability to sustain, without failure, a load equal to 5 times design load, as determined by testing per ASTM E 1190 conducted by a qualified independent testing agency.
- F. Mechanical Fasteners: ASTM C 1513, corrosion-resistant-coated, self-drilling, self-tapping steel drill screws.
 - 1. Head Type: Low-profile head beneath sheathing, manufacturer's standard elsewhere.

2.06 MISCELLANEOUS MATERIALS

- A. Galvanizing Repair Paint: SSPC-Paint 20 or DOD-P-21035.
- B. Cement Grout: Portland cement, ASTM C 150, Type I; and clean, natural sand, ASTM C 404. Mix at ratio of 1 part cement to 2-1/2 parts sand, by volume, with minimum water required for placement and hydration.
- C. Shims: Load bearing, high-density multimonomer plastic, nonleaching.

- D. Sealer Gaskets: Closed-cell neoprene foam, 1/4 inch thick, selected from manufacturer's standard widths to match width of bottom track or rim track members.

PART 3 - EXECUTION

3.01 PREPARATION

- A. Install load bearing shims or grout between the underside of wall bottom track or rim track and the top of foundation wall or slab at stud or joist locations to ensure a uniform bearing surface on supporting concrete or masonry construction.
- B. Install sealer gaskets to isolate the underside of wall bottom track or rim track and the top of foundation wall or slab at stud or joist locations.

3.02 INSTALLATION, GENERAL

- A. Install cold-formed metal framing according to AISI's "Standard for Cold-Formed Steel Framing - General Provisions" and to manufacturer's written instructions unless more stringent requirements are indicated.
- B. Install cold-formed metal framing and accessories plumb, square, and true to line, and with connections securely fastened.
- C. Install framing members in one-piece lengths.
- D. Install temporary bracing and supports to secure framing and support loads comparable in intensity to those for which structure was designed. Maintain braces and supports in place, undisturbed, until entire integrated supporting structure has been completed and permanent connections to framing are secured.
- E. Do not bridge building expansion and control joints with cold-formed metal framing. Independently frame both sides of joints.
- F. Install insulation, specified in Division 07 Section "Thermal Insulation," in built-up exterior framing members, such as headers, sills, boxed joists, and multiple studs at openings, that are inaccessible on completion of framing work.
- G. Fasten hole reinforcing plate over web penetrations that exceed size of manufacturer's standard punched openings.
- H. Erection Tolerances: Install cold-formed metal framing level, plumb, and true to line to a maximum allowable tolerance variation of 1/8 inch in 10 feet and as follows:
 - 1. Space individual framing members no more than plus or minus 1/8 inch from plan location. Cumulative error shall not exceed minimum fastening requirements of sheathing or other finishing materials.

3.03 EXTERIOR NON-LOAD-BEARING WALL INSTALLATION

- A. Install continuous tracks sized to match studs. Align tracks accurately and securely anchor to supporting structure as indicated.
- B. Fasten both flanges of studs to top and bottom track, unless otherwise indicated. Space studs as follows:

1. Stud Spacing: As indicated on the Contract Documents
- C. Set studs plumb, except as needed for diagonal bracing or required for nonplumb walls or warped surfaces and similar requirements.
- D. Isolate non-load-bearing steel framing from building structure to prevent transfer of vertical loads while providing lateral support.
 1. Install single deflection tracks and anchor to building structure.
 2. Install double deflection tracks and anchor outer track to building structure.
 3. Connect vertical deflection clips to bypassing or infill studs and anchor to primary building structure.
- E. Install horizontal bridging in wall studs, spaced in rows indicated on Shop Drawings but not more than 48 inches (1220 mm) apart. Fasten at each stud intersection.
 1. Top Bridging for Single Deflection Track: Install row of horizontal bridging within 12 inches of single deflection track. Install a combination of flat, taut, steel sheet straps of width and thickness indicated and stud or stud-track solid blocking of width and thickness matching studs. Fasten flat straps to stud flanges and secure solid blocking to stud webs or flanges.
 - a. Install solid blocking as indicated on the Contract Documents
 2. Bridging: Cold-rolled steel channel, welded or mechanically fastened to webs of punched studs.
 3. Bridging: Combination of flat, taut, steel sheet straps of width and thickness indicated and stud-track solid blocking of width and thickness to match studs. Fasten flat straps to stud flanges and secure solid blocking to stud webs or flanges.
 4. Bridging: Proprietary bridging bars installed according to manufacturer's written instructions.
- F. Install miscellaneous framing and connections, including stud kickers, web stiffeners, clip angles, continuous angles, anchors, fasteners, and stud girts, to provide a complete and stable curtain-wall-framing system.

3.04 FIELD QUALITY CONTROL

- A. Testing: Owner will engage a qualified independent testing and inspecting agency to perform field tests and inspections and prepare test reports.
- B. Field and shop welds will be subject to testing and inspecting.
- C. Testing agency will report test results promptly and in writing to Contractor and Architect.
- D. Remove and replace work where test results indicate that it does not comply with specified requirements.
- E. Additional testing and inspecting, at Contractor's expense, will be performed to determine compliance of replaced or additional work with specified requirements.

3.05 REPAIRS AND PROTECTION

- A. Galvanizing Repairs: Prepare and repair damaged galvanized coatings on fabricated and installed cold-formed metal framing with galvanized repair paint according to ASTM A 780 and manufacturer's written instructions.
- B. Provide final protection and maintain conditions, in a manner acceptable to manufacturer and Installer, that ensure that cold-formed metal framing is without damage or deterioration at time of Substantial Completion.

END OF SECTION

SECTION 05 5000 METAL FABRICATIONS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Shop fabricated aluminum items.

1.02 RELATED REQUIREMENTS

- A. Section 07 4646 - Fiber Cement Siding.
- B. Section 08 4343 - Aluminum-Framed Storefront: Storefront finish coordination.
- C. Section 09 9113 - Exterior Painting: Paint finish.

1.03 PRICE AND PAYMENT PROCEDURES

- A. See Section 01 2200 - Unit Prices, for additional requirements.
- B. Components:
 - 1. Basis of Measurement: By the pound (kg).
 - 2. Basis of Payment: Includes fabrication, finishing, and installation.

1.04 REFERENCE STANDARDS

- A. AAMA 611 - Voluntary Specification for Anodized Architectural Aluminum; 2020.
- B. AAMA 2603 - Voluntary Specification, Performance Requirements and Test Procedures for Pigmented Organic Coatings on Aluminum Extrusions and Panels (with Coil Coating Appendix); 2022.
- C. AAMA 2604 - Voluntary Specification, Performance Requirements and Test Procedures for High Performance Organic Coatings on Aluminum Extrusions and Panels (with Coil Coating Appendix); 2022.
- D. AAMA 2605 - Voluntary Specification, Performance Requirements and Test Procedures for Superior Performing Organic Coatings on Aluminum Extrusions and Panels (with Coil Coating Appendix); 2022.
- E. ASTM B209/B209M - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate; 2021a.
- F. SSPC-Paint 20 - Zinc-Rich Primers (Type I, "Inorganic," and Type II, "Organic"); 2002 (Ed. 2004).

PART 2 PRODUCTS

2.01 MATERIALS - ALUMINUM

- A. Sheet Aluminum: ASTM B209/B209M, 5052 alloy, H32 or H22 temper.

2.02 FABRICATION

- A. Fit and shop assemble items in largest practical sections, for delivery to site.
- B. Fabricate items with joints tightly fitted and secured.
- C. Grind exposed joints flush and smooth with adjacent finish surface. Make exposed joints butt tight, flush, and hairline. Ease exposed edges to small uniform radius.
- D. Conceal all mechanical fastenings.
- E. Furnish components required for anchorage of fabrications. Fabricate anchors and related components of same material and finish as fabrication, except where specifically noted otherwise.

2.03 FABRICATED ITEMS

- A. Aluminum Trim: Extruded aluminum alloy 6063-T5 temper.
 - 1. Finish: As indicated on drawings.
 - 2. Pattern: Provide trim in the longest continuous runs possible. Overlap any joints a minimum of 3". Align joints with the fiber cement panels, as indicated on drawings.

3. Fasteners: Sheet metal screws placed only in concealed locations; Space fasteners per manufacturer recommendation and to resist wind uplift.

2.04 FINISHES - ALUMINUM

- A. Exterior Aluminum Surfaces: superior performance organic coating.
- B. Superior Performance Organic Coating System: AAMA 2605 multiple coat, thermally cured polyvinylidene fluoride system; color as indicated.
 1. Manufacturers:
 - a. PPG; Duranar: www.ppgmetalcoatings.com/#sle.
 - b. Sherwin-Williams Company; Fluropon: www.coil.sherwin.com/#sle.
 - c. Substitutions: See Section 01 6000 - Product Requirements.
- C. Apply one coat of bituminous paint to concealed aluminum surfaces in contact with cementitious or dissimilar materials.

2.05 FABRICATION TOLERANCES

- A. Squareness: 1/8 inch (3 mm) maximum difference in diagonal measurements.
- B. Maximum Offset Between Faces: 1/16 inch (1.5 mm).
- C. Maximum Misalignment of Adjacent Members: 1/16 inch (1.5 mm).
- D. Maximum Bow: 1/8 inch (3 mm) in 48 inches (1.2 m).
- E. Maximum Deviation From Plane: 1/16 inch (1.5 mm) in 48 inches (1.2 m).

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field conditions are acceptable and are ready to receive work.

3.02 PREPARATION

- A. Clean and strip aluminum where site welding is required.

3.03 INSTALLATION

- A. Install items plumb and level, accurately fitted, free from distortion or defects.
- B. Provide for erection loads, and for sufficient temporary bracing to maintain true alignment until completion of erection and installation of permanent attachments.
- C. Obtain approval prior to site cutting or making adjustments not scheduled.

END OF SECTION

**SECTION 05 5213
PIPE AND TUBE RAILINGS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Free-standing railings at steps and ramps.

1.02 RELATED REQUIREMENTS

- A. Section 03 3000 - Cast-in-Place Concrete: Placement of anchors in concrete.

1.03 REFERENCE STANDARDS

- A. ADA Standards - 2010 ADA Standards for Accessible Design; 2010.
- B. AISC 201 - AISC Certification Program for Structural Steel Fabricators, Standard for Steel Building Structures; 2006.
- C. ASTM A53/A53M - Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless; 2012.
- D. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products; 2017.
- E. ASTM A500/A500M - Standard Specification for Cold-Formed Welded and Seamless Carbon Steel Structural Tubing in Rounds and Shapes; 2023.
- F. ASTM A501/A501M - Standard Specification for Hot-Formed Welded and Seamless Carbon Steel Structural Tubing; 2014.
- G. ASTM E935 - Standard Test Methods for Performance of Permanent Metal Railing Systems and Rails for Buildings; 2013.
- H. AWS A2.4 - Standard Symbols for Welding, Brazing, and Nondestructive Examination; 2020.
- I. AWS B2.1/B2.1M - Specification for Welding Procedure and Performance Qualification; 2021.
- J. AWS D1.1/D1.1M - Structural Welding Code - Steel; 2020, with Errata (2023).
- K. AWS D1.6/D1.6M - Structural Welding Code - Stainless Steel; 2007.
- L. AWS C3.4M/C3.4 - Specification for Torch Brazing; 2007.
- M. AWS C3.5M/C3.5 - Specification for Induction Brazing; 2016, with Amendment (2017).
- N. AWS C3.9M/C3.9 - Specification for Resistance Brazing; 2009.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Shop Drawings: Indicate profiles, sizes, connection attachments, anchorage, size and type of fasteners, and accessories.
 - 1. Indicate welded connections using standard AWS A2.4 welding symbols. Indicate net weld lengths.
 - 2. Include the design engineer's seal and signature on each sheet of shop drawings.
- C. Welders' Qualification Statement: Welders' certificates in accordance with AWS B2.1/B2.1M and dated within the previous 12 months.
- D. Designer's Qualification Statement.
- E. Fabricator's Qualification Statement.

1.05 QUALITY ASSURANCE

- A. Structural Designer Qualifications: Professional Structural Engineer experienced in design of this work and licensed in Oklahoma, or personnel under direct supervision of such an engineer.
- B. Welder Qualifications: Welding processes and welding operators qualified within previous 12 months.
- C. Fabricator Qualifications:

1. A qualified steel fabricator that is certified by the American Institute for Steel Construction (AISC) under AISC 201.

PART 2 PRODUCTS

2.01 RAILINGS - GENERAL REQUIREMENTS

- A. Design, fabricate, and test railing assemblies in accordance with the most stringent requirements of applicable local code.
- B. Allow for expansion and contraction of members and building movement without damage to connections or members.
- C. Dimensions: See drawings for configurations and heights.
- D. Provide anchors and other components as required to attach to structure, made of same materials as railing components unless otherwise indicated; where exposed fasteners are unavoidable provide flush countersunk fasteners.
- E. Provide slip-on non-weld mechanical fittings to join lengths, seal open ends, and conceal exposed mounting bolts and nuts, including but not limited to elbows, T-shapes, splice connectors, flanges, escutcheons, and wall brackets.
- F. Welded and Brazed Joints: Make visible joints butt tight, flush, and hairline; use methods that avoid discoloration and damage of finish; grind smooth, polish, and restore to required finish.
 1. Ease exposed edges to a small uniform radius.
 2. Welded Joints:
 - a. Carbon Steel: Perform welding in accordance with AWS D1.1/D1.1M.
 - b. Stainless Steel: Perform welding in accordance with AWS D1.6/D1.6M.
 3. Brass/Bronze Brazed Joints:
 - a. Perform torch brazing in accordance with AWS C3.4M/C3.4.
 - b. Perform induction brazing in accordance with AWS C3.5M/C 3.5.
 - c. Perform resistance brazing in accordance with AWS C3.9M/C3.9.

2.02 STEEL RAILING SYSTEM

- A. Non-Weld Mechanical Fittings: Slip-on, galvanized malleable iron castings, for Schedule 40 pipe, with flush setscrews for tightening by standard hex wrench, no bolts or screw fasteners.
- B. Exposed Fasteners: Flush countersunk screws or bolts; consistent with design of railing.
- C. Straight Splice Connectors: Steel concealed spigots.
- D. Galvanizing: In accordance with requirements of ASTM A123/A123M.
 1. Touch-Up Primer for Galvanized Surfaces: SSPC-Paint 20 Type I - Inorganic.

2.03 FABRICATION

- A. Accurately form components to suit specific project conditions and for proper connection to structure.
- B. Fit and shop assemble components in largest practical sizes for delivery to site.
- C. Fabricate components with joints tightly fitted and secured. Provide spigots and sleeves to accommodate site assembly and installation.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field conditions are acceptable and are ready to receive work.

3.02 PREPARATION

- A. Clean and strip primed steel items to bare metal where site welding is required.
- B. Supply items required to be cast into concrete or embedded in masonry with setting templates, for installation as work of other sections.

3.03 INSTALLATION

- A. Install in accordance with manufacturer's instructions.

- B. Install components plumb and level, accurately fitted, free from distortion or defects, with tight joints.
- C. Install railings in compliance with ADA Standards for accessible design at applicable locations.
- D. Field weld anchors as indicated on drawings. Touch-up welds with primer. Grind welds smooth.
- E. Conceal anchor bolts and screws whenever possible. Where not concealed, use flush countersunk fastenings.

3.04 TOLERANCES

- A. Maximum Variation From Plumb: 1/4 inch (6 mm) per floor level, non-cumulative.
- B. Maximum Offset From True Alignment: 1/4 inch (6 mm).
- C. Maximum Out-of-Position: 1/4 inch (6 mm).

END OF SECTION

This page intentionally left blank

SECTION 06 1000 ROUGH CARPENTRY

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Nonstructural dimension lumber framing.
- B. Rough opening framing for doors, windows, and roof openings.
- C. Preservative treated wood materials.
- D. Fire retardant treated wood materials.
- E. Miscellaneous framing and sheathing.
- F. Concealed wood blocking, nailers, and supports.
- G. Miscellaneous wood nailers, furring, and grounds.

1.02 RELATED REQUIREMENTS

- A. Section 07 2500 - Weather Barriers: Water-resistive barrier over sheathing.
- B. Section 07 6200 - Sheet Metal Flashing and Trim: Sill flashings.
- C. Section 09 2116 - Gypsum Board Assemblies: Gypsum-based sheathing.

1.03 REFERENCE STANDARDS

- A. ASTM A153/A153M - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware; 2023.
- B. ASTM C1177/C1177M - Standard Specification for Glass Mat Gypsum Substrate for Use as Sheathing; 2017.
- C. ASTM D2898 - Standard Practice for Accelerated Weathering of Fire-Retardant-Treated Wood for Fire Testing; 2010 (Reapproved 2017).
- D. ASTM D3273 - Standard Test Method for Resistance to Growth of Mold on the Surface of Interior Coatings in an Environmental Chamber; 2021.
- E. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2023a.
- F. AWPA U1 - Use Category System: User Specification for Treated Wood; 2023.
- G. ICC (IBC) - International Building Code; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- H. PS 1 - Structural Plywood; 2019.
- I. PS 20 - American Softwood Lumber Standard; 2021.

1.04 DELIVERY, STORAGE, AND HANDLING

- A. General: Cover wood products to protect against moisture. Support stacked products to prevent deformation and to allow air circulation.
- B. Fire Retardant Treated Wood: Prevent exposure to precipitation during shipping, storage, and installation.

PART 2 PRODUCTS

2.01 GENERAL REQUIREMENTS

- A. Dimension Lumber: Comply with PS 20 and requirements of specified grading agencies.
 - 1. If no species is specified, provide species graded by the agency specified; if no grading agency is specified, provide lumber graded by grading agency meeting the specified requirements.
 - 2. Grading Agency: Grading agency whose rules are approved by the Board of Review, American Lumber Standard Committee at www.alsc.org, and who provides grading service for the species and grade specified; provide lumber stamped with grade mark unless otherwise indicated.

2.02 DIMENSION LUMBER FOR CONCEALED APPLICATIONS

- A. Sizes: Nominal sizes as indicated on drawings, S4S.
- B. Moisture Content: S-dry or MC19.
- C. Miscellaneous Framing, Blocking, Nailers, Grounds, and Furring:
 - 1. Lumber: S4S, No. 2 or Standard Grade.
 - 2. Boards: Standard or No. 3.

2.03 CONSTRUCTION PANELS

- A. Wall Sheathing, For Exterior Walls: Glass mat faced gypsum, ASTM C1177/C1177M, 5/8 inch Type X fire resistant (16 mm Type X fire resistant).
 - 1. At Assemblies Indicated with Fire-Rating: Use type required by indicated tested assembly.
 - 2. Mold Resistance: Score of 10, when tested in accordance with ASTM D3273.
 - 3. Edges: Square.
 - 4. Products:
 - a. Georgia-Pacific Gypsum; DensGlass Sheathing: www.gpgypsum.com/#sle.
 - b. Gold Bond Building Products, LLC provided by National Gypsum Company; Gold Bond eXP Fire-Shield Sheathing: www.goldbondbuilding.com/#sle.
 - c. USG Corporation; Securock Brand Glass-Mat Sheathing Regular 5/8 in. (15.9 mm): www.usg.com/#sle.
- B. Communications and Electrical Room Mounting Boards: PS 1 A-D plywood, or medium density fiberboard; 3/4 inch (19 mm) thick; flame spread index of 25 or less, smoke developed index of 450 or less, when tested in accordance with ASTM E84.
- C. Other Applications:
 - 1. Plywood Concealed From View But Located Within Exterior Enclosure: PS 1, C-C Plugged or better, Exterior grade.
 - 2. Plywood Exposed to View But Not Exposed to Weather: PS 1, A-D, or better.
 - 3. Other Locations: PS 1, C-D Plugged or better.

2.04 ACCESSORIES

- A. Fasteners and Anchors:
 - 1. Metal and Finish: Hot-dipped galvanized steel complying with ASTM A153/A153M for high humidity and preservative-treated wood locations, unfinished steel elsewhere.
- B. Sill Gasket on Top of Foundation Wall: 1/4 inch (6 mm) thick, plate width, closed cell plastic foam from continuous rolls.
- C. Sill Flashing: See Section 07 6200.

2.05 FACTORY WOOD TREATMENT

- A. Treated Lumber and Plywood: Comply with requirements of AWWA U1 - Use Category System for wood treatments determined by use categories, expected service conditions, and specific applications.
 - 1. Fire-Retardant Treated Wood: Mark each piece of wood with producer's stamp indicating compliance with specified requirements.
 - 2. Preservative-Treated Wood: Provide lumber and plywood marked or stamped by an ALSC-accredited testing agency, certifying level and type of treatment in accordance with AWWA standards.
- B. Fire Retardant Treatment:
 - 1. Exterior Type: AWWA U1, Category UCFB, Commodity Specification H, chemically treated and pressure impregnated; capable of providing a maximum flame spread index of 25 when tested in accordance with ASTM E84, with no evidence of significant combustion when test is extended for an additional 20 minutes both before and after accelerated weathering test performed in accordance with ASTM D2898.
 - a. Kiln dry wood after treatment to a maximum moisture content of 19 percent for lumber and 15 percent for plywood.

- b. Treat exterior rough carpentry items.
 - c. Do not use treated wood in direct contact with the ground.
- 2. Interior Type A: AWP A U1, Use Category UCFA, Commodity Specification H, low temperature (low hygroscopic) type, chemically treated and pressure impregnated; capable of providing a maximum flame spread index of 25 when tested in accordance with ASTM E84, with no evidence of significant combustion when test is extended for an additional 20 minutes.
 - a. Kiln dry wood after treatment to a maximum moisture content of 19 percent for lumber and 15 percent for plywood.
 - b. Interior rough carpentry items are to be fire retardant treated.
 - c. Treat rough carpentry items as indicated .
 - d. Do not use treated wood in applications exposed to weather or where the wood may become wet.
- C. Preservative Treatment:
 - 1. Preservative Pressure Treatment of Lumber Above Grade: AWP A U1, Use Category UC3B, Commodity Specification A using waterborne preservative.
 - a. Kiln dry lumber after treatment to maximum moisture content of 19 percent.
 - b. Treat lumber exposed to weather.
 - c. Treat lumber in contact with roofing, flashing, or waterproofing.
 - d. Treat lumber in contact with masonry or concrete.
 - e. Treat lumber less than 18 inches (450 mm) above grade.

PART 3 EXECUTION

3.01 PREPARATION

- A. Coordinate installation of rough carpentry members specified in other sections.

3.02 INSTALLATION - GENERAL

- A. Select material sizes to minimize waste.
- B. Reuse scrap to the greatest extent possible; clearly separate scrap for use on site as accessory components, including: shims, bracing, and blocking.
- C. Where treated wood is used on interior, provide temporary ventilation during and immediately after installation sufficient to remove indoor air contaminants.

3.03 BLOCKING, NAILERS, AND SUPPORTS

- A. Provide framing and blocking members as indicated or as required to support finishes, fixtures, specialty items, and trim.
- B. In framed assemblies that have concealed spaces, provide solid wood fireblocking as required by applicable local code, to close concealed draft openings between floors and between top story and roof/attic space; other material acceptable to authorities having jurisdiction may be used in lieu of solid wood blocking.
- C. In metal stud walls, provide continuous blocking around door and window openings for anchorage of frames, securely attached to stud framing.
- D. In walls, provide blocking attached to studs as backing and support for wall-mounted items, unless item can be securely fastened to two or more studs or other method of support is explicitly indicated.
- E. Where ceiling-mounting is indicated, provide blocking and supplementary supports above ceiling, unless other method of support is explicitly indicated.

3.04 INSTALLATION OF CONSTRUCTION PANELS

- A. Wall Sheathing: Secure with long dimension perpendicular to wall studs, with ends over firm bearing and staggered, using nails, screws, or staples.
- B. Communications and Electrical Room Mounting Boards: Secure with screws to studs with edges over firm bearing; space fasteners at maximum 24 inches (610 mm) on center on all edges and into studs in field of board.

1. At fire-rated walls, install board over wall board indicated as part of the fire-rated assembly.
2. Where boards are indicated as full floor-to-ceiling height, install with long edge of board parallel to studs.
3. Install adjacent boards without gaps.

3.05 TOLERANCES

- A. Variation from Plane, Other than Floors: 1/4 inch in 10 feet (2 mm/m) maximum, and 1/4 inch in 30 feet (7 mm in 10 m) maximum.

3.06 CLEANING

- A. Waste Disposal: See Section 01 7419 - Construction Waste Management and Disposal.
 1. Comply with applicable regulations.
 2. Do not burn scrap on project site.
 3. Do not burn scraps that have been pressure treated.
 4. Do not send materials treated with pentachlorophenol, CCA, or ACA to co-generation facilities or "waste-to-energy" facilities.
- B. Do not leave wood, shavings, sawdust, etc. on the ground or buried in fill.
- C. Prevent sawdust and wood shavings from entering the storm drainage system.

END OF SECTION

SECTION 06 2000 FINISH CARPENTRY

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Finish carpentry items.

1.02 RELATED REQUIREMENTS

- A. Section 09 9123 - Interior Painting: Painting of finish carpentry items.

1.03 REFERENCE STANDARDS

- A. NHLA G-101 - Rules for the Measurement and Inspection of Hardwood and Cypress; 2023.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data:
 - 1. Provide manufacturer's product data, storage and handling instructions for factory-fabricated units.
 - 2. Provide instructions for attachment hardware.
- C. Shop Drawings: Indicate materials, component profiles, fastening methods, jointing details, and accessories.
 - 1. Scale of Drawings: 1-1/2 inch to 1 foot (125 mm to 1 m), minimum.
- D. Samples: Submit two samples of finish wood paneling, 6x6 inch (____x____ mm) in size illustrating wood grain and specified finish.

1.05 QUALITY ASSURANCE

- A. Fabricator Qualifications: Company specializing in fabricating the products specified in this section with minimum five years of documented experience.
 - 1. Company with at least one project within the past 5 years with value of woodwork within 20 percent of cost of woodwork for this project.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Deliver factory-fabricated units to project site in original packages, containers or bundles bearing brand name and identification.
- B. Store finish carpentry items under cover, elevated above grade, and in a dry, well-ventilated area not exposed to heat or sunlight.
- C. Protect from moisture damage.

PART 2 PRODUCTS

2.01 FINISH CARPENTRY ITEMS

- A. Interior Woodwork Items:
 - 1. Wood Paneling (Type WP1)
 - a. Basis of Design: Solid Wood Tambour as manufactured by Surfacing Solution, www.surfacing-solution.com
 - 1) Species: White Oak
 - 2) Wood Profile: T693 - Slat width of 1-1/2 inches and height of 3/4 inches
 - 3) Field Finish: transparent, refer 09 9123 Interior Painting.
 - 2. Moldings, Casings, and Miscellaneous Trim: White oak to match WP1; prepare for transparent finish.

2.02 LUMBER MATERIALS

- A. Hardwood Lumber: white oak species, quarter sawn, maximum moisture content of 6 percent ; with vertical grain , of quality suitable for transparent finish.
 - 1. Grading: In accordance with NHLA G-101 Grading Rules; www.nhla.org.

2.03 FASTENINGS

- A. Fasteners: Of size and type to suit application; to be concealing in all locations.

2.04 ACCESSORIES

- A. Adhesive: Type recommended by fabricator to suit application.
- B. Lumber for Shimming and Blocking: Softwood lumber of indicated species.
- C. Wood Filler: Solvent base, tinted to match surface finish color.

2.05 FABRICATION

- A. Shop assemble work for delivery to site, permitting passage through building openings.
- B. When necessary to cut and fit on site, provide materials with ample allowance for cutting. Provide trim for scribing and site cutting.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify adequacy of backing and support framing.
- B. Verify mechanical, electrical, and building items affecting work of this section are placed and ready to receive this work.

3.02 INSTALLATION

- A. Install WP1 in accordance to manufacturer's guidelines.
- B. Set and secure materials and components in place, plumb and level.
- C. Carefully scribe work abutting other components, with maximum gaps of 1/32 inch (0.79 mm). Do not use additional overlay trim to conceal larger gaps.

3.03 PREPARATION FOR SITE FINISHING

- A. Set exposed fasteners. Apply wood filler in exposed fastener indentations. Sand work smooth.
- B. Site Finishing: See Section 09 9123.

3.04 TOLERANCES

- A. Maximum Variation from True Position: 1/16 inch (1.6 mm).
- B. Maximum Offset from True Alignment with Abutting Materials: 1/32 inch (0.79 mm).

END OF SECTION

**SECTION 06 4100
ARCHITECTURAL WOOD CASEWORK**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Specially fabricated cabinet units.
- B. Hardware.

1.02 RELATED REQUIREMENTS

- A. Section 12 3600 - Countertops.

1.03 REFERENCE STANDARDS

- A. ANSI A208.1 - American National Standard for Particleboard; 2022.
- B. AWI (QCP) - Quality Certification Program; Current Edition.
- C. AWI/AWMAC/WI (AWS) - Architectural Woodwork Standards, 2nd Edition; 2014, with Errata (2016).
- D. AWMAC/WI (NAAWS) - North American Architectural Woodwork Standards; 2021, with Errata.
- E. BHMA A156.9 - Cabinet Hardware; 2020.
- F. NEMA LD 3 - High-Pressure Decorative Laminates; 2005.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Shop Drawings: Indicate materials, component profiles, fastening methods, jointing details, and accessories.
 - 1. Scale of Drawings: 1-1/2 inch to 1 foot (125 mm to 1 m), minimum.
- C. Samples: Submit samples of cabinet finishes, 6" x 6" minimal size, for final approval
- D. Product Data: Provide data for hardware accessories.

1.05 QUALITY ASSURANCE

- A. Fabricator Qualifications: Company specializing in fabricating the products specified in this section with minimum five years of documented experience.
 - 1. Accredited participant in the specified certification program prior to the commencement of fabrication and throughout the duration of the project.
- B. Quality Certification:
 - 1. Comply with AWI (QCP) woodwork association quality certification service/program in accordance with requirements for work specified in this section: www.awiqcp.org/#sle.

1.06 FIELD CONDITIONS

- A. During and after installation of custom cabinets, maintain temperature and humidity conditions in building spaces at same levels planned for occupancy.

PART 2 PRODUCTS

2.01 CABINETS

- A. Quality Standard: Custom Grade, in accordance with AWI/AWMAC/WI (AWS) or AWMAC/WI (NAAWS), unless noted otherwise.
- B. Plastic Laminate Faced Cabinets: Custom grade.
- C. Cabinets:
 - 1. Finish - Exposed Exterior Surfaces: Decorative laminate.
 - 2. Finish - Exposed Interior Surfaces: Decorative laminate.
 - 3. Finish - Semi-Exposed Surfaces: Decorative laminate
 - 4. Finish - Concealed Surfaces: Manufacturer's option.
 - 5. Door and Drawer Front Edge Profiles: Square edge with thin applied band.
 - 6. Casework Construction Type: Type A - Frameless.

7. Cabinet Design Series: As indicated on drawings.
8. Adjustable Shelf Loading: 40 psf (19.5 gm/sq cm).

2.02 WOOD-BASED COMPONENTS

- A. Wood fabricated from old growth timber is not permitted.

2.03 PANEL CORE MATERIALS

- A. Particleboard: Composite panel composed of cellulosic particles, additives, and bonding system; comply with ANSI A208.1.
 1. Grade: M-2; moisture resistance: MR10.
 2. Panel Thickness: 3/4 inch (19.1 mm).

2.04 LAMINATE MATERIALS

- A. Manufacturers:
 1. Wilsonart LLC: www.wilsonart.com/#sle.
 2. Substitutions: See Section 01 6000 - Product Requirements.
- B. High Pressure Decorative Laminate (HPDL): NEMA LD 3, types as recommended for specific applications.
- C. Provide specific types as indicated.
 1. Horizontal Surfaces: HGS, 0.048 inch (1.22 mm) nominal thickness, through color, finish as indicated.
 2. Vertical Surfaces: VGS, 0.028 inch (0.71 mm) nominal thickness, through color, finish as indicated.

2.05 COUNTERTOPS

- A. Countertops: See Section 12 3600.

2.06 ACCESSORIES

- A. Adhesive: Type recommended by fabricator to suit application.
- B. Plastic Edge Banding: Extruded PVC, convex shaped; smooth finish; self locking serrated tongue; of width to match component thickness.
- C. Bolts, Nuts, Washers, Lags, Pins, and Screws: Of size and type to suit application; galvanized or chrome-plated finish in concealed locations and stainless steel or chrome-plated finish in exposed locations.
- D. Concealed Joint Fasteners: Threaded steel.

2.07 HARDWARE

- A. Hardware: BHMA A156.9, types as recommended by fabricator for quality grade specified.
- B. Adjustable Shelf Supports: Standard side-mounted system using recessed metal shelf standards or multiple holes for pin supports and coordinated self rests, satin chrome finish, for nominal 1 inch (25 mm) spacing adjustments.
- C. Countertop Support Brackets: Fixed, L-shaped, face-of-stud mounting.
 1. Materials: Steel; T-shape cross-section.
 - a. Finish: Manufacturer's standard, factory-applied, powder coat.
 - b. Color: White.
 - c. Size: as indicated in the drawings
 2. Products:
 - a. A&M Hardware, Inc; Hybrid Brackets: www.aandmhardware.com/#sle.
 - b. Substitutions: See Section 01 6000 - Product Requirements.
- D. Drawer and Door Pulls: "U" shaped wire pull, steel with satin finish, 4 inch centers ("U" shaped wire pull, steel with satin finish, 100 mm centers).
- E. Keyed Cabinet Locks: Keyed cylinder, two keys per lock, master keyed, steel with satin finish.
- F. Drawer Slides:
 1. Type: Extension types as indicated.

2. Static Load Capacity: Commercial grade.
 3. Mounting: Side mounted.
 4. Stops: Integral type.
- G. Hinges: European style concealed self-closing type, steel with nickel-plated finish.
- H. Push fittings - at removable panels on ADA sink shrouds
1. Keku Push-in Fittings as manufactured by Hafele, www.hafele.com
 - a. Substitutions: See Section 01 6000 - Product Requirements

2.08 FABRICATION

- A. Assembly: Shop assemble cabinets for delivery to site in units easily handled and to permit passage through building openings.
- B. Edging: Fit shelves, doors, and exposed edges with specified edging. Do not use more than one piece for any single length.
- C. Fitting: When necessary to cut and fit on site, provide materials with ample allowance for cutting. Provide matching trim for scribing and site cutting.
- D. Plastic Laminate: Apply plastic laminate finish in full uninterrupted sheets consistent with manufactured sizes. Fit corners and joints hairline; secure with concealed fasteners. Slightly bevel arises. Locate counter butt joints minimum 2 feet from sink cut-outs. (Locate counter butt joints minimum 600 mm from sink cut-outs.)
- E. Provide cutouts for plumbing fixtures. Verify locations of cutouts from on-site dimensions. Prime paint cut edges.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify adequacy of backing and support framing.
- B. Verify location and sizes of utility rough-in associated with work of this section.

3.02 INSTALLATION

- A. Install work in accordance with AWI/AWMAC/WI (AWS) or AWMAC/WI (NAAWS) requirements for grade indicated.
- B. Set and secure custom cabinets in place, assuring that they are rigid, plumb, and level.
- C. Secure cabinets to floor using appropriate angles and anchorages.

3.03 ADJUSTING

- A. Adjust installed work.

3.04 CLEANING

- A. Clean casework, counters, shelves, hardware, fittings, and fixtures.

END OF SECTION

This page intentionally left blank

**SECTION 06 8316
FIBERGLASS REINFORCED PANELING**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fiberglass reinforced plastic panels.
- B. Trim.

1.02 REFERENCE STANDARDS

- A. ASTM D256 - Standard Test Methods for Determining the Izod Pendulum Impact Resistance of Plastics; 2023, with Editorial Revision.
- B. ASTM D3273 - Standard Test Method for Resistance to Growth of Mold on the Surface of Interior Coatings in an Environmental Chamber; 2021.
- C. ASTM D5319 - Standard Specification for Glass-Fiber Reinforced Polyester Wall and Ceiling Panels; 2022.
- D. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2023a.
- E. FDA Food Code - Chapter 6 - Physical Facilities; Current Edition.
- F. ISO 2812-1 - Paints and Varnishes -- Determination of Resistance to Liquids -- Part 1: Immersion in Liquids Other than Water; 2017.

1.03 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data on specified products, describing physical and performance characteristics; including sizes, patterns and colors available; and installation instructions.

1.04 DELIVERY, STORAGE, AND HANDLING

- A. Store panels flat, indoors, on a clean, dry surface. Remove packaging and allow panels to acclimate to room temperature for 48 hours prior to installation.

PART 2 PRODUCTS

2.01 PANEL SYSTEMS

- A. Wall Panels:
 - 1. Panel Size: 4 by 8 feet (1.2 by 2.4 m).
 - 2. Panel Thickness: 0.10 inch (2.5 mm).
 - 3. Surface Design: Embossed.
 - 4. Color: White.
 - 5. Attachment Method: Mechanical fasteners concealed by trim, with sealant in joints.

2.02 MATERIALS

- A. Panels: Fiberglass reinforced plastic (FRP), complying with ASTM D5319.
 - 1. Surface Burning Characteristics: Maximum flame spread index of 25 and smoke developed index of 450; when system tested in accordance with ASTM E84.
 - 2. Mold Resistance: Score of 10, when tested in accordance with ASTM D3273.
 - 3. Impact Strength: Greater than 6 ft lb force per inch (320 J per m), when tested in accordance with ASTM D256.
 - 4. Surface Characteristics and Cleanability: Provide products that are smooth, durable, and easily cleanable, in compliance with FDA Food Code, Chapter 6 - Physical Facilities.
 - 5. Chemical Cleanability: Excellent chemical resistance to common cleaners and detergents when tested in accordance with ISO 2812-1.
- B. Trim: Vinyl; color coordinating with panel.
- C. Fasteners: Nylon rivets.
- D. Sealant: Type recommended by panel manufacturer; white.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions and substrate flatness before starting work.
- B. Verify that substrate conditions are ready to receive the work of this section.

3.02 INSTALLATION - WALLS

- A. Install panels in accordance with manufacturer's instructions.
- B. Cut and drill panels with carbide tipped saw blades, drill bits, or snips.
- C. Pre-drill fastener holes in panels, 1/8 inch (3.2 mm) greater in diameter than fastener, spaced as indicated by panel manufacturer.
- D. Apply adhesive to the back side of the panel using trowel as recommended by adhesive manufacturer.
- E. Apply panels to wall with seams plumb and pattern aligned with adjoining panels.
- F. Install panels with manufacturer's recommended gap for panel field and corner joints.
- G. Drive fasteners to provide snug fit, and do not over-tighten.
- H. Place trim on panel before fastening edges, as required.
- I. Fill channels in trim with sealant before attaching to panel.
- J. Install trim with adhesive and screws or nails, as required.
- K. Seal gaps at floor, ceiling, and between panels with applicable sealant to prevent moisture intrusion.
- L. Remove excess sealant after paneling is installed and prior to curing.

END OF SECTION

SECTION 07 2100 THERMAL INSULATION

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Board insulation at exterior wall behind fiber cement wall finish.
- B. Batt insulation in exterior wall, ceiling, and roof construction.
- C. Batt insulation for filling perimeter window and door shim spaces and crevices in exterior wall and roof.

1.02 RELATED REQUIREMENTS

- A. Section 072500 - Weather Barriers: Separate weather barrier materials

1.03 REFERENCE STANDARDS

- A. ASTM C240 - Standard Test Methods for Testing Cellular Glass Insulation Block; 2021.
- B. ASTM C423 - Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method; 2023.
- C. ASTM C518 - Standard Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter Apparatus; 2021.
- D. ASTM C578 - Standard Specification for Rigid, Cellular Polystyrene Thermal Insulation; 2023.
- E. ASTM C665 - Standard Specification for Mineral-Fiber Blanket Thermal Insulation for Light Frame Construction and Manufactured Housing; 2023.
- F. ASTM C1338 - Standard Test Method for Determining Fungi Resistance of Insulation Materials and Facings; 2019 (Reapproved 2022).
- G. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2023a.
- H. ASTM E136 - Standard Test Method for Assessing Combustibility of Materials Using a Vertical Tube Furnace at 750 °C; 2022.
- I. ASTM E2357 - Standard Test Method for Determining Air Leakage Rate of Air Barrier Assemblies; 2023a.
- J. NFPA 285 - Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Wall Assemblies Containing Combustible Components; 2023.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide data on product characteristics, performance criteria, and product limitations.
- C. Manufacturer's Certificate: Certify that products meet or exceed specified requirements.
- D. Manufacturer's Installation Instructions: Include information on special environmental conditions required for installation and installation techniques.

1.05 FIELD CONDITIONS

- A. Do not install insulation adhesives when temperature or weather conditions are detrimental to successful installation.

PART 2 PRODUCTS

2.01 APPLICATIONS

- A. Insulation on Outside of Existing Concrete and Masonry Exterior Walls: Expanded polystyrene (EPS) board.
- B. Insulation in Metal Framed Walls: Batt insulation with no vapor retarder.

2.02 FOAM BOARD INSULATION MATERIALS

- A. Expanded Polystyrene (EPS) Board Insulation: Comply with ASTM C578.
 - 1. Flame Spread Index (FSI): Class A - 0 to 25, when tested in accordance with ASTM E84.
 - 2. Smoke Developed Index (SDI): 450 or less, when tested in accordance with ASTM E84.
 - 3. Board Thickness: 2 inch (51 mm).
 - 4. Board Edges: Square.
 - 5. Type and Water Absorption: Type I, 4.0 percent by volume, maximum, by total immersion.
 - 6. Type and Thermal Resistance, R-value (RSI-value): Type I, 3.6 (0.63), minimum, per 1 inch (25.4 mm) thickness at 75 degrees F (24 degrees C) mean temperature.
 - 7. Products:
 - a. Atlas Molded Products, a Division of Atlas Roofing Corporation; ThermalStar EPS Wall Insulation Board: www.atlasmoldedproducts.com/#sle.
 - b. InsulFoam LLC; InsulFoam Unfaced Foam: www.insulfoam.com/#sle.
 - c. Substitutions: See Section 01 6000 - Product Requirements.

2.03 BATT INSULATION MATERIALS

- A. Flexible Glass Fiber Blanket Thermal Insulation: Preformed insulation, complying with ASTM C665; friction fit.
 - 1. Flame Spread Index: 25 or less, when tested in accordance with ASTM E84.
 - 2. Smoke Developed Index: 450 or less, when tested in accordance with ASTM E84.
 - 3. Combustibility: Non-combustible, when tested in accordance with ASTM E136, except for facing, if any.
 - 4. Formaldehyde Content: Zero.
 - 5. Thermal Resistance: R-value (RSI-value) of 13.5.
 - 6. Facing: Unfaced.
 - 7. Products:
 - a. CertainTeed Corporation: www.certainteed.com/#sle.
 - b. Johns Manville: www.jm.com/#sle.
 - c. Owens Corning Corporation: www.ocbuildingspec.com/#sle.
 - d. Substitutions: See Section 01 6000 - Product Requirements.

2.04 ACCESSORIES

- A. Tape: Manufacturer's recommended tape.
- B. Insulation Fasteners: Impaling clip of unfinished steel with washer retainer and clips, to be adhered to surface to receive insulation, length to suit insulation thickness and substrate, capable of securely and rigidly fastening insulation in place.
- C. Nails or Staples: Steel wire; electroplated or galvanized; type and size to suit application.
- D. Adhesive: Type recommended by insulation manufacturer for application.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that substrate, adjacent materials, and insulation materials are dry and that substrates are ready to receive insulation and adhesive.
- B. Verify substrate surfaces are flat, free of honeycomb, fins, irregularities, or materials or substances that may impede adhesive bond.

3.02 BOARD INSTALLATION AT EXTERIOR WALLS

- A. Install boards horizontally on walls.
 - 1. Install in running bond pattern.
 - 2. Butt edges and ends tightly to adjacent boards and protrusions.
- B. Cut and fit insulation tightly to protrusions or interruptions to the insulation plane.
- C. Tape insulation board joints in accordance insulation manufacturers' instructions.

3.03 BATT INSTALLATION

- A. Install insulation in accordance with manufacturer's instructions.
- B. Install in exterior wall spaces without gaps or voids. Do not compress insulation.
- C. Trim insulation neatly to fit spaces. Insulate miscellaneous gaps and voids.
- D. Fit insulation tightly in cavities and tightly to exterior side of mechanical and electrical services within the plane of the insulation.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements for additional requirements.

3.05 PROTECTION

- A. Do not permit installed insulation to be damaged prior to its concealment.

END OF SECTION

This page intentionally left blank

SECTION 07 2500

WEATHER BARRIER, FLUID-APPLIED MEMBRANE AIR BARRIERS, VAPOR PERMEABLE

PART 1 GENERAL

1.01 SUMMARY

- A. This Section includes the following:
 - 1. Materials and installation methods for fluid-applied, vapor permeable air barrier membrane system located in the non-accessible part of the wall.
 - 2. Materials and installation methods to bridge and seal air leakage pathways in roof and foundation junctions, window and door openings, control and expansion joints, masonry ties, piping and other penetrations through the wall assembly.

1.02 RELATED SECTIONS:

- A. Section 04 2000 - Unit Masonry Assemblies
- B. Section 06 1610 - Gypsum Sheathing
- C. Section 07 6200 - Sheet Metal Flashing and Trim
- D. Section 07 9005 - Joint Sealers

1.03 DEFINITIONS

- A. Air Barrier Assembly: The collection of air barrier materials and auxiliary materials applied to an opaque wall, including joints and junctions to abutting construction, to control air movement through the wall.

1.04 PERFORMANCE REQUIREMENTS

- A. General: Air barrier shall be capable of performing as a continuous vapor-permeable air barrier and as a liquid-water drainage plane flashed to discharge to the exterior incidental condensation or water penetration. Air barrier assemblies shall be capable of accommodating substrate movement and of sealing substrate expansion and control joints, construction material changes, and transitions at perimeter conditions without deterioration and air leakage exceeding specified limits.
- B. The building envelope shall be designed and constructed with a continuous air barrier to control air leakage into, or out of the conditioned space. The air barrier shall have the following characteristics:
 - 1. It must be continuous, with all joints made airtight.
 - 2. It shall have an air permeability not to exceed 0.004 cfm/sq. ft. under a pressure differential of 0.3 in. water (1.57 psf) (equal to 0.02 L/s. x sq. m. @ 75 Pa), when tested in accordance with ASTM E 2178.
 - 3. It shall be capable of withstanding positive and negative combined design wind, fan and stack pressures on the envelope without damage or displacement, and shall transfer the load to the structure. It shall not displace adjacent materials under full load.
 - 4. It shall be durable or maintainable.
 - 5. The air barrier shall be joined in an airtight and flexible manner to the air barrier material of adjacent systems, allowing for the relative movement of systems due to thermal and moisture variations and creep. Connection shall be made between:
 - a. Foundation and walls
 - b. Walls and windows or doors
 - c. Different wall systems
 - d. Wall and roof
 - e. Wall and roof over unconditioned space
 - f. Walls, floor and roof across construction, control and expansion joints
 - g. Walls, floors and roof to utility, pipe and duct penetrations
 - 6. All penetrations of the air barrier and paths of air infiltration/exfiltration shall be made airtight.

1.05 REFERENCES

- A. The following standards and publications are applicable to the extent referenced in the text. The most recent version of these standards is implied unless otherwise stated.
- B. American Society for Testing and Materials (ASTM)
 - 1. ASTM C 1193 - Guide for Use of Joint Sealants
 - 2. ASTM D 412 - Standard Test Methods for Rubber Properties in Tension
 - 3. ASTM D 570 - Test Method for Water Absorption of Plastics
 - 4. ASTM D 903 - Standard Test Method for Peel or Stripping Strength of Adhesive Bonds
 - 5. ASTM D 1004 - Test Method for Initial Tear Resistance of Plastic Film and Sheeting
 - 6. ASTM D 1876 - Test Method for Peel Resistance of Adhesives
 - 7. ASTM D 1938 - Test Method for Tear Propagation Resistance of Plastic Film and Sheeting
 - 8. ASTM D 1970 - Standard Specification for Self-Adhering Polymer Modified Bituminous Sheet Materials Used as Steep Roofing Underlayment for Ice Dam Protection
 - 9. ASTM D 4258 - Practice for Surface Cleaning Concrete for Coating
 - 10. ASTM D 4263 - Test Method for Indicating Moisture in Concrete by the Plastic Sheet Method
 - 11. ASTM E 96 - Test Methods for Water Vapor Transmission of Materials
 - 12. ASTM E 154 - Test Methods for Water Vapor Retarders Used in Contact with Earth Under Concrete Slabs, on Walls, or as Ground Cover
 - 13. ASTM E 1186 - Practice for Air Leakage Site Detection in Building Envelopes and Air Retarder Systems
 - 14. ASTM E 2178 - Standard Test Method for Air Permeance of Building Materials
 - 15. ASTM E 2357 - Standard Test Method for Determining Air Leakage of Air Barrier Assemblies

1.06 SUBMITTALS

- A. Product Data: Include manufacturer's written instructions for evaluating, preparing, and treating substrate; technical data; and tested physical and performance properties of air barrier.
- B. Shop Drawings: Show locations and extent of air barrier. Include details for substrate joints and cracks, counterflashing strip, penetrations, inside and outside corners, terminations, and tie-ins with adjoining construction.
 - 1. Include details of interfaces with other materials that form part of air barrier
 - 2. Include details of mockups
- C. Product Certificates: For air barriers, certifying compatibility of air barrier and accessory materials with Project materials that connect to or that come in contact with the barrier; signed by product manufacturer.
- D. Qualification Data: For Applicator.
- E. Product Test Reports: Based on evaluation of comprehensive tests performed by a qualified testing agency, for air barriers, submit certified test report showing compliance with requirements specified for ASTM E2178.
- F. Warranty: Submit a sample warranty identifying the terms and conditions stated in Article 1.10.

1.07 QUALITY ASSURANCE

- A. Manufacturer: Air barrier systems shall be manufactured and marketed by a firm with a minimum of 20 years experience in the production and sales of waterproofing and air barriers. Manufacturers proposed for use, but not named in these specifications shall submit evidence of ability to meet all requirements specified, and include a list of projects of similar design and complexity completed within the past five years.
- B. Source Limitations: Obtain primary air-barrier material and through wall flashing through one source from a single manufacturer. Should project require a vapor permeable and a vapor impermeable air barrier on same project, obtain vapor-permeable and vapor impermeable air

WEATHER BARRIER, FLUID-
APPLIED MEMBRANE AIR
BARRIERS, VAPOR
PERMEABLE

barrier and through wall flashing from one source from a single manufacturer. See specification Section 07 2500 for fully-adhered vapor impermeable air barrier.

- C. Applicator Qualifications: A firm experienced in applying air barrier materials similar in material, design, and extent to those indicated for this Project, whose work has resulted in applications with a record of successful in-service performance.
- D. Pre-Installation Conference: A pre-installation conference shall be held prior to commencement of field operations to establish procedures to maintain optimum working conditions and to coordinate this work with related and adjacent work. Preinstallation conference shall include the Contractor, installer, Architect, and system manufacturer's field representative. Agenda for meeting shall include but not be limited to the following:
 - 1. Review of submittals
 - 2. Review of surface preparation, minimum curing period and installation procedures
 - 3. Review of special details and flashings
 - 4. Sequence of construction, responsibilities and schedule for subsequent operations
 - 5. Review of inspection, testing, protection and repair procedures

1.08 DELIVERY, STORAGE, AND HANDLING

- A. Deliver materials and products in labeled packages. Store and handle in strict compliance with manufacturer's instructions, recommendations and material safety data sheets. Protect from damage from sunlight, weather, excessive temperatures and construction operations. Remove damaged material from the site and dispose of in accordance with applicable regulations.
- B. Do not double-stack pallets of fluid applied membrane components on the job site. Provide cover on top and all sides, allowing for adequate ventilation.
- C. Protect fluid-applied membrane components from freezing and extreme heat.
- D. Sequence deliveries to avoid delays, but minimize on-site storage.

1.09 PROJECT CONDITIONS

- A. Environmental Limitations: Apply air barrier within the range of ambient and substrate temperatures recommended by air barrier manufacturer. Protect substrates from environmental conditions that affect performance of air barrier. Do not apply air barrier to a wet substrate or during snow, rain, fog, or mist.

1.10 WARRANTY

- A. Material Warranty: Manufacturer's standard form in which manufacturer agrees to replace fluid-applied air barrier membrane materials that fail within specified warranty period when installed and used in strict conformance with written manufacturer's instructions.
 - 1. Failures include, but are not limited to, the following:
 - a. Failure to maintain air permeance rating not to exceed 0.004 cfm/sq. ft. under a pressure differential of 0.3 in. water (1.57 psf) (equal to 0.02 L/s. x sq. m. @ 75 Pa), when tested per ASTM E 2178, within specified warranty period.
 - b. Failure to maintain a vapor permeance rating greater than 10 perms when tested in accordance with ASTM E 96, Method B.
 - 2. Warranty Period: Five years from date of Substantial Completion

PART 2 PRODUCTS

2.01 FLUID-APPLIED, VAPOR PERMEABLE MEMBRANE AIR BARRIER

- A. FLUID-APPLIED AIR BARRIER MEMBRANE: a fluid-applied, vapor permeable, acrylic membrane that cures to form a resilient, monolithic, fully bonded elastomeric membrane when applied to construction surfaces. The membrane provides superior protection against the damaging effects of air and liquid water ingress on the building structures. Product shall have the following minimum physical properties:
 - 1. Manufacturer:
 - a. Grace Construction Products; Product: Perm-A-Barrier® VPL.
www.graceconstruction.com.

WEATHER BARRIER, FLUID-
APPLIED MEMBRANE AIR
BARRIERS, VAPOR
PERMEABLE

2. Membrane Air Permeance: ASTM E2178: Not to exceed 0.0004 cfm/sq. ft. under a pressure differential of 0.3 in. water (1.57 psf) (equal to 0.002 L/s. x sq. m. @ 75 Pa)
 3. Assembly Performance: Provide a continuous air barrier assembly that has an air leakage not to exceed 0.0008 cfm/sq. ft. of surface area under a pressure differential of 0.3 in. water (1.57 psf) (equal to 0.004 L/s. x sq. m. of surface area at 75 Pa) when tested in accordance with ASTM E2357.
 4. Membrane Vapor Permeance: ASTM E96, Method B: 11.2 perms
 5. Peel Adhesion: ASTM D903: min. 5 pli or substrate failure to glass faced wall board, min. 20 pli to concrete/CMU
 6. UV Exposure Limit: Not more than 180 calendar days
- B. TRANSITION MEMBRANE: a 0.9 mm (36 mils) of self-adhesive rubberized asphalt integrally bonded to 0.1 mm (4 mil) of cross-laminated, high-density polyethylene film to provide a min. 1.0 mm (40 mil) thick membrane. Membrane shall be interleaved with disposable silicone-coated release paper until installed, conforming with the following:
1. Manufacturer:
 - a. Grace Construction Products; Product: Perm-A-Barrier Detail Membrane.
www.graceconstruction.com.
 2. Water Vapor Transmission: ASTM E96, Method B: 0.05 perms (2.9 ng/Pa s. sq. m.) max.
 3. Air Permeance at 75 Pa (0.3 in. water) pressure difference: 0.0006 L/s. sq. m (0.00012 cfm/ sq. ft.) max.
 4. Puncture Resistance: ASTM E154: 178 N (40 lbs.) min.
 5. Lap Adhesion at -4°C (25°F): ASTM D1876: 880 N/m (5.0 lbs./in.) of width
 6. Low Temperature Flexibility: ASTM D1970: Unaffected to -43°C (-45°F)
 7. Tensile Strength: ASTM D412, Die C Modified: min. 2.7 MPa (400 psi)
 8. Elongation, Ultimate Failure of Rubberized Asphalt: ASTM D412, Die C: min. 200%

2.02 PRIMERS

- A. Wall Primer for Self-adhered transition membrane and Self-adhered flexible membrane wall flashing: Perm-A-Barrier WB Primer manufactured by Grace Construction Products; a water-based primer which imparts an aggressive, high tack finish on the treated substrate.
1. Flash Point: No flash to boiling point
 2. VOC Content: Not to exceed 10 g/L
 3. Application Temperature: -4°C (25°F) and above
 4. Freezing point (as packaged): -7°C (21°F)

2.03 PENETRATIONS & TERMINATION SEALANT

- A. Liquid Membrane for Details and Terminations: Bituthene Liquid Membrane manufactured by Grace Construction Products; a two-part, elastomeric, trowel grade material designed for use with fluid-applied membranes, self-adhered membranes and tapes. 10 g/L max. VOC content.
- B. Substrate Patching Membrane: Bituthene Liquid Membrane manufactured by Grace Construction Products; a two-part, elastomeric, trowel grade material designed for use with fluid-applied membranes, self-adhered membranes and tapes. 10 g/L max. VOC content.
- C. Joint Sealant: Refer to sealant manufacturer's recommendations.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that substrates and conditions are ready to accept the Work of this section. Notify Architect in writing of any discrepancies. Commencement of the Work or any parts thereof shall mean acceptance of the prepared substrates.
- B. All surfaces must be sound, dry, clean and free of oil, grease, dirt, excess mortar or other contaminants detrimental to the adhesion of the membranes. Fill voids, gaps and spalled areas in substrate to provide an even plane. Strike masonry joints full-flush.

- C. Curing compounds or release agents used in concrete construction must be resin based without oil, wax or pigments.

3.02 SURFACE PREPARATION

- A. Refer to manufacturer's literature for requirements for preparation of substrates. Surfaces shall be sound and free of voids, spalled areas, loose aggregate and sharp protrusions. Remove contaminants such as grease, oil and wax from exposed surfaces. Remove dust, dirt, loose stone and debris. Use repair materials and methods that are acceptable to manufacturer of the fluid-applied air barrier assembly.
- B. Exterior sheathing panels: Ensure that the boards are sufficiently stabilized with corners and edges fastened with appropriate screws. Pre-treat all board joints with 50 - 75 mm (2-3 in.) wide, manufacturer's recommended mesh-style wallboard tape. Gaps greater than 6 mm (1/4 in.) should be filled with mastic or caulk, allowing sufficient time to fully cure before application of the mesh-style wallboard tape and fluid applied air barrier system.
- C. Masonry Substrates: Apply air and vapor barrier over concrete block and brick with smooth trowel-cut mortar joints, struck full and flush. Fill all voids and holes, particularly in the mortar joints, with a lean mortar mix, non-shrinking grout or parge coat.
- D. Related Materials: Treat construction joints and install flashing as recommended by manufacturer.
- E. Clean, prepare, treat, and seal substrate according to manufacturer's written instructions. Provide clean, dust-free, and dry substrate for air barrier application.
- F. Mask off adjoining surfaces not covered by air barrier to prevent spillage and overspray affecting other construction.
- G. Remove grease, oil, bitumen, form-release agents, paints, curing compounds, and other penetrating contaminants or film-forming coatings from concrete.
- H. Remove fins, ridges, mortar, and other projections and fill honeycomb, aggregate pockets, holes, and other voids in concrete with substrate patching membrane.
- I. Remove excess mortar from masonry ties, shelf angles, and other obstructions.
- J. At changes in substrate plane, apply sealant or Bituthene Liquid Membrane at sharp corners and edges to form a smooth transition from one plane to another.
- K. Cover gaps in substrate plane and form a smooth transition from one substrate plane to another with stainless-steel sheet mechanically fastened to structural framing to provide continuous support for air barrier.

3.03 JOINT TREATMENT

- A. Concrete and Masonry: Prepare, treat, rout, and fill joints and cracks in substrate according to ASTM C1193 and air barrier manufacturer's written instructions. Remove dust and dirt from joints and cracks complying with ASTM D4258 before coating surfaces.
 - 1. Prime substrate as required.
- B. Gypsum Sheathing: Fill joints greater than 1/4 inch (6 mm) with sealant according to ASTM C1193 and with air barrier manufacturer's written instructions. Apply mesh-style wallboard tape to joint prior to installing fluid air barrier membrane.

3.04 AIR BARRIER MEMBRANE INSTALLATION

- A. Apply air barrier membrane to achieve a continuous air barrier according to air barrier manufacturer's written instructions.
- B. Apply air barrier membrane within manufacturer's recommended application temperature ranges.
- C. Apply a continuous unbroken air barrier to substrates according to the following minimum thickness. Apply membrane in full contact around protrusions such as masonry ties.

1. Vapor-Permeable Membrane Air Barrier: 90-mil (2.4-mm) wet film thickness, 42~45-mil (1.2-mm) dry film thickness.
- D. Do not cover air barrier until it has been tested and inspected by Owner's testing agency.
- E. Correct deficiencies in or remove air barrier that does not comply with requirements; repair substrates and reapply air barrier components.
- F. Air barrier is to wrap inside of all rough openings for doors, windows, storefront, curtainwall assemblies, etc..., and extend to the interior sealant.

3.05 TRANSITION MEMBRANE INSTALLATION

- A. Install strips, transition membrane, and auxiliary materials according to air barrier manufacturer's written instructions to form a seal with adjacent construction and maintain a continuous air barrier.
- B. Apply primer to substrates to receive transition membrane at required rate and allow to dry. Limit priming to areas that will be covered by transition tape in same day. Re-prime areas exposed for more than 24 hours.
 1. Prime glass-fiber-surfaced gypsum sheathing not covered with air membrane material with number of prime coats needed to achieve required bond, with adequate drying time between coats.
- C. Connect and seal exterior wall air barrier membrane continuously to roofing membrane air barrier, concrete below-grade structures, floor-to floor construction, exterior glazing and window systems, glazed curtain-wall systems, storefront systems, exterior louvers, exterior door framing, and other construction used in exterior wall openings, using accessory materials.
- D. At end of each working day, seal top edge of strips and transition membrane to substrate with termination sealant.
- E. Apply joint sealants forming part of air barrier assembly within sealant manufacturer's recommended application temperature ranges. Consult sealant manufacturer when sealant cannot be applied within these temperature ranges.
- F. Wall Openings: Prime concealed perimeter frame surfaces of windows, curtain walls, storefronts, and doors. Apply transition membrane so that a minimum of 3 inches (75 mm) of coverage is achieved over both substrates.
 1. Transition Membrane: Roll firmly to enhance adhesion.
- G. Fill gaps in perimeter frame surfaces of windows, curtain walls, storefronts, and doors, and miscellaneous penetrations of air barrier membrane with foam sealant.
- H. Repair punctures, voids, and deficient lapped seams in strips and transition membrane. Slit and flatten fish-mouths and blisters. Patch with transition membrane extending 6 inches (150 mm) beyond repaired areas in strip direction.

3.06 FIELD QUALITY CONTROL

- A. Testing Agency: Owner may engage a qualified testing agency to perform tests and inspections and prepare test reports.
- B. Inspections: Air barrier materials and installation are subject to inspection for compliance with requirements. Inspections may include the following:
 1. Continuity of air barrier system has been achieved throughout the building envelope with no gaps or holes
 2. Continuous structural support of air barrier system has been provided
 3. Masonry and concrete surfaces are smooth, clean and free of cavities, protrusions, and mortar droppings
 4. Site conditions for application temperature and dryness of substrates have been maintained
 5. Maximum exposure time of materials to UV deterioration has not been exceeded
 6. Surfaces have been primed, if applicable

7. Laps in strips and transition membrane have complied with minimum requirements and have been shingled in the correct direction (or mastic has been applied on exposed edges), with no fish-mouths
 8. Termination sealant has been applied on cut edges
 9. Strips and transition membrane have been firmly adhered to substrate
 10. Compatible materials have been used
 11. Transitions at changes in direction and structural support at gaps have been provided.
 12. Connections between assemblies (membrane and sealants) have complied with requirements for cleanliness, preparation and priming of surfaces, structural support, integrity, and continuity of seal
 13. All penetrations have been sealed
- C. Tests: Testing to be performed will be determined by Owner's testing agency from among the following tests:
1. Qualitative Testing: Air barrier assemblies will be tested for evidence of air leakage according to ASTM E 1186.
- D. Remove and replace deficient air barrier components and retest as specified above.

3.07 CLEANING AND PROTECTION

- A. Protect air barrier system from damage during application and remainder of construction period, according to manufacturer's written instructions.
- B. Protect air barrier from exposure to UV light and harmful weather exposure as required by manufacturer. Remove and replace main air barrier material exposed for more than 180 days.
- C. Clean spills, stains, and soiling from construction that would be exposed in the completed work using cleaning agents and procedures recommended by manufacturer of affected construction.
- D. Remove masking materials after installation.

END OF SECTION

This page intentionally left blank

**SECTION 07 4646
FIBER-CEMENT SIDING**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fiber-cement siding.
- B. Accessories.

1.02 RELATED REQUIREMENTS

- A. Section 06 1000 - Rough Carpentry: Siding substrate.
- B. Section 07 2500 - Weather Barriers: Water-resistive barrier under siding.
- C. Section 07 9200 - Joint Sealants: Sealing joints between siding and adjacent construction and fixtures.
- D. Section 09 9113 - Exterior Painting: Field painting.

1.03 REFERENCE STANDARDS

- A. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2023.
- B. ASTM C1186 - Standard Specification for Flat Fiber-Cement Sheets; 2022.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Submit manufacturer's data sheets on each product to be used, including:
 - 1. Manufacturer's requirements for related materials to be installed by others.
 - 2. Preparation instructions and recommendations.
 - 3. Storage and handling requirements and recommendations.
 - 4. Installation methods, including nail patterns.
- C. Shop Drawings: Indicate dimensions, layout, joints, construction details, support clips, _____, and methods of anchorage.
- D. Manufacturer's qualification statement.
- E. Installer's qualification statement.
- F. Maintenance Instructions: Periodic inspection recommendations and maintenance procedures.
- G. Warranty: Submit copy of manufacturer's warranty, made out in Owner's name, showing that it has been registered with manufacturer.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section, with not less than five years of documented experience.
- B. Installer Qualifications: Company specializing in performing work of type specified in this section with not less than three years of experience.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Deliver and store materials in manufacturer's unopened packaging, with labels intact, until ready for installation.
- B. Store materials under dry and waterproof cover, well ventilated, and elevated above grade on a flat surface.
- C. Protect materials from harmful environmental elements, construction dust, and other potentially detrimental conditions.

PART 2 PRODUCTS

2.01 FIBER-CEMENT SIDING

- A. Panel Siding: Vertically-applied panels made of cement and cellulose fiber formed under high pressure with integral surface texture, complying with ASTM C1186, Type A, Grade II.
 - 1. Texture: Smooth.
 - 2. Panel Size: As indicated on drawings.
 - 3. Thickness: 5/16 inch (8 mm), nominal.
 - 4. Finish: Factory applied primer.
 - 5. Color: To match the aluminum framing system of the existing solarium.
 - 6. Warranty: 50 year limited; transferable.
 - 7. Products:
 - a. James Hardie Building Products, Inc; Architectural Panel:
www.jameshardie.com/#sle.
 - b. Substitutions: See Section 01 6000 - Product Requirements.

2.02 ACCESSORIES

- A. Support for Cladding and Continuous Insulation: Continuous thermal Z-girts.
 - 1. Galvanized steel girts that provide cladding attachment support for exterior wall cladding.
 - 2. Depth : As indicated on drawings.
 - 3. Spacing: 16 inches (406 mm) on center, horizontally.
 - 4. Fasteners: As recommended by clip manufacturer.
 - 5. Products:
 - a. Knight Wall Systems; ThermaZee: <https://knightwallsystems.com/products/knight-thermazee-cladding-attachment/>.
 - b. Substitutions: See Section 01 6000 - Product Requirements.
- B. Aluminum Trim: Extruded aluminum alloy 6063-T5 temper.
 - 1. Finish: Field painted.
 - 2. Color: To match siding color.
 - 3. Reveal Trim:
 - a. Type: Vertical reveal.
 - 1) Products:
 - (a) Fry Reglet; V7 Double T: <https://fryreglet.com/v6-v7-double-t>
 - (b) Substitutions: See Section 01 6000-Product Requirements.
 - b. Type: Horizontal reveal.
 - 1) Products:
 - (a) Fry Reglet; H6 Sleek Horizontal: <https://fryreglet.com/h6-sleek-horizontal>
 - (b) Substitutions: See Section 01 6000-Product Requirements.
 - 4. Edge Trim:
 - a. Type: "L" Shape.
 - b. Products:
 - 1) Fry Reglet; T24 Lap Wall Angle: <https://fryreglet.com/t24-lap-wall-angle>.
 - 2) Substitutions: See Section 01 6000 - Product Requirements.
 - 5. Base Trim:
 - a. Type: As indicated on drawings.
 - b. Products:
 - 1) Fry Reglet; H10 Base: <https://fryreglet.com/h10-base/>.
 - 2) Substitutions: See Section 01 6000 - Product Requirements.
 - C. Fasteners: Galvanized or corrosion resistant; length as required to penetrate, 1-1/4 inches (31.8 mm), minimum.
 - D. Insect Screen.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Examine substrate, clean and repair as required to eliminate conditions that would be detrimental to proper installation.
- B. Verify that water-resistant barrier has been installed over substrate completely and correctly; see Section 07 2500.
- C. Do not begin until unacceptable conditions have been corrected.
- D. If substrate preparation is responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.

3.02 PREPARATION

- A. Protect surrounding areas and adjacent surfaces during execution of this work.
- B. Install Sheet Metal Flashing:
 - 1. Above door and window trim and casings.
 - 2. As indicated on drawings.
 - 3. Above horizontal trim in field of siding.

3.03 INSTALLATION

- A. Install in accordance with manufacturer's instructions and recommendations.
 - 1. Read warranty and comply with terms necessary to maintain warranty coverage.
 - 2. Paint all aluminum trim prior to their install to ensure complete coverage. Touch up paint after installation as necessary.
 - 3. Touch up field cut edges before installing.
 - 4. Pre-drill nail holes if necessary to prevent breakage.
 - 5. Before applying finish paint, caulk all nail holes and smooth to create even surface.
- B. Joints in Vertical Siding: Install Z-flashing in horizontal joints between successive courses of vertical siding.
- C. Do not install siding less than 6 inches (152 mm) from ground surface, or closer than 1 inch (25.4 mm) to roofs, patios, porches, and other surfaces where water may collect.
- D. After installation, seal joints except lap joints of lap siding; seal around penetrations, and paint exposed cut edges.
- E. Finish Painting: See Section 09 9113. Apply finish painting to all exposed accessories before installation of the fiber cement panels.

3.04 CLEANING

- A. See Section 01 7000 - Execution and Closeout Requirements for additional requirements.
- B. Clean faced panels in accordance with manufacturer's maintenance instructions, using cleaning materials and methods acceptable to manufacturer.

3.05 PROTECTION

- A. Protect installed products until Date of Substantial Completion.
- B. Touch-up, repair or replace damaged products before Date of Substantial Completion.

END OF SECTION

This page intentionally left blank

**SECTION 07 6200
SHEET METAL FLASHING AND TRIM**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fabricated sheet metal items, including flashings.
- B. Sealants for joints within sheet metal fabrications.

1.02 RELATED REQUIREMENTS

- A. Section 04 2000-Unit Masonry: Metal flashings embedded in masonry.
- B. Section 06 1000-Rough Carpentry: Wood nailers for sheet metal work.
- C. Section 07 9200-Joint Sealants: Sealing non-lap joints between sheet metal fabrications and adjacent construction.

1.03 REFERENCE STANDARDS

- A. AAMA 611 - Voluntary Specification for Anodized Architectural Aluminum; 2020.
- B. AAMA 2605 - Voluntary Specification, Performance Requirements and Test Procedures for Superior Performing Organic Coatings on Aluminum Extrusions and Panels (with Coil Coating Appendix); 2022.
- C. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2023.
- D. ASTM A666 - Standard Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar; 2023.
- E. ASTM B209/B209M - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate; 2021a.
- F. ASTM C920 - Standard Specification for Elastomeric Joint Sealants; 2018.
- G. CDA A4050 - Copper in Architecture - Handbook; current edition.
- H. SMACNA (ASMM) - Architectural Sheet Metal Manual; 2012.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Shop Drawings: Indicate material profile, jointing pattern, jointing details, fastening methods, flashings, terminations, and installation details.
- C. Samples: Submit two samples, 12 by 12 inches (304.8 by 304.8 mm) in size, illustrating metal finish color.

1.05 QUALITY ASSURANCE

- A. Perform work in accordance with SMACNA (ASMM) and CDA A4050 requirements and standard details, except as otherwise indicated.
- B. Fabricator and Installer Qualifications: Company specializing in sheet metal work with three years of documented experience.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Stack material to prevent twisting, bending, and abrasion, and to provide ventilation. Slope metal sheets to ensure drainage.
- B. Prevent contact with materials that could cause discoloration or staining.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Sheet Metal Flashing and Trim:
 - 1. ALUCOBOND by 3A Composites USA; ALUCOBOND AXCENT:
www.alucobondusa.com/#sle.

2. Fairview Architectural LLC: www.fairview-na.com/#sle.
3. Petersen Aluminum Corporation: www.pac-clad.com/#sle.
4. Substitutions: See Section 01 6000 - Product Requirements.

2.02 SHEET MATERIALS

- A. General: Protect mechanical and other finishes on exposed surfaces from damage by applying a strippable, temporary protective film before shipping.
- B. Galvanized Steel: ASTM A653/A653M, with G90/Z275 zinc coating; minimum 24-gauge, 0.0239-inch (0.61 mm) thick base metal.
- C. Anodized Aluminum: ASTM B209/B209M, 3005 alloy, H12 or H14 temper; 20 gauge, 0.032 inch (0.81 mm) thick; clear anodized finish.
 1. Clear Anodized Finish: AAMA 611, AA-M12C22A41, Class I, clear anodic coating not less than 0.7 mil, 0.0007 inch (0.018 mm) thick.
- D. Pre-Finished Aluminum: ASTM B209/B209M, 3005 alloy, H12 or H14 temper; 18 gauge, 0.040 inch (1.02 mm) thick; plain finish shop pre-coated with PVDF coating.
 1. Polyvinylidene Fluoride (PVDF) Coating: Superior performing organic powder coating, AAMA 2605; pretreated metal with two-coat system including primer and color coat with at least 70 percent PVDF coating.
 2. Color: As indicated on drawings.
- E. Stainless Steel: ASTM A666, Type 304 alloy, soft temper, 28 gauge, 0.0156 inch (0.40 mm) thick; smooth No. 4 - Brushed finish.

2.03 FABRICATION

- A. General: Custom fabricate sheet metal flashing and trim to comply with recommendations in SMACNA's "Architectural Sheet Metal Manual" that apply to design, dimensions, geometry, metal thickness, and other characteristics of item indicated. Fabricate items at the shop to greatest extent possible.
 1. Obtain field measurements for accurate fit before shop fabrication.
 2. Form sheet metal flashing and trim without excessive oil canning, buckling, and tool marks and true to line and levels indicated, with exposed edges folded back to form hems. Conceal fasteners and expansion provisions where possible.
 3. Exposed fasteners are not allowed on faces exposed to view.
- B. Form sections true to shape, accurate in size, square, and free from distortion or defects.
- C. Form pieces in longest possible lengths.
- D. Hem exposed edges on underside 1/2 inch (13 mm); miter and seam corners.
- E. Form material with flat lock seams, except where otherwise indicated; at moving joints, use sealed lapped, bayonet-type or interlocking hooked seams.
- F. Fabricate corners from one piece with minimum 18-inch (450 mm) long legs; seam for rigidity, seal with sealant.
- G. Fabricate vertical faces with bottom edge formed outward 1/4 inch (6 mm) and hemmed to form drip.

2.04 ACCESSORIES

- A. General: Provide materials and types of fasteners, solder, welding rods, protective coatings, separators, sealants, and other miscellaneous items as required for complete sheet metal flashing and trim installation and recommended by manufacturer of primary sheet metal or manufactured item unless otherwise indicated.
- B. Fasteners: Galvanized steel, with soft neoprene washers.
- C. Underlayment: Polyethylene, 6 mil, 0.006 inch (0.15 mm) thick.
- D. Primer Type: Zinc chromate.
- E. Concealed Sealants: Non-curing butyl sealant.

- F. Epoxy Seam Sealer: Two-part, noncorrosive, aluminum seam-cementing compound, recommended by aluminum manufacturer for exterior nonmoving joints, including riveted joints.
- G. Bituminous Coating: Cold-applied asphalt emulsion complying with ASTM D 1187.
- H. Exposed Sealants: ASTM C920; elastomeric sealant, with minimum movement capability as recommended by manufacturer for substrates to be sealed; color to match adjacent material.

PART 3 EXECUTION

3.01 PREPARATION

- A. Install starter and edge strips, and cleats before starting installation.
- B. Back paint concealed metal surfaces with protective backing paint to a minimum dry film thickness of 15 mil, 0.015 inch (0.38 mm).

3.02 INSTALLATION

- A. General: Anchor sheet metal flashing and trim and other components of the work securely in place, with provisions for thermal and structural movement so that completed sheet metal flashing and trim shall not rattle, leak, or loosen, and shall remain watertight. Use fasteners, solder, welding rods, protective coatings, separators, sealants, and other miscellaneous items as required to complete sheet metal flashing and trim system.
- B. Comply with drawing details.
- C. Insert flashings into reglets to form tight fit; secure in place with lead wedges; pack remaining spaces with lead wool; seal flashings into reglets with sealant.
- D. Secure flashings in place using concealed fasteners, and use exposed fasteners only where permitted..
- E. Apply plastic cement compound between metal flashings and felt flashings.
- F. Fit flashings tight in place; make corners square, surfaces true and straight in planes, and lines accurate to profiles.
- G. Metal Protection: Where dissimilar metals will contact each other or corrosive substrates, protect against galvanic action by painting contact surfaces with bituminous coating or by other permanent separation as recommended by SMACNA.
 - 1. Underlayment: Where installing metal flashing directly on cementitious or wood substrates, install a course of felt underlayment and cover with a course of polyethylene sheet.
- H. Expansion Provisions: Provide for thermal expansion of exposed flashing and trim. Space movement joints at a maximum of 10 feet with no joints allowed within 24 inches of corner or intersection. Where lapped expansion provisions cannot be used or would not be sufficiently watertight, form expansion joints of intermeshing hooked flanges, not less than 1 inch deep, filled with sealant concealed within joints.
- I. Solder metal joints for full metal surface contact. After soldering, wash metal clean with neutralizing solution and rinse with water.
 - 1. Do not solder metallic-coated steel and aluminum sheet.
 - 2. Do not use torches for soldering. Heat surfaces to receive solder and flow solder into joint.
 - 3. Fill joint completely. Completely remove flux and spatter from exposed surfaces.

3.03 WALL FLASHING INSTALLATION

- A. General: Install sheet metal wall flashing to intercept and exclude penetrating moisture according to SMACNA recommendations and as indicated. Coordinate installation of wall flashing with installation of wall-opening components such as windows, doors, and louvers.
- B. Through-Wall Flashing: Installation of through-wall flashing is specified in Division 4 Section "Unit Masonry Assemblies."
- C. Opening Flashings in Frame Construction: Install continuous head, sill, jamb, and similar flashings to extend 4 inches beyond wall openings.

3.04 CLEANING AND PROTECTION

- A. Clean exposed metal surfaces of substances that interfere with uniform oxidation and weathering.
- B. Clean and neutralize flux materials. Clean off excess solder and sealants.
- C. Remove temporary protective coverings and strippable films as sheet metal flashing and trim are installed unless otherwise indicated in manufacturer's written installation instructions.

3.05 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements for field inspection requirements.
- B. Inspection will involve surveillance of work during installation to ascertain compliance with specified requirements.

END OF SECTION

SECTION 07 8400 FIRESTOPPING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Firestopping systems.
- B. Firestopping of joints and penetrations in fire-resistance-rated and smoke-resistant assemblies, whether indicated on drawings or not, and other openings indicated.

1.02 RELATED REQUIREMENTS

- A. Section 01 7000 - Execution and Closeout Requirements: Cutting and patching.
- B. Section 09 2116 - Gypsum Board Assemblies: Gypsum wallboard fireproofing.

1.03 REFERENCE STANDARDS

- A. ASTM E119 - Standard Test Methods for Fire Tests of Building Construction and Materials; 2022.
- B. ASTM E814 - Standard Test Method for Fire Tests of Penetration Firestop Systems; 2023a.
- C. ASTM E1966 - Standard Test Method for Fire-Resistive Joint Systems; 2015 (Reapproved 2019).
- D. ASTM E2837 - Standard Test Method for Determining the Fire Resistance of Continuity Head-of-Wall Joint Systems Installed Between Rated Wall Assemblies and Nonrated Horizontal Assemblies; 2023.
- E. ITS (DIR) - Directory of Listed Products; Current Edition.
- F. FM (AG) - FM Approval Guide; Current Edition.
- G. UL 1479 - Standard for Fire Tests of Penetration Firestops; Current Edition, Including All Revisions.
- H. UL 2079 - Standard for Tests for Fire Resistance of Building Joint Systems; Current Edition, Including All Revisions.
- I. UL (FRD) - Fire Resistance Directory; Current Edition.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Schedule of Firestopping: List each type of penetration, fire rating of the penetrated assembly, and firestopping test or design number.
- C. Manufacturer's Installation Instructions: Indicate preparation and installation instructions.
- D. Manufacturer's Certificate: Certify that products meet or exceed specified requirements.
- E. Certificate from authority having jurisdiction indicating approval of materials used.
- F. Manufacturer's qualification statement.
- G. Installer's qualification statement.

1.05 QUALITY ASSURANCE

- A. Fire Testing: Provide firestopping assemblies of designs that provide the scheduled fire ratings when tested in accordance with methods indicated.
 - 1. Listing in UL (FRD), FM (AG), or ITS (DIR) will be considered as constituting an acceptable test report.
 - 2. Valid evaluation report published by ICC Evaluation Service, Inc. (ICC-ES) at www.icc-es.org will be considered as constituting an acceptable test report.
 - 3. Submission of actual test reports is required for assemblies for which none of the above substantiation exists.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.

- C. Installer Qualifications: Company specializing in performing the work of this section and:
 - 1. Verification of minimum three years documented experience installing work of this type.

1.06 FIELD CONDITIONS

- A. Comply with firestopping manufacturer's recommendations for temperature and conditions during and after installation; maintain minimum temperature before, during, and for three days after installation of materials.
- B. Provide ventilation in areas where solvent-cured materials are being installed.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Firestopping Manufacturers:
 - 1. 3M Fire Protection Products: www.3m.com/firestop/#sle.
 - 2. Grabber Construction Products, Inc; GrabberGard EFC: www.grabberman.com/#sle.
 - 3. Hilti, Inc: www.hilti.com/#sle.
 - 4. Tremco Commercial Sealants & Waterproofing; TREMstop Acrylic: www.tremcosealants.com/#sle.
 - 5. Substitutions: See Section 01 6000 - Product Requirements.

2.02 MATERIALS

- A. Firestopping Materials: Any materials meeting requirements.
 - 1. If there are multiple contractors applying these products, then all contractors are to use the same manufacturer and types of firestopping for consistency.
- B. Primers, Sleeves, Forms, Insulation, Packing, Stuffing, and Accessories: Provide type of materials as required for tested firestopping assembly.
- C. Fire Ratings: Refer to drawings for required systems and ratings.

2.03 FIRESTOPPING ASSEMBLY REQUIREMENTS

- A. Head-of-Wall (HW) Joint System Firestopping at Joints Between Fire-Rated Wall Assemblies and Non-Rated Horizontal Assemblies: Use system that has been tested according to ASTM E2837 to have fire resistance F Rating equal to required fire rating of wall assembly.
- B. Floor-to-Floor (FF), Floor-to-Wall (FW), Head-of-Wall (HW), and Wall-to-Wall (WW) Joints, Except Perimeter, Where Both Are Fire-Rated: Use system that has been tested according to ASTM E1966 or UL 2079 to have fire resistance F Rating equal to required fire rating of the assembly in which the joint occurs.
- C. Through Penetration Firestopping: Use system that has been tested according to ASTM E814 to have fire resistance F Rating equal to required fire rating of penetrated assembly.

2.04 FIRESTOPPING SYSTEMS

- A. Firestopping: Any material meeting requirements.
 - 1. Fire Ratings: Use system that is listed by FM (AG), ITS (DIR), or UL (FRD) and tested in accordance with ASTM E814, ASTM E119, or UL 1479 with F Rating equal to fire rating of penetrated assembly and minimum T Rating Equal to F Rating and in compliance with other specified requirements.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify openings are ready to receive the work of this section.

3.02 PREPARATION

- A. Clean substrate surfaces of dirt, dust, grease, oil, loose material, or other materials that could adversely affect bond of firestopping material.
- B. Remove incompatible materials that could adversely affect bond.
- C. Install backing materials to prevent liquid material from leakage.

3.03 INSTALLATION

- A. Install materials in manner described in fire test report and in accordance with manufacturer's instructions, completely closing openings.
- B. Do not cover installed firestopping until inspected by authorities having jurisdiction.
- C. Install labeling required by code.

3.04 FIELD QUALITY CONTROL

- A. Repair or replace penetration firestopping and joints at locations where inspection results indicate firestopping or joints do not meet specified requirements.

3.05 CLEANING

- A. Clean adjacent surfaces of firestopping materials.

3.06 PROTECTION

- A. Protect adjacent surfaces from damage by material installation.

END OF SECTION

This page intentionally left blank

SECTION 07 9200 JOINT SEALANTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Nonsag gunnable joint sealants.
- B. Self-leveling pourable joint sealants.
- C. Joint backings and accessories.

1.02 RELATED REQUIREMENTS

- A. Section 07 2500 - Weather Barriers: Sealants required in conjunction with air barriers and vapor retarders.
- B. Section 07 8400 - Firestopping: Firestopping sealants.
- C. Section 08 7100 - Door Hardware: Setting exterior door thresholds in sealant.
- D. Section 08 8000 - Glazing: Glazing sealants and accessories.
- E. Section 09 2116 - Gypsum Board Assemblies: Sealing acoustical and sound-rated walls and ceilings.
- F. Section 09 2216 - Non-Structural Metal Framing: Sealing between framing and adjacent construction in acoustical and sound-rated walls and ceilings.
- G. Section 09 3000 - Tiling: Sealant between tile and plumbing fixtures and at junctions with other materials and changes in plane.

1.03 REFERENCE STANDARDS

- A. ASTM C794 - Standard Test Method for Adhesion-in-Peel of Elastomeric Joint Sealants; 2018 (Reapproved 2022).
- B. ASTM C834 - Standard Specification for Latex Sealants; 2017 (Reapproved 2023).
- C. ASTM C919 - Standard Practice for Use of Sealants in Acoustical Applications; 2022.
- D. ASTM C920 - Standard Specification for Elastomeric Joint Sealants; 2018.
- E. ASTM C1087 - Standard Test Method for Determining Compatibility of Liquid-Applied Sealants with Accessories Used in Structural Glazing Systems; 2023.
- F. ASTM C1193 - Standard Guide for Use of Joint Sealants; 2016 (Reapproved 2023).
- G. ASTM C1248 - Standard Test Method for Staining of Porous Substrate by Joint Sealants; 2022.
- H. ASTM C1311 - Standard Specification for Solvent Release Sealants; 2022.
- I. ASTM C1330 - Standard Specification for Cylindrical Sealant Backing for Use with Cold Liquid-Applied Sealants; 2023.
- J. ASTM C1521 - Standard Practice for Evaluating Adhesion of Installed Weatherproofing Sealant Joints; 2019 (Reapproved 2020).
- K. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2023a.
- L. SCAQMD 1168 - Adhesive and Sealant Applications; 1989, with Amendment (2022).

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Submit manufacturer's technical datasheets for each product to be used; include the following:
 - 1. Physical characteristics, including movement capability, VOC content, hardness, cure time, and color availability.
 - 2. List of backing materials approved for use with the specific product.
 - 3. Backing material recommended by sealant manufacturer.
 - 4. Substrates that product is known to satisfactorily adhere to and with which it is compatible.

5. Substrates the product should not be used on.
6. Substrates for which use of primer is required.
- C. Color Cards for Selection: Where sealant color is not specified, submit manufacturer's color cards showing standard colors available for selection.
- D. Samples for Verification: Where custom sealant color is specified, obtain directions from Architect and submit at least two physical samples for verification of color of each required sealant.
- E. Preconstruction Laboratory Test Reports: Submit at least four weeks prior to start of installation.
- F. Installation Plan: Submit at least four weeks prior to start of installation.
 1. Installation plan to include each unique location and type of sealant to be used (i.e. Windows, Doors, Acoustical Walls, Countertops, Restroom Fixtures, Fire Partition Penetration etc...). Submit concurrently with color cards.
- G. Installation Log: Submit filled-out log for each length or instance of sealant installed.
- H. Executed warranty.

1.05 QUALITY ASSURANCE

- A. Preconstruction Laboratory Testing: Arrange for sealant manufacturer(s) to test each combination of sealant, substrate, backing, and accessories.
 1. Adhesion Testing: In accordance with ASTM C794.
 2. Compatibility Testing: In accordance with ASTM C1087.
 3. Allow sufficient time for testing to avoid delaying the work.
 4. Deliver sufficient samples to manufacturer for testing.
 5. Report manufacturer's recommended corrective measures, if any, including primers or techniques not indicated in product data submittals.
- B. Installation Plan: Include schedule of sealed joints, including the following:
 1. Installation Log Form: Include the following data fields, with known information filled out.
 - a. Unique identification of each length or instance of sealant installed.
 - b. Location on project.
 - c. Sealant used.
 - d. Stated movement capability of sealant.
 - e. Primer to be used, or indicate no primer is used.
 - f. Size and actual backing material used.
 - g. Date of installation.
 - h. Air temperature.
- C. Destructive Field Adhesion Test: Test for adhesion in accordance with ASTM C1521, using Destructive Tail Procedure.
 1. Sample: At least 18 inches (457 mm) long.
 2. Minimum Elongation Without Adhesive Failure: Consider the tail at rest, not under any elongation stress; multiply the stated movement capability of the sealant in percent by two; then multiply 1 inch (25.4 mm) by that percentage; if adhesion failure occurs before the 1-inch mark is that distance from the substrate, the test has failed.
 3. If either adhesive or cohesive failure occurs before minimum elongation, take necessary measures to correct conditions and retest; record each modification to products or installation procedures.
 4. Record results on Field Quality Control Log.
 5. Repair failed portions of joints.

1.06 WARRANTY

- A. See Section 01 7800 - Closeout Submittals for additional warranty requirements.
- B. Correct defective work within a five year period after Date of Substantial Completion.
- C. Warranty: Include coverage for installed sealants and accessories that fail to achieve watertight seal, exhibit loss of adhesion or cohesion, or do not cure.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Nonsag Sealants:
 - 1. Adfast USA Inc: www.adfastcorp.com/#sle.
 - 2. Dow: www.dow.com/#sle.
 - 3. Hilti, Inc: www.hilti.com/#sle.
 - 4. Pecora Corporation: www.pecora.com/#sle.
 - 5. Sherwin-Williams Company: www.sherwin-williams.com/#sle.
 - 6. Tremco Commercial Sealants & Waterproofing: www.tremcosealants.com/#sle.
 - 7. Substitutions: See Section 01 6000 - Product Requirements.
- B. Self-Leveling Sealants:
 - 1. Dow: www.dow.com/#sle.
 - 2. Pecora Corporation: www.pecora.com/#sle.
 - 3. Sherwin-Williams Company: www.sherwin-williams.com/#sle.
 - 4. Tremco Commercial Sealants & Waterproofing: www.tremcosealants.com/#sle.
 - 5. Substitutions: See Section 01 6000 - Product Requirements.

2.02 JOINT SEALANT APPLICATIONS

- A. Scope:
 - 1. Exterior Joints:
 - a. Do not seal exterior joints unless indicated as sealed on drawings or in the list below.
 - b. Seal the following joints:
 - 1) Wall expansion and control joints.
 - 2) Joints between doors, windows, and other frames or adjacent construction.
 - (a) Both sides of all doors, windows, and frames to receive same sealant (color may vary).
 - 3) Joints between different exposed materials.
 - 2. Interior Joints:
 - a. Do not seal interior joints unless specifically indicated to be sealed. Interior joints to be sealed include, but are not limited to, the following items.
 - 1) Joints between door frames and window frames and adjacent construction.
 - 2) In sound-rated wall and ceiling assemblies, gaps at electrical outlets, wiring devices, piping penetrations, other openings, and between wall/ceiling and other construction and other flanking sound paths.
 - (a) Exception: Through-penetrations in sound-rated assemblies that are also fire-rated assemblies.
 - 3. Do Not Seal:
 - a. Intentional weep holes in masonry.
 - b. Joints indicated to be covered with manufactured expansion joint cover assemblies or other sealing devices.
 - c. Joints where sealant installation is specified in other sections.
 - d. Joints between suspended ceilings and walls.
- B. Exterior Joints: Use nonsag nonstaining silicone sealant, unless otherwise indicated.
 - 1. Lap Joints in Sheet Metal Fabrications: Butyl rubber, noncuring.
 - 2. Control and Expansion Joints in Concrete Paving: Self-leveling polyurethane traffic-grade sealant.
- C. Interior Joints: Use nonsag acrylic emulsion latex sealant, unless otherwise indicated.
 - 1. Wall and Ceiling Joints in Nonwet Areas: Acrylic emulsion latex sealant.
 - 2. Wall and Ceiling Joints in Wet Areas: Nonsag non-staining silicone sealant for continuous liquid immersion.
 - 3. Floor Joints in Wet Areas: non-sag, non-staining silicone sealant suitable for continuous liquid immersion.

4. Joints between Fixtures in Wet Areas and Floors, Walls, and Ceilings: Mildew-resistant silicone sealant; clear.
 5. In Sound-Rated Assemblies: Acrylic emulsion latex sealant.
- D. Interior Wet Areas: restrooms, kitchens, food service areas, and other spaces where plumbing is present; fixtures in wet areas include plumbing fixtures, food service equipment, countertops, cabinets, and other similar items.
- E. Sound-Rated Assemblies: Walls and ceilings identified as STC-rated, sound-rated, or acoustical.

2.03 JOINT SEALANTS - GENERAL

- A. Sealants and Primers: Provide products having lower volatile organic compound (VOC) content than indicated in SCAQMD 1168.

2.04 NONSAG JOINT SEALANTS

- A. Nonstaining Silicone Sealant: ASTM C920, Grade NS, Uses M and A; not expected to withstand continuous water immersion or traffic.
1. Movement Capability: Plus and minus 50 percent, minimum.
 2. Nonstaining to Porous Stone: Nonstaining to light-colored natural stone when tested in accordance with ASTM C1248.
 3. Dirt Pick-Up: Reduced dirt pick-up compared to other silicone sealants.
 4. Color: To be selected by Architect from manufacturer's standard range.
 5. Basis of Design Product:
 - a. Tremco Commercial Sealants & Waterproofing; Spectrem 3:
www.tremcosealants.com/#sle.
 - b. Substitutions: See Section 01 6000 - Product Requirements.
- B. Silicone Sealant: ASTM C920, Grade NS, Use T; single component, explicitly approved by manufacturer for traffic exposure when recessed below traffic surface; not expected to withstand continuous water immersion.
1. Movement Capability: Plus 100 percent and minus 50 percent, minimum.
 2. Color: To be selected by Architect from manufacturer's standard range.
 3. Basis of Design Product:
 - a. Tremco Commercial Sealants & Waterproofing; Spectrem 800:
www.tremcosealants.com/#sle.
 - b. Substitutions: See Section 01 6000 - Product Requirements.
- C. Mildew-Resistant Silicone Sealant: ASTM C920, Grade NS, Uses M and A; single component, mildew resistant; not expected to withstand continuous water immersion or traffic.
1. Color: Clear.
 2. Basis of Design Product:
 - a. Tremco Commercial Sealants & Waterproofing; Tremsil 200:
www.tremcosealants.com/#sle. Tremsil 200.
 - b. Substitutions: See Section 01 6000 - Product Requirements.
- D. Polyurethane Sealant for Continuous Water Immersion: ASTM C920, Grade NS, Uses M and A; single or multicomponent; explicitly approved by manufacturer for continuous water immersion; suitable for traffic exposure when recessed below traffic surface.
1. Movement Capability: Plus and minus 35 percent, minimum.
- E. Acrylic Emulsion Latex: Water-based; ASTM C834, single component, nonstaining, nonbleeding, nonsagging; not intended for exterior use.
1. Color: To be selected by Architect from manufacturer's standard range.
 2. Basis of Design Product:
 - a. Tremco Commercial Sealants & Waterproofing; Tremflex 834:
www.tremcosealants.com/#sle.
 - b. Substitutions: See Section 01 6000 - Product Requirements.
- F. Noncuring Butyl Sealant: Solvent-based, single component, nonsag, nonskinning, nonhardening, nonbleeding; nonvapor permeable; intended for fully concealed applications.

2.05 SELF-LEVELING JOINT SEALANTS

- A. Self-Leveling Polyurethane Sealant: ASTM C920, Grade P, Uses M and A; single or multicomponent; explicitly approved by manufacturer for traffic exposure; not expected to withstand continuous water immersion .
 - 1. Movement Capability: Plus and minus 35 percent, minimum.
 - 2. Color: To be selected by Architect from manufacturer's standard range.
 - 3. Basis of Design Product:
 - a. Tremco Commercial Sealants & Waterproofing; Vulkem 45 SSL: www.tremcosealants.com/#sle.
 - b. Substitutions: See Section 01 6000 - Product Requirements.

2.06 ACCESSORIES

- A. Sealant Backing Materials, General: Materials placed in joint before applying sealants; assists sealant performance and service life by developing optimum sealant profile and preventing three-sided adhesion; type and size recommended by sealant manufacturer for compatibility with sealant, substrate, and application.
- B. Backing Tape: Self-adhesive polyethylene tape with surface that sealant will not adhere to and recommended by tape and sealant manufacturers for specific application.
- C. Masking Tape: Self-adhesive, nonabsorbent, nonstaining, removable without adhesive residue, and compatible with surfaces adjacent to joints and sealants.
- D. Joint Cleaner: Noncorrosive and nonstaining type, type recommended by sealant manufacturer; compatible with joint forming materials.
- E. Primers: Type recommended by sealant manufacturer to suit application; nonstaining.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that joints are ready to receive work.
- B. Verify that backing materials are compatible with sealants.
- C. Verify that backer rods are of the correct size.

3.02 PREPARATION

- A. Remove loose materials and foreign matter that could impair adhesion of sealant.
- B. Clean joints, and prime as necessary, in accordance with manufacturer's instructions.
- C. Perform preparation in accordance with manufacturer's instructions and ASTM C1193.
- D. Mask elements and surfaces adjacent to joints from damage and disfigurement due to sealant work; be aware that sealant drips and smears may not be completely removable.

3.03 INSTALLATION

- A. Install this work in accordance with sealant manufacturer's requirements for preparation of surfaces and material installation instructions.
- B. Provide joint sealant installations complying with ASTM C1193.
- C. Install acoustical sealant application work in accordance with ASTM C919.
- D. Measure joint dimensions and size joint backers to achieve width-to-depth ratio, neck dimension, and surface bond area as recommended by manufacturer.
- E. Install bond breaker backing tape where backer rod cannot be used.
- F. Install sealant free of air pockets, foreign embedded matter, ridges, and sags, and without getting sealant on adjacent surfaces.
- G. Do not install sealant when ambient temperature is outside manufacturer's recommended temperature range, or will be outside that range during the entire curing period, unless manufacturer's approval is obtained and instructions are followed.

- H. Nonsag Sealants: Tool surface concave, unless otherwise indicated; remove masking tape immediately after tooling sealant surface.

END OF SECTION

**SECTION 08 1113
HOLLOW METAL DOORS AND FRAMES**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Non-fire-rated hollow metal doors and frames.
- B. Hollow metal frames for wood doors.
- C. Fire-rated hollow metal doors and frames.
- D. Thermally insulated hollow metal doors with frames.
- E. Hollow metal borrowed lites glazing frames.

1.02 RELATED REQUIREMENTS

- A. Section 08 7100 - Door Hardware.
- B. Section 08 8000 - Glazing: Glass for doors and borrowed lites.
- C. Section 09 9123 - Interior Painting: Field painting.

1.03 ABBREVIATIONS AND ACRONYMS

- A. ANSI: American National Standards Institute.
- B. ASCE: American Society of Civil Engineers.
- C. HMMA: Hollow Metal Manufacturers Association.
- D. NAAMM: National Association of Architectural Metal Manufacturers.
- E. NFPA: National Fire Protection Association.
- F. SDI: Steel Door Institute.
- G. UL: Underwriters Laboratories.

1.04 REFERENCE STANDARDS

- A. ADA Standards - 2010 ADA Standards for Accessible Design; 2010.
- B. ANSI/SDI A250.4 - Test Procedure and Acceptance Criteria for Physical Endurance for Steel Doors, Frames and Frame Anchors; 2022.
- C. ANSI/SDI A250.8 - Specifications for Standard Steel Doors and Frames (SDI-100); 2023.
- D. ANSI/SDI A250.10 - Test Procedure and Acceptance Criteria for Prime Painted Steel Surfaces for Steel Doors and Frames; 2020.
- E. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2023.
- F. ASTM A1008/A1008M - Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Required Hardness, Solution Hardened, and Bake Hardenable; 2023.
- G. ASTM A1011/A1011M - Standard Specification for Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength; 2023.
- H. ASTM C143/C143M - Standard Test Method for Slump of Hydraulic-Cement Concrete; 2020.
- I. ASTM C476 - Standard Specification for Grout for Masonry; 2023.
- J. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2023a.
- K. ASTM E330/E330M - Standard Test Method for Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference; 2014 (Reapproved 2021).
- L. BHMA A156.115 - Hardware Preparation in Steel Doors and Frames; 2016.

- M. ICC A117.1 - Accessible and Usable Buildings and Facilities; 2017.
- N. ITS (DIR) - Directory of Listed Products; Current Edition.
- O. NAAMM HMMA 805 - Recommended Selection and Usage Guide for Hollow Metal Doors and Frames; 2012.
- P. NAAMM HMMA 830 - Hardware Selection for Hollow Metal Doors and Frames; 2002.
- Q. NAAMM HMMA 831 - Hardware Locations for Hollow Metal Doors and Frames; 2011.
- R. NAAMM HMMA 840 - Guide Specifications For Receipt, Storage and Installation of Hollow Metal Doors and Frames; 2017.
- S. NAAMM HMMA 850 - Fire-Rated Hollow Metal Doors and Frames; 2014.
- T. NAAMM HMMA 860 - Guide Specifications for Hollow Metal Doors and Frames; 2018.
- U. NAAMM HMMA 861 - Guide Specifications for Commercial Hollow Metal Doors and Frames; 2014.
- V. NFPA 80 - Standard for Fire Doors and Other Opening Protectives; 2022.
- W. NFPA 105 - Standard for Smoke Door Assemblies and Other Opening Protectives; 2022.
- X. NFPA 252 - Standard Methods of Fire Tests of Door Assemblies; 2022.
- Y. SDI 117 - Manufacturing Tolerances for Standard Steel Doors and Frames; 2023.
- Z. UL (DIR) - Online Certifications Directory; Current Edition.
- AA. UL 10C - Standard for Positive Pressure Fire Tests of Door Assemblies; Current Edition, Including All Revisions.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Materials and details of design and construction, hardware locations, reinforcement type and locations, anchorage and fastening methods, and finishes.
- C. Shop Drawings: Details of each opening, showing elevations, glazing, frame profiles, and any indicated finish requirements.
- D. Installation Instructions: Manufacturer's published instructions, including any special installation instructions relating to this project.

1.06 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section, with not less than three years documented experience.
- B. Maintain at project site copies of reference standards relating to installation of products specified.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Comply with NAAMM HMMA 840 or ANSI/SDI A250.8 (SDI-100) in accordance with specified requirements.
- B. Protect with resilient packaging; avoid humidity build-up under coverings; prevent corrosion and adverse effects on factory applied painted finish.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Hollow Metal Doors and Frames:
 - 1. Ceco Door, an Assa Abloy Group company: www.assaabloydss.com/#sle.
 - 2. Curries, an Assa Abloy Group company: www.assaabloydss.com/#sle.
 - 3. Steelcraft, an Allegion brand: www.steelcraft.com/#sle.
 - 4. Ambico: www.ambico.com.
 - 5. Substitutions: See Section 01 6000 - Product Requirements.
- B. Hollow Metal Frames for Traffic Doors

1. Eliason Corporation: www.eliasoncorp.com, www.restaurantdoors.net, and www.supermarketdoors.net.
2. Substitutions: See Section 01 6000-Product Requirements.

2.02 PERFORMANCE REQUIREMENTS

- A. Requirements for Hollow Metal Doors and Frames:
 1. Steel Sheet: Comply with one or more of the following requirements; galvanized steel complying with ASTM A653/A653M, cold-rolled steel complying with ASTM A1008/A1008M, or hot-rolled pickled and oiled (HRPO) steel complying with ASTM A1011/A1011M, commercial steel (CS) Type B, for each.
 2. Accessibility: Comply with ICC A117.1 and ADA Standards.
 3. Door Edge Profile: Manufacturers standard for application indicated.
 4. Typical Door Face Sheets: Flush. Refer to Door Schedule for additional information.
 5. Glazed Lights: Non-removable stops on non-secure side; sizes and configurations as indicated on drawings. Style: Manufacturer's standard.
 6. Hardware Preparations, Selections and Locations: Comply with NAAMM HMMA 830 and NAAMM HMMA 831 or BHMA A156.115 and ANSI/SDI A250.8 (SDI-100) in accordance with specified requirements.
 7. Zinc Coating for Typical Interior and/or Exterior Locations: Provide metal components zinc-coated (galvanized) and/or zinc-iron alloy-coated (galvanized) by the hot-dip process in accordance with ASTM A653/A653M, with manufacturer's standard coating thickness, unless noted otherwise for specific hollow metal doors and frames.
 - a. Based on SDI Standards: Provide at least A40/ZF120 (galvanized) when necessary, coating not required for typical interior door applications, and at least A60/ZF180 (galvanized) for corrosive locations.
- B. Combined Requirements: If a particular door and frame unit is indicated to comply with more than one type of requirement, comply with the specified requirements for each type; for instance, an exterior door that is also indicated as being sound-rated must comply with the requirements specified for exterior doors and for sound-rated doors; where two requirements conflict, comply with the most stringent.

2.03 HOLLOW METAL DOORS

- A. Exterior Doors: Thermally insulated.
 1. Based on SDI Standards: ANSI/SDI A250.8 (SDI-100).
 - a. Level 2 - Heavy-duty.
 - b. Physical Performance Level B, 500,000 cycles; in accordance with ANSI/SDI A250.4.
 - c. Model 1 - Full Flush.
 - d. Door Face Metal Thickness: 18 gauge, 0.042 inch (1.0 mm), minimum.
 2. Door Core Material: Manufacturers standard core material/construction and in compliance with requirements.
 - a. Foam Plastic Insulation: Manufacturer's standard board insulation with maximum flame spread index (FSI) of 75, and maximum smoke developed index (SDI) of 450 in accordance with ASTM E84, and completely enclosed within interior of door.
 3. Door Thickness: 1-3/4 inches (44.5 mm), nominal.
 4. Top Closures for Outswinging Doors: Flush with top of faces and edges.
 5. Door Finish: Factory primed and field finished.
- B. Fire-Rated Doors:
 1. Based on SDI Standards: ANSI/SDI A250.8 (SDI-100).
 - a. Level 2 - Heavy-duty.
 - b. Physical Performance Level B, 500,000 cycles; in accordance with ANSI/SDI A250.4.
 - c. Model 1 - Full Flush.
 - d. Door Face Metal Thickness: 18 gauge, 0.042 inch (1.0 mm), minimum.
 2. Fire Rating: As indicated on Door Schedule, tested in accordance with UL 10C and NFPA 252 ("positive pressure fire tests").
 3. Provide units listed and labeled by UL (DIR) or ITS (DIR).

- a. Attach fire rating label to each fire rated unit.
- 4. Door Core Material: Manufacturers standard core material/construction in compliance with requirements.
- 5. Door Thickness: 1-3/4 inches (44.5 mm), nominal.
- 6. Door Finish: Factory primed and field finished.

2.04 HOLLOW METAL FRAMES

- A. Comply with standards and/or custom guidelines as indicated for corresponding door in accordance with applicable door frame requirements.
- B. Exterior Door Frames: Face welded type.
 - 1. Galvanizing: Components hot-dipped zinc-iron alloy-coated (galvannealed) in accordance with ASTM A653/A653M, with A40/ZF120 coating.
 - 2. Frame Metal Thickness: 16 gauge, 0.053 inch (1.3 mm), minimum.
 - 3. Frame Finish: Factory primed and field finished.
 - 4. Weatherstripping: Separate, see Section 08 7100.
- C. Door Frames, Fire-Rated: Face welded type.
 - 1. Fire Rating: Same as door, labeled.
 - 2. Frame Metal Thickness: 16 gauge, 0.053 inch (1.3 mm), minimum.
 - 3. Frame Finish: Factory primed and field finished.
- D. Frames for Traffic Doors: Face welded type.
 - 1. Frame Metal Thickness: 16 gauge, 0.053 inch (1.3 mm).
 - 2. Finish: Same as stainless-steel door finish.
 - 3. Swing Type: Double Acting
- E. Frames for Wood Doors: Comply with frame requirements in accordance with corresponding door.
- F. Mullions for Pairs of Doors: Removable type, with profile similar to jambs.
- G. Borrowed Lites Glazing Frames: Construction and face dimensions to match door frames, and as indicated on drawings.
- H. Frames in Masonry Walls: Size to suit masonry coursing with head member 4 inches (102 mm) high to fill opening without cutting masonry units.
- I. Frames Wider than 48 inches (1219 mm): Reinforce with steel channel fitted tightly into frame head, flush with top.

2.05 FINISHES

- A. Primer: Rust-inhibiting, complying with ANSI/SDI A250.10, door manufacturer's standard.

2.06 ACCESSORIES

- A. Door Window Frames: Door window frames with glazing securely fastened within door opening.
 - 1. Size: As indicated on drawings.
 - 2. Frame Material: 18 gauge, 0.0478 inch (1.21 mm), galvanized steel.
- B. Glazing: As specified in Section 08 8000, factory installed.
- C. Removable Stops: Formed sheet steel, shape as indicated on drawings, mitered or butted corners; prepared for countersink style tamper proof screws.
- D. Astragals for Double Doors: Specified in Section 08 7100.
- E. Mechanical Fasteners for Concealed Metal-to-Metal Connections: Self-drilling, self-tapping, steel with electroplated zinc finish.
 - 1. Manufacturers:
 - a. ITW Commercial Construction North America; ITW CCNA-Buildex Teks Select Series: www.ITWBuildex.com/#sle.
 - b. Substitutions: See Section 01 6000 - Product Requirements.

- F. Grout for Frames: Mortar grout complying with ASTM C476 with maximum slump of 4 inches (102 mm) as measured in accordance with ASTM C143/C143M for hand troweling in place; plaster grout and thinner pumpable grout are prohibited.
- G. Silencers: Resilient rubber, fitted into drilled hole; provide three on strike side of single door, three on center mullion of pairs, and two on head of pairs without center mullions.
- H. Temporary Frame Spreaders: Provide for factory- or shop-assembled frames.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify that opening sizes and tolerances are acceptable.
- C. Verify that finished walls are in plane to ensure proper door alignment.

3.02 PREPARATION

- A. Coat inside of frames to be installed in masonry or to be grouted, with bituminous coating, prior to installation.
 - 1. All exterior hollow metal frames to be grout filled unless noted otherwise.

3.03 INSTALLATION

- A. Install doors and frames in accordance with manufacturer's instructions and related requirements of specified door and frame standards or custom guidelines indicated.
- B. Install fire rated units in accordance with NFPA 80.
- C. Coordinate frame anchor placement with wall construction.
- D. Grout frames in masonry construction, using hand trowel methods; brace frames so that pressure of grout before setting will not deform frames.
- E. Install door hardware as specified in Section 08 7100.
- F. Comply with glazing installation requirements of Section 08 8000.
- G. Touch up damaged factory finishes.

3.04 TOLERANCES

- A. Clearances Between Door and Frame: Comply with related requirements of specified frame standards or custom guidelines indicated in accordance with SDI 117 or NAAMM HMMA 861.
- B. Maximum Diagonal Distortion: 1/16 inch (1.6 mm) measured with straight edge, corner to corner.

3.05 ADJUSTING

- A. Adjust for smooth and balanced door movement.

3.06 SCHEDULE

- A. Refer to Door and Frame Schedule on the drawings.

END OF SECTION

This page intentionally left blank

SECTION 08 1416 FLUSH WOOD DOORS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Flush wood doors; flush and flush glazed configuration; non-rated.

1.02 RELATED REQUIREMENTS

- A. Section 08 1113 - Hollow Metal Doors and Frames.
- B. Section 08 7100 - Door Hardware.
- C. Section 08 8000 - Glazing.

1.03 REFERENCE STANDARDS

- A. AWI/AWMAC/WI (AWS) - Architectural Woodwork Standards, 2nd Edition; 2014, with Errata (2016).
- B. AWMAC/WI (NAAWS) - North American Architectural Woodwork Standards; 2021, with Errata.
- C. WDMA I.S. 1A - Interior Architectural Wood Flush Doors; 2021, with Errata (2022).

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Indicate door core materials and construction; veneer species, type and characteristics.
- C. Shop Drawings: Show doors and frames, elevations, sizes, types, swings, undercuts, beveling, blocking for hardware, factory machining, factory finishing, cutouts for glazing and other details.
- D. Samples: Submit two samples of door veneer, in size illustrating wood grain, stain color, and sheen.
- E. Manufacturer's Installation Instructions: Indicate special installation instructions.
- F. Warranty, executed in Owner's name.

1.05 QUALITY ASSURANCE

- A. Maintain one copy of the specified door quality standard on site for review during installation and finishing.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section, with not less than three years of documented experience.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Package, deliver and store doors in accordance with specified quality standard.
- B. Accept doors on site in manufacturer's packaging, and inspect for damage.
- C. Protect doors with resilient packaging sealed with heat shrunk plastic; do not store in damp or wet areas or areas where sunlight might bleach veneer; seal top and bottom edges with tinted sealer if stored more than one week, and break seal on site to permit ventilation.

1.07 WARRANTY

- A. See Section 01 7800 - Closeout Submittals for additional warranty requirements.
- B. Manufacturer Warranty: Provide manufacturer's warranty on interior doors for the life of the installation. Complete forms in Owner's name and register with manufacturer.
 - 1. Include coverage for delamination of veneer, warping beyond specified installation tolerances, defective materials, and telegraphing core construction.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Wood Veneer Faced Doors:

1. Masonite Architectural; Aspiro Select Wood Veneer Doors:
www.architectural.masonite.com/#sle.
2. VT Industries, Inc: www.vtindustries.com/#sle.
3. Substitutions: See Section 01 6000 - Product Requirements.

2.02 DOORS AND PANELS

- A. Doors: See drawings for locations and additional requirements.
 1. Quality Standard: Custom Grade, Heavy Duty performance, in accordance with AWI/AWMAC/WI (AWS), AWMAC/WI (NAAWS) or WDMA I.S. 1A.
 2. Wood Veneer Faced Doors: 5-ply unless otherwise indicated.
- B. Interior Doors: 1-3/4 inches (44 mm) thick unless otherwise indicated; flush construction.
 1. Provide solid core doors at each location.
 2. Wood veneer facing with factory transparent finish.

2.03 DOOR AND PANEL CORES

- A. Non-Rated Solid Core and 20 Minute Rated Doors: Type structural composite lumber core (SCLC), plies and faces as indicated.

2.04 DOOR FACINGS

- A. Veneer Facing for Transparent Finish: White oak, veneer grade in accordance with quality standard indicated, rift cut (only red and white oak), with book match between leaves of veneer, running match of spliced veneer leaves assembled on door or panel face.
 1. Vertical Edges: Same species as face veneer.
 2. "Pair Match" each pair of doors; "Set Match" pairs of doors within 10 feet (3 m) of each other when doors are closed.
- B. Facing Adhesive: Type I - waterproof.

2.05 DOOR CONSTRUCTION

- A. Fabricate doors in accordance with door quality standard specified.
- B. Cores Constructed with stiles and rails:
 1. Provide solid blocks at lock edge for hardware reinforcement.
 2. Provide solid blocking for other throughbolted hardware.
- C. Glazed Openings: Non-removable stops on non-secure side; sizes and configurations as indicated on drawings. All doors with glazing to come with glass factory installed.
- D. Factory machine doors for hardware other than surface-mounted hardware, in accordance with hardware requirements and dimensions.
- E. Factory fit doors for frame opening dimensions identified on shop drawings, with edge clearances in accordance with specified quality standard.
- F. Provide edge clearances in accordance with the quality standard specified.

2.06 FINISHES - WOOD VENEER DOORS

- A. Finish work in accordance with AWI/AWMAC/WI (AWS) or AWMAC/WI (NAAWS), Section 5 - Finishing for grade specified and as follows:
 1. Transparent:
 - a. System - 9, UV Curable, Acrylated Epoxy, Polyester or Urethane.
 - b. Stain: Custom stained as selected by Architect.
 - c. Sheen: Satin.
- B. Factory finish doors in accordance with approved sample.

2.07 ACCESSORIES

- A. Hollow Metal Door Frames: See Section 08 1113.
- B. Glazing: See Section 08 8000. All doors with glass are to be factory glazed.
- C. Glazing Stops: Wood, of same species as door facing, butted corners; prepared for countersink style tamper proof screws.

- D. Door Hardware: See Section 08 7100.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify that opening sizes and tolerances are acceptable.
- C. Do not install doors in frame openings that are not plumb or are out-of-tolerance for size or alignment.

3.02 INSTALLATION

- A. Install doors in accordance with manufacturer's instructions and specified quality standard.
- B. Factory-Finished Doors: Do not field cut or trim; if fit or clearance is not correct, replace door.
- C. Use machine tools to cut or drill for hardware.
- D. Coordinate installation of doors with installation of frames and hardware.
- E. Coordinate installation of glazing.

3.03 TOLERANCES

- A. Comply with specified quality standard for fit and clearance tolerances.
- B. Comply with specified quality standard for telegraphing, warp, and squareness.

3.04 ADJUSTING

- A. Adjust doors for smooth and balanced door movement.
- B. Adjust closers for full closure.

END OF SECTION

This page intentionally left blank

**SECTION 08 3100
ACCESS DOORS AND PANELS**

PART 2 PRODUCTS

1.01 ACCESS DOORS AND PANELS ASSEMBLIES

END OF SECTION

This page intentionally left blank

**SECTION 08 3313
COILING COUNTER DOORS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Non-fire-rated coiling counter doors and operating hardware.

1.02 REFERENCE STANDARDS

- A. ASTM B221 - Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes; 2021.

1.03 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Submit manufacturer's standard literature showing materials and details of construction and finish. Include data on electrical operation.
- C. Shop Drawings: Indicate rough and actual opening dimensions, anchorage methods, hardware locations, and installation details.
- D. Manufacturer's qualification statement.
- E. Installer's qualification statement.
- F. Operation and Maintenance Data: Indicate modes of operation, lubrication requirements and frequency, and periodic adjustments required.

1.04 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years of documented experience.
- B. Installer Qualifications: Company specializing in performing work of type specified and with at least three years documented experience.

1.05 WARRANTY

- A. See Section 01 7800 - Closeout Submittals for additional warranty requirements.
- B. Manufacturer Warranty: Provide 2-year manufacturer warranty for counterbalance shaft assembly. Complete forms in Owner's name and register with manufacturer.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Coiling Counter Doors:
 - 1. Overhead Door Corporation; Counter Door - Model 652: www.overheaddoor.com/#sle.
 - 2. Substitutions: See Section 01 6000 - Product Requirements.

2.02 COILING COUNTER DOORS

- A. Coiling Counter Metal Doors, Non-Fire-Rated: Aluminum slat curtain.
 - 1. Mounting: Between jambs, within prepared opening.
 - 2. Provide integral frame and sill of same material and finish.
 - 3. Nominal Slat Size: 1-1/4 inches (32 mm) wide.
 - 4. Slat Profile: Flat, perforated.
 - 5. Finish, Aluminum: Anodized.
 - 6. Guides: Formed track; same material and finish unless otherwise indicated.
 - 7. Hood Enclosure: Manufacturer's standard; aluminum.
 - 8. Manual hand chain lift operation.
 - 9. Locking Devices: Slide bolt on inside.

2.03 COMPONENTS

- A. Metal Curtain Construction: Interlocking, single-thickness slats.
 - 1. Slat Ends: Alternate slats fitted with end locks to act as wearing surface in guides and to prevent lateral movement.

2. Curtain Bottom: Fitted with angles to provide reinforcement and positive contact in closed position.
 3. Aluminum Slats: ASTM B221 (ASTM B221M), aluminum alloy Type 6063; minimum thickness 0.05 inch (1.3 mm).
- B. Guide Construction: Continuous, of profile to retain door in place, with mounting brackets of same metal.
 1. Aluminum Guides: Extruded aluminum channel, with wool pile runners along inside.
 - C. Hood Enclosure: Internally reinforced to maintain rigidity and shape.
 - D. Lock Hardware:
 1. Slide Bolt: Provide on single-jamb side, extending into slot in guides, with padlock on one side.
 - E. Roller Shaft Counterbalance: Steel pipe and torsion steel spring system, capable of producing torque sufficient to ensure smooth operation of curtain from any position and capable of holding position at mid-travel; with adjustable spring tension; requiring 25 lb (10 kg) nominal force to operate.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that adjacent construction is suitable for door installation.
- B. Verify that door opening is plumb, header is level, and dimensions are correct.
- C. Notify Architect of any unacceptable conditions or varying dimensions.
- D. Commencement of installation indicates acceptance of substrate and door opening conditions.

3.02 INSTALLATION

- A. Install units in accordance with manufacturer's instructions.
- B. Use anchorage devices to securely fasten assembly to wall construction and building framing without distortion or stress.
- C. Securely and rigidly brace components suspended from structure. Secure guides to structural members only.
- D. Fit and align assembly including hardware; level and plumb, to provide smooth operation.

3.03 TOLERANCES

- A. Maintain dimensional tolerances and alignment with adjacent work.
- B. Maximum Variation From Plumb: 1/16 inch (1.5 mm).
- C. Maximum Variation From Level: 1/16 inch (1.5 mm).
- D. Longitudinal or Diagonal Warp: Plus or minus 1/8 inch per 10 ft (3 mm per 3 m) straight edge.

3.04 ADJUSTING

- A. Adjust operating assemblies for smooth and noiseless operation.

3.05 CLEANING

- A. Clean installed components.
- B. Remove labels and visible markings.

END OF SECTION

SECTION 08 3330 SECURITY GRILLES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Side Folding Security Grilles, manually operated.

1.02 RELATED SECTIONS

- A. Section 08 7100 - Door Hardware: Product Requirements for cylinder core and keys.

1.03 REFERENCES

- A. ASTM A 653 - Standard Specification for Steel Sheet, Zinc-Coated/Galvanized or Zinc-Iron Alloy-Coated/Galvannealed by the Hot-Dip Process.
- B. ASTM A 666 - Standard Specification for Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar.
- C. ASTM A 924 - Standard Specification for General Requirements for Steel Sheet, Metallic-Coated by the Hot-Dip Process.
- D. ASTM B 221 - Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes.
- E. ASTM B 221 - Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes - Metric.

1.04 SUBMITTALS

- A. See Section 01 3000-Administrative Requirements for submittal procedures.
- B. Product Data: Manufacturer's data sheets on each product to be used, including:
 - 1. Preparation instructions and recommendations.
 - 2. Storage and handling requirements and recommendations.
 - 3. Installation methods.
- C. Shop Drawings: Include detailed plans, elevations, details of framing members, required clearances, anchors, and accessories. Include relationship with adjacent materials.
- D. Selection Samples: For each finish product specified, two complete sets of color chips representing manufacturer's full range of available colors and patterns.
- E. Verification Samples: For each finish product specified, two samples, representing actual product, color, and patterns.
- F. Manufacturer's Certificates: Certify products meet or exceed specified requirements.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in performing Work of this section with a minimum of five years experience in the fabrication and installation of security closures.
- B. Installer Qualifications: Company specializing in performing Work of this section with minimum three years and approved by manufacturer.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Store products in manufacturer's unopened packaging until ready for installation.
- B. Protect materials from exposure to moisture. Do not deliver until after wet work is complete and dry.
- C. Store materials in a dry, warm, ventilated weathertight location.

1.07 COORDINATION

- A. Coordinate Work with other operations and installation of adjacent finish materials to avoid damage to installed materials.

1.08 WARRANTY

- A. See Section 01 7800-Closeout Submittals for additional warranty requirements.

- B. Manufacturer Warranty: Provide manufacturer's warranty for a minimum of two years from the date of substantial completion. Complete forms in Owner's name and register with manufacturer.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Side Folding Security Grilles and accessories:
 - 1. Overhead Door Corporation, 2501 S. State Hwy. 121, Suite 200, Lewisville, TX 75067. ASD. Tel. Toll Free: (800) 275-3290.
 - 2. Dynamic Closures Corporation. (www.dynamicclosures.com)
 - 3. Substitutions: See Section 01 6000 - Product Requirements.

2.02 SIDE FOLDING SECURITY GRILLES

- A. Side-Folding Open Aluminum Grilles:
 - 1. Basis of Design Product: Overhead Door Corporation Model 683.
 - 2. Curtain: Constructed of 1/8 inch (3 mm) by 5/8 inch (17 mm) by 6 inch (152 mm) horizontal clear anodized aluminum links that slide into 5/16 inch (8 mm) vertical rods. Links held in place by 1/2 inch (16 mm) clear anodized aluminum S-126 spacer tubes on alternate rods.
 - a. Panel Width: 6-5/16 inch (160 mm)
 - b. Pattern: Straight
 - 3. Finish:
 - a. Aluminum clear anodized.
 - 4. Track:
 - a. Trolley assemblies shall be 1-1/8 inch (29 mm) and adjustable 1 inch (25 mm) upward or downward without the removal of the curtain.
 - 5. Locking:
 - a. Provide a top and bottom spring loaded locking post with interior thumb turn and protection, exterior keyed cylinder, and dustproof floor sockets for all drop bolts. Provide rubber bumper at the edge of lead post.

2.03 ACCESSORIES

- A. Pocket Door:
 - 1. Basis of Design Product: Dynamic Closures Elite Pocket Door.
 - 2. Locking: Thumb-turn lock.
 - 3. Hand Operation: Left Hand.
 - 4. Finish: Shop primed, field painted. Color to match the wall in which it is installed.
 - a. Hinges and cylinders, is not to be field painted

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify opening sizes, tolerances and conditions are acceptable.
- B. Examine conditions of substrates, supports, and other conditions under which this work is to be performed.
- C. If substrate preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.

3.02 PREPARATION

- A. Clean surfaces thoroughly prior to installation.
- B. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.

3.03 INSTALLATION

- A. Install in accordance with manufacturer's instructions.

- B. Use anchorage devices to securely fasten assembly to wall construction and building framing without distortion or stress.
- C. Securely and rigidly brace components suspended from structure. Secure guides to structural members only.
- D. Fit and align assembly including hardware; level and plumb, to provide smooth operation.
- E. Coordinate installation of sealants and backing materials at frame perimeter as specified in Section 07 9200.
- F. Install perimeter trim and closures.

3.04 ADJUSTING

- A. Test security grilles for proper operation and adjust as necessary to provide proper operation without binding or distortion.
- B. Adjust hardware and operating assemblies for smooth and noiseless operation.

3.05 CLEANING

- A. Clean curtain and components using non-abrasive materials and methods recommended by manufacturer.
- B. Remove labels and visible markings.
- C. Touch-up, repair or replace damaged products before Substantial Completion.

3.06 PROTECTION

- A. Protect installed products until completion of project.

END OF SECTION

This page intentionally left blank

SECTION 08 3800 TRAFFIC DOORS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Rigid and semi-rigid traffic doors.
- B. Door accessories.
- C. Door frames.

1.02 RELATED REQUIREMENTS

- A. Section 08 1213 - Hollow Metal Frames: Flat-faced frame.
- B. Section 08 7100 - Door Hardware: Wall-mounted door stops.

1.03 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Manufacturer's technical information for each type of door specified, including details about materials, components, profiles, gaskets, and finishes; include:
 - 1. Preparation and installation instructions and methods.
 - 2. Storage and handling requirements and recommendations.
 - 3. Operation and maintenance data.
- C. Shop Drawings: Indicate installation details of doors and frames, including elevations and attachment.
- D. Manufacturer's qualification statement.
- E. Executed warranty.
- F. Specimen warranty.

1.04 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products of type specified in this section, with not less than three years of documented experience.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Deliver product in manufacturer's original unopened packages with label legible and intact.
- B. Store doors at project site on edge or in upright position, under cover and elevated above grade, following manufacturer's instructions.

1.06 WARRANTY

- A. See Section 01 7800 - Closeout Submittals for additional warranty requirements.
- B. Manufacturer Warranty: Provide 2-year manufacturer warranty for molded polyethylene doors against damage due to vehicle traffic; state limitations in executed warranty. Complete forms in Owner's name and register with manufacturer.

PART 2 PRODUCTS

2.01 RIGID AND SEMI-RIGID TRAFFIC DOORS

- A. Construction: Manufacturer's standard.
 - 1. Door Assemblies: Double-acting, self-closing door; factory fabricated and finished, complete with hinges and specified accessories.
 - a. Door Swing: Minimum of 90 degrees each direction.
 - b. Hinges: V-cam gravity hinges at top and pivots at bottom; mounted on bottom of header and on top of floor; maximum rise 1-1/2 inches (38 mm); vertical and horizontal adjustment in the field; manufacturer's standard lower hinge guards.
 - c. Hinge Guards: Manufacturer's standard material and configuration to protect lower hinge finish floors from damage.
 - d. Exposed Metal Parts: Stainless steel.

- e. Dimensional Tolerances: Plus or minus 1/4 inch (6 mm) in width and height of each panel.
- 2. View Windows: Factory-installed glazing in molded or extruded black thermoplastic or rubber gasket.
 - a. Configuration: One window in each door panel unless otherwise indicated on drawings, centered in door width, and 48 inches (1220 mm), maximum, from finished floor to bottom of viewing area.
 - b. Square-Shaped Window Size: 9 inches (229 mm) by 14 inches (356 mm).
 - c. Glazing: Manufacturer's standard; use single glazing unless otherwise indicated on drawings.
 - 1) Single Glazing: Acrylic glazing sheet, 1/4-inch (6 mm) thick, clear.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that jambs and frames are square and plumb.
- B. Verify that opening is ready to receive work and opening dimensions and clearances are as indicated on drawings.
- C. If substrate preparation is responsibility of another installer, notify Architect of unsatisfactory conditions before proceeding.
- D. Commencement of work by installer indicates acceptance of opening conditions.

3.02 PREPARATION

- A. Clean surfaces thoroughly prior to installation.

3.03 INSTALLATION

- A. Install doors with clearances, anchors, hardware, and accessories according to the manufacturer's instructions and as specified.
- B. Install doors plumb, level, and properly aligned.

3.04 ADJUSTING

- A. Clean and lubricate operating parts.
- B. Adjust doors to open and close smoothly and freely without binding and for proper fit of seals.

3.05 CLEANING

- A. Clean surfaces using methods as recommended by manufacturer.

3.06 PROTECTION

- A. Protect installed products until completion of project.
- B. Touch-up, repair or replace damaged products before Date of Substantial Completion.

END OF SECTION

SECTION 08 4313
ALUMINUM-FRAMED STOREFRONTS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Aluminum-framed storefront, with vision glass.
- B. Aluminum doors and frames.
- C. Weatherstripping.

1.02 RELATED REQUIREMENTS

- A. Section 05 5000 - Metal Fabrications: Steel attachment devices.
- B. Section 07 2500 - Weather Barriers: Sealing framing to water-resistive barrier installed on adjacent construction.
- C. Section 07 9200 - Joint Sealants: Sealing joints between frames and adjacent construction.
- D. Section 08 7100 - Door Hardware: Hardware items other than specified in this section.
- E. Section 08 8000 - Glazing: Glass and glazing accessories.
- F. Section 12 2400 - Window Shades: Attachments to framing members.

1.03 REFERENCE STANDARDS

- A. AAMA CW-10 - Care and Handling of Architectural Aluminum from Shop to Site; 2015.
- B. AAMA 501.2 - Quality Assurance and Diagnostic Water Leakage Field Check of Installed Storefronts, Curtain Walls, and Sloped Glazing Systems; 2015.
- C. AAMA 503 - Voluntary Specification for Field Testing of Newly Installed Storefronts, Curtain Walls and Sloped Glazing Systems; 2014.
- D. AAMA 609 & 610 - Cleaning and Maintenance Guide for Architecturally Finished Aluminum (Combined Document); 2015.
- E. AAMA 611 - Voluntary Specification for Anodized Architectural Aluminum; 2020.
- F. AAMA 1503 - Voluntary Test Method for Thermal Transmittance and Condensation Resistance of Windows, Doors and Glazed Wall Sections; 2009.
- G. ASTM A36/A36M - Standard Specification for Carbon Structural Steel; 2019.
- H. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products; 2017.
- I. ASTM B221 - Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes; 2021.
- J. ASTM B221M - Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes (Metric); 2021.
- K. ASTM E283/E283M - Standard Test Method for Determining Rate of Air Leakage Through Exterior Windows, Skylights, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen; 2019.
- L. ASTM E330/E330M - Standard Test Method for Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference; 2014 (Reapproved 2021).
- M. ASTM E331 - Standard Test Method for Water Penetration of Exterior Windows, Skylights, Doors, and Curtain Walls by Uniform Static Air Pressure Difference; 2000 (Reapproved 2023).
- N. ASTM E783 - Standard Test Method for Field Measurement of Air Leakage Through Installed Exterior Windows and Doors; 2002 (Reapproved 2018).
- O. ASTM E1105 - Standard Test Method for Field Determination of Water Penetration of Installed Exterior Windows, Skylights, Doors, and Curtain Walls, by Uniform or Cyclic Static Air Pressure Difference; 2015 (Reapproved 2023).

- P. SSPC-Paint 20 - Zinc-Rich Primers (Type I, "Inorganic," and Type II, "Organic"); 2002 (Ed. 2004).

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordinate with installation of other components that comprise the exterior enclosure.
- B. Preinstallation Meeting: Conduct a preinstallation meeting one week before starting work of this section; require attendance by all affected installers.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide component dimensions, describe components within assembly, anchorage and fasteners, glass and infill, and internal drainage details.
- C. Shop Drawings: Indicate system dimensions, framed opening requirements and tolerances, affected related work, expansion and contraction joint location and details, and field welding required.
- D. Samples: Submit two samples 12x12 inches (304.8x304.8 mm) in size illustrating finished aluminum surface, glass, infill panels, glazing materials.
- E. Manufacturer's Certificate: Certify that the products supplied meet or exceed the specified requirements.
- F. Design Data: Provide framing member structural and physical characteristics, engineering calculations, and dimensional limitations.
- G. Hardware Schedule: Complete itemization of each item of hardware to be provided for each door, cross-referenced to door identification numbers in Contract Documents.
- H. Field Quality Control Submittals: Report of field testing for water penetration and air leakage.
- I. Designer's qualification statement.
- J. Manufacturer's qualification statement.
- K. Installer's qualification statement.

1.06 QUALITY ASSURANCE

- A. Designer Qualifications: Design structural support framing components under direct supervision of a Professional Structural Engineer experienced in design of this Work and licensed in Oklahoma.
- B. Manufacturer Qualifications: Company specializing in performing work of type specified and with at least three years of documented experience.
 - 1. Provide certified glass products through ANSI accredited certifications that include plant audits and independent laboratory performance testing.
 - a. Insulating Glass Certification Council (IGCC).
 - b. Safety Glazing Certification Council (SGCC).
- C. Installer Qualifications: Company specializing in performing work of type specified and with at least three years of documented experience.
 - 1. Provide company, field supervisors, and installers that hold active ANSI accredited certifications in appropriate categories for work specified.
 - a. North American Contractor Certification (NACC) for glazing contractors.
 - b. Equivalent independent third-party ANSI accredited certification.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Handle products of this section in accordance with AAMA CW-10.
- B. Protect finished aluminum surfaces with wrapping. Do not use adhesive papers or sprayed coatings that bond to aluminum when exposed to sunlight or weather.

1.08 FIELD CONDITIONS

- A. Do not install sealants when ambient temperature is less than 40 degrees F (5 degrees C). Maintain this minimum temperature during and 48 hours after installation.

1.09 WARRANTY

- A. See Section 01 7800 - Closeout Submittals for additional warranty requirements.
- B. Correct defective Work within a five year period after Date of Substantial Completion.
- C. Provide five year manufacturer warranty against failure of glass seal on insulating glass units, including interpane dusting or misting. Include provision for replacement of failed units.
- D. Provide 20 year manufacturer warranty against excessive degradation of exterior finish. Include provision for replacement of units with excessive fading, chalking, or flaking.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Aluminum-Framed Storefronts:
 - 1. Boyd Aluminum; Series B450: www.boydaluminum.com/#sle.
 - 2. Kawneer North America; Trifab VersaGlaze 451T: www.kawneer.com/#sle.
 - 3. Oldcastle BuildingEnvelope; Series 3000XT: www.oldcastlebe.com/#sle.
 - 4. Substitutions: See Section 01 6000 - Product Requirements.

2.02 ALUMINUM-FRAMED STOREFRONT

- A. Aluminum-Framed Storefront: Factory fabricated, factory finished aluminum framing members with infill, and related flashings, anchorage and attachment devices.
 - 1. Glazing Position: Centered (front to back).
 - 2. Frame Dimensions: As indicated on drawings.
 - 3. Finish: Class I natural anodized.
 - a. Factory finish all surfaces that will be exposed in completed assemblies.
 - b. Coat concealed metal surfaces that will be in contact with cementitious materials or dissimilar metals with bituminous paint.
 - 4. Finish Color: Anodized Aluminum.
 - 5. Fabrication: Joints and corners flush, hairline, and weatherproof, accurately fitted and secured; prepared to receive anchors and hardware; fasteners and attachments concealed from view; reinforced as required for imposed loads.
 - 6. Construction: Eliminate noises caused by wind and thermal movement, prevent vibration harmonics, and prevent "stack effect" in internal spaces.
 - 7. System Internal Drainage: Drain to the exterior by means of a weep drainage network any water entering joints, condensation occurring in glazing channel, and migrating moisture occurring within system.
 - 8. Expansion/Contraction: Provide for expansion and contraction within system components caused by cycling temperature range of 170 degrees F (95 degrees C) over a 12 hour period without causing detrimental effect to system components, anchorages, and other building elements.
 - 9. Movement: Allow for movement between storefront and adjacent construction, without damage to components or deterioration of seals.
 - 10. Perimeter Clearance: Minimize space between framing members and adjacent construction while allowing expected movement.
- B. Performance Requirements
 - 1. Wind Loads: Design and size components to withstand the specified load requirements without damage or permanent set, when tested in accordance with ASTM E330/E330M, using loads 1.5 times the design wind loads and 10 second duration of maximum load.
 - a. Member Deflection: Limit member deflection to flexure limit of glass in any direction, with full recovery of glazing materials.
 - 2. Water Penetration Resistance on Manufactured Assembly: No uncontrolled water on interior face, when tested in accordance with ASTM E331 at pressure differential of 8 psf

- (390 Pa).
3. Air Leakage: 0.06 cfm/sq ft (0.3 L/sec sq m) maximum leakage of storefront wall area when tested in accordance with ASTM E283/E283M at 1.57 psf (75 Pa) pressure difference.
 4. Air Leakage: 0.06 cfm/sq ft (0.3 L/sec sq m) maximum leakage of storefront wall area when tested in accordance with ASTM E283/E283M at 1.57 psf (75 Pa) pressure difference.

2.03 COMPONENTS

- A. Aluminum Framing Members: Tubular aluminum sections, thermally broken with interior section insulated from exterior, drainage holes and internal weep drainage system.
 1. Glazing Stops: Flush.
- B. Glazing: See Section 08 8000.
- C. Swing Doors: Glazed aluminum.
 1. Top Rail: As indicated on drawings.
 2. Vertical Stiles: As indicated on drawings.
 3. Bottom Rail: As indicated on drawings.
 4. Finish: Same as storefront.
 5. Thermal performance of the door and door glazing is to equal or exceed that of the corresponding storefront system.

2.04 MATERIALS

- A. Extruded Aluminum: ASTM B221 (ASTM B221M).
- B. Structural Steel Sections: ASTM A36/A36M; galvanized in accordance with requirements of ASTM A123/A123M.
- C. Fasteners: Stainless steel.
- D. Sill Flashing Sealant: Silicone compatible with flashing material.
- E. Sealant for Setting Thresholds: Non-curing butyl type.
- F. Glazing Gaskets: Type to suit application to achieve weather, moisture, and air infiltration requirements.
- G. Glazing Accessories: See Section 08 8000.
- H. Shop and Touch-Up Primer for Steel Components: Zinc oxide, alkyd, linseed oil primer appropriate for use over hand cleaned steel.
- I. Touch-Up Primer for Galvanized Steel Surfaces: SSPC-Paint 20, zinc rich.

2.05 FINISHES

- A. Class I Natural Anodized Finish: AAMA 611 AA-M12C22A41 Clear anodic coating not less than 0.7 mils (0.018 mm) thick.
- B. Touch-Up Materials: As recommended by coating manufacturer for field application.

2.06 HARDWARE

- A. For each door, include weatherstripping, sill sweep strip, and threshold.
- B. Other Door Hardware: See Section 08 7100.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions, dimensions, tolerances, and method of attachment with other work.
- B. Verify that storefront wall openings and adjoining water-resistive and/or air barrier seal materials are ready to receive work of this section.

3.02 INSTALLATION

- A. Install wall system in accordance with manufacturer's instructions.

- B. Attach to structure to permit sufficient adjustment to accommodate construction tolerances and other irregularities.
- C. Provide alignment attachments and shims to permanently fasten system to building structure.
- D. Align assembly plumb and level, free of warp or twist. Maintain assembly dimensional tolerances, aligning with adjacent work.
- E. Provide thermal isolation where components penetrate or disrupt building insulation.
- F. Install sill flashings. Turn up ends and edges a minimum of 4"; seal to adjacent work to form water tight dam.
- G. Where fasteners penetrate sill flashings, make watertight by seating and sealing fastener heads to sill flashing.
- H. Pack fibrous insulation in shim spaces at perimeter of assembly to maintain continuity of thermal barrier.
- I. Set thresholds in bed of sealant and secure.
- J. Touch-up minor damage to factory applied finish; replace components that cannot be satisfactorily repaired.

3.03 TOLERANCES

- A. Maximum Variation from Plumb: 0.06 inch per 3 feet (1.5 mm per m) non-cumulative or 0.06 inch per 10 feet (1.5 mm per 3 m), whichever is less.
- B. Maximum Misalignment of Two Adjoining Members Abutting in Plane: 1/32 inch (0.8 mm).

3.04 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements for independent field testing and inspection requirements, and requirements for monitoring quality of specified product installations.
- B. Water-Spray Test: Provide water spray quality test of installed storefront components in accordance with AAMA 501.2 during construction process and before installation of interior finishes.
 - 1. Perform a minimum of two tests in each designated area as directed by Architect.
 - 2. Conduct tests in each area prior to 50 percent completion of this work.
- C. Provide field testing of installed storefront system by independent laboratory in accordance with AAMA 503 during construction process and before installation of interior finishes.
 - 1. Perform a minimum of two tests in each designated area as directed by Architect.
 - 2. Conduct tests in each area prior to 10 percent and 50 percent completion of this work.
 - 3. Field test for water penetration in accordance with ASTM E1105 with uniform static air pressure difference (Procedure A) not less than 4.18 psf (200 Pa).
 - a. Maximum allowable rate of water penetration in 15-minute test is 0.5 ounce (14 gram) that is not contained in an area with provisions to drain to exterior, or collected on surface of interior horizontal framing member.
 - 4. Field test for air leakage in accordance with ASTM E783 with uniform static air pressure difference of 1.57 psf (75 Pa).
- D. Repair or replace storefront components that have failed designated field testing, and retest to verify performance complies with specified requirements.

3.05 ADJUSTING

- A. Adjust operating hardware and sash for smooth operation and compliance with all applicable accessibility codes.

3.06 CLEANING

- A. Remove protective material from pre-finished aluminum surfaces.
- B. Wash down surfaces with a solution of mild detergent in warm water, applied with soft, clean wiping cloths, and take care to remove dirt from corners and to wipe surfaces clean.

- C. Upon completion of installation, thoroughly clean aluminum surfaces in accordance with AAMA 609 & 610.

3.07 PROTECTION

- A. Protect installed products from damage until Date of Substantial Completion.

END OF SECTION

SECTION 08 5113 ALUMINUM WINDOWS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Extruded aluminum windows with fixed sash.

1.02 RELATED REQUIREMENTS

- A. Section 06 1000 - Rough Carpentry: Rough opening framing.
- B. Section 07 2500 - Weather Barriers: Sealing frame to water-resistive barrier installed on adjacent construction.
- C. Section 07 9200 - Joint Sealants: Sealing joints between window frames and adjacent construction.
- D. Section 08 8000 - Glazing.

1.03 REFERENCE STANDARDS

- A. AAMA/WDMA/CSA 101/I.S.2/A440 - North American Fenestration Standard/Specification for Windows, Doors, and Skylights; 2022.
- B. AAMA CW-10 - Care and Handling of Architectural Aluminum from Shop to Site; 2015.
- C. AAMA 502 - Voluntary Specification for Field Testing of Newly Installed Fenestration Products; 2021.
- D. AAMA 609 & 610 - Cleaning and Maintenance Guide for Architecturally Finished Aluminum (Combined Document); 2015.
- E. AAMA 611 - Voluntary Specification for Anodized Architectural Aluminum; 2020.
- F. AAMA 1503 - Voluntary Test Method for Thermal Transmittance and Condensation Resistance of Windows, Doors and Glazed Wall Sections; 2009.
- G. ASHRAE Std 90.1 I-P - Energy Standard for Buildings Except Low-Rise Residential Buildings; Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- H. ASTM A123/A123M - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products; 2017.
- I. ASTM B209/B209M - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate; 2021a.
- J. ASTM B221 - Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes; 2021.
- K. ASTM B221M - Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes (Metric); 2021.
- L. ASTM E283/E283M - Standard Test Method for Determining Rate of Air Leakage Through Exterior Windows, Skylights, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen; 2019.
- M. ASTM E331 - Standard Test Method for Water Penetration of Exterior Windows, Skylights, Doors, and Curtain Walls by Uniform Static Air Pressure Difference; 2000 (Reapproved 2023).
- N. ASTM E783 - Standard Test Method for Field Measurement of Air Leakage Through Installed Exterior Windows and Doors; 2002 (Reapproved 2018).
- O. ASTM E1105 - Standard Test Method for Field Determination of Water Penetration of Installed Exterior Windows, Skylights, Doors, and Curtain Walls, by Uniform or Cyclic Static Air Pressure Difference; 2015 (Reapproved 2023).
- P. SSPC-Paint 20 - Zinc-Rich Primers (Type I, "Inorganic," and Type II, "Organic"); 2002 (Ed. 2004).

1.04 ADMINISTRATIVE REQUIREMENTS

- A. Coordinate with installation of other components that comprise the exterior enclosure.
- B. Preinstallation Meeting: Convene one week before starting work of this section.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Include component dimensions, information on glass and glazing, internal drainage details, and descriptions of hardware and accessories.
- C. Shop Drawings: Indicate opening dimensions, elevations of different types, framed opening tolerances, anchorage locations, and installation requirements.
- D. Samples:
 - 1. Framing: Two samples, 12 by 12 inch (300 by 300 mm) in size illustrating typical corner construction, accessories, and finishes.
- E. Grade Substantiation: Prior to submitting shop drawings or starting fabrication, submit one of the following showing compliance with specified grade:
 - 1. Evidence of AAMA Certification.
 - 2. Evidence of WDMA Certification.
 - 3. Evidence of CSA Certification.
 - 4. Test report(s) by independent testing agency itemizing compliance and acceptable to authorities having jurisdiction.
- F. Test Reports: Prior to submitting shop drawings or starting fabrication, submit test report(s) by independent testing agency showing compliance with performance requirements in excess of those prescribed by specified grade.
- G. Manufacturer's Installation Instructions: Include complete preparation, installation, and cleaning requirements.
- H. Field Quality Control Submittals: Report of field testing for water penetration and air leakage.
- I. Manufacturer's qualification statement.
- J. Installer's qualification statement.

1.06 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section with minimum three years of documented experience.
- B. Installer Qualifications: Company specializing in performing work of type specified and with at least three years of documented experience.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Comply with requirements of AAMA CW-10.
- B. Protect finished surfaces with wrapping paper or strippable coating during installation. Do not use adhesive papers or sprayed coatings that bond to substrate when exposed to sunlight or weather.

1.08 FIELD CONDITIONS

- A. Do not install sealants when ambient temperature is less than 40 degrees F (5 degrees C).
- B. Maintain this minimum temperature during and 48 hours after installation of sealants.

1.09 WARRANTY

- A. See Section 01 7800 - Closeout Submittals for additional warranty requirements.
- B. Correct defective work within a five year period after Date of Substantial Completion.
- C. Manufacturer Warranty: Provide 5-year manufacturer warranty against failure of glass seal on insulating glass units, including interpane dusting or misting. Include provision for replacement of failed units. Complete forms in Owner's name and register with manufacturer.

- D. Manufacturer Warranty: Provide 20-year manufacturer warranty against excessive degradation of exterior finish. Include provision for replacement of units with excessive fading, chalking, or flaking. Complete forms in Owner's name and register with manufacturer.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Basis of Design: Oldcastle Building Envelope; 1200 Arctic Fixed: www.obe.com.
- B. Other Acceptable - Aluminum Windows Manufacturers:
 - 1. Arcadia, Inc; T200 Series (Thermal): www.arcadiainc.com/#sle.
 - 2. Boyd Aluminum; 3250XTF: www.boydaluminum.com/#sle.
 - 3. Substitutions: See Section 01 6000 - Product Requirements.

2.02 ALUMINUM WINDOWS

- A. Aluminum Windows: Extruded aluminum frame and sash, factory fabricated, factory finished, with operating hardware, related flashings, and anchorage and attachment devices.
 - 1. Fabrication: Joints and corners flush, hairline, and weatherproof, accurately fitted and secured; prepared to receive anchors; fasteners and attachments concealed from view; reinforced as required for operating hardware and imposed loads.
 - 2. Perimeter Clearance: Minimize space between framing members and adjacent construction while allowing expected movement.
 - 3. Movement: Accommodate movement between window and perimeter framing and deflection of lintel, without damage to components or deterioration of seals.
 - 4. System Internal Drainage: Drain to the exterior by means of a weep drainage network any water entering joints, condensation occurring in glazing channel, and migrating moisture occurring within system.
- B. Fixed, Non-Operable Type:
 - 1. Construction: Thermally broken.
 - 2. Glazing: As indicated on drawings.
 - 3. Exterior Finish: Class I natural anodized.
 - 4. Interior Finish: Class I natural anodized.

2.03 PERFORMANCE REQUIREMENTS

- A. Grade: AAMA/WDMA/CSA 101/I.S.2/A440 requirements for specific window type:
 - 1. Performance Class (PC): LC.
 - 2. Performance Grade (PG): Equivalent to or greater than specified design pressure.
- B. Design Pressure (DP): In accordance with applicable codes.
- C. Water Leakage: No uncontrolled leakage on interior face when tested in accordance with ASTM E331 at differential pressure of 12.11 psf (580 Pa).
- D. Air Leakage: 0.1 cfm/sq ft (0.5 L/sec sq m) maximum leakage per unit area of outside window frame dimension when tested at 1.57 psf (75 Pa) pressure difference in accordance with ASTM E283/E283M.

2.04 COMPONENTS

- A. Frames: Size as indicated on drawings; thermally broken with interior portion of frame insulated from exterior portion; flush glass stops of snap-on type.
- B. Glazing: See Section 08 8000.
- C. Fasteners: Stainless steel. Coat to prevent galvanic action.
- D. Sealant for Setting Sills and Sill Flashing: Non-curing butyl type.
 - 1. See Section 07 9200 for additional requirements.

2.05 MATERIALS

- A. Sheet Aluminum: ASTM B209/B209M, 5005 alloy, H12 or H14 temper.

- B. Exposed Flashings: Aluminum sheet, 20 guage, 0.032 inch minimum thickness; finish to match framing members.

2.06 FINISHES

- A. Class I Natural Anodized Finish: AAMA 611 AA-M12C22A41, clear anodic coating not less than 0.7 mil (0.018 mm) thick.
- B. Finish Color: Anodized Aluminum..
- C. Apply one coat of bituminous coating to concealed aluminum and steel surfaces in contact with dissimilar materials.
- D. Shop and Touch-Up Primer for Steel Components: Zinc oxide, alkyd, linseed oil primer appropriate for use over hand cleaned steel.
- E. Touch-Up Primer for Galvanized Steel Surfaces: SSPC-Paint 20, zinc rich.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that wall openings and adjoining water-resistive barrier materials are ready to receive aluminum windows; see Section 07 2500.

3.02 PRIME WINDOW INSTALLATION

- A. Install windows in accordance with manufacturer's instructions.
- B. Attach window frame and shims to perimeter opening to accommodate construction tolerances and other irregularities.
- C. Align window plumb and level, free of warp or twist. Maintain dimensional tolerances and alignment with adjacent work.
- D. Install sill and sill end angles.
- E. Set sill members and sill flashing in continuous bead of sealant.
- F. Provide thermal isolation where components penetrate or disrupt building insulation. Pack fibrous insulation in shim spaces at perimeter of assembly to maintain continuity of thermal barrier.
- G. Install glass in accordance with requirements; see Section 08 8000.

3.03 TOLERANCES

- A. Maximum Variation from Level or Plumb: 1/16 inches every 3 ft (1.5 mm/m) non-cumulative or 1/8 inches per 10 ft (3 mm/3 m), whichever is less.

3.04 FIELD QUALITY CONTROL

- A. See Section 01 4000 - Quality Requirements for independent field testing and inspection requirements, and requirements for monitoring quality of specified product installations.
- B. Provide field testing of installed aluminum windows by independent laboratory in accordance with AAMA 502 and AAMA/WDMA/CSA 101/I.S.2/A440 during construction process and before installation of interior finishes.
 - 1. Perform tests on one individual window of each type in designated locations as directed by Architect.
 - 2. Conduct tests on individual windows prior to 50 percent completion of this work.
 - 3. Field test for water penetration in accordance with ASTM E1105 using Procedure B - cyclic static air pressure difference; test pressure shall not be less than 1.9 psf (91 Pa).
 - 4. Field test for air leakage in accordance with ASTM E783 with uniform static air pressure difference of 1.57 psf (75 Pa).
- C. Repair or replace fenestration components that have failed designated field testing, and retest to verify performance complies with specified requirements.

3.05 CLEANING

- A. Remove protective material from factory finished aluminum surfaces.

- B. Wash surfaces by method recommended and acceptable to window manufacturer; rinse and wipe surfaces clean.
- C. Upon completion of installation, thoroughly clean aluminum surfaces in accordance with AAMA 609 & 610.
- D. Remove excess glazing sealant by moderate use of mineral spirits or other solvent acceptable to sealant and window manufacturer.

END OF SECTION

This page intentionally left blank

SECTION 087100 - DOOR HARDWARE

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes commercial door hardware for the following:
 - 1. Swinging doors.
 - 2. Sliding doors.
 - 3. Other doors to the extent indicated.
- B. Door hardware includes, but is not necessarily limited to, the following:
 - 1. Mechanical door hardware.
 - 2. Cylinders specified for doors in other sections.
- C. Related Sections:
 - 1. Division 08 Section "Hollow Metal Doors and Frames".
 - 2. Division 08 Section "Flush Wood Doors".
- D. Codes and References: Comply with the version year adopted by the Authority Having Jurisdiction.
 - 1. ANSI A117.1 - Accessible and Usable Buildings and Facilities.
 - 2. ICC/IBC - International Building Code.
 - 3. NFPA 70 - National Electrical Code.
 - 4. NFPA 80 - Fire Doors and Windows.
 - 5. NFPA 101 - Life Safety Code.
 - 6. NFPA 105 - Installation of Smoke Door Assemblies.
 - 7. State Building Codes, Local Amendments.
- E. Standards: All hardware specified herein shall comply with the following industry standards as applicable. Any undated reference to a standard shall be interpreted as referring to the latest edition of that standard:
 - 1. ANSI/BHMA Certified Product Standards - A156 Series.
 - 2. UL10C - Positive Pressure Fire Tests of Door Assemblies.
 - 3. ANSI/UL 294 - Access Control System Units.
 - 4. UL 305 - Panic Hardware.
 - 5. ANSI/UL 437- Key Locks.

OPSU STUDENT UNION RENOVATION
GOODWELL, OK

1.2 SUBMITTALS

- A. Product Data: Manufacturer's product data sheets including installation details, material descriptions, dimensions of individual components and profiles, operational descriptions and finishes.
- B. Door Hardware Schedule: Prepared by or under the supervision of supplier, detailing, fabrication and assembly of door hardware, as well as procedures and diagrams. Coordinate the final Door Hardware Schedule with doors, frames, and related work to ensure proper size, thickness, hand, function, and finish of door hardware.
 - 1. Format: Comply with scheduling sequence and vertical format in DHI's "Sequence and Format for the Hardware Schedule."
 - 2. Organization: Organize the Door Hardware Schedule into door hardware sets indicating complete designations of every item required for each door or opening. Organize door hardware sets in same order as in the Door Hardware Sets at the end of Part 3. Submittals that do not follow the same format and order as the Door Hardware Sets will be rejected and subject to resubmission.
 - 3. Content: Include the following information:
 - a. Type, style, function, size, label, hand, and finish of each door hardware item.
 - b. Manufacturer of each item.
 - c. Fastenings and other pertinent information.
 - d. Location of door hardware set, cross-referenced to Drawings, both on floor plans and in door and frame schedule.
 - e. Explanation of abbreviations, symbols, and codes contained in schedule.
 - f. Mounting locations for door hardware.
 - g. Door and frame sizes and materials.
 - h. Warranty information for each product.
 - 4. Submittal Sequence: Submit the final Door Hardware Schedule at earliest possible date, particularly where approval of the Door Hardware Schedule must precede fabrication of other work that is critical in the Project construction schedule. Include Product Data, Samples, Shop Drawings of other work affected by door hardware, and other information essential to the coordinated review of the Door Hardware Schedule.
- C. Keying Schedule: After a keying meeting with the owner has taken place prepare a separate keying schedule detailing final instructions. Submit the keying schedule in electronic format. Include keying system explanation, door numbers, key set symbols, hardware set numbers and special instructions. Owner must approve submitted keying schedule prior to the ordering of permanent cylinders/cores.
- D. Informational Submittals:
 - 1. Product Test Reports: Indicating compliance with cycle testing requirements, based on evaluation of comprehensive tests performed by manufacturer and witnessed by a qualified independent testing agency.

OPSU STUDENT UNION RENOVATION
GOODWELL, OK

- E. Operating and Maintenance Manuals: Provide manufacturers operating and maintenance manuals for each item comprising the complete door hardware installation in quantity as required in Division 01, Closeout Procedures.

1.3 QUALITY ASSURANCE

- A. Manufacturers Qualifications: Engage qualified manufacturers with a minimum 5 years of documented experience in producing hardware and equipment similar to that indicated for this Project and that have a proven record of successful in-service performance.
- B. Certified Products: Where specified, products must maintain a current listing in the Builders Hardware Manufacturers Association (BHMA) Certified Products Directory (CPD).
- C. Installer Qualifications: A minimum 3 years documented experience installing both standard and electrified door hardware similar in material, design, and extent to that indicated for this Project and whose work has resulted in construction with a record of successful in-service performance.
- D. Door Hardware Supplier Qualifications: Experienced commercial door hardware distributors with a minimum 5 years documented experience supplying both mechanical and electromechanical hardware installations comparable in material, design, and extent to that indicated for this Project. Supplier recognized as a factory direct distributor by the manufacturers of the primary materials with a warehousing facility in Project's vicinity. Supplier to have on staff a certified Architectural Hardware Consultant (AHC) available during the course of the Work to consult with Contractor, Architect, and Owner concerning both standard and electromechanical door hardware and keying.
- E. Source Limitations: Obtain each type and variety of door hardware specified in this section from a single source unless otherwise indicated.
- F. Each unit to bear third party permanent label indicating compliance with the referenced testing standards.
- G. Keying Conference: Conduct conference to comply with requirements in Division 01 Section "Project Meetings." Keying conference to incorporate the following criteria into the final keying schedule document:
 - 1. Function of building, purpose of each area and degree of security required.
 - 2. Plans for existing and future key system expansion.
 - 3. Requirements for key control storage and software.
 - 4. Installation of permanent keys, cylinder cores and software.
 - 5. Address and requirements for delivery of keys.
- H. Pre-Submittal Conference: Conduct coordination conference in compliance with requirements in Division 01 Section "Project Meetings" with attendance by representatives of Supplier(s), Installer(s), and Contractor(s) to review proper methods and the procedures for receiving, handling, and installing door hardware.

OPSU STUDENT UNION RENOVATION
GOODWELL, OK

1. Prior to installation of door hardware, conduct a project specific training meeting to instruct the installing contractors' personnel on the proper installation and adjustment of their respective products. Product training to be attended by installers of door hardware (including electromechanical hardware) for aluminum, hollow metal and wood doors. Training will include the use of installation manuals, hardware schedules, templates and physical product samples as required.
 2. Inspect and discuss electrical roughing-in, power supply connections, and other preparatory work performed by other trades.
 3. Review sequence of operation narratives for each unique access controlled opening.
 4. Review and finalize construction schedule and verify availability of materials.
 5. Review the required inspecting, testing, commissioning, and demonstration procedures
- I. At completion of installation, provide written documentation that components were applied according to manufacturer's instructions and recommendations and according to approved schedule.

1.4 DELIVERY, STORAGE, AND HANDLING

- A. Inventory door hardware on receipt and provide secure lock-up and shelving for door hardware delivered to Project site. Do not store electronic access control hardware, software or accessories at Project site without prior authorization.
- B. Tag each item or package separately with identification related to the final Door Hardware Schedule, and include basic installation instructions with each item or package.
- C. Deliver, as applicable, permanent keys, cylinders, cores, access control credentials, software and related accessories directly to Owner via registered mail or overnight package service. Instructions for delivery to the Owner shall be established at the "Keying Conference".

1.5 COORDINATION

- A. Templates: Obtain and distribute to the parties involved templates for doors, frames, and other work specified to be factory prepared for installing standard and electrified hardware. Check Shop Drawings of other work to confirm that adequate provisions are made for locating and installing hardware to comply with indicated requirements.
- B. Door and Frame Preparation: Doors and corresponding frames are to be prepared, reinforced and pre-wired (if applicable) to receive the installation of the specified electrified, monitoring, signaling and access control system hardware without additional in-field modifications.

1.6 WARRANTY

- A. General Warranty: Reference Division 01, General Requirements. Special warranties specified in this Article shall not deprive Owner of other rights Owner may have under other provisions of the Contract Documents and shall be in addition to, and run concurrent with, other warranties made by Contractor under requirements of the Contract Documents.

- B. Warranty Period: Written warranty, executed by manufacturer(s), agreeing to repair or replace components of standard and electrified door hardware that fails in materials or workmanship within specified warranty period after final acceptance by the Owner. Failures include, but are not limited to, the following:
 - 1. Structural failures including excessive deflection, cracking, or breakage.
 - 2. Faulty operation of the hardware.
 - 3. Deterioration of metals, metal finishes, and other materials beyond normal weathering.
 - 4. Electrical component defects and failures within the systems operation.
- C. Warranty Period: Unless otherwise indicated, warranty shall be one year from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 SCHEDULED DOOR HARDWARE

- A. General: Provide door hardware for each door to comply with requirements in Door Hardware Sets and each referenced section that products are to be supplied under.
- B. Designations: Requirements for quantity, item, size, finish or color, grade, function, and other distinctive qualities of each type of door hardware are indicated in the Door Hardware Sets at the end of Part 3. Products are identified by using door hardware designations, as follows:
 - 1. Named Manufacturer's Products: Product designation and manufacturer are listed for each door hardware type required for the purpose of establishing requirements. Manufacturers' names are abbreviated in the Door Hardware Schedule.
- C. Please note that ASSA ABLOY is transitioning the Yale Commercial brand to ASSA ABLOY ACCENTRA. This affects only the brand name; the products and product numbers will remain unchanged. The brand transition is expected to be complete in or about May of 2024, and products shipping after that time will be branded ASSA ABLOY ACCENTRA.
- D. Substitutions: Requests for substitution and product approval for inclusive mechanical and electromechanical door hardware in compliance with the specifications must be submitted in writing and in accordance with the procedures and time frames outlined in Division 01, Substitution Procedures. Approval of requests is at the discretion of the architect, owner, and their designated consultants.

2.2 BUTT HINGES

- A. Hinges: ANSI/BHMA A156.1 butt hinges with number of hinge knuckles and other options as specified in the Door Hardware Sets.
 - 1. Quantity: Provide the following hinge quantity:
 - a. Two Hinges: For doors with heights up to 60 inches.
 - b. Three Hinges: For doors with heights 61 to 90 inches.
 - c. Four Hinges: For doors with heights 91 to 120 inches.

OPSU STUDENT UNION RENOVATION
GOODWELL, OK

- d. For doors with heights more than 120 inches, provide 4 hinges, plus 1 hinge for every 30 inches of door height greater than 120 inches.
2. Hinge Size: Provide the following, unless otherwise indicated, with hinge widths sized for door thickness and clearances required:
 - a. Widths up to 3'0": 4-1/2" standard or heavy weight as specified.
 - b. Sizes from 3'1" to 4'0": 5" standard or heavy weight as specified.
3. Hinge Weight and Base Material: Unless otherwise indicated, provide the following:
 - a. Exterior Doors: Heavy weight, non-ferrous, ball bearing or oil impregnated bearing hinges unless Hardware Sets indicate standard weight.
 - b. Interior Doors: Standard weight, steel, ball bearing or oil impregnated bearing hinges unless Hardware Sets indicate heavy weight.
4. Hinge Options: Comply with the following:
 - a. Non-removable Pins: With the exception of electric through wire hinges, provide set screw in hinge barrel that, when tightened into a groove in hinge pin, prevents removal of pin while door is closed; for the all out-swinging lockable doors.
5. Manufacturers:
 - a. Ives (IV) - 5BB Series, 5-knuckle.
 - b. McKinney (MK) - TA/T4A Series, 5-knuckle.
 - c. dormakaba Best (ST) - F/FBB Series, 5-knuckle.

2.3 DOOR OPERATING TRIM

- A. Door Push Plates and Pulls: ANSI/BHMA A156.6 door pushes and pull units of type and design specified in the Hardware Sets. Coordinate and provide proper width and height as required where conflicting hardware dictates.
 1. Push/Pull Plates: Minimum .050 inch thick, size as indicated in hardware sets, with beveled edges, secured with exposed screws unless otherwise indicated.
 2. Fasteners: Provide manufacturer's designated fastener type as indicated in Hardware Sets.
 3. Manufacturers:
 - a. Ives (IV).
 - b. Rockwood (RO).
 - c. Trimco (TC).

2.4 CYLINDERS AND KEYING

- A. General: Cylinder manufacturer to have minimum (10) years experience designing secured master key systems and have on record a published security keying system policy.

OPSU STUDENT UNION RENOVATION
GOODWELL, OK

- B. Cylinder Types: Original manufacturer cylinders able to supply the following cylinder formats and types:
 - 1. Threaded mortise cylinders with rings and cams to suit hardware application.
 - 2. Rim cylinders with back plate, flat-type vertical or horizontal tailpiece, and raised trim ring.
 - 3. Bored or cylindrical lock cylinders with tailpieces as required to suit locks.
 - 4. Tubular deadlocks and other auxiliary locks.
 - 5. Mortise and rim cylinder collars to be solid and recessed to allow the cylinder face to be flush and be free spinning with matching finishes.
 - 6. Keyway: Match Facility Standard.
- C. Keying System: Each type of lock and cylinders to be factory keyed.
 - 1. Supplier shall conduct a "Keying Conference" to define and document keying system instructions and requirements.
 - 2. Furnish factory cut, nickel-silver large bow permanently inscribed with a visual key control number as directed by Owner.
 - 3. Existing System: Field verify and key cylinders to match Owner's existing system.
- D. Key Quantity: Provide the following minimum number of keys:
 - 1. Change Keys per Cylinder: Two (2)
 - 2. Master Keys (per Master Key Level/Group): Five (5).
 - 3. Construction Keys (where required): Ten (10).
- E. Construction Keying: Provide construction master keyed cylinders.
- F. Key Registration List (Bitting List):
 - 1. Provide keying transcript list to Owner's representative in the proper format for importing into key control software.
 - 2. Provide transcript list in writing or electronic file as directed by the Owner.

2.5 KEY CONTROL

- A. Key Control Cabinet: Provide a key control system including envelopes, labels, and tags with self-locking key clips, receipt forms, 3-way visible card index, temporary markers, permanent markers, and standard metal cabinet. Key control cabinet shall have expansion capacity of 150% of the number of locks required for the project.
 - 1. Manufacturers:
 - a. Lund Equipment (LU).
 - b. MMF Industries (MM).
 - c. Telkee (TK).

OPSU STUDENT UNION RENOVATION
GOODWELL, OK

2.6 MORTISE LOCKS AND LATCHING DEVICES

- A. Mortise Locksets, Grade 1 (Heavy Duty): Provide ANSI/BHMA A156.13, Series 1000, Operational Grade 1 Certified Products Directory (CPD) listed mortise locksets. Listed manufacturers shall meet all functions and features as specified herein.
1. Manufacturers:
 - a. ASSA ABLOY ACCENTRA, formerly known as Yale (YA) - 8800FL Series.
 - b. Corbin Russwin Hardware (RU) - ML2000 Series.

2.7 LOCK AND LATCH STRIKES

- A. Strikes: Provide manufacturer's standard strike with strike box for each latch or lock bolt, with curved lip extended to protect frame, finished to match door hardware set, unless otherwise indicated, and as follows:
1. Flat-Lip Strikes: For locks with three-piece antifriction latchbolts, as recommended by manufacturer.
 2. Extra-Long-Lip Strikes: For locks used on frames with applied wood casing trim.
 3. Aluminum-Frame Strike Box: Provide manufacturer's special strike box fabricated for aluminum framing.
 4. Double-lipped strikes: For locks at double acting doors. Furnish with retractable stop for rescue hardware applications.
- B. Standards: Comply with the following:
1. Strikes for Mortise Locks and Latches: BHMA A156.13.
 2. Strikes for Bored Locks and Latches: BHMA A156.2.
 3. Strikes for Auxiliary Deadlocks: BHMA A156.36.
 4. Dustproof Strikes: BHMA A156.16.

2.8 CONVENTIONAL EXIT DEVICES

- A. General Requirements: All exit devices specified herein shall meet or exceed the following criteria:
1. At doors not requiring a fire rating, provide devices complying with NFPA 101 and listed and labeled for "Panic Hardware" according to UL305. Provide proper fasteners as required by manufacturer including sex nuts and bolts at openings specified in the Hardware Sets.
 2. Where exit devices are required on fire rated doors, provide devices complying with NFPA 80 and with UL labeling indicating "Fire Exit Hardware". Provide devices with the proper fasteners for installation as tested and listed by UL. Consult manufacturer's catalog and template book for specific requirements.
 3. Except on fire rated doors, provide exit devices with hex key dogging device to hold the pushbar and latch in a retracted position. Provide optional keyed cylinder dogging on devices where specified in Hardware Sets.

OPSU STUDENT UNION RENOVATION
GOODWELL, OK

4. Devices must fit flat against the door face with no gap that permits unauthorized dogging of the push bar. The addition of filler strips is required in any case where the door light extends behind the device as in a full glass configuration.
 5. Lever Operating Trim: Where exit devices require lever trim, furnish manufacturer's heavy duty escutcheon trim with threaded studs for thru-bolts.
 - a. Lock Trim Design: As indicated in Hardware Sets, provide finishes and designs to match that of the specified locksets.
 - b. Where function of exit device requires a cylinder, provide a cylinder (Rim or Mortise) as specified in Hardware Sets.
 6. Vertical Rod Exit Devices: Where surface or concealed vertical rod exit devices are used at interior openings, provide as less bottom rod (LBR) unless otherwise indicated. Provide dust proof strikes where thermal pins are required to project into the floor.
 7. Narrow Stile Applications: At doors constructed with narrow stiles, or as specified in Hardware Sets, provide devices designed for maximum 2" wide stiles.
 8. Dummy Push Bar: Nonfunctioning push bar matching functional push bar.
 9. Rail Sizing: Provide exit device rails factory sized for proper door width application.
 10. Through Bolt Installation: For exit devices and trim as indicated in Door Hardware Sets.
- B. Conventional Push Rail Exit Devices (Heavy Duty): ANSI/BHMA A156.3, Grade 1 Certified Products Directory (CPD) listed exit devices. Listed manufacturers shall meet all functions and features as specified herein.
1. Manufacturers:
 - a. ASSA ABLOY ACCENTRA, formerly known as Yale (YA) - 7000 Series.
 - b. Corbin Russwin Hardware (RU) - ED4000 / ED5000 Series.
 - c. Detex (DE) - Advantex.

2.9 DOOR CLOSERS

- A. All door closers specified herein shall meet or exceed the following criteria:
1. General: Door closers to be from one manufacturer, matching in design and style, with the same type door preparations and templates regardless of application or spring size. Closers to be non-handed with full sized covers.
 2. Standards: Closers to comply with UL-10C for Positive Pressure Fire Test and be U.L. listed for use of fire rated doors.
 3. Size of Units: Comply with manufacturer's written recommendations for sizing of door closers depending on size of door, exposure to weather, and anticipated frequency of use. Where closers are indicated for doors required to be accessible to the Americans with Disabilities Act, provide units complying with ANSI ICC/A117.1.
 4. Closer Arms: Provide heavy duty, forged steel closer arms unless otherwise indicated in Hardware Sets.
 5. Closers shall not be installed on exterior or corridor side of doors; where possible install closers on door for optimum aesthetics.

6. Closer Accessories: Provide door closer accessories including custom templates, special mounting brackets, spacers and drop plates as required for proper installation. Provide through-bolt and security type fasteners as specified in the hardware sets.
- B. Door Closers, Surface Mounted (Standard Duty): ANSI/BHMA 156.4, Grade 1 Certified Products Directory (CPD) listed surface mounted, institutional grade door closers with complete spring power adjustment, sizes 1 thru 6; and fully operational adjustable according to door size, frequency of use, and opening force. Closers to be rack and pinion type, one piece cast iron or aluminum alloy body construction, with adjustable backcheck, closing sweep, and latch speed control valves. Provide non-handed units standard.
 1. Manufacturers:
 - a. ASSA ABLOY ACCENTRA, formerly known as Yale (YA) - 2700 Series.
 - b. Corbin Russwin Hardware (RU) - DC3000 Series.
 - c. Sargent Manufacturing (SA) - 1331 Series.

2.10 ARCHITECTURAL TRIM

A. Door Protective Trim

1. General: Door protective trim units to be of type and design as specified below or in the Hardware Sets.
2. Size: Fabricate protection plates (kick, armor, or mop) not more than 2" less than door width (LDW) on stop side of single doors and 1" LDW on stop side of pairs of doors, and not more than 1" less than door width on pull side. Coordinate and provide proper width and height as required where conflicting hardware dictates. Height to be as specified in the Hardware Sets.
3. Where plates are applied to fire rated doors with the top of the plate more than 16" above the bottom of the door, provide plates complying with NFPA 80. Consult manufacturer's catalog and template book for specific requirements for size and applications.
4. Protection Plates: ANSI/BHMA A156.6 protection plates (kick, armor, or mop), fabricated from the following:
 - a. Stainless Steel: 300 grade, .050-inch thick.
5. Options and fasteners: Provide manufacturer's designated fastener type as specified in the Hardware Sets. Provide countersunk screw holes.
6. Manufacturers:
 - a. Ives (IV).
 - b. Rockwood (RO).
 - c. Trimco (TC).

2.11 DOOR STOPS AND HOLDERS

- A. General: Door stops and holders to be of type and design as specified below or in the Hardware Sets.

OPSU STUDENT UNION RENOVATION
GOODWELL, OK

- B. Door Stops and Bumpers: ANSI/BHMA A156.16, Grade 1 door stops and wall bumpers. Provide wall bumpers, either convex or concave types with anchorage as indicated, unless floor or other types of door stops are specified in Hardware Sets. Do not mount floor stops where they will impede traffic. Where floor or wall bumpers are not appropriate, provide overhead type stops and holders.
 - 1. Manufacturers:
 - a. Ives (IV).
 - b. Rockwood (RO).
 - c. Trimco (TC).
- C. Overhead Door Stops and Holders: ANSI/BHMA A156.8, Grade 1 Certified Products Directory (CPD) listed overhead stops and holders to be surface or concealed types as indicated in Hardware Sets. Track, slide, arm and jamb bracket to be constructed of extruded bronze and shock absorber spring of heavy tempered steel. Provide non-handed design with mounting brackets as required for proper operation and function.
 - 1. Manufacturers:
 - a. Norton Rixson (RF).
 - b. Rockwood (RO).

2.12 ARCHITECTURAL SEALS

- A. General: Thresholds, weatherstripping, and gasket seals to be of type and design as specified below or in the Hardware Sets. Provide continuous weatherstrip gasketing on exterior doors and provide smoke, light, or sound gasketing on interior doors where indicated. At exterior applications provide non-corrosive fasteners and elsewhere where indicated.
- B. Smoke Labeled Gasketing: Assemblies complying with NFPA 105 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for smoke control ratings indicated, based on testing according to UL 1784.
 - 1. Provide smoke labeled perimeter gasketing at all smoke labeled openings.
- C. Fire Labeled Gasketing: Assemblies complying with NFPA 80 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire ratings indicated, based on testing according to UL-10C.
 - 1. Provide intumescent seals as indicated to meet UL10C Standard for Positive Pressure Fire Tests of Door Assemblies, and NPFA 252, Standard Methods of Fire Tests of Door Assemblies.
- D. Sound-Rated Gasketing: Assemblies that are listed and labeled by a testing and inspecting agency, for sound ratings indicated.
- E. Replaceable Seal Strips: Provide only those units where resilient or flexible seal strips are easily replaceable and readily available from stocks maintained by manufacturer.

OPSU STUDENT UNION RENOVATION
GOODWELL, OK

F. Manufacturers:

1. National Guard Products (NG).
2. Pemko (PE).
3. Zero (ZE).

2.13 FABRICATION

- A. Fasteners: Provide door hardware manufactured to comply with published templates generally prepared for machine, wood, and sheet metal screws. Provide screws according to manufacturers recognized installation standards for application intended.

2.14 FINISHES

- A. Standard: Designations used in the Hardware Sets and elsewhere indicate hardware finishes complying with ANSI/BHMA A156.18, including coordination with traditional U.S. finishes indicated by certain manufacturers for their products.
- B. Provide quality of finish, including thickness of plating or coating (if any), composition, hardness, and other qualities complying with manufacturer's standards, but in no case less than specified by referenced standards for the applicable units of hardware
- C. Protect mechanical finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine scheduled openings, with Installer present, for compliance with requirements for installation tolerances, labeled fire door assembly construction, wall and floor construction, and other conditions affecting performance.
- B. Notify architect of any discrepancies or conflicts between the door schedule, door types, drawings and scheduled hardware. Proceed only after such discrepancies or conflicts have been resolved in writing.

3.2 PREPARATION

- A. Hollow Metal Doors and Frames: Comply with ANSI/DHI A115 series.
- B. Wood Doors: Comply with ANSI/DHI A115-W series.

3.3 INSTALLATION

- A. Install each item of mechanical and electromechanical hardware and access control equipment to comply with manufacturer's written instructions and according to specifications.

OPSU STUDENT UNION RENOVATION
GOODWELL, OK

1. Installers are to be trained and certified by the manufacturer on the proper installation and adjustment of fire, life safety, and security products including: hanging devices; locking devices; closing devices; and seals.
- B. Mounting Heights: Mount door hardware units at heights indicated in following applicable publications, unless specifically indicated or required to comply with governing regulations:
 1. Standard Steel Doors and Frames: DHI's "Recommended Locations for Architectural Hardware for Standard Steel Doors and Frames."
 2. DHI TDH-007-20: Installation Guide for Doors and Hardware.
 3. Where indicated to comply with accessibility requirements, comply with ANSI A117.1 "Accessibility Guidelines for Buildings and Facilities."
 4. Provide blocking in drywall partitions where wall stops or other wall mounted hardware is located.
- C. Retrofitting: Install door hardware to comply with manufacturer's published templates and written instructions. Where cutting and fitting are required to install door hardware onto or into surfaces that are later to be painted or finished in another way, coordinate removal, storage, and reinstallation of surface protective trim units with finishing work specified in Division 9 Sections. Do not install surface-mounted items until finishes have been completed on substrates involved.
- D. Thresholds: Set thresholds for exterior and acoustical doors in full bed of sealant complying with requirements specified in Division 7 Section "Joint Sealants."
- E. Storage: Provide a secure lock up for hardware delivered to the project but not yet installed. Control the handling and installation of hardware items so that the completion of the work will not be delayed by hardware losses before and after installation.

3.4 FIELD QUALITY CONTROL

- A. Field Inspection (Punch Report): Reference Division 01 Sections "Closeout Procedures". Produce project punch report for each installed door opening indicating compliance with approved submittals and verification hardware is properly installed, operating and adjusted. Include list of items to be completed and corrected, indicating the reasons or deficiencies causing the Work to be incomplete or rejected.
 1. Organization of List: Include separate Door Opening and Deficiencies and Corrective Action Lists organized by Mark, Opening Remarks and Comments, and related Opening Images and Video Recordings.

3.5 ADJUSTING

- A. Initial Adjustment: Adjust and check each operating item of door hardware and each door to ensure proper operation or function of every unit. Replace units that cannot be adjusted to operate as intended. Adjust door control devices to compensate for final operation of heating and ventilating equipment and to comply with referenced accessibility requirements.

OPSU STUDENT UNION RENOVATION
GOODWELL, OK

3.6 CLEANING AND PROTECTION

- A. Protect all hardware stored on construction site in a covered and dry place. Protect exposed hardware installed on doors during the construction phase. Install any and all hardware at the latest possible time frame.
- B. Clean adjacent surfaces soiled by door hardware installation.
- C. Clean operating items as necessary to restore proper finish. Provide final protection and maintain conditions that ensure door hardware is without damage or deterioration at time of owner occupancy.

3.7 DEMONSTRATION

- A. Instruct Owner's maintenance personnel to adjust, operate, and maintain mechanical and electromechanical door hardware.

3.8 DOOR HARDWARE SETS

- A. The hardware sets represent the design intent and direction of the owner and architect. They are a guideline only and should not be considered a detailed hardware schedule. Discrepancies, conflicting hardware and missing items should be brought to the attention of the architect with corrections made prior to the bidding process. Omitted items not included in a hardware set should be scheduled with the appropriate additional hardware required for proper application and functionality.
 - 1. Quantities listed are for each pair of doors, or for each single door.
 - 2. The supplier is responsible for handing and sizing all products.
 - 3. Where multiple options for a piece of hardware are given in a single line item, the supplier shall provide the appropriate application for the opening.
- B. Manufacturer's Abbreviations:
 - 1. MK - McKinney
 - 2. PE - Pemko
 - 3. RO - Rockwood
 - 4. DE - Detex Corporation
 - 5. YA - ASSA ABLOY ACCENTRA, formerly known as Yale
 - 6. GJ - Glynn-Johnson
 - 7. OT - Other

Hardware Sets

Set: 1.0

Doors: 18A

Description: Pair Existing Cafeteria

OPSU STUDENT UNION RENOVATION
GOODWELL, OK

| | | | |
|-------------------------------|---------------------------------|-------|----|
| 8 Hinge, Full Mortise, Hvy Wt | T4A3786 NRP 4-1/2" x 4-1/2" | US26D | MK |
| 1 Mullion | 90KR | | DE |
| 2 Rim Exit Device | V40 08BN S Lever | 628 | DE |
| 3 Rim Cylinder | Match Existing System | 626 | YA |
| 2 Surface Closer | 2721 STOP ARM | 689 | YA |
| 2 Kick Plate | K1050 10" high x 2" LDW CSK BEV | US32D | RO |
| 2 Silencer | 608-RKW | | RO |

Set: 2.0

Doors: 21B

Description: Pair Cafeteria

| | | | |
|-------------------------------|---------------------------------|-------|----|
| 6 Hinge, Full Mortise, Hvy Wt | T4A3786 NRP 4-1/2" x 4-1/2" | US26D | MK |
| 1 Mullion | 90KR | | DE |
| 2 Rim Exit Device | V40 08BN S Lever | 628 | DE |
| 3 Rim Cylinder | Match Existing System | 626 | YA |
| 2 Surface Closer | 2721 STOP ARM | 689 | YA |
| 2 Kick Plate | K1050 10" high x 2" LDW CSK BEV | US32D | RO |
| 2 Silencer | 608-RKW | | RO |

Set: 3.0

Doors: 20B

Description: Single Grille

| | | | |
|-------------------------------|---------------------------------|-------|----|
| 3 Hinge, Full Mortise, Hvy Wt | T4A3786 NRP 4-1/2" x 4-1/2" | US26D | MK |
| 1 Rim Exit Device | V40 08BN S Lever | 628 | DE |
| 1 Rim Cylinder | Match Existing System | 626 | YA |
| 1 Surface Closer | 2721 HD PARALLEL | 689 | YA |
| 1 Kick Plate | K1050 10" high x 2" LDW CSK BEV | US32D | RO |
| 3 Silencer | 608-RKW | | RO |

Set: 4.0

Doors: 2A

Description: Single Housing

| | | | |
|-----------------------|---------------------------------|-------|----|
| 3 Hinge, Full Mortise | TA2714 4-1/2" x 4-1/2" | US26D | MK |
| 1 Classroom Lock | AUR 8808FL LC | 626 | YA |
| 1 Mortise Cylinder | Match Existing System | 626 | YA |
| 1 Surface Closer | 2701 REG ARM | 689 | YA |
| 1 Kick Plate | K1050 10" high x 2" LDW CSK BEV | US32D | RO |
| 1 Wall Stop | 406 | US32D | RO |
| 3 Silencer | 608-RKW | | RO |

Set: 5.0

Doors: 10A, 3A, 6A

Description: Single Housing, Nurse, Workroom

| | | | |
|-----------------------|------------------------|-------|----|
| 3 Hinge, Full Mortise | TA2714 4-1/2" x 4-1/2" | US26D | MK |
| 1 Classroom Lock | AUR 8808FL LC | 626 | YA |

OPSU STUDENT UNION RENOVATION
GOODWELL, OK

| | | | |
|--------------------|---------------------------------|-------|----|
| 1 Mortise Cylinder | Match Existing System | 626 | YA |
| 1 Overhead Stop | 90_S | 630 | GJ |
| 1 Surface Closer | 2701 REG ARM | 689 | YA |
| 1 Kick Plate | K1050 10" high x 2" LDW CSK BEV | US32D | RO |
| 3 Silencer | 608-RKW | | RO |

Set: 5.1

Doors: 5A

Description: Single Exam

| | | | |
|-----------------------|------------------------|-------|----|
| 3 Hinge, Full Mortise | TA2714 4-1/2" x 4-1/2" | US26D | MK |
| 1 Passage Lock | AUR 8801FL | 626 | YA |
| 1 Wall Stop | 406 | US32D | RO |
| 3 Silencer | 608-RKW | | RO |

Set: 6.0

Doors: 7A, 8A

Description: Single Men, Women

| | | | |
|-----------------------|---------------------------------|-------|----|
| 3 Hinge, Full Mortise | TA2714 4-1/2" x 4-1/2" | US26D | MK |
| 1 Pull Plate | 132x70C | US32D | RO |
| 1 Push Plate | 70F | US32D | RO |
| 1 Surface Closer | 2701 REG ARM | 689 | YA |
| 1 Kick Plate | K1050 10" high x 2" LDW CSK BEV | US32D | RO |
| 1 Wall Stop | 406 | US32D | RO |
| 3 Silencer | 608-RKW | | RO |

Set: 7.0

Doors: 12A

Description: Single Chase Rated

| | | | |
|----------------------------|---------------------------------|-------|----|
| 3 Hinge, Full Mortise | TA2314 NRP 4-1/2" x 4-1/2" | US32D | MK |
| 1 Storeroom or Closet Lock | AUR 8805FL LC | 630 | YA |
| 1 Mortise Cylinder | Match Existing System | 630 | YA |
| 1 Surface Closer | 2721 STOP ARM | 689 | YA |
| 1 Kick Plate | K1050 10" high x 2" LDW CSK BEV | US32D | RO |
| 1 Gasketing | S88D | | PE |

Set: 8.0

Doors: 22A

Description: Single Traffic Door

| | | | |
|------------|--------------------------|--|----|
| 1 Hardware | Provided by Manufacturer | | OT |
|------------|--------------------------|--|----|

Set: 9.0

Doors: 20A, 21A

Description: Folding Security Grille

| | | | |
|--------------------|-----------------------|-----|----|
| 1 Mortise Cylinder | Match Existing System | 626 | YA |
|--------------------|-----------------------|-----|----|

OPSU STUDENT UNION RENOVATION
GOODWELL, OK

Notes: Balance of hardware by door manufacturer. General contractor to coordinate cylinder requirements.

Set: 10.0

Doors: 10B

Description: Counter Shutter

| | | |
|------------|--------------------------|----|
| 1 Hardware | Provided by Manufacturer | OT |
|------------|--------------------------|----|

Set: 11.0

Doors: 20E

Description: Pair Grille AL Alternate #2

| | | | |
|--------------------|-----------------------|-------|----|
| 2 Continuous Hinge | CFM SLF-HD1 | | PE |
| 1 Mullion | 90KR | | DE |
| 1 Rim Exit Device | V40xNS 03WS | 628 | DE |
| 1 Rim Exit Device | V40xNS | 628 | DE |
| 2 Rim Cylinder | Match Existing System | 626 | YA |
| 2 Door Pull | BF158 Mtg-Type 12XHD | US32D | RO |
| 2 Surface Closer | 2721 STOP ARM | 689 | YA |
| 2 Drop Plate | 3158 | 689 | YA |

Notes: Perimeter gasket and astragal to be provided by door supplier.

Set: 12.0

Doors: 20C, 20D

Description: Single Grille Alternate #1

| | | | |
|-------------------------------|---------------------------------|-------|----|
| 3 Hinge, Full Mortise, Hvy Wt | T4A3786 NRP 4-1/2" x 4-1/2" | US26D | MK |
| 1 Rim Exit Device | V40 08BN S Lever | 628 | DE |
| 1 Rim Cylinder | Match Existing System | 626 | YA |
| 1 Surface Closer | 2721 STOP ARM | 689 | YA |
| 1 Kick Plate | K1050 10" high x 2" LDW CSK BEV | US32D | RO |
| 3 Silencer | 608-RKW | | RO |

Set: 13.0

Doors: 41A

Description: Pair Storage Alternate #3

| | | | |
|-------------------------------|---------------------------------|-------|----|
| 8 Hinge, Full Mortise, Hvy Wt | T4A3786 4-1/2" x 4-1/2" | US26D | MK |
| 2 Flush Bolt | 555 | US26D | RO |
| 1 Dust Proof Strike | 570 | US26D | RO |
| 1 Storeroom or Closet Lock | AUR 8805FL LC | 626 | YA |
| 1 Mortise Cylinder | Match Existing System | 626 | YA |
| 2 Overhead Stop | 90_S | 630 | GJ |
| 2 Surface Closer | 2701 REG ARM | 689 | YA |
| 2 Kick Plate | K1050 10" high x 2" LDW CSK BEV | US32D | RO |
| 1 Astragal | 357C | | PE |

OPSU STUDENT UNION RENOVATION
GOODWELL, OK

2 Silencer 608-RKW RO

Notes: Mount astragal on push side of inactive leaf and size doors for 1/8" clearance between leaves.

Set: 14.0

Doors: 40A

Description: Single Storage Alternate #3

| | | | |
|-------------------------------|---------------------------------|-------|----|
| 3 Hinge, Full Mortise, Hvy Wt | T4A3786 4-1/2" x 4-1/2" | US26D | MK |
| 1 Storeroom or Closet Lock | AUR 8805FL LC | 626 | YA |
| 1 Mortise Cylinder | Match Existing System | 626 | YA |
| 1 Surface Closer | 2701 REG ARM | 689 | YA |
| 1 Kick Plate | K1050 10" high x 2" LDW CSK BEV | US32D | RO |
| 1 Wall Stop | 406 | US32D | RO |
| 3 Silencer | 608-RKW | | RO |

Set: 15.0

Doors: 39A

Description: Single A/V & IT Rated Alternate #3

| | | | |
|----------------------------|---------------------------------|-------|----|
| 3 Hinge, Full Mortise | TA2714 NRP 4-1/2" x 4-1/2" | US26D | MK |
| 1 Storeroom or Closet Lock | AUR 8805FL LC | 626 | YA |
| 1 Mortise Cylinder | Match Existing System | 626 | YA |
| 1 Surface Closer | 2721 STOP ARM | 689 | YA |
| 1 Kick Plate | K1050 10" high x 2" LDW CSK BEV | US32D | RO |
| 1 Gasketing | S88D | | PE |

Set: 16.0

Doors: 18B

Description: Pair Storage Alternate #4

| | | | |
|-------------------------------|---------------------------------|-------|----|
| 6 Hinge, Full Mortise, Hvy Wt | T4A3786 NRP 4-1/2" x 4-1/2" | US26D | MK |
| 2 Flush Bolt | 555 | US26D | RO |
| 1 Dust Proof Strike | 570 | US26D | RO |
| 1 Storeroom or Closet Lock | AUR 8805FL LC 2815-7/8" | 626 | YA |
| 1 Mortise Cylinder | Match Existing System | 626 | YA |
| 2 Surface Closer | 2721 STOP ARM | 689 | YA |
| 2 Kick Plate | K1050 10" high x 2" LDW CSK BEV | US32D | RO |
| 1 Astragal | 357C | | PE |
| 2 Silencer | 608-RKW | | RO |

Notes: Mount astragal on pull side of active leaf and size doors for 1/8" clearance between leaves.

END OF SECTION 087100

SECTION 08 8000 GLAZING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Insulating glass units.
- B. Glazing units.
- C. Glazing compounds.

1.02 RELATED REQUIREMENTS

- A. Section 07 9200 - Joint Sealants: Sealants for other than glazing purposes.
- B. Section 08 1113 - Hollow Metal Doors and Frames: Glazed lites in doors and borrowed lites.
- C. Section 08 1416 - Flush Wood Doors: Glazed lites in doors.
- D. Section 08 4313 - Aluminum-Framed Storefronts: Glazing provided as part of storefront assembly.
- E. Section 08 5113 - Aluminum Windows: Glazing provided by window manufacturer.

1.03 REFERENCE STANDARDS

- A. ASCE 7 - Minimum Design Loads and Associated Criteria for Buildings and Other Structures; Most Recent Edition Cited by Referring Code or Reference Standard.
- B. ASTM C864 - Standard Specification for Dense Elastomeric Compression Seal Gaskets, Setting Blocks, and Spacers; 2005 (Reapproved 2019).
- C. ASTM C920 - Standard Specification for Elastomeric Joint Sealants; 2018.
- D. ASTM C1036 - Standard Specification for Flat Glass; 2021.
- E. ASTM C1048 - Standard Specification for Heat-Strengthened and Fully Tempered Flat Glass; 2018.
- F. ASTM C1193 - Standard Guide for Use of Joint Sealants; 2016 (Reapproved 2023).
- G. ASTM C1376 - Standard Specification for Pyrolytic and Vacuum Deposition Coatings on Flat Glass; 2021a.
- H. ASTM E1300 - Standard Practice for Determining Load Resistance of Glass in Buildings; 2016.
- I. ASTM E2190 - Standard Specification for Insulating Glass Unit Performance and Evaluation; 2019.
- J. GANA (GM) - GANA Glazing Manual; 2022.
- K. GANA (SM) - GANA Sealant Manual; 2008.
- L. GANA (LGRM) - Laminated Glazing Reference Manual; 2019.
- M. IGMA TM-3000 - North American Glazing Guidelines for Sealed Insulating Glass Units for Commercial & Residential Use; 1990 (2016).
- N. NFRC 100 - Procedure for Determining Fenestration Product U-factors; 2023.
- O. NFRC 200 - Procedure for Determining Fenestration Product Solar Heat Gain Coefficient and Visible Transmittance at Normal Incidence; 2023.
- P. NFRC 300 - Test Method for Determining the Solar Optical Properties of Glazing Materials and Systems; 2023.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data on Insulating Glass Unit and Glazing Unit Glazing Types: Provide structural, physical and environmental characteristics, size limitations, special handling and installation requirements.

- C. Product Data on Glazing Compounds and Accessories: Provide chemical, functional, and environmental characteristics, limitations, special application requirements, and identify available colors.
- D. Samples: Submit two samples 12 by 12 inch (304.8 by 304.8 mm) in size of glass units.
- E. Samples: Submit 6 inch (152.4 mm) long bead of glazing sealant, color as selected.
- F. Manufacturer's qualification statement.
- G. Installer's qualification statement.
- H. Warranty Documentation: Submit manufacturer warranty and ensure that forms have been completed in Owner's name and registered with manufacturer.

1.05 QUALITY ASSURANCE

- A. Perform Work in accordance with GANA (GM), GANA (SM), GANA (LGRM), and IGMA TM-3000 for glazing installation methods. Maintain one copy on site.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years of documented experience.
- C. Installer Qualifications: Company specializing in performing work of the type specified and with at least three years documented experience.

1.06 FIELD CONDITIONS

- A. Do not install glazing when ambient temperature is less than 40 degrees F (4 degrees C).
- B. Maintain minimum ambient temperature before, during and 24 hours after installation of glazing compounds.

1.07 WARRANTY

- A. See Section 01 7800 - Closeout Submittals for additional warranty requirements.
- B. Insulating Glass Units: Provide a five (5) year manufacturer warranty to include coverage for seal failure, interpane dusting or misting, including providing products to replace failed units.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Glass Fabricators:
 - 1. GGI - General Glass International: www.generalglass.com/#sle.
 - 2. Standard Bent Glass Corp: www.standardbent.com/#sle.
 - 3. Trulite Glass & Aluminum Solutions, LLC: www.trulite.com/#sle.
 - 4. Viracon, Inc: www.viracon.com/#sle.
 - 5. Substitutions: See Section 01 6000 - Product Requirements.

2.02 PERFORMANCE REQUIREMENTS - EXTERIOR GLAZING ASSEMBLIES

- A. Provide type and thickness of exterior glazing assemblies to support assembly dead loads, and to withstand live loads caused by positive and negative wind pressure acting normal to plane of glass.
 - 1. Design Pressure: Calculated in accordance with ASCE 7.
 - 2. Comply with ASTM E1300 for design load resistance of glass type, thickness, dimensions, and maximum lateral deflection of supported glass.
 - 3. Seismic Loads: Design and size glazing components to withstand seismic loads and sway displacement in accordance with the requirements of ASCE 7
 - 4. Provide glass edge support system sufficiently stiff to limit the lateral deflection of supported glass edges to less than 1/175 of their lengths under specified design load.
 - 5. Glass thicknesses listed are minimum.
- B. Weather-Resistive Barrier Seals: Provide completed assemblies that maintain continuity of building enclosure water-resistive barrier, vapor retarder, and/or air barrier.
 - 1. To utilize inner pane of multiple pane insulating glass units for continuity of vapor retarder and/or air barrier seal.

2. To maintain a continuous vapor retarder and/or air barrier throughout glazed assembly from glass pane to heel bead of glazing sealant.
- C. Thermal and Optical Performance: Provide exterior glazing products with performance properties as indicated. Performance properties are in accordance with manufacturer's published data as determined with the following procedures and/or test methods:
 1. Center of Glass U-Value: Comply with NFRC 100 using Lawrence Berkeley National Laboratory (LBNL) WINDOW 6.3 computer program.
 2. Center of Glass Solar Heat Gain Coefficient (SHGC): Comply with NFRC 200 using Lawrence Berkeley National Laboratory (LBNL) WINDOW 6.3 computer program.
 3. Solar Optical Properties: Comply with NFRC 300 test method.

2.03 INSULATING GLASS UNITS

- A. Insulating Glass Units: Types as indicated.
 1. Durability: Certified by an independent testing agency to comply with ASTM E2190.
 2. Coated Glass: Comply with requirements of ASTM C1376 for pyrolytic (hard-coat) or magnetic sputter vapor deposition (soft-coat) type coatings on flat glass; coated vision glass, Kind CV; coated overhead glass, Kind CO; or coated spandrel glass, Kind CS.
 3. Metal-Edge Spacers: Aluminum, bent and soldered corners.
 4. Spacer Color: Black.
 5. Edge Seal:
 - a. Color: Black.
 6. Purge interpane space with dry air, hermetically sealed.
- B. Type GL1 - Insulating Glass Units: Vision glass, double glazed.
 1. Applications: Exterior glazing unless otherwise indicated.
 2. Space between lites filled with air.
 3. Outboard Lite: Fully tempered float glass, 1/4 inch (6.4 mm) thick, minimum.
 - a. Tint: Clear.
 - b. Coating: Low-E (passive type), on #2 surface.
 4. Inboard Lite: Fully tempered float glass, 1/4 inch (6.4 mm) thick, minimum.
 - a. Tint: Clear.
 5. Total Thickness: 1 inch (25.4 mm).
 6. Thermal Transmittance (U-Value), Winter - Center of Glass: 0.28, nominal.
 7. Visible Light Transmittance (VLT): 79 percent, nominal.
 8. Solar Heat Gain Coefficient (SHGC): 0.7, nominal.
- C. Type ____ - Insulating Glass Units: Vision glass, double glazed.
 1. Applications: Exterior glazing as indicated on drawings.
 2. Space between lites filled with air.
 3. Outboard Lite: Heat-strengthened float glass, 1/4 inch (6.4 mm) thick, minimum.
 - a. Tint: Clear.
 - b. Coating: Low-E (passive type), on #2 surface.
 4. Inboard Lite: Heat-strengthened float glass, 1/4 inch (6.4 mm) thick, minimum.
 - a. Tint: Clear.
 5. Total Thickness: 1 inch (25.4 mm).
 6. Thermal Transmittance (U-Value), Winter - Center of Glass: 0.28, nominal.
 7. Visible Light Transmittance (VLT): 79 percent, nominal.
 8. Solar Heat Gain Coefficient (SHGC): 0.7, nominal.

2.04 GLAZING UNITS

- A. Type GL2 - Monolithic Interior Vision Glazing:
 1. Applications: Interior glazing unless otherwise indicated.
 2. Glass Type: Fully tempered float glass.
 3. Tint: Clear.
 4. Thickness: 1/4 inch (6.4 mm), nominal.

2.05 GLAZING COMPOUNDS

- A. Butyl Sealant: Single component; ASTM C920 Grade NS, Class 12-1/2, Uses M and A, Shore A hardness of 10 to 20; black color.
- B. Silicone Sealant: Single component; neutral curing; capable of water immersion without loss of properties; nonbleeding, nonstaining; ASTM C920 Type S, Grade NS, Class 25, Uses M, A, and G; with cured Shore A hardness range of 15 to 25; color as selected.

2.06 ACCESSORIES

- A. Setting Blocks: Silicone, with 80 to 90 Shore A durometer hardness; ASTM C864 Option II. Length of 0.1 inch for each square foot (25 mm for each square meter) of glazing or minimum 4 inch (100 mm) by width of glazing rabbet space minus 1/16 inch (1.5 mm) by height to suit glazing method and pane weight and area.
- B. Spacer Shims: Neoprene, 50 to 60 Shore A durometer hardness; ASTM C864 Option II. Minimum 3 inch (75 mm) long by one half the height of the glazing stop by thickness to suit application, self adhesive on one face.
- C. Glazing Tape, Back Bedding Mastic Type: Preformed, butyl-based, 100 percent solids compound with integral resilient spacer rod applicable to application indicated; 5 to 30 cured Shore A durometer hardness; coiled on release paper; black color.
- D. Glazing Splines: Resilient silicone extruded shape to suit glazing channel retaining slot; ASTM C864 Option II; color black.
- E. Glazing Clips: Manufacturer's standard type.

PART 3 EXECUTION

3.01 VERIFICATION OF CONDITIONS

- A. Verify that openings for glazing are correctly sized and within tolerances, including those for size, squareness, and offsets at corners.
- B. Verify that the minimum required face and edge clearances are being provided.
- C. Verify that surfaces of glazing channels or recesses are clean, free of obstructions that may impede moisture movement, weeps are clear, and support framing is ready to receive glazing system.
- D. Verify that sealing between joints of glass framing members has been completed effectively.
- E. Proceed with glazing system installation only after unsatisfactory conditions have been corrected.

3.02 PREPARATION

- A. Clean contact surfaces with appropriate solvent and wipe dry within maximum of 24 hours before glazing. Remove coatings that are not tightly bonded to substrates.
- B. Seal porous glazing channels or recesses with substrate compatible primer or sealer.
- C. Prime surfaces scheduled to receive sealant where required for proper sealant adhesion.

3.03 INSTALLATION, GENERAL

- A. Install glazing sealants in accordance with ASTM C1193, GANA (SM), and manufacturer's instructions.
- B. Do not exceed edge pressures around perimeter of glass lites as stipulated by glass manufacturer.
- C. Set glass lites of system with uniform pattern, draw, bow, and similar characteristics.
- D. Set glass lites in proper orientation so that coatings face exterior or interior as indicated.
- E. Prevent glass from contact with any contaminating substances that may be the result of construction operations such as, and not limited to the following; weld splatter, fire-safing, plastering, mortar droppings, and paint.

3.04 INSTALLATION - DRY GLAZING METHOD (GASKET GLAZING)

- A. Application - Exterior and/or Interior Glazed: Set glazing infills from either the exterior or the interior of the building.
- B. Place setting blocks at 1/4 points with edge block no more than 6 inch (152 mm) from corners.
- C. Rest glazing on setting blocks and push against fixed stop with sufficient pressure on gasket to attain full contact.
- D. Install removable stops without displacing glazing gasket; exert pressure for full continuous contact.

3.05 FIELD QUALITY CONTROL

- A. Glass and Glazing product manufacturers to provide field surveillance of the installation of their products.
- B. Monitor and report installation procedures and unacceptable conditions.

3.06 CLEANING

- A. Remove excess glazing materials from finish surfaces immediately after application using solvents or cleaners recommended by manufacturers.
- B. Remove nonpermanent labels immediately after glazing installation is complete.
- C. Clean glass and adjacent surfaces after sealants are fully cured.
- D. Clean glass on both exposed surfaces not more than 4 days prior to Date of Substantial Completion in accordance with glass manufacturer's written recommendations.

3.07 PROTECTION

- A. After installation, mark pane with an 'X' by using removable plastic tape or paste; do not mark heat absorbing or reflective glass units.
- B. Remove and replace glass that is damaged during construction period prior to Date of Substantial Completion.

END OF SECTION

This page intentionally left blank

**SECTION 09 2116
GYPSUM BOARD ASSEMBLIES**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Performance criteria for gypsum board assemblies.
- B. Metal stud wall framing.
- C. Metal channel ceiling framing.
- D. Acoustic insulation.
- E. Gypsum sheathing.
- F. Cementitious backing board.
- G. Gypsum wallboard.
- H. Joint treatment and accessories.

1.02 RELATED REQUIREMENTS

- A. Section 05 4000 - Cold-Formed Metal Framing: Structural steel stud framing.
- B. Section 06 1000 - Rough Carpentry: Building sheathing.
- C. Section 06 1000 - Rough Carpentry: Wood blocking product and execution requirements.
- D. Section 07 8400 - Firestopping: Top-of-wall assemblies at fire-resistance-rated walls.
- E. Section 07 9200 - Joint Sealants: Sealing acoustical gaps in construction other than gypsum board or plaster work.

1.03 REFERENCE STANDARDS

- A. AISI S100 - North American Specification for the Design of Cold-Formed Steel Structural Members; 2016, with Supplement (2020).
- B. AISI S220 - North American Standard for Cold-Formed Steel Nonstructural Framing; 2020.
- C. AISI S240 - North American Standard for Cold-Formed Steel Structural Framing; 2015, with Errata (2020).
- D. ANSI A108.11 - American National Standard Specifications for Interior Installation of Cementitious Backer Units; 2018.
- E. ASTM A653/A653M - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process; 2023.
- F. ASTM A1003/A1003M - Standard Specification for Steel Sheet, Carbon, Metallic- and Nonmetallic-Coated for Cold-Formed Framing Members; 2015.
- G. ASTM B221 - Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes; 2021.
- H. ASTM C1007 - Standard Specification for Installation of Load Bearing (Transverse and Axial) Steel Studs and Related Accessories; 2020.
- I. ASTM C475/C475M - Standard Specification for Joint Compound and Joint Tape for Finishing Gypsum Board; 2017 (Reapproved 2022).
- J. ASTM C665 - Standard Specification for Mineral-Fiber Blanket Thermal Insulation for Light Frame Construction and Manufactured Housing; 2023.
- K. ASTM C754 - Standard Specification for Installation of Steel Framing Members to Receive Screw-Attached Gypsum Panel Products; 2020.
- L. ASTM C840 - Standard Specification for Application and Finishing of Gypsum Board; 2020.
- M. ASTM C954 - Standard Specification for Steel Drill Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Steel Studs from 0.033 in. (0.84 mm) to 0.112 in. (2.84 mm) in Thickness; 2022.

- N. ASTM C1002 - Standard Specification for Steel Self-Piercing Tapping Screws for Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs; 2022.
- O. ASTM C1047 - Standard Specification for Accessories for Gypsum Wallboard and Gypsum Veneer Base; 2019.
- P. ASTM C1278/C1278M - Standard Specification for Fiber-Reinforced Gypsum Panel; 2017.
- Q. ASTM C1288 - Standard Specification for Fiber-Cement Interior Substrate Sheets; 2017.
- R. ASTM C1396/C1396M - Standard Specification for Gypsum Board; 2017.
- S. ASTM D3273 - Standard Test Method for Resistance to Growth of Mold on the Surface of Interior Coatings in an Environmental Chamber; 2021.
- T. ASTM E90 - Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements; 2009 (Reapproved 2016).
- U. ASTM E413 - Classification for Rating Sound Insulation; 2022.
- V. GA-216 - Application and Finishing of Gypsum Panel Products; 2021.
- W. GA-226 - Application of Gypsum Board to Form Curved Surfaces; 2019.
- X. UL (FRD) - Fire Resistance Directory; Current Edition.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data:
 - 1. Provide data on metal framing, gypsum board, accessories, and joint finishing system.
 - 2. Provide manufacturer's data on partition head to structure connectors, showing compliance with requirements.
- C. Test Reports: For stud framing products that do not comply with AISI S220 or ASTM C754, provide independent laboratory reports showing maximum stud heights at required spacings and deflections.

1.05 QUALITY ASSURANCE

- A. Designer Qualifications: Perform design under direct supervision of a Professional Engineer experienced in design of this type of work and licensed in Oklahoma.
- B. Installer Qualifications: Company specializing in performing work of the type specified and with at least three years of documented experience.
- C. Fire-Resistance-Rated Assemblies: for fire-resistance-rated assemblies, provide materials and construction identical to those tested in assembly indicated according to ASTM E 119 by an independent testing agency.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Store gypsum products and accessories indoors and keep above freezing. Elevate boards above floor, on nonwicking supports, in accordance with manufacturer's recommendations.
- B. Store metal products to prevent corrosion, under cover and above grade.

PART 2 PRODUCTS

2.01 GYPSUM BOARD ASSEMBLIES

- A. Provide completed assemblies complying with ASTM C840 and GA-216.
- B. Interior Partitions, Indicated as Acoustic: Provide completed assemblies with the following characteristics:
 - 1. Acoustic Attenuation: STC of 45-49 calculated in accordance with ASTM E413, based on tests conducted in accordance with ASTM E90.
- C. Fire-Resistance-Rated Assemblies: Provide completed assemblies with the following characteristics:
 - 1. Fire-Resistance-Rated Partitions: UL listed assembly No. U301; 2 hour rating.
 - 2. Fire-Resistance-Rated Ceilings: 2 hour fire rating.

3. UL Assembly Numbers: Provide construction equivalent to that listed for the particular assembly in the current UL (FRD).

2.02 METAL FRAMING MATERIALS

- A. Steel Sheet: ASTM A1003/A1003M, subject to the ductility limitations indicated in AISI S220 or equivalent.
 1. Structural Grade: As required to meet design criteria.
- B. Manufacturers - Metal Framing, Connectors, and Accessories:
 1. ClarkDietrich: www.clarkdietrich.com/#sle.
 2. Jaimes Industries: www.jaimesind.com/#sle.
 3. R-stud: www.rstud.com/#sle.
 4. SCAFCO Corporation: www.scafco.com/#sle.
 5. Steel Construction Systems: www.steelconsystems.com/#sle.
 6. Substitutions: See Section 01 6000 - Product Requirements.
- C. Nonstructural Framing System Components: AISI S220; galvanized sheet steel, of size and properties necessary to comply with ASTM C754 for the spacing indicated, with maximum deflection of wall framing of L/120 at 5 psf (L/120 at 240 Pa).
 1. Studs: C-shaped with knurled or embossed faces.
 2. Runners: U shaped, sized to match studs.
 3. Ceiling Channels: T-shaped.
 4. Furring Members: Hat-shaped sections, minimum depth as indicated on drawings.
- D. Partition Head to Structure Connections: Provide mechanical anchorage devices that accommodate deflection and prevent rotation of studs while maintaining structural performance of partition.
 1. Structural Performance: Maintain lateral load resistance and vertical movement capacity required by applicable code, when evaluated in accordance with AISI S100.
 2. Material: ASTM A653/A653M steel sheet, SS Grade 50/340, with G60/Z180 hot-dipped galvanized coating.
 3. Provide components UL-listed for use in UL-listed fire-resistance-rated head of partition joint systems indicated on drawings.
 4. Provide mechanical anchorage devices as described above that accommodate deflection while maintaining the fire-resistance rating of the wall assembly.
 - a. Products:
 - 1) ClarkDietrich; BlazeFrame RipTrak: www.clarkdietrich.com/#sle.
 - 2) FireTrak Corporation; Posi Klip: www.fire-trak.com/#sle.
 - 3) Metal-Lite, Inc; The System: www.metal-lite.net/#sle.
 - 4) Substitutions: See Section 01 6000 - Product Requirements.

2.03 BOARD MATERIALS

- A. Manufacturers - Gypsum-Based Board:
 1. American Gypsum Company: www.americangypsum.com/#sle.
 2. Georgia-Pacific Gypsum: www.gpgypsum.com/#sle.
 3. Gold Bond Building Products, LLC provided by National Gypsum Company: www.goldbondbuilding.com/#sle.
 4. USG Corporation: www.usg.com/#sle.
 5. Substitutions: See Section 01 6000 - Product Requirements.
- B. Gypsum Wallboard: Paper-faced gypsum panels as defined in ASTM C1396/C1396M; sizes to minimize joints in place; ends square cut.
 1. Application: Use for vertical surfaces and ceilings, unless otherwise indicated.
 2. Mold Resistance: Score of 10, when tested in accordance with ASTM D3273.
 - a. Mold resistant board is required at restrooms, mechanical and service areas, and anywhere there is a water connection.
 3. At Assemblies Indicated with Fire-Resistance Rating: Use type required by indicated tested assembly; if no tested assembly is indicated, use Type X board, UL or WH listed.

4. Thickness:
 - a. Vertical Surfaces: 5/8 inch (16 mm).
 - b. Ceilings: 1/2 inch (13 mm).
 - c. Multi-Layer Assemblies: Thicknesses as indicated on drawings.
- C. Impact Resistant Wallboard:
 1. Application: Corridors and restrooms.
 2. Mold Resistance: Score of 10, when tested in accordance with ASTM D3273.
 3. Paper-Faced Type: Gypsum wallboard, as defined in ASTM C1396/C1396M.
 4. Unfaced Type: Interior fiber-reinforced gypsum panels, as defined in ASTM C1278/C1278M.
 5. Type: Fire-resistance-rated Type X, UL or WH listed.
 6. Thickness: 5/8 inch (16 mm).
 7. Edges: Tapered.
 8. Products:
 - a. National Gypsum Company; Gold Bond Hi-Impact Brand XP Wallboard.
 - b. USG Corporation; Fiberock Brand Panels--VHI Abuse-Resistant.
- D. Backing Board For Wet Areas: One of the following products:
 1. Application: Surfaces behind tile in wet areas including water fountains, sinks, toilets
 2. Application: Surfaces behind tile in wet areas including behind water fountains and sinks.
 3. Mold Resistance: Score of 10, when tested in accordance with ASTM D3273.
 4. ASTM Cement-Based Backing Board: Non-gypsum-based, cementitious board complying with ASTM C1288.
 - a. Thickness: 1/4 inch (6.35 mm).
- E. Backing Board For Non-Wet Areas: Water-resistant gypsum backing board as defined in ASTM C1396/C1396M; sizes to minimum joints in place; ends square cut.
 1. Application: Vertical surfaces behind thinset tile, except in wet areas.
 2. Mold Resistance: Score of 10, when tested in accordance with ASTM D3273.
 3. Type: Regular and Type X, in locations indicated.
 4. Type X Thickness: 5/8 inch (16 mm).
 5. Regular Board Thickness: 5/8 inch (16 mm).
 6. Edges: Tapered.
 7. Products:
 - a. American Gypsum Company; M-Bloc: www.americangypsum.com/#sle.
 - b. CertainTeed Corporation; ProRoc Brand Moisture & Mold Resistant Gypsum Board.
 - c. Georgia-Pacific Gypsum; DensShield Tile Backer.
 - d. National Gypsum Company; Gold Bond Brand XP Gypsum Board.
 - e. Temple-Inland Building Product by Georgia-Pacific, LLC; ComfortGuard WR.
 - f. USG Corporation; Sheetrock Brand Mold Tough Gypsum Panels.
- F. Ceiling Board: Special sag resistant gypsum ceiling board as defined in ASTM C1396/C1396M; sizes to minimize joints in place; ends square cut.
 1. Application: Ceilings, unless otherwise indicated.
 2. Thickness: 1/2 inch (13 mm).
 3. Edges: Tapered.
 4. Products:
 - a. American Gypsum; Interior Ceiling Board.
 - b. CertainTeed Corporation;
 - c. National Gypsum Company; High Strength Brand Ceiling Board.
 - d. Temple-Inland Building Products by Georgia-Pacific, LLC; Span24 Ceiling Board.
 - e. USG Corporation; Sheetrock Brand Sag-Resistant Interior Gypsum Ceiling Board.
 - f. Substitutions: See Section 01 6000 - Product Requirements.
- G. Exterior Sheathing Board: See Section 06 1000.

2.04 GYPSUM BOARD ACCESSORIES

- A. Acoustic Insulation: ASTM C665; preformed mineral-fiber, friction fit type, unfaced; thickness as required for STC.
- B. Acoustic Sealant: Acrylic emulsion latex or water-based elastomeric sealant; do not use solvent-based non-curing butyl sealant.
- C. Beads, Joint Accessories, and Other Trim: ASTM C1047, rigid plastic, galvanized steel, or rolled zinc, unless noted otherwise.
 - 1. Corner Beads: Low profile, for outside corners.
 - a. Products:
 - 1) CertainTeed Corporation; No-Coat Drywall Corner: www.certainteed.com/#sle.
 - 2) ClarkDietrich; Strait-Flex OS-300: www.clarkdietrich.com/#sle.
 - 3) Phillips Manufacturing Co; Everlast Corner Bead: www.phillipsmfg.com/#sle.
 - 4) Substitutions: See Section 01 6000 - Product Requirements.
- D. Joint Materials: ASTM C475/C475M and as recommended by gypsum board manufacturer for project conditions.
 - 1. Fiberglass Tape: 2 inch (50 mm) wide, coated glass fiber tape for joints and corners, except as otherwise indicated.
 - 2. Paper Tape: 2 inch (50 mm) wide, creased paper tape for joints and corners, except as otherwise indicated.
 - 3. Joint Compound: Setting type, field-mixed.
- E. Screws for Fastening of Gypsum Panel Products to Cold-Formed Steel Studs Less than 0.033 inches (0.84 mm) in Thickness and Wood Members: ASTM C1002; self-piercing tapping screws, corrosion-resistant.
- F. Screws for Fastening of Gypsum Panel Products to Steel Members from 0.033 to 0.112 inch (0.84 to 2.84 mm) in Thickness: ASTM C954; steel drill screws, corrosion-resistant.
- G. Anchorage to Substrate: Tie wire, nails, screws, and other metal supports, of type and size to suit application; to rigidly secure materials in place.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that project conditions are appropriate for work of this section to commence.

3.02 FRAMING INSTALLATION

- A. Metal Framing: Install in accordance with ASTM C1007/AISI S220 and manufacturer's instructions.
- B. Suspended Ceilings and Soffits: Space framing and furring members as indicated.
 - 1. Level ceiling system to a tolerance of 1/1200.
 - 2. Laterally brace entire suspension system.
 - 3. Install bracing as required at exterior locations to resist wind uplift.
- C. Studs: Space studs at 16 inches on center (at 406 mm on center).
 - 1. Extend partition framing to structure where indicated and to ceiling in other locations.
 - 2. Partitions Terminating at Ceiling: Attach ceiling runner securely to ceiling track in accordance with manufacturer's instructions.
 - 3. Partitions Terminating at Structure: Attach top runner to structure, maintain clearance between top of studs and structure, and connect studs to track using specified mechanical devices in accordance with manufacturer's instructions; verify free movement of top of stud connections; do not leave studs unattached to track.
- D. Openings: Reinforce openings as required for weight of doors or operable panels, using not less than double studs at jambs.
- E. Standard Wall Furring: Install at concrete and masonry walls scheduled to receive gypsum board, not more than 4 inches (100 mm) from floor and ceiling lines and abutting walls. Secure in place on alternate channel flanges at maximum 24 inches (600 mm) on center.

1. Orientation: Horizontal.
- F. Blocking: Install wood blocking for support of:
 1. Framed openings.
 2. Wall-mounted cabinets.
 3. Plumbing fixtures.
 4. Toilet partitions.
 5. Toilet accessories.
 6. Wall-mounted door hardware.
 7. Technology indicated on drawings such as televisions.
 8. Wall-mounted equipment.

3.03 ACOUSTIC ACCESSORIES INSTALLATION

- A. Acoustic Insulation: Place tightly within spaces, around cut openings, behind and around electrical and mechanical items within partitions, and tight to items passing through partitions.
- B. Acoustic Sealant: Install in accordance with manufacturer's instructions.
 1. Seal around all penetrations by conduit, pipe, ducts, and rough-in boxes, except where firestopping is provided.

3.04 BOARD INSTALLATION

- A. Comply with ASTM C840, GA-216, and manufacturer's instructions. Install to minimize butt end joints, especially in highly visible locations.
- B. Single-Layer Nonrated: Install gypsum board in most economical direction, with ends and edges occurring over firm bearing.
 1. Exception: Tapered edges to receive joint treatment at right angles to framing.
- C. Double-Layer, Nonrated: Use gypsum board for first layer, placed parallel to framing or furring members, with ends and edges occurring over firm bearing. Use glass mat faced gypsum board at exterior walls and at other locations as indicated. Place second layer perpendicular to framing or furring members. Offset joints of second layer from joints of first layer.
- D. Fire-Resistance-Rated Construction: Install gypsum board in strict compliance with requirements of assembly listing.
- E. Cementitious Backing Board: Install over steel framing members and plywood substrate where indicated, in accordance with ANSI A108.11 and manufacturer's instructions.
- F. Installation on Metal Framing: Use screws for attachment of gypsum board except face layer of nonrated double-layer assemblies, which may be installed by means of adhesive lamination.
- G. Curved Surfaces: Apply gypsum board to curved substrates in accordance with GA-226.
- H. Moisture Protection: Treat cut edges and holes in moisture-resistant gypsum board with sealant.

3.05 JOINT TREATMENT

- A. Glass Mat Faced Gypsum Board: Use fiberglass joint tape, embed and finish with setting type joint compound.
- B. Paper Faced Gypsum Board: Use paper joint tape, embed with drying type joint compound and finish with drying type joint compound.
- C. Finish gypsum board in accordance with levels defined in ASTM C840, as follows:
 1. Level 5: Walls and ceilings to receive semi-gloss or gloss paint finish and other areas specifically indicated.
 2. Level 4: Walls and ceilings to receive paint finish or wall coverings, unless otherwise indicated.
 3. Level 2: In utility areas, behind cabinetry, and on backing board to receive tile finish.
 4. Level 1: Fire-resistance-rated wall areas above finished ceilings, whether or not accessible in the completed construction.
- D. Tape, fill, and sand exposed joints, edges, and corners to produce smooth surface ready to receive finishes.

1. Feather coats of joint compound so that camber is maximum 1/32 inch (0.8 mm).
- E. Where Level 5 finish is indicated, spray apply high build drywall surfacer over entire surface after joints have been properly treated; achieve a flat and tool mark-free finish.

3.06 TOLERANCES

- A. Maximum Variation of Finished Gypsum Board Surface from True Flatness: 1/8 inch in 10 feet (3 mm in 3 m) in any direction.

END OF SECTION

This page intentionally left blank

SECTION 09 2236 LATH

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Metal lath for lime-based plaster.

1.02 RELATED REQUIREMENTS

- A. Section 09 2116 - Gypsum Board Assemblies: C.
- B. Section 09 2523 - Lime Based Plastering

1.03 REFERENCE STANDARDS

- A. ASTM C841 - Standard Specification for Installation of Interior Lathing and Furring; 2023.
- B. ASTM C847 - Standard Specification for Metal Lath; 2018.
- C. ASTM C954 - Standard Specification for Steel Drill Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Steel Studs from 0.033 in. (0.84 mm) to 0.112 in. (2.84 mm) in Thickness; 2022.
- D. ASTM C1002 - Standard Specification for Steel Self-Piercing Tapping Screws for Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs; 2022.
- E. ASTM C1063 - Standard Specification for Installation of Lathing and Furring to Receive Interior and Exterior Portland Cement-Based Plaster; 2023.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data on furring and lathing components, structural characteristics, material limitations, and finish.
- C. Samples:
 - 1. Submit two samples, 12 by 12 inch (304.8 by 304.8 mm) in size illustrating lath material and finish.

1.05 QUALITY ASSURANCE

- A. Installer Qualifications: Company specializing in performing the work of this section with at least three years of documented experience.

PART 2 PRODUCTS

2.01 LATH

- A. Diamond Mesh Metal Lath: ASTM C847, galvanized; flat.
 - 1. Weight: To suit application and as specified in ASTM C841 or ASTM C1063 for framing spacing.
- B. Corner Mesh: ASTM C1063; Formed sheet steel, minimum 0.018 inch (0.5 mm) thick, perforated flanges shaped to permit complete embedding in plaster, minimum 2 inch (50 mm) size; same finish as lath.
- C. Strip Mesh: Expanded metal lath, same weight as lath, 2 inch (50 mm) wide by 24 inch (600 mm) long; same finish as lath.
- D. Beads, Screeds, Joint Accessories, and Other Trim: Depth governed by plaster thickness, and maximum possible lengths.
 - 1. Material: Formed sheet steel with rust inhibitive primer, expanded metal flanges.
 - 2. Corner Beads: Bullnosed corners.
 - 3. Base Screeds: Bevelle
 - 4. Control Joints: Accordion profile with factory-installed protective tape, 2 inch (50 mm) flanges.

2.02 ACCESSORIES

- A. Anchorage: Tie wire, nails, and other metal supports, of type and size to suit application; to rigidly secure materials in place, galvanized.
- B. Fasteners: Self-piercing tapping screws; ASTM C1002 or ASTM C954.
- C. Tie Wire: Annealed galvanized steel.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify that substrates are ready to receive work and conditions are suitable for application.
- C. Do not begin until unacceptable conditions have been corrected.
- D. If substrate preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.

3.02 INSTALLATION - GENERAL

- A. Install interior lath and furring for lime based plaster in accordance with ASTM C841.

3.03 CONTROL AND EXPANSION JOINT INSTALLATION

- A. Locate joints as indicated on drawings, but not less than:
 - 1. Area of plaster panel not to exceed 144 sq ft (13.4 sq m) for vertical surfaces.
 - 2. Area of plaster panel not to exceed 100 sq ft (9.3 sq m) for horizontal, curved or angled surfaces.
 - 3. Spacing between control joints not to exceed 18 ft (5.5 m) in each direction.
 - 4. Area bounded by control joints not to exceed a length-to-width ratio of 2-1/2 to 1.
- B. Install prefabricated joint accessories in accordance with ASTM C1063.

3.04 LATH INSTALLATION

- A. Apply lath taut, with long dimension perpendicular to supports.
- B. Attach metal lath to metal supports using tie wire at maximum 6 inches (150 mm) on center.
- C. Continuously reinforce internal angles with corner mesh, except where the metal lath returns 3 inches (75 mm) from corner to form the angle reinforcement; fasten at perimeter edges only.
- D. Place corner bead at external wall corners; fasten at outer edges of lath only.
- E. Place base screeds at termination of plaster areas; secure rigidly in place.
- F. Place 4 inch (100 mm) wide strips of lath centered over junctions of dissimilar backing materials, and secure rigidly in place.
- G. Place lath vertically above each top corner and each side of door frames to 6 inches (150 mm) above ceiling line.
- H. Place casing beads at terminations of plaster finish. Butt and align ends. Secure rigidly in place.
- I. Place additional strip mesh diagonally at corners of lathed openings. Secure rigidly in place.

3.05 TOLERANCES

- A. Maximum Variation from True Lines and Levels: 1/8 inch in 10 feet (3 mm in 3 m).
- B. Maximum Variation from True Position: 1/8 inch (3 mm).

END OF SECTION

SECTION 09 2523 LIME BASED PLASTERING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Interior lime based plastering.
- B. Accessories.

1.02 RELATED REQUIREMENTS

- A. Section 09 2236 - Lath.
- B. Section 09 9123 - Interior Painting.

1.03 REFERENCE STANDARDS

- A. ASTM C35 - Standard Specification for Inorganic Aggregates for Use in Gypsum Plaster; 2001 (Reapproved 2019).
- B. ASTM C207 - Standard Specification for Hydrated Lime for Masonry Purposes; 2018.
- C. ASTM C842 - Standard Specification for Application of Interior Gypsum Plaster; 2005 (Reapproved 2021).
- D. ASTM C1063 - Standard Specification for Installation of Lathing and Furring to Receive Interior and Exterior Portland Cement-Based Plaster; 2023.
- E. CEN EN 459 - Building Lime - Part 1: Definitions, Specifications and Conformity Criteria; 2015.
- F. PCA EB049 - Portland Cement Plaster/Stucco Manual; 2003.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittals procedures.
- B. Product Data: Submit manufacturer's product data and installation instructions for systems specified, demonstrating compliance with requirements.
- C. Samples:
 - 1. Plaster Finish: Submit 12 inch by 36 inch (305 mm by 914 mm) sample of each required plaster finish. Divide each panel into thirds to illustrate each coat. A portion of the finish coat should be painted per the architectural room finish schedule in the Contract Drawings.
 - a. Mount on plywood or hardboard using standard metal lath as a key.
 - 2. Control Joint: Submit a manufactured control joint with field-applied paint. Paint to match the plaster.
- D. Manufacturer's qualification statement.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section, with at least three years of documented experience.

1.06 MOCK-UPS

- A. See Section 01 4000 - Quality Requirements for additional requirements.
- B. Provide one mock-up panel in location directed by architect using existing exposed masonry wall as substrate to show workmanship and method of blending new work with existing plaster.
 - 1. Mock-up should be fully cured and painted prior to the Architect's review.
 - 2. The Architect's review and approval is required
- C. Mock-up may remain as part of the work.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Deliver materials in original and unopened packaging, with brand names and manufacturer's labels intact and legible.
- B. Store materials in dry location, fully protected from weather.

PART 2 - PRODUCTS

2.01 MATERIALS

- A. Aggregate for Base Coats: Natural sand complying with ASTM C35.
- B. Aggregate for Finish Coats: ASTM C842.
- C. Premixed Plaster:
 - 1. Custom match existing plaster constituents, color, texture, and strength.
- D. Lath and Accessories:
 - 1. Metal Lath: See Section 09 2236.
 - 2. Fasteners: Nails, staples, or other approved metal supports, of type and size to suit application, compatible with lath and plaster, and rigidly securing lath and accessories in place.
 - 3. Control Joints: Product should have a finish that is able to be painted in the field. Paint to match the plaster.
 - 4. Fiberglass Mesh Tape: Use at any cracks in the existing plaster to be repaired.
- E. See Section 09 9123 for interior painting materials.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Areas of full or partial removal of existing plaster are indicated on drawings.

3.02 EXISTING PLASTER REMOVAL

- A. In areas indicated, remove existing plaster to expose underlying masonry substrate.
- B. Select, employ, and control methods of removal.
 - 1. Protect substrate and adjacent materials to remain from damage.
 - 2. Sawcut joints at existing plaster where new control joints are to be installed.

3.03 PREPARATION

- A. Masonry Substrates with Metal Lath: See Section 09 2236.
 - 1. Control Joints: Install control joint lathing accessories in accordance with ASTM C1063.
- B. Protection: Protect adjacent surfaces from soiling and damage.

3.04 PLASTER APPLICATION

- A. General:
 - 1. Comply with lime manufacturer's instructions.
- B. Prefill depressions or low areas in masonry substrate with coats of plaster applied not greater than 3/8 inch (9.5 mm) nominal to level the surface prior to applying plaster coats.
- C. Install coats as follows:
 - 1. First or Scratch Coat: 3/8-inch (9.5 mm) nominal thickness.
 - 2. Second, Strengthening, or Brown Coat: 3/8-inch (9.5 mm) nominal thickness.
 - 3. Top or Finish Coat: One layer of 1/8-inch (3 mm) nominal thickness.
 - a. Surface Texture: Match existing; PCA EB049.
 - 4. After consolidating the scratch coat and when thumbprint hard, scratch the surface to provide key for subsequent coat.
 - 5. Compact each base coat using a wood float. Rewet, by misting, and float brown coat at least twice to consolidate mortar during drying. Float to open-grained surface to provide sufficient key for finish coat.
 - 6. Float finish coat to compact and provide uniform texture and color finish. Do not overwork. Patch minor imperfections by floating small quantities of fairly dry finish coat mixture into the surface.
 - 7. Uniformity:
 - a. Obtain uniform texture to match approved mock-up.
 - b. Obtain uniform color within the limits of color variation, as determined by the Architect

8. Tolerances: Deviation from plane not to exceed 1/8 inch in 10 feet (3 mm in 3 m), measured with a straightedge at any location on surface.
9. Curing:
 - a. Allow approximately one to three weeks or more curing time between coats according to temperature and humidity.
 - b. Rewet cured coats before applying subsequent coats.

3.05 JOINTING

- A. Do not bridge expansion or control joints.

3.06 CURING

- A. Protect plaster against uneven and excessive evaporation of moisture and from strong, dry airflow.
 1. Apply and cure plaster as required by climatic and job conditions to prevent drying out during curing period.
 2. Cover with plastic sheeting to protect from frost, heavy rain, strong winds, and direct sunlight for minimum of 72 hours after application.
 3. Mist plaster surfaces three times per day - morning, noon, and evening - to ensure plaster environment remains at 90 percent relative humidity during the first 72 hours of curing each coat.
 4. Do not use commercial curing compounds.

END OF SECTION

This page intentionally left blank

SECTION 09 3000 TILING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Tile for floor applications.
- B. Tile for wall applications.
- C. Cementitious backer board as tile substrate.
- D. Non-ceramic trim.

1.02 REFERENCE STANDARDS

- A. ANSI A108/A118/A136 - American National Standard Specifications for the Installation of Ceramic Tile (Compendium); 2019.
- B. ANSI A108.11 - American National Standard Specifications for Interior Installation of Cementitious Backer Units; 2018.
- C. ANSI A118.9 - American National Standard Specifications for Test Methods and Specifications for Cementitious Backer Units; 2019.
- D. ANSI A118.12 - American National Standard Specifications for Crack Isolation Membranes for Thin-Set Ceramic Tile and Dimension Stone Installation; 2014 (Reaffirmed 2019).
- E. ANSI A137.1 - American National Standard Specifications for Ceramic Tile; 2022.
- F. ASTM C373 - Standard Test Methods for Determination of Water Absorption and Associated Properties by Vacuum Method for Pressed Ceramic Tiles and Glass Tiles and Boil Method for Extruded Ceramic Tiles and Non-tile Fired Ceramic Whiteware Products; 2018 (Reapproved 2023).
- G. TCNA (HB) - Handbook for Ceramic, Glass, and Stone Tile Installation; 2023.

1.03 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide manufacturers' data sheets on tile, mortar, grout, and accessories. Include instructions for using grouts and adhesives.
- C. Shop Drawings: Indicate tile layout, patterns, color arrangement, perimeter conditions, junctions with dissimilar materials, control and expansion joints, thresholds, and setting details.
- D. Samples: Mount tile and apply grout on two plywood panels, minimum 18 by 18 inches (457 by 457 mm) in size illustrating pattern, color variations, and grout joint size variations.
- E. Maintenance Materials: Furnish the following for Owner's use in maintenance of project.
 - 1. See Section 01 6000 - Product Requirements, for additional provisions.
 - 2. Extra Tile: 1 percent of each size, color, and surface finish combination, but not less than 10 of each type.

1.04 QUALITY ASSURANCE

- A. Maintain one copy of ANSI A108/A118/A136 and TCNA (HB) on site.
- B. Manufacturer Qualifications: Company specializing in manufacturing the types of products specified in this section, with minimum five years of documented experience.
- C. Installer Qualifications:
 - 1. Company specializing in performing tile installation, with minimum of five years of documented experience.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Protect adhesives from freezing or overheating in accordance with manufacturer's instructions.

1.06 FIELD CONDITIONS

- A. Do not install solvent-based products in an unventilated environment.

- B. Maintain ambient and substrate temperature above 50 degrees F (10 degrees C) and below 100 degrees F (38 degrees C) during installation and curing of setting materials.

PART 2 PRODUCTS

2.01 TILE

- A. Ceramic Wall Tile, Type CWT1, CWT2, CWT3: ANSI A137.1 standard grade.
 - 1. Moisture Absorption: 0 to 0.5 percent as tested in accordance with ASTM C373.
 - 2. Color and Size: As indicated on drawings.
 - 3. Products:
 - a. Dal-Tile Corporation: www.daltile.com/#sle.
 - b. _____.
 - c. Substitutions: See Section 01 6000 - Product Requirements.
- B. Porcelain Tile; Type PFT1, PWT1, PTB1: ANSI A137.1 standard grade.
 - 1. Moisture Absorption: 0 to 0.5 percent as tested in accordance with ASTM C373.
 - 2. Size: As indicated on drawings
 - 3. Color(s): As indicated on drawings
 - 4. Products:
 - a. Crossville Studios: Sands; www.crossvillestudios.com
 - b. Substitutions: See Section 01 6000 - Product Requirements
- C. Porcelain Floor Tile, Type PFT2; ANSI A137.1 standard grade
 - 1. Moisture Absorption: 0 to 0.5 percent as tested in accordance with ASTM C373.
 - 2. Color & Size: As indicated on drawings
 - 3. Products:
 - a. Crossville Studios; Joyful Place; www.crossvillestudios.com
 - b. Substitutions: See Section 01 6000 - Product Requirements.
- D. Porcelain Tile, Type PFT3, PTB2; ANSI A137.1 standard grade
 - 1. Moisture Absorption: 0 to 0.5 percent as tested in accordance with ASTM C373.
 - 2. Color & Size: As indicated on drawings
 - 3. Products:
 - a. Crossville Studios: Cross-Colors Mingles; www.crossvillestudios.com
 - b. Substitutions: See Section 01 6000 - Product Requirements.
- E. Porcelain Wall Tile, Type PWT2, ANSI A137.1 standard grade
 - 1. Moisture Absorption: 0 to 0.5 percent as tested in accordance with ASTM C373
 - 2. Color & Size: As indicated on drawings
 - 3. Products:
 - a. Metro Surfaces: Division 5 Stacked; www.metro Surfaces.com
 - b. Substitutions: See Section 01 6000 - Product Requirements

2.02 TRIM AND ACCESSORIES

- A. Non-Ceramic Trim: Satin brass anodized extruded aluminum, style and dimensions as indicated on drawings, for setting using tile mortar or adhesive.

2.03 SETTING MATERIALS

- A. Provide setting and grout materials from same manufacturer.
- B. Setting Mortar for Large Module Tile: Medium-bed polymer-modified single-component mortar complying with ANSI A116.4 and ISO 13007.
 - 1. Basis of design: Acceptable products, MAPEI, "Ultraflex LFT", ISO 13007; C2TES1P1
 - a. Substitutions: See Section 01 6000 - Product Requirements
 - b. Adjust trowel notch size to 1/4"x1/4"x1/4" for smaller tiles.
 - c. Provide white mortar when adhering white.
 - d. Applications: interior floor and wall installations.

2.04 GROUTS

- A. Provide setting and grout materials from same manufacturer.

- B. Epoxy Grout meeting ISO 13007; RG and ANSI A118.3
 - 1. Basis of design: MAPEI "Kerapoxy CQ" as manufactured by Mapei; www.mapei.com
 - a. Substitutions: See Section 01 6000 - Product Requirements
 - 2. Color(s): As selected by Architect from manufacturer's full line.
 - 3. Application: Use for all tile where water is present in locations such as restrooms, kitchens, water fountains.
- C. Polymer Modified Sanded Grout meeting ISO 13007-4; CG2 and ANSI A118.3.
 - 1. Basis of design: MAPEI "Flexcolor CQ" as manufactured by Mapei; www.mapei.com
 - 2. Compressive Strength: When tested in accordance with ASTM C 109 at 110 percent flow.
 - 3. Color: As indicated in Material Schedule.
 - 4. Application: Use for all tile for which a different grout is not specified.

2.05 MAINTENANCE MATERIALS

- A. Tile Sealant: Gunnable, silicone, siliconized acrylic, or urethane sealant; moisture and mildew resistant type.
 - 1. Applications: Between tile and plumbing fixtures.
 - 2. Color(s): As selected by Architect from manufacturer's full line.
 - 3. Products:
 - a. Mapesil T as manufactured by Mapei, www.mapei.com.
 - b. Substitutions: See Section 01 6000 - Product Requirements.

2.06 ACCESSORY MATERIALS

- A. Concrete Floor Slab Crack Isolation Membrane: Material complying with ANSI A118.12; not intended as waterproofing.
 - 1. Crack Resistance: No failure at 1/8 inch (3.2 mm) gap, minimum.
 - 2. Fluid or Trowel Applied Type:
 - a. Material: Synthetic rubber or Acrylic.
 - b. Thickness: 20 mils (0.5 mm), maximum.
 - c. Products:
 - 1) Mapelast AquaDefense as manufactured by Mapei. www.mapei.com.
 - 2) Substitutions: See Section 01 6000 - Product Requirements.
- B. Backer Board: Cementitious type complying with ANSI A118.9; high density, glass fiber reinforced, 7/16 inch (11 mm) thick; 2 inch (51 mm) wide coated glass fiber tape for joints and corners.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that subfloor surfaces are smooth and flat within the tolerances specified for that type of work and are ready to receive tile.
- B. Verify that wall surfaces are smooth and flat within the tolerances specified for that type of work, are dust-free, and are ready to receive tile.
- C. Verify that subfloor surfaces are dust free and free of substances that could impair bonding of setting materials to subfloor surfaces.
- D. Cementitious Subfloor Surfaces: Verify that substrates are ready for tiling installation by testing for moisture and alkalinity (pH).
 - 1. Obtain instructions if test results are not within limits recommended by tiling material manufacturer and setting material manufacturer.

3.02 PREPARATION

- A. Protect surrounding work from damage.
- B. Vacuum clean surfaces and damp clean.
- C. Seal substrate surface cracks with filler. Level existing substrate surfaces to acceptable flatness tolerances.

- D. Install backer board in accordance with ANSI A108.11 and board manufacturer's instructions. Tape joints and corners, cover with skim coat of setting material to a feather edge.

3.03 INSTALLATION - GENERAL

- A. Install tile and thresholds and grout in accordance with applicable requirements of ANSI A108.1a through ANSI A108.20, manufacturer's instructions, and TCNA (HB) recommendations.
- B. Lay tile to pattern indicated. Do not interrupt tile pattern through openings.
- C. Cut and fit tile to penetrations through tile, leaving sealant joint space. Form corners and bases neatly. Align floor joints.
- D. Place tile joints uniform in width, subject to variance in tolerance allowed in tile size. Make grout joints without voids, cracks, excess mortar or excess grout, or too little grout.
- E. Form internal angles square and external angles bullnosed.
- F. Install non-ceramic trim in accordance with manufacturer's instructions.
- G. Install thresholds where indicated.
- H. Sound tile after setting. Replace hollow sounding units.
- I. Keep control and expansion joints free of mortar, grout, and adhesive.
- J. Prior to grouting, allow installation to completely cure; minimum of 48 hours.
- K. Grout tile joints unless otherwise indicated.
- L. At changes in plane and tile-to-tile control joints, use tile sealant instead of grout, with either bond breaker tape or backer rod as appropriate to prevent three-sided bonding.

3.04 INSTALLATION - FLOORS - THIN-SET METHODS

- A. Over interior concrete substrates, install in accordance with TCNA (HB) Method F113, dry-set or latex-Portland cement bond coat, with standard grout, unless otherwise indicated.
 - 1. Where waterproofing membrane is indicated, install in accordance with TCNA (HB) Method F122, with latex-Portland cement grout.
 - 2. Where epoxy bond coat and grout are indicated, install in accordance with TCNA (HB) Method F131.
- B. Install tile-to-tile floor movement joints in accordance with TCNA (HB) Method EJ171F.

3.05 INSTALLATION - WALL TILE

- A. Over cementitious backer units on studs, install in accordance with TCNA (HB) Method W244, using membrane at toilet rooms.

3.06 CLEANING

- A. Clean tile and grout surfaces.

3.07 PROTECTION

- A. Do not permit traffic over finished floor surface for 4 days after installation.

END OF SECTION

SECTION 09 5100 ACOUSTICAL CEILINGS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Suspended metal grid ceiling system.
- B. Acoustical units.

1.02 REFERENCE STANDARDS

- A. ASTM C635/C635M - Standard Specification for Manufacture, Performance, and Testing of Metal Suspension Systems for Acoustical Tile and Lay-in Panel Ceilings; 2022.
- B. ASTM C636/C636M - Standard Practice for Installation of Metal Ceiling Suspension Systems for Acoustical Tile and Lay-In Panels; 2019.
- C. ASTM E580/E580M - Standard Practice for Installation of Ceiling Suspension Systems for Acoustical Tile and Lay-in Panels in Areas Subject to Earthquake Ground Motions; 2022.
- D. ASTM E1264 - Standard Classification for Acoustical Ceiling Products; 2023.

1.03 ADMINISTRATIVE REQUIREMENTS

- A. Sequence work to ensure acoustical ceilings are not installed until building is enclosed, sufficient heat is provided, dust generating activities have terminated, and overhead work is completed, tested, and approved.
- B. Do not install acoustical units until after interior wet work is dry.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Shop Drawings: Indicate grid layout and related dimensioning.
- C. Product Data: Provide data on suspension system components and acoustical units.
- D. Samples: Submit two samples 6 by 6 inch (____by____ mm) in size illustrating material and finish of acoustical units.
- E. Maintenance Materials: Furnish the following for Owner's use in maintenance of project.
 - 1. See Section 01 6000 - Product Requirements, for additional provisions.
 - 2. Extra Acoustical Units: Quantity equal to 5 percent of total installed.

1.05 QUALITY ASSURANCE

- A. Designer Qualifications for Seismic Design: Perform under direct supervision of a Professional Structural Engineer experienced in design of this work and licensed at Oklahoma.
- B. Suspension System Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.
- C. Acoustical Unit Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience.

1.06 FIELD CONDITIONS

- A. Maintain uniform temperature of minimum 60 degrees F (16 degrees C), and maximum humidity of 40 percent prior to, during, and after acoustical unit installation.

PART 2 PRODUCTS

2.01 ACOUSTICAL UNITS

- A. Acoustical Units - General: ASTM E1264, Class A.
- B. Acoustical Panels ACT1: Painted mineral fiber, with the following characteristics:
 - 1. Classification: ASTM E1264 Type IV.
 - 2. Size: 24 by 24 inches (610 by 610 mm).
 - 3. Thickness: 1 inch (____ mm).
 - 4. Panel Edge: Square.

5. Suspension System: Exposed grid.
 6. Products:
 - a. Armstrong World Industries, Inc, Ultima High NRC 15/16" Square Lay-in: www.armstrongceilings.com.
 - b. Substitutions: See Section 01 6000 - Product Requirements.
- C. Acoustical Panels ACT2: Painted mineral fiber, with the following characteristics:
1. Classification: ASTM E1264 Type IX.
 - a. Form: 2, water felted.
 - b. Pattern: "G" - smooth.
 2. Size: 24 by 24 inches (610 by 610 mm).
 3. Thickness: 5/8 inch (16 mm).
 4. Panel Edge: Square.
 5. Suspension System: Exposed grid.
 6. Products:
 - a. Armstrong World Industries, Kitchen Zone Square Lay-in Smooth Texture; www.armstrongceilings.com.
 - b. Substitutions: See Section 01 6000 - Product Requirements.

2.02 SUSPENSION SYSTEM(S)

- A. Metal Suspension Systems - General: Complying with ASTM C635/C635M; die cut and interlocking components, with perimeter moldings, hold down clips, stabilizer bars, clips, and splices as required.
- B. Metal Suspension Systems - General: Complying with ASTM C635/C635M; die cut and interlocking components, with perimeter moldings, hold down clips, stabilizer bars, clips, and splices as required.
- C. Exposed Suspension System, Type CG1: Hot-dipped galvanized steel grid with steel cap.
 1. Structural Classification: Intermediate-duty, when tested in accordance with ASTM C635/C635M.
 2. Profile: Tee; 15/16 inch (24 mm) face width.
 3. Finish: Baked enamel.
 4. Color: White.
 5. Products:
 - a. Armstrong World Industries; Prelude 15/16" Square Lay-in Grid; www.armstrongceilings.com.
 - b. Substitutions: See Section 01 6000 - Product Requirements.

2.03 ACCESSORIES

- A. Support Channels and Hangers: Galvanized steel; size and type to suit application, seismic requirements, and ceiling system flatness requirement specified.
- B. Hanger Wire: 12 gauge, 0.08 inch (2 mm) galvanized steel wire.
- C. Hold-Down Clips: Manufacturer's standard clips to suit application.
- D. Perimeter Moldings: Same metal and finish as grid.
- E. Metal Edge Trim for "Cloud" Suspension Systems and Metal Transition Pieces: Steel or extruded aluminum, provide attachment clips, splice plates, and preformed corner pieces for complete trim system.
 1. Finish: Baked enamel.
 2. Color: White
 3. Dimensions: refer to plans
 4. Products:
 - a. Armstrong World Industries, Inc; Armstrong AXIOM Perimeter Trim
 - b. Substitutions: See Section 01 6000 - Product Requirements
- F. Metal Edge Trim for Suspension Systems: Steel or extruded aluminum; provide attachment clips, splice plates, and preformed corner pieces for complete trim system.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify that layout of hangers will not interfere with other work.

3.02 PREPARATION

- A. Install after major above-ceiling work is complete.
- B. Coordinate the location of hangers with other work.
- C. Provide hanger clips during steel deck erection. Provide additional hangers and inserts as required.

3.03 INSTALLATION - SUSPENSION SYSTEM

- A. Install suspension system in accordance with ASTM C636/C636M, ASTM E580/E580M, and manufacturer's instructions and as supplemented in this section.
- B. Rigidly secure system, including integral mechanical and electrical components, for maximum deflection of 1:360.
- C. Perimeter Molding: Install at intersection of ceiling and vertical surfaces and at junctions with other interruptions.
 - 1. Use longest practical lengths.
- D. Suspension System, Non-Seismic: Hang suspension system independent of walls, columns, ducts, pipes and conduit. Where carrying members are spliced, avoid visible displacement of face plane of adjacent members.
- E. Where ducts or other equipment prevent the regular spacing of hangers, reinforce the nearest affected hangers and related carrying channels to span the extra distance.
- F. Do not support components on main runners or cross runners if weight causes total dead load to exceed deflection capability.
- G. Support fixture loads using supplementary hangers located within 6 inches (152 mm) of each corner, or support components independently.
- H. Do not eccentrically load system or induce rotation of runners.

3.04 INSTALLATION - ACOUSTICAL UNITS

- A. Install acoustical units in accordance with manufacturer's instructions.
- B. Fit acoustical units in place, free from damaged edges or other defects detrimental to appearance and function.
- C. Fit border trim neatly against abutting surfaces.
- D. Install acoustical units level, in uniform plane, and free from twist, warp, and dents.
- E. Cutting Acoustical Units:
 - 1. Make field cut edges of same profile as factory edges.

3.05 TOLERANCES

- A. Maximum Variation from Flat and Level Surface: 1/8 inch in 10 feet (3 mm in 3 m).
- B. Maximum Variation from Plumb of Grid Members Caused by Eccentric Loads: 2 degrees.

3.06 CLEANING

- A. See Section 01 7000 - Execution and Closeout Requirements for additional requirements.
- B. Clean surfaces.
- C. Replace damaged or abraded components.

END OF SECTION

This page intentionally left blank

SECTION 09 6500 RESILIENT FLOORING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Resilient base.
- B. Installation accessories.

1.02 REFERENCE STANDARDS

- A. ASTM F710 - Standard Practice for Preparing Concrete Floors to Receive Resilient Flooring; 2022.
- B. ASTM F1861 - Standard Specification for Resilient Wall Base; 2021.
- C. ASTM F1869 - Standard Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride; 2023.
- D. ASTM F2170 - Standard Test Method for Determining Relative Humidity in Concrete Floor Slabs Using in situ Probes; 2019a.

1.03 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Provide data on specified products, describing physical and performance characteristics; including sizes, patterns and colors available; and installation instructions.
- C. Verification Samples: Submit two samples, 2 by 4 inch (___ by ___ mm) in size illustrating color and pattern for each resilient flooring product specified.
- D. Manufacturer's Qualification Statement.
- E. Installer's Qualification Statement.
- F. Maintenance Materials: Furnish the following for Owner's use in maintenance of project.
 - 1. See Section 01 6000 - Product Requirements, for additional provisions.
 - 2. Extra Wall Base: 50 linear feet (_____ linear meters) of each type and color.

1.04 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing specified flooring with minimum three years documented experience.
- B. Installer Qualifications: Company specializing in installing specified flooring with minimum three years documented experience.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Upon receipt, immediately remove any shrink-wrap and check materials for damage and the correct style, color, quantity and run numbers.
- B. Store all materials off of the floor in an acclimatized, weather-tight space.
- C. Maintain temperature in storage area between 55 degrees F (13 degrees C) and 90 degrees F (72 degrees C).
- D. Protect roll materials from damage by storing on end.

1.06 FIELD CONDITIONS

- A. Store materials for not less than 48 hours prior to installation in area of installation at a temperature of 70 degrees F (21 degrees C) to achieve temperature stability. Thereafter, maintain conditions above 55 degrees F (13 degrees C).

PART 2 PRODUCTS

2.01 RESILIENT BASE

- A. Resilient Base - RB1: ASTM F1861, Type TS, rubber, vulcanized thermoset; style as scheduled.
 - 1. Manufacturers:

- a. Johnsonite, a Tarkett Company: www.johnsonite.com/#sle.
 - b. Substitutions: See Section 01 6000 - Product Requirements.
- 2. Height: 4 inches (100 mm).
- 3. Thickness: 0.125 inch (3.2 mm).
- 4. Finish: Satin.
- 5. Length: Roll.
- 6. Color: As indicated on drawings.
- 7. Accessories: Premolded external corners and internal corners.

2.02 ACCESSORIES

- A. Subfloor Filler: White premix latex; type recommended by adhesive material manufacturer.
- B. Primers, Adhesives, and Seam Sealer: Waterproof; types recommended by flooring manufacturer.
- C. Moldings, Transition and Edge Strips: Same material as flooring.
- D. Filler for Coved Base: Plastic.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that surfaces are flat to tolerances acceptable to flooring manufacturer, free of cracks that might telegraph through flooring, clean, dry, and free of curing compounds, surface hardeners, and other chemicals that might interfere with bonding of flooring to substrate.
- B. Verify that wall surfaces are smooth and flat within the tolerances specified for that type of work, are dust-free, and are ready to receive resilient base.
- C. Cementitious Subfloor Surfaces: Verify that substrates are ready for resilient flooring installation by testing for moisture and alkalinity (pH).
 - 1. Test as Follows:
 - a. Alkalinity (pH): ASTM F710.
 - b. Internal Relative Humidity: ASTM F2170.
 - c. Moisture Vapor Emission: ASTM F1869.
 - 2. Obtain instructions if test results are not within limits recommended by resilient flooring manufacturer and adhesive materials manufacturer.

3.02 INSTALLATION - GENERAL

- A. Install in accordance with manufacturer's written instructions.
- B. Install edge strips at unprotected or exposed edges, where flooring terminates, and where indicated.
 - 1. Resilient Strips: Attach to substrate using adhesive.

3.03 INSTALLATION - RESILIENT BASE

- A. Fit joints tightly and make vertical. Maintain minimum dimension of 18 inches (45 mm) between joints.
- B. Miter internal corners. At external corners, use premolded units. At exposed ends, use premolded units.
- C. Install base on solid backing. Bond tightly to wall and floor surfaces.

3.04 CLEANING

- A. Remove excess adhesive from floor, base, and wall surfaces without damage.
- B. Clean in accordance with manufacturer's written instructions.

3.05 PROTECTION

- A. Prohibit traffic on resilient flooring for 48 hours after installation.

END OF SECTION

SECTION 09 6813 TILE CARPETING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Carpet tile, fully adhered.

1.02 REFERENCE STANDARDS

- A. ASTM D2859 - Standard Test Method for Ignition Characteristics of Finished Textile Floor Covering Materials; 2016 (Reapproved 2021).
- B. ASTM E648 - Standard Test Method for Critical Radiant Flux of Floor-Covering Systems Using a Radiant Heat Energy Source; 2019a, with Editorial Revision (2020).
- C. ASTM F710 - Standard Practice for Preparing Concrete Floors to Receive Resilient Flooring; 2022.
- D. ASTM F1869 - Standard Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride; 2023.
- E. ASTM F2170 - Standard Test Method for Determining Relative Humidity in Concrete Floor Slabs Using in situ Probes; 2019a.
- F. NFPA 253 - Standard Method of Test for Critical Radiant Flux of Floor Covering Systems Using a Radiant Heat Energy Source; 2023.

1.03 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data on specified products, describing physical and performance characteristics; sizes, patterns, colors available, and method of installation.
- C. Shop Drawings: Indicate layout of joints.
- D. Samples: Submit two carpet tiles illustrating color and pattern design for each carpet color selected.
- E. Maintenance Materials: Furnish the following for Owner's use in maintenance of project.
 - 1. See Section 01 6000 - Product Requirements, for additional provisions.
 - 2. Extra Carpet Tiles: Quantity equal to 5 percent of total installed of each color and pattern installed.

1.04 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing specified carpet tile with minimum three years documented experience.
- B. Installer Qualifications: Company specializing in installing carpet tile with minimum three years documented experience and approved by carpet tile manufacturer.

1.05 FIELD CONDITIONS

- A. Store materials in area of installation for minimum period of 24 hours prior to installation.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Tile Carpeting, Type CPT1: Tufted, manufactured in one color dye lot.
 - 1. Product: Diffuse Color manufactured by Shaw Contract; www.shawcontract.com.
 - a. Substitutions: See Section 01 6000 - Product Requirements
 - 2. Color & Size: as indicated on the drawings.
 - 3. Critical Radiant Flux: Minimum of 0.22 watts/sq cm, when tested in accordance with ASTM E648 or NFPA 253.
 - 4. Surface Flammability Ignition: Pass ASTM D2859 (the "pill test").
- B. Tile Carpeting, Type CPT2: Tufted, manufactured in one color dye lot.
 - 1. Product: Color Frame manufactured by Shaw Contract; www.shawcontract.com

2. Substitutions: See Section 01 6000 - Product Requirements
 3. Color & Size: as indicated on the drawings.
 4. Critical Radiant Flux: Minimum of 0.22 watts/sq cm, when tested in accordance with ASTM E648 or NFPA 253.
 5. Surface Flammability Ignition: Pass ASTM D2859 (the "pill test").
- C. Tile Carpeting; Type WOC1; Tufted, manufactured in one color dye lot
1. Product: Moving as manufactured by Patcraft; www.patcraft.com
 - a. Substitutions: See Section 01 6000 - Product Requirements
 2. Color & Size: as indicated on the drawings
 3. Critical Radiant Flux: Minimum of 0.22 watts/sq cm, when tested in accordance with ASTM E648 or NFPA 253.
 4. Surface Flammability Ignition: Pass ASTM D2859 (the "pill test")

2.02 ACCESSORIES

- A. Subfloor Filler: White premix latex; type recommended by flooring material manufacturer.
- B. Edge Strips: Rubber, color as selected by Architect.
- C. Carpet Tile Adhesive: Recommended by carpet tile manufacturer; releasable type.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that subfloor surfaces are smooth and flat within tolerances specified for that type of work and are ready to receive carpet tile.
- B. Verify that subfloor surfaces are dust-free and free of substances that could impair bonding of adhesive materials to subfloor surfaces.
- C. Cementitious Subfloor Surfaces: Verify that substrates are ready for flooring installation by testing for moisture and alkalinity (pH).
 1. Test as Follows:
 - a. Alkalinity (pH): ASTM F710.
 - b. Internal Relative Humidity: ASTM F2170.
 - c. Moisture Vapor Emission: ASTM F1869.
 2. Obtain instructions if test results are not within limits recommended by flooring material manufacturer and adhesive materials manufacturer.

3.02 PREPARATION

- A. Prepare floor substrates as recommended by flooring and adhesive manufacturers.
- B. Remove subfloor ridges and bumps. Fill minor or local low spots, cracks, joints, holes, and other defects with subfloor filler.
- C. Apply, trowel, and float filler to achieve smooth, flat, hard surface. Prohibit traffic until filler is cured.

3.03 INSTALLATION

- A. Starting installation constitutes acceptance of subfloor conditions.
- B. Install carpet tile in accordance with manufacturer's instructions.
- C. Blend carpet from different cartons to ensure minimal variation in color match.
- D. Cut carpet tile clean. Fit carpet tight to intersection with vertical surfaces without gaps.
- E. Lay carpet tile in square pattern, with pile direction parallel to next unit, set parallel to building lines.
- F. Fully adhere carpet tile to substrate.
- G. Trim carpet tile neatly at walls and around interruptions.
- H. Complete installation of edge strips, concealing exposed edges.

3.04 CLEANING

- A. Remove excess adhesive without damage, from floor, base, and wall surfaces.
- B. Clean and vacuum carpet surfaces.

END OF SECTION

This page intentionally left blank

**SECTION 09 7260
TACKABLE WALLCOVERING**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Resilient cork/linoleum tackable wallcovering.

1.02 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: indicating compliance with specified requirements.
- C. Shop Drawings: Indicate location, type and dimensions.
- D. Samples: Two samples, 7 by 7 inches (___ by ___ mm) in size, indicating type of tackable wallcovering material required in color specified.

1.03 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section, with at least three years of documented experience.
- B. Fabricator Qualifications: Company specializing in fabricating products specified in this section, with at least three years of documented experience.
- C. Installer Qualifications: Company specializing in performing work of the type specified and with at least three years of documented experience.
- D. Surface Burning Characteristics Classification: Provide materials that meet classification ratings: ASTM E84 (Flame Spread and Smoke Developed) IIB
- E. Single Source Responsibility: Obtain tackable wallcovering system components from a single source.
- F. Deliver materials in original factory packaging, labeled with manufacturer, brand name, size, color, and lot number.
- G. Store materials in original, undamaged packaging inside a well-ventilated area protected from weather, moisture, soiling, and extreme temperatures.
 - 1. Maintain room temperature within the storage area at not less than 68 degrees Fahrenheit (20 degrees Celsius) during the period materials are stored.

1.04 FIELD CONDITIONS

- A. Maintain ambient temperature within the building at not less than 68 degrees Fahrenheit (20 degrees Celsius) for a minimum of seventy-two hours prior to beginning of installation.
 - 1. Do not install tackable wallcovering until the space is enclosed and weatherproof.
 - 2. Do not install tackable wallcovering until temperature is stabilized and permanent lighting is in place.

1.05 MAINTENANCE

- A. Maintenance Instructions: Include precautions against cleaning materials and methods that may be detrimental to finishes and performance.

1.06 WARRANTY

- A. Submit manufacturer's limited five-year written warranty against manufacturing defects.

PART 2 PRODUCTS

2.01 PRODUCTS

- A. Tac-Wall as manufactured by Walltalkers; www.walltalkers.com
 - 1. Substitutions: See Section: 01 6000 - Product Requirements
- B. Content: uni-color resilient homogeneous tackable linoleum surface consisting of linseed oil, granulated cork, rosin binders, and dry pigments calendered onto natural burlap backing. Color shall extend through thickness of material.

- C. Width: 48 inch or 72 inch
- D. Gauge: 1/4 inch
- E. Flexible enough to bend around a 2-3/4" radius. Dimensionally stable due to burlap backing

2.02 ACCESSORIES

- A. Adhesive: as recommended by manufacturer.
- B. Caulk: color to match tack surface.
- C. Trims as required for installation condition.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Examine areas and conditions in which tackable wallcoverings will be installed.
 1. Complete finishing operations, including painting, before beginning installation of tackable wallcovering materials.
 2. Wall surface to receive wallcovering materials shall be dry and free from dirt, grease, loose paint, and scale.
 3. Notify the contractor and architect in writing of any conditions detrimental to the proper and timely completion of the installation.
 4. Beginning of installation means acceptance of surface conditions.

3.02 PREPARATION

- A. Surface Preparation: Remove hardware, accessories, plates, and similar items to allow tackable wallcovering to be installed.
 1. Gypsum board surface: Recess nails and screws. Repair irregular tape joints, sand and remove dust.
 2. Painted surface: Remove loose paint or scale. Sand surface of enamel or gloss paint and wipe clean
 3. Ensure wall surfaces scheduled to receive tackable wallcovering are properly sealed with a quality primer specified for use under flexible vinyl wallcoverings.

3.03 INSTALLATION

- A. Install in accordance with manufacturer's written instructions.
- B. Cut sheets to size including a few inches of overage. Allow sheets to lay flat for at least twenty-four hours prior to the application. Mark roll direction and sequence on the backside of each sheet. Hang sheets in sequence as cut from the roll, do not reverse sheets.
- C. Permanent HVAC system should be set to 68 degrees Fahrenheit (20 degree Celsius) for at least seventy-two hours prior to, during, and after the installation.
- D. Back roll each sheet prior to the installation to release curl memory.
- E. For seamed applications, using a seam and strip cutter remove the factory edge of one sheet. Using the same tool, overlap and trace cut the mating edge of the second sheet. Repeat this step for as many sheets as required for the job.
- F. Scribe, cut and fit material to butt tightly to adjacent surfaces, built-in casework, and permanent fixtures and pipes.
- G. Apply adhesive with a 1/16 inch square notch trowel to the area to receiving the sheet (apply enough for one sheet at a time).
- H. Work from top to bottom then side to side. Roll sheet firmly into adhesive for positive contact and to remove air bubbles.
- I. Remove adhesive residue immediately after each panel is hung with a mild soap/water solution and soft cloth/sponge.

3.04 CLEANING

- A. Clean wallcovering using a sponge with a neutral pH cleaning solution. Do not use abrasive cleaners. Rinse thoroughly with water and let dry before using.

B. It is important to remove adhesive while wet.

3.05 PROTECTION

A. Protect installed product from subsequent construction operations.

END OF SECTION

This page intentionally left blank

**SECTION 09 8430
SOUND-ABSORBING WALL AND CEILING UNITS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Sound-absorbing ceiling clouds
- B. Sound-absorbing ceiling baffles.

1.02 REFERENCE STANDARDS

1.03 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Manufacturer's printed data sheets for products specified.
- C. Shop Drawings: Fabrication and installation details, panel layout and fabric orientation.
- D. Verification Samples: Fabricated samples of each type of panel specified; 12 by 12 inch (305 by 305 mm), showing construction, edge details, and fabric covering.
- E. Test Reports: Certified test data from an independent test agency verifying that panels meet specified requirements for acoustical and fire performance.

1.04 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products of the type specified in this section, with at least three years of documented experience.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Protect acoustical units from moisture during shipment, storage, and handling. Deliver in factory-wrapped bundles; do not open bundles until units are needed for installation.
- B. Store units flat, in dry, well-ventilated space; do not stand on end.
- C. Protect edges from damage.

PART 2 PRODUCTS

2.01 SOUND-ABSORBING UNITS

- A. Acoustic Clouds (Type ACC1, ACC2)
 - 1. Manufacturer:
 - a. Geo Cloud as manufactured by EZObord; www.ezobord.com; Steven Mott - 405-760-4466
 - b. Substitutions: See Section 01 6000 - Product Requirements
 - 2. Composition: 100% PET (min. %50 recycled content)
 - 3. Fire Testing: ASTM E84
 - 4. Color & Size: as indicated on the drawings
- B. Acoustic Baffles (Type AB1)
 - 1. Manufacturer:
 - a. Ceiling Baffles as manufactured by EZObord; www.ezobord.com, Steven Mott - 405-760-4466
 - b. Substitutions: See Section 01 6000 - Product Requirements
 - 2. Composition: 100% PET (min %50 recycled content)
 - 3. Fire Testing: ASTM E84
 - 4. Color & Size: as indicated on the drawings

2.02 ACCESSORIES

- A. Ceiling-Suspended Accessories: Manufacturer's standard accessories at locations as indicated on each acoustical unit, sized appropriately for weight of acoustical unit.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Examine substrates for conditions detrimental to installation of acoustical units. Proceed with installation only after unsatisfactory conditions have been corrected.

3.02 INSTALLATION

- A. Install acoustical units in locations as indicated, following manufacturer's installation instructions.
- B. Install mounting accessories and supports in accordance with shop drawings.
- C. Suspend ceiling clouds at locations and heights as indicated.

3.03 CLEANING

- A. Clean sound-absorptive panels upon completion of installation from dust and other foreign materials, following manufacturer's instructions.

3.04 PROTECTION

- A. Provide protection of installed acoustical panels until Date of Substantial Completion.
- B. Replace panels that cannot be cleaned and repaired to satisfaction of the Architect.

END OF SECTION

SECTION 09 9113 EXTERIOR PAINTING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Surface preparation.
- B. Field application of paints.
- C. Scope: Finish exterior surfaces exposed to view, unless fully factory-finished and unless otherwise indicated, including the following:
 - 1. Exposed surfaces of structural steel.
- D. Do Not Paint or Finish the Following Items:
 - 1. Items factory-finished unless otherwise indicated; materials and products having factory-applied primers are not considered factory finished.
 - 2. Items indicated to receive other finishes.
 - 3. Items indicated to remain unfinished.
 - 4. Fire rating labels, equipment serial number and capacity labels, and operating parts of equipment.
 - 5. Stainless steel, anodized aluminum, bronze, terne-coated stainless steel, zinc, and lead.
 - 6. Marble, granite, slate, and other natural stones.
 - 7. Floors, unless specifically indicated.
 - 8. Brick, glass unit masonry, architectural concrete, cast stone, integrally colored plaster and stucco.
 - 9. Glass.
 - 10. Concealed pipes, ducts, and conduits.

1.02 RELATED REQUIREMENTS

- A. Section 05 5000 - Metal Fabrications: Shop-primed items.

1.03 DEFINITIONS

- A. Comply with ASTM D16 for interpretation of terms used in this section.

1.04 REFERENCE STANDARDS

- A. ASTM D16 - Standard Terminology for Paint, Related Coatings, Materials, and Applications; 2023.
- B. MPI (APSM) - Master Painters Institute Architectural Painting Specification Manual; Current Edition.
- C. SSPC-SP 1 - Solvent Cleaning; 2015, with Editorial Revision (2016).
- D. SSPC-SP 6 - Commercial Blast Cleaning; 2007.

1.05 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide complete list of products to be used, with the following information for each:
 - 1. Manufacturer's name, product name and/or catalog number, and general product category (e.g. "alkyd enamel").
 - 2. MPI product number (e.g. MPI #47).
 - 3. Cross-reference to specified paint system(s) product is to be used in; include description of each system.
- C. Samples: Submit three paper "draw down" samples, 8-1/2 by 11 inches (216 by 279 mm) in size, illustrating range of colors available for each finishing product specified.
 - 1. Where sheen is specified, submit samples in only that sheen.
 - 2. Where sheen is not specified, discuss sheen options with Architect before preparing samples, to eliminate sheens not required.

1.06 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified, with minimum three years documented experience.
- B. Applicator Qualifications: Company specializing in performing the type of work specified with minimum three years documented experience.

1.07 DELIVERY, STORAGE, AND HANDLING

- A. Deliver products to site in sealed and labeled containers; inspect to verify acceptability.
- B. Container Label: Include manufacturer's name, type of paint, brand name, lot number, brand code, coverage, surface preparation, drying time, cleanup requirements, color designation, and instructions for mixing and reducing.
- C. Paint Materials: Store at minimum ambient temperature of 45 degrees F (7 degrees C) and a maximum of 90 degrees F (32 degrees C), in ventilated area, and as required by manufacturer's instructions.

1.08 FIELD CONDITIONS

- A. Do not apply materials when surface and ambient temperatures are outside the paint product manufacturer's temperature ranges.
- B. Follow manufacturer's recommended procedures for producing best results, including testing of substrates, moisture in substrates, and humidity and temperature limitations.
- C. Do not apply exterior paint and finishes during rain or snow, or when relative humidity is outside the humidity ranges required by the paint product manufacturer.
- D. Minimum Application Temperatures for Latex Paints: 50 degrees F (10 degrees C) for exterior; unless required otherwise by manufacturer's instructions.
- E. Provide lighting level of 80 ft candles (860 lx) measured mid-height at substrate surface.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Provide paints and finishes from the same manufacturer to the greatest extent possible.
- B. Paints:
 - 1. Base Manufacturer: Sherwin-Williams Company.
 - 2. Behr Process Corporation: www.behr.com/#sle.
 - 3. PPG Paints: www.ppgpaints.com/#sle.
- C. Primer Sealers: Same manufacturer as top coats.
- D. Substitutions: See Section 01 6000 - Product Requirements.

2.02 PAINTS AND FINISHES - GENERAL

- A. Paints and Finishes: Ready-mixed, unless required to be a field-catalyzed paint.
 - 1. Provide paints and finishes of a soft paste consistency, capable of being readily and uniformly dispersed to a homogeneous coating, with good flow and brushing properties, and capable of drying or curing free of streaks or sags.
 - 2. Supply each paint material in quantity required to complete entire project's work from a single production run.
 - 3. Do not reduce, thin, or dilute paint or finishes or add materials unless such procedure is described explicitly in manufacturer's product instructions.
- B. Colors: To be selected from manufacturer's full range of available colors.
 - 1. Selection to be made by Architect after award of contract.

2.03 PAINT SYSTEMS - EXTERIOR

- A. Concrete: Cementitious Siding
 - 1. Latex Systems:
 - a. Flat Finish:

- 1) 1st Coat: S-W Loxon Concrete and Masonry Primer Sealer, LX02W50 (5.3-8.0 mils wet, 2.1-3.2 mils dry).
 - 2) 2nd Coat: S-W A-100 Exterior Latex Flat, A6 Series.
 - 3) 3rd Coat: S-W A-100 Exterior Latex Flat, A6 Series (4.0 mils wet, 1.2 mils dry per coat).
- B. Metal: Aluminum, Galvanized.
1. Latex Systems:
 - a. Semi-Gloss Finish:
 - 1) 1st Coat: S-W Pro Industrial Acrylic Semi-Gloss, B66-650 Series.
 - 2) 2nd Coat: S-W Pro Industrial Acrylic Semi-Gloss, B66-650 Series (2.0-4.0 mils dry per coat).
- C. Metal: Structural Iron and Steel, Ferrous Metal, Hollow metal doors and Frames (including interior hollow metal doors and frames exposed to moisture).
1. Alkyd Systems; Waterbased:
 - a. Semi-Gloss Finish:
 - 1) 1st Coat: S-W Pro Industrial Pro-Cryl Universal Primer, B66-1310 Series (5.0 mils wet, 2.0 mils dry).
 - 2) 2nd Coat: S-W Pro Industrial Waterbased Alkyd Urethane Enamel Semi-Gloss, B53-1150 Series.
 - 3) 3rd Coat: S-W Pro Industrial Waterbased Alkyd Urethane Enamel Semi-Gloss, B53-1150 Series (4.0-5.0 mils wet, 1.4 - 1.7 mils dry per coat).

2.04 ACCESSORY MATERIALS

- A. Accessory Materials: Provide primers, sealers, cleaning agents, cleaning cloths, sanding materials, and clean-up materials as required for final completion of painted surfaces.
- B. Patching Material: Latex filler.
- C. Fastener Head Cover Material: Latex filler.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Do not begin application of paints and finishes until substrates have been properly prepared.
- B. Verify that surfaces are ready to receive work as instructed by the product manufacturer.
- C. Examine surfaces scheduled to be finished prior to commencement of work. Report any condition that may potentially affect proper application.
- D. If substrate preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.
- E. Test shop-applied primer for compatibility with subsequent cover materials.

3.02 PREPARATION

- A. Clean surfaces thoroughly and correct defects prior to application.
- B. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.
- C. Remove or mask surface appurtenances, including electrical plates, hardware, light fixture trim, escutcheons, and fittings, prior to preparing surfaces for finishing.
- D. Seal surfaces that might cause bleed through or staining of topcoat.
- E. Remove mildew from impervious surfaces by scrubbing with solution of tetra-sodium phosphate and bleach. Rinse with clean water and allow surface to dry.
- F. Fiber Cement Siding: Remove dirt, dust and other foreign matter with a stiff fiber brush. Do not coat surfaces if moisture content or alkalinity of surfaces to be coated exceeds that permitted in manufacturer's written instructions.
- G. Galvanized Surfaces:
 1. Remove surface contamination and oils and wash with solvent according to SSPC-SP 1.

- H. Ferrous Metal:
 - 1. Solvent clean according to SSPC-SP 1.
 - 2. Remove rust, loose mill scale, and other foreign substances using methods recommended in writing by paint manufacturer and blast cleaning according to SSPC-SP 6 Commercial Blast Cleaning. Protect from corrosion until coated.
- I. Metal Doors to be Painted: Prime metal door top and bottom edge surfaces.

3.03 APPLICATION

- A. Apply products in accordance with manufacturer's written instructions and recommendations in "MPI Architectural Painting Specification Manual".
- B. Do not apply finishes to surfaces that are not dry. Allow applied coats to dry before next coat is applied.
- C. Apply each coat to uniform appearance.
- D. Vacuum clean surfaces of loose particles. Use tack cloth to remove dust and particles just prior to applying next coat.
- E. Reinstall electrical cover plates, hardware, light fixture trim, escutcheons, and fittings removed prior to finishing.

3.04 CLEANING

- A. Collect waste material that could constitute a fire hazard, place in closed metal containers, and remove daily from site.

3.05 PROTECTION

- A. Protect finishes until completion of project.
- B. Touch-up damaged finishes after Substantial Completion.

END OF SECTION

**SECTION 09 9123
INTERIOR PAINTING**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Surface preparation.
- B. Field application of paints.
- C. Scope: Finish interior surfaces exposed to view, unless fully factory-finished and unless otherwise indicated.
 - 1. Both sides and edges of plywood backboards for electrical and telecom equipment before installing equipment.
 - 2. Prime surfaces to receive owner provided graphics.
- D. Do Not Paint or Finish the Following Items:
 - 1. Items factory-finished unless otherwise indicated; materials and products having factory-applied primers are not considered factory finished.
 - 2. Items indicated to receive other finishes.
 - 3. Items indicated to remain unfinished.
 - 4. Fire rating labels, equipment serial number and capacity labels, bar code labels, and operating parts of equipment.
 - 5. Floors, unless specifically indicated.
 - 6. Glass.
 - 7. Concealed pipes, ducts, and conduits.

1.02 RELATED REQUIREMENTS

- A. Section 05 5000 - Metal Fabrications: Shop-primed items.
- B. Section 09 9113 - Exterior Painting: Interior hollow metal doors and frames exposed to moisture.

1.03 REFERENCE STANDARDS

- A. ASTM D4442 - Standard Test Methods for Direct Moisture Content Measurement of Wood and Wood-Based Materials; 2020.
- B. MPI (APSM) - Master Painters Institute Architectural Painting Specification Manual; Current Edition.
- C. SSPC-SP 1 - Solvent Cleaning; 2015, with Editorial Revision (2016).
- D. SSPC-SP 6 - Commercial Blast Cleaning; 2007.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide complete list of products to be used, with the following information for each:
 - 1. Manufacturer's name, product name and/or catalog number, and general product category (e.g., "alkyd enamel").
 - 2. MPI product number (e.g., MPI #47).
 - 3. Cross-reference to specified paint system products to be used in project; include description of each system.
- C. Samples: Submit three paper "draw down" samples, 8-1/2 by 11 inches (216 by 279 mm) in size, illustrating range of colors available for each finishing product specified.
 - 1. Where sheen is specified, submit samples in only that sheen.
- D. Maintenance Materials: Furnish the following for Owner's use in maintenance of project.
 - 1. See Section 01 6000 - Product Requirements, for additional provisions.
 - 2. Extra Paint and Finish Materials: 1 gal (4 L) of each color; from the same product run, store where directed.
 - 3. Label each container with color in addition to the manufacturer's label.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified, with minimum three years documented experience.
- B. Applicator Qualifications: Company specializing in performing the type of work specified with minimum three years experience and approved by manufacturer.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Deliver products to site in sealed and labeled containers; inspect to verify acceptability.
- B. Container Label: Include manufacturer's name, type of paint, brand name, lot number, brand code, coverage, surface preparation, drying time, cleanup requirements, color designation, and instructions for mixing and reducing.
- C. Paint Materials: Store at minimum ambient temperature of 45 degrees F (7 degrees C) and a maximum of 90 degrees F (32 degrees C), in ventilated area, and as required by manufacturer's instructions.

1.07 FIELD CONDITIONS

- A. Do not apply materials when surface and ambient temperatures are outside the temperature ranges required by the paint product manufacturer.
- B. Follow manufacturer's recommended procedures for producing best results, including testing of substrates, moisture in substrates, and humidity and temperature limitations.
- C. Do not apply materials when relative humidity exceeds 85 percent, at temperatures less than 5 degrees F (3 degrees C) above the dew point, or to damp or wet surfaces.
- D. Minimum Application Temperatures for Paints: 50 degrees F (10 degrees C) for interiors unless required otherwise by manufacturer's instructions.
- E. Provide lighting level of 80 fc (860 lux) measured mid-height at substrate surface.

PART 2 PRODUCTS

2.01 PAINTS AND FINISHES - GENERAL

- A. Paints and Finishes: Ready-mixed, unless intended to be a field-catalyzed paint.
 - 1. Provide paints and finishes of a soft paste consistency, capable of being readily and uniformly dispersed to a homogeneous coating, with good flow and brushing properties, and capable of drying or curing free of streaks or sags.
 - 2. Supply each paint material in quantity required to complete entire project's work from a single production run.
 - 3. Do not reduce, thin, or dilute paint or finishes or add materials unless such procedure is specifically described in manufacturer's product instructions.
- B. Flammability: Comply with applicable code for surface burning characteristics.
- C. Sheens: Provide the sheens specified; where sheen is not specified, sheen will be selected later by Architect from the manufacturer's full line.
- D. Colors: As indicated on drawings.
 - 1. In finished areas, finish pipes, ducts, conduit, and equipment the same color as the wall/ceiling under which they are mounted.

2.02 PAINT SYSTEMS - INTERIOR

- A. Drywall; Walls, ceilings and gypsum board
 - 1. Latex Systems:
 - 2. Eg-Shel/Satin Finish:
 - a. 1st coat: S-W ProMar 200 Zero VOC Interior Latex Primer, B28W600 (4 mils wet, 1.5 mils dry).
 - b. 2nd coat: S-W ProMar 200 Zero VOC Latex Eg-Shel, B20-2600 Series.
 - c. 3rd coat: S-W ProMar 200 Zero VOC Latex Eg-Shel, B20-2600 Series (4 mils wet, 1.7 mils dry per coat)
 - 3. Manufacturer: Sherwin Williams

- a. Substitutions: See Section 01 6000 - Product Requirements
- B. Epoxy Systems: Waterbased, Wet Areas
 - a. Eg-Shel/Low Luster Finish
 - 1) 1st Coat: S-W ProMar 200 Zero VOC Interior Latex Primer B28W2600 (4 mils wet, 1.5 mils dry.)
 - 2) 2nd Coat: S-W Pro Industrial Waterbased Catalyzed Epoxy, B73-360 Series
 - 3) 3rd Coat: S-W Pro Industrial Waterbased Catalysed Epoxy, B73-360 Series (5.0 mils wet, 2.0 mils dry per coat.)
 - 2. Manufacturer: Sherwin Williams
 - a. Substitutions: See Section 01 6000 - Product Requirements
- C. Ferrous hollow metal doors, framed, miscellaneous metal, low VOC, 3 coats
 - 1. Primer: 1 coat, SW B66-310 series, Pro-Cryl Universal Water Based Primer
 - 2. Finish: 2 coats, SW B66-650, Pro Industrial Acrylic Semi-Gloss
 - 3. Manufacturer: Sherwin Williams
 - a. Substitutions: See Section 01 6000 - Product Requirements
 - 4. For interior hollow metal doors and frames exposed to moisture, see Section 09 9113 Exterior Painting.
- D. Exposed metal deck, ductwork, piping, and structure, 2 coats
 - 1. Two coats Pro Industrial Waterborne Acrylic Dryfall B42 Series
 - 2. Manufacturer: Sherwin Williams
 - a. Substitutions: See Section 01 6000 - Product Requirements
- E. Painted wood, transparent
 - 1. Sher-Wood Water White Conversion Varnish
 - 2. Manufacturer: Sherwin Williams
 - a. Substitutions: See Section 01 6000 - Product Requirements
- F. Level 5 Finish Primer: for used where level 5 finish is specified for digital graphics
 - 1. One coat: Tuff Surface Interior Acrylic Premium Texttrue Finish A44W00050
 - 2. Finish: See interior paint systems above
 - 3. Manufacturer: Sherwin Williams
 - a. Substitutions: See Section 01 6000 - Product Requirements.
 - 4. ACCESSORY MATERIALS
 - a. Accessory Materials: Provide primers, sealers, cleaning agents, cleaning cloths, sanding materials, and clean-up materials as required for final completion of painted surfaces.
 - b. Patching Material: Latex filler.
 - c. Fastener Head Cover Material: Latex filler.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that surfaces are ready to receive work as instructed by the product manufacturer.
- B. Examine surfaces scheduled to be finished prior to commencement of work. Report any condition that may potentially affect proper application.
- C. Test shop-applied primer for compatibility with subsequent cover materials.
- D. Measure moisture content of surfaces using an electronic moisture meter. Do not apply finishes unless moisture content of surfaces is below the following maximums:
 - 1. Gypsum Wallboard: 12 percent.
 - 2. Plaster and Stucco: 12 percent.
 - 3. Masonry, Concrete, and Concrete Masonry Units: 12 percent.
 - 4. Interior Wood: 15 percent, measured in accordance with ASTM D4442.

3.02 PREPARATION

- A. Clean surfaces thoroughly and correct defects prior to application.

- B. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.
- C. Remove or mask surface appurtenances, including electrical plates, hardware, light fixture trim, escutcheons, and fittings, prior to preparing surfaces or finishing.
- D. Seal surfaces that might cause bleed through or staining of topcoat.
- E. Remove mildew from impervious surfaces by scrubbing with solution of tetra-sodium phosphate and bleach. Rinse with clean water and allow surface to dry.
- F. Masonry:
 - 1. Remove efflorescence and chalk. Do not coat surfaces if moisture content, alkalinity of surfaces, or if alkalinity of mortar joints exceed that permitted in manufacturer's written instructions. Allow to dry.
 - 2. Prepare surface as recommended by top coat manufacturer.
- G. Gypsum Board: Fill minor defects with filler compound. Spot prime defects after repair.
- H. Plaster: Fill hairline cracks, small holes, and imperfections with latex patching plaster. Make smooth and flush with adjacent surfaces. Wash and neutralize high-alkali surfaces.
- I. Ferrous Metal:
 - 1. Solvent clean according to SSPC-SP 1.
 - 2. Remove rust, loose mill scale, and other foreign substances using methods recommended in writing by paint manufacturer and blast cleaning according to SSPC-SP 6 Commercial Blast Cleaning. Protect from corrosion until coated.
- J. Metal Doors to be Painted: Prime metal door top and bottom edge surfaces.

3.03 APPLICATION

- A. Apply products in accordance with manufacturer's written instructions and recommendations in "MPI Architectural Painting Specification Manual".
- B. Do not apply finishes to surfaces that are not dry. Allow applied coats to dry before next coat is applied.
- C. Apply each coat to uniform appearance in thicknesses specified by manufacturer.
- D. Sand wood and metal surfaces lightly between coats to achieve required finish.
- E. Vacuum clean surfaces of loose particles. Use tack cloth to remove dust and particles just prior to applying next coat.
- F. Reinstall electrical cover plates, hardware, light fixture trim, escutcheons, and fittings removed prior to finishing.

3.04 CLEANING

- A. Collect waste material that could constitute a fire hazard, place in closed metal containers, and remove daily from site.

3.05 PROTECTION

- A. Protect finishes until completion of project.
- B. Touch-up damaged finishes after Substantial Completion.

END OF SECTION

SECTION 10 1419 DIMENSIONAL LETTER SIGNAGE

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Dimensional letter signage.

1.02 REFERENCE STANDARDS

- A. 36 CFR 1191 - Americans with Disabilities Act (ADA) Accessibility Guidelines for Buildings and Facilities; Architectural Barriers Act (ABA) Accessibility Guidelines; current edition.
- B. ADA Standards - 2010 ADA Standards for Accessible Design; 2010.
- C. ICC A117.1 - Accessible and Usable Buildings and Facilities; 2017.

1.03 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Manufacturer's product literature for each type of dimensional letter sign, indicating style, font, colors, locations, and overall dimensions of each sign.
- C. Shop Drawings:
 - 1. Include dimensions, locations, elevations, materials, text and graphic layout, and attachment details.
- D. Samples: Submit one sample of each type of dimensional letter sign of size similar to that required for project, indicating sign style, font, and method of attachment.
- E. Manufacturer's Installation Instructions: Include installation templates and attachment devices.

1.04 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years of documented experience.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Package dimensional letter signs as required to prevent damage before installation.
- B. Store under cover and elevated above grade.

1.06 FIELD CONDITIONS

- A. Do not install tape adhesive when ambient temperature is lower than recommended by manufacturer.
- B. Maintain minimum ambient temperature during and after installation.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Dimensional Letter Signs:
 - 1. Apco Signs, apcosigns.com
 - 2. Substitutions: See Section 01 6000 - Product Requirements.

2.02 REGULATORY REQUIREMENTS

- A. Accessibility Requirements: Comply with ADA Standards and ICC A117.1 and applicable building codes, unless otherwise indicated; in the event of conflicting requirements, comply with the most restrictive requirements.

2.03 DIMENSIONAL LETTERS

- A. Applications: Building identification.
 - 1. Use individual metal letters.
 - 2. Mounting Location: Interior as indicated on drawings.
- B. Metal Letters:
 - 1. Material: Aluminum sheet, fabricated reverse channel.

2. Thickness: 1/8 inch minimum (3 mm).
3. Letter Height: As indicated on drawings.
4. Text and Typeface: As indicated on drawings
 - a. Character Font: Helvetica, Arial, or other sans serif font.
5. Finish: Brushed, satin.
6. Color: As selected.
7. Mounting: blind stud mount. Stand-off
8. Products:
 - a. Substitutions: See Section 01 6000 - Product Requirements.

2.04 ACCESSORIES

- A. Concealed Screws: Noncorroding metal; stainless steel.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that substrate surfaces are ready to receive work.
- B. Notify Architect if conditions are not suitable for installation of signs; do not proceed until conditions are satisfactory.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Install with horizontal edges level.
- C. Locate dimensional letter signs and mount at heights indicated on drawings and in accordance with ADA Standards and ICC A117.1.
- D. Protect from damage until date of Substantial Completion; repair or replace damaged items.

END OF SECTION

SECTION 10 1423 PANEL SIGNAGE

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Panel signage.

1.02 REFERENCE STANDARDS

- A. ADA Standards - 2010 ADA Standards for Accessible Design; 2010.
- B. ICC A117.1 - Accessible and Usable Buildings and Facilities; 2017.

1.03 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Manufacturer's product literature for each type of panel sign, indicating styles, font, foreground and background colors, locations, and overall dimensions of each sign.
- C. Shop Drawings:
 - 1. Include dimensions, locations, elevations, materials, text and graphic layout, attachment details, and schedules.
 - 2. Schedule: Provide information sufficient to completely define each panel sign for fabrication, including room number, room name, other text to be applied, sign and letter sizes, fonts, and colors.
 - a. When room numbers to appear on signs differ from those on drawings, include the drawing room number on schedule.
 - b. When content of signs is indicated to be determined later, request such information from Owner through Architect at least 2 months prior to start of fabrication; upon request, submit preliminary schedule.
 - c. Submit for approval by Owner through Architect prior to fabrication.
- D. Samples: Submit two samples of each type of sign, of size similar to that required for project, indicating sign style, font, and method of attachment.
- E. Selection Samples: Where colors, materials, and finishes are not specified, submit two sets of color selection charts or chips.
- F. Manufacturer's qualification statement.

1.04 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years of documented experience.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Package signs as required to prevent damage before installation.
- B. Package room and door signs in sequential order of installation, labeled by floor or building.
- C. Store tape adhesive at normal room temperature.

1.06 FIELD CONDITIONS

- A. Do not install tape adhesive when ambient temperature is lower than recommended by manufacturer.
- B. Maintain minimum ambient temperature during and after installation.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Panel Signage:
 - 1. Best Sign Systems, Inc: www.bestsigns.com/#sle.
 - 2. FASTSIGNS International, Inc: www.fastsigns.com/#sle.
 - 3. Inpro Corporation: www.inprocorp.com/#sle.

2.02 REGULATORY REQUIREMENTS

- A. Accessibility Requirements: Comply with ADA Standards and ICC A117.1 and applicable building codes, unless otherwise indicated; in the event of conflicting requirements, comply with the most restrictive requirements.

2.03 PANEL SIGNAGE

- A. Panel Signage:
 - 1. Application: Room and door signs.
 - 2. Description: Flat signs with engraved panel media, tactile characters.
 - 3. Sign Size: As indicated on drawings.
 - 4. Total Thickness: 1/8 inch (3 mm).
 - 5. Color and Font, unless otherwise indicated:
 - a. Character Font: Helvetica, Arial, or other sans serif font.
 - b. Character Case: Upper and lower case (title case).
 - c. Background Color: As scheduled.
 - d. Character Color: Contrasting color.
 - 6. Material: Laminated colored plastic engraved through face to expose core as background color.
 - 7. Profile: Flat panel in aluminum frame.
 - a. Frame Finish: Natural (clear) anodized.
 - 8. Tactile Letters: Raised 1/32 inch minimum.
 - 9. Braille: Grade II, ADA-compliant.
 - 10. One-Sided Wall Mounting: Tape adhesive.

2.04 SIGNAGE APPLICATIONS

- A. Room and Door Signs:
 - 1. Office Doors: Identify with room names and numbers to be determined later, not those indicated on drawings; provide "window" section for replaceable occupant name.
 - 2. Conference and Meeting Rooms: Identify with room names and numbers to be determined later, not those indicated on drawings; provide "window" section with sliding "In Use/Vacant" indicator.
 - 3. Service Rooms: Identify with room names and numbers to be determined later, not those indicated on drawings.
 - 4. Rest Rooms: Identify with pictograms, the names "MEN" and "WOMEN", room numbers to be determined later, and braille.
- B. Interior Directional and Informational Panel Signs:
 - 1. Directories: For customer-produced media; provide divider strips.
- C. Emergency Evacuation Map Panel Signs:
 - 1. Allow for one map per elevator lobby.
 - 2. Map content to be provided by Owner.

2.05 ACCESSORIES

- A. Concealed Screws: Noncorroding metal; stainless steel, galvanized steel, chrome plated, or other.
- B. Tape Adhesive: Double-sided tape, permanent adhesive.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that substrate surfaces are ready to receive work.
- B. Notify Architect if conditions are not suitable for installation of signs; do not proceed until conditions are satisfactory.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.

- B. Install with horizontal edges level.
- C. Locate panel signs and mount at heights indicated on drawings and in accordance with ADA Standards and ICC A117.1.
- D. Protect from damage until substantial completion, repair or replace damaged items.

END OF SECTION

This page intentionally left blank

**SECTION 10 2113.17
PHENOLIC TOILET COMPARTMENTS**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Phenolic toilet compartments.
- B. Urinal and vestibule screens.

1.02 REFERENCE STANDARDS

- A. ASTM A666 - Standard Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar; 2023.

1.03 ADMINISTRATIVE REQUIREMENTS

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide data on panel construction, hardware, and accessories.
- C. Shop Drawings: Indicate partition plan, elevation views, dimensions, details of wall supports, door swings.
- D. Samples: Submit two samples of partition panels, 6 by 6 inch (____by____ mm) in size illustrating panel finish, color, and sheen.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Phenolic Toilet Compartments:
 - 1. ASI Accurate Partitions: www.asi-accuratepartitions.com/#sle.
 - 2. Substitutions: Section 01 6000 - Product Requirements.

2.02 PHENOLIC TOILET COMPARTMENTS

- A. Toilet Compartments: Factory fabricated doors, pilasters, and divider panels made of solid phenolic core panels with integral melamine finish, floor-mounted headrail-braced.
- B. Doors:
 - 1. Thickness: 3/4 inch (19 mm).
 - 2. Width: 24 inch (610 mm).
 - 3. Width for Handicapped Use: 36 inch (915 mm), out-swinging.
 - 4. Height: 58 inch (1473 mm).
- C. Panels:
 - 1. Thickness: 1/2 inch (13 mm).
 - 2. Height: 58 inch (1473 mm).
 - 3. Depth: As indicated on drawings.
- D. Pilasters:
 - 1. Thickness: 3/4 inch (19 mm).
 - 2. Width: As required to fit space; minimum 3 inch (76 mm).
- E. Screens: Without doors; to match compartments; mounted to wall with two panel brackets with vertical support/bracing same as compartments.

2.03 ACCESSORIES

- A. Pilaster Shoes: Formed ASTM A666 Type 304 stainless steel with No. 4 finish, 3 inch (76 mm) high, concealing floor fastenings.
- B. Head Rails: Hollow anodized aluminum, 1 inch by 1-1/2 inch (25 mm by 38 mm) size, with anti-grip profile and cast socket wall brackets.
- C. Attachments, Screws, and Bolts: Stainless steel, tamper proof type.
- D. Hardware: Polished stainless steel:

1. Pivot hinges, gravity type, adjustable for door close positioning; two per door.
2. Door Latch: Slide type with exterior emergency access feature.
3. Door strike and keeper with rubber bumper; mounted on pilaster in alignment with door latch.
4. Coat hook with rubber bumper; one per compartment, mounted on door.
5. Provide door pull for outswinging doors.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that field measurements are as indicated.
- B. Verify correct spacing of and between plumbing fixtures.
- C. Verify correct location of built-in framing, anchorage, and bracing.

3.02 INSTALLATION

- A. Install partitions secure, rigid, plumb, and level in accordance with manufacturer's instructions.
- B. Maintain 3/8 inch to 1/2 inch (9 mm to 13 mm) space between wall and panels and between wall and end pilasters.
- C. Attach panel brackets securely to walls using anchor devices.
- D. Attach panels and pilasters to brackets. Locate head rail joints at pilaster center lines.

3.03 TOLERANCES

- A. Maximum Variation From True Position: 1/4 inch (6 mm).
- B. Maximum Variation From Plumb: 1/8 inch (3 mm).

3.04 ADJUSTING

- A. Adjust and align hardware to uniform clearance at vertical edge of doors, not exceeding 3/16 inch (5 mm).
- B. Adjust hinges to position doors in full closed position when unlatched. Return out-swinging doors to closed position.

END OF SECTION

**SECTION 10 2600
WALL AND DOOR PROTECTION**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Corner guards.

1.02 REFERENCE STANDARDS

- A. ASTM D256 - Standard Test Methods for Determining the Izod Pendulum Impact Resistance of Plastics; 2023, with Editorial Revision.
- B. ASTM D543 - Standard Practices for Evaluating the Resistance of Plastics to Chemical Reagents; 2021.
- C. ASTM F476 - Standard Test Methods for Security of Swinging Door Assemblies; 2023.

1.03 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Indicate physical dimensions, features, wall mounting brackets with mounted measurements, anchorage details, and rough-in measurements.
- C. Shop Drawings: Include plans, elevation, sections, and attachment details.
- D. Samples: Submit samples illustrating component design, configurations, joinery, color and finish.
 - 1. Submit two sections of corner guards, 24 inches (610 mm) long.
- E. Maintenance Materials: Furnish the following for Owner's use in maintenance of project:
 - 1. See Section 01 6000 - Product Requirements, for additional provisions.
 - 2. Extra Stock Materials: One package(s) of minimum 96 inches (2438 mm) long unit of each kind of covers for corner guards.

1.04 DELIVERY, STORAGE, AND HANDLING

- A. Deliver wall and door protection items in original, undamaged protective packaging. Label items to designate installation locations.
- B. Protect work from moisture damage.
- C. Protect work from UV light damage.
- D. Do not deliver products to project site until areas for storage and installation are fully enclosed, and interior temperature and humidity are in compliance with manufacturer's recommendations for each type of item.

PART 2 PRODUCTS

2.01 PERFORMANCE CRITERIA

- A. Impact Strength: Unless otherwise noted, provide protection products and assemblies that have been successfully tested for compliance with applicable provisions of ASTM D256 and/or ASTM F476.
- B. Chemical and Stain Resistance: Unless otherwise noted, provide protection products and assemblies with chemical and stain resistance complying with applicable provisions of ASTM D543.

2.02 PRODUCT TYPES

- A. Corner Guards (CDG) - Surface Mounted:
 - 1. Basis of Design: Inpro 160 High Impact Corner Guard
 - 2. Material: High impact vinyl with full height extruded aluminum retainer.
 - 3. Fire Resistance: Where fire rating is specified for the wall in which the guard is mounted, provide assemblies that have been tested in accordance with ASTM E119 for the same rating as the wall.

4. Surface Burning Characteristics: Provide assemblies with flame spread index of 25 or less and smoke developed index of 450 or less, when tested in accordance with ASTM E84.
 5. Width of wings: 2 inches
 6. Height: Corner guard to start above base and continue to height of wall.
 7. Corner: square
 8. Color: As selected from manufacturer
 9. Length: one piece
 10. Preformed end caps
- B. Corner Guards (SSG1) - Surface Mounted
1. Material: Type 304 stainless steel, No. 4 finish, 16 gauge, _____ inch (_____ mm) thick.
 2. Basis of Design: Inpro Stainless Steel Flush Mount Corner Guard

2.03 FABRICATION

- A. Fabricate components with tight joints, corners and seams.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify that rough openings, concealed blocking, and anchors are correctly sized and located.
- B. Verify that field measurements are as indicated on drawings.
- C. Verify that substrate surfaces for adhered items are clean and smooth.
1. Test painted or wall covering surfaces for adhesion in inconspicuous area, as recommended by manufacturer. Follow adhesive manufacturer's recommendations for remedial measures at locations and/or application conditions where adhesion test's results are unsatisfactory.
- D. Start of installation constitutes acceptance of project conditions.

3.02 INSTALLATION

- A. Install components in accordance with manufacturer's instructions, level and plumb, secured rigidly in position to supporting construction.
- B. Position corner guard 4 inches (102 mm) above finished floor to 8'-0" A.F.F..

3.03 TOLERANCES

- A. Maximum Variation From Required Height: 1/4 inch (6 mm).
- B. Maximum Variation From Level or Plane For Visible Length: 1/4 inch (6 mm).

3.04 CLEANING

- A. See Section 01 7419 - Construction Waste Management and Disposal, for additional requirements.
- B. Clean wall and door protection items of excess adhesive, dust, dirt, and other contaminants.

END OF SECTION

**SECTION 10 2800
TOILET, BATH, AND LAUNDRY ACCESSORIES**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Commercial toilet accessories.

1.02 REFERENCE STANDARDS

- A. ASTM A269/A269M - Standard Specification for Seamless and Welded Austenitic Stainless Steel Tubing for General Service; 2022.
- B. ASTM A666 - Standard Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar; 2023.
- C. ASTM C1036 - Standard Specification for Flat Glass; 2021.
- D. ASTM C1503 - Standard Specification for Silvered Flat Glass Mirror; 2018.

1.03 ADMINISTRATIVE REQUIREMENTS

- A. Coordinate the work with the placement of internal wall reinforcement, concealed ceiling supports, and reinforcement of toilet partitions to receive anchor attachments.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Submit data on accessories describing size, finish, details of function, and attachment methods.

PART 2 PRODUCTS

2.01 MATERIALS

- A. Accessories - General: Shop assembled, free of dents and scratches and packaged complete with anchors and fittings, steel anchor plates, adapters, and anchor components for installation.
- B. Keys: Provide 8 keys for each accessory to Owner; master key lockable accessories.
- C. Stainless Steel Sheet: ASTM A666, Type 304.
- D. Stainless Steel Tubing: ASTM A269/A269M, Grade TP304 or TP316.
- E. Mirror Glass: Annealed float glass, ASTM C1036 Type I, Class 1, Quality Q2, with silvering, protective and physical characteristics complying with ASTM C1503.
- F. Fasteners, Screws, and Bolts: Hot dip galvanized; tamper-proof; security type.

2.02 FINISHES

- A. Stainless Steel: Satin finish, unless otherwise noted.

2.03 COMMERCIAL TOILET ACCESSORIES

- A. Toilet Paper Dispenser (Type TA1)
 - 1. Owner provided and installed
- B. Paper Towel Dispenser (Type TA2):
 - 1. Owner provided and installed
- C. Waste Receptacle (Type TA4): Semi-recessed, stainless steel, seamless lower door for access to container, with tumbler lock, reinforced panel full height of door, continuously welded bottom pan and seamless exposed flanges.
 - 1. Products:
 - a. American Specialties, Inc; Waste Receptacle 4" proj., 4" rec. - #0458: www.americanspecialties.com/#sle.
 - b. Substitutions: Section 01 6000 - Product Requirements.
- D. Soap Dispenser (Type TA6): Liquid soap dispenser, wall-mounted, surface, with stainless steel cover and vertical stainless steel tank and working parts; push type soap valve, check valve, and window gauge refill indicator, tumbler lock.

1. Products:
 - a. ASI American Specialties, Inc.; Soap Dispenser - Surface Mounted #0347; www.americanspecialties.com.
 - b. Substitutions: Section 01 6000 - Product Requirements.
- E. Mirrors (Type TA8): Stainless steel framed, 1/4 inch (6 mm) thick annealed float glass; ASTM C1036.
 1. Annealed Float Glass: Silvering, protective and physical characteristics in compliance with ASTM C1503.
 2. Size: as shown in the drawings.
 3. Frame: 0.05 inch (1.3 mm) angle shapes, with mitered and welded and ground corners, and tamperproof hanging system; satin finish.
 4. Products:
 - a. American Specialties, Inc: www.americanspecialties.com/#sle.
 - b. Substitutions: Section 01 6000 - Product Requirements.
- F. Grab Bars: Stainless steel, smooth surface.
 1. Standard Duty Grab Bars:
 - a. Push/Pull Point Load: 250 pound-force (1112 N), minimum.
 - b. Dimensions: 1-1/4 inch (32 mm) outside diameter, minimum 0.05 inch (1.3 mm) wall thickness, exposed flange mounting, 1-1/2 inch (38 mm) clearance between wall and inside of grab bar.
 - c. Finish: Satin.
 - d. Length and Configuration: As indicated on drawings.
 - e. Products:
 - 1) American Specialties, Inc: www.americanspecialties.com/#sle.
 - 2) Substitutions: Section 01 6000 - Product Requirements.
- G. Combination Sanitary Napkin/Tampon Dispenser Type TA19: Stainless steel, recessed.
 1. Cabinet: Fully welded, 0.03 inch (0.8 mm) thick sheet.
 2. Operation: No charge; no coin slots.
 3. Products:
 - a. American Specialties, Inc; Dual (15) Napkin/(23) Tampon Vendor - Recessed - Free Operation; #04684: www.americanspecialties.com/#sle.
 - b. Substitutions: Section 01 6000 - Product Requirements.
- H. Sanitary Napkin Disposal Unit: Stainless steel, surface-mounted, self-closing door, non-locking bottom panel with full-length stainless steel piano-type hinge, removable receptacle.
 1. Products:
 - a. American Specialties, Inc; Sanitary Napkin Disposal - Surface Mounted #0473-A: www.americanspecialties.com/#sle.
 - b. Substitutions: Section 01 6000 - Product Requirements.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify exact location of accessories for installation.
- C. Verify that field measurements are as indicated on drawings.

3.02 PREPARATION

- A. Provide templates and rough-in measurements as required.

3.03 INSTALLATION

- A. Install accessories in accordance with manufacturers' instructions in locations indicated on drawings.
- B. Install plumb and level, securely and rigidly anchored to substrate.
- C. Mounting Heights: As required by accessibility regulations, unless otherwise indicated.

3.04 PROTECTION

- A. Protect installed accessories from damage due to subsequent construction operations.

END OF SECTION

This page intentionally left blank

**SECTION 10 4400
FIRE PROTECTION SPECIALTIES**

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Fire extinguishers.
- B. Fire extinguisher cabinets.
- C. Accessories.

1.02 RELATED REQUIREMENTS

- A. Section 06 1000 - Rough Carpentry: Wood blocking product and execution requirements.

1.03 REFERENCE STANDARDS

- A. FM (AG) - FM Approval Guide; Current Edition.
- B. NFPA 10 - Standard for Portable Fire Extinguishers; 2022.
- C. UL (DIR) - Online Certifications Directory; Current Edition.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Shop Drawings: Indicate locations of cabinets and cabinet physical dimensions.
- C. Manufacturer's Installation Instructions: Indicate special criteria and wall opening coordination requirements.
- D. Manufacturer's Certificate: Certify that products meet or exceed specified requirements.
- E. Maintenance Data: Include test, refill or recharge schedules and re-certification requirements.

1.05 FIELD CONDITIONS

- A. Do not install extinguishers when ambient temperature may cause freezing of extinguisher ingredients.

PART 2 PRODUCTS

2.01 MANUFACTURERS

- A. Fire Extinguishers:
 - 1. Ansul, a Tyco Business: www.ansul.com/#sle.
 - 2. Larsen's Manufacturing Co
 - 3. Substitutions: See Section 01 6000 - Product Requirements.

2.02 FIRE EXTINGUISHERS

- A. Fire Extinguishers - General: Comply with product requirements of NFPA 10 and applicable codes, whichever is more stringent.
 - 1. Provide extinguishers labeled by UL (DIR) or FM (AG) for purpose specified and as indicated.
- B. Multipurpose Dry Chemical Type Fire Extinguishers: Carbon steel tank, with pressure gauge.
 - 1. Class: A:B:C type.
 - 2. UL Rating: 3A-80B:C
- C. Dry Chemical Type Fire Extinguishers: Stainless steel tank, with pressure gauge.
 - 1. Class: K type.
 - 2. UL Rating: 3A-80B:C minimum.
 - 3. Temperature range: Minus 20 degrees F (Minus 29 degrees C) to 120 degrees F (49 degrees C).

2.03 FIRE EXTINGUISHER CABINETS

- A. Cabinet Configuration: Recessed type.
 - 1. Size to accommodate accessories.
 - 2. Trim: Flat square edge, with 2 inch (50.8 mm) wide face.

3. Provide cabinet enclosure with right angle inside corners and seams, and with formed perimeter trim and door stiles.
- B. Door: 0.036 inch (0.9 mm) metal thickness, reinforced for flatness and rigidity with nylon catch. Hinge doors for 180 degree opening with two butt hinges.
- C. Door Glazing: Float glass, clear, 1/8 inch (3 mm) thick, and set in resilient channel glazing gasket.
- D. Fabrication: Weld, fill, and grind components smooth.
- E. Finish of Cabinet Exterior Trim and Door: No.4 - Brushed stainless steel.
- F. Finish of Cabinet Interior: White colored enamel.

2.04 ACCESSORIES

- A. Extinguisher Brackets: Formed steel, chrome-plated.
- B. Cabinet Signage: Lettering complying with authorities having jurisdiction for letter style, size, spacing, and location. Locate as directed by Architect..
 1. Identify fire extinguisher in fire protection cabinet with the words "FIRE EXTINGUISHER."
 - a. Location: Applied to cabinet doors
 - b. Application Process: Decals.
 - c. Lettering Color: Red.
 - d. Orientation: Vertical.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Verify existing conditions before starting work.
- B. Verify rough openings for cabinet are correctly sized and located.

3.02 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Mounting height of the fire extinguisher and fire extinguisher cabinet, regardless of type, shall meet ADA
- C. Secure rigidly in place.
- D. Place extinguishers in cabinets.
- E. Adjust fire extinguisher cabinet doors to operate smoothly. Verify that intergal lock

END OF SECTION

SECTION 12 2400 WINDOW SHADES

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Interior manual roller shades.

1.02 REFERENCE STANDARDS

- A. NFPA 701 - Standard Methods of Fire Tests for Flame Propagation of Textiles and Films; 2023, with Errata.

1.03 ADMINISTRATIVE REQUIREMENTS

- A. Coordination:
- B. Sequencing:
 - 1. Do not fabricate shades until field dimensions for each opening have been taken with field conditions in place.
 - 2. Do not install shades until final surface finishes and painting are complete.

1.04 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements, for submittal procedures.
- B. Product Data: Provide manufacturer's standard catalog pages and data sheets, including materials, finishes, fabrication details, dimensions, profiles, mounting requirements, and accessories.
- C. Shop Drawings: Include shade schedule indicating size, location and keys to details, head, jamb and sill details, mounting dimension requirements for each product and condition, and operation direction.
- D. Verification Samples: Minimum size 6 inches (150 mm) square, representing actual materials, color and pattern.

1.05 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section, with not less than five years of documented experience.
- B. Installer Qualifications: Company specializing in performing work of this type with minimum five years of documented experience with shading systems of similar size and type.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Deliver shades in manufacturer's unopened packaging, labeled to identify each shade for each opening.
- B. Handle and store shades in accordance with manufacturer's recommendations.

1.07 FIELD CONDITIONS

- A. Do not install products under environmental conditions outside manufacturer's absolute limits.

PART 2 PRODUCTS

2.01 ROLLER SHADES

- A. General:
 - 1. Provide shade system components that are easy to remove or adjust without removal of mounted shade brackets.
 - 2. Provide shade system that operates smoothly when shades are raised or lowered.
- B. Roller Shades Type RS1:
 - 1. Basis of Design: Clutch-Operated Flex Shade NEXD as manufactured by Draper, Inc..
 - 2. Description - Interior Roller Shades: Single roller, manually operated fabric window shade system complete with mounting brackets, roller tubes, hembars, hardware, and accessories.
 - a. Drop Position: Regular roll.

- b. Roll Direction: Roll down, closed position is at window sill.
 - c. Mounting: Window jamb mounted - inside, between jambs.
 - d. Size: full window height including spandrel; refer to plan for window width.
 - e. Fabric: As indicated under Shade Fabric article.
 - f. Location: refer to floor finish plan
- 3. Brackets and Mounting Hardware: As recommended by manufacturer for mounting indicated and to accommodate shade fabric roll-up size and weight.
- 4. Roller Tubes: As required for type of shade operation.
- 5. Hembars: Designed to maintain bottom of shade straight and flat.
- 6. Manual Operation for Interior Shades:
 - a. Clutch Operator: Manufacturer's standard material and design, permanently lubricated.
 - b. Drive Chain: Continuous loop beaded ball chain, 95 lb (43 kg) minimum breaking strength. Provide upper and lower limit stops.

2.02 SHADE FABRIC

- A. Fabric: Nonflammable, color-fast, impervious to heat and moisture, and able to retain its shape under normal operation.
 - 1. Manufacturers:
 - a. Phifer, Inc; Sheerweave Style SW2500: www.phifer.com/#sle.
 - b. Substitutions: See Section 01 6000 - Product Requirements.
 - 2. Material: Vinyl coated polyester.
 - 3. Performance Requirements:
 - a. Flammability: Pass NFPA 701 large and small tests.
 - 4. Openness Factor: 1%.
 - 5. Color: to be selected from manufacturer's full line.

2.03 ROLLER SHADE FABRICATION

- A. Field measure finished openings prior to ordering or fabrication.
- B. Dimensional Tolerances: Fabricate shades to fit openings within specified tolerances.
 - 1. Vertical Dimensions: Fill openings from head to sill with 1/2 inch (13 mm) space between bottom bar and window stool including spandrel glass.
 - 2. Horizontal Dimensions - Inside Mounting: Fill openings from jamb to jamb.
- C. Dimensional Tolerances: As recommended in writing by manufacturer.
- D. At openings requiring continuous multiple shade units with separate rollers, locate roller joints at window mullion centers; butt rollers end-to-end.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Examine finished openings for deficiencies that may preclude satisfactory installation.
- B. If substrate preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.
- C. Start of installation shall be considered acceptance of substrates.

3.02 PREPARATION

- A. Prepare surfaces using methods recommended by manufacturer for achieving best result for substrate under the project conditions.
- B. Coordinate with window installation and placement of concealed blocking to support shades.

3.03 INSTALLATION

- A. Install in accordance with manufacturer's instructions and approved shop drawings, using mounting devices as indicated.
- B. Adjust level, projection, and shade centering from mounting bracket. Verify there is no telescoping of shade fabric. Ensure smooth shade operation.

3.04 CLEANING

- A. Clean soiled shades and exposed components as recommended by manufacturer.
- B. Replace shades that cannot be cleaned to "like new" condition.

END OF SECTION

This page intentionally left blank

SECTION 12 3600 COUNTERTOPS

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Countertops for architectural cabinet work.
- B. Sinks molded into countertops.
- C. Window Sills

1.02 REFERENCE STANDARDS

- A. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2023a.
- B. AWI (QCP) - Quality Certification Program; Current Edition.
- C. AWI/AWMAC/WI (AWS) - Architectural Woodwork Standards, 2nd Edition; 2014, with Errata (2016).
- D. AWMAC/WI (NAAWS) - North American Architectural Woodwork Standards; 2021, with Errata.
- E. IAPMO Z124 - Plastic Plumbing Fixtures; 2022, with Editorial Revision.
- F. ISFA 2-01 - Classification and Standards for Solid Surfacing Material; 2013.
- G. ISFA 3-01 - Classification and Standards for Quartz Surfacing Material; 2013.
- H. NEMA LD 3 - High-Pressure Decorative Laminates; 2005.
- I. NSI (DSDM) - Dimensional Stone Design Manual, Version VIII; 2016.
- J. PS 1 - Structural Plywood; 2019.

1.03 SUBMITTALS

- A. See Section 01 3000 - Administrative Requirements for submittal procedures.
- B. Product Data: Manufacturer's data sheets on each product to be used, including:
 - 1. Preparation instructions and recommendations.
 - 2. Storage and handling requirements and recommendations.
 - 3. Specimen warranty.
- C. Shop Drawings: Complete details of materials and installation, to include countertop supports and the suggested spacing; combine with shop drawings of cabinets and casework specified in other sections.
- D. Verification Samples: For each finish product specified, minimum size 6 inches (150 mm) square, representing actual product, color, and patterns.
- E. Test Reports: Chemical resistance testing, showing compliance with specified requirements.

1.04 QUALITY ASSURANCE

- A. Fabricator Qualifications: Natural Stone Institute (NSI) Accredited Natural Stone Fabricator; www.naturalstoneinstitute.org/#sle.
- B. Installer Qualifications: Company specializing in performing work of the type specified in this section, with not less than three years of documented experience.
- C. Quality Certification:
 - 1. Comply with AWI (QCP) woodwork association quality certification service/program in accordance with requirements for work specified in this section: www.awiqcp.org/#sle.

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Store products in manufacturer's unopened packaging until ready for installation.
- B. Store and dispose of solvent-based materials, and materials used with solvent-based materials, in accordance with requirements of local authorities having jurisdiction.

1.06 FIELD CONDITIONS

- A. Maintain environmental conditions (temperature, humidity, and ventilation) within limits recommended by manufacturer for optimum results. Do not install products under environmental conditions outside manufacturer's absolute limits.

PART 2 PRODUCTS

2.01 COUNTERTOPS

- A. Quality Standard: Custom Grade, in accordance with AWI/AWMAC/WI (AWS) or AWMAC/WI (NAAWS), unless noted otherwise.
- B. Solid Surfacing Countertops: Solid surfacing sheet or plastic resin casting over continuous substrate.
 - 1. Flat Sheet Thickness: 1/2 inch (12 mm), minimum.
 - 2. Solid Surfacing Sheet and Plastic Resin Castings: Complying with ISFA 2-01 and NEMA LD 3; acrylic resin, mineral filler, and pigments; homogenous, non-porous and capable of being worked and repaired using standard woodworking tools; no surface coating; color and pattern consistent throughout thickness.
 - a. Manufacturers:
 - 1) Dupont: www.corian.com/#sle.
 - 2) Substitutions: See Section 01 6000 - Product Requirements.
 - b. Surface Burning Characteristics: Flame spread index of 25, maximum; smoke developed index of 450, maximum; when tested in accordance with ASTM E84.
 - c. Sinks and Bowls: Integral castings; minimum 3/4 inch (19 mm) wall thickness; comply with IAPMO Z124.
 - 1) Basis of Design: Corian 810P Lavatory, color to match countertop.
 - d. Finish on Exposed Surfaces: Matte, gloss rating of 5 to 20.
 - 3. Other Components Thickness: 1/2 inch (12 mm), minimum.
 - 4. Back and End Splashes: Same sheet material, square top; minimum 4 inches (102 mm) high.
 - 5. Fabricate in accordance with AWI/AWMAC/WI (AWS) or AWMAC/WI (NAAWS), Section 11 - Countertops, Premium Grade.
- C. Natural Quartz and Resin Composite Countertops: Sheet or slab of natural quartz and plastic resin over continuous substrate.
 - 1. Flat Sheet Thickness: 1-1/4 inch (32 mm), minimum.
 - 2. Natural Quartz and Resin Composite Sheets, Slabs and Castings: Complying with ISFA 3-01 and NEMA LD 3; orthophthalic polyester resin, mineral filler, and pigments; homogenous, non-porous and capable of being worked and repaired using standard stone fabrication tools; no surface coating; color and pattern consistent throughout thickness.
 - a. Manufacturers:
 - 1) Wilsonart: www.wilsonart.com/#sle.
 - 2) Substitutions: See Section 01 6000 - Product Requirements.
 - b. Factory fabricate components to the greatest extent practical in sizes and shapes indicated; comply with NSI (DSDM).
 - c. Finish on Exposed Surfaces: Polished.
 - 3. Other Components Thickness: 3/4 inch (19 mm), minimum.
 - 4. Back and End Splashes: Same sheet material, square top; minimum 4 inches (102 mm) high.

2.02 WINDOW SILLS

- A. Solid Surface Sills: solid surfacing sheet or plastic resin casting over continuous substrate.
 - 1. Flat Sheet Thickness: 1/4 inch, minimum
 - 2. Material to extend full width of window sill
 - 3. Profile: refer to drawings
 - 4. Solid Surfacing Sheet and Plastic Resin Castings: Complying with ISFA 2-01 and NEMA LD 3, acrylic resin, mineral filler, and pigments; homogeneous, non-porous and capable of

being worked and repaired using standard woodworking tools; no surface coating, color and pattern consistent throughout thickness.

5. Manufacturers:
 - a. Dupont: www.corian.com
 - b. Substitutions: See Section 01 6000 - Product Requirements
6. Surface Burning Characteristics: Flame spread index of 25, maximum; smoke developed index of 450, maximum, when tested in accordance with ASTM E84

2.03 MATERIALS

- A. Wood-Based Components:
 1. Wood fabricated from old growth timber is not permitted.
- B. Plywood for Supporting Substrate: PS 1 Exterior Grade, A-C veneer grade, minimum 5-ply; minimum 3/4 inch (19 mm) thick; join lengths using metal splines.
- C. Adhesives: Chemical resistant waterproof adhesive as recommended by manufacturer of materials being joined.
- D. Joint Sealant: Mildew-resistant silicone sealant, white.

2.04 ACCESSORIES

- A. Concealed Support Brackets:
 1. Material: Steel or heavy-duty aluminum.
 2. Color: As selected by Architect from manufacturer's standard line.
 3. Size: To be selected by contractor based on countertop depth.
 4. Spacing: To be determined by contractor in coordination with the product manufacturer. Contractor is to consider the various countertop depths as well as any owner-furnished equipment to be installed on the countertop.
 5. Products:
 - a. Centerline Brackets; Front Mounting Countertop Support and Front Mounting Plus Countertop Support: www.countertopbracket.com/#sle.
 - b. Rangine Corporation; EH Countertop Support Bracket and Pole-Supported Counter Bracket: www.rakks.com/sle..
 - c. Substitutions: See Section 01 6000 - Product Requirements.

2.05 FABRICATION

- A. Fabricate sills, tops and splashes in the largest sections practicable, with top surface of joints flush.
 1. Join lengths of tops using best method recommended by manufacturer.
 2. Fabricate to overhang fronts and ends of cabinets 1 inch (25 mm) except where top butts against cabinet or wall.
 3. Prepare all cutouts accurately to size; replace tops having improperly dimensioned or unnecessary cutouts or fixture holes.
- B. Provide back/end splash wherever counter edge abuts vertical surface unless otherwise indicated.
 1. Secure to countertop with concealed fasteners and with contact surfaces set in waterproof glue.
 2. Height: 4 inches (102 mm), unless otherwise indicated.

PART 3 EXECUTION

3.01 EXAMINATION

- A. Do not begin installation until substrates have been properly prepared.
- B. If substrate preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.
- C. Verify that wall surfaces have been finished and mechanical and electrical services and outlets are installed in proper locations.

3.02 PREPARATION

- A. Clean surfaces thoroughly prior to installation.
- B. Prepare surfaces using the methods recommended by the manufacturer for achieving the best result for the substrate under the project conditions.

3.03 INSTALLATION

- A. Install vanities and sills in accordance with manufacturer's instructions and approved shop drawings
- B. Securely attach sills to windows and countertops to cabinets using concealed fasteners. Make flat surfaces level; shim where required.
- C. Seal joint between window and sill, back/end splashes and vertical surfaces.

3.04 TOLERANCES

- A. Variation From Horizontal: 1/8 inch in 10 feet (3 mm in 3 m), maximum.
- B. Offset From Wall, Countertops: 1/8 inch (3 mm) maximum; 1/16 inch (1.5 mm) minimum.
- C. Field Joints: 1/8 inch (3 mm) wide, maximum.

END OF SECTION

SECTION 21 1310 - FIRE SPRINKLER SYSTEMS, WET PIPE TYPES

PART 1 - GENERAL

1.1 SUMMARY

- A. This specification section includes the requirements for the qualifications, submittals, products, installation, and testing of the new fire sprinkler systems to be provided throughout the project in Goodwell, OK.
- B. Contractor must provide a complete, compliant, and functional fire sprinkler systems.
- C. The scope of this specification includes all fire sprinkler system components, wiring, devices, and accessories. This includes the underground piping up to 5 feet outside the building. The fire sprinkler contractor may exclude all underground scope but the Technician specified herein must still approve the submittals and installation of the entry piece up to 5 feet outside the building.

1.2 DEFINITIONS

- A. Contractor: The company, appropriately licensed by the Oklahoma Department of Consumer and Business Services, which is contracted to perform the fire sprinkler system scope of work for this project.
- B. Technician: The individual, appropriately licensed by the Oklahoma Department of Consumer and Business Services and who has obtained NICET III or IV Certification in Water-Based Systems Layout, who is an employee of the Contractor.
- C. Engineer: The Oklahoma-licensed engineering firm which developed the fire sprinkler specifications and drawings for this project, Rated Engineering PLLC.
- D. Fire Department: The lead fire department which is expected to respond in the event of a fire emergency. The fire department for this project is considered to be:
 - 1. The City of Goodwell Fire Department
 - 2. Oklahoma State University Fire Marshal
- E. AHJ: The Authority Having Jurisdiction ("AHJ") as defined by NFPA. The AHJ for this project are:
 - 1. The City of Goodwell Fire Marshal's Office

1.3 APPLICABLE CODES AND STANDARDS

- A. Oklahoma International Building code, 2018 edition, as adopted and amended by the State of Oklahoma.
- B. NFPA 13 Standard for the Installation of Sprinkler Systems, 2016 edition
- C. NFPA 24 Standard for the Installation of Private Fire Service Mains and Their Appurtenances, 2016 edition

1.4 QUALIFICATIONS

- A. The Contractor must have been in full compliance with all applicable Oklahoma Department of Consumer and Business Services contractor licensing regulations for at least the continuous five-year period preceding submission of bid on this project.
- B. The foremen shall have a minimum of three years of experience.
- C. The Contractor and Technician must not have been fined by the Oklahoma Department of Consumer and Business Services within the three years preceding submission of bid on this project.
- D. The Technician must have obtained NICET III or IV Certification in Water-Based Systems Layout and must maintain this degree of certification throughout the course of the project.

1.5 QUALITY CONTROL

- A. General

1. The contractor must comply with all supervision and quality control requirements prescribed by the Oklahoma Department of Consumer and Business Services of Insurance and as additionally specified herein and on the plans.
- B. Design and Submittals
 1. The Technician must review and approve each submittal prior to its submittal.
- C. Construction and Testing
 1. The Contractor must ensure compliance with the Oklahoma Department of Consumer and Business Services rules regarding the experience, qualifications, testing, licensing, and supervision of staff performing the fire sprinkler system installation. Any representative of the Owner may request confirmation of compliance with these rules at any time.
 2. The aboveground piping must not be connected to the underground piping until the Contractor has received a certificate documenting NFPA 24-compliant hydrostatic testing and flushing. If the aboveground piping is filled by underground piping which has not been flushed in accordance with NFPA 24, the Contractor must inspect, flush, clean, and/or replace system components as necessary to ensure debris will not impair system operation.
- D. AHJ and Fire Department Site Visit
 1. The contractor must invite the AHJ and Fire Department to perform an interim observation of the fire sprinkler system installation prior to concealing piping.
- E. Contractor Testing
 1. Prior to requesting the AHJ and Fire Department Testing, the Contractor must inspect and test their system for compliance with the contract and code requirements.
- F. AHJ and Fire Department Testing
 1. Upon successful completion of the Contractor Testing, the contractor must invite the AHJ and Fire Department to witness any tests requested or required by the AHJ and Fire Department.

1.6 SUBMITTALS

- A. Format of submittals:
 1. All submittals must be submitted electronically.
 2. All submitted files must be in .PDF file format.
 3. All submittals must generated electronically; files which are scans or photocopies of physical documents are prohibited.
 4. Files must be logically separated and electronically bookmarked.
 5. If required by reviewing government agencies or their delegates, the contractor must also provide hard copy submittals at no additional cost to the owner.
- B. Sequence of submittals:
 1. Submittals must be submitted to the Engineer. Upon approval by the Engineer, submittals must then be routed to the Architect and Owner.
 2. Upon approval of submittals by the Engineering, Architect, and Owner, submittals must be sent to:
 - a. The Oklahoma State University Fire Marshal
 3. The contractor must confirm the reviewing agencies and their addresses prior to submittal.
 4. Shop drawings, product data, and calculations must be submitted simultaneously.
 5. Contractor must field-verify existing conditions prior to developing shop drawings.
- C. Shop Drawings:

1. Comply with NFPA 13 Paragraph 23.1 Working Plans.
 2. Indicate results of hydrant flow test on the shop drawings.
 3. Shop drawings must indicate approval by the Technician.
 - D. Product Data:
 1. Include manufacturer's data sheet for each product intended to be used in the fire sprinkler system.
 2. Annotate each data sheet to indicate the selected model, finishes, features, and values.
 3. Product data must indicate approval by the Technician.
 - E. Firestop
 1. Include listed assembly for each type of penetration through fire rated construction.
 2. Include product data for each firestop assembly component, including but not limited to the sealant and backer material.
 - F. Calculations:
 1. Hydraulic calculations must be submitted to justify all pipe sizing and sprinkler spacing. Calculation format shall comply with NFPA 13 paragraph 23.3.5 Computer-Generated Hydraulic Reports. Refer to design paragraph below for additional description.
 2. Calculations must indicate approval by the Technician.
 - G. Contractor Testing Report:
 1. Within five business days of successful completion of acceptance testing, submit a test report to the Engineer.
 - H. AHJ and Fire Department Acceptance Testing:
 1. The Contractor must be prepared to perform any testing requested by the AHJ and Fire Department.
 2. The Contractor must notify the Architect and Owner of the date of the AHJ and Fire Department acceptance testing.
 - I. Completion Documentation
 1. Within ten business days of successful completion of the AHJ and Fire Department Acceptance Testing:
 - a. Submit as-built shop drawings reflecting all field changes.
 - b. Provide all literature, instructions, and copy of NFPA 25 as required by NFPA 13 Paragraph 25.4.
 2. A physical copy of all closeout documentation must be provided in the documentation cabinet.
- 1.7 HYDRANT FLOW TEST**
- A. Contractor must perform a hydrant flow test in accordance with NFPA 291 on the existing water utility as close as feasible to the point of connection.
 - B. The hydrant flow test must be performed within 12 months of submittal of the hydraulic calculations.
 - C. Coordinate hydrant flow test permissions, data, and reporting with the water purveyor (City of Goodwell).
 - D. Basis of Design Test Data is as follows:
 1. 59 psi static pressure
 2. 45 psi residual pressure flowing 748 gpm
- 1.8 DESIGN**
- A. Refer to plans for indication of fire sprinkler system design criteria.

1.9 SEISMIC PERFORMANCE

- A. Protection from earthquake damage is not required.
- B. Seismic Design category is B. Seismic bracing and restraints are not required in accordance with NFPA 13 chapter nine.

1.10 SPARE PARTS

- A. After successful acceptance testing, leave spare parts with owner's representative which match the products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 - 1. Spare sprinklers and wrenches in accordance with NFPA 13.

1.11 WARRANTY

- A. Contractor shall provide a warranty for all system failures as a result of manufacturing, installation, or workmanship. The warranty period shall be one year from the date of completion (established by the Architect). Include the warranty statement in the O&M manual.
- B. Warranty claims which are necessary for proper system operation shall be responded to, and their repair scheduled, within 24 hours of warranty claim (the actual time allowed for the repair work shall be negotiated with the building owner at the time of warranty claim).
- C. Warranty claims which are not necessary for proper system operation shall be responded to, and their repair scheduled, within one week of warranty claim (the actual time allowed for the repair work shall be negotiated with the building owner at the time of warranty claim).

PART 2 - PRODUCTS

2.1 ACCEPTABLE PRODUCTS

- A. All products permitted by NFPA 13 are acceptable, except where prohibited or otherwise specified herein.
- B. It is the contractor's responsibility to provide all system components necessary to accomplish the input/output function on the contract drawings.
- C. All devices must be listed to operate within the temperature, humidity, and airborne particulate environment expected to be present.
- D. All products must be new and shall be in current production as of the date of shop drawing submittal.
- E. Products which have been refurbished or previously installed are prohibited.

2.2 ABOVEGROUND PIPING

- A. All normally water-filled piping shall be schedule 40 black steel or schedule 10 black steel.
- B. All flexible sprinkler hose must be designed for direct connection to a sprinkler and must include a braided metal jacket.

2.3 UNDERGROUND PIPING

- A. The underground piping provided by the site utility contractor must be connected to the aboveground piping by use of a one-piece stainless steel assembly (AMES IBR or similar). Cathodic protection must be provided in accordance with the manufacturer's instructions.

2.4 BACKFLOW PREVENTION ASSEMBLY

- A. Backflow prevention assembly shall be the double check type.
- B. A means of flushing the backflow prevention assembly at the system demand shall be provided.
- C. The backflow prevention assembly flushing connection shall not require modification of the riser by the building owner to perform test.

2.5 SPRINKLERS

- A. All sprinklers must be the intermediate temperature type except where proximity to a heat source requires a higher temperature rating.

- B. All sprinklers must be quick response.
- C. All sprinklers installed in ceilings must be the recessed type, with white polyester finish and matching escutcheon except where the plans indicate other specific types and colors.
- D. All sprinklers installed in exposed ceiling spaces must have a brass finish.

2.6 FIRE DEPARTMENT CONNECTION

- A. The fire department connection size, type, and locking caps shall be as directed by the City of Goodwell Fire Department.
- B. The fire department connection shall be Siamese with two-and-a-half-inch connection
- C. The FDC shall be brass with a matching escutcheon with “AUTOMATIC SPRINKLERS” cast in the plate.

2.7 RISER MANIFOLD ASSEMBLY

- A. The riser manifold assembly must include a test and drain with pressure relief valve, pressure gauge, and waterflow switch.

2.8 GAUGES

- A. All pressure gauges must be liquid-filled, 0-200 psi range water pressure gauges

2.9 CONTROL VALVES

- A. All system control valves shall be the butterfly type with integral tamper switch.
- B. Butterfly valves with integral tamper switches shall be specifically ordered based on their normal position (normally open or normally closed).

2.10 AIR VENT FOR WET PIPE SYSTEMS

- A. Air vent must be listed.
- B. If the contractor chooses to plumb the air vent discharge to the exterior, it may be a product similar to the Potter PAV.
- C. If the contractor choose to not plumb the air vent discharge to the exterior and install the air vent in a location where it is visible from the floor, it may be a product similar to the ECS PAV-W.

2.11 LOCAL WATERFLOW ALARM

- A. The local waterflow alarm must be a weatherproof horn/strobe. Device must be powered by the fire alarm system but must only activate upon sprinkler system waterflow.

2.12 PENETRATION OF SLAB

- A. Slab penetrations shall be sleeved. Sleeve shall be galvanized schedule 40 steel and shall extend at least one inch above and below the slab. Size of sleeve shall be one nominal pipe size larger than penetrating piping. Annular space shall be filled with flexible waterproof sealant which dries to a firm but pliable mass.

2.13 SUPERVISION BY FIRE ALARM SYSTEM

- A. Coordinate with the fire alarm contractor to ensure all valves controlling water supply to the fire sprinkler system are electrically supervised by the fire alarm system.
- B. Contractor must ensure the fire alarm system device labels correspond to the correct function of each supervised device.

2.14 CONTROL VALVES

- A. Install all control valves in easily accessible locations and not more than 6 feet above finished floor.

2.15 VALVE LABELING

- A. Provide metal or durable plastic signs with molded or stamped labels indicating the purpose of each valve and whether it is to be normally open or normally closed.

2.16 PIPE PAINTING AND LABELING

- A. Paint all piping associated with the fire sprinkler riser with one coat of red enamel paint. Clean, pretreat and prime all surfaces before painting.
- B. Painting piping outside of the fire sprinkler riser is not necessary.
- C. To mains, apply red wrap around labels at least 8-inches long with white lettering at least 2-inches high which reads "FIRE SPRINKLER" on each side of wall and floor penetrations and additionally at 50 ft intervals.
- D. Branch lines do not require labeling.

2.17 PIPE JOINING

- A. All piping shall be joined using grooved couplings and fittings except piping serving a single sprinkler may be joined using threaded couplings and fittings.
- B. Threaded fittings shall utilize PTFE tape or joint compound. Do not apply excessive thread sealant.
- C. Comply with all recommendations and best practices in the coupling and fitting manufacturers literature. For example, if Victaulic is used, comply with the Victaulic I-100 Field Installation Handbook.

2.18 DRAINAGE

- A. All drains which discharge under utility pressure must be hard-piped to the exterior and must discharge to a location which is capable of accepting the full discharge without causing property damage.
- B. All auxiliary drains must be hard-piped to the exterior. Hose bibbs are not permitted on auxiliary drains.
- C. To the maximum extent feasible, all auxiliary drain valves must be hard-piped to a location accessible without the use of a ladder.
- D. Where auxiliary drains are concealed in the building construction, provide an access panel and a rigidly attached label which reads "FIRE SPRINKLER AUXILIARY DRAIN."

2.19 FIRESTOPPING

- A. All new penetrations through fire- and/or smoke-resistant rated construction must be firestopped with a listed firestop assembly appropriate for the installation. Refer to code plans for location and type of rated construction.

2.20 CLEANING

- A. Clean dirt and debris from all components prior to installation.
- B. Clean dirt and debris from all components prior to final testing.
- C. Clean dirt and debris from all components after final testing.

2.21 FLOW SWITCH SENSITIVITY

- A. Flow switch must be adjusted so that an alarm signal is initiated 45 to 60 seconds from when the inspector's test valve is opened.

2.22 FIELD QUALITY CONTROL

- A. Testing must be conducted in the sequence identified in QUALITY CONTROL in Part I of this specification.
- B. Technician supervision of system installation must be conducted in accordance with QUALITY CONTROL in Part I of this specification.
- C. Reacceptance Testing: Perform reacceptance testing to verify the proper operation of added or replaced devices and appliances.
- D. Fire sprinkler system will be considered defective if it does not pass tests and inspections.
- E. Prepare test and inspection reports as required in SUBMITTALS in PART I of this specification.

- F. The Contractor must coordinate water discharge logistics with, and receive written approval from owner, prior to discharging water.
- G. The Contractor is responsible for managing test discharge water and ensuring no property damage occurs.
- H. The Owner will provide water and electrical service for installation and testing.

2.23 TRAINING

- A. Contractor must conduct two training sessions for building staff and the Fire Department. Each training session must be identical. Coordinate the timing of the two required training sessions with the owner and Fire Department.
- B. Training must address, at a minimum:
 - 1. Review of the approved completion documentation submittal including:
 - a. As-built shop drawings
 - b. Product data sheets for major system components
 - c. Narrative of system operation and location of major components
 - d. Operator instructions for basic system operations
 - e. Routine maintenance and testing
 - f. Emergency shutdown and startup procedures
 - 2. Demonstration of all operation of all valves and switches including associated fire alarm system supervision.
 - 3. Demonstration of location of equipment which is concealed or not easily identifiable from as-built drawings.

2.24 WARRANTY PERIOD INSPECTION TESTING AND MAINTENANCE

- A. Throughout the warranty period, the Contractor must perform all inspections and tests required by NFPA 25 for the fire sprinkler system and all associated components, except that the Contractor is not responsible for weekly inspections.
- B. Personnel conducting warranty period inspections, tests, and maintenance activities must have at least 5 years of experience in systems of similar type and configuration. Personnel performing inspections and tests of the fire pump and controller must be trained by the manufacturers for inspection and testing of their components.
- C. Annual Test and Inspection: One year after date of Substantial Completion, perform annual fire sprinkler system test complying with inspection and testing inspection requirements in NFPA 25.
- D. Contractor must provide NFPA 25-compliant documentation of all warranty period inspection, testing, and maintenance to the Owner within one week of associated activity.

END OF SECTION 21 1313

SECTION 22 0523.12 - BALL VALVES FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Bronze ball valves.
 - 2. Iron ball valves.

1.2 DEFINITIONS

- A. CWP: Cold working pressure.
- B. RPTFE: Reinforced polytetrafluoroethylene.
- C. WOG: Water, oil, gas.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of valve.

1.4 DELIVERY, STORAGE, AND HANDLING

- A. Prepare valves for shipping as follows:
 - 1. Protect internal parts against rust and corrosion.
 - 2. Protect threads, flange faces, and soldered ends.
 - 3. Set ball valves open to minimize exposure of functional surfaces.
- B. Use the following precautions during storage:
 - 1. Maintain valve end protection.
 - 2. Store valves indoors and maintain at higher-than-ambient-dew-point temperature. If outdoor storage is necessary, store valves off the ground in watertight enclosures.
- C. Use sling to handle large valves; rig sling to avoid damage to exposed parts. Do not use operating handles or stems as lifting or rigging points.

PART 2 - PRODUCTS

2.1 SOURCE LIMITATIONS

- A. Obtain each type of valve from single source from single manufacturer.

2.2 PERFORMANCE REQUIREMENTS

- A. Standards:
 - 1. Domestic water valves intended to convey or dispense water for human consumption must comply with the SDWA, requirements of authorities having jurisdiction, and NSF 61 and NSF 372, or must be certified to be in compliance with NSF 61 and NSF 372 (by an ANSI-accredited third-party certification body) that the weighted average lead content at wetted surfaces is less than or equal to 0.25 percent.
- B. ASME Compliance:
 - 1. ASME B1.20.1 for threads for threaded end valves.
 - 2. ASME B16.1 for flanges on iron valves.

3. ASME B16.10 and ASME B16.34 for ferrous valve dimensions and design criteria.
 4. ASME B16.18 for cast copper solder-joint connections.
 5. ASME B16.22 for wrought copper and copper alloy solder-joint connections.
 6. ASME B16.34 for flanged and threaded end connections
 7. ASME B31.9 for building services piping valves.
- C. Provide bronze valves made with dezincification-resistant materials. Bronze valves made with copper alloy (brass) containing more than 15 percent zinc are not permitted.
- D. Valve Pressure-Temperature Ratings: Not less than indicated and as required for system pressures and temperatures.
- E. Valve Sizes: Same as upstream piping unless otherwise indicated.
- F. Valve Actuator Type:
1. Hand Lever: For quarter-turn valves smaller than NPS 4.
- G. Valves in Insulated Piping:
1. Provide 2-inch extended neck stems.
 2. Extended operating handles with nonthermal-conductive covering material and protective sleeves that allow operation of valves without breaking vapor seals or disturbing insulation.
 3. Memory stops that are fully adjustable after insulation is applied.

2.3 BRONZE BALL VALVES

- A. Bronze Ball Valves, Two Piece with Full Port and Stainless-Steel Trim, Threaded or Soldered Ends:
1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. [Apollo Valves; a part of Aalberts Integrated Piping Systems.](#)
 - b. [Hammond Valve.](#)
 - c. [NIBCO INC.](#)
 - d. [WATTS.](#)
 2. Standard: MSS SP-110; MSS SP-145.
 3. CWP Rating: 600 psig.
 4. Body Design: Two piece.
 5. Body Material: Bronze.
 6. Ends: Threaded or soldered.
 7. Seats: PTFE.
 8. Stem: Stainless steel.
 9. Ball: Stainless steel, vented.
 10. Port: Full.

2.4 IRON BALL VALVES

- A. Iron Ball Valves, Class 125, Flanged or Threaded Ends:
1. **Manufacturers:** Subject to compliance with requirements, provide products by one of the following:
 - a. [American Valve, Inc.](#)
 - b. [Apollo Valves; a part of Aalberts Integrated Piping Systems.](#)
 - c. [Sure Flow Equipment Inc.](#)
 - d. [WATTS.](#)
 2. Standard: MSS SP-72; MSS SP-110; MSS SP-145.

3. CWP Rating: 200 psig.
4. Body Design: Split body.
5. Body Material: ASTM A126, gray iron.
6. Ends: Flanged or threaded.
7. Seats: PTFE.
8. Stem: Stainless steel.
9. Ball: Stainless steel.
10. Port: Full.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine valve interior for cleanliness, freedom from foreign matter, and corrosion. Remove special packing materials, such as blocks, used to prevent disc movement during shipping and handling.
- B. Operate valves in positions from fully open to fully closed. Examine guides and seats made accessible by such operations.
- C. Examine threads on valve and mating pipe for form and cleanliness.
- D. Examine mating flange faces for conditions that might cause leakage. Check bolting for proper size, length, and material. Verify that gasket is of proper size, that its material composition is suitable for service, and that it is free from defects and damage.
- E. Do not attempt to repair defective valves; replace with new valves. Remove defective valves from site.

3.2 INSTALLATION OF VALVES

- A. Install valves with unions or flanges at each piece of equipment arranged to allow space for service, maintenance, and equipment removal without system shutdown.
- B. Provide support to piping adjacent to valves such that no force is imposed upon valves.
- C. Locate valves for easy access.
- D. For valves in horizontal piping, install valves with stem at or above center of pipe.
- E. Install valves in position to allow full valve actuation movement.
- F. Valve Tags: Comply with requirements in Section 22 0553 "Identification for Plumbing Piping and Equipment" for valve tags and schedules.
- G. Adhere to manufacturer's written installation instructions. When soldering or brazing valves, do not heat valves above maximum permitted temperature. Do not use solder with melting point temperature above valve manufacturer's recommended maximum.

3.3 ADJUSTING

- A. Adjust or replace valve packing after piping systems have been tested and put into service, but before final adjusting and balancing. Replace valves exhibiting leakage.

3.4 GENERAL REQUIREMENTS FOR VALVE APPLICATIONS

- A. If valves with specified CWP ratings are unavailable, provide the same types of valves with higher CWP ratings.
- B. Select valves with the following end connections:
 - 1. For Copper Tubing, NPS 2 and Smaller: Threaded ends except where solder-joint valve-end option or press-end option is indicated in valve schedules below.
 - 2. For Copper Tubing, NPS 2-1/2: Flanged ends except where threaded valve-end option is indicated in valve schedules below.

3.5 DOMESTIC HOT- AND COLD-WATER VALVE SCHEDULE

- A. Pipe NPS 2 and Smaller:
 - 1. Bronze ball valves, two-piece with full port, and stainless-steel trim. Provide with threaded, solder, or press-connection-joint ends.
- B. Pipe NPS 2-1/2 and Larger:
 - 1. Steel and Iron Valves, NPS 2-1/2 to NPS 4: May be provided with threaded ends instead of flanged ends.
 - 2. Iron ball valves, Class 150.

END OF SECTION 22 0523.12

SECTION 22 0523.13 - BUTTERFLY VALVES FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Iron, single-flange (lug-type) butterfly valves.
 - 2. Chainwheels.

1.2 DEFINITIONS

- A. CWP: Cold working pressure.
- B. EPDM: Ethylene propylene-diene terpolymer rubber.
- C. NBR: ABS, Buna-N, or nitrile butadiene rubber.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of valve.

1.4 DELIVERY, STORAGE, AND HANDLING

- A. Prepare valves for shipping as follows:
 - 1. Protect internal parts against rust and corrosion.
 - 2. Protect threads, flange faces, grooves, and weld ends.
 - 3. Set butterfly valves closed or slightly open.
- B. Use the following precautions during storage:
 - 1. Maintain valve end protection.
 - 2. Store valves indoors and maintain at higher-than-ambient-dew-point temperature. If outdoor storage is necessary, store valves off the ground in watertight enclosures.
- C. Use sling to handle large valves; rig sling to avoid damage to exposed parts. Do not use handwheels or stems as lifting or rigging points.

PART 2 - PRODUCTS

2.1 SOURCE LIMITATIONS

- A. Obtain each type of valve from single source from single manufacturer.

2.2 PERFORMANCE REQUIREMENTS

- A. Standards:
 - 1. Domestic water piping specialties intended to convey or dispense water for human consumption must comply with the SDWA, requirements of authorities having jurisdiction, and NSF 61 and NSF 372, or must be certified to be in compliance with NSF 61 and NSF 372 (by an ANSI-accredited third-party certification body) that the weighted average lead content at wetted surfaces is less than or equal to 0.25 percent.
- B. ASME Compliance:
 - 1. ASME B16.1 for flanges on iron valves.
 - 2. ASME B16.10 and ASME B16.34 for ferrous valve dimensions and design criteria.

3. ASME B31.9 for building services valves.
- C. Valve Pressure-Temperature Ratings: Not less than indicated and as required for system pressures and temperatures.
- D. Valve Sizes: Same as upstream piping unless otherwise indicated.
- E. Valve Actuator Types:
 1. Gear Actuator: For valves NPS 8 and larger.
 2. Hand lever: For valves NPS 6 and smaller.
 3. Chainwheel: Device for attachment to gear, hand lever, or stem; of size and with chain for mounting height, according to "Installation of Valves" Article.
- F. Valves in Insulated Piping: Provide 2-inch extended neck stems.

2.3 IRON, SINGLE-FLANGE (LUG-TYPE) BUTTERFLY VALVES

- A. Iron, Single-Flange (Lug-Type) Butterfly Valves with Aluminum-Bronze Disc:
 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Hammond Valve.
 - b. NIBCO INC.
 - c. WATTS.
 2. Standard: MSS SP-67, Type I.
 3. CWP Rating: 200 psig.
 4. Body Design: Single flange (lug type), suitable for bidirectional dead-end service at rated pressure without use of downstream flange.
 5. Body Material: ASTM A126, cast iron or ASTM A536, ductile iron.
 6. Seat: EPDM.
 7. Stem: One- or two-piece stainless steel.
 8. Disc: Aluminum bronze.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine valve interior for cleanliness, freedom from foreign matter, and corrosion. Remove special packing materials, such as blocks, used to prevent disc movement during shipping and handling.
- B. Operate valves in positions from fully open to fully closed. Examine guides and seats made accessible by such operations.
- C. Examine mating flange faces for damage. Check bolting for proper size, length, and material. Verify that gasket is of proper size, that its material composition is suitable for service, and that it is free from defects and damage.
- D. Do not attempt to repair defective valves; replace with new valves. Remove defective valves from site.

3.2 INSTALLATION OF VALVES

- A. Install valves with unions or flanges at each piece of equipment arranged to allow space for service, maintenance, and equipment removal without system shutdown.

- B. Provide support to piping adjacent to valves such that no force is imposed upon valves.
- C. Locate valves for easy access.
- D. Install valves in horizontal piping with stem at or above center of pipe.
- E. Install valves in position to allow full valve actuation movement.
- F. Install chainwheels on actuators for butterfly valves NPS 3 and larger and more than 84 inches above floor. Extend chains to 60 inches above finished floor.
- G. Valve Tags: Comply with requirements in Section 22 0553 "Identification for Plumbing Piping and Equipment" for valve tags and schedules.

3.3 ADJUSTING

- A. Adjust or replace valve packing after piping systems have been tested and put into service but before final adjusting and balancing. If leakage cannot be repaired, replace valves.

3.4 DOMESTIC HOT- AND COLD-WATER VALVE SCHEDULE

- A. Pipe NPS 2-1/2 and Larger:
 - 1. Iron, Single-Flange (Lug-Type) Butterfly Valves: 200 CWP, EPDM seat, and aluminum-bronze disc.

END OF SECTION 22 0523.13

SECTION 22 0719 - PLUMBING PIPING INSULATION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes insulating the following plumbing piping services:
 - 1. Domestic cold-water piping.
 - 2. Domestic hot-water piping.
 - 3. Supplies and drains for handicap-accessible lavatories and sinks.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product. Include thermal conductivity, water-vapor permeance thickness, and jackets (both factory and field applied if any).

1.4 INFORMATIONAL SUBMITTALS

- A. Field quality-control reports.

1.5 QUALITY ASSURANCE

- A. Surface-Burning Characteristics: For insulation and related materials, as determined by testing identical products in accordance with ASTM E84 by a testing agency acceptable to authorities having jurisdiction. Factory label insulation and jacket materials and adhesive, mastic, tapes, and cement material containers, with appropriate markings of applicable testing agency.
 - 1. Insulation Installed Indoors: Flame-spread index of 25 or less and smoke-developed index of 50 or less.
 - 2. Insulation Installed Outdoors: Flame-spread index of 75 or less and smoke-developed index of 150 or less.
- B. Comply with the following applicable standards and other requirements specified for miscellaneous components:
 - 1. Supply and Drain Protective Shielding Guards: ICC A117.1.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Packaging: Insulation material containers shall be marked by manufacturer with appropriate ASTM standard designation, type and grade, and maximum use temperature.

1.7 COORDINATION

- A. Coordinate sizes and locations of supports, hangers, and insulation shields specified in Section 22 0529 "Hangers and Supports for Plumbing Piping and Equipment."
- B. Coordinate clearance requirements with piping Installer for piping insulation application. Before preparing piping Shop Drawings, establish and maintain clearance requirements for installation of insulation and field-applied jackets and finishes and for space required for maintenance.
- C. Coordinate installation and testing of heat tracing.

1.8 SCHEDULING

- A. Schedule insulation application after pressure testing systems and, where required, after installing and testing heat tracing. Insulation application may begin on segments that have satisfactory test results.
- B. Complete installation and concealment of plastic materials as rapidly as possible in each area of construction.

PART 2 - PRODUCTS

2.1 INSULATION MATERIALS

- A. Comply with requirements in "Piping Insulation Schedule, General," "Indoor Piping Insulation Schedule," "Outdoor, Aboveground Piping Insulation Schedule," and "Outdoor, Underground Piping Insulation Schedule" articles for where insulating materials shall be applied.
- B. Products shall not contain asbestos, lead, mercury, or mercury compounds.
- C. Products that come into contact with stainless steel shall have a leachable chloride content of less than 50 ppm when tested in accordance with ASTM C871.
- D. Insulation materials for use on austenitic stainless steel shall be qualified as acceptable in accordance with ASTM C795.
- E. Flexible Elastomeric: Closed-cell, sponge- or expanded-rubber materials. Comply with ASTM C534/C534M, Type I for tubular materials.
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Aeroflex USA.
 - b. Armacell LLC.
 - c. K-Flex USA.
- F. Mineral-Fiber, Preformed Pipe: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C547.
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Johns Manville; a Berkshire Hathaway company.
 - b. Knauf Insulation.
 - c. Manson Insulation Inc.
 - d. Owens Corning.
 - 2. Preformed Pipe Insulation: Type I, Grade A with factory-applied ASJ-SSL.
 - 3. 850 deg F.
 - 4. Factory fabricate shapes in accordance with ASTM C450 and ASTM C585.
 - 5. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.

2.2 INSULATING CEMENTS

- A. Mineral-Fiber, Hydraulic-Setting Insulating and Finishing Cement: Comply with ASTM C449.
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Ramco Insulation, Inc.

2.3 ADHESIVES

- A. Materials shall be compatible with insulation materials, jackets, and substrates and for bonding insulation to itself and to surfaces to be insulated unless otherwise indicated.
- B. Flexible Elastomeric and Polyolefin Adhesive: Solvent-based adhesive.
 - 1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. [Aeroflex USA.](#)
 - b. [Armacell LLC.](#)
 - c. [Foster Brand; H. B. Fuller Construction Products.](#)
 - d. [K-Flex USA.](#)
 - 2. **Adhesive:** As recommended by flexible elastomeric and polyolefin manufacturer and with a VOC content of 80 g/L or less.
 - 3. Flame-spread index shall be 25 or less and smoke-developed index shall be 50 or less as tested in accordance with ASTM E84.
 - 4. Wet Flash Point: Below 0 deg F.
 - 5. Service Temperature Range: 40 to 200 deg F.
 - 6. Color: Black.
- C. Mineral-Fiber Adhesive: Comply with MIL-A-3316C, Class 2, Grade A.
 - 1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. [Childers Brand; H. B. Fuller Construction Products.](#)
 - b. [Foster Brand; H. B. Fuller Construction Products.](#)
 - c. [Mon-Eco Industries, Inc.](#)
 - 2. **Adhesive:** As recommended by mineral fiber manufacturer and with a VOC content of 80 g/L or less.
- D. ASJ Adhesive and FSK Jacket Adhesive: Comply with MIL-A-3316C, Class 2, Grade A, for bonding insulation jacket lap seams and joints.
 - 1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. [Childers Brand; H. B. Fuller Construction Products.](#)
 - b. [Foster Brand; H. B. Fuller Construction Products.](#)
 - c. [Mon-Eco Industries, Inc.](#)
 - 2. **Verify adhesives have a VOC** content of 50 g/L or less.

2.4 MASTICS AND COATINGS

- A. Materials shall be compatible with insulation materials, jackets, and substrates.
 - 1. **Mastics:** As recommended by insulation manufacturer and with a VOC content of 50 g/L or less.
- B. Vapor-Retarder Mastic, Water Based: Suitable for indoor use on below-ambient services.
 - 1. **Manufacturers:** Subject to compliance with requirements, provide products by one of the following:
 - a. [Childers Brand; H. B. Fuller Construction Products.](#)
 - b. [Foster Brand; H. B. Fuller Construction Products.](#)
 - c. [Vimasco Corporation.](#)
 - 2. Water-Vapor Permeance: Comply with ASTM E96/E96M or ASTM F1249.
 - 3. Service Temperature Range: Minus 20 to plus 180 deg F.
 - 4. Comply with MIL-PRF-19565C, Type II, for permeance requirements.

5. Color: White.
- C. Vapor-Retarder Mastic, Solvent Based, Outdoor Use: Suitable for outdoor use on below-ambient services.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Childers Brand; H. B. Fuller Construction Products.
 - b. Foster Brand; H. B. Fuller Construction Products.
 2. Water-Vapor Permeance: Comply with ASTM E96/E96M or ASTM F1249.
 3. Service Temperature Range: Minus 50 to plus 220 deg F.
 4. Color: White.
- D. Breather Mastic: Water based; suitable for indoor and outdoor use on above-ambient services.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Childers Brand; H. B. Fuller Construction Products.
 - b. Foster Brand; H. B. Fuller Construction Products.
 - c. Mon-Eco Industries, Inc.
 2. Water-Vapor Permeance: ASTM E96/E96M, greater than 1.0 perm at manufacturer's recommended dry film thickness.
 3. Service Temperature Range: Minus 20 to plus 180 deg F.
 4. Color: White.
- 2.5 SEALANTS
- A. Materials shall be as recommended by the insulation manufacturer and shall be compatible with insulation materials, jackets, and substrates.
- B. Joint Sealants:
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Childers Brand; H. B. Fuller Construction Products.
 - b. Foster Brand; H. B. Fuller Construction Products.
 - c. Mon-Eco Industries, Inc.
 2. Permanently flexible, elastomeric sealant.
 3. Service Temperature Range: Minus 100 to plus 300 deg F.
 4. Color: White or gray.
 5. Verify sealant has a VOC content of 420 g/L or less.
- C. FSK and Metal Jacket Flashing Sealants:
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Childers Brand; H. B. Fuller Construction Products.
 - b. Foster Brand; H. B. Fuller Construction Products.
 - c. Mon-Eco Industries, Inc.
 2. Fire- and water-resistant, flexible, elastomeric sealant.
 3. Service Temperature Range: Minus 40 to plus 250 deg F.
 4. Color: Aluminum.
 5. Verify sealant has a VOC content of 420 g/L or less.
- D. ASJ Flashing Sealants and PVC Jacket Flashing Sealants:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Childers Brand; H. B. Fuller Construction Products.
2. Fire- and water-resistant, flexible, elastomeric sealant.
3. Service Temperature Range: Minus 40 to plus 250 deg F.
4. Color: White.
5. Verify sealant has a VOC content of 420 g/L or less.

2.6 FACTORY-APPLIED JACKETS

- A. Insulation system schedules indicate factory-applied jackets on various applications. When factory-applied jackets are indicated, comply with the following:
 1. ASJ: White, kraft-paper, fiberglass-reinforced scrim with aluminum-foil backing; complying with ASTM C1136, Type I.
 2. ASJ-SSL: ASJ with self-sealing, pressure-sensitive, acrylic-based adhesive covered by a removable protective strip; complying with ASTM C1136, Type I.

2.7 TAPES

- A. ASJ Tape: White vapor-retarder tape matching factory-applied jacket with acrylic adhesive, complying with ASTM C1136.
 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. 3M Industrial Adhesives and Tapes Division.
 - b. Avery Dennison Corporation, Specialty Tapes Division.
 - c. Knauf Insulation.
 2. Width: 3 inches.
 3. Thickness: 11.5 mils.
 4. Adhesion: 90 ounces force/inch in width.
 5. Elongation: 2 percent.
 6. Tensile Strength: 40 lbf/inch in width.
 7. ASJ Tape Disks and Squares: Precut disks or squares of ASJ tape.
- B. Aluminum-Foil Tape: Vapor-retarder tape with acrylic adhesive.
 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. 3M Industrial Adhesives and Tapes Division.
 - b. Avery Dennison Corporation, Specialty Tapes Division.
 - c. Knauf Insulation.
 2. Width: 2 inches.
 3. Thickness: 3.7 mils.
 4. Adhesion: 100 ounces force/inch in width.
 5. Elongation: 5 percent.
 6. Tensile Strength: 34 lbf/inch in width.

2.8 SECUREMENTS

- A. Bands:
 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. RPR Products, Inc.

2. Stainless Steel: ASTM A240/A240M, Type 304 or Type 316; 0.015 inch thick, 1/2 inch wide with wing seal or closed seal.
 3. Aluminum: ASTM B209, Alloy 3003, 3005, 3105, or 5005; Temper H-14, 0.020 inch thick, 1/2 inch wide with wing seal or closed seal.
- B. Staples: Outward-clinching insulation staples, nominal 3/4-inch-wide, stainless steel or Monel.
- C. Wire: 0.062-inch soft-annealed, stainless steel.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. C & F Wire.

2.9 PROTECTIVE SHIELDING GUARDS

- A. Protective Shielding Pipe Covers,:
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Just Manufacturing.
 - b. Truebro.
 - c. Zurn Industries, LLC.
 2. Description: Manufactured plastic wraps for covering plumbing fixture hot- and cold-water supplies and trap and drain piping. Comply with Americans with Disabilities Act (ADA) requirements.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates and conditions for compliance with requirements for installation tolerances and other conditions affecting performance of insulation application.
1. Verify that systems to be insulated have been tested and are free of defects.
 2. Verify that surfaces to be insulated are clean and dry.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Clean and dry surfaces to receive insulation. Remove materials that will adversely affect insulation application.
- B. Clean and prepare surfaces to be insulated. Before insulating, apply a corrosion coating to insulated surfaces as follows:
1. Stainless Steel: Coat 300 series stainless steel with an epoxy primer 5 mils thick and an epoxy finish 5 mils thick if operating in a temperature range of between 140 and 300 deg F. Consult coating manufacturer for appropriate coating materials and application methods for operating temperature range.
 2. Carbon Steel: Coat carbon steel operating at a service temperature of between 32 and 300 deg F with an epoxy coating. Consult coating manufacturer for appropriate coating materials and application methods for operating temperature range.
- C. Coordinate insulation installation with the tradesman installing heat tracing. Comply with requirements for heat tracing that apply to insulation.

- D. Mix insulating cements with clean potable water; if insulating cements are to be in contact with stainless steel surfaces, use demineralized water.

3.3 GENERAL INSTALLATION REQUIREMENTS

- A. Install insulation materials, accessories, and finishes with smooth, straight, and even surfaces; free of voids throughout the length of piping, including fittings, valves, and specialties.
- B. Install insulation materials, forms, vapor barriers or retarders, jackets, and of thicknesses required for each item of pipe system, as specified in insulation system schedules.
- C. Install accessories compatible with insulation materials and suitable for the service. Install accessories that do not corrode, soften, or otherwise attack insulation or jacket in either wet or dry state.
- D. Install insulation with longitudinal seams at top and bottom of horizontal runs.
- E. Install multiple layers of insulation with longitudinal and end seams staggered.
- F. Do not weld brackets, clips, or other attachment devices to piping, fittings, and specialties.
- G. Keep insulation materials dry during storage, application, and finishing. Replace insulation materials that get wet.
- H. Install insulation with tight longitudinal seams and end joints. Bond seams and joints with adhesive recommended by insulation material manufacturer.
- I. Install insulation with least number of joints practical.
- J. Where vapor barrier is indicated, seal joints, seams, and penetrations in insulation at hangers, supports, anchors, and other projections with vapor-barrier mastic.
 - 1. Install insulation continuously through hangers and around anchor attachments.
 - 2. For insulation application where vapor barriers are indicated, extend insulation on anchor legs from point of attachment to supported item to point of attachment to structure. Taper and seal ends attached to structure with vapor-barrier mastic.
 - 3. Install insert materials and insulation to tightly join the insert. Seal insulation to insulation inserts with adhesive or sealing compound recommended by insulation material manufacturer.
 - 4. Cover inserts with jacket material matching adjacent pipe insulation. Install shields over jacket, arranged to protect jacket from tear or puncture by hanger, support, and shield.
- K. Apply adhesives, mastics, and sealants at manufacturer's recommended coverage rate and wet and dry film thicknesses.
- L. Install insulation with factory-applied jackets as follows:
 - 1. Draw jacket tight and smooth.
 - 2. Cover circumferential joints with 3-inch-wide strips, of same material as insulation jacket. Secure strips with adhesive and outward-clinching staples along both edges of strip, spaced 4 inches o.c.
 - 3. Overlap jacket longitudinal seams at least 1-1/2 inches. Install insulation with longitudinal seams at bottom of pipe. Clean and dry surface to receive self-sealing lap. Staple laps with outward-clinching staples along edge at 4 inches o.c.
 - a. For below-ambient services, apply vapor-barrier mastic over staples.
 - 4. Cover joints and seams with tape, in accordance with insulation material manufacturer's written instructions, to maintain vapor seal.

5. Where vapor barriers are indicated, apply vapor-barrier mastic on seams and joints and at ends adjacent to pipe flanges and fittings.
- M. Cut insulation in a manner to avoid compressing insulation more than 25 percent of its nominal thickness.
- N. Finish installation with systems at operating conditions. Repair joint separations and cracking due to thermal movement.
- O. Repair damaged insulation facings by applying same facing material over damaged areas. Extend patches at least 4 inches beyond damaged areas. Adhere, staple, and seal patches in similar fashion to butt joints.
- P. For above-ambient services, do not install insulation to the following:
 1. Vibration-control devices.
 2. Testing agency labels and stamps.
 3. Nameplates and data plates.
 4. Cleanouts.

3.4 PENETRATIONS

- A. Insulation Installation at Roof Penetrations: Install insulation continuously through roof penetrations.
 1. Seal penetrations with flashing sealant.
 2. For applications requiring only indoor insulation, terminate insulation above roof surface and seal with joint sealant. For applications requiring indoor and outdoor insulation, install insulation for outdoor applications tightly joined to indoor insulation ends. Seal joint with joint sealant.
 3. Extend jacket of outdoor insulation outside roof flashing at least 2 inches below top of roof flashing.
 4. Seal jacket to roof flashing with flashing sealant.
- B. Insulation Installation at Underground Exterior Wall Penetrations: Terminate insulation flush with sleeve seal. Seal terminations with flashing sealant.
- C. Insulation Installation at Aboveground Exterior Wall Penetrations: Install insulation continuously through wall penetrations.
 1. Seal penetrations with flashing sealant.
 2. For applications requiring only indoor insulation, terminate insulation inside wall surface and seal with joint sealant. For applications requiring indoor and outdoor insulation, install insulation for outdoor applications tightly joined to indoor insulation ends. Seal joint with joint sealant.
 3. Extend jacket of outdoor insulation outside wall flashing and overlap wall flashing at least 2 inches.
 4. Seal jacket to wall flashing with flashing sealant.
- D. Insulation Installation at Interior Wall and Partition Penetrations (That Are Not Fire Rated): Install insulation continuously through walls and partitions.
- E. Insulation Installation at Fire-Rated Wall and Partition Penetrations: Install insulation continuously through penetrations of fire-rated walls and partitions.
 1. Comply with requirements in Section 07 8413 "Penetration Firestopping" for firestopping and fire-resistive joint sealers.
- F. Insulation Installation at Floor Penetrations:

1. Pipe: Install insulation continuously through floor penetrations.
2. Seal penetrations through fire-rated assemblies. Comply with requirements in Section 07 8413 "Penetration Firestopping."

3.5 GENERAL PIPE INSULATION INSTALLATION

- A. Requirements in this article generally apply to all insulation materials, except where more specific requirements are specified in various pipe insulation material installation articles.
- B. Insulation Installation on Fittings, Valves, Strainers, Flanges, Mechanical Couplings, and Unions:
 1. Install insulation over fittings, valves, strainers, flanges, mechanical couplings, unions, and other specialties with continuous thermal and vapor-retarder integrity unless otherwise indicated.
 2. Insulate pipe elbows using preformed fitting insulation or mitered fittings made from same material and density as that of adjacent pipe insulation. Each piece shall be butted tightly against adjoining piece and bonded with adhesive. Fill joints, seams, voids, and irregular surfaces with insulating cement finished to a smooth, hard, and uniform contour that is uniform with adjoining pipe insulation.
 3. Insulate tee fittings with preformed fitting insulation or sectional pipe insulation of same material and thickness as that used for adjacent pipe. Cut sectional pipe insulation to fit. Butt each section closely to the next and hold in place with tie wire. Bond pieces with adhesive.
 4. Insulate valves using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as that used for adjacent pipe. Overlap adjoining pipe insulation by not less than 2 times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. For valves, insulate up to and including the bonnets, valve stuffing-box studs, bolts, and nuts. Fill joints, seams, and irregular surfaces with insulating cement.
 5. Insulate strainers using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as used for adjacent pipe. Overlap adjoining pipe insulation by not less than 2 times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. Fill joints, seams, and irregular surfaces with insulating cement. Insulate strainers, so strainer basket flange or plug can be easily removed and replaced without damaging the insulation and jacket. Provide a removable reusable insulation cover. For below-ambient services, provide a design that maintains vapor barrier.
 6. Insulate flanges, mechanical couplings, and unions, using a section of oversized preformed pipe insulation. Overlap adjoining pipe insulation by not less than 2 times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. Stencil or label the outside insulation jacket of each union with the word "union" matching size and color of pipe labels.
 7. Cover segmented insulated surfaces with a layer of finishing cement and coat with a mastic. Install vapor-barrier mastic for below-ambient services and a breather mastic for above-ambient services. Reinforce the mastic with fabric-reinforcing mesh. Trowel the mastic to a smooth and well-shaped contour.
 8. For services not specified to receive a field-applied jacket, except for flexible elastomeric and polyolefin, install fitted PVC cover over elbows, tees, strainers, valves, flanges, and unions. Terminate ends with PVC end caps. Tape PVC covers to adjoining insulation facing, using PVC tape.
- C. Insulate instrument connections for thermometers, pressure gages, pressure temperature taps, test connections, flow meters, sensors, switches, and transmitters on insulated pipes. Shape insulation at these connections by tapering it to and around the connection with insulating cement and finish with finishing cement, mastic, and flashing sealant.

- D. Install removable insulation covers at locations indicated. Installation shall conform to the following:
 - 1. Make removable flange and union insulation from sectional pipe insulation of same thickness as that on adjoining pipe. Install same insulation jacket as that of adjoining pipe insulation.
 - 2. When flange and union covers are made from sectional pipe insulation, extend insulation from flanges or union at least 2 times the insulation thickness over adjacent pipe insulation on each side of flange or union. Secure flange cover in place with stainless steel or aluminum bands. Select band material compatible with insulation and jacket.
 - 3. Construct removable valve insulation covers in same manner as for flanges, except divide the two-part section on the vertical center line of valve body.
 - 4. When covers are made from block insulation, make two halves, each consisting of mitered blocks wired to stainless steel fabric. Secure this wire frame, with its attached insulation, to flanges with tie wire. Extend insulation at least 2 inches over adjacent pipe insulation on each side of valve. Fill space between flange or union cover and pipe insulation with insulating cement. Finish cover assembly with insulating cement applied in two coats. After first coat is dry, apply and trowel second coat to a smooth finish.

3.6 INSTALLATION OF FLEXIBLE ELASTOMERIC INSULATION

- A. Seal longitudinal seams and end joints with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.
- B. Insulation Installation on Pipe Flanges:
 - 1. Install pipe insulation to outer diameter of pipe flange.
 - 2. Make width of insulation section same as overall width of flange and bolts, plus twice the thickness of pipe insulation.
 - 3. Fill voids between inner circumference of flange insulation and outer circumference of adjacent straight pipe segments with cut sections of sheet insulation of same thickness as that of pipe insulation.
 - 4. Secure insulation to flanges and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.
- C. Insulation Installation on Pipe Fittings and Elbows:
 - 1. Install mitered sections of pipe insulation.
 - 2. Secure insulation materials and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.
- D. Insulation Installation on Valves and Pipe Specialties:
 - 1. Install preformed valve covers manufactured of same material as that of pipe insulation when available.
 - 2. When preformed valve covers are not available, install cut sections of pipe and sheet insulation to valve body. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
 - 3. Install insulation to flanges as specified for flange insulation application.
 - 4. Secure insulation to valves and specialties, and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.

3.7 INSTALLATION OF MINERAL-FIBER INSULATION

- A. Insulation Installation on Straight Pipes and Tubes:
 - 1. Secure each layer of preformed pipe insulation to pipe with wire or bands and tighten bands without deforming insulation materials.
 - 2. Where vapor barriers are indicated, seal longitudinal seams, end joints, and protrusions with vapor-barrier mastic and joint sealant.

3. For insulation with factory-applied jackets on above-ambient surfaces, secure laps with outward-clinched staples at 6 inches o.c.
 4. For insulation with factory-applied jackets on below-ambient surfaces, do not staple longitudinal tabs. Instead, secure tabs with additional adhesive, as recommended by insulation material manufacturer, and seal with vapor-barrier mastic and flashing sealant.
- B. Insulation Installation on Pipe Flanges:
1. Install preformed pipe insulation to outer diameter of pipe flange.
 2. Make width of insulation section same as overall width of flange and bolts, plus twice the thickness of pipe insulation.
 3. Fill voids between inner circumference of flange insulation and outer circumference of adjacent straight pipe segments with mineral-fiber blanket insulation.
 4. Install jacket material with manufacturer's recommended adhesive, overlap seams at least 1 inch, and seal joints with flashing sealant.
- C. Insulation Installation on Pipe Fittings and Elbows:
1. Install preformed sections of same material as that of straight segments of pipe insulation when available.
 2. When preformed insulation elbows and fittings are not available, install mitered sections of pipe insulation, to a thickness equal to adjoining pipe insulation. Secure insulation materials with wire or bands.
- D. Insulation Installation on Valves and Pipe Specialties:
1. Install preformed sections of same material as that of straight segments of pipe insulation when available.
 2. When preformed sections are not available, install mitered sections of pipe insulation to valve body.
 3. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
 4. Install insulation to flanges as specified for flange insulation application.

3.8 FINISHES

- A. Insulation with ASJ, Glass-Cloth, or Other Paintable Jacket Material: Paint jacket with paint system identified below and as specified in Section 09 9113 "Exterior Painting" and Section 09 9123 "Interior Painting."
1. Flat Acrylic Finish: Two finish coats over a primer that is compatible with jacket material and finish coat paint. Add fungicidal agent to render fabric mildew proof.
 - a. Finish Coat Material: Interior, flat, latex-emulsion size.
- B. Flexible Elastomeric Thermal Insulation: After adhesive has fully cured, apply two coats of insulation manufacturer's recommended protective coating.
- C. Color: Final color as selected by Architect. Vary first and second coats to allow visual inspection of the completed Work.
- D. Do not field paint aluminum or stainless-steel jackets.

3.9 FIELD QUALITY CONTROL

- A. Engage a qualified testing agency to perform tests and inspections.
- B. Manufacturer's Field Service: Engage a factory-authorized service representative to test and inspect components, assemblies, and equipment installations, including connections.

- C. Perform tests and inspections.
- D. Tests and Inspections: Inspect pipe, fittings, strainers, and valves, randomly selected by Architect, by removing field-applied jacket and insulation in layers in reverse order of their installation. Extent of inspection shall be limited to three locations of straight pipe, three locations of threaded fittings, three locations of welded fittings, two locations of threaded strainers, two locations of welded strainers, three locations of threaded valves, and three locations of flanged valves for each pipe service defined in the "Piping Insulation Schedule, General" Article.
- E. All insulation applications will be considered defective if they do not pass tests and inspections.
- F. Prepare test and inspection reports.

3.10 PIPING INSULATION SCHEDULE, GENERAL

- A. Acceptable preformed pipe and tubular insulation materials and thicknesses are identified for each piping system and pipe size range. If more than one material is listed for a piping system, selection from materials listed is Contractor's option.
- B. Items Not Insulated: Unless otherwise indicated, do not install insulation on the following:
 - 1. Underground piping.
 - 2. Chrome-plated pipes and fittings unless there is a potential for personnel injury.

3.11 INDOOR PIPING INSULATION SCHEDULE

- A. Domestic Cold Water:
 - 1. NPS 1 and Smaller: Insulation shall be the following:
 - a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1/2 inch thick.
 - 2. NPS 1-1/4 and Larger: Insulation shall be the following:
 - a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1 inch thick.
- B. Domestic Hot and Recirculated Hot Water:
 - 1. NPS 1-1/4 and Smaller: Insulation shall be the following:
 - a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1 inch thick.
 - 2. NPS 1-1/2 and Larger: Insulation shall be the following:
 - a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1-1/2 inches thick.
- C. Exposed Sanitary Drains, Domestic Water, Domestic Hot Water, and Stops for Plumbing Fixtures for People with Disabilities:
 - 1. All Pipe Sizes: Insulation shall be one of the following:
 - a. Flexible Elastomeric: 1 inch thick.
 - b. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1 inch thick.

END OF SECTION 22 0719

SECTION 22 1116 - DOMESTIC WATER PIPING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Copper tube and fittings.
 - 2. Piping joining materials.
 - 3. Transition fittings.
 - 4. Dielectric fittings.

1.3 ACTION SUBMITTALS

- A. Product Data:
 - 1. Pipe and tube.
 - 2. Fittings.
 - 3. Joining materials.

1.4 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Piping layout, or BIM model, drawn to scale, showing the items described in this Section, and coordinated with all building trades.
- B. System purging and disinfecting activities report.
- C. Field quality-control reports.

1.5 FIELD CONDITIONS

- A. Interruption of Existing Water Service: Do not interrupt water service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary water service according to requirements indicated:
 - 1. Notify Construction Manager no fewer than two days in advance of proposed interruption of water service.
 - 2. Do not interrupt water service without Construction Manager's written permission.

PART 2 - PRODUCTS

2.1 PIPING MATERIALS

- A. Potable-water piping and components shall comply with NSF 14, NSF 61, and NSF 372. Include marking "NSF-pw" on piping.

2.2 COPPER TUBE AND FITTINGS

- A. Drawn-Temper Copper Tube: ASTM B88, Type L.
- B. Annealed-Temper Copper Tube: ASTM B88, Type K.

- C. Cast-Copper, Solder-Joint Fittings: ASME B16.18, pressure fittings.
- D. Wrought-Copper, Solder-Joint Fittings: ASME B16.22, pressure fittings.
- E. Bronze Flanges: ASME B16.24, Class 150, with solder-joint ends.
- F. Cast Copper Unions: MSS SP-123, cast-copper-alloy, hexagonal-stock body, with ball-and-socket, metal-to-metal seating surfaces and solder-joint or threaded ends.
- G. Wrought Copper Unions: ASME B16.22.
- H. Copper-Tube, Mechanically Formed Tee Fitting: For forming T-branch on copper water tube.
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. T-DRILL Industries Inc.
 - 2. Description: Tee formed in copper tube in accordance with ASTM F2014.
- I. Copper Tube, Pressure-Seal-Joint Fittings:
 - 1. Basis-of-Design Product: Subject to compliance with requirements, provide Viega LLC ProPress; or a comparable product by one of the following:
 - a. Mueller Industries, Inc.
 - b. NIBCO INC.
 - 2. Fittings: Cast-brass, cast-bronze, or wrought-copper with EPDM O-ring seal in each end.
 - 3. Minimum 200-psig working-pressure rating at 250 deg F.

2.3 PIPING JOINING MATERIALS

- A. Pipe-Flange Gasket Materials:
 - 1. AWWA C110/A21.10, rubber, flat face, 1/8-inch-thick or ASME B16.21, nonmetallic and asbestos free unless otherwise indicated.
 - 2. Full-face or ring type unless otherwise indicated.
- B. Metal, Pipe-Flange Bolts and Nuts: ASME B18.2.1, carbon steel unless otherwise indicated.
- C. Solder Filler Metals: ASTM B32, lead-free alloys.
- D. Flux: ASTM B813, water flushable.
- E. Brazing Filler Metals: AWS A5.8M/A5.8, BCuP Series, copper-phosphorus alloys for general-duty brazing unless otherwise indicated.

2.4 TRANSITION FITTINGS

- A. General Requirements:
 - 1. Same size as pipes to be joined.
 - 2. Pressure rating at least equal to pipes to be joined.
 - 3. End connections compatible with pipes to be joined.
- B. Fitting-Type Transition Couplings: Manufactured piping coupling or specified piping system fitting.

2.5 DIELECTRIC FITTINGS

- A. General Requirements: Assembly of copper alloy and ferrous materials with separating nonconductive insulating material. Include end connections compatible with pipes to be joined.
- B. Dielectric Unions:
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Capitol Manufacturing Company.
 - b. WATTS.
 - c. Zurn Industries, LLC.
 2. Standard: ASSE 1079.
 3. Pressure Rating: 125 psig minimum at 180 deg F.
 4. End Connections: Solder-joint copper alloy and threaded ferrous.
- C. Dielectric Flanges:
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Capitol Manufacturing Company.
 - b. WATTS.
 - c. Zurn Industries, LLC.
 2. Standard: ASSE 1079.
 3. Factory-fabricated, bolted, companion-flange assembly.
 4. Pressure Rating: 125 psig minimum at 180 deg F.
 5. End Connections: Solder-joint copper alloy and threaded ferrous; threaded solder-joint copper alloy and threaded ferrous.
- D. Dielectric-Flange Insulating Kits:
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Advance Products & Systems, Inc.
 - b. Calpico, Inc.
 - c. Central Plastics Company.
 2. Nonconducting materials for field assembly of companion flanges.
 3. Pressure Rating: 150 psig.
 4. Gasket: Neoprene or phenolic.
 5. Bolt Sleeves: Phenolic or polyethylene.
 6. Washers: Phenolic with steel backing washers.
- E. Dielectric Waterway:
1. Fittings shall be a copper-silicon casting conforming to UNS C87850.
 2. UL classified in accordance with ANSI / NSF-61 for potable water service.
 3. Threaded ends.
 4. Basis of Design: Victaulic Style 647.
- F. Dielectric Nipples:
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Precision Plumbing Products.
 - b. Sioux Chief Manufacturing Company, Inc.
 - c. Victaulic Company.

2. Standard: IAPMO PS 66.
3. Electroplated steel nipple complying with ASTM F1545.
4. Pressure Rating and Temperature: 300 psig at 225 deg F.
5. End Connections: Male threaded.
6. Lining: Inert and noncorrosive, propylene.

PART 3 - EXECUTION

3.1 PIPING APPLICATIONS

- A. Transition and special fittings with pressure ratings at least equal to piping rating may be used in applications below unless otherwise indicated.
- B. Flanges and unions may be used for aboveground piping joints unless otherwise indicated.
- C. Aboveground domestic water piping, NPS 2 and smaller, shall be one of the following:
 1. Drawn-temper copper tube, ASTM B88, Type L; cast- or wrought-copper, solder-joint fittings; and soldered joints.
 2. Drawn-temper copper tube, ASTM B88, Type L; copper pressure-seal-joint fittings; and pressure-sealed joints.
- D. Aboveground domestic water piping, NPS 2-1/2 to NPS 4, shall be one of the following:
 1. Drawn-temper copper tube, ASTM B88, Type L; cast- or wrought-copper, solder-joint fittings; and soldered joints.
 2. Drawn-temper copper tube, ASTM B88, Type L; copper pressure-seal-joint fittings; and pressure-sealed joints.

3.2 INSTALLATION OF PIPING

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of domestic water piping. Indicated locations and arrangements are used to size pipe and calculate friction loss, expansion, and other design considerations. Install piping as indicated unless deviations to layout are approved on coordination drawings.
- B. Install copper tubing under building slab according to CDA's "Copper Tube Handbook."
- C. Install valves according to the following:
 1. Section 22 0523.12 "Ball Valves for Plumbing Piping."
 2. Section 22 0523.13 "Butterfly Valves for Plumbing Piping."
- D. Install domestic water piping level without pitch plumb.
- E. Rough-in domestic water piping for water-meter installation according to utility company's requirements.
- F. Install piping concealed from view and protected from physical contact by building occupants unless otherwise indicated and except in equipment rooms and service areas.
- G. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- H. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal, and coordinate with other services occupying that space.

- I. Install piping to permit valve servicing.
- J. Install nipples, unions, special fittings, and valves with pressure ratings the same as or higher than the system pressure rating used in applications below unless otherwise indicated.
- K. Install piping free of sags and bends.
- L. Install fittings for changes in direction and branch connections.
- M. Install unions in copper tubing at final connection to each piece of equipment, machine, and specialty.

3.3 JOINT CONSTRUCTION

- A. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.
- B. Remove scale, slag, dirt, and debris from inside and outside of pipes, tubes, and fittings before assembly.
- C. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:
 - 1. Apply appropriate tape or thread compound to external pipe threads.
 - 2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged.
- D. Brazed Joints for Copper Tubing: Comply with CDA's "Copper Tube Handbook," "Brazed Joints" chapter.
- E. Soldered Joints for Copper Tubing: Apply ASTM B813, water-flushable flux to end of tube. Join copper tube and fittings according to ASTM B828 or CDA's "Copper Tube Handbook."
- F. Pressure-Sealed Joints for Copper Tubing: Join copper tube and pressure-seal fittings with tools and procedure recommended by pressure-seal-fitting manufacturer. Leave insertion marks on pipe after assembly.
- G. Flanged Joints: Select appropriate asbestos-free, nonmetallic gasket material in size, type, and thickness suitable for domestic water service. Join flanges with gasket and bolts according to ASME B31.9.
- H. Joints for Dissimilar-Material Piping: Make joints using adapters compatible with materials of both piping systems.

3.4 INSTALLATION OF DIELECTRIC FITTINGS

- A. Install dielectric fittings in piping at connections of dissimilar metal piping and tubing.
- B. Dielectric Fittings for NPS 2 and Smaller: Use dielectric couplings, nipples, or unions.
- C. Dielectric Fittings for NPS 2-1/2 to NPS 4: Use dielectric flanges or flange kits.

3.5 INSTALLATION OF HANGERS AND SUPPORTS

- A. Comply with requirements for hangers, supports, and anchor devices in Section 22 0529 "Hangers and Supports for Plumbing Piping and Equipment."
- B. Install hangers for copper or tubing and piping, with maximum horizontal spacing and minimum rod diameters, to comply with MSS-58, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.
- C. Support horizontal piping within 12 inches of each fitting.
- D. Support vertical runs of copper or tubing and piping to comply with MSS-58, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.

3.6 CONNECTIONS

- A. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. When installing piping adjacent to equipment and machines, allow space for service and maintenance.
- C. Connect domestic water piping to exterior water-service piping. Use transition fitting to join dissimilar piping materials.
- D. Connect domestic water piping to water-service piping with shutoff valve; extend and connect to the following:
 - 1. Domestic Water Booster Pumps: Cold-water suction and discharge piping.
 - 2. Water Heaters: Cold-water inlet and hot-water outlet piping in sizes indicated, but not smaller than sizes of water heater connections.
 - 3. Plumbing Fixtures: Cold- and hot-water-supply piping in sizes indicated, but not smaller than that required by plumbing code.
 - 4. Equipment: Cold- and hot-water-supply piping as indicated, but not smaller than equipment connections. Provide shutoff valve and union for each connection. Use flanges instead of unions for NPS 2-1/2 and larger.

3.7 ADJUSTING

- A. Perform the following adjustments before operation:
 - 1. Close drain valves, hydrants, and hose bibbs.
 - 2. Open shutoff valves to fully open position.
 - 3. Open throttling valves to proper setting.
 - 4. Adjust balancing valves in hot-water-circulation return piping to provide adequate flow.
 - a. Manually adjust ball-type balancing valves in hot-water-circulation return piping to provide hot-water flow in each branch.
 - b. Adjust calibrated balancing valves to flows indicated.
 - 5. Remove plugs used during testing of piping and for temporary sealing of piping during installation.
 - 6. Remove and clean strainer screens. Close drain valves and replace drain plugs.
 - 7. Remove filter cartridges from housings and verify that cartridges are as specified for application where used and are clean and ready for use.
 - 8. Check plumbing specialties and verify proper settings, adjustments, and operation.

3.8 FIELD QUALITY CONTROL

A. Perform the following tests and inspections:

1. Piping Inspections:

- a. Do not enclose, cover, or put piping into operation until it has been inspected and approved by authorities having jurisdiction.
- b. During installation, notify authorities having jurisdiction at least one day before inspection must be made. Perform tests specified below in presence of authorities having jurisdiction:
 - 1) Roughing-in Inspection: Arrange for inspection of piping before concealing or closing in after roughing in and before setting fixtures.
 - 2) Final Inspection: Arrange for authorities having jurisdiction to observe tests specified in "Piping Tests" Subparagraph below and to ensure compliance with requirements.
- c. Reinspection: If authorities having jurisdiction find that piping will not pass tests or inspections, make required corrections and arrange for reinspection.
- d. Reports: Prepare inspection reports and have them signed by authorities having jurisdiction.

2. Piping Tests:

- a. Fill domestic water piping. Check components to determine that they are not air bound and that piping is full of water.
- b. Test for leaks and defects in new piping and parts of existing piping that have been altered, extended, or repaired. If testing is performed in segments, submit a separate report for each test, complete with diagram of portion of piping tested.
- c. Leave new, altered, extended, or replaced domestic water piping uncovered and unconcealed until it has been tested and approved. Expose work that was covered or concealed before it was tested.
- d. Cap and subject piping to static water pressure of 50 psig above operating pressure, without exceeding pressure rating of piping system materials. Isolate test source and allow it to stand for four hours. Leaks and loss in test pressure constitute defects that must be repaired.
- e. Hydrostatic testing and documentation of test results for polypropylene piping to be in accordance with the manufacturer's instructions and submitted to the manufacturer upon successful completion per warranty requirements.
- f. Repair leaks and defects with new materials, and retest piping or portion thereof until satisfactory results are obtained.
- g. Prepare reports for tests and for corrective action required.

B. Domestic water piping will be considered defective if it does not pass tests and inspections.

C. Prepare test and inspection reports.

3.9 CLEANING

A. Clean and disinfect potable domestic water piping as follows:

1. Purge new piping and parts of existing piping that have been altered, extended, or repaired before using.
2. Use purging and disinfecting procedures prescribed by authorities having jurisdiction; if methods are not prescribed, use procedures described in either AWWA C651 or AWWA C652 or follow procedures described below:
 - a. Flush piping system with clean, potable water until dirty water does not appear at outlets.
 - b. Fill and isolate system according to either of the following:
 - 1) Fill system or part thereof with water/chlorine solution with at least 50 ppm of chlorine. Isolate with valves and allow to stand for 24 hours.

- 2) Fill system or part thereof with water/chlorine solution with at least 200 ppm of chlorine. Isolate and allow to stand for three hours.
 - c. Flush system with clean, potable water until no chlorine is in water coming from system after the standing time.
 - d. Repeat procedures if biological examination shows contamination.
 - e. Submit water samples in sterile bottles to authorities having jurisdiction.
- B. Clean non-potable domestic water piping as follows:
 1. Purge new piping and parts of existing piping that have been altered, extended, or repaired before using.
 2. Use purging procedures prescribed by authorities having jurisdiction or if methods are not prescribed, follow procedures described below:
 - a. Flush piping system with clean, potable water until dirty water does not appear at outlets.
 - b. Submit water samples in sterile bottles to authorities having jurisdiction. Repeat procedures if biological examination shows contamination.
- C. Prepare and submit reports of purging and disinfecting activities. Include copies of water-sample approvals from authorities having jurisdiction.
- D. Clean interior of domestic water piping system. Remove dirt and debris as work progresses.

END OF SECTION 22 1116

SECTION 22 1316 - SANITARY WASTE AND VENT PIPING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Hub-and-spigot, cast-iron soil pipe and fittings.
 - 2. Hubless, cast-iron soil pipe and fittings.
 - 3. Copper tube and fittings.
 - 4. Specialty pipe fittings.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.

1.4 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Piping layout, or BIM model, drawn to scale, showing the items described in this Section, and coordinated with all building trades.
- B. Field quality-control reports.

1.5 FIELD CONDITIONS

- A. Interruption of Existing Sanitary Waste Service: Do not interrupt service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary service according to requirements indicated:
 - 1. Notify Construction Manager no fewer than two days in advance of proposed interruption of sanitary waste service.
 - 2. Do not proceed with interruption of sanitary waste service without Construction Manager's written permission.

1.6 WARRANTY

- A. Listed manufacturers to provide labeling and warranty of their respective products.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Components and installation shall be capable of withstanding the following minimum working pressure unless otherwise indicated:
 - 1. Soil, Waste, and Vent Piping: 10-foot head of water.

2.2 PIPING MATERIALS

- A. Piping materials shall bear label, stamp, or other markings of specified testing agency.

- B. Comply with requirements in "Piping Schedule" Article for applications of pipe, tube, fitting materials, and joining methods for specific services, service locations, and pipe sizes.

2.3 HUB-AND-SPIGOT, CAST-IRON SOIL PIPE AND FITTINGS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - 1. AB & I Foundry; a part of the McWane family of companies.
 - 2. Charlotte Pipe and Foundry Company.
 - 3. Tyler Pipe; a part of McWane family of companies.
- B. Pipe and Fittings: ASTM A 74, Service class(es).
- C. Gaskets: ASTM C 564, rubber.
- D. Caulking Materials: ASTM B 29, pure lead and oakum or hemp fiber.

2.4 HUBLESS, CAST-IRON SOIL PIPE AND FITTINGS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - 1. AB & I Foundry; a part of the McWane family of companies.
 - 2. Charlotte Pipe and Foundry Company.
 - 3. Tyler Pipe; a part of McWane family of companies.
- B. Pipe and Fittings: ASTM A 888 or CISPI 301.
- C. CISPI, Hubless-Piping Couplings:
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. ANACO-Husky.
 - b. Charlotte Pipe and Foundry Company.
 - c. Tyler Pipe; a subsidiary of McWane Inc.
 - 2. Standards: ASTM C 1277 and CISPI 310.
 - 3. Description: Stainless-steel corrugated shield with stainless-steel bands and tightening devices; and ASTM C 564, rubber sleeve with integral, center pipe stop.

2.5 COPPER TUBE AND FITTINGS

- A. Copper Type DWV Tube: ASTM B 306, drainage tube, drawn temper.
- B. Copper Drainage Fittings: ASME B16.23, cast copper or ASME B16.29, wrought copper, solder-joint fittings.
- C. Hard Copper Tube: ASTM B 88, Type L and Type M, water tube, drawn temper.
- D. Soft Copper Tube: ASTM B 88, Type L, water tube, annealed temper.
- E. Copper Pressure Fittings:
 - 1. Copper Fittings: ASME B16.18, cast-copper-alloy or ASME B16.22, wrought-copper, solder-joint fittings. Furnish wrought-copper fittings if indicated.
 - 2. Copper Unions: MSS SP-123, copper-alloy, hexagonal-stock body with ball-and-socket, metal-to-metal seating surfaces, and solder-joint or threaded ends.
- F. Copper Flanges: ASME B16.24, Class 150, cast copper with solder-joint end.

1. Flange Gasket Materials: ASME B16.21, full-face, flat, nonmetallic, asbestos-free, 1/8-inch maximum thickness unless thickness or specific material is indicated.
 2. Flange Bolts and Nuts: ASME B18.2.1, carbon steel unless otherwise indicated.
- G. Solder: ASTM B 32, lead free with ASTM B 813, water-flushable flux.
- H. Transition Couplings:
1. Fitting-Type Transition Couplings: Manufactured piping coupling or specified piping system fitting.
 2. Shielded, Nonpressure Transition Couplings:
 - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - 1) Cascade Waterworks Mfg. Co.
 - 2) Mission Rubber Company, LLC; a division of MCP Industries.
 - b. Standard: ASTM C 1460.
 - c. Description: Elastomeric or rubber sleeve with full-length, corrosion-resistant outer shield and corrosion-resistant-metal tension band and tightening mechanism on each end.
 - d. End Connections: Same size as and compatible with pipes to be joined.
 3. Pressure Transition Couplings:
 - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - 1) Apollo Valves; a part of Aalberts Integrated Piping Systems.
 - 2) Cascade Waterworks Mfg. Co.
 - 3) Romac Industries, Inc.
 - b. Standard: AWWA C219.
 - c. Description: Metal, sleeve-type same size as, with pressure rating at least equal to, and ends compatible with, pipes to be joined.
 - d. Center-Sleeve Material: Manufacturer's standard.
 - e. Gasket Material: Natural or synthetic rubber.
 - f. Metal Component Finish: Corrosion-resistant coating or material.
- I. Dielectric Fittings:
1. Dielectric Unions:
 - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - 1) Capitol Manufacturing Company.
 - 2) WATTS.
 - 3) Zurn Industries, LLC.
 - b. Description:
 - 1) Standard: ASSE 1079.
 - 2) Pressure Rating: 125 psig minimum at 180 deg F.
 - 3) End Connections: Solder-joint copper alloy and threaded ferrous.
 2. Dielectric Flanges:
 - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - 1) Capitol Manufacturing Company.
 - 2) WATTS.
 - 3) Zurn Industries, LLC.
 - b. Description:
 - 1) Standard: ASSE 1079.
 - 2) Factory-fabricated, bolted, companion-flange assembly.

- 3) Pressure Rating: 125 psig minimum at 180 deg F.
 - 4) End Connections: Solder-joint copper alloy and threaded ferrous; threaded solder-joint copper alloy and threaded ferrous.
3. Dielectric-Flange Insulating Kits:
 - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - 1) Advance Products & Systems, Inc.
 - 2) Calpico, Inc.
 - 3) Central Plastics Company.
 - b. Description:
 - 1) Nonconducting materials for field assembly of companion flanges.
 - 2) Pressure Rating: 150 psig.
 - 3) Gasket: Neoprene or phenolic.
 - 4) Bolt Sleeves: Phenolic or polyethylene.
 - 5) Washers: Phenolic with steel backing washers.
4. Dielectric Nipples:
 - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - 1) Grinnell G-Fire by Johnson Controls Company.
 - 2) Matco-Norca.
 - 3) Victaulic Company.
 - b. Description:
 - 1) Standard: IAPMO PS 66.
 - 2) Electroplated steel nipple.
 - 3) Pressure Rating: 300 psig at 225 deg F.
 - 4) End Connections: Male threaded.
 - 5) Lining: Inert and noncorrosive, propylene.

PART 3 - EXECUTION

3.1 PIPING INSTALLATION

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems.
 1. Indicated locations and arrangements were used to size pipe and calculate friction loss, expansion, pump sizing, and other design considerations.
 2. Install piping as indicated unless deviations to layout are approved on coordination drawings.
- B. Install piping in concealed locations unless otherwise indicated and except in equipment rooms and service areas.
- C. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- D. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- E. Install piping to permit valve servicing.
- F. Install piping at indicated slopes.
- G. Install piping free of sags and bends.

- H. Install fittings for changes in direction and branch connections.
- I. Install piping to allow application of insulation.
- J. Make changes in direction for soil and waste drainage and vent piping using appropriate branches, bends, and long-sweep bends.
 - 1. Sanitary tees and short-sweep 1/4 bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical.
 - 2. Use long-turn, double Y-branch and 1/8-bend fittings if two fixtures are installed back to back or side by side with common drain pipe.
 - a. Straight tees, elbows, and crosses may be used on vent lines.
 - 3. Do not change direction of flow more than 90 degrees.
 - 4. Use proper size of standard increasers and reducers if pipes of different sizes are connected.
 - a. Reducing size of waste piping in direction of flow is prohibited.
- K. Lay buried building waste piping beginning at low point of each system.
 - 1. Install true to grades and alignment indicated, with unbroken continuity of invert. Place hub ends of piping upstream.
 - 2. Install required gaskets according to manufacturer's written instructions for use of lubricants, cements, and other installation requirements.
 - 3. Maintain swab in piping and pull past each joint as completed.
- L. Install soil and waste and vent piping at the following minimum slopes unless otherwise indicated:
 - 1. Building Sanitary Waste: 2 percent downward in direction of flow for piping NPS 3 and smaller; 1 percent downward in direction of flow for piping NPS 4 and larger.
 - 2. Horizontal Sanitary Waste Piping: 2 percent downward in direction of flow.
 - 3. Vent Piping: 1 percent down toward vertical fixture vent or toward vent stack.
- M. Install cast-iron soil piping according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings."
- N. Install aboveground copper tubing according to CDA's "Copper Tube Handbook."
- O. Plumbing Specialties:
 - 1. Install cleanouts at grade and extend to where building sanitary drains connect to building sanitary sewers in sanitary waste gravity-flow piping.
 - a. Comply with requirements for cleanouts specified in Section 22 1319 "Sanitary Waste Piping Specialties."
 - 2. Install drains in sanitary waste gravity-flow piping.
 - a. Comply with requirements for drains specified in Section 22 1319 "Sanitary Waste Piping Specialties."
- P. Do not enclose, cover, or put piping into operation until it is inspected and approved by authorities having jurisdiction.
- Q. Install sleeves for piping penetrations of walls, ceilings, and floors.
 - 1. Comply with requirements for sleeves specified in Section 22 0517 "Sleeves and Sleeve Seals for Plumbing Piping."
- R. Install sleeve seals for piping penetrations of concrete walls and slabs.
 - 1. Comply with requirements for sleeve seals specified in Section 22 0517 "Sleeves and Sleeve Seals for Plumbing Piping."
- S. Install escutcheons for piping penetrations of walls, ceilings, and floors.

3.2 JOINT CONSTRUCTION

- A. Join hub-and-spigot, cast-iron soil piping with gasket joints according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.
- B. Join hub-and-spigot, cast-iron soil piping with calked joints according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead-and-oakum calked joints.
- C. Join hubless, cast-iron soil piping according to CISPI 310 and CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless-piping coupling joints.
- D. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1.
 - 1. Cut threads full and clean using sharp dies.
 - 2. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:
 - a. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is specified.
 - b. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged.
 - c. Do not use pipe sections that have cracked or open welds.
- E. Join copper tube and fittings with soldered joints according to ASTM B 828. Use ASTM B 813, water-flushable, lead-free flux and ASTM B 32, lead-free-alloy solder.
- F. Flanged Joints: Align bolt holes. Select appropriate gasket material, size, type, and thickness. Install gasket concentrically positioned. Use suitable lubricants on bolt threads. Torque bolts in cross pattern.

3.3 SPECIALTY PIPE FITTING INSTALLATION

- A. Transition Couplings:
 - 1. Install transition couplings at joints of piping with small differences in ODs.
 - 2. In Waste Drainage Piping: Shielded, nonpressure transition couplings.
- B. Dielectric Fittings:
 - 1. Install dielectric fittings in piping at connections of dissimilar metal piping and tubing.
 - 2. Dielectric Fittings for NPS 2 and Smaller: Use dielectric nipples or unions.
 - 3. Dielectric Fittings for NPS 2-1/2 to NPS 4: Use dielectric flanges or flange kits.

3.4 VALVE INSTALLATION

- A. Comply with requirements in Section 22 0523.12 "Ball Valves for Plumbing Piping," Section 22 0523.13 "Butterfly Valves for Plumbing Piping," and Section 22 0523.14 "Check Valves for Plumbing Piping."

3.5 INSTALLATION OF HANGERS AND SUPPORTS

- A. Comply with requirements for pipe hanger and support devices and installation specified in Section 22 0529 "Hangers and Supports for Plumbing Piping and Equipment." And Section 22 0548.13 "Vibration Controls for Plumbing Piping and Equipment."
 - 1. Install carbon-steel pipe hangers for horizontal piping in noncorrosive environments.
 - 2. Install stainless-steel pipe hangers for horizontal piping in corrosive environments.
 - 3. Install carbon-steel pipe support clamps for vertical piping in noncorrosive environments.
 - 4. Install stainless-steel pipe support clamps for vertical piping in corrosive environments.
 - 5. Vertical Piping: MSS Type 8 or Type 42, clamps.
 - 6. Install individual, straight, horizontal piping runs:

- a. 100 Feet and Less: MSS Type 1, adjustable, steel clevis hangers.
- b. Longer Than 100 Feet: MSS Type 43, adjustable roller hangers.
- c. Longer Than 100 Feet if Indicated: MSS Type 49, spring cushion rolls.
- 7. Multiple, Straight, Horizontal Piping Runs 100 Feet or Longer: MSS Type 44, pipe rolls. Support pipe rolls on trapeze.
- 8. Base of Vertical Piping: MSS Type 52, spring hangers.

- B. Install hangers for cast-iron, steel, and copper soil piping, with maximum horizontal spacing and minimum rod diameters, to comply with MSS-58, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.
- C. Support horizontal piping and tubing within 12 inches of each fitting, valve, and coupling.
- D. Support vertical runs of cast iron, steel, and copper soil piping to comply with MSS-58, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.

3.6 CONNECTIONS

- A. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Connect soil and waste piping to exterior sanitary sewerage piping. Use transition fitting to join dissimilar piping materials.
- C. Connect waste and vent piping to the following:
 - 1. Plumbing Fixtures: Connect waste piping in sizes indicated, but not smaller than required by plumbing code.
 - 2. Plumbing Fixtures and Equipment: Connect atmospheric vent piping in sizes indicated, but not smaller than required by authorities having jurisdiction.
 - 3. Plumbing Specialties: Connect waste and vent piping in sizes indicated, but not smaller than required by plumbing code.
 - 4. Install test tees (wall cleanouts) in conductors near floor and floor cleanouts with cover flush with floor.
 - 5. Comply with requirements for cleanouts and drains specified in Section 22 1319 "Sanitary Waste Piping Specialties."
 - 6. Equipment: Connect waste piping as indicated.
 - a. Provide shutoff valve if indicated and union for each connection.
 - b. Use flanges instead of unions for connections NPS 2-1/2 and larger.
- D. Where installing piping adjacent to equipment, allow space for service and maintenance of equipment.
- E. Make connections according to the following unless otherwise indicated:
 - 1. Install unions, in piping NPS 2 and smaller, adjacent to each valve and at final connection to each piece of equipment.
 - 2. Install flanges, in piping NPS 2-1/2 and larger, adjacent to flanged valves and at final connection to each piece of equipment.

3.7 IDENTIFICATION

- A. Identify exposed sanitary waste and vent piping.
- B. Comply with requirements for identification specified in Section 22 0553 "Identification for Plumbing Piping and Equipment."

3.8 FIELD QUALITY CONTROL

- A. During installation, notify authorities having jurisdiction at least 24 hours before inspection must be made. Perform tests specified below in presence of authorities having jurisdiction.
 - 1. Roughing-in Inspection: Arrange for inspection of piping before concealing or closing-in after roughing-in and before setting fixtures.
 - 2. Final Inspection: Arrange for final inspection by authorities having jurisdiction to observe tests specified below and to ensure compliance with requirements.
- B. Reinspection: If authorities having jurisdiction find that piping will not pass test or inspection, make required corrections and arrange for reinspection.
- C. Reports: Prepare inspection reports and have them signed by authorities having jurisdiction.
- D. Test sanitary waste and vent piping according to procedures of authorities having jurisdiction or, in absence of published procedures, as follows:
 - 1. Test for leaks and defects in new piping and parts of existing piping that have been altered, extended, or repaired.
 - a. If testing is performed in segments, submit separate report for each test, complete with diagram of portion of piping tested.
 - 2. Leave uncovered and unconcealed new, altered, extended, or replaced waste and vent piping until it has been tested and approved.
 - a. Expose work that was covered or concealed before it was tested.
 - 3. Roughing-in Plumbing Test Procedure: Test waste and vent piping except outside leaders on completion of roughing-in.
 - a. Close openings in piping system and fill with water to point of overflow, but not less than 10-foot head of water.
 - b. From 15 minutes before inspection starts to completion of inspection, water level must not drop.
 - c. Inspect joints for leaks.
 - 4. Finished Plumbing Test Procedure: After plumbing fixtures have been set and traps filled with water, test connections and prove they are gastight and watertight.
 - a. Plug vent-stack openings on roof and building drains where they leave building. Introduce air into piping system equal to pressure of 1-inch wg.
 - b. Use U-tube or manometer inserted in trap of water closet to measure this pressure.
 - c. Air pressure must remain constant without introducing additional air throughout period of inspection.
 - d. Inspect plumbing fixture connections for gas and water leaks.
 - 5. Repair leaks and defects with new materials and retest piping, or portion thereof, until satisfactory results are obtained.
 - 6. Prepare reports for tests and required corrective action.

3.9 CLEANING AND PROTECTION

- A. Clean interior of piping. Remove dirt and debris as work progresses.
- B. Protect sanitary waste and vent piping during remainder of construction period to avoid clogging with dirt and debris and to prevent damage from traffic and construction work.
- C. Place plugs in ends of uncompleted piping at end of day and when work stops.
- D. Repair damage to adjacent materials caused by waste and vent piping installation.

3.10 PIPING SCHEDULE

- A. Flanges and unions may be used on aboveground pressure piping unless otherwise indicated.
- B. Aboveground, soil and waste piping NPS 4 and smaller shall be any of the following:
 - 1. Hubless, cast-iron soil pipe and fittings; CISPI hubless-piping couplings; and coupled joints.
 - 2. Copper Type DWV tube, copper drainage fittings, and soldered joints.
 - 3. Dissimilar Pipe-Material Couplings: Shielded, nonpressure transition couplings.
- C. Aboveground, vent piping NPS 4 and smaller shall be any of the following:
 - 1. Hubless, cast-iron soil pipe and fittings; CISPI hubless-piping couplings; and coupled joints.
 - 2. Copper Type DWV tube, copper drainage fittings, and soldered joints.
 - a. Option for Vent Piping, NPS 2-1/2 and NPS 3-1/2: Hard copper tube, Type M; copper pressure fittings; and soldered joints.
 - 3. Dissimilar Pipe-Material Couplings: Shielded, nonpressure transition couplings.
- D. Underground, soil, waste, and vent piping NPS 4 and smaller shall be the following:
 - 1. Service class, cast-iron soil piping; gaskets; and gasketed joints.
 - 2. Dissimilar Pipe-Material Couplings: Shielded, nonpressure transition couplings.

END OF SECTION 22 1316

SECTION 22 1319 - SANITARY WASTE PIPING SPECIALTIES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Cleanouts.
 - 2. Miscellaneous sanitary drainage piping specialties.
- B. Related Requirements:
 - 1. Section 07 8413 "Penetration Firestopping" for through-penetration firestop assemblies.

1.3 DEFINITIONS

- A. ABS: Acrylonitrile butadiene styrene.
- B. PVC: Polyvinyl chloride.

1.4 ACTION SUBMITTALS

- A. Product Data: For each type of product.

1.5 INFORMATIONAL SUBMITTALS

- A. Field quality-control reports.

1.6 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For sanitary waste piping specialties to include in emergency, operation, and maintenance manuals.

PART 2 - PRODUCTS

2.1 ASSEMBLY DESCRIPTIONS

- A. Sanitary waste piping specialties shall bear label, stamp, or other markings of specified testing agency.
- B. Comply with NSF 14 for plastic sanitary waste piping specialty components.

2.2 CLEANOUTS

A. Cast-Iron Exposed Cleanouts:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Jay R. Smith Mfg Co; a division of Morris Group International.
 - b. WATTS.
 - c. Zurn Industries, LLC.
2. Standard: ASME A112.36.2M.
3. Size: Same as connected drainage piping
4. Body Material: Hubless, cast-iron soil pipe test tee as required to match connected piping.
5. Closure: Countersunk or raised-head, brass plug.
6. Closure Plug Size: Same as or not more than one size smaller than cleanout size.

B. Cast-Iron Exposed Floor Cleanouts:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Jay R. Smith Mfg Co; a division of Morris Group International.
 - b. WATTS.
 - c. Zurn Industries, LLC.
2. Standard: ASME A112.36.2M for adjustable housing threaded, adjustable housing cleanout.
3. Size: Same as connected branch.
4. Type: Adjustable housing.
5. Body or Ferrule: Cast iron.
6. Clamping Device: Not required.
7. Outlet Connection: Inside calk.
8. Closure: Brass plug with straight threads and gasket.
9. Adjustable Housing Material: Cast iron with threads.
10. Frame and Cover Material and Finish: Nickel-bronze, copper alloy.
11. Frame and Cover Shape: Round.
12. Cover type: To match adjacent flooring: Carpet marker for carpeted areas, 1/8 inch recessed for tile, 1-1/4 inch recess for terrazzo, flush top for concrete areas.
13. Top-Loading Classification: Medium Duty in occupied spaces and heavy duty in laboratories, service areas, and mechanical spaces.
14. Riser: ASTM A74, Service Class, cast-iron drainage pipe fitting and riser to cleanout.

C. Cast-Iron Wall Cleanouts:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Jay R. Smith Mfg Co; a division of Morris Group International.
 - b. WATTS.
 - c. Zurn Industries, LLC.
2. Standard: ASME A112.36.2M. Include wall access.
3. Size: Same as connected drainage piping.
4. Body: Hubless, cast-iron soil pipe test tee as required to match connected piping.
5. Closure Plug:
 - a. Brass.
 - b. Countersunk head.
 - c. Drilled and threaded for cover attachment screw.
 - d. Size: Same as or not more than one size smaller than cleanout size.

6. Wall Access, Cover Plate: Round, flat, chrome-plated brass or stainless steel cover plate with screw.
7. Wall Access, Frame and Cover: Round, nickel-bronze, copper-alloy, or stainless steel wall-installation frame and cover.

2.3 MISCELLANEOUS SANITARY DRAINAGE PIPING SPECIALTIES

- A. Open Drains:
 1. Description: Shop or field fabricate from ASTM A74, Service Class, hub-and-spigot, cast-iron soil-pipe fittings. Include P-trap, hub-and-spigot riser section; and where required, increaser fitting joined with ASTM C564 rubber gaskets.
 2. Size: Same as connected waste piping with increaser fitting of size indicated.
- B. Deep-Seal Traps:
 1. Description: Cast-iron or bronze casting, with inlet and outlet matching connected piping and cleanout trap-seal primer valve connection.
 2. Size: Same as connected waste piping.
 - a. NPS 2: 4-inch-minimum water seal.
 - b. NPS 2-1/2 and Larger: 5-inch-minimum water seal.
- C. Air-Gap Fittings:
 1. Standard: ASME A112.1.2, for fitting designed to ensure fixed, positive air gap between installed inlet and outlet piping.
 2. Body: Bronze or cast iron.
 3. Inlet: Opening in top of body.
 4. Outlet: Larger than inlet.
 5. Size: Same as connected waste piping and with inlet large enough for associated indirect waste piping.
- D. Sleeve Flashing Device:
 1. Description: Manufactured, cast-iron fitting, with clamping device that forms sleeve for pipe floor penetrations of floor membrane. Include galvanized-steel pipe extension in top of fitting that will extend 2 inches above finished floor and galvanized-steel pipe extension in bottom of fitting that will extend through floor slab.
 2. Size: As required for close fit to riser or stack piping.
- E. Stack Flashing Fittings:
 1. Description: Counterflashing-type, cast-iron fitting, with bottom recess for terminating roof membrane, and with threaded or hub top for extending vent pipe.
 2. Size: Same as connected stack vent or vent stack.
- F. Vent Caps:
 1. Description: Cast-iron body with threaded or hub inlet and vandal-proof design. Include vented hood and setscrews to secure to vent pipe.
 2. Size: Same as connected stack vent or vent stack.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install cleanouts in aboveground piping and building drain piping according to the following, unless otherwise indicated:

1. Size same as drainage piping up to NPS 4. Use NPS 4 for larger drainage piping unless larger cleanout is indicated.
 2. Locate at each change in direction of piping greater than 45 degrees.
 3. Locate at minimum intervals of 50 feet for piping NPS 4 and smaller and 100 feet for larger piping.
 4. Locate at base of each vertical soil and waste stack.
- B. For floor cleanouts for piping below floors, install cleanout deck plates with top flush with finished floor.
- C. For cleanouts located in concealed piping, install cleanout wall access covers, of types indicated, with frame and cover flush with finished wall.
- D. Assemble open drain fittings and install with top of hub 2 inches above floor.
- E. Install deep-seal traps on floor drains and other waste outlets, unless otherwise indicated.
- F. Install air-gap fittings on draining-type backflow preventers and on indirect-waste piping discharge into sanitary drainage system.
- G. Install sleeve and sleeve seals with each riser and stack passing through floors with waterproof membrane.
- H. Install vent caps on each vent pipe passing through roof.
- I. Install expansion joints on vertical stacks and conductors. Position expansion joints for easy access and maintenance.
- J. Install wood-blocking reinforcement for wall-mounting-type specialties.
- K. Install traps on plumbing specialty drain outlets. Omit traps on indirect wastes unless trap is indicated.

3.2 PIPING CONNECTIONS

- A. Comply with requirements in Section 22 1316 "Sanitary Waste and Vent Piping" for piping installation requirements. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Install piping adjacent to equipment, to allow service and maintenance.

3.3 LABELING AND IDENTIFYING

- A. Distinguish among multiple units, inform operator of operational requirements, indicate safety and emergency precautions, and warn of hazards and improper operations, in addition to identifying unit.

3.4 PROTECTION

- A. Protect drains during remainder of construction period to avoid clogging with dirt or debris and to prevent damage from traffic or construction work.

- B. Place plugs in ends of uncompleted piping at end of each day or when work stops.

END OF SECTION 22 1319

SECTION 22 1319.13 - SANITARY DRAINS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Floor drains.
 - 2. Floor sinks.

1.3 DEFINITIONS

- A. ABS: Acrylonitrile-butadiene styrene.
- B. FRP: Fiberglass-reinforced plastic.
- C. HDPE: High-density polyethylene.
- D. PE: Polyethylene.
- E. PP: Polypropylene.
- F. PVC: Polyvinyl chloride.

1.4 ACTION SUBMITTALS

- A. Product Data: For each type of product.

PART 2 - PRODUCTS

2.1 DRAIN ASSEMBLIES

- A. Sanitary drains shall bear label, stamp, or other markings of specified testing agency.
- B. Comply with NSF 14 for plastic sanitary piping specialty components.

2.2 FLOOR DRAINS

- A. Cast-Iron Floor Drains:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Jay R. Smith Mfg Co; a division of Morris Group International.
 - b. WATTS.
 - c. Zurn Industries, LLC.
2. Standard: ASME A112.6.3.
3. Pattern: Floor drain.
4. Body Material: Gray iron.
5. Seepage Flange: Not required.
6. Anchor Flange: Required.
7. Clamping Device: Required.
8. Outlet: Bottom.
9. Backwater Valve: Not required.
10. Coating on Interior and Exposed Exterior Surfaces: Acid-resistant enamel.
11. Sediment Bucket: Not required unless noted on the plans.
12. Top or Strainer Material: Nickel bronze.
13. Top of Body and Strainer Finish: Nickel bronze.
14. Top Shape: See schedule.
15. Funnel: See schedule.
16. Inlet Fitting: Not required.
17. Trap Material: Cast iron.
18. Trap Pattern: Deep-seal P-trap.
19. Trap Features: Trap-seal primer valve drain connection .

2.3 FLOOR SINKS

A. Cast-Iron Floor Sinks:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Jay R. Smith Mfg Co; a division of Morris Group International.
 - b. WATTS.
 - c. Zurn Industries, LLC.
2. Standard: ASME A112.6.7.
3. Pattern: Floor drain.
4. Body Material: Cast iron.
5. Anchor Flange: Required.
6. Clamping Device: Required.
7. Outlet: Bottom, no-hub connection.
8. Coating on Interior Surfaces: Acid-resistant enamel.
9. Sediment Bucket: Not required unless noted otherwise on plans.
10. Internal Strainer: Dome.
11. Internal Strainer Material: Aluminum.
12. Top Grate Material: Cast iron, loose.
13. Top of Body and Grate Finish: Acid-resistant enamel.
14. Top Shape: Square.
15. Funnel: Not required..

B. Stainless-Steel Floor Sinks, ASME A112.6.7 FS-1:

1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. Jay R. Smith Mfg Co; a division of Morris Group International.
 - b. Mifab, Inc.

- c. Wade; a subsidiary of McWane Inc.
- d. WATTS.
- e. Zurn Industries, LLC.
- 2. Standard: ASME A112.6.7.
- 3. Pattern: Floor drain.
- 4. Body Material: Stainless steel.
- 5. Anchor Flange: Required , with seepage holes.
- 6. Clamping Device: Required.
- 7. Outlet: Bottom, no-hub connection.
- 8. Sediment Bucket: Not required.
- 9. Internal Strainer: Dome.
- 10. Internal Strainer Material: Stainless steel.
- 11. Top Grate Material: Stainless steel, loose.
- 12. Top of Body and Grate Finish: Stainless steel.
- 13. Top Shape: Square.
- 14. Dimensions of Top Grate: 3/4 grate.
- 15. Top Loading Classification: No traffic.
- 16. Funnel: Not required..

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install floor drains at low points of surface areas to be drained. Set grates of drains flush with finished floor, unless otherwise indicated.
 - 1. Position floor drains for easy access and maintenance.
 - 2. Set floor drains below elevation of surrounding finished floor to allow floor drainage.
 - 3. Set with grates depressed according to the following drainage area radii:
 - a. Radius, 30 Inches or Less: Equivalent to 1 percent slope, but not less than 1/4-inch total depression.
 - b. Radius, 30 to 60 Inches: Equivalent to 1 percent slope.
 - c. Radius, 60 Inches or Larger: Equivalent to 1 percent slope, but not greater than 1-inch total depression.
 - 4. Install floor-drain flashing collar or flange, so no leakage occurs between drain and adjoining flooring.
 - a. Maintain integrity of waterproof membranes where penetrated.
 - 5. Install individual traps for floor drains connected to sanitary building drain, unless otherwise indicated.
- B. Install trench drains at low points of surface areas to be drained.
 - 1. Set grates of drains flush with finished surface, unless otherwise indicated.
- C. Comply with ASME A112.3.1 for installation of stainless-steel channel drainage systems.
 - 1. Install on support devices, so that top will be flush with adjacent surface.
- D. Install open drain fittings with top of hub 2 inches above floor.

3.2 CONNECTIONS

- A. Comply with requirements in Section 22 1316 "Sanitary Waste and Vent Piping" for piping installation requirements. Drawings indicate general arrangement of piping, fittings, and specialties.

- B. Comply with requirements in Section 22 1319 "Sanitary Waste Piping Specialties" for backwater valves, air admittance devices and miscellaneous sanitary drainage piping specialties.
- C. Install piping adjacent to equipment to allow service and maintenance.

3.3 PROTECTION

- A. Protect drains during remainder of construction period to avoid clogging with dirt or debris and to prevent damage from traffic or construction work.
- B. Place plugs in ends of uncompleted piping at end of each day or when work stops.

END OF SECTION 22 1319.13

SECTION 22 4213.13 - COMMERCIAL WATER CLOSETS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Wall-mounted water closets.
 - 2. Flushometer valves.
 - 3. Toilet seats.
 - 4. Supports.

1.2 DEFINITIONS

- A. High-Efficiency Flush Volume: 1.28 gal. or less per flush.
- B. WaterSense Fixture: Water closet and/or flushometer valve/tank certified by the EPA to meet the WaterSense performance criteria.

1.3 ACTION SUBMITTALS

- A. Product Data:
 - 1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for water closets.
 - 2. Include rated capacities, operating characteristics, electrical characteristics, and furnished specialties and accessories.
 - 3. WaterSense certification for commercial water closets.
- B. Shop Drawings: Include diagrams for power and control wiring.

1.4 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For flushometer valves and electronic sensors to include in operation and maintenance manuals.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Standards:
 - 1. Comply with ASME A112.19.2/CSA B45.1 for water closets.
 - 2. Comply with ASME A112.19.5/CSA B45.15 for flush valves and spuds for water closets and tanks.
 - 3. Comply with ASSE 1037/ASME A112.1037/CSA B125.37 for flush valves.
 - 4. Comply with IAMPO/ANSI Z124.5 for water-closet (toilet) seats.
 - 5. Comply with ASME A112.6.1M for water-closet supports.
 - 6. Comply with ICC A117.1 for ADA-compliant water closets.
 - 7. Comply with ASTM A1045 for flexible PVC gaskets used in connection of vitreous china water closets to sanitary drainage systems.
 - 8. Comply with ASME A112.4.3 for plastic fittings used in connection of vitreous china water closets to sanitary drainage systems.

2.2 WALL-MOUNTED WATER CLOSETS

- A. Water Closets - Wall Mounted, Top Spud P-1.

1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. Kohler Co.
 - b. TOTO USA, INC.
 - c. Zurn Industries, LLC.
2. Source Limitations: Obtain water closets from single source from single manufacturer.
3. Bowl:
 - a. Material: Vitreous china.
 - b. Type: Siphon jet.
 - c. Style: Flushometer valve.
 - d. Mounting Height: Standard.
 - e. Rim Contour: Elongated.
 - f. Water Consumption: 1.28 gal. per flush.
 - g. Spud Size and Location: NPS 1-1/2; top.
 - h. Color: White.
4. Flushometer Valve: P-1 and P-2.
5. Toilet Seat: P-1 and P-2.
6. Support: Water-closet carrier.

B. Water Closets - Wall Mounted, Top Spud P-2; accessible.

1. Same as P-1 except mounted at ADA height.

2.3 FLUSHOMETER VALVES

- A. Flushometer Valves – Hydropower, electronic, Sensor Operated, Battery Powered: P-1 and P-2.
1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings:
 2. Source Limitations: Obtain flushometer valve from single source from single manufacturer.
 3. Minimum Pressure Rating: 125 psig.
 4. Features: Include integral check stop and backflow-prevention device.
 5. Material: Brass body with corrosion-resistant components.
 6. Style: Exposed.
 7. Exposed Flushometer-Valve Finish: Chrome-plated.
 8. Panel Finish: Chrome-plated or stainless steel.
 9. Actuator: Piston valve and solenoid with self-cleaning mechanism.
 10. Trip Mechanism: Battery-powered electronic sensor; listed and labeled as defined in NFPA 70, by qualified testing agency, and marked for intended location and application.
 11. Consumption: 1.28 gal. per flush.
 12. Minimum Inlet: NPS 1.
 13. Minimum Outlet: NPS 1-1/4.

2.4 TOILET SEATS

- A. Toilet Seats: P-1 and P-2.
1. Basis-of-Design Product: Subject to compliance with requirements, provide Bemis Manufacturing Company; 1655SSCT or a comparable product by one of the following:
 - a. American Standard.
 - b. Church Seats; Bemis Manufacturing Company.
 - c. Kohler Co.
 - d. TOTO USA, INC.
 2. Source Limitations: Obtain toilet seat from single source from single manufacturer.
 3. Material: Plastic.
 4. Type: Commercial (Heavy duty).
 5. Shape: Elongated rim, open front.

6. Hinge: Self-sustaining, check.
7. Hinge Material: Noncorroding metal.
8. Seat Cover: Not required.
9. Color: White.
10. Surface Treatment: Not required.

2.5 SUPPORTS

A. Water-Closet Carrier:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Jay R. Smith Mfg Co; a division of Morris Group International.
 - b. WATTS.
 - c. Zurn Industries, LLC.
2. Source Limitations: Obtain water-closet carrier from single source from single manufacturer.
3. Description: Waste-fitting assembly, as required to match drainage piping material and arrangement with faceplates, couplings gaskets, and feet; bolts and hardware matching fixture. Include additional extension coupling, faceplate, and feet for installation in wide pipe space.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine roughing-in for water-supply piping and sanitary drainage and vent piping systems to verify actual locations of piping connections before water-closet installation.
- B. Examine walls and floors for suitable conditions where water closets will be installed.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION, GENERAL

A. Water-Closet Installation:

1. Install level and plumb.
2. Install floor-mounted water closets on bowl-to-drain connecting fitting attachments to piping or building substrate.
3. Install accessible, wall-mounted water closets at mounting height in accordance with ICC A117.1.

B. Support Installation:

1. Install supports, affixed to building substrate, for floor-mounted, back-outlet water closets.
2. Use carrier supports with waste-fitting assembly and seal.
3. Install floor-mounted, back-outlet water closets attached to building floor substrate, onto waste-fitting seals; and attach to support.
4. Install wall-mounted, back-outlet water-closet supports with waste-fitting assembly and waste-fitting seals; and affix to building substrate.
5. Measure support height installation from finished floor, not structural floor.

C. Flushometer-Valve Installation:

1. Install flushometer-valve, water-supply fitting on each supply to each water closet.
2. Attach supply piping to supports or substrate within pipe spaces behind fixtures.

3. Install lever-handle flushometer valves for accessible water closets with handle mounted on open side of water closet.
4. Install actuators in locations easily reachable for people with disabilities.
5. Install new batteries in battery-powered, electronic-sensor mechanisms.

D. Install toilet seats on water closets.

E. Wall Flange and Escutcheon Installation:

1. Install wall flanges or escutcheons at piping wall penetrations in exposed, finished locations and within cabinets and millwork.
2. Install deep-pattern escutcheons if required to conceal protruding fittings.
3. Comply with escutcheon requirements specified in Section 22 0518 "Escutcheons for Plumbing Piping."

F. Joint Sealing:

1. Seal joints between water closets and walls and floors using sanitary-type, one-part, mildew-resistant silicone sealant.
2. Match sealant color to water-closet color.
3. Comply with sealant requirements specified in Section 07 9200 "Joint Sealants."

3.3 PIPING CONNECTIONS

- A. Connect water closets with water supplies and soil, waste, and vent piping. Use size fittings required to match water closets.
- B. Comply with water piping requirements specified in Section 22 1116 "Domestic Water Piping."
- C. Comply with soil and waste piping requirements specified in Section 22 1316 "Sanitary Waste and Vent Piping."
- D. Where installing piping adjacent to water closets, allow space for service and maintenance.

3.4 ADJUSTING

- A. Operate and adjust water closets and controls. Replace damaged and malfunctioning water closets, fittings, and controls.
- B. Adjust water pressure at flushometer valves to produce proper flow.
- C. Install new batteries in battery-powered, electronic-sensor mechanisms.

3.5 CLEANING AND PROTECTION

- A. Clean water closets and fittings with manufacturers' recommended cleaning methods and materials.
- B. Install protective covering for installed water closets and fittings.
- C. Do not allow use of water closets for temporary facilities unless approved in writing by Owner.

END OF SECTION 22 4213.13

SECTION 22 4213.16 - COMMERCIAL URINALS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Wall-hung urinals.
 - 2. Urinal flushometer valves.
 - 3. Supports.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.
 - 1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for urinals.
 - 2. Include rated capacities, operating characteristics, electrical characteristics, and furnished specialties and accessories.

1.4 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For flushometer valves and electronic sensors to include in operation and maintenance manuals.

PART 2 - PRODUCTS

2.1 STALL URINALS

2.2 WALL-HUNG URINALS

- A. Urinals - Wall Hung, Back Outlet, Washout: P-3.
 - 1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. Kohler Co.
 - b. TOTO USA, INC.
 - c. Zurn Industries, LLC.
 - 2. Fixture:
 - a. Standards: ASME A112.19.2/CSA B45.1 and ASME A112.19.5/CSA B45.15.
 - b. Material: Vitreous china.
 - c. Type: Washout with extended shields.
 - d. Strainer or Trapway: Manufacturer's standard strainer with integral trap.
 - e. Water Consumption: 0.125 gpf.

- f. Spud Size and Location: NPS 3/4, top.
 - g. Outlet Size and Location: NPS 2, back.
 - h. Color: White.
 3. Flushometer Valve: P-3 and P-4.
 4. Waste Fitting:
 - a. Standard: ASME A112.18.2/CSA B125.2 for coupling.
 - b. Size: NPS 2.
 5. Support: Type II urinal carrier with fixture support plates and coupling with seal and fixture bolts and hardware matching fixture. Include rectangular, steel uprights.
 6. Urinal Mounting Height: Standard.
- B. Urinals - Wall Hung, Back Outlet, Washout: Accessible P-4.
 1. Same as P-3 except mounted at ADA height

2.3 URINAL FLUSHOMETER VALVES

- A. Hydropower, Electronic Flushometer Valves: P-3 and P-4.
 1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings:
 2. Standard: ASSE 1037/ASME 112.1037/CSA B125.37.
 3. Minimum Pressure Rating: 125 psig.
 4. Features: Include integral check stop and backflow-prevention device.
 5. Material: Brass body with corrosion-resistant components.
 6. Exposed Flushometer-Valve Finish: Chrome plated.
 7. Panel Finish: Chrome plated or stainless steel.
 8. Style: Exposed.
 9. Actuator: Actuator: Piston valve and solenoid with self-cleaning mechanism. Solenoid complying with UL 1951; listed and labeled as defined in NFPA 70, by a qualified testing agency; and marked for intended location and application.
 10. Trip Mechanism: Battery-powered electronic sensor complying with UL 1951; listed and labeled as defined in NFPA 70, by a qualified testing agency; and marked for intended location and application.
 11. Consumption: 0.125 gal. per flush.
 12. Minimum Inlet: NPS 3/4.
 13. Minimum Outlet: NPS 3/4.

2.4 SUPPORTS

- A. Type II Urinal Carrier:
 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Jay R. Smith Mfg Co; a division of Morris Group International.
 - b. WATTS.
 - c. Zurn Industries, LLC.
 2. Standard: ASME A112.6.1M.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine roughing-in of water supply and sanitary drainage and vent piping systems to verify actual locations of piping connections before urinal installation.
- B. Examine walls and floors for suitable conditions where urinals will be installed.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Urinal Installation:
 - 1. Install urinals level and plumb according to rough-in drawings.
 - 2. Install wall-hung, back-outlet urinals onto waste fitting seals and attached to supports.
 - 3. Install accessible, wall-mounted urinals at mounting height for the handicapped/elderly, according to ICC A117.1.
- B. Support Installation:
 - 1. Install supports, affixed to building substrate, for wall-hung urinals.
- C. Flushometer-Valve Installation:
 - 1. Install flushometer-valve water-supply fitting on each supply to each urinal.
 - 2. Attach supply piping to supports or substrate within pipe spaces behind fixtures.
 - 3. Install lever-handle flushometer valves for accessible urinals with handle mounted on open side of compartment.
 - 4. Install fresh batteries in battery-powered, electronic-sensor mechanisms.
- D. Wall Flange and Escutcheon Installation:
 - 1. Install wall flanges or escutcheons at piping wall penetrations in exposed, finished locations.
 - 2. Install deep-pattern escutcheons if required to conceal protruding fittings.
 - 3. Comply with escutcheon requirements specified in Section 22 0518 "Escutcheons for Plumbing Piping."
- E. Joint Sealing:
 - 1. Seal joints between urinals and walls and floors using sanitary-type, one-part, mildew-resistant silicone sealant.
 - 2. Match sealant color to urinal color.
 - 3. Comply with sealant requirements specified in Section 07 9200 "Joint Sealants."

3.3 PIPING CONNECTIONS

- A. Connect urinals with water supplies and soil, waste, and vent piping. Use size fittings required to match urinals.
- B. Comply with water piping requirements specified in Section 22 1116 "Domestic Water Piping."
- C. Comply with soil and waste piping requirements specified in Section 22 1316 "Sanitary Waste and Vent Piping."

- D. Where installing piping adjacent to urinals, allow space for service and maintenance.

3.4 ADJUSTING

- A. Operate and adjust urinals and controls. Replace damaged and malfunctioning urinals, fittings, and controls.
- B. Adjust water pressure at flushometer valves to produce proper flow.
- C. Install fresh batteries in battery-powered, electronic-sensor mechanisms.

3.5 CLEANING AND PROTECTION

- A. Clean urinals and fittings with manufacturers' recommended cleaning methods and materials.
- B. Install protective covering for installed urinals and fittings.
- C. Do not allow use of urinals for temporary facilities unless approved in writing by Owner.

END OF SECTION 22 4213.16

SECTION 22 4216.13 - COMMERCIAL LAVATORIES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Automatically operated lavatory faucets.
 - 2. Supply fittings.
 - 3. Waste fittings.
- B. Related Requirements:
 - 1. Section 22 1119 "Domestic Water Piping Specialties" for water temperature limiting devices located at each fixture.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.
 - 1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for lavatories.
 - 2. Include rated capacities, operating characteristics, electrical characteristics, and furnished specialties and accessories.

1.4 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Counter cutout templates for mounting of counter-mounted lavatories.

1.5 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For lavatories and faucets to include in operation and maintenance manuals.
 - 1. In addition to items specified in Section 01 7823 "Operation and Maintenance Data," include the following:
 - a. Servicing and adjustments of automatic faucets.

PART 2 - PRODUCTS

2.1 VITREOUS-CHINA, COUNTER-MOUNTED LAVATORIES

- A. Lavatory - Undercounter Mounted P-5:
 - 1. **Integral** fixture by countertop manufacturer.
 - 2. Faucet: P5.

2.2 AUTOMATICALLY OPERATED LAVATORY FAUCETS

- A. Lavatory faucets intended to convey or dispense water for human consumption are to comply with the U.S. Safe Drinking Water Act (SDWA), requirements of the Authority Having Jurisdiction (AHJ), and with NSF 61/NSF 372, or be certified in compliance with NSF 61/NSF 372 by an American National Standards Institute (ANSI) accredited third-party certification body, that the weighted average lead content at wetted surfaces is less than or equal to 0.25 percent.
- B. Lavatory Faucets - Automatic Type: Battery Powered Electronic Sensor Operated, Mixing, P-5:
 - 1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. American Standard.
 - b. Bradley Corporation.
 - c. Chicago Faucets; Geberit Company.
 - d. Kohler Co.
 - e. Sloan Valve Company.
 - f. T&S Brass and Bronze Works, Inc.
 - g. TOTO USA, INC.
 - 2. Standards: ASME A112.18.1/CSA B125.1 and UL 1951.
 - 3. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
 - 4. General: Coordinate faucet inlets with supplies and fixture hole punchings; coordinate outlet with spout and fixture receptor.
 - 5. Body Type: Single hole.
 - 6. Body Material: Commercial, solid-brass, or die-cast housing with brazed copper and brass waterway.
 - 7. Finish: Polished chrome plate.
 - 8. Maximum Flow Rate: 0.5 gpm.
 - 9. Mounting Type: Deck, concealed.
 - 10. Spout: Rigid type.
 - 11. Spout Outlet: Aerator.
 - 12. Drain: Not part of faucet.
 - 13. Water Temperature Limiting Device: ASSE 1070.

2.3 SUPPLY FITTINGS

- A. NSF Standard: Comply with NSF 61 and NSF 372 for supply-fitting materials that will be in contact with potable water.
- B. Standard: ASME A112.18.1/CSA B125.1.
- C. Supply Piping: Chrome-plated-brass pipe or chrome-plated copper tube matching water-supply piping size. Include chrome-plated-brass or stainless-steel wall flange.
- D. Supply Stops: Chrome-plated-brass, one-quarter-turn, ball-type or compression valve with inlet connection matching supply piping.
- E. Operation: Loose key.
- F. Risers:
 - 1. NPS 1/2.
 - 2. ASME A112.18.6/CSA B125.6, braided- or corrugated-stainless steel, flexible hose riser.

2.4 WASTE FITTINGS

- A. Standard: ASME A112.18.2/CSA B125.2.
- B. Drain: Grid type with NPS 1-1/4 offset and straight tailpiece.
- C. Trap:
 - 1. Size: NPS 1-1/2 by NPS 1-1/4.
 - 2. Material:
 - a. Chrome-plated, two-piece, cast-brass trap and swivel elbow with 0.032-inch-thick brass tube to wall; and chrome-plated, brass or steel wall flange.
 - b. Stainless steel, two-piece trap and swivel elbow with 0.012-inch thick stainless steel tube to wall, and stainless steel wall flange.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine roughing-in of water supply and sanitary drainage and vent piping systems to verify actual locations of piping connections before lavatory installation.
- B. Examine counters and walls for suitable conditions where lavatories will be installed.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Install lavatories level and plumb in accordance with roughing-in drawings.
- B. Install supports, affixed to building substrate, for wall-mounted lavatories.
- C. Install accessible wall-mounted lavatories at handicapped/elderly mounting height for people with disabilities or the elderly, in accordance with ICC A117.1.
- D. Install wall flanges or escutcheons at piping wall penetrations in exposed, finished locations. Use deep-pattern escutcheons if required to conceal protruding fittings. Comply with escutcheon requirements specified in Section 22 0518 "Escutcheons for Plumbing Piping."
- E. Seal joints between lavatories, counters, and walls using sanitary-type, one-part, mildew-resistant silicone sealant. Match sealant color to fixture color. Comply with sealant requirements specified in Section 07 9200 "Joint Sealants."
- F. Install protective shielding pipe covers and enclosures on exposed supplies and waste piping of accessible lavatories. Comply with requirements in Section 22 0719 "Plumbing Piping Insulation."

3.3 PIPING CONNECTIONS

- A. Connect fixtures with water supplies, stops, and risers, and with traps, soil, waste, and vent piping. Use size fittings required to match fixtures.

- B. Comply with water piping requirements specified in Section 22 1116 "Domestic Water Piping."
- C. Comply with soil and waste piping requirements specified in Section 22 1316 "Sanitary Waste and Vent Piping."

3.4 ADJUSTING

- A. Operate and adjust lavatories and controls. Replace damaged and malfunctioning lavatories, fittings, and controls.
- B. Install new batteries in battery-powered, electronic-sensor mechanisms.

3.5 CLEANING AND PROTECTION

- A. After completing installation of lavatories, inspect and repair damaged finishes.
- B. Clean lavatories, faucets, and other fittings with manufacturers' recommended cleaning methods and materials.
- C. Provide protective covering for installed lavatories and fittings.
- D. Do not allow use of lavatories for temporary facilities unless approved in writing by Owner.

END OF SECTION 22 4216.13

SECTION 22 4713 - DRINKING FOUNTAINS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Drinking fountains.
 - 2. Bottle filling stations.
 - 3. Remote water coolers.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of drinking fountain and bottle filling station.
 - 1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes.
 - 2. Include operating characteristics, and furnished specialties and accessories.
- B. Shop Drawings:
 - 1. Include diagrams for power wiring.

1.4 CLOSEOUT SUBMITTALS

- A. Maintenance Data: For drinking fountains and bottle filling stations to include in maintenance manuals.

1.5 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 - 1. Filter Cartridges: 2 extra filters..

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Standards:
 - 1. Drinking fountains and bottle filling stations intended to convey or dispense water for human consumption are to comply with the U.S. Safe Drinking Water Act (SDWA), requirements of the Authority Having Jurisdiction (AHJ), and with NSF 61 or NSF 372, or be certified in compliance with NSF 61 or NSF 372 by an ANSI-accredited third-party certification body, that the weighted average lead content at wetted surfaces is less than or equal to 0.25 percent.
 - 2. Comply with ASME A112.19.3/CSA B45.4 for stainless steel drinking fountains and bottle filling stations.
 - 3. Comply with NSF 42 and NSF 53 for water filters for drinking fountains and bottle filling stations.
 - 4. Comply with ICC A117.1 for accessible drinking fountains and bottle filling stations.

2.2 DRINKING FOUNTAINS

- A. Drinking Fountains - Recessed, Wall-Mounted, Powder-Coated Metal: P-6.
1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings.
 2. With integral bottle filler. See article "Bottle Filling Station – Recessed, Powder-Coated Stainless-steel.
 3. Finish Color: Selected by Architect.
 4. Receptor(s):
 - a. Type: On horizontal support.
 - b. Shape: Round.
 - c. Back Panel: Stainless steel wall plate behind drinking fountain.
 - d. Bubblers: One for each receptor, with adjustable stream regulator, located on deck.
 - e. Drain: Grid type with NPS 1-1/4 tailpiece.
 5. Maximum Water Flow: 0.5 gpm.
 6. Control: Push button.
 7. Supply: NPS 3/8 with shutoff valve.
 8. Waste Fitting: ASME A112.18.2/CSA B125.2, NPS 1-1/4 chrome-plated brass P-trap and waste.
 9. Filter: One or more water filters with capacity sized for unit peak flow rate.
 10. Support: Provide manufacturer's mounting plate and drinking fountain carrier.
 11. Drinking Fountain Mounting Height: High/low - standard/accessible in accordance with ICC A117.1.

2.3 BOTTLE FILLING STATIONS

- A. Bottle Filling Station - Recessed, Wall-Mounted, Powder-Coated Metal: P-6.
1. Cabinet: Powder-coated Stainless-steel.
 2. Finish Color: Selected by Architect.
 3. Bottle Filler: Battery Operated Sensor activation. Fill rate 0.5 to 1.5 gpm.
 4. Drain: Grid type with NPS 1-1/4 tailpiece.
 5. Supply: NPS 3/8 with shutoff valve.
 6. Waste Fitting: ASME A112.18.2/CSA B125.2, NPS 1-1/4 brass P-trap.
 7. Filter: One or more water filters complying with NSF 42 and NSF 53 and with capacity sized for peak flow rate.
 8. Support: Provide manufacturer's frame attached to substrate.
 9. Bottle Filling Station Mounting Height: Accessible in accordance with ICC A117.1.

2.4 REMOTE WATER COOLERS

- A. Remote Water Coolers P-6:
1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings.
 2. Description: Remote water-cooling chiller unit serving cooled water to drinking water fountains or bottle filling stations.
 3. Standards:
 - a. NSF 61.
 - b. NSF 372.
 - c. UL 399.
 - d. ASHRAE 18.
 - e. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
 4. Refrigerant: R134a or R513A.
 5. Chassis: Galvanized or corrosion-resistant coated steel.

6. Chiller: Hermetically sealed compressor, cooling coil, air-cooled condensing unit, corrosion-resistant tubing, and refrigerant.
7. Storage Tank: 0.5 gal. stainless steel.
8. Controls: Adjustable thermostat.
9. Ventilation Grille: Galvanized steel.
10. Filter: One or more water filters with capacity sized for unit peak flow rate.
 - a. Standards:
 - 1) NSF 42.
 - 2) NSF 53.
11. Capacities and Characteristics:
 - a. Cooled Water: 8 gph.
 - b. Ambient-Air Temperature: 90 deg F.
 - c. Inlet-Water Temperature: 80 deg F
 - d. Cooled-Water Temperature: 50 deg F.
 - e. Electrical Characteristics:
 - 1) Motor Horsepower: 1/4.
 - 2) Volts: 120 V ac.
 - 3) Phase: Single.
 - 4) Hertz: 60.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine roughing-in for water-supply and sanitary drainage and vent piping systems to verify actual locations of piping connections before fixture installation.
- B. Examine walls and floors for suitable conditions where fixtures will be installed.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Install fixtures level and plumb according to roughing-in drawings. For fixtures indicated for children, install at height required by authorities having jurisdiction.
- B. Install recessed, drinking fountains and bottle filling stations secured to wood blocking in wall construction.
- C. Install off-the-floor carrier supports, affixed to building substrate, for wall-mounted fixtures.
- D. Install water-supply piping with shutoff valve on supply to each fixture to be connected to domestic-water distribution piping. Use ball valve. Install valves in locations where they can be easily reached for operation. Valves are specified in Section 22 0523.12 "Ball Valves for Plumbing Piping"
- E. Install trap and waste piping on drain outlet of each fixture to be connected to sanitary drainage system.
- F. Install wall flanges or escutcheons at piping wall penetrations in exposed, finished locations. Use deep-pattern escutcheons where required to conceal protruding fittings.
- G. Seal joints between fixtures and walls using sanitary-type, one-part, mildew-resistant, silicone sealant. Match sealant color to fixture color. Comply with sealant requirements specified in Section 07 9200 "Joint Sealants."

3.3 PIPING CONNECTIONS

- A. Connect fixtures with water supplies, stops, and risers, and with traps, soil, waste, and vent piping. Use size fittings required to match fixtures.
- B. Comply with water piping requirements specified in Section 22 1116 "Domestic Water Piping."
- C. Install ball shutoff valve on water supply to each fixture. Install valve upstream from filter for drinking fountain. Comply with valve requirements specified in Section 22 0523.12 "Ball Valves for Plumbing Piping"
- D. Comply with soil and waste piping requirements specified in Section 22 1316 "Sanitary Waste and Vent Piping."

3.4 ELECTRICAL CONNECTIONS

- A. Ground equipment according to Section 26 0526 "Grounding and Bonding for Electrical Systems."
- B. Install electrical devices furnished by manufacturer, but not factory mounted, according to NFPA 70 and NECA 1.
- C. Install nameplate for each electrical connection, indicating electrical equipment designation and circuit number feeding connection.
 - 1. Nameplates to be laminated acrylic or melamine plastic signs, as specified in Section 26 0553 "Identification for Electrical Systems."
 - 2. Nameplates to be laminated acrylic or melamine plastic signs with a black background and engraved white letters at least 1/2 inch high.

3.5 ADJUSTING

- A. Adjust fixture flow regulators for proper flow and stream height.

3.6 CLEANING

- A. After installing fixtures, inspect unit. Remove paint splatters and other spots, dirt, and debris. Repair damaged finish to match original finish.
- B. Clean fixtures, on completion of installation, according to manufacturer's written instructions.
- C. Provide protective covering for installed fixtures.
- D. Do not allow use of fixtures for temporary facilities unless approved in writing by Owner.

END OF SECTION 22 4713

SECTION 23 0529 - HANGERS AND SUPPORTS FOR HVAC PIPING AND EQUIPMENT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Metal pipe hangers and supports.
 - 2. Trapeze pipe hangers.
 - 3. Metal framing systems.
 - 4. Thermal-hanger shield inserts.
 - 5. Fastener systems.
 - 6. Pipe stands.
 - 7. Equipment supports.
- B. Related Requirements:
 - 1. Section 23 3113 "Metal Ducts" for duct hangers and supports.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.
- B. Shop Drawings: Show fabrication and installation details and include calculations for the following; include Product Data for components:
 - 1. Trapeze pipe hangers.
 - 2. Metal framing systems.
 - 3. Pipe stands.
 - 4. Equipment supports.
- C. Delegated-Design Submittal: For trapeze hangers indicated to comply with performance requirements and design criteria, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation.
 - 1. Detail fabrication and assembly of trapeze hangers.
 - 2. Include design calculations for designing trapeze hangers.

1.4 QUALITY ASSURANCE

- A. Structural-Steel Welding Qualifications: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."
- B. Pipe Welding Qualifications: Qualify procedures and operators according to ASME Boiler and Pressure Vessel Code, Section IX.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Delegated Design: Engage a qualified professional engineer, as defined in Section 01 4000 "Quality Requirements," to design trapeze pipe hangers and equipment supports.

- B. Structural Performance: Hangers and supports for HVAC piping and equipment shall withstand the effects of gravity loads and stresses within limits and under conditions indicated according to ASCE/SEI 7.
 - 1. Design supports for multiple pipes, including pipe stands, capable of supporting combined weight of supported systems, system contents, and test water.
 - 2. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.

2.2 METAL PIPE HANGERS AND SUPPORTS

- A. Carbon-Steel Pipe Hangers and Supports:
 - 1. Description: MSS SP-58, Types 1 through 58, factory-fabricated components.
 - 2. Galvanized Metallic Coatings: Pre-galvanized, hot-dip galvanized, or electro-galvanized.
 - 3. Nonmetallic Coatings: Plastic coated, or epoxy powder-coated.
 - 4. Padded Hangers: Hanger with fiberglass or other pipe insulation pad or cushion to support bearing surface of piping.
 - 5. Hanger Rods: Continuous-thread rod, nuts, and washer made of carbon steel.
- B. Copper Pipe and Tube Hangers:
 - 1. Description: MSS SP-58, Types 1 through 58, copper-plated steel, factory-fabricated components.
 - 2. Hanger Rods: Continuous-thread rod, nuts, and washer made of copper-plated steel or stainless steel.

2.3 TRAPEZE PIPE HANGERS

- A. Description: MSS SP-58, Type 59, shop- or field-fabricated pipe-support assembly made from structural carbon-steel shapes with MSS SP-58 carbon-steel hanger rods, nuts, saddles, and U-bolts.

2.4 METAL FRAMING SYSTEMS

- A. MFMA Manufacturer Metal Framing Systems:
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. B-line; Eaton, Electrical Sector.
 - b. Haydon Corporation.
 - c. Unistrut; Atkore International.
 - 2. Description: Shop- or field-fabricated, pipe-support assembly made of steel channels, accessories, fittings, and other components for supporting multiple parallel pipes.
 - 3. Standard: Comply with MFMA-4 factory-fabricated components for field assembly.
 - 4. Channels: Continuous slotted carbon-steel channel with inturned lips.
 - 5. Channel Width: Selected for applicable load criteria.
 - 6. Channel Nuts: Formed or stamped nuts or other devices designed to fit into channel slot and, when tightened, prevent slipping along channel.
 - 7. Hanger Rods: Continuous-thread rod, nuts, and washer made of galvanized steel or stainless steel.
 - 8. Metallic Coating: Pregalvanized G90 or Electroplated zinc
 - 9. Paint Coating: Green epoxy, acrylic, or urethane.
- B. Non-MFMA Manufacturer Metal Framing Systems:
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following :
 - a. Anvil International.

- b. [Empire Industries, Inc.](#)
- c. [PHD Manufacturing, Inc.](#)
- 2. Description: Shop- or field-fabricated, pipe-support assembly made of steel channels, accessories, fittings, and other components for supporting multiple parallel pipes.
- 3. Standard: Comply with MFMA-4 factory-fabricated components for field assembly.
- 4. Channels: Continuous slotted carbon-steel channel with inturned lips.
- 5. Channel Width: Select for applicable load criteria.
- 6. Channel Nuts: Formed or stamped nuts or other devices designed to fit into channel slot and, when tightened, prevent slipping along channel.
- 7. Hanger Rods: Continuous-thread rod, nuts, and washer made of galvanized steel or stainless steel.
- 8. Metallic Coating: Pregalvanized G90 or Hot-dip galvanized.
- 9. Paint Coating: Green epoxy, acrylic, or urethane.

2.5 THERMAL-HANGER SHIELD INSERTS

- A. [Manufacturers:](#) Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following :
 - 1. [National Pipe Hanger Corporation.](#)
 - 2. [Pipe Shields Inc.](#)
 - 3. [Piping Technology & Products, Inc.](#)
- B. Insulation-Insert Material for Cold Piping: ASTM C552, Type II cellular glass with 100-psi or ASTM C591, Type VI, Grade 1 polyisocyanurate with 125-psi minimum compressive strength and vapor barrier.
- C. Insulation-Insert Material for Hot Piping: Water-repellent-treated, ASTM C533, Type I calcium silicate with 100-psi ASTM C552, Type II cellular glass with 100-psi or ASTM C591, Type VI, Grade 1 polyisocyanurate with 125-psi minimum compressive strength.
- D. For Trapeze or Clamped Systems: Insert and shield shall cover entire circumference of pipe.
- E. For Clevis or Band Hangers: Insert and shield shall cover lower 180 degrees of pipe.
- F. Insert Length: Extend 2 inches beyond sheet metal shield for piping operating below ambient air temperature.

2.6 FASTENER SYSTEMS

- A. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.
 - 1. [Manufacturers:](#) Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following :
 - a. [Hilti, Inc.](#)
 - b. [ITW Ramset/Red Head; Illinois Tool Works, Inc.](#)
 - c. [MKT Fastening, LLC.](#)
- B. Mechanical-Expansion Anchors: Insert-wedge-type anchors for use in hardened portland cement concrete; with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.
 - 1. [Manufacturers:](#) Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following :

- a. [Hilti, Inc.](#)
- b. [ITW Ramset/Red Head; Illinois Tool Works, Inc.](#)
- c. [MKT Fastening, LLC.](#)
2. Indoor Applications: Zinc-coated or stainless steel.
3. Outdoor Applications: Stainless steel.

2.7 PIPE STANDS

- A. General Requirements for Pipe Stands: Shop- or field-fabricated assemblies made of manufactured corrosion-resistant components to support roof-mounted piping.
- B. Compact Pipe Stand:
 1. [Manufacturers:](#) Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following Subject to compliance with requirements, provide products by one of the following:
 - a. [MIRO Industries.](#)
 - b. [PHP Systems/Design.](#)
 - c. [RectorSeal HVAC; a CSW Industrials Company.](#)
 - d. [Rooftop Support Systems, a division of Eberl Iron Works, Inc.](#)
 2. Description: Single base unit with integral-rod roller, pipe clamps, or V-shaped cradle to support pipe, for roof installation without membrane penetration.
 3. Base: Single, vulcanized rubber, molded polypropylene, or polycarbonate.
 4. Hardware: Galvanized steel or polycarbonate.
 5. Accessories: Protection pads.

2.8 EQUIPMENT SUPPORTS

- A. Description: Welded, shop- or field-fabricated equipment support made from structural carbon-steel shapes.

2.9 MATERIALS

- A. Aluminum: ASTM B221.
- B. Carbon Steel: ASTM A1011/A1011M.
- C. Structural Steel: ASTM A36/A36M, carbon-steel plates, shapes, and bars; galvanized.
- D. Stainless Steel: ASTM A240/A240M.
- E. Threaded Rods: Continuously threaded. Zinc-plated or galvanized steel for indoor applications and stainless steel for outdoor applications. Mating nuts and washers of similar materials as rods.

PART 3 - EXECUTION

3.1 APPLICATION

- A. Comply with requirements in Section 07 8413 "Penetration Firestopping" for firestopping materials and installation for penetrations through fire-rated walls, ceilings, and assemblies.
- B. Strength of Support Assemblies: Where not indicated, select sizes of components so strength will be adequate to carry present and future static loads within specified loading limits. Minimum

static design load used for strength determination shall be weight of supported components plus 200 lb.

3.2 HANGER AND SUPPORT INSTALLATION

- A. Metal Pipe-Hanger Installation: Comply with MSS SP-58. Install hangers, supports, clamps, and attachments as required to properly support piping from the building structure.
- B. Metal Trapeze Pipe-Hanger Installation: Comply with MSS SP-58. Arrange for grouping of parallel runs of horizontal piping, and support together on field-fabricated trapeze pipe hangers.
 - 1. Pipes of Various Sizes: Support together and space trapezes for smallest pipe size or install intermediate supports for smaller diameter pipes as specified for individual pipe hangers.
 - 2. Field fabricate from ASTM A36/A36M, carbon-steel shapes selected for loads being supported. Weld steel according to AWS D1.1/D1.1M.
- C. Fiberglass Pipe-Hanger Installation: Comply with applicable portions of MSS SP-58. Install hangers and attachments as required to properly support piping from building structure.
- D. Metal Framing System Installation: Arrange for grouping of parallel runs of piping, and support together on field-assembled strut systems.
- E. Thermal-Hanger Shield Installation: Install in pipe hanger or shield for insulated piping.
- F. Fastener System Installation:
 - 1. Install powder-actuated fasteners for use in lightweight concrete or concrete slabs less than 4 inches thick in concrete after concrete is placed and completely cured. Use operators that are licensed by powder-actuated tool manufacturer. Install fasteners according to powder-actuated tool manufacturer's operating manual.
 - 2. Install mechanical-expansion anchors in concrete after concrete is placed and completely cured. Install fasteners according to manufacturer's written instructions.
- G. Pipe Stand Installation:
 - 1. Pipe Stand Types except Curb-Mounted Type: Assemble components and mount on smooth roof surface. Do not penetrate roof membrane.
 - 2. Curb-Mounted-Type Pipe Stands: Assemble components or fabricate pipe stand and mount on permanent, stationary roof curb. See Section 07 7200 "Roof Accessories" for curbs.
- H. Install hangers and supports complete with necessary attachments, inserts, bolts, rods, nuts, washers, and other accessories.
- I. Equipment Support Installation: Fabricate from welded-structural-steel shapes.
- J. Install hangers and supports to allow controlled thermal and seismic movement of piping systems, to permit freedom of movement between pipe anchors, and to facilitate action of expansion joints, expansion loops, expansion bends, and similar units.
- K. Install lateral bracing with pipe hangers and supports to prevent swaying.
- L. Install building attachments within concrete slabs or attach to structural steel. Install additional attachments at concentrated loads, including valves, flanges, and strainers, NPS 2-1/2 and larger and at changes in direction of piping. Install concrete inserts before concrete is placed; fasten inserts to forms and install reinforcing bars through openings at top of inserts.

- M. Load Distribution: Install hangers and supports so that piping live and dead loads and stresses from movement will not be transmitted to connected equipment.
- N. Pipe Slopes: Install hangers and supports to provide indicated pipe slopes and to not exceed maximum pipe deflections allowed by ASME B31.9 for building services piping.
- O. Insulated Piping:
 - 1. Attach clamps and spacers to piping.
 - a. Piping Operating above Ambient Air Temperature: Clamp may project through insulation.
 - b. Piping Operating below Ambient Air Temperature: Use thermal-hanger shield insert with clamp sized to match OD of insert.
 - c. Do not exceed pipe stress limits allowed by ASME B31.9 for building services piping.
 - 2. Install MSS SP-58, Type 39, protection saddles if insulation without vapor barrier is indicated. Fill interior voids with insulation that matches adjoining insulation.
 - a. Option: Thermal-hanger shield inserts may be used. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.
 - 3. Install MSS SP-58, Type 40, protective shields on cold piping with vapor barrier. Shields shall span an arc of 180 degrees.
 - a. Option: Thermal-hanger shield inserts may be used. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.
 - 4. Shield Dimensions for Pipe: Not less than the following:
 - a. NPS 1/4 to NPS 3-1/2: 12 inches long and 0.048 inch thick.
 - b. NPS 4: 12 inches long and 0.06 inch thick.
 - c. NPS 5 and NPS 6: 18 inches long and 0.06 inch thick.
 - 5. Pipes NPS 8 and Larger: Include wood or reinforced calcium-silicate-insulation inserts of length at least as long as protective shield.
 - 6. Thermal-Hanger Shields: Install with insulation same thickness as piping insulation.

3.3 EQUIPMENT SUPPORTS

- A. Fabricate structural-steel stands to suspend equipment from structure overhead or to support equipment above floor.
- B. Provide lateral bracing, to prevent swaying, for equipment supports.

3.4 METAL FABRICATIONS

- A. Cut, drill, and fit miscellaneous metal fabrications for trapeze pipe hangers and equipment supports.
- B. Fit exposed connections together to form hairline joints. Field weld connections that cannot be shop welded because of shipping size limitations.
- C. Field Welding: Comply with AWS D1.1/D1.1M procedures for shielded, metal arc welding; appearance and quality of welds; and methods used in correcting welding work; and with the following:
 - 1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
 - 2. Obtain fusion without undercut or overlap.
 - 3. Remove welding flux immediately.
 - 4. Finish welds at exposed connections so no roughness shows after finishing and so contours of welded surfaces match adjacent contours.

3.5 ADJUSTING

- A. Hanger Adjustments: Adjust hangers to distribute loads equally on attachments and to achieve indicated slope of pipe.
- B. Trim excess length of continuous-thread hanger and support rods to 1-1/2 inches.

3.6 PAINTING

- A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.
 - 1. Apply paint by brush or spray to provide a minimum dry film thickness of 2.0 mils.
- B. Touchup: Comply with requirements in Section 09 9113 "Exterior Painting" for cleaning and touchup painting of field welds, bolted connections, and abraded areas of shop paint on miscellaneous metal.
- C. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A780/A780M.

3.7 HANGER AND SUPPORT SCHEDULE

- A. Specific hanger and support requirements are in Sections specifying piping systems and equipment.
- B. Comply with MSS SP-58 for pipe-hanger selections and applications that are not specified in piping system Sections.
- C. Use hangers and supports with galvanized metallic coatings for piping and equipment that will not have field-applied finish.
- D. Use nonmetallic coatings on attachments for electrolytic protection where attachments are in direct contact with copper tubing.
- E. Use carbon-steel pipe hangers and supports, metal trapeze pipe hangers, and metal framing systems and attachments for general service applications.
- F. Use copper-plated pipe hangers and copper or stainless steel attachments for copper piping and tubing.
- G. Use padded hangers for piping that is subject to scratching.
- H. Use thermal-hanger shield inserts for insulated piping and tubing.
- I. Horizontal-Piping Hangers and Supports: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
 - 1. Adjustable, Steel Clevis Hangers (MSS Type 1): For suspension of noninsulated or insulated, stationary pipes NPS 1/2 to NPS 30.
 - 2. Yoke-Type Pipe Clamps (MSS Type 2): For suspension of up to 1050 deg F, pipes NPS 4 to NPS 24, requiring up to 4 inches of insulation.
 - 3. Carbon- or Alloy-Steel, Double-Bolt Pipe Clamps (MSS Type 3): For suspension of pipes NPS 3/4 to NPS 36, requiring clamp flexibility and up to 4 inches of insulation.
 - 4. Steel Pipe Clamps (MSS Type 4): For suspension of cold and hot pipes NPS 1/2 to NPS 24 if little or no insulation is required.

5. Pipe Hangers (MSS Type 5): For suspension of pipes NPS 1/2 to NPS 4, to allow off-center closure for hanger installation before pipe erection.
 6. Adjustable, Swivel Split- or Solid-Ring Hangers (MSS Type 6): For suspension of noninsulated, stationary pipes NPS 3/4 to NPS 8.
 7. Adjustable, Steel Band Hangers (MSS Type 7): For suspension of noninsulated, stationary pipes NPS 1/2 to NPS 8.
 8. Adjustable Band Hangers (MSS Type 9): For suspension of noninsulated, stationary pipes NPS 1/2 to NPS 8.
 9. Adjustable, Swivel-Ring Band Hangers (MSS Type 10): For suspension of noninsulated, stationary pipes NPS 1/2 to NPS 8.
 10. Split Pipe Ring with or without Turnbuckle Hangers (MSS Type 11): For suspension of noninsulated, stationary pipes NPS 3/8 to NPS 8.
 11. Extension Hinged or Two-Bolt Split Pipe Clamps (MSS Type 12): For suspension of noninsulated, stationary pipes NPS 3/8 to NPS 3.
 12. U-Bolts (MSS Type 24): For support of heavy pipes NPS 1/2 to NPS 30.
 13. Clips (MSS Type 26): For support of insulated pipes not subject to expansion or contraction.
 14. Pipe Saddle Supports (MSS Type 36): For support of pipes NPS 4 to NPS 36, with steel-pipe base stanchion support and cast-iron floor flange or carbon-steel plate.
 15. Pipe Stanchion Saddles (MSS Type 37): For support of pipes NPS 4 to NPS 36, with steel-pipe base stanchion support and cast-iron floor flange or carbon-steel plate, and with U-bolt to retain pipe.
 16. Adjustable Pipe Saddle Supports (MSS Type 38): For stanchion-type support for pipes NPS 2-1/2 to NPS 36 if vertical adjustment is required, with steel-pipe base stanchion support and cast-iron floor flange.
 17. Single-Pipe Rolls (MSS Type 41): For suspension of pipes NPS 1 to NPS 30, from two rods if longitudinal movement caused by expansion and contraction might occur.
 18. Adjustable Roller Hangers (MSS Type 43): For suspension of pipes NPS 2-1/2 to NPS 24, from single rod if horizontal movement caused by expansion and contraction might occur.
 19. Complete Pipe Rolls (MSS Type 44): For support of pipes NPS 2 to NPS 42 if longitudinal movement caused by expansion and contraction might occur but vertical adjustment is unnecessary.
 20. Pipe Roll and Plate Units (MSS Type 45): For support of pipes NPS 2 to NPS 24 if small horizontal movement caused by expansion and contraction might occur and vertical adjustment is unnecessary.
 21. Adjustable Pipe Roll and Base Units (MSS Type 46): For support of pipes NPS 2 to NPS 30 if vertical and lateral adjustment during installation might be required in addition to expansion and contraction.
- J. Vertical-Piping Clamps: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Extension Pipe or Riser Clamps (MSS Type 8): For support of pipe risers NPS 3/4 to NPS 24.
 2. Carbon- or Alloy-Steel Riser Clamps (MSS Type 42): For support of pipe risers NPS 3/4 to NPS 24 if longer ends are required for riser clamps.
- K. Hanger-Rod Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Steel Turnbuckles (MSS Type 13): For adjustment up to 6 inches for heavy loads.
 2. Steel Clevises (MSS Type 14): For 120 to 450 deg F piping installations.
 3. Swivel Turnbuckles (MSS Type 15): For use with MSS Type 11, split pipe rings.
 4. Malleable-Iron Sockets (MSS Type 16): For attaching hanger rods to various types of building attachments.
 5. Steel Weldless Eye Nuts (MSS Type 17): For 120 to 450 deg F piping installations.

- L. Building Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Steel or Malleable Concrete Inserts (MSS Type 18): For upper attachment to suspend pipe hangers from concrete ceiling.
 2. Top-Beam C-Clamps (MSS Type 19): For use under roof installations with bar-joist construction, to attach to top flange of structural shape.
 3. Side-Beam or Channel Clamps (MSS Type 20): For attaching to bottom flange of beams, channels, or angles.
 4. Center-Beam Clamps (MSS Type 21): For attaching to center of bottom flange of beams.
 5. Welded Beam Attachments (MSS Type 22): For attaching to bottom of beams if loads are considerable and rod sizes are large.
 6. C-Clamps (MSS Type 23): For structural shapes.
 7. Top-Beam Clamps (MSS Type 25): For top of beams if hanger rod is required tangent to flange edge.
 8. Side-Beam Clamps (MSS Type 27): For bottom of steel I-beams.
 9. Steel-Beam Clamps with Eye Nuts (MSS Type 28): For attaching to bottom of steel I-beams for heavy loads.
 10. Linked-Steel Clamps with Eye Nuts (MSS Type 29): For attaching to bottom of steel I-beams for heavy loads, with link extensions.
 11. Malleable-Beam Clamps with Extension Pieces (MSS Type 30): For attaching to structural steel.
 12. Welded-Steel Brackets: For support of pipes from below or for suspending from above by using clip and rod. Use one of the following for indicated loads:
 - a. Light (MSS Type 31): 750 lb.
 - b. Medium (MSS Type 32): 1500 lb.
 - c. Heavy (MSS Type 33): 3000 lb.
 13. Side-Beam Brackets (MSS Type 34): For sides of steel or wooden beams.
 14. Plate Lugs (MSS Type 57): For attaching to steel beams if flexibility at beam is required.
 15. Horizontal Travelers (MSS Type 58): For supporting piping systems subject to linear horizontal movement where headroom is limited.
- M. Saddles and Shields: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Steel-Pipe-Covering Protection Saddles (MSS Type 39): To fill interior voids with insulation that matches adjoining insulation.
 2. Protection Shields (MSS Type 40): Of length recommended in writing by manufacturer to prevent crushing insulation.
 3. Thermal-Hanger Shield Inserts: For supporting insulated pipe.
- N. Spring Hangers and Supports: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Restraint-Control Devices (MSS Type 47): Where indicated to control piping movement.
 2. Spring Cushions (MSS Type 48): For light loads if vertical movement does not exceed 1-1/4 inches.
 3. Spring-Cushion Roll Hangers (MSS Type 49): For equipping Type 41, roll hanger with springs.
 4. Spring Sway Braces (MSS Type 50): To retard sway, shock, vibration, or thermal expansion in piping systems.
 5. Variable-Spring Hangers (MSS Type 51): Preset to indicated load and limit variability factor to 25 percent to allow expansion and contraction of piping system from hanger.
 6. Variable-Spring Base Supports (MSS Type 52): Preset to indicated load and limit variability factor to 25 percent to allow expansion and contraction of piping system from base support.
 7. Variable-Spring Trapeze Hangers (MSS Type 53): Preset to indicated load and limit variability factor to 25 percent to allow expansion and contraction of piping system from trapeze support.

8. Constant Supports: For critical piping stress and if necessary to avoid transfer of stress from one support to another support, critical terminal, or connected equipment. Include auxiliary stops for erection, hydrostatic test, and load-adjustment capability. These supports include the following types:
 - a. Horizontal (MSS Type 54): Mounted horizontally.
 - b. Vertical (MSS Type 55): Mounted vertically.
 - c. Trapeze (MSS Type 56): Two vertical-type supports and one trapeze member.
- O. Comply with MSS SP-58 for trapeze pipe-hanger selections and applications that are not specified in piping system Sections.
- P. Comply with MFMA-103 for metal framing system selections and applications that are not specified in piping system Sections.
- Q. Use powder-actuated fasteners or mechanical-expansion anchors instead of building attachments where required in concrete construction.

END OF SECTION 23 0529

SECTION 23 0593 - TESTING, ADJUSTING, AND BALANCING FOR HVAC

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Testing, Adjusting, and Balancing of Air Systems:
 - a. Constant-volume air systems.
 - 2. Testing, adjusting, and balancing of equipment.
 - 3. Sound tests.
 - 4. Vibration tests.
 - 5. HVAC-control system verification.

1.3 DEFINITIONS

- A. AABC: Associated Air Balance Council.
- B. NEBB: National Environmental Balancing Bureau.
- C. TAB: Testing, adjusting, and balancing.
- D. TABB: Testing, Adjusting, and Balancing Bureau.
- E. TAB Specialist: An independent entity meeting qualifications to perform TAB work.
- F. TDH: Total dynamic head.

1.4 PREINSTALLATION MEETINGS

- A. TAB Conference: Conduct a TAB conference at Project site after approval of the TAB strategies and procedures plan, to develop a mutual understanding of the details. Provide a minimum of 14 days' advance notice of scheduled meeting time and location.
 - 1. Minimum Agenda Items:
 - a. The Contract Documents examination report.
 - b. The TAB plan.
 - c. Needs for coordination and cooperation of trades and subcontractors.
 - d. Proposed procedures for documentation and communication flow.

1.5 INFORMATIONAL SUBMITTALS

- A. Qualification Data: Within 30 days of Contractor's Notice to Proceed, submit documentation that the TAB specialist and this Project's TAB team members meet the qualifications specified in "Quality Assurance" Article.
- B. Contract Documents Examination Report: Within 60 days of Contractor's Notice to Proceed, submit the Contract Documents review report, as specified in Part 3.

- C. Strategies and Procedures Plan: Within 90 days of Contractor's Notice to Proceed, submit TAB strategies and step-by-step procedures, as specified in "Preparation" Article.
- D. System Readiness Checklists: Within 90 days of Contractor's Notice to Proceed, submit system readiness checklists, as specified in "Preparation" Article.
- E. Examination Report: Submit a summary report of the examination review required in "Examination" Article.
- F. Certified TAB reports.
- G. Sample report forms.
- H. Instrument calibration reports, to include the following:
 - 1. Instrument type and make.
 - 2. Serial number.
 - 3. Application.
 - 4. Dates of use.
 - 5. Dates of calibration.

1.6 QUALITY ASSURANCE

- A. TAB Specialists Qualifications, Certified by AABC:
 - 1. TAB Field Supervisor: Employee of the TAB specialist and certified by AABC.
 - 2. TAB Technician: Employee of the TAB specialist and certified by AABC.
- B. TAB Specialists Qualifications, Certified by NEBB or TABB:
 - 1. TAB Field Supervisor: Employee of the TAB specialist and certified by NEBB or TABB.
 - 2. TAB Technician: Employee of the TAB specialist and certified by NEBB or TABB.
- C. Instrumentation Type, Quantity, Accuracy, and Calibration: Comply with requirements in ASHRAE 111, Section 4, "Instrumentation."
- D. ASHRAE/IES 90.1 Compliance: Applicable requirements in ASHRAE/IES 90.1, Section 6.7.2.3 - "System Balancing."
- E. Code and AHJ Compliance: TAB is required to comply with governing codes and requirements of authorities having jurisdiction.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION

3.1 COMMISSIONING ASSISTANCE

- A. The Testing, Adjusting, and Balancing (TAB) Contractor shall provide assistance to the Commissioning Authority.

3.2 EXAMINATION

- A. Examine the Contract Documents to become familiar with Project requirements and to discover conditions in systems designs that may preclude proper TAB of systems and equipment.

- B. Examine installed systems for balancing devices, such as test ports, gauge cocks, thermometer wells, flow-control devices, balancing valves and fittings, and manual volume dampers. Verify that locations of these balancing devices are applicable for intended purpose and are accessible.
- C. Examine the approved submittals for HVAC systems and equipment.
- D. Examine design data, including HVAC system descriptions, statements of design assumptions for environmental conditions and systems output, and statements of philosophies and assumptions about HVAC system and equipment controls.
- E. Examine ceiling plenums and underfloor air plenums used for HVAC to verify that they are properly separated from adjacent areas and sealed.
- F. Examine equipment performance data, including fan and pump curves.
 - 1. Relate performance data to Project conditions and requirements, including system effects that can create undesired or unpredicted conditions that cause reduced capacities in all or part of a system.
 - 2. Calculate system-effect factors to reduce performance ratings of HVAC equipment when installed under conditions different from the conditions used to rate equipment performance. To calculate system effects for air systems, use tables and charts found in AMCA 201, "Fans and Systems," or in SMACNA's "HVAC Systems - Duct Design." Compare results with the design data and installed conditions.
- G. Examine system and equipment installations and verify that field quality-control testing, cleaning, and adjusting specified in individual Sections have been performed.
- H. Examine test reports specified in individual system and equipment Sections.
- I. Examine HVAC equipment and verify that bearings are greased, belts are aligned and tight, filters are clean, and equipment with functioning controls is ready for operation.
- J. Examine terminal units, such as variable-air-volume boxes, and verify that they are accessible and their controls are connected and functioning.
- K. Examine temporary and permanent strainers. Verify that temporary strainer screens used during system cleaning and flushing have been removed and permanent strainer baskets are installed and clean.
- L. Examine control valves for proper installation for their intended function of isolating, throttling, diverting, or mixing fluid flows.
- M. Examine heat-transfer coils for correct piping connections and for clean and straight fins.
- N. Examine operating safety interlocks and controls on HVAC equipment.
- O. Examine control dampers for proper installation for their intended function of isolating, throttling, diverting, or mixing air flows.
- P. Report deficiencies discovered before and during performance of TAB procedures. Observe and record system reactions to changes in conditions. Record default set points if different from indicated values.

3.3 PREPARATION

- A. Prepare a TAB plan that includes the following:
 - 1. Equipment and systems to be tested.
 - 2. Strategies and step-by-step procedures for balancing the systems.
 - 3. Instrumentation to be used.
 - 4. Sample forms with specific identification for all equipment.
- B. Perform system-readiness checks of HVAC systems and equipment to verify system readiness for TAB work. Include, at a minimum, the following:
 - 1. Airside:
 - a. Verify that leakage and pressure tests on air distribution systems have been satisfactorily completed.
 - b. Duct systems are complete with terminals installed.
 - c. Volume, smoke, and fire dampers are open and functional.
 - d. Clean filters are installed.
 - e. Fans are operating, free of vibration, and rotating in correct direction.
 - f. Variable-frequency controllers' startup is complete, and safeties are verified.
 - g. Automatic temperature-control systems are operational.
 - h. Ceilings are installed.
 - i. Windows and doors are installed.
 - j. Suitable access to balancing devices and equipment is provided.

3.4 GENERAL PROCEDURES FOR TESTING AND BALANCING

- A. Perform testing and balancing procedures on each system in accordance with the procedures contained in AABC's "National Standards for Total System Balance", ASHRAE 111, or NEBB's "Procedural Standards for Testing, Adjusting, and Balancing of Environmental Systems" and in this Section.
- B. Cut insulation, ducts, pipes, and equipment casings for installation of test probes to the minimum extent necessary for TAB procedures.
 - 1. After testing and balancing, patch probe holes in ducts with same material and thickness as used to construct ducts.
 - 2. After testing and balancing, install test ports and duct access doors that comply with requirements in Section 23 3300 "Air Duct Accessories."
 - 3. Install and join new insulation that matches removed materials. Restore insulation, coverings, vapor barrier, and finish in accordance with Section 23 0713 "Duct Insulation," Section 23 0716 "HVAC Equipment Insulation," and Section 23 0719 "HVAC Piping Insulation."
- C. Mark equipment and balancing devices, including damper-control positions, valve position indicators, fan-speed-control levers, and similar controls and devices, with paint or other suitable, permanent identification material to show final settings.
- D. Take and report testing and balancing measurements in inch-pound (IP) units.

3.5 TESTING, ADJUSTING, AND BALANCING OF HVAC EQUIPMENT

- A. Test, adjust, and balance HVAC equipment indicated on Drawings, including, but not limited to, the following:
 - 1. Motors.
 - 2. Fans and ventilators.
 - 3. Condensing units.

4. Rooftop air-conditioning units.
5. Split-system air conditioners.
6. Coils.
7. Fan coil units.

3.6 GENERAL PROCEDURES FOR BALANCING AIR SYSTEMS

- A. Prepare test reports for both fans and outlets. Obtain manufacturer's outlet factors and recommended testing procedures. Crosscheck the summation of required outlet volumes with required fan volumes.
- B. Prepare schematic diagrams of systems' Record drawings duct layouts.
- C. For variable-air-volume systems, develop a plan to simulate diversity.
- D. Determine the best locations in main and branch ducts for accurate duct-airflow measurements.
- E. Check airflow patterns from the outdoor-air louvers and dampers and the return- and exhaust-air dampers through the supply-fan discharge and mixing dampers.
- F. Locate start-stop and disconnect switches, electrical interlocks, and motor starters.
- G. Verify that motor starters are equipped with properly sized thermal protection.
- H. Check dampers for proper position to achieve desired airflow path.
- I. Check for airflow blockages.
- J. Check condensate drains for proper connections and functioning.
- K. Check for proper sealing of air-handling-unit components.

3.7 PROCEDURES FOR CONSTANT-VOLUME AIR SYSTEMS

- A. Adjust fans to deliver total indicated airflows within the maximum allowable fan speed listed by fan manufacturer.
 1. Measure total airflow.
 - a. Set outside-air, return-air, and relief-air dampers for proper position that simulates minimum outdoor-air conditions.
 - b. Where duct conditions allow, measure airflow by main Pitot-tube traverse. If necessary, perform multiple Pitot-tube traverses close to the fan and prior to any outlets, to obtain total airflow.
 - c. Where duct conditions are unsuitable for Pitot-tube traverse measurements, a coil traverse may be acceptable.
 2. Measure fan static pressures as follows:
 - a. Measure static pressure directly at the fan outlet or through the flexible connection.
 - b. Measure static pressure directly at the fan inlet or through the flexible connection.
 - c. Measure static pressure across each component that makes up the air-handling system.
 - d. Report artificial loading of filters at the time static pressures are measured.
 3. Review Contractor-prepared shop drawings and Record drawings to determine variations in design static pressures versus actual static pressures. Calculate actual system-effect factors. Recommend adjustments to accommodate actual conditions.

4. Obtain approval from Architect for adjustment of fan speed higher or lower than indicated speed. Comply with requirements in HVAC Sections for air-handling units for adjustment of fans, belts, and pulley sizes to achieve indicated air-handling-unit performance.
 5. Do not make fan-speed adjustments that result in motor overload. Consult equipment manufacturers about fan-speed safety factors. Modulate dampers and measure fan-motor amperage to ensure that no overload occurs. Measure amperage in full-cooling, full-heating, economizer, and any other operating mode to determine the maximum required brake horsepower.
- B. Adjust volume dampers for main duct, submain ducts, and major branch ducts to indicated airflows.
1. Measure airflow of submain and branch ducts.
 2. Adjust submain and branch duct volume dampers for specified airflow.
 3. Re-measure each submain and branch duct after all have been adjusted.
- C. Adjust air inlets and outlets for each space to indicated airflows.
1. Set airflow patterns of adjustable outlets for proper distribution without drafts.
 2. Measure inlets and outlets airflow.
 3. Adjust each inlet and outlet for specified airflow.
 4. Re-measure each inlet and outlet after they have been adjusted.
- D. Verify final system conditions.
1. Re-measure and confirm that minimum outdoor, return, and relief airflows are within design. Readjust to design if necessary.
 2. Re-measure and confirm that total airflow is within design.
 3. Re-measure all final fan operating data, speed, volts, amps, and static profile.
 4. Mark all final settings.
 5. Test system in economizer mode. Verify proper operation and adjust if necessary.
 6. Measure and record all operating data.
 7. Record final fan-performance data.

3.8 PROCEDURES FOR MOTORS

- A. Motors 1/2 HP and Larger: Test at final balanced conditions and record the following data:
1. Manufacturer's name, model number, and serial number.
 2. Motor horsepower rating.
 3. Motor rpm.
 4. Phase and hertz.
 5. Nameplate and measured voltage, each phase.
 6. Nameplate and measured amperage, each phase.
 7. Starter size and thermal-protection-element rating.
 8. Service factor and frame size.
- B. Motors Driven by Variable-Frequency Controllers: Test manual bypass of controller to prove proper operation.

3.9 PROCEDURES FOR AIR-COOLED CONDENSING UNITS

- A. Verify proper rotation of fan(s).
- B. Measure and record entering- and leaving-air temperatures.
- C. Measure and record entering and leaving refrigerant pressures.

- D. Measure and record operating data of compressor(s), fan(s), and motors.

3.10 PROCEDURES FOR HEAT-TRANSFER COILS

- A. Measure, adjust, and record the following data for each hydronic coil:
 - 1. Entering- and leaving-water temperature.
 - 2. Water flow rate.
 - 3. Water pressure drop.
 - 4. Dry-bulb temperature of entering and leaving air.
 - 5. Wet-bulb temperature of entering and leaving air for cooling coils.
 - 6. Airflow.
 - 7. Air pressure drop.
- B. Measure, adjust, and record the following data for each refrigerant coil:
 - 1. Dry-bulb temperature of entering and leaving air.
 - 2. Wet-bulb temperature of entering and leaving air.
 - 3. Airflow.
 - 4. Air pressure drop.
 - 5. Entering and leaving refrigerant pressure and temperatures.

3.11 SOUND TESTS

- A. After systems are balanced and Substantial Completion, measure and record sound levels at 15 locations as designated by the Architect.
- B. Instrumentation:
 - 1. The sound-testing meter shall be a portable, general-purpose testing meter consisting of a microphone, processing unit, and readout.
 - 2. The sound-testing meter shall be capable of showing fluctuations at minimum and maximum levels, and measuring the equivalent continuous sound pressure level (L_{eq}).
 - 3. The sound-testing meter must be capable of using one-third octave band filters to measure mid-frequencies from 31.5 Hz to 8000 Hz.
 - 4. The accuracy of the sound-testing meter shall be plus or minus one decibel.
- C. Test Procedures:
 - 1. Perform test at quietest background noise period. Note cause of unpreventable sound that affects test outcome.
 - 2. Equipment should be operating at design values.
 - 3. Calibrate the sound-testing meter prior to taking measurements.
 - 4. Use a microphone suitable for the type of noise levels measured that is compatible with meter. Provide a windshield for outside or in-duct measurements.
 - 5. Record a set of background measurements in dBA and sound pressure levels in the eight unweighted octave bands 63 Hz to 8000 Hz (NC) with the equipment off.
 - 6. Take sound readings in dBA and sound pressure levels in the eight unweighted octave bands 63 Hz to 8000 Hz (NC) with the equipment operating.
 - 7. Take readings no closer than 36 inches from a wall or from the operating equipment and approximately 60 inches from the floor, with the meter held or mounted on a tripod.
 - 8. For outdoor measurements, move sound-testing meter slowly and scan area that has the most exposure to noise source being tested. Use A-weighted scale for this type of reading.
- D. Reporting:
 - 1. Report shall record the following:
 - a. Location.

- b. System tested.
 - c. dBA reading.
 - d. Sound pressure level in each octave band with equipment on and off.
- 2. Plot sound pressure levels on Noise Criteria (NC) or Room Criteria (RC) worksheet with equipment on and off.

3.12 VIBRATION TESTS

- A. After systems are balanced and Substantially Completion, measure and record vibration levels on equipment having motor horsepower equal to or greater than 10.
- B. Instrumentation:
 - 1. Use portable, battery-operated, and microprocessor-controlled vibration meter with or without a built-in printer.
 - 2. The meter shall automatically identify engineering units, filter bandwidth, amplitude, and frequency scale values.
 - 3. The meter shall be able to measure machine vibration displacement in mils of deflection, velocity in inches per second, and acceleration in inches per second squared.
 - 4. Verify calibration date is current for vibration meter before taking readings.
- C. Test Procedures:
 - 1. To ensure accurate readings, verify that accelerometer has a clean, flat surface and is mounted properly.
 - 2. With the unit running, set up vibration meter in a safe, secure location. Connect transducer to meter with proper cables. Hold magnetic tip of transducer on top of the bearing, and measure unit in mils of deflection. Record measurement, then move transducer to the side of the bearing and record in mils of deflection. Record an axial reading in mils of deflection by holding nonmagnetic, pointed transducer tip on end of shaft.
 - 3. Change vibration meter to velocity (inches per second) measurements. Repeat and record above measurements.
 - 4. Record CPM or rpm.
 - 5. Read each bearing on motor, fan, and pump as required. Track and record vibration levels from rotating component through casing to base.
- D. Reporting:
 - 1. Report shall record location and the system tested.
 - 2. Include horizontal-vertical-axial measurements for tests.
 - 3. Verify that vibration limits follow Specifications, or, if not specified, follow the General Machinery Vibration Severity Chart or Vibration Acceleration General Severity Chart from AABC's "National Standards for Total System Balance." Acceptable levels of vibration are normally "smooth" to "good."
 - 4. Include in General Machinery Vibration Severity Chart, with conditions plotted.

3.13 TOLERANCES

- A. Set HVAC system's airflow rates and water flow rates within the following tolerances:
 - 1. Supply, Return, and Exhaust Fans and Equipment with Fans: Plus 10 percent or minus 5 percent. If design value is less than 100 cfm, within 10 cfm.
 - 2. Air Outlets and Inlets: Plus 10 percent or minus 5 percent. If design value is less than 100 cfm, within 10 cfm.
- B. Maintaining pressure relationships as designed shall have priority over the tolerances specified above.

3.14 PROGRESS REPORTING

- A. Initial Construction-Phase Report: Based on examination of the Contract Documents as specified in "Examination" Article, prepare a report on the adequacy of design for system-balancing devices. Recommend changes and additions to system-balancing devices, to facilitate proper performance measuring and balancing. Recommend changes and additions to HVAC systems and general construction to allow access for performance-measuring and -balancing devices.
- B. Status Reports: Prepare weekly progress reports to describe completed procedures, procedures in progress, and scheduled procedures. Include a list of deficiencies and problems found in systems being tested and balanced. Prepare a separate report for each system and each building floor for systems serving multiple floors.

3.15 FINAL REPORT

- A. General: Prepare a certified written report; tabulate and divide the report into separate sections for tested systems and balanced systems.
 - 1. Include a certification sheet at the front of the report's binder, signed and sealed by the certified testing and balancing engineer.
 - 2. Include a list of instruments used for procedures, along with proof of calibration.
 - 3. Certify validity and accuracy of field data.
- B. Final Report Contents: In addition to certified field-report data, include the following:
 - 1. Pump curves.
 - 2. Fan curves.
 - 3. Manufacturers' test data.
 - 4. Field test reports prepared by system and equipment installers.
 - 5. Other information relative to equipment performance; do not include Shop Drawings and Product Data.
- C. General Report Data: In addition to form titles and entries, include the following data:
 - 1. Title page.
 - 2. Name and address of the TAB specialist.
 - 3. Project name.
 - 4. Project location.
 - 5. Architect's name and address.
 - 6. Engineer's name and address.
 - 7. Contractor's name and address.
 - 8. Report date.
 - 9. Signature of TAB supervisor who certifies the report.
 - 10. Table of Contents with the total number of pages defined for each section of the report. Number each page in the report.
 - 11. Summary of contents, including the following:
 - a. Indicated versus final performance.
 - b. Notable characteristics of systems.
 - c. Description of system operation sequence if it varies from the Contract Documents.
 - 12. Nomenclature sheets for each item of equipment.
 - 13. Data for terminal units, including manufacturer's name, type, size, and fittings.
 - 14. Notes to explain why certain final data in the body of reports vary from indicated values.
 - 15. Test conditions for fans performance forms, including the following:
 - a. Settings for outdoor-, return-, and exhaust-air dampers.
 - b. Conditions of filters.

- c. Cooling coil, wet- and dry-bulb conditions.
 - d. Heating coil, dry-bulb conditions.
 - e. Face and bypass damper settings at coils.
 - f. Fan drive settings, including settings and percentage of maximum pitch diameter.
 - g. Variable-frequency controller settings for variable-air-volume systems.
 - h. Settings for pressure controller(s).
 - i. Other system operating conditions that affect performance.
- D. System Diagrams: Include schematic layouts of air distribution systems. Present each system with single-line diagram and include the following:
 - 1. Quantities of outdoor, supply, return, and exhaust airflows.
 - 2. Water and steam flow rates.
 - 3. Duct, outlet, and inlet sizes.
 - 4. Pipe and valve sizes and locations.
 - 5. Terminal units.
 - 6. Balancing stations.
 - 7. Position of balancing devices.
- E. Air-Handling-Unit Test Reports: For air-handling units, include the following:
 - 1. Unit Data:
 - a. Unit identification.
 - b. Location.
 - c. Make and type.
 - d. Model number and unit size.
 - e. Manufacturer's serial number.
 - f. Unit arrangement and class.
 - g. Discharge arrangement.
 - h. Sheave make, size in inches, and bore.
 - i. Center-to-center dimensions of sheave and amount of adjustments in inches.
 - j. Number, make, and size of belts.
 - k. Number, type, and size of filters.
 - 2. Motor Data:
 - a. Motor make, and frame type and size.
 - b. Horsepower and speed.
 - c. Volts, phase, and hertz.
 - d. Full-load amperage and service factor.
 - e. Sheave make, size in inches, and bore.
 - f. Center-to-center dimensions of sheave and amount of adjustments in inches.
 - 3. Test Data (Indicated and Actual Values):
 - a. Total airflow rate in cfm.
 - b. Total system static pressure in inches wg.
 - c. Fan speed.
 - d. Inlet and discharge static pressure in inches wg.
 - e. For each filter bank, filter static-pressure differential in inches wg.
 - f. Preheat-coil static-pressure differential in inches wg.
 - g. Cooling-coil static-pressure differential in inches wg.
 - h. Heating-coil static-pressure differential in inches wg.
 - i. List for each internal component with pressure-drop, static-pressure differential in inches wg.
 - j. Outdoor airflow in cfm.
 - k. Return airflow in cfm.
 - l. Outdoor-air damper position.
 - m. Return-air damper position.

- F. Apparatus-Coil Test Reports:
1. Coil Data:
 - a. System identification.
 - b. Location.
 - c. Coil type.
 - d. Number of rows.
 - e. Fin spacing in fins per inch o.c.
 - f. Make and model number.
 - g. Face area in sq. ft..
 - h. Tube size in NPS.
 - i. Tube and fin materials.
 - j. Circuiting arrangement.
 2. Test Data (Indicated and Actual Values):
 - a. Airflow rate in cfm.
 - b. Average face velocity in fpm.
 - c. Air pressure drop in inches wg.
 - d. Outdoor-air, wet- and dry-bulb temperatures in deg F.
 - e. Return-air, wet- and dry-bulb temperatures in deg F.
 - f. Entering-air, wet- and dry-bulb temperatures in deg F.
 - g. Leaving-air, wet- and dry-bulb temperatures in deg F.
 - h. Water flow rate in gpm.
 - i. Water pressure differential in feet of head or psig.
 - j. Entering-water temperature in deg F.
 - k. Leaving-water temperature in deg F.
 - l. Refrigerant expansion valve and refrigerant types.
 - m. Refrigerant suction pressure in psig.
 - n. Refrigerant suction temperature in deg F.
 - o. Inlet steam pressure in psig.
- G. Fan Test Reports: For supply, return, and exhaust fans, include the following:
1. Fan Data:
 - a. System identification.
 - b. Location.
 - c. Make and type.
 - d. Model number and size.
 - e. Manufacturer's serial number.
 - f. Arrangement and class.
 - g. Sheave make, size in inches, and bore.
 - h. Center-to-center dimensions of sheave and amount of adjustments in inches.
 2. Motor Data:
 - a. Motor make, and frame type and size.
 - b. Horsepower and speed.
 - c. Volts, phase, and hertz.
 - d. Full-load amperage and service factor.
 - e. Sheave make, size in inches, and bore.
 - f. Center-to-center dimensions of sheave and amount of adjustments in inches.
 - g. Number, make, and size of belts.
 3. Test Data (Indicated and Actual Values):
 - a. Total airflow rate in cfm.
 - b. Total system static pressure in inches wg.
 - c. Fan speed.
 - d. Discharge static pressure in inches wg.
 - e. Suction static pressure in inches wg.

- H. Round, Flat-Oval, and Rectangular Duct Traverse Reports: Include a diagram with a grid representing the duct cross-section and record the following:
1. Report Data:
 - a. System fan and air-handling-unit number.
 - b. Location and zone.
 - c. Traverse air temperature in deg F.
 - d. Duct static pressure in inches wg.
 - e. Duct size in inches.
 - f. Duct area in sq. ft..
 - g. Indicated airflow rate in cfm.
 - h. Indicated velocity in fpm.
 - i. Actual airflow rate in cfm.
 - j. Actual average velocity in fpm.
 - k. Barometric pressure in psig.
- I. Air-Terminal-Device Reports:
1. Unit Data:
 - a. System and air-handling unit identification.
 - b. Location and zone.
 - c. Apparatus used for test.
 - d. Area served.
 - e. Make.
 - f. Number from system diagram.
 - g. Type and model number.
 - h. Size.
 - i. Effective area in sq. ft..
 2. Test Data (Indicated and Actual Values):
 - a. Airflow rate in cfm.
 - b. Air velocity in fpm.
 - c. Preliminary airflow rate as needed in cfm.
 - d. Preliminary velocity as needed in fpm.
 - e. Final airflow rate in cfm.
 - f. Final velocity in fpm.
 - g. Space temperature in deg F.
- J. System-Coil Reports: For reheat coils and water coils of terminal units, include the following:
1. Unit Data:
 - a. System and air-handling-unit identification.
 - b. Location and zone.
 - c. Room or riser served.
 - d. Coil make and size.
 - e. Flowmeter type.
 2. Test Data (Indicated and Actual Values):
 - a. Airflow rate in cfm.
 - b. Entering-water temperature in deg F.
 - c. Leaving-water temperature in deg F.
 - d. Water pressure drop in feet of head or psig.
 - e. Entering-air temperature in deg F.
 - f. Leaving-air temperature in deg F.
- K. Instrument Calibration Reports:
1. Report Data:
 - a. Instrument type and make.
 - b. Serial number.

- c. Application.
- d. Dates of use.
- e. Dates of calibration.

3.16 VERIFICATION OF TAB REPORT

- A. The TAB specialist's test and balance engineer shall conduct the inspection in the presence of Architect, Owner, Construction Manager, and Commissioning Authority.
- B. Architect or Commissioning Authority shall randomly select measurements, documented in the final report, to be rechecked. Rechecking shall be limited to the lesser of either 10 percent of the total measurements recorded or the extent of measurements that can be accomplished in a normal 8-hour business day.
- C. If rechecks yield measurements that differ from the measurements documented in the final report by more than the tolerances allowed, the measurements shall be noted as "FAILED."
- D. If the number of "FAILED" measurements is greater than 10 percent of the total measurements checked during the final inspection, the TAB shall be considered incomplete and shall be rejected.
- E. If recheck measurements find the number of failed measurements noncompliant with requirements indicated, proceed as follows:
 - 1. TAB specialists shall recheck all measurements and make adjustments. Revise the final report and balancing device settings to include all changes; resubmit the final report and request a second final inspection. All changes shall be tracked to show changes made to previous report.
 - 2. If the second final inspection also fails, Owner may pursue others Contract options to complete TAB work.
- F. Prepare test and inspection reports.

3.17 ADDITIONAL TESTS

- A. Seasonal Periods: If initial TAB procedures were not performed during near-peak summer and winter conditions, perform additional TAB during near-peak summer and winter conditions.

END OF SECTION 23 0593

SECTION 23 0713 - DUCT INSULATION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes insulating the following duct services:
 - 1. Indoor, concealed supply air.
 - 2. Indoor, exposed supply air.
- B. Related Sections:
 - 1. Section 23 0719 "HVAC Piping Insulation."

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated. Include thermal conductivity, water-vapor permeance thickness, and jackets (both factory- and field-applied if any).

1.4 INFORMATIONAL SUBMITTALS

- A. Field quality-control reports.

1.5 QUALITY ASSURANCE

- A. Surface-Burning Characteristics: For insulation and related materials, as determined by testing identical products according to ASTM E84, by a testing agency acceptable to authorities having jurisdiction. Factory label insulation and jacket materials and adhesive, mastic, tapes, and cement material containers, with appropriate markings of applicable testing agency.
 - 1. Insulation Installed Indoors: Flame-spread index of 25 or less, and smoke-developed index of 50 or less.
 - 2. Insulation Installed Outdoors: Flame-spread index of 75 or less, and smoke-developed index of 150 or less.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Packaging: Insulation material containers shall be marked by manufacturer with appropriate ASTM standard designation, type and grade, and maximum use temperature.

1.7 COORDINATION

- A. Coordinate sizes and locations of supports, hangers, and insulation shields specified in Section 23 0529 "Hangers and Supports for HVAC Piping and Equipment."
- B. Coordinate clearance requirements with duct Installer for duct insulation application. Before preparing ductwork Shop Drawings, establish and maintain clearance requirements for installation of insulation and field-applied jackets and finishes and for space required for maintenance.
- C. Coordinate installation and testing of heat tracing.

1.8 SCHEDULING

- A. Schedule insulation application after pressure testing systems and, where required, after installing and testing heat tracing. Insulation application may begin on segments that have satisfactory test results.
- B. Complete installation and concealment of plastic materials as rapidly as possible in each area of construction.

PART 2 - PRODUCTS

2.1 INSULATION MATERIALS

- A. Comply with requirements in "Duct Insulation Schedule, General," "Indoor Duct and Plenum Insulation Schedule," and "Aboveground, Outdoor Duct and Plenum Insulation Schedule" articles for where insulating materials shall be applied.
- B. Products shall not contain asbestos, lead, mercury, or mercury compounds.
- C. Products that come in contact with stainless steel shall have a leachable chloride content of less than 50 ppm when tested according to ASTM C871.
- D. Insulation materials for use on austenitic stainless steel shall be qualified as acceptable according to ASTM C795.
- E. Mineral-Fiber Blanket Insulation: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C553, Type II and ASTM C1290, Type III with factory-applied FSK jacket. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.
 - 1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. [Johns Manville; a Berkshire Hathaway company.](#)
 - b. [Knauf Insulation.](#)
 - c. [Owens Corning.](#)
- F. Mineral-Fiber Board Insulation: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C612, Type IA or Type IB. For duct and plenum applications, provide insulation with factory-applied FSK jacket. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.
 - 1. **Manufacturers:** Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. [Johns Manville; a Berkshire Hathaway company.](#)
 - b. [Knauf Insulation.](#)
 - c. [Owens Corning.](#)

2.2 ADHESIVES

- A. Materials shall be compatible with insulation materials, jackets, and substrates and for bonding insulation to itself and to surfaces to be insulated unless otherwise indicated.
- B. Mineral-Fiber Adhesive: Comply with MIL-A-3316C, Class 2, Grade A.

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Childers Brand; H. B. Fuller Construction Products.
 - b. Foster Brand; H. B. Fuller Construction Products.
 - c. Mon-Eco Industries, Inc.
 2. Verify fiberglass adhesive has a VOC content of 80 g/L or less when calculated in accordance with 40 CFR 59, Subpart D (EPA Method 24).
- C. ASJ Adhesive, and FSK Jacket Adhesive: Comply with MIL-A-3316C, Class 2, Grade A for bonding insulation jacket lap seams and joints.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following :
 - a. Childers Brand; H. B. Fuller Construction Products.
 - b. Foster Brand; H. B. Fuller Construction Products.
 - c. Mon-Eco Industries, Inc.
 2. Verify adhesive has a VOC content of 80 g/L or less when calculated in accordance with 40 CFR 59, Subpart D (EPA Method 24).

2.3 MASTICS AND COATINGS

- A. Materials shall be compatible with insulation materials, jackets, and substrates.
1. VOC Content: 300 g/L or less.
- B. Vapor-Retarder Mastic: Water based; suitable for indoor use on below ambient services.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Childers Brand; H. B. Fuller Construction Products.
 - b. Foster Brand; H. B. Fuller Construction Products.
 - c. Vimasco Corporation.
 2. Water-Vapor Permeance: Comply with ASTM C755, Section 7.2.2, Table 2, for insulation type and service conditions.
 3. Service Temperature Range: Minus 20 to plus 180 deg F.
 4. Comply with MIL-PRF-19565C, Type II, for permeance requirements.
 5. Color: White.
- C. Vapor-Retarder Mastic: Solvent based; suitable for indoor use on below ambient services.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Childers Brand; H. B. Fuller Construction Products.
 - b. Foster Brand; H. B. Fuller Construction Products.
 - c. Mon-Eco Industries, Inc.
 2. Water-Vapor Permeance: Comply with ASTM C755, Section 7.2.2, Table 2, for insulation type and service conditions.
 3. Service Temperature Range: 0 to 180 deg F.
 4. Color: White.
- D. Vapor-Retarder Mastic: Solvent based; suitable for outdoor use on below ambient services.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Childers Brand; H. B. Fuller Construction Products.

- b. [Eagle Bridges - Marathon Industries.](#)
 - c. [Foster Brand; H. B. Fuller Construction Products.](#)
 - 2. Water-Vapor Permeance: Comply with ASTM C755, Section 7.2.2, Table 2, for insulation type and service conditions.
 - 3. Service Temperature Range: Minus 50 to plus 220 deg F.
 - 4. Color: White.
- E. Breather Mastic: Water based; suitable for indoor and outdoor use on above ambient services.
 - 1. [Manufacturers:](#) Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. [Childers Brand; H. B. Fuller Construction Products.](#)
 - b. [Foster Brand; H. B. Fuller Construction Products.](#)
 - c. [Mon-Eco Industries, Inc.](#)
 - 2. Water-Vapor Permeance: ASTM E96, greater than 1.0 perm at manufacturer's recommended dry film thickness.
 - 3. Service Temperature Range: Minus 20 to plus 180 deg F.
 - 4. Color: White.

2.4 LAGGING ADHESIVES

- A. Description: Comply with MIL-A-3316C, Class I, Grade A and shall be compatible with insulation materials, jackets, and substrates.
 - 1. [Manufacturers:](#) Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. [Childers Brand; H. B. Fuller Construction Products.](#)
 - b. [Foster Brand; H. B. Fuller Construction Products.](#)
 - c. [Vimasco Corporation.](#)
 - 2. [Verify adhesives have a VOC](#) content of 50 g/L or less.
 - 3. Fire-resistant, water-based lagging adhesive and coating for use indoors to adhere fire-resistant lagging cloths over duct insulation.
 - 4. Service Temperature Range: 0 to plus 180 deg F.
 - 5. Color: White.

2.5 SEALANTS

- A. FSK and Metal Jacket Flashing Sealants:
 - 1. [Manufacturers:](#) Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. [Childers Brand; H. B. Fuller Construction Products.](#)
 - b. [Foster Brand; H. B. Fuller Construction Products.](#)
 - c. [Mon-Eco Industries, Inc.](#)
 - 2. Materials shall be compatible with insulation materials, jackets, and substrates.
 - 3. Fire- and water-resistant, flexible, elastomeric sealant.
 - 4. Service Temperature Range: Minus 40 to plus 250 deg F.
 - 5. Color: Aluminum.
 - 6. [Verify sealant has a VOC](#) content of 420 g/L or less.
- B. ASJ Flashing Sealants, and Vinyl and PVC Jacket Flashing Sealants:
 - 1. [Manufacturers:](#) Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. [Childers Brand; H. B. Fuller Construction Products.](#)

2. Materials shall be compatible with insulation materials, jackets, and substrates.
3. Fire- and water-resistant, flexible, elastomeric sealant.
4. Service Temperature Range: Minus 40 to plus 250 deg F.
5. Color: White.
6. [Verify sealant has a VOC](#) content of 420 g/L or less.

2.6 FACTORY-APPLIED JACKETS

- A. Insulation system schedules indicate factory-applied jackets on various applications. When factory-applied jackets are indicated, comply with the following:
 1. ASJ: White, kraft-paper, fiberglass-reinforced scrim with aluminum-foil backing; complying with ASTM C1136, Type I.
 2. ASJ-SSL: ASJ with self-sealing, pressure-sensitive, acrylic-based adhesive covered by a removable protective strip; complying with ASTM C1136, Type I.
 3. FSK Jacket: Aluminum-foil, fiberglass-reinforced scrim with kraft-paper backing; complying with ASTM C1136, Type II.
 4. FSP Jacket: Aluminum-foil, fiberglass-reinforced scrim with polyethylene backing; complying with ASTM C1136, Type II.
 5. Vinyl Jacket: White vinyl with a permeance of 1.3 perms when tested according to ASTM E96/E96M, Procedure A, and complying with NFPA 90A and NFPA 90B.

2.7 FIELD-APPLIED FABRIC-REINFORCING MESH

- A. Woven Glass-Fiber Fabric: Approximately 6 oz./sq. yd. with a thread count of 5 strands by 5 strands/sq. in. for covering ducts.
 1. [Manufacturers:](#) Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. [Childers Brand; H. B. Fuller Construction Products.](#)
- B. Woven Polyester Fabric: Approximately 1 oz./sq. yd. with a thread count of 10 strands by 10 strands/sq. in., in a Leno weave, for ducts.
 1. [Manufacturers:](#) Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. [Foster Brand; H. B. Fuller Construction Products.](#)
 - b. [Vimasco Corporation.](#)

2.8 FIELD-APPLIED CLOTHS

- A. Woven Glass-Fiber Fabric: Comply with MIL-C-20079H, Type I, plain weave, and presized a minimum of 8 oz./sq. yd..
 1. [Manufacturers:](#) Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. [Alpha Associates, Inc.](#)

2.9 FIELD-APPLIED JACKETS

- A. Field-applied jackets shall comply with ASTM C921, Type I, unless otherwise indicated.
- B. FSK Jacket: Aluminum-foil-face, fiberglass-reinforced scrim with kraft-paper backing.

2.10 TAPES

- A. ASJ Tape: White vapor-retarder tape matching factory-applied jacket with acrylic adhesive, complying with ASTM C1136.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Avery Dennison Corporation, Specialty Tapes Division.
 - b. Ideal Tape Co., Inc., an American Biltrite Company.
 - c. Venture Tape.
 2. Width: 3 inches.
 3. Thickness: 11.5 mils.
 4. Adhesion: 90 ounces force/inch in width.
 5. Elongation: 2 percent.
 6. Tensile Strength: 40 lbf/inch in width.
 7. ASJ Tape Disks and Squares: Precut disks or squares of ASJ tape.
- B. FSK Tape: Foil-face, vapor-retarder tape matching factory-applied jacket with acrylic adhesive; complying with ASTM C1136.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Avery Dennison Corporation, Specialty Tapes Division.
 - b. Ideal Tape Co., Inc., an American Biltrite Company.
 - c. Venture Tape.
 2. Width: 3 inches.
 3. Thickness: 6.5 mils.
 4. Adhesion: 90 ounces force/inch in width.
 5. Elongation: 2 percent.
 6. Tensile Strength: 40 lbf/inch in width.
 7. FSK Tape Disks and Squares: Precut disks or squares of FSK tape.
- C. Aluminum-Foil Tape: Vapor-retarder tape with acrylic adhesive.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Avery Dennison Corporation, Specialty Tapes Division.
 - b. Ideal Tape Co., Inc., an American Biltrite Company.
 - c. Venture Tape.
 2. Width: 2 inches.
 3. Thickness: 3.7 mils.
 4. Adhesion: 100 ounces force/inch in width.
 5. Elongation: 5 percent.
 6. Tensile Strength: 34 lbf/inch in width.

2.11 SECUREMENTS

- A. Bands:
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. ITW Insulation Systems; Illinois Tool Works, Inc.
 - b. RPR Products, Inc.
 2. Stainless Steel: ASTM A167 or ASTM A240/A240M, Type 304 or Type 316; 0.015 inch thick, 3/4 inch wide with wing seal or closed seal.

3. Aluminum: ASTM B209, Alloy 3003, 3005, 3105, or 5005; Temper H-14, 0.020 inch thick, 3/4 inch wide with wing seal or closed seal.

B. Insulation Pins and Hangers:

1. Capacitor-Discharge-Weld Pins: Copper- or zinc-coated steel pin, fully annealed for capacitor-discharge welding, 0.106-inch- diameter shank, length to suit depth of insulation indicated.
 - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1) AGM Industries, Inc.
 - 2) Hardcast; a Carlisle Company.
 - 3) Nelson Stud Welding.
2. Cupped-Head, Capacitor-Discharge-Weld Pins: Copper- or zinc-coated steel pin, fully annealed for capacitor-discharge welding, 0.106-inch- diameter shank, length to suit depth of insulation indicated with integral 1-1/2-inch galvanized carbon-steel washer.
 - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1) AGM Industries, Inc.
 - 2) Hardcast; a Carlisle Company.
 - 3) Nelson Stud Welding.
3. Self-Sticking-Base Insulation Hangers: Baseplate welded to projecting spindle that is capable of holding insulation, of thickness indicated, securely in position indicated when self-locking washer is in place. Comply with the following requirements:
 - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1) AGM Industries, Inc.
 - 2) Hardcast; a Carlisle Company.
 - 3) Midwest Fasteners, Inc.
 - b. Baseplate: Galvanized carbon-steel sheet, 0.030 inch thick by 2 inches square.
 - c. Spindle: Copper- or zinc-coated, low-carbon steel, Aluminum, or Stainless steel, fully annealed, 0.106-inch-diameter shank, length to suit depth of insulation indicated.
 - d. Adhesive-backed base with a peel-off protective cover.
4. Insulation-Retaining Washers: Self-locking washers formed from 0.016-inch-thick, galvanized-steel, aluminum, or stainless-steel sheet, with beveled edge sized as required to hold insulation securely in place but not less than 1-1/2 inches in diameter.
 - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1) AGM Industries, Inc.
 - 2) Hardcast; a Carlisle Company.
 - 3) Midwest Fasteners, Inc.
 - 4) Nelson Stud Welding.
 - b. Protect ends with capped self-locking washers incorporating a spring steel insert to ensure permanent retention of cap in exposed locations.
5. Nonmetal Insulation-Retaining Washers: Self-locking washers formed from 0.016-inch-thick nylon sheet, with beveled edge sized as required to hold insulation securely in place but not less than 1-1/2 inches in diameter.
 - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1) Gemco.

2) Midwest Fasteners, Inc.

- C. Staples: Outward-clinching insulation staples, nominal 3/4-inch-wide, stainless steel or Monel.
- D. Wire: 0.062-inch soft-annealed, stainless steel.
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. C & F Wire.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates and conditions for compliance with requirements for installation tolerances and other conditions affecting performance of insulation application.
 - 1. Verify that systems to be insulated have been tested and are free of defects.
 - 2. Verify that surfaces to be insulated are clean and dry.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Surface Preparation: Clean and dry surfaces to receive insulation. Remove materials that will adversely affect insulation application.

3.3 GENERAL INSTALLATION REQUIREMENTS

- A. Install insulation materials, accessories, and finishes with smooth, straight, and even surfaces; free of voids throughout the length of ducts and fittings.
- B. Install insulation materials, vapor barriers or retarders, jackets, and thicknesses required for each item of duct system as specified in insulation system schedules.
- C. Install accessories compatible with insulation materials and suitable for the service. Install accessories that do not corrode, soften, or otherwise attack insulation or jacket in either wet or dry state.
- D. Install insulation with longitudinal seams at top and bottom of horizontal runs.
- E. Install multiple layers of insulation with longitudinal and end seams staggered.
- F. Keep insulation materials dry during application and finishing.
- G. Install insulation with tight longitudinal seams and end joints. Bond seams and joints with adhesive recommended by insulation material manufacturer.
- H. Install insulation with least number of joints practical.
- I. Where vapor barrier is indicated, seal joints, seams, and penetrations in insulation at hangers, supports, anchors, and other projections with vapor-barrier mastic.
 - 1. Install insulation continuously through hangers and around anchor attachments.

2. For insulation application where vapor barriers are indicated, extend insulation on anchor legs from point of attachment to supported item to point of attachment to structure. Taper and seal ends at attachment to structure with vapor-barrier mastic.
 3. Install insert materials and install insulation to tightly join the insert. Seal insulation to insulation inserts with adhesive or sealing compound recommended by insulation material manufacturer.
- J. Apply adhesives, mastics, and sealants at manufacturer's recommended coverage rate and wet and dry film thicknesses.
- K. Install insulation with factory-applied jackets as follows:
1. Draw jacket tight and smooth.
 2. Cover circumferential joints with 3-inch-wide strips, of same material as insulation jacket. Secure strips with adhesive and outward clinching staples along both edges of strip, spaced 4 inches o.c.
 3. Overlap jacket longitudinal seams at least 1-1/2 inches. Clean and dry surface to receive self-sealing lap. Staple laps with outward clinching staples along edge at 2 inches o.c.
 - a. For below ambient services, apply vapor-barrier mastic over staples.
 4. Cover joints and seams with tape, according to insulation material manufacturer's written instructions, to maintain vapor seal.
 5. Where vapor barriers are indicated, apply vapor-barrier mastic on seams and joints and at ends adjacent to duct flanges and fittings.
- L. Cut insulation in a manner to avoid compressing insulation more than 75 percent of its nominal thickness.
- M. Finish installation with systems at operating conditions. Repair joint separations and cracking due to thermal movement.
- N. Repair damaged insulation facings by applying same facing material over damaged areas. Extend patches at least 4 inches beyond damaged areas. Adhere, staple, and seal patches similar to butt joints.

3.4 PENETRATIONS

- A. Insulation Installation at Roof Penetrations: Install insulation continuously through roof penetrations.
1. Seal penetrations with flashing sealant.
 2. For applications requiring only indoor insulation, terminate insulation above roof surface and seal with joint sealant. For applications requiring indoor and outdoor insulation, install insulation for outdoor applications tightly joined to indoor insulation ends. Seal joint with joint sealant.
 3. Extend jacket of outdoor insulation outside roof flashing at least 2 inches below top of roof flashing.
 4. Seal jacket to roof flashing with flashing sealant.
- B. Insulation Installation at Aboveground Exterior Wall Penetrations: Install insulation continuously through wall penetrations.
1. Seal penetrations with flashing sealant.
 2. For applications requiring only indoor insulation, terminate insulation inside wall surface and seal with joint sealant. For applications requiring indoor and outdoor insulation, install insulation for outdoor applications tightly joined to indoor insulation ends. Seal joint with joint sealant.
 3. Extend jacket of outdoor insulation outside wall flashing and overlap wall flashing at least 2 inches.

4. Seal jacket to wall flashing with flashing sealant.
 - C. Insulation Installation at Interior Wall and Partition Penetrations (That Are Not Fire Rated): Install insulation continuously through walls and partitions.
 - D. Insulation Installation at Fire-Rated Wall and Partition Penetrations: Terminate insulation at fire damper sleeves for fire-rated wall and partition penetrations. Externally insulate damper sleeves to match adjacent insulation and overlap duct insulation at least 2 inches.
 1. Comply with requirements in Section 07 8413 "Penetration Firestopping."
- 3.5 INSTALLATION OF MINERAL-FIBER INSULATION
- A. Blanket Insulation Installation on Ducts and Plenums: Secure with adhesive and insulation pins.
 1. Apply adhesives according to manufacturer's recommended coverage rates per unit area, for 100 percent coverage of duct and plenum surfaces.
 2. Apply adhesive to entire circumference of ducts and to all surfaces of fittings and transitions.
 3. Install either capacitor-discharge-weld pins and speed washers or cupped-head, capacitor-discharge-weld pins on sides and bottom of horizontal ducts and sides of vertical ducts as follows:
 - a. On duct sides with dimensions 18 inches and smaller, place pins along longitudinal centerline of duct. Space 3 inches maximum from insulation end joints, and 16 inches o.c.
 - b. On duct sides with dimensions larger than 18 inches, place pins 16 inches o.c. each way, and 3 inches maximum from insulation joints. Install additional pins to hold insulation tightly against surface at cross bracing.
 - c. Pins may be omitted from top surface of horizontal, rectangular ducts and plenums.
 - d. Do not overcompress insulation during installation.
 - e. Impale insulation over pins and attach speed washers.
 - f. Cut excess portion of pins extending beyond speed washers or bend parallel with insulation surface. Cover exposed pins and washers with tape matching insulation facing.
 4. For ducts and plenums with surface temperatures below ambient, install a continuous unbroken vapor barrier. Create a facing lap for longitudinal seams and end joints with insulation by removing 2 inches from one edge and one end of insulation segment. Secure laps to adjacent insulation section with 1/2-inch outward-clinching staples, 1 inch o.c. Install vapor barrier consisting of factory- or field-applied jacket, adhesive, vapor-barrier mastic, and sealant at joints, seams, and protrusions.
 - a. Repair punctures, tears, and penetrations with tape or mastic to maintain vapor-barrier seal.
 - b. Install vapor stops for ductwork and plenums operating below 50 deg F at 18-foot intervals. Vapor stops shall consist of vapor-barrier mastic applied in a Z-shaped pattern over insulation face, along butt end of insulation, and over the surface. Cover insulation face and surface to be insulated a width equal to two times the insulation thickness, but not less than 3 inches.
 5. Overlap unfaced blankets a minimum of 2 inches on longitudinal seams and end joints. At end joints, secure with steel bands spaced a maximum of 18 inches o.c.
 6. Install insulation on rectangular duct elbows and transitions with a full insulation section for each surface. Install insulation on round and flat-oval duct elbows with individually mitered gores cut to fit the elbow.
 7. Insulate duct stiffeners, hangers, and flanges that protrude beyond insulation surface with 6-inch-wide strips of same material used to insulate duct. Secure on alternating sides of stiffener, hanger, and flange with pins spaced 6 inches o.c.

- B. Board Insulation Installation on Ducts and Plenums: Secure with adhesive and insulation pins.
1. Apply adhesives according to manufacturer's recommended coverage rates per unit area, for 100 percent coverage of duct and plenum surfaces.
 2. Apply adhesive to entire circumference of ducts and to all surfaces of fittings and transitions.
 3. Install either capacitor-discharge-weld pins and speed washers or cupped-head, capacitor-discharge-weld pins on sides and bottom of horizontal ducts and sides of vertical ducts as follows:
 - a. On duct sides with dimensions 18 inches and smaller, place pins along longitudinal centerline of duct. Space 3 inches maximum from insulation end joints, and 16 inches o.c.
 - b. On duct sides with dimensions larger than 18 inches, space pins 16 inches o.c. each way, and 3 inches maximum from insulation joints. Install additional pins to hold insulation tightly against surface at cross bracing.
 - c. Pins may be omitted from top surface of horizontal, rectangular ducts and plenums.
 - d. Do not overcompress insulation during installation.
 - e. Cut excess portion of pins extending beyond speed washers or bend parallel with insulation surface. Cover exposed pins and washers with tape matching insulation facing.
 4. For ducts and plenums with surface temperatures below ambient, install a continuous unbroken vapor barrier. Create a facing lap for longitudinal seams and end joints with insulation by removing 2 inches from one edge and one end of insulation segment. Secure laps to adjacent insulation section with 1/2-inch outward-clinching staples, 1 inch o.c. Install vapor barrier consisting of factory- or field-applied jacket, adhesive, vapor-barrier mastic, and sealant at joints, seams, and protrusions.
 - a. Repair punctures, tears, and penetrations with tape or mastic to maintain vapor-barrier seal.
 - b. Install vapor stops for ductwork and plenums operating below 50 deg F at 18-foot intervals. Vapor stops shall consist of vapor-barrier mastic applied in a Z-shaped pattern over insulation face, along butt end of insulation, and over the surface. Cover insulation face and surface to be insulated a width equal to two times the insulation thickness, but not less than 3 inches.
 5. Install insulation on rectangular duct elbows and transitions with a full insulation section for each surface. Groove and score insulation to fit as closely as possible to outside and inside radius of elbows. Install insulation on round and flat-oval duct elbows with individually mitered gores cut to fit the elbow.
 6. Insulate duct stiffeners, hangers, and flanges that protrude beyond insulation surface with 6-inch-wide strips of same material used to insulate duct. Secure on alternating sides of stiffener, hanger, and flange with pins spaced 6 inches o.c.

3.6 FIELD-APPLIED JACKET INSTALLATION

- A. Where glass-cloth jackets are indicated, install directly over bare insulation or insulation with factory-applied jackets.
1. Draw jacket smooth and tight to surface with 2-inch overlap at seams and joints.
 2. Embed glass cloth between two 0.062-inch-thick coats of lagging adhesive.
 3. Completely encapsulate insulation with coating, leaving no exposed insulation.
- B. Where FSK jackets are indicated, install as follows:
1. Draw jacket material smooth and tight.
 2. Install lap or joint strips with same material as jacket.
 3. Secure jacket to insulation with manufacturer's recommended adhesive.
 4. Install jacket with 1-1/2-inch laps at longitudinal seams and 3-inch-wide joint strips at end joints.

5. Seal openings, punctures, and breaks in vapor-retarder jackets and exposed insulation with vapor-barrier mastic.

3.7 FINISHES

- A. Insulation with ASJ, Glass-Cloth, or Other Paintable Jacket Material: Paint jacket with paint system identified below and as specified in Section 09 9113 "Exterior Painting" and Section 09 9123 "Interior Painting."
 1. Flat Acrylic Finish: Two finish coats over a primer that is compatible with jacket material and finish coat paint. Add fungicidal agent to render fabric mildew proof.
 - a. Finish Coat Material: Interior, flat, latex-emulsion size.
- B. Color: Final color as selected by Architect. Vary first and second coats to allow visual inspection of the completed Work.
- C. Do not field paint aluminum or stainless-steel jackets.

3.8 FIELD QUALITY CONTROL

- A. Testing Agency: Engage a qualified testing agency to perform tests and inspections.
- B. Perform tests and inspections.
- C. Tests and Inspections:
 1. Inspect ductwork, randomly selected by Architect, by removing field-applied jacket and insulation in layers in reverse order of their installation. Extent of inspection shall be limited to one location(s) for each duct system defined in the "Duct Insulation Schedule, General" Article.
- D. All insulation applications will be considered defective Work if sample inspection reveals noncompliance with requirements.

3.9 DUCT INSULATION SCHEDULE, GENERAL

- A. Plenums and Ducts Requiring Insulation:
 1. Indoor, concealed supply air.
 2. Indoor, exposed supply air.
- B. Items Not Insulated:
 1. Fibrous-glass ducts.
 2. Metal ducts with duct liner of sufficient thickness to comply with energy code and ASHRAE/IESNA 90.1.
 3. Factory-insulated flexible ducts.
 4. Factory-insulated plenums and casings.
 5. Flexible connectors.
 6. Vibration-control devices.
 7. Factory-insulated access panels and doors.

3.10 INDOOR DUCT AND PLENUM INSULATION SCHEDULE

- A. Concealed, rectangular, round, and flat-oval, supply-air duct and plenum insulation shall be the following:
 1. Mineral-Fiber Blanket: 1-1/2 inches thick and 0.75-lb/cu. ft. nominal density.

- B. Exposed, rectangular, round, and flat-oval, supply-air duct and plenum insulation shall be the following:
 - 1. Mineral-Fiber Board: 1-1/2 inches thick and 2-lb/cu. ft. nominal density.

3.11 INDOOR, FIELD-APPLIED JACKET SCHEDULE

- A. Install jacket over insulation material. For insulation with factory-applied jacket, install the field-applied jacket over the factory-applied jacket.
- B. If more than one material is listed, selection from materials listed is Contractor's option.
- C. Ducts and Plenums, Concealed:
 - 1. None.
- D. Ducts and Plenums, Exposed, only where indicated to receive jackets:
 - 1. Aluminum, Smooth: 0.016 inch thick.

END OF SECTION 23 0713

SECTION 23 0719 - HVAC PIPING INSULATION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes insulation for HVAC piping systems.
- B. Related Requirements:
 - 1. Section 23 0713 "Duct Insulation" for duct insulation.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product. Include thermal conductivity, water-vapor permeance thickness, and jackets (both factory and field applied if any).

1.4 INFORMATIONAL SUBMITTALS

- A. Field quality-control reports.

1.5 QUALITY ASSURANCE

- A. Surface-Burning Characteristics: For insulation and related materials, as determined by testing identical products in accordance with ASTM E84, by a testing agency acceptable to authorities having jurisdiction. Factory label insulation and jacket materials and adhesive, mastic, tapes, and cement material containers, with appropriate markings of applicable testing agency.
 - 1. Insulation Installed Indoors: Flame-spread index of 25 or less, and smoke-developed index of 50 or less.
 - 2. Insulation Installed Outdoors: Flame-spread index of 75 or less, and smoke-developed index of 150 or less.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Packaging: Insulation material containers shall be marked by manufacturer with appropriate ASTM standard designation, type and grade, and maximum use temperature.

1.7 COORDINATION

- A. Coordinate sizes and locations of supports, hangers, and insulation shields specified in Section 23 0529 "Hangers and Supports for HVAC Piping and Equipment."
- B. Coordinate clearance requirements with piping Installer for piping insulation application. Before preparing piping Shop Drawings, establish and maintain clearance requirements for installation of insulation and field-applied jackets and finishes and for space required for maintenance.

1.8 SCHEDULING

- A. Schedule insulation application after pressure testing systems and, where required, after installing and testing heat tracing. Insulation application may begin on segments that have satisfactory test results.

- B. Complete installation and concealment of plastic materials as rapidly as possible in each area of construction.

PART 2 - PRODUCTS

2.1 INSULATION MATERIALS

- A. Comply with requirements in "Piping Insulation Schedule, General," "Indoor Piping Insulation Schedule" articles for where insulating materials shall be applied.
- B. Products shall not contain asbestos, lead, mercury, or mercury compounds.
- C. Products that come into contact with stainless steel shall have a leachable chloride content of less than 50 ppm when tested in accordance with ASTM C871.
- D. Insulation materials for use on austenitic stainless steel shall be qualified as acceptable in accordance with ASTM C795.
- E. Foam insulation materials shall not use CFC or HCFC blowing agents in the manufacturing process.
- F. Flexible Elastomeric: Closed-cell, sponge- or expanded-rubber materials. Comply with ASTM C534/C534M, Type I for tubular materials, Type II for sheet materials.
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Aeroflex USA.
 - b. Armacell LLC.
 - c. K-Flex USA.

2.2 ADHESIVES

- A. Materials shall be compatible with insulation materials, jackets, and substrates and for bonding insulation to itself and to surfaces to be insulated unless otherwise indicated.
- B. Flexible Elastomeric and Polyolefin Adhesive: Solvent-based adhesive.
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Aeroflex USA.
 - b. Armacell LLC.
 - c. K-Flex USA.
 - 2. Adhesive: As recommended by flexible elastomeric and polyolefin manufacturer and with a VOC content of 80 g/L or less.
 - 3. Flame-spread index shall be 25 or less and smoke-developed index shall be 50 or less as tested in accordance with ASTM E84.
 - 4. Wet Flash Point: Below 0 deg F.
 - 5. Service Temperature Range: 40 to 200 deg F.
 - 6. Color: Black.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates and conditions for compliance with requirements for installation tolerances and other conditions affecting performance of insulation application.

1. Verify that systems to be insulated have been tested and are free of defects.
2. Verify that surfaces to be insulated are clean and dry.

B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Clean and dry surfaces to receive insulation. Remove materials that will adversely affect insulation application.
- B. Clean and prepare surfaces to be insulated. Before insulating, apply a corrosion coating to insulated surfaces as follows:
1. Carbon Steel: Coat carbon steel operating at a service temperature of between 32 and 300 deg F with an epoxy coating. Consult coating manufacturer for appropriate coating materials and application methods for operating temperature range.

3.3 GENERAL INSTALLATION REQUIREMENTS

- A. Install insulation materials, accessories, and finishes with smooth, straight, and even surfaces; free of voids throughout the length of piping, including fittings, valves, and specialties.
- B. Install insulation materials, forms, vapor barriers or retarders, jackets, and of thicknesses required for each item of pipe system, as specified in insulation system schedules.
- C. Install accessories compatible with insulation materials and suitable for the service. Install accessories that do not corrode, soften, or otherwise attack insulation or jacket in either wet or dry state.
- D. Install insulation with longitudinal seams at top and bottom of horizontal runs.
- E. Install multiple layers of insulation with longitudinal and end seams staggered.
- F. Do not weld brackets, clips, or other attachment devices to piping, fittings, and specialties.
- G. Keep insulation materials dry during storage, application, and finishing. Replace insulation materials that get wet.
- H. Install insulation with tight longitudinal seams and end joints. Bond seams and joints with adhesive recommended by insulation material manufacturer.
- I. Install insulation with least number of joints practical.
- J. Where vapor barrier is indicated, seal joints, seams, and penetrations in insulation at hangers, supports, anchors, and other projections with vapor-barrier mastic.
1. Install insulation continuously through hangers and around anchor attachments.
 2. For insulation application where vapor barriers are indicated, extend insulation on anchor legs from point of attachment to supported item to point of attachment to structure. Taper and seal ends attached to structure with vapor-barrier mastic.
 3. Install insert materials and insulation to tightly join the insert. Seal insulation to insulation inserts with adhesive or sealing compound recommended by insulation material manufacturer.
 4. Cover inserts with jacket material matching adjacent pipe insulation. Install shields over jacket, arranged to protect jacket from tear or puncture by hanger, support, and shield.

- K. Apply adhesives, mastics, and sealants at manufacturer's recommended coverage rate and wet and dry film thicknesses.
- L. Install insulation with factory-applied jackets as follows:
 - 1. Draw jacket tight and smooth.
 - 2. Cover circumferential joints with 3-inch-wide strips, of same material as insulation jacket. Secure strips with adhesive and outward-clinching staples along both edges of strip, spaced 4 inches o.c.
 - 3. Overlap jacket longitudinal seams at least 1-1/2 inches. Install insulation with longitudinal seams at bottom of pipe. Clean and dry surface to receive self-sealing lap. Staple laps with outward-clinching staples along edge at 2 inches o.c.
 - a. For below-ambient services, apply vapor-barrier mastic over staples.
 - 4. Cover joints and seams with tape, in accordance with insulation material manufacturer's written instructions, to maintain vapor seal.
 - 5. Where vapor barriers are indicated, apply vapor-barrier mastic on seams and joints and at ends adjacent to pipe flanges and fittings.
- M. Cut insulation in a manner to avoid compressing insulation more than 25 percent of its nominal thickness.
- N. Finish installation with systems at operating conditions. Repair joint separations and cracking due to thermal movement.
- O. Repair damaged insulation facings by applying same facing material over damaged areas. Extend patches at least 4 inches beyond damaged areas. Adhere, staple, and seal patches in similar fashion to butt joints.
- P. For above-ambient services, do not install insulation to the following:
 - 1. Vibration-control devices.
 - 2. Testing agency labels and stamps.
 - 3. Nameplates and data plates.

3.4 PENETRATIONS

- A. Insulation Installation at Roof Penetrations: Install insulation continuously through roof penetrations.
 - 1. Seal penetrations with flashing sealant.
 - 2. For applications requiring only indoor insulation, terminate insulation above roof surface and seal with joint sealant. For applications requiring indoor and outdoor insulation, install insulation for outdoor applications tightly joined to indoor insulation ends. Seal joint with joint sealant.
 - 3. Extend jacket of outdoor insulation outside roof flashing at least 2 inches below top of roof flashing.
 - 4. Seal jacket to roof flashing with flashing sealant.
- B. Insulation Installation at Underground Exterior Wall Penetrations: Terminate insulation flush with sleeve seal. Seal terminations with flashing sealant.
- C. Insulation Installation at Aboveground Exterior Wall Penetrations: Install insulation continuously through wall penetrations.
 - 1. Seal penetrations with flashing sealant.
 - 2. For applications requiring only indoor insulation, terminate insulation inside wall surface and seal with joint sealant. For applications requiring indoor and outdoor insulation, install insulation for outdoor applications tightly joined to indoor insulation ends. Seal joint with joint sealant.

3. Extend jacket of outdoor insulation outside wall flashing and overlap wall flashing at least 2 inches.
 4. Seal jacket to wall flashing with flashing sealant.
- D. Insulation Installation at Interior Wall and Partition Penetrations (That Are Not Fire Rated): Install insulation continuously through walls and partitions.
- E. Insulation Installation at Fire-Rated Wall and Partition Penetrations: Install insulation continuously through penetrations of fire-rated walls and partitions.
1. Comply with requirements in Section 07 8413 "Penetration Firestopping" for firestopping and fire-resistive joint sealers.
- F. Insulation Installation at Floor Penetrations:
1. Pipe: Install insulation continuously through floor penetrations.
 2. Seal penetrations through fire-rated assemblies. Comply with requirements in Section 07 8413 "Penetration Firestopping."

3.5 GENERAL PIPE INSULATION INSTALLATION

- A. Requirements in this article generally apply to all insulation materials, except where more specific requirements are specified in various pipe insulation material installation articles.
- B. Insulation Installation on Fittings, Valves, Strainers, Flanges, Mechanical Couplings, and Unions:
1. Install insulation over fittings, valves, strainers, flanges, mechanical couplings, unions, and other specialties with continuous thermal and vapor-retarder integrity unless otherwise indicated.
 2. Insulate pipe elbows using preformed fitting insulation or mitered fittings made from same material and density as that of adjacent pipe insulation. Each piece shall be butted tightly against adjoining piece and bonded with adhesive. Fill joints, seams, voids, and irregular surfaces with insulating cement finished to a smooth, hard, and uniform contour that is uniform with adjoining pipe insulation.
 3. Insulate tee fittings with preformed fitting insulation or sectional pipe insulation of same material and thickness as that used for adjacent pipe. Cut sectional pipe insulation to fit. Butt each section closely to the next and hold in place with tie wire. Bond pieces with adhesive.
 4. Insulate valves using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as that used for adjacent pipe. Overlap adjoining pipe insulation by not less than 2 times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. For valves, insulate up to and including the bonnets, valve stuffing-box studs, bolts, and nuts. Fill joints, seams, and irregular surfaces with insulating cement.
 5. Insulate strainers using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as that used for adjacent pipe. Overlap adjoining pipe insulation by not less than 2 times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. Fill joints, seams, and irregular surfaces with insulating cement. Insulate strainers, so strainer basket flange or plug can be easily removed and replaced without damaging the insulation and jacket. Provide a removable reusable insulation cover. For below-ambient services, provide a design that maintains vapor barrier.
 6. Insulate flanges, mechanical couplings, and unions using a section of oversized preformed pipe insulation to fit. Overlap adjoining pipe insulation by not less than 2 times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. Stencil or label the outside insulation jacket of each union with the word "union" matching size and color of pipe labels.
 7. Cover segmented insulated surfaces with a layer of finishing cement and coat with a mastic. Install vapor-barrier mastic for below-ambient services and a breather mastic for

- above-ambient services. Reinforce the mastic with reinforcing mesh. Trowel the mastic to a smooth and well-shaped contour.
8. For services not specified to receive a field-applied jacket, except for flexible elastomeric and polyolefin, install fitted PVC cover over elbows, tees, strainers, valves, flanges, and unions. Terminate ends with PVC end caps. Tape PVC covers to adjoining insulation facing, using PVC tape.
- C. Insulate instrument connections for thermometers, pressure gages, pressure temperature taps, test connections, flow meters, sensors, switches, and transmitters on insulated pipes. Shape insulation at these connections by tapering it to and around the connection with insulating cement and finish with finishing cement, mastic, and flashing sealant.
 - D. Install removable insulation covers at locations indicated. Installation shall conform to the following:
 1. Make removable flange and union insulation from sectional pipe insulation of same thickness as that on adjoining pipe. Install same insulation jacket as that of adjoining pipe insulation.
 2. When flange and union covers are made from sectional pipe insulation, extend insulation from flanges or union at least 2 times the insulation thickness over adjacent pipe insulation on each side of flange or union. Secure flange cover in place with stainless steel or aluminum bands. Select band material compatible with insulation and jacket.
 3. Construct removable valve insulation covers in same manner as for flanges, except divide the two-part section on the vertical center line of valve body.
 4. When covers are made from block insulation, make two halves, each consisting of mitered blocks wired to stainless steel fabric. Secure this wire frame, with its attached insulation, to flanges with tie wire. Extend insulation at least 2 inches over adjacent pipe insulation on each side of valve. Fill space between flange or union cover and pipe insulation with insulating cement. Finish cover assembly with insulating cement applied in two coats. After first coat is dry, apply and trowel second coat to a smooth finish.

3.6 INSTALLATION OF FLEXIBLE ELASTOMERIC INSULATION

- A. Seal longitudinal seams and end joints with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.
- B. Insulation Installation on Pipe Flanges:
 1. Install pipe insulation to outer diameter of pipe flange.
 2. Make width of insulation section same as overall width of flange and bolts, plus twice the thickness of pipe insulation.
 3. Fill voids between inner circumference of flange insulation and outer circumference of adjacent straight pipe segments with cut sections of sheet insulation of same thickness as that of pipe insulation.
 4. Secure insulation to flanges and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.
- C. Insulation Installation on Pipe Fittings and Elbows:
 1. Install mitered sections of pipe insulation.
 2. Secure insulation materials and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.
- D. Insulation Installation on Valves and Pipe Specialties:
 1. Install preformed valve covers manufactured of same material as that of pipe insulation when available.
 2. When preformed valve covers are not available, install cut sections of pipe and sheet insulation to valve body. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.

3. Install insulation to flanges as specified for flange insulation application.
4. Secure insulation to valves and specialties, and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.

3.7 FINISHES

- A. Flexible Elastomeric Thermal Insulation: After adhesive has fully cured, apply two coats of insulation manufacturer's recommended protective coating.

3.8 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Tests and Inspections: Inspect pipe, fittings, strainers, and valves, randomly selected by Architect, by removing field-applied jacket and insulation in layers in reverse order of their installation. Extent of inspection shall be limited to three locations of straight pipe, three locations of threaded fittings, three locations of welded fittings, two locations of threaded strainers, two locations of welded strainers, three locations of threaded valves, and three locations of flanged valves for each pipe service defined in the "Piping Insulation Schedule, General" Article.
- C. All insulation applications will be considered defective if they do not pass tests and inspections.
- D. Prepare test and inspection reports.

3.9 PIPING INSULATION SCHEDULE, GENERAL

- A. Insulation conductivity and thickness per pipe size shall comply with schedules in this Section or with requirements of authorities having jurisdiction, whichever is more stringent.
- B. Acceptable preformed pipe and tubular insulation materials and thicknesses are identified for each piping system and pipe size range. If more than one material is listed for a piping system, selection from materials listed is Contractor's option.
- C. Items Not Insulated: Unless otherwise indicated, do not install insulation on the following:
 1. Underground piping.
 2. Chrome-plated pipes and fittings unless there is a potential for personnel injury.

3.10 INDOOR PIPING INSULATION SCHEDULE

- A. Condensate and Equipment Drain Water below 60 Deg F:
 1. All Pipe Sizes: Insulation shall be one of the following:
 - a. Flexible Elastomeric: 1 inch thick.
- B. Refrigerant Suction and Hot-Gas Piping:
 1. All Pipe Sizes: Insulation shall be one of the following:
 - a. Flexible Elastomeric: 1 inch thick.
- C. Refrigerant Liquid Piping:
 1. All Pipe Sizes: Insulation shall be one of the following:
 - a. Flexible Elastomeric: 1 inch thick.

END OF SECTION 23 0719

SECTION 23 1123 - FACILITY NATURAL-GAS PIPING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Pipes, tubes, and fittings.
 - 2. Piping specialties.
 - 3. Joining materials.
 - 4. Manual gas shutoff valves.
 - 5. Dielectric fittings.

1.2 DEFINITIONS

- A. CWP: Cold working pressure.
- B. Exposed, Exterior Installations: Exposed to view outdoors or subject to outdoor ambient temperatures and weather conditions. An example includes rooftop locations.
- C. Exposed, Interior Installations: Exposed to view indoors. Examples include finished occupied spaces and mechanical equipment rooms.
- D. Finished Spaces: Spaces other than mechanical and electrical equipment rooms, furred spaces, pipe and duct shafts, unheated spaces immediately below roof, spaces above ceilings, unexcavated spaces, crawlspaces, and tunnels.

1.3 ACTION SUBMITTALS

- A. Product Data:
 - 1. Piping specialties.
 - 2. Valves. Include pressure rating, capacity, settings, and electrical connection data of selected models.
 - 3. Pressure regulators. Indicate pressure ratings and capacities.
 - 4. Dielectric fittings.
- B. Shop Drawings: For facility natural-gas piping layout. Include plans, piping layout and elevations, sections, and details for fabrication of pipe anchors, hangers, supports for multiple pipes, alignment guides, expansion joints and loops, and attachments of the same to building structure. Detail location of anchors, alignment guides, and expansion joints and loops.
 - 1. Shop Drawing Scale: 1/4 inch per foot.
 - 2. Detail mounting, supports, and valve arrangements for pressure regulator assembly.

1.4 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Plans and details, drawn to scale, on which natural-gas piping is shown and coordinated with other installations, using input from installers of the items involved.
- B. Field Quality-Control Submittals:
 - 1. Field quality-control reports.

1.5 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For pressure regulators to include in emergency, operation, and maintenance manuals.

1.6 QUALITY ASSURANCE

- A. Qualifications:
 - 1. Steel Support Welding: Qualify procedures and personnel in accordance with AWS D1.1/D1.1M, "Structural Welding Code - Steel."
 - 2. Pipe Welding: Qualify procedures and operators in accordance with the ASME Boiler and Pressure Vessel Code.

1.7 DELIVERY, STORAGE, AND HANDLING

- A. Handling Flammable Liquids: Remove and dispose of liquids from existing natural-gas piping in accordance with requirements of authorities having jurisdiction.
- B. Deliver pipes and tubes with factory-applied end caps. Maintain end caps through shipping, storage, and handling to prevent pipe end damage and to prevent entrance of dirt, debris, and moisture.
- C. Store and handle pipes and tubes having factory-applied protective coatings to avoid damaging coating, and protect from direct sunlight.
- D. Protect stored PE pipes and valves from direct sunlight.

1.8 PROJECT CONDITIONS

- A. Perform site survey, research public utility records, and verify existing utility locations. Contact utility-locating service for area where Project is located.
- B. Interruption of Existing Natural-Gas Service: Do not interrupt natural-gas service to facilities occupied by Owner or others unless permitted under the following conditions, and then only after arranging to provide purging and startup of natural-gas supply in accordance with requirements indicated:
 - 1. Notify Construction Manager no fewer than two days in advance of proposed interruption of natural-gas service.
 - 2. Do not proceed with interruption of natural-gas service without Construction Manager's written permission.

1.9 COORDINATION

- A. Coordinate sizes and locations of concrete bases with actual equipment provided.
- B. Coordinate requirements for access panels and doors for valves installed and concealed behind finished surfaces. Comply with requirements in Section 08 3113 "Access Doors and Frames."
- C. Coordinate requirements for piping identification for natural-gas piping. Comply with requirements in Section 22 0553 "Identification of Plumbing Piping and Equipment."

PART 2 - PRODUCTS

2.1 SOURCE LIMITATIONS

- A. Obtain each product type from single source from single manufacturer.

2.2 PERFORMANCE REQUIREMENTS

- A. Comply with the International Fuel Gas Code.

- B. Minimum Operating-Pressure Ratings:
 - 1. Piping and Valves: 100 psig minimum unless otherwise indicated.
 - 2. Service Regulators: 65 psig minimum unless otherwise indicated.
- C. Natural-Gas System Pressure within Buildings:
 - 1. Single Pressure: 0.5 psig or less.
- D. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

2.3 PIPES, TUBES, AND FITTINGS

- A. Steel Pipe: ASTM A53/A53M, black steel, Schedule 40, Type E or S, Grade B.
 - 1. Malleable-Iron Threaded Fittings: ASME B16.3, Class 150, standard pattern.
 - 2. Wrought-Steel Welding Fittings: ASTM A234/A234M for butt welding and socket welding.
 - 3. Unions: ASME B16.39, Class 150, malleable iron with brass-to-iron seat, ground joint, and threaded ends.
 - 4. Forged-Steel Flanges and Flanged Fittings: ASME B16.5, minimum Class 150, including bolts, nuts, and gaskets of the following material group, end connections, and facings:
 - a. Material Group: 1.1.
 - b. End Connections: Threaded or butt welding to match pipe.
 - c. Lapped Face: Not permitted underground.
 - d. Gasket Materials: ASME B16.20, metallic, flat, asbestos free, aluminum O-rings, and spiral-wound metal gaskets.
 - e. Bolts and Nuts: ASME B18.2.1, carbon steel aboveground and stainless steel underground.
 - 5. Protective Coating for Underground Piping: Factory-applied, three-layer coating of epoxy, adhesive, and PE.
 - a. Joint Cover Kits: Epoxy paint, adhesive, and heat-shrink PE sleeves.
 - 6. Plastic Mechanical Couplings, NPS 2 and Larger: Suitable for joining PE pipe to PE pipe, steel pipe to PE pipe, or steel pipe to steel pipe.
 - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - 1) Lvall, R. W. & Company, Inc.
 - 2) Mueller Co.
 - 3) Perfection Corporation.
 - b. Fiber-reinforced plastic body.
 - c. PE body tube.
 - d. Seals: NBR.
 - e. Acetal collets.
 - f. Stainless steel bolts, nuts, and washers.
 - 7. Steel Mechanical Couplings: Suitable for joining plain-end PE pipe to PE pipe, steel pipe to PE pipe, or steel pipe to steel pipe.
 - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - 1) Baker Hughes Company.
 - 2) Smith-Blair, Inc.
 - b. Stainless steel flanges and tube with epoxy finish.
 - c. Seals: NBR.
 - d. Stainless steel bolts, washers, and nuts.
 - e. Factory-installed anode for steel-body couplings installed underground.

2.4 PIPING SPECIALTIES

- A. Appliance Flexible Connectors:
 - 1. Indoor, Fixed-Appliance Flexible Connectors: Comply with ANSI Z21.24.
 - 2. Indoor, Movable-Appliance Flexible Connectors: Comply with ANSI Z21.69.
 - 3. Outdoor, Appliance Flexible Connectors: Comply with ANSI Z21.75.
 - 4. Operating-Pressure Rating: 0.5 psig.
 - 5. End Fittings: Zinc-coated steel.
 - 6. Threaded Ends: Comply with ASME B1.20.1.
 - 7. Maximum Length: 72 inches.
- B. Y-Pattern Strainers:
 - 1. Body: ASTM A126, Class B, cast iron with bolted cover and bottom drain connection.
 - 2. End Connections: Threaded ends for NPS 2 and smaller; flanged ends for NPS 2-1/2 and larger.
 - 3. Strainer Screen: 40-mesh startup strainer, and perforated stainless steel basket with 50 percent free area.
 - 4. CWP Rating: 125 psig.
- C. Basket Strainers:
 - 1. Body: ASTM A126, Class B, high-tensile cast iron with bolted cover and bottom drain connection.
 - 2. End Connections: Threaded ends for NPS 2 and smaller; flanged ends for NPS 2-1/2 and larger.
 - 3. Strainer Screen: 40-mesh startup strainer, and perforated stainless-steel basket with 50 percent free area.
 - 4. CWP Rating: 125 psig.
- D. T-Pattern Strainers:
 - 1. Body: Ductile or malleable iron with removable access coupling and end cap for strainer maintenance.
 - 2. End Connections: Grooved ends.
 - 3. Strainer Screen: 40-mesh startup strainer, and perforated stainless-steel basket with 57 percent free area.
 - 4. CWP Rating: 750 psig.
- E. Weatherproof Vent Cap:
 - 1. Cast- or malleable-iron increaser fitting with corrosion-resistant wire screen, with free area at least equal to cross-sectional area of connecting pipe and threaded-end connection.

2.5 JOINING MATERIALS

- A. Joint Compound and Tape: Suitable for natural gas.
- B. Welding Filler Metals: Comply with AWS D10.12/D10.12M for welding materials appropriate for wall thickness and chemical analysis of steel pipe being welded.

2.6 MANUAL GAS SHUTOFF VALVES

- A. See "Underground, Manual Gas Shutoff Valve Schedule" and "Aboveground, Manual Gas Shutoff Valve Schedule" articles for where each valve type is applied in various services.
- B. General Requirements for Metallic Valves, NPS 2 and Smaller: Comply with ASME B16.33.
 - 1. CWP Rating: 125 psig.

2. Threaded Ends: Comply with ASME B1.20.1.
 3. Dryseal Threads on Flare Ends: Comply with ASME B1.20.3.
 4. Tamperproof Feature: Locking feature for valves indicated in "Underground, Manual Gas Shutoff Valve Schedule" and "Aboveground, Manual Gas Shutoff Valve Schedule" articles.
 5. Listed and labeled by an NRTL acceptable to authorities having jurisdiction for valves 1 inch and smaller.
 6. Service Mark: Valves NPS 1-1/4 to NPS 2 having initials "WOG" permanently marked on valve body.
- C. General Requirements for Metallic Valves, NPS 2-1/2 and Larger: Comply with ASME B16.38.
1. CWP Rating: 125 psig.
 2. Flanged Ends: Comply with ASME B16.5 for steel flanges.
 3. Tamperproof Feature: Locking feature for valves indicated in "Underground, Manual Gas Shutoff Valve Schedule" and "Aboveground, Manual Gas Shutoff Valve Schedule" articles.
 4. Service Mark: Initials "WOG" permanently marked on valve body.
- D. Two-Piece, Full-Port, Bronze Ball Valves with Bronze Trim: MSS SP-110.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. A.Y. McDonald Mfg. Co.
 - b. Apollo Valves; a part of Aalberts Integrated Piping Systems.
 - c. BrassCraft Manufacturing Co.; a Masco company.
 2. Body: Bronze, complying with ASTM B584.
 3. Ball: Chrome-plated bronze.
 4. Stem: Bronze; blowout proof.
 5. Seats: Reinforced TFE; blowout proof.
 6. Packing: Threaded-body packnut design with adjustable-stem packing.
 7. Ends: Threaded, flared, or socket as indicated in "Underground, Manual Gas Shutoff Valve Schedule" and "Aboveground, Manual Gas Shutoff Valve Schedule" articles.
 8. CWP Rating: 600 psig.
 9. Listing: Valves NPS 1 and smaller are to be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
 10. Service: Suitable for natural-gas service with "WOG" indicated on valve body.
- E. Bronze Plug Valves: MSS SP-78.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. A.Y. McDonald Mfg. Co.
 - b. Lee Brass Company.
 2. Body: Bronze, complying with ASTM B584.
 3. Plug: Bronze.
 4. Ends: Threaded, socket, or flanged as indicated in "Underground, Manual Gas Shutoff Valve Schedule" and "Aboveground, Manual Gas Shutoff Valve Schedule" articles.
 5. Operator: Square head or lug type with tamperproof feature where indicated.
 6. Pressure Class: 125 psig.
 7. Listing: Valves NPS 1 and smaller are to be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
 8. Service: Suitable for natural-gas service with "WOG" indicated on valve body.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine roughing-in for natural-gas piping system to verify actual locations of piping connections before equipment installation.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Close equipment shutoff valves before turning off natural gas to premises or piping section.
- B. Inspect natural-gas piping in accordance with the International Fuel Gas Code to determine that natural-gas utilization devices are turned off in piping section affected.
- C. Comply with the International Fuel Gas Code requirements for preventing accidental ignition.

3.3 INSTALLATION OF OUTDOOR PIPING

- A. All underground gas piping shall be performed by OSU energy services.

3.4 INSTALLATION OF INDOOR PIPING

- A. Comply with the International Fuel Gas Code for installation and purging of natural-gas piping.
- B. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicated locations and arrangements are used to size pipe and calculate friction loss, expansion, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.
- C. Arrange for pipe spaces, chases, slots, sleeves, and openings in building structure during progress of construction, to allow for mechanical installations.
- D. Do not install piping in concealed locations unless sleeved with the sleeve open at both ends.
- E. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- F. Where installing piping above accessible ceilings, allow sufficient space for ceiling panel removal.
- G. Locate valves for easy access. Do not locate valves within return air plenums.
- H. Install piping free of sags and bends.
- I. Install fittings for changes in direction and branch connections.
- J. Verify final equipment locations for roughing-in.
- K. Comply with requirements in Sections specifying gas-fired appliances and equipment for roughing-in requirements.

- L. Drips and Sediment Traps: Install drips at points where condensate may collect, including service-meter outlets. Locate where accessible to permit cleaning and emptying. Do not install where condensate is subject to freezing.
 - 1. Construct drips and sediment traps using tee fitting with bottom outlet plugged or capped. Use nipple a minimum length of 3 pipe diameters, but not less than 3 inches long and same size as connected pipe. Install with space below bottom of drip to remove plug or cap.
 - 2. Install sediment trap on both sides of regulators for gas reduction to 2 psig with valve and capped.
- M. Extend relief vent connections for service regulators, line regulators, and overpressure protection devices to outdoors and terminate with weatherproof vent cap.
- N. Conceal pipe installations in walls, pipe spaces, utility spaces, above ceilings, below grade or floors, and in floor channels unless indicated to be exposed to view.
- O. Concealed Location Installations: Except as specified below, install concealed natural-gas piping and piping installed under the building in containment conduit constructed of steel pipe with welded joints as described in Part 2. Install a vent pipe from containment conduit to outdoors and terminate with weatherproof vent cap.
 - 1. Above Accessible Ceilings: Natural-gas piping, fittings, valves, and regulators may be installed in accessible spaces without containment conduit.
 - 2. In Floors: Install natural-gas piping with welded or brazed joints and protective coating in cast-in-place concrete floors. Cover piping to be cast in concrete slabs with minimum of 1-1/2 inches of concrete. Piping may not be in physical contact with other metallic structures such as reinforcing rods or electrically neutral conductors. Do not embed piping in concrete slabs containing quick-set additives or cinder aggregate.
 - 3. In Floor Channels: Install natural-gas piping in floor channels. Channels must have cover and be open to space above cover for ventilation.
 - 4. In Walls or Partitions: Protect tubing installed inside partitions or hollow walls from physical damage using steel striker barriers at rigid supports.
 - a. Exception: Tubing passing through partitions or walls does not require striker barriers.
 - 5. Prohibited Locations:
 - a. Do not install natural-gas piping in or through circulating air ducts, clothes or trash chutes, chimneys or gas vents (flues), ventilating ducts, or dumbwaiter or elevator shafts.
 - b. Do not install natural-gas piping in solid walls or partitions.
- P. Use eccentric reducer fittings to make reductions in pipe sizes. Install fittings with level side down.
- Q. Connect branch piping from top or side of horizontal piping.
- R. Install unions in pipes NPS 2 and smaller, adjacent to each valve, at final connection to each piece of equipment. Unions are not required at flanged connections.
- S. Do not use natural-gas piping as grounding electrode.
- T. Install strainer on inlet of each line-pressure regulator and automatic or electrically operated valve.
- U. Install pressure gauge upstream and downstream from each line regulator. Pressure gauges are specified in Section 23 0519 "Meters and Gauges for HVAC Piping."

- V. Install sleeves for piping penetrations of walls, ceilings, and floors. Comply with requirements for sleeves specified in Section 23 0517 "Sleeves and Sleeve Seals for HVAC Piping."
- W. Install sleeve seals for piping penetrations of concrete walls and slabs. Comply with requirements for sleeve seals specified in Section 23 0517 "Sleeves and Sleeve Seals for HVAC Piping."
- X. Install escutcheons for piping penetrations of walls, ceilings, and floors. Comply with requirements for escutcheons specified in Section 23 0518 "Escutcheons for HVAC Piping."

3.5 INSTALLATION OF VALVES

- A. Install manual gas shutoff valve for each gas appliance ahead of corrugated stainless steel tubing, aluminum, or copper connector.
- B. Install underground valves with valve boxes.
- C. Install regulators and overpressure protection devices with maintenance access space adequate for servicing and testing.
- D. Install earthquake valves aboveground outside buildings according to listing.
- E. Install anode for metallic valves in underground PE piping.
- F. Do not install valves in return-air plenums.

3.6 PIPING JOINT CONSTRUCTION

- A. Ream ends of pipes and tubes and remove burrs.
- B. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
- C. Threaded Joints:
 - 1. Thread pipe with tapered pipe threads complying with ASME B1.20.1.
 - 2. Cut threads full and clean using sharp dies.
 - 3. Ream threaded pipe ends to remove burrs and restore full inside diameter of pipe.
 - 4. Apply appropriate tape or thread compound to external pipe threads unless dryseal threading is specified.
 - 5. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.
- D. Welded Joints:
 - 1. Construct joints in accordance with AWS D10.12/D10.12M, using qualified processes and welding operators.
 - 2. Bevel plain ends of steel pipe.
 - 3. Patch factory-applied protective coating as recommended by manufacturer at field welds and where damage to coating occurs during construction.
- E. Flanged Joints: Install gasket material, size, type, and thickness appropriate for natural-gas service. Install gasket concentrically positioned.
- F. Flared Joints: Cut tubing with roll cutting tool. Flare tube end with tool to result in flare dimensions complying with SAE J513. Tighten finger tight, and then use wrench. Do not overtighten.

- G. PE Piping Heat-Fusion Joints: Clean and dry joining surfaces by wiping with clean cloth or paper towels. Join in accordance with ASTM D2657.
 - 1. Plain-End Pipe and Fittings: Use butt fusion.
 - 2. Plain-End Pipe and Socket Fittings: Use socket fusion.

3.7 INSTALLATION OF HANGERS AND SUPPORTS

- A. Comply with requirements in Section 23 0529 "Hangers and Supports for HVAC Piping and Equipment" for hangers, supports, and anchor devices.
- B. Install hangers for steel piping, with maximum horizontal spacing and minimum rod diameters, to comply with MSS SP-58, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.
- C. Support horizontal piping within 12 inches of each fitting.
- D. Support vertical runs of steel piping to comply with MSS SP-58, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.

3.8 PIPING CONNECTIONS

- A. Connect to utility's gas main according to utility's procedures and requirements.
- B. Install natural-gas piping electrically continuous, and bonded to gas-appliance equipment grounding conductor of the circuit powering the appliance in accordance with NFPA 70.
- C. Where installing piping adjacent to appliances, allow space for service and maintenance of appliances.
- D. Connect piping to appliances using manual gas shutoff valves and unions. Install valve within 72 inches of each gas-fired appliance and equipment. Install union between valve and appliances or equipment.

3.9 FIELD QUALITY CONTROL

- A. Tests and Inspections:
 - 1. Test, inspect, and purge natural gas in accordance with the International Fuel Gas Code and authorities having jurisdiction.
 - 2. Natural-gas piping will be considered defective if it does not pass tests and inspections.
- B. Prepare test and inspection reports.

3.10 OUTDOOR PIPING SCHEDULE

- A. Aboveground natural-gas piping is to be one of the following:
 - 1. Steel pipe with malleable-iron fittings and threaded joints.
 - 2. Steel pipe with wrought-steel fittings and welded joints.

3.11 INDOOR PIPING SCHEDULE FOR SYSTEM PRESSURES LESS THAN 0.5 PSIG

- A. Aboveground, branch piping NPS 1 and smaller is to be the following:
 - 1. Steel pipe with malleable-iron fittings and threaded joints.
- B. Aboveground, distribution piping is to be one of the following:
 - 1. Steel pipe with malleable-iron fittings and threaded joints.

2. Steel pipe with wrought-steel fittings and welded joints.

3.12 ABOVEGROUND, MANUAL GAS SHUTOFF VALVE SCHEDULE

- A. Valves for pipe sizes NPS 2 and smaller at service meter are to be one of the following:
 1. Two-piece, full-port, bronze ball valves with bronze trim.
 2. Bronze plug valve.
- B. Valves for pipe sizes NPS 2-1/2 and larger at service meter are to be the following:
 1. Cast-iron, nonlubricated plug valve.
- C. Distribution piping valves for pipe sizes NPS 2 and smaller are to be one of the following:
 1. Two-piece, full-port, bronze ball valves with bronze trim.
 2. Bronze plug valve.
- D. Distribution piping valves for pipe sizes NPS 2-1/2 and larger are to be the following:
 1. Cast-iron, lubricated plug valve.
- E. Valves in branch piping for single appliance are to be one of the following:
 1. Two-piece, full-port, bronze ball valves with bronze trim.
 2. Bronze plug valve.

END OF SECTION 23 1123

SECTION 23 2300 - REFRIGERANT PIPING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Refrigerant pipes and fittings.
 - 2. Refrigerant piping valves and specialties.
 - 3. Refrigerants.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of valve, refrigerant piping, and refrigerant piping specialty.
- B. Shop Drawings:
 - 1. Show piping size and piping layout, including oil traps, double risers, specialties, and pipe and tube sizes to accommodate, as a minimum, equipment provided, elevation difference between compressor and evaporator, and length of piping to ensure proper operation and compliance with warranties of connected equipment.
 - 2. Show interface and spatial relationships between piping and equipment.

1.3 INFORMATIONAL SUBMITTALS

- A. Field quality-control reports.

1.4 QUALITY ASSURANCE

- A. Comply with ASHRAE 15, "Safety Code for Refrigeration Systems."
- B. Comply with ASME B31.5, "Refrigeration Piping and Heat Transfer Components."

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Line Test Pressure for Refrigerant R-410A:
 - 1. Suction Lines for Air-Conditioning Applications: 300 psig.
 - 2. Suction Lines for Heat-Pump Applications: 535 psig.
 - 3. Hot-Gas and Liquid Lines: 535 psig.

2.2 COPPER TUBE AND FITTINGS

- A. Copper Tube: ASTM B 280, Type ACR.
- B. Wrought-Copper Fittings: ASME B16.22.
- C. Wrought-Copper Unions: ASME B16.22.
- D. Solder Filler Metals: ASTM B 32. Use 95-5 tin antimony or alloy HB solder to join copper socket fittings on copper pipe.
- E. Brazing Filler Metals: AWS A5.8/A5.8M.

- F. Flexible Connectors:
 - 1. Body: Tin-bronze bellows with woven, flexible, tinned-bronze-wire-reinforced protective jacket.
 - 2. End Connections: Socket ends.
 - 3. Offset Performance: Capable of minimum 3/4-inch misalignment in minimum 7-inch- long assembly.
 - 4. Working Pressure Rating: Factory test at minimum 500 psig.
 - 5. Maximum Operating Temperature: 250 deg F.

2.3 VALVES AND SPECIALTIES

- A. Service Valves:
 - 1. Body: Forged brass with brass cap including key end to remove core.
 - 2. Core: Removable ball-type check valve with stainless-steel spring.
 - 3. Seat: Polytetrafluoroethylene.
 - 4. End Connections: Copper spring.
 - 5. Working Pressure Rating: 500 psig.
- B. Moisture/Liquid Indicators:
 - 1. Body: Forged brass.
 - 2. Window: Replaceable, clear, fused glass window with indicating element protected by filter screen.
 - 3. Indicator: Color coded to show moisture content in parts per million (ppm).
 - 4. Minimum Moisture Indicator Sensitivity: Indicate moisture above 60 ppm.
 - 5. End Connections: Socket or flare.
 - 6. Working Pressure Rating: 500 psig.
 - 7. Maximum Operating Temperature: 240 deg F.

2.4 REFRIGERANTS

- A. ASHRAE 34, R-410A: Pentafluoroethane/Difluoromethane.
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. [DuPont; Fluorochemicals Div.](#)
 - b. [Genetron Refrigerants; Honeywell International Inc.](#)
 - c. [Mexichem Fluor Inc.](#)

PART 3 - EXECUTION

3.1 PIPING APPLICATIONS FOR REFRIGERANT R-410A

- A. Suction Lines: Copper, Type ACR, annealed-temper tubing and wrought-copper fittings with brazed joints.
- B. Hot-Gas and Liquid Lines: Copper, Type ACR, annealed- or drawn-temper tubing and wrought-copper fittings with brazed joints.

3.2 VALVE AND SPECIALTY APPLICATIONS

- A. Install service valves for gage taps at inlet and outlet of hot-gas bypass valves and strainers if they are not an integral part of valves and strainers.
- B. Install safety relief valves where required by 2010 ASME Boiler and Pressure Vessel Code. Pipe safety-relief-valve discharge line to outside according to ASHRAE 15.

- C. Install filter dryers in liquid line between compressor and thermostatic expansion valve.

3.3 PIPING INSTALLATION

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems; indicated locations and arrangements were used to size pipe and calculate friction loss, expansion, pump sizing, and other design considerations. Install piping as indicated unless deviations to layout are approved on Shop Drawings.
- B. Install refrigerant piping according to ASHRAE 15.
- C. Install piping in concealed locations unless otherwise indicated and except in equipment rooms and service areas.
- D. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- E. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- F. Install piping adjacent to machines to allow service and maintenance.
- G. Install piping free of sags and bends.
- H. Install fittings for changes in direction and branch connections.
- I. Select system components with pressure rating equal to or greater than system operating pressure.
- J. Install piping as short and direct as possible, with a minimum number of joints, elbows, and fittings.
- K. Arrange piping to allow inspection and service of refrigeration equipment. Install valves and specialties in accessible locations to allow for service and inspection. Install access doors or panels as specified in Section 08 3113 "Access Doors and Frames" if valves or equipment requiring maintenance is concealed behind finished surfaces.
- L. Install refrigerant piping in protective conduit where installed belowground.
- M. Install refrigerant piping in rigid or flexible conduit in locations where exposed to mechanical injury.
- N. Slope refrigerant piping as follows:
 - 1. Install horizontal hot-gas discharge piping with a uniform slope downward away from compressor.
 - 2. Install horizontal suction lines with a uniform slope downward to compressor.
 - 3. Install traps and double risers to entrain oil in vertical runs.
 - 4. Liquid lines may be installed level.
- O. When brazing or soldering, remove solenoid-valve coils and sight glasses; also remove valve stems, seats, and packing, and accessible internal parts of refrigerant specialties. Do not apply heat near expansion-valve bulb.
- P. Install piping with adequate clearance between pipe and adjacent walls and hangers or between pipes for insulation installation.

- Q. Identify refrigerant piping and valves according to Section 23 0553 "Identification for HVAC Piping and Equipment."
- R. Install sleeves for piping penetrations of walls, ceilings, and floors. Comply with requirements for sleeves specified in Section 23 0517 "Sleeves and Sleeve Seals for HVAC Piping."
- S. Install sleeve seals for piping penetrations of concrete walls and slabs. Comply with requirements for sleeve seals specified in Section 23 0517 "Sleeves and Sleeve Seals for HVAC Piping."
- T. Install escutcheons for piping penetrations of walls, ceilings, and floors. Comply with requirements for escutcheons specified in Section 23 0518 "Escutcheons for HVAC Piping."

3.4 PIPE JOINT CONSTRUCTION

- A. Ream ends of pipes and tubes and remove burrs.
- B. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
- C. Brazed Joints: Construct joints according to AWS's "Brazing Handbook," Chapter "Pipe and Tube."
 - 1. Use Type BCuP (copper-phosphorus) alloy for joining copper socket fittings with copper pipe.
 - 2. Use Type BAg (cadmium-free silver) alloy for joining copper with bronze or steel.

3.5 HANGERS AND SUPPORTS

- A. Comply with requirements for pipe hangers and supports specified in Section 23 0529 "Hangers and Supports for HVAC Piping and Equipment."
- B. Install the following pipe attachments:
 - 1. Copper-clad hangers and supports for hangers and supports in direct contact with copper pipe.
- C. Install hangers for copper tubing with the following maximum spacing and minimum rod diameters:
 - 1. NPS 1/2: Maximum span, 60 inches; minimum rod, 1/4 inch.
 - 2. NPS 5/8: Maximum span, 60 inches; minimum rod, 1/4 inch.
 - 3. NPS 1 : Maximum span, 72 inches; minimum rod, 1/4 inch.
 - 4. NPS 1-1/4 : Maximum span, 96 inches; minimum rod, 3/8 inch.
 - 5. NPS 1-1/2 : Maximum span, 96 inches; minimum rod, 3/8 inch.
 - 6. NPS 2 : Maximum span, 96 inches; minimum rod, 3/8 inch.
 - 7. NPS 2-1/2 : Maximum span, 108 inches; minimum rod, 3/8 inch.
 - 8. NPS 3 : Maximum span, 10 feet; minimum rod, 3/8 inch.
 - 9. NPS 4 : Maximum span, 12 feet; minimum rod, 1/2 inch.
- D. Support multifloor vertical runs at least at each floor.

3.6 FIELD QUALITY CONTROL

- A. Perform the following tests and inspections:
 - 1. Comply with ASME B31.5, Chapter VI.

2. Test refrigerant piping, specialties, and receivers. Isolate compressor, condenser, evaporator, and safety devices from test pressure if they are not rated above the test pressure.
3. Test high- and low-pressure side piping of each system separately at not less than the pressures indicated in "Performance Requirements" Article.
 - a. Fill system with nitrogen to the required test pressure.
 - b. System shall maintain test pressure at the manifold gage throughout duration of test.
 - c. Test joints and fittings with electronic leak detector or by brushing a small amount of soap and glycerin solution over joints.
 - d. Remake leaking joints using new materials, and retest until satisfactory results are achieved.

- B. Prepare test and inspection reports.

3.7 SYSTEM CHARGING

- A. Charge system using the following procedures:
1. Install core in filter dryers after leak test but before evacuation.
 2. Evacuate entire refrigerant system with a vacuum pump to 500 micrometers. If vacuum holds for 12 hours, system is ready for charging.
 3. Break vacuum with refrigerant gas, allowing pressure to build up to 2 psig.
 4. Charge system with a new filter-dryer core in charging line.

3.8 ADJUSTING

- A. Adjust thermostatic expansion valve to obtain proper evaporator superheat.
- B. Adjust high- and low-pressure switch settings to avoid short cycling in response to fluctuating suction pressure.
- C. Adjust set-point temperature of air-conditioning or chilled-water controllers to the system design temperature.
- D. Perform the following adjustments before operating the refrigeration system, according to manufacturer's written instructions:
1. Verify that compressor oil level is correct.
 2. Open compressor suction and discharge valves.
 3. Open refrigerant valves except bypass valves that are used for other purposes.
- E. Replace core of replaceable filter dryer after system has been adjusted and after design flow rates and pressures are established.

END OF SECTION 23 2300

SECTION 23 3113 - METAL DUCTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Single-wall rectangular ducts and fittings.
 - 2. Single-wall round and flat-oval ducts and fittings.
 - 3. Sheet metal materials.
 - 4. Duct liner.
 - 5. Sealants and gaskets.
 - 6. Hangers and supports.
- B. Related Sections:
 - 1. Section 23 0593 "Testing, Adjusting, and Balancing for HVAC" for testing, adjusting, and balancing requirements for metal ducts.
 - 2. Section 23 3300 "Air Duct Accessories" for dampers, sound-control devices, duct-mounting access doors and panels, turning vanes, and flexible ducts.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of the following products:
 - 1. Liners and adhesives.
 - 2. Sealants and gaskets.
- B. Shop Drawings:
 - 1. Fabrication, assembly, and installation, including plans, elevations, sections, components, and attachments to other work.
 - 2. Factory- and shop-fabricated ducts and fittings.
 - 3. Duct layout indicating sizes, configuration, liner material, and static-pressure classes.
 - 4. Elevation of top and bottom of ducts.
 - 5. Dimensions of main duct runs from building grid lines.
 - 6. Fittings.
 - 7. Reinforcement and spacing.
 - 8. Seam and joint construction.
 - 9. Penetrations through fire-rated and other partitions.
 - 10. Equipment installation based on equipment being used on Project.
 - 11. Locations for duct accessories, including dampers, turning vanes, and access doors and panels.
 - 12. Hangers and supports, including methods for duct and building attachment, and vibration isolation.
- C. Delegated-Design Submittal:
 - 1. Sheet metal thicknesses.
 - 2. Joint and seam construction and sealing.
 - 3. Reinforcement details and spacing.
 - 4. Materials, fabrication, assembly, and spacing of hangers and supports.
 - 5. Design Calculations: Calculations for selecting hangers and supports.

1.4 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: A single set of plans or BIM model, drawn to scale, showing the items described in this Section, and coordinated with all building trades.
- B. Field quality-control reports.

1.5 QUALITY ASSURANCE

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Delegated Duct Design: Duct construction, including sheet metal thicknesses, seam and joint construction, reinforcements, and hangers and supports, shall comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" and with performance requirements and design criteria indicated in "Duct Schedule" Article.
- B. Structural Performance: Duct hangers and supports shall withstand the effects of gravity loads and stresses within limits and under conditions described in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" and ASCE/SEI 7. Airstream Surfaces: Surfaces in contact with airstream shall comply with requirements in ASHRAE 62.1.
- C. ASHRAE Compliance: Applicable requirements in ASHRAE 62.1, Section 5 - "Systems and Equipment," and Section 7 - "Construction and System Startup."
- D. ASHRAE/IES Compliance: Applicable requirements in ASHRAE/IES 90.1, Section 6.4.4 - "HVAC System Construction and Insulation."
- E. Duct Dimensions: Unless otherwise indicated, all duct dimensions indicated on Drawings are inside clear dimensions and do not include insulation or duct wall thickness.

2.2 SINGLE-WALL RECTANGULAR DUCTS AND FITTINGS

- A. General Fabrication Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" based on indicated static-pressure class unless otherwise indicated.
 - 1. Construct ducts of galvanized sheet steel unless otherwise indicated.
- B. Transverse Joints: Fabricate joints in accordance with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 2-1, "Rectangular Duct/Transverse Joints," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
 - 1. For ducts with longest side less than 36 inches, select joint types in accordance with Figure 2-1.
 - 2. For ducts with longest side 36 inches or greater, use flange joint connector Type T-22, T-24, T-24A, T-25a, or T-25b. Factory-fabricated flanged duct connection system may be used if submitted and approved by engineer of record.
 - 3. Where specified for specific applications, all joints shall be welded.
- C. Longitudinal Seams: Select seam types and fabricate in accordance with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 2-2, "Rectangular Duct/Longitudinal Seams," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

- D. Elbows, Transitions, Offsets, Branch Connections, and Other Duct Construction: Select types and fabricate in accordance with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Ch. 4, "Fittings and Other Construction," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

2.3 SINGLE-WALL ROUND AND FLAT-OVAL DUCTS AND FITTINGS

- A. General Fabrication Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Ch. 3, "Round, Oval, and Flexible Duct," based on indicated static-pressure class unless otherwise indicated.
 - 1. Construct ducts of galvanized sheet steel unless otherwise indicated.
 - 2. For ducts exposed to weather, construct of Type 316 stainless steel indicated by manufacturer to be suitable for outdoor installation.
 - 3. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Ductmate Industries, Inc.
 - b. McGill AirFlow LLC.
 - c. SEMCO, LLC; part of FlaktGroup.
 - d. Spiral Manufacturing Co., Inc.
- B. Transverse Joints: Select joint types and fabricate in accordance with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-1, "Round Duct Transverse Joints," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
 - 1. Transverse Joints in Ducts Larger Than 60 Inches in Diameter: Flanged.
- C. Longitudinal Seams: Select seam types and fabricate in accordance with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-2, "Round Duct Longitudinal Seams," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
 - 1. Fabricate round ducts larger than 90 inches in diameter with butt-welded longitudinal seams.
 - 2. Fabricate flat-oval ducts larger than 72 inches in width (major dimension) with butt-welded longitudinal seams.
- D. Tees and Laterals: Select types and fabricate in accordance with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-5, "90 Degree Tees and Laterals," and Figure 3-6, "Conical Tees," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

2.4 SHEET METAL MATERIALS

- A. General Material Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for acceptable materials, material thicknesses, and duct construction methods unless otherwise indicated. Sheet metal materials shall be free of pitting, seam marks, roller marks, stains, discolorations, and other imperfections.
- B. Galvanized Sheet Steel: Comply with ASTM A653/A653M.
 - 1. Galvanized Coating Designation: G90.
 - 2. Finishes for Surfaces Exposed to View: Mill phosphatized.

- C. Reinforcement Shapes and Plates: ASTM A36/A36M, steel plates, shapes, and bars; black and galvanized.
- D. Tie Rods: Galvanized steel, 1/4-inch-minimum diameter for lengths 36 inches or less; 3/8-inch-minimum diameter for lengths longer than 36 inches.

2.5 DUCT LINER

- A. Fibrous-Glass Duct Liner: Comply with ASTM C1071, NFPA 90A, or NFPA 90B; and with NAIMA AH124, "Fibrous Glass Duct Liner Standard."
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - a. Johns Manville; a Berkshire Hathaway company.
 - b. Knauf Insulation.
 - c. Owens Corning.
 - 2. Maximum Thermal Conductivity:
 - a. Type I, Flexible: 0.27 Btu x in./h x sq. ft. x deg F at 75 deg F mean temperature.
 - b. Type II, Rigid: 0.23 Btu x in./h x sq. ft. x deg F at 75 deg F mean temperature.
 - 3. Antimicrobial Erosion-Resistant Coating: Apply to the surface of the liner that will form the interior surface of the duct to act as a moisture repellent and erosion-resistant coating. Antimicrobial compound shall be tested for efficacy by an NRTL and registered by the EPA for use in HVAC systems.
 - 4. Water-Based Liner Adhesive: Comply with NFPA 90A or NFPA 90B and with ASTM C916.
 - a. Adhesive shall have a VOC content of 80 g/L or less.
- B. Insulation Pins and Washers:
 - 1. Cupped-Head, Capacitor-Discharge-Weld Pins: Copper- or zinc-coated steel pin, fully annealed for capacitor-discharge welding, 0.106-inch- diameter shank, length to suit depth of insulation indicated with integral 1-1/2-inch galvanized carbon-steel washer.
 - 2. Insulation-Retaining Washers: Self-locking washers formed from 0.016-inch-thick galvanized steel, aluminum, or stainless steel; with beveled edge sized as required to hold insulation securely in place, but not less than 1-1/2 inches in diameter.
- C. Shop Application of Duct Liner: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 7-11, "Flexible Duct Liner Installation."
 - 1. Adhere a single layer of indicated thickness of duct liner with at least 90 percent adhesive coverage at liner contact surface area. Attaining indicated thickness with multiple layers of duct liner is prohibited.
 - 2. Apply adhesive to transverse edges of liner facing upstream that do not receive metal nosing.
 - 3. Butt transverse joints without gaps, and coat joint with adhesive.
 - 4. Fold and compress liner in corners of rectangular ducts or cut and fit to ensure butted-edge overlapping.
 - 5. Do not apply liner in rectangular ducts with longitudinal joints, except at corners of ducts, unless duct size and dimensions of standard liner make longitudinal joints necessary.
 - 6. Apply adhesive coating on longitudinal seams in ducts with air velocity of 2500 fpm or greater.
 - 7. Secure liner with mechanical fasteners 4 inches from corners and at intervals not exceeding 12 inches transversely; at 3 inches from transverse joints and at intervals not exceeding 18 inches longitudinally.
 - 8. Secure transversely oriented liner edges facing the airstream with metal nosings that have either channel or "Z" profiles or are integrally formed from duct wall. Fabricate edge facings at the following locations:
 - a. Fan discharges.

- b. Intervals of lined duct preceding unlined duct.
 - c. Upstream edges of transverse joints in ducts where air velocities are higher than 2500 fpm or where indicated.
- 9. Secure insulation between perforated sheet metal inner duct of same thickness as specified for outer shell. Use mechanical fasteners that maintain inner duct at uniform distance from outer shell without compressing insulation.
 - a. Sheet Metal Inner Duct Perforations: 3/32-inch diameter, with an overall open area of 23 percent.
- 10. Terminate inner ducts with buildouts attached to fire-damper sleeves, dampers, turning vane assemblies, or other devices. Fabricated buildouts (metal hat sections) or other buildout means are optional; when used, secure buildouts to duct walls with bolts, screws, rivets, or welds.

2.6 SEALANT AND GASKETS

- A. General Sealant and Gasket Requirements: Surface-burning characteristics for sealants and gaskets shall be a maximum flame-spread index of 25 and a maximum smoke-developed index of 50 when tested in accordance with UL 723; certified by an NRTL.
- B. Two-Part Tape Sealing System:
 - 1. Tape: Woven cotton fiber impregnated with mineral gypsum and modified acrylic/silicone activator to react exothermically with tape to form hard, durable, airtight seal.
 - 2. Tape Width: 3 inches.
 - 3. Sealant: Modified styrene acrylic.
 - 4. Water resistant.
 - 5. Mold and mildew resistant.
 - 6. Maximum Static-Pressure Class: 10-inch wg, positive and negative.
 - 7. Service: Indoor and outdoor.
 - 8. Service Temperature: Minus 40 to plus 200 deg F.
 - 9. Substrate: Compatible with galvanized sheet steel (both PVC coated and bare), stainless steel, or aluminum.
 - 10. For indoor applications, sealant shall have a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
- C. Water-Based Joint and Seam Sealant:
 - 1. Application Method: Brush on.
 - 2. Solids Content: Minimum 65 percent.
 - 3. Shore A Hardness: Minimum 20.
 - 4. Water resistant.
 - 5. Mold and mildew resistant.
 - 6. VOC: Maximum 75 g/L (less water).
 - 7. Maximum Static-Pressure Class: 10 inch wg, positive and negative.
 - 8. Service: Indoor or outdoor.
 - 9. Substrate: Compatible with galvanized sheet steel (both PVC coated and bare), stainless steel, or aluminum sheets.
- D. Solvent-Based Joint and Seam Sealant:
 - 1. Application Method: Brush on.
 - 2. Base: Synthetic rubber resin.
 - 3. Solvent: Toluene and heptane.
 - 4. Solids Content: Minimum 60 percent.
 - 5. Shore A Hardness: Minimum 60.
 - 6. Water resistant.
 - 7. Mold and mildew resistant.
 - 8. For indoor applications, sealant shall have a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

9. Maximum Static-Pressure Class: 10-inch wg, positive or negative.
 10. Service: Indoor or outdoor.
 11. Substrate: Compatible with galvanized sheet steel (both PVC coated and bare), stainless steel, or aluminum sheets.
- E. Flanged Joint Sealant: Comply with ASTM C920.
1. General: Single-component, acid-curing, silicone, elastomeric.
 2. Type: S.
 3. Grade: NS.
 4. Class: 25.
 5. Use: O.
 6. For indoor applications, sealant shall have a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
- F. Flange Gaskets: Butyl rubber, neoprene, or EPDM polymer with polyisobutylene plasticizer.
- G. Round Duct Joint O-Ring Seals:
1. Seal shall provide maximum leakage class of 3 cfm/100 sq. ft. at 1-inch wg and shall be rated for 10-inch wg static-pressure class, positive or negative.
 2. EPDM O-ring to seal in concave bead in coupling or fitting spigot.
 3. Double-lipped, EPDM O-ring seal, mechanically fastened to factory-fabricated couplings and fitting spigots.

2.7 HANGERS AND SUPPORTS

- A. Hanger Rods for Noncorrosive Environments: Galvanized-steel rods and nuts.
- B. Hanger Rods for Corrosive Environments: Electrogalvanized, all-thread rods or galvanized rods with threads painted with zinc-chromate primer after installation.
- C. Strap and Rod Sizes: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Table 5-1, "Rectangular Duct Hangers Minimum Size," and Table 5-2, "Minimum Hanger Sizes for Round Duct."
- D. Steel Cables for Galvanized-Steel Ducts: Galvanized steel complying with ASTM A603.
- E. Steel Cables for Stainless-Steel Ducts: Stainless steel complying with ASTM A492.
- F. Steel Cable End Connections: Galvanized-steel assemblies with brackets, swivel, and bolts designed for duct hanger service; with an automatic-locking and clamping device.
- G. Duct Attachments: Sheet metal screws, blind rivets, or self-tapping metal screws; compatible with duct materials.
- H. Trapeze and Riser Supports:
1. Supports for Galvanized-Steel Ducts: Galvanized-steel shapes and plates.
 2. Supports for Stainless-Steel Ducts: Stainless-steel shapes and plates.

PART 3 - EXECUTION

3.1 DUCT INSTALLATION

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of duct system. Indicated duct locations, configurations, and arrangements were used to size ducts and calculate friction loss for air-handling equipment sizing and for other design considerations.

Install duct systems as indicated unless deviations to layout are approved on Shop Drawings and coordination drawings.

- B. Install ducts in accordance with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" unless otherwise indicated.
- C. Install ducts in maximum practical lengths with fewest possible joints.
- D. Install factory- or shop-fabricated fittings for changes in direction, size, and shape and for branch connections.
- E. Unless otherwise indicated, install ducts vertically and horizontally, and parallel and perpendicular to building lines.
- F. Install ducts close to walls, overhead construction, columns, and other structural and permanent enclosure elements of building.
- G. Install ducts with a clearance of 1 inch, plus allowance for insulation thickness.
- H. Route ducts to avoid passing through transformer vaults and electrical equipment rooms and enclosures.
- I. Where ducts pass through non-fire-rated interior partitions and exterior walls and are exposed to view, cover the opening between the partition and duct or duct insulation with sheet metal flanges of same metal thickness as the duct. Overlap openings on four sides by at least 1-1/2 inches.
- J. Install fire, combination fire/smoke, and smoke dampers where indicated on Drawings and as required by code, and by local authorities having jurisdiction. Comply with requirements in Section 23 3300 "Air Duct Accessories" for fire and smoke dampers and specific installation requirements of the damper UL listing.
- K. Install heating coils, cooling coils, air filters, dampers, and all other duct-mounted accessories in air ducts where indicated on Drawings.
- L. Protect duct interiors from moisture, construction debris and dust, and other foreign materials both before and after installation. Comply with SMACNA's "IAQ Guidelines for Occupied Buildings Under Construction," Appendix G, "Duct Cleanliness for New Construction Guidelines."
- M. Elbows: Use long-radius elbows wherever they fit.
 - 1. Fabricate 90-degree rectangular mitered elbows to include turning vanes.
 - 2. Fabricate 90-degree round elbows with a minimum of three segments for 12 inches and smaller and a minimum of five segments for 14 inches and larger.
- N. Branch Connections: Use lateral or conical branch connections.

3.2 INSTALLATION OF EXPOSED DUCTWORK

- A. Protect ducts exposed in finished spaces from being dented, scratched, or damaged.
- B. Trim duct sealants flush with metal. Create a smooth and uniform exposed bead. Do not use two-part tape sealing system.

- C. Grind welds to provide smooth surface free of burrs, sharp edges, and weld splatter. When welding stainless steel with a No. 3 or 4 finish, grind the welds flush, polish the exposed welds, and treat the welds to remove discoloration caused by welding.
- D. Maintain consistency, symmetry, and uniformity in arrangement and fabrication of fittings, hangers and supports, duct accessories, and air outlets.
- E. Repair or replace damaged sections and finished work that does not comply with these requirements.

3.3 DUCT SEALING

- A. Seal ducts for duct static-pressure, seal classes, and leakage classes specified in "Duct Schedule" Article in accordance with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

3.4 HANGER AND SUPPORT INSTALLATION

- A. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Chapter 5, "Hangers and Supports."
- B. Building Attachments: Concrete inserts, powder-actuated fasteners, or structural-steel fasteners appropriate for construction materials to which hangers are being attached.
 - 1. Where practical, install concrete inserts before placing concrete.
 - 2. Install powder-actuated concrete fasteners after concrete is placed and completely cured.
 - 3. Use powder-actuated concrete fasteners for standard-weight aggregate concretes or for slabs more than 4 inches thick.
 - 4. Do not use powder-actuated concrete fasteners for lightweight-aggregate concretes or for slabs less than 4 inches thick.
- C. Hanger Spacing: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Table 5-1, "Rectangular Duct Hangers Minimum Size," and Table 5-2, "Minimum Hanger Sizes for Round Duct," for maximum hanger spacing; install hangers and supports within 24 inches of each elbow and within 48 inches of each branch intersection.
- D. Hangers Exposed to View: Threaded rod and angle or channel supports.
- E. Support vertical ducts with steel angles or channel secured to the sides of the duct with welds, bolts, sheet metal screws, or blind rivets; support at each floor and at a maximum intervals of 16 feet.
- F. Install upper attachments to structures. Select and size upper attachments with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.

3.5 CONNECTIONS

- A. Make connections to equipment with flexible connectors complying with Section 23 3300 "Air Duct Accessories."
- B. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for branch, outlet and inlet, and terminal unit connections.

3.6 PAINTING

- A. Paint interior of metal ducts that are visible through registers and grilles and that do not have duct liner. Apply one coat of flat, black, latex paint over a compatible galvanized-steel primer. Paint materials and application requirements are specified in Section 09 9113 "Exterior Painting" and Section 09 9123 "Interior Painting."

3.7 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Duct System Cleanliness Tests:
 - 1. Visually inspect duct system to ensure that no visible contaminants are present.
 - 2. Test sections of metal duct system, chosen randomly by Owner, for cleanliness in accordance with "Description of Method 3 - NADCA Vacuum Test" in NADCA ACR, "Assessment, Cleaning and Restoration of HVAC Systems."
 - a. Acceptable Cleanliness Level: Net weight of debris collected on the filter media shall not exceed 0.75 mg/100 sq. cm.
- C. Duct system will be considered defective if it does not pass tests and inspections.
- D. Prepare test and inspection reports.

3.8 DUCT CLEANING

- A. Clean new duct system(s) before testing, adjusting, and balancing.
- B. Use duct cleaning methodology as indicated in NADCA ACR.
- C. Use service openings for entry and inspection.
 - 1. Provide openings with access panels appropriate for duct static-pressure and leakage class at dampers, coils, and any other locations where required for inspection and cleaning access. Provide insulated panels for insulated or lined duct. Patch insulation and liner as recommended by duct liner manufacturer. Comply with Section 23 3300 "Air Duct Accessories" for access panels and doors.
 - 2. Disconnect and reconnect flexible ducts as needed for cleaning and inspection.
 - 3. Remove and reinstall ceiling to gain access during the cleaning process.
- D. Particulate Collection and Odor Control:
 - 1. When venting vacuuming system inside the building, use HEPA filtration with 99.97 percent collection efficiency for 0.3-micron-size (or larger) particles.
 - 2. When venting vacuuming system to outdoors, use filter to collect debris removed from HVAC system, and locate exhaust downwind and away from air intakes and other points of entry into building.
- E. Clean the following components by removing surface contaminants and deposits:
 - 1. Air outlets and inlets (registers, grilles, and diffusers).
 - 2. Supply, return, and exhaust fans including fan housings, plenums (except ceiling supply and return plenums), scrolls, blades or vanes, shafts, baffles, dampers, and drive assemblies.
 - 3. Air-handling unit internal surfaces and components including mixing box, coil section, air wash systems, spray eliminators, condensate drain pans, humidifiers and dehumidifiers, filters and filter sections, and condensate collectors and drains.
 - 4. Coils and related components.

5. Return-air ducts, dampers, actuators, and turning vanes except in ceiling plenums and mechanical equipment rooms.
6. Supply-air ducts, dampers, actuators, and turning vanes.
7. Dedicated exhaust and ventilation components and makeup air systems.

F. Mechanical Cleaning Methodology:

1. Clean metal duct systems using mechanical cleaning methods that extract contaminants from within duct systems and remove contaminants from building.
2. Use vacuum-collection devices that are operated continuously during cleaning. Connect vacuum device to downstream end of duct sections so areas being cleaned are under negative pressure.
3. Use mechanical agitation to dislodge debris adhered to interior duct surfaces without damaging integrity of metal ducts, duct liner, or duct accessories.
4. Clean fibrous-glass duct liner with HEPA vacuuming equipment; do not permit duct liner to get wet. Replace fibrous-glass duct liner that is damaged, deteriorated, or delaminated or that has friable material, mold, or fungus growth.
5. Clean coils and coil drain pans in accordance with NADCA ACR. Keep drain pan operational. Rinse coils with clean water to remove latent residues and cleaning materials; comb and straighten fins.
6. Provide drainage and cleanup for wash-down procedures.
7. Antimicrobial Agents and Coatings: Apply EPA-registered antimicrobial agents if fungus is present. Apply antimicrobial agents in accordance with manufacturer's written instructions after removal of surface deposits and debris.

3.9 STARTUP

- A. Air Balance: Comply with requirements in Section 23 0593 "Testing, Adjusting, and Balancing for HVAC."

3.10 DUCT SCHEDULE

A. Fabricate ducts with galvanized sheet steel except as otherwise indicated and as follows:

1. Fabricate all ducts to achieve SMACNA pressure class, seal class, and leakage class as indicated below.
2. Minimum duct gauge for any ductwork shall be 26 gauge.

B. Supply Ducts:

1. Ducts Connected to Fan Coil Units, Furnaces, Heat Pumps, Packaged Rooftop Units, and Terminal Units:
 - a. Pressure Class: Positive 2-inch wg.
 - b. Minimum SMACNA Seal Class: A.
 - c. SMACNA Leakage Class for Rectangular: 12.
 - d. SMACNA Leakage Class for Round and Flat Oval: 6.

C. Return Ducts:

1. Ducts Connected to Fan Coil Units, Furnaces, Heat Pumps, Packaged Rooftop Units and Terminal Units:
 - a. Pressure Class: Positive or negative 2-inch wg.
 - b. Minimum SMACNA Seal Class: A.
 - c. SMACNA Leakage Class for Rectangular: 12.
 - d. SMACNA Leakage Class for Round and Flat Oval: 12.

D. Exhaust Ducts:

1. Ducts Connected to Fans Exhausting (ASHRAE 62.1, Class 1 and 2) Air:
 - a. Pressure Class: Negative 1-inch wg.
 - b. Minimum SMACNA Seal Class: A if negative pressure, and A if positive pressure.

- c. SMACNA Leakage Class for Rectangular: 6.
 - d. SMACNA Leakage Class for Round and Flat Oval: 6.
- E. Intermediate Reinforcement:
 - 1. Galvanized-Steel Ducts: Galvanized steel.
 - 2. PVC-Coated Ducts:
 - a. Exposed to Airstream: Match duct material.
 - b. Not Exposed to Airstream: Match duct material.
- F. Liner:
 - 1. Return-Air Ducts (On all runouts to return devices and elsewhere as noted): Fibrous glass, Type I, 1 inch thick.
 - 2. Transfer Ducts: Fibrous glass, Type I, 1 inch thick.
- G. Elbow Configuration:
 - 1. Rectangular Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 4-2, "Rectangular Elbows."
 - a. Radius Type RE 1 with minimum 1.5 radius-to-diameter ratio.
 - b. Radius Type RE 3 with minimum 1.0 radius-to-diameter ratio and two vanes.
 - c. Mitered Type RE 2 with vanes complying with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 4-3, "Vanes and Vane Runners," and Figure 4-4, "Vane Support in Elbows."
 - 2. Round Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-4, "Round Duct Elbows."
 - a. Minimum Radius-to-Diameter Ratio and Elbow Segments: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Table 3-1, "Mitered Elbows." Elbows with less than 90-degree change of direction have proportionately fewer segments.
 - 1) Radius-to Diameter Ratio: 1.5.
 - b. Round Elbows, 12 Inches and Smaller in Diameter: Stamped, segmented, or segmented standing seam.
 - c. Round Elbows, 14 Inches and Larger in Diameter: Segmented, segmented standing seam, or Welded.
- H. Branch Configuration:
 - 1. Rectangular Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 4-6, "Branch Connection."
 - a. Rectangular Main to Rectangular Branch: 45-degree entry.
 - b. Rectangular Main to Round Branch: Conical spin in.
 - 2. Round and Flat Oval: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-5, "90 Degree Tees and Laterals," and Figure 3-6, "Conical Tees." Saddle taps are permitted in existing duct.
 - a. Velocity 1000 fpm or Lower: 90-degree tap.
 - b. Velocity 1000 to 1500 fpm: Conical tap.
 - c. Velocity 1500 fpm or Higher: 45-degree lateral.

END OF SECTION 23 3113

SECTION 23 3300 - AIR DUCT ACCESSORIES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Manual volume dampers.
 - 2. Flange connectors.
 - 3. Turning vanes.
 - 4. Duct-mounted access doors.
 - 5. Flexible connectors.
 - 6. Duct accessory hardware.
- B. Related Requirements:
 - 1. Section 23 3346 "Flexible Ducts" for insulated and non-insulated flexible ducts.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.
- B. Shop Drawings: For duct accessories. Include plans, elevations, sections, details, and attachments to other work.
 - 1. Detail duct accessories' fabrication and installation in ducts and other construction. Include dimensions, weights, loads, and required clearances; and method of field assembly into duct systems and other construction. Include the following:
 - a. Special fittings.
 - b. Manual volume damper installations.
 - c. Control-damper installations.
 - d. Fire-damper, smoke-damper, combination fire- and smoke-damper installations, including sleeves; and duct-mounted access doors.
 - e. Include diagrams for power, signal, and control wiring.

1.4 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Reflected ceiling plans, or BIM model, drawn to scale, on which ceiling-mounted access panels and access doors required for access to duct accessories are shown and coordinated with each other, using input from installers of the items involved.
- B. Source quality-control reports.

1.5 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For air duct accessories to include in operation and maintenance manuals.

1.6 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

1. Fusible Links: Furnish quantity equal to 10 percent of amount installed.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Comply with NFPA 90A and NFPA 90B.
- B. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for acceptable materials, material thicknesses, and duct construction methods unless otherwise indicated. Sheet metal materials shall be free of pitting, seam marks, roller marks, stains, discolorations, and other imperfections.

2.2 MANUAL VOLUME DAMPERS

- A. Standard, Steel, Manual Volume Dampers:
 1. Basis-of-Design Product: Subject to compliance with requirements, provide Ruskin Company; CD60 or a comparable product by one of the following:
 - a. American Warming and Ventilating; a Mestek Architectural Group company.
 - b. Greenheck Fan Corporation.
 - c. Nailor Industries Inc.
 2. Performance:
 - a. Leakage Rating Class IA: Leakage not exceeding 4 cfm/sq. ft. against 1-inch wg differential static pressure. Suitable for velocities exceeding 3,000 fpm.
 3. Construction:
 - a. Linkage out of airstream.
 - b. Suitable for horizontal or vertical airflow applications.
 4. Frames:
 - a. Hat-shaped, 16-gauge-thick, galvanized sheet steel.
 - b. Mitered and welded corners.
 - c. Flanges for attaching to walls and flangeless frames for installing in ducts.
 5. Blades:
 - a. Multiple or single blade.
 - b. Opposed-blade design.
 - c. Stiffen damper blades for stability.
 - d. Galvanized steel; 16 gauge thick.
 6. Blade Axles: Galvanized steel.
 7. Bearings:
 - a. Oil-impregnated stainless steel sleeve.
 - b. Dampers mounted with vertical blades to have thrust bearing at each end of every blade.
 8. Tie Bars and Brackets: Galvanized steel.
 9. Locking device to hold damper blades in a fixed position without vibration.
- B. Standard, Aluminum, Manual Volume Dampers:
 1. Basis-of-Design Product: Subject to compliance with requirements, provide Ruskin Company; CD51 or a comparable product by one of the following:
 - a. American Warming and Ventilating; a Mestek Architectural Group company.
 - b. McGill AirFlow LLC.
 - c. Nailor Industries Inc.
 2. Performance:
 - a. Leakage Rating Class I: Leakage not exceeding 4 cfm/sq. ft. against 1-inch wg differential static pressure.
 3. Construction:
 - a. Linkage out of airstream.
 - b. Suitable for horizontal or vertical airflow applications.

4. Frames:
 - a. Hat-shaped, 0.125-inch-thick, aluminum sheet channels.
 - b. Flanges for attaching to walls and flangeless frames for installing in ducts.
5. Blades:
 - a. Multiple or single blade.
 - b. Opposed-blade design.
 - c. Stiffen damper blades for stability.
 - d. Roll-Formed Aluminum Blades: 0.125-inch-thick aluminum sheet.
6. Blade Axles: Galvanized steel.
7. Bearings:
 - a. Oil-impregnated bronze.
 - b. Dampers mounted with vertical blades to have thrust bearing at each end of every blade.
8. Tie Bars and Brackets: Aluminum.
9. Locking device to hold damper blades in a fixed position without vibration.

2.3 FLANGE CONNECTORS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 1. Ductmate Industries, Inc.
 2. DynAir; a Carlisle Company.
 3. Ward Industries; a brand of Hart & Cooley, Inc.
- B. Description: Add-on or roll-formed, factory fabricated, slide-on transverse flange connectors, gaskets, and components.
- C. Material: Galvanized steel.
- D. Gauge and Shape: Match connecting ductwork.

2.4 TURNING VANES

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 1. CL WARD & Family Inc.
 2. Ductmate Industries, Inc.
 3. Ward Industries; a brand of Hart & Cooley, Inc.
- B. Manufactured Turning Vanes for Metal Ducts: Fabricate curved blades of galvanized sheet steel; support with bars perpendicular to blades set; set into vane runners suitable for duct mounting.
- C. General Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible"; Figure 4-3, "Vanes and Vane Runners," and Figure 4-4, "Vane Support in Elbows."
- D. Vane Construction:
 1. Single wall for ducts up to 31 inches wide and double wall for larger dimensions.

2.5 DUCT-MOUNTED ACCESS DOORS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 1. Cesco Products; a division of MESTEK, Inc.

2. [Ductmate Industries, Inc.](#)
 3. [Ruskin Company.](#)
- B. Duct-Mounted Access Doors: Fabricate access panels in accordance with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible"; Figure 7-2 (7-2M), "Duct Access Doors and Panels," and Figure 7-3, "Access Doors - Round Duct."
1. Door:
 - a. Double wall, rectangular.
 - b. Galvanized sheet metal with insulation fill and thickness as indicated for duct pressure class.
 - c. 22-gauge-thick galvanized steel door panel.
 - d. Hinges and Latches: 1-by-1-inch butt or piano hinge and cam latches.
 - e. Fabricate doors airtight and suitable for duct pressure class.
 2. Frame: Galvanized sheet steel, with bend-over tabs and foam gaskets.
 - a. 22-gauge-thick galvanized steel frame.
 3. Number of Hinges and Locks:
 - a. Access Doors Less Than 12 Inches Square: No hinges and two sash locks.
 - b. Access Doors up to 18 Inches Square: Two hinges Continuous and two sash locks.
 - c. Access Doors up to 24 by 48 Inches: Continuous and two compression latches with outside and inside handles.
 - d. Access Doors Larger Than 24 by 48 Inches: Continuous and two compression latches with outside and inside handles.

2.6 FLEXIBLE CONNECTORS

- A. [Manufacturers:](#) Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
1. [CL WARD & Family Inc.](#)
 2. [Ductmate Industries, Inc.](#)
 3. [Ward Industries; a brand of Hart & Cooley, Inc.](#)
- B. Fire-Performance Characteristics: Adhesives, sealants, fabric materials, and accessory materials shall have flame-spread index not exceeding 25 and smoke-developed index not exceeding 50 when tested in accordance with ASTM E84.
- C. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1.
- D. Materials: Flame-retardant or noncombustible fabrics.
- E. Coatings and Adhesives: Comply with UL 181, Class 1.
- F. Metal-Edged Connectors: Factory fabricated with a fabric strip 3-1/2 inches wide attached to two strips of 2-3/4-inch-wide, 0.028-inch-thick, galvanized sheet steel or 0.032-inch-thick aluminum sheets. Provide metal compatible with connected ducts.
- G. Indoor System, Flexible Connector Fabric: Glass fabric double coated with neoprene.
1. Minimum Weight: 26 oz./sq. yd..
 2. Tensile Strength: 480 lbf/inch in the warp and 360 lbf/inch in the filling.
 3. Service Temperature: Minus 40 to plus 200 deg F.
- H. Thrust Limits: Combination coil spring and elastomeric insert with spring and insert in compression, and with a load stop. Include rod and angle-iron brackets for attaching to fan discharge and duct.

1. Frame: Steel, fabricated for connection to threaded rods and to allow for a maximum of 30 degrees of angular rod misalignment without binding or reducing isolation efficiency.
2. Outside Spring Diameter: Not less than 80 percent of the compressed height of the spring at rated load.
3. Minimum Additional Travel: 50 percent of the required deflection at rated load.
4. Lateral Stiffness: More than 80 percent of rated vertical stiffness.
5. Overload Capacity: Support 200 percent of rated load, fully compressed, without deformation or failure.
6. Elastomeric Element: Molded, oil-resistant rubber or neoprene.
7. Coil Spring: Factory set and field adjustable for a maximum of 1/4-inch movement at start and stop.

2.7 DUCT ACCESSORY HARDWARE

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 1. CL WARD & Family Inc.
 2. Ductmate Industries, Inc.
 3. Ward Industries; a brand of Hart & Cooley, Inc.
- B. Instrument Test Holes: Cast iron or cast aluminum to suit duct material, including screw cap and gasket. Size to allow insertion of pitot tube and other testing instruments and of length to suit duct-insulation thickness.
- C. Adhesives: High strength, quick setting, neoprene based, waterproof, and resistant to gasoline and grease.

2.8 MATERIALS

- A. Galvanized Sheet Steel: Comply with ASTM A653/A653M.
 1. Galvanized Coating Designation: G90.
 2. Exposed-Surface Finish: Mill phosphatized.
- B. Stainless Steel Sheets: Comply with ASTM A480/A480M, Type 304, and having a No. 2 finish for concealed ducts and No. 5 finish for exposed ducts.
- C. Aluminum Sheets: Comply with ASTM B209, Alloy 3003, Temper H14; with mill finish for concealed ducts and standard, one-side bright finish for exposed ducts.
- D. Extruded Aluminum: Comply with ASTM B221, Alloy 6063, Temper T6.
- E. Reinforcement Shapes and Plates: Galvanized-steel reinforcement where installed on galvanized sheet metal ducts; compatible materials for aluminum and stainless steel ducts.
- F. Tie Rods: Galvanized steel, 1/4-inch minimum diameter for lengths 36 inches or less; 3/8-inch minimum diameter for lengths longer than 36 inches.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install duct accessories in accordance with applicable details in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for metal ducts and in NAIMA AH116 for fibrous-glass ducts.

- B. Install duct accessories of materials suited to duct materials; use galvanized-steel accessories in galvanized-steel and fibrous-glass ducts, stainless steel accessories in stainless steel ducts, and aluminum accessories in aluminum ducts.
- C. Where multiple damper sections are necessary to achieve required dimensions, provide reinforcement to fully support damper assembly when fully closed at full system design static pressure.
- D. Install volume dampers at points on supply, return, and exhaust systems where branches extend from larger ducts. Where dampers are installed in ducts having duct liner, install dampers with hat channels of same depth as liner, and terminate liner with nosing at hat channel.
 - 1. Install steel volume dampers in steel ducts.
 - 2. Install aluminum volume dampers in aluminum ducts.
- E. Set dampers to fully open position before testing, adjusting, and balancing.
- F. Install test holes at fan inlets and outlets and elsewhere as indicated and as needed for testing and balancing.
- G. Install fire dampers in accordance with UL listing.
- H. Connect ducts to duct silencers.
- I. Install duct access doors on sides of ducts to allow for inspecting, adjusting, and maintaining accessories and equipment at the following locations:
 - 1. On both sides of duct coils.
 - 2. Upstream from duct filters.
 - 3. At outdoor-air intakes and mixed-air plenums.
 - 4. At drain pans and seals.
 - 5. Downstream from manual volume dampers, control dampers, backdraft dampers, and equipment.
 - 6. Adjacent to and close enough to fire or smoke dampers, to reset or reinstall fusible links. Access doors for access to fire or smoke dampers having fusible links shall be pressure relief access doors and shall be outward operation for access doors installed upstream from dampers and inward operation for access doors installed downstream from dampers.
 - 7. Upstream or downstream from duct silencers.
 - 8. Control devices requiring inspection.
 - 9. Elsewhere as indicated.
- J. Install access doors with swing against duct static pressure.
- K. Access Door Sizes:
 - 1. One-Hand or Inspection Access: 8 by 5 inches.
 - 2. Two-Hand Access: 12 by 6 inches.
 - 3. Head and Hand Access: 18 by 10 inches.
 - 4. Head and Shoulders Access: 21 by 14 inches.
 - 5. Body Access: 25 by 14 inches.
 - 6. Body plus Ladder Access: 25 by 17 inches.
- L. Label access doors according to Section 23 0553 "Identification for HVAC Piping and Equipment" to indicate the purpose of access door.
- M. Install flexible connectors to connect ducts to equipment.

- N. For fans developing static pressures of 5 inches wg and more, cover flexible connectors with loaded vinyl sheet held in place with metal straps.
- O. Install duct test holes where required for testing and balancing purposes.
- P. Install thrust limits at centerline of thrust, symmetrical on both sides of equipment. Attach thrust limits at centerline of thrust and adjust to a maximum of 1/4-inch movement during start and stop of fans.

3.2 FIELD QUALITY CONTROL

- A. Tests and Inspections:
 - 1. Operate dampers to verify full range of movement.
 - 2. Inspect locations of access doors and verify that size and location of access doors are adequate to perform required operation.
 - 3. Operate fire, smoke, and combination fire and smoke dampers to verify full range of movement and that proper heat-response device is installed.
 - 4. Inspect turning vanes for proper and secure installation and verify that vanes do not move or rattle.

END OF SECTION 23 3300

SECTION 23 3346 - FLEXIBLE DUCTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Insulated flexible ducts.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.
- B. Shop Drawings: For flexible ducts.
 - 1. Include plans showing locations and mounting and attachment details.

1.4 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Reflected ceiling plans, drawn to scale, on which ceiling-mounted access panels and access doors required for access to duct accessories are shown and coordinated with each other, using input from installers of the items involved.

PART 2 - PRODUCTS

2.1 ASSEMBLY DESCRIPTION

- A. Comply with NFPA 90A, "Installation of Air Conditioning and Ventilating Systems," and with NFPA 90B, "Installation of Warm Air Heating and Air Conditioning Systems."
- B. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for acceptable materials, material thicknesses, and duct construction methods unless otherwise indicated. Sheet metal materials shall be free of pitting, seam marks, roller marks, stains, discolorations, and other imperfections.
- C. Comply with the Air Diffusion Council's "ADC Flexible Air Duct Test Code FD 72-R1."
- D. Comply with ASTM E96/E96M, "Test Methods for Water Vapor Transmission of Materials."

2.2 INSULATED FLEXIBLE DUCTS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - 1. Flexmaster U.S.A., Inc.
 - 2. JP Lamborn Co.
 - 3. Thermaflex; a Flex-Tek Group company.
- B. Insulated, Flexible Duct: UL 181, Class 1, black polymer film supported by helically wound, coated spring-steel wire; fibrous-glass insulation; Fiberglass scrim reinforced aluminized polyester film vapor barrier.
 - 1. Pressure Rating: 6-inch wg positive and 1-inch wg negative.
 - 2. Maximum Air Velocity: 4000 fpm.
 - 3. Temperature Range: Minus 20 to plus 175 deg F.
 - 4. Insulation R-Value: R6.

2.3 FLEXIBLE DUCT CONNECTORS

- A. Clamps: Stainless-steel band with cadmium-plated hex screw to tighten band with a worm-gear action or Nylon strap in sizes 3 through 18 inches, to suit duct size.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install flexible ducts according to applicable details in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for metal ducts and in NAIMA AH116, "Fibrous Glass Duct Construction Standards," for fibrous-glass ducts.
- B. Install in indoor applications only. Flexible ductwork should not be exposed to UV lighting.
- C. Connect terminal units to supply ducts directly. Do not use flexible ducts to change directions.
- D. Connect diffusers to ducts directly or with maximum 60-inch lengths of flexible duct clamped or strapped in place.
- E. Connect flexible ducts to metal ducts with draw bands.
- F. Install duct test holes where required for testing and balancing purposes.
- G. Installation:
 - 1. Install ducts fully extended.
 - 2. Do not bend ducts across sharp corners.
 - 3. Bends of flexible ducting shall not exceed a minimum of one duct diameter.
 - 4. Avoid contact with metal fixtures, water lines, pipes, or conduits.
 - 5. Install flexible ducts in a direct line, without sags, twists, or turns.
- H. Supporting Flexible Ducts:
 - 1. Suspend flexible ducts with bands 1-1/2 inches wide or wider and spaced a maximum of 48 inches apart. Maximum centerline sag between supports shall not exceed 1/2 inch per 12 inches.

2. Install extra supports at bends placed approximately one duct diameter from center line of the bend.
3. Ducts may rest on ceiling joists or truss supports. Spacing between supports shall not exceed the maximum spacing per manufacturer's written installation instructions.
4. Vertically installed ducts shall be stabilized by support straps at a maximum of 60 inches o.c.

END OF SECTION 23 3346

SECTION 23 3400 - HVAC FANS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Ventilators, centrifugal - roof-mounted downblast.

1.2 ACTION SUBMITTALS

- A. Product Data:
 - 1. For each type of product.
 - a. Construction details, material descriptions, dimensions of individual components and profiles, and finishes for fans.
 - b. Rated capacities, furnished specialties, and accessories for each fan.
 - c. Fans:
 - 1) Certified fan performance curves with system operating conditions indicated.
 - 2) Certified fan sound-power ratings.
 - 3) Fan construction and accessories.
 - 4) Motor ratings and electrical characteristics, plus motor and electrical accessories.
 - 5) Fan speed controllers.
 - d. Material thickness and finishes, including color charts.
 - e. Dampers, including housings, linkages, and operators.
- B. Shop Drawings:
 - 1. Include plans, elevations, sections, and attachment details.
 - 2. Include details of equipment assemblies. Indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
 - 3. Include diagrams for power, signal, and control wiring.

1.3 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Floor plans showing fan rooms and fan system layouts, reflected ceiling plans, and other drawings required to illustrate relationships between components and adjacent structural and mechanical elements. Show support locations, type of support, and weight on each support. Indicate and certify field measurements.
- B. Startup service reports.
- C. Field quality-control reports.

1.4 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For fans and ventilators, include the following:
 - 1. Operation in normal and emergency modes.
 - 2. Operation and maintenance manuals.

1.5 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials that match products installed and that are packaged with protective coverage for storage and identified with labels describing contents.
 - 1. Belts: [One] set(s) for each belt-driven unit.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by an NRTL, and marked for intended location and application.
- B. NFPA Compliance: Comply with NFPA 90A for design, fabrication, and installation of unit components.
- C. ASHRAE 62.1 Compliance: Applicable requirements in ASHRAE 62.1, Section 5 - "Systems and Equipment" and Section 7 - "Construction and Startup."
- D. ASHRAE/IES 90.1 Compliance: Applicable requirements in ASHRAE/IES 90.1, Section 6 - "Heating, Ventilating, and Air-Conditioning."

2.2 VENTILATORS, CENTRIFUGAL - ROOF-MOUNTED DOWNBLAST

- A. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - 1. Acme Engineering & Manufacturing Corp.
 - 2. Greenheck Fan Corporation.
 - 3. Loren Cook Company.
- B. Source Limitations: Obtain roof-mounted downblast centrifugal ventilators from single manufacturer.
- C. Standards: Comply with UL 705.
- D. Housing: Downblast; removable spun-aluminum dome top and outlet baffle spun aluminum; square, one-piece aluminum base with venturi inlet cone.
- E. Fan Wheels: Aluminum hub and wheel with backward-inclined blades.
- F. Belt Drives:
 - 1. Resiliently mounted to housing.
 - 2. Fan Shaft: Turned, ground, and polished steel; keyed to wheel hub.
 - 3. Shaft Bearings: Permanently lubricated, permanently sealed, self-aligning ball bearings.
 - 4. Fan Pulleys: Cast iron or cast steel with split, tapered bushing; dynamically balanced at factory.
 - 5. Motor Pulleys: Adjustable pitch for use with motors through 5 hp. Select pulley so pitch adjustment is at the middle of adjustment range at fan design conditions.
- G. Accessories:
 - 1. Disconnect Switch: Nonfusible type, with thermal-overload protection mounted outside fan housing, factory wired through an internal aluminum conduit.

2. Bird Screens: Removable, 1/2-inch mesh, aluminum or brass wire.
 3. Motorized Dampers: Parallel-blade dampers mounted in curb base with electric actuator; wired to close when fan stops.
- H. Prefabricated Roof Curbs: Galvanized steel; mitered and welded corners; 1-1/2-inch-thick, rigid, fiberglass insulation adhered to inside walls; and 1-1/2-inch wood nailer. Size as required to suit roof opening and fan base.
1. Configuration: Built-in cant and mounting flange.
 2. Overall Height: 12 inches.
 3. Metal Liner: Galvanized steel.
 4. Mounting Pedestal: Galvanized steel with removable access panel.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Install fans level and plumb.
- B. Disassemble and reassemble units, as required for moving to the final location, in accordance with manufacturer's written instructions.
- C. Lift and support units with manufacturer's designated lifting or supporting points.
- D. Equipment Mounting:
 1. Install roof-mounted fans on roof curbs or support steel. See Drawings for specific requirements.
- E. Install units with adequate clearances for service and maintenance.
- F. Label fans in accordance with requirements specified in Section 23 0553 "Identification for HVAC Piping and Equipment."

3.2 DUCTWORK CONNECTIONS

- A. Drawings indicate general arrangement of ducts and duct accessories. Make final duct connections with flexible connectors. Flexible connectors are specified in Section 23 3300 "Air Duct Accessories."
- B. Where installing ducts adjacent to fans, allow space for service and maintenance.

3.3 PIPING CONNECTIONS

- A. Install piping from scroll drain connection, with trap with seal equal to 1.5 times specified static pressure, to nearest floor drain with pipe sizes matching the drain connection.
- B. Install heat tracing on all drain piping subject to freezing temperature and as indicated on Drawings. Furnish and install heat tracing in accordance with Section 23 0533 "Heat Tracing for HVAC Piping."

3.4 ELECTRICAL CONNECTIONS

- A. Connect wiring in accordance with Section 26 0519 "Low-Voltage Electrical Power Conductors and Cables."
- B. Ground equipment in accordance with Section 26 0526 "Grounding and Bonding for Electrical Systems."
- C. Install electrical devices furnished by manufacturer, but not factory mounted, in accordance with NFPA 70 and NECA 1.
- D. Install nameplate for each electrical connection, indicating electrical equipment designation and circuit number feeding connection.
 - 1. Nameplate is to be laminated acrylic or melamine plastic signs, as specified in Section 26 0553 "Identification for Electrical Systems."
 - 2. Nameplate is to be laminated acrylic or melamine plastic signs with a black background and engraved white letters at least 1/2 inch high.

3.5 CONTROL CONNECTIONS

- A. Install control and electrical power wiring to field-mounted control devices.
- B. Connect wiring in accordance with Section 26 0519 "Low-Voltage Electrical Power Conductors and Cables."

3.6 STARTUP SERVICE:

- A. Perform startup service.
 - 1. Complete installation and startup checks in accordance with manufacturer's written instructions.
 - 2. Verify that shipping, blocking, and bracing are removed.
 - 3. Verify that unit is secure on mountings and supporting devices and that connections to ducts and electrical components are complete. Verify that proper thermal-overload protection is installed in motors, starters, and disconnect switches.
 - 4. Verify that cleaning and adjusting are complete.
 - 5. For belt-drive fans, disconnect fan drive from motor, verify proper motor rotation direction, and verify fan wheel free rotation and smooth bearing operation. Reconnect fan drive system, align and adjust belts, and install belt guards.
 - 6. Adjust belt tension.
 - 7. Adjust damper linkages for proper damper operation.
 - 8. Verify lubrication for bearings and other moving parts.
 - 9. Verify that manual and automatic volume control and fire and smoke dampers in connected ductwork systems are in fully open position.
 - 10. Disable automatic temperature-control operators, energize motor and confirm proper motor rotation and unit operation, adjust fan to indicated rpm, and measure and record motor voltage and amperage.
 - 11. Shut unit down and reconnect automatic temperature-control operators.
 - 12. Remove and replace malfunctioning units and retest as specified above.

3.7 ADJUSTING

- A. Adjust damper linkages for proper damper operation.

- B. Adjust belt tension.
- C. Lubricate bearings.
- D. Comply with requirements in Section 23 0593 "Testing, Adjusting, and Balancing for HVAC."

3.8 CLEANING

- A. After completing system installation and testing, adjusting, and balancing and after completing startup service, clean fans internally to remove foreign material and construction dirt and dust.

3.9 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
 - 1. Fan Operational Test: After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation.
 - 2. Test and adjust controls and safeties.
 - 3. Fans and components will be considered defective if they do not pass tests and inspections.
 - 4. Prepare test and inspection reports.

3.10 DEMONSTRATION

- A. Train Owner's maintenance personnel to adjust, operate, and maintain HVAC fans.

END OF SECTION 23 3400

SECTION 23 3713.13 - AIR DIFFUSERS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Rectangular and square ceiling diffusers.
 - 2. Linear slot diffusers.
- B. Related Requirements:
 - 1. Section 23 3300 "Air Duct Accessories" for fire and smoke dampers and volume-control dampers not integral to diffusers.
 - 2. Section 23 3713.23 "Air Registers and Grilles" for adjustable-bar register and grilles, fixed-face registers and grilles, and linear bar grilles.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.
 - 1. Data Sheet: Indicate materials of construction, finish, and mounting details; and performance data including throw and drop, static-pressure drop, and noise ratings.
 - 2. Diffuser Schedule: Indicate drawing designation, room location, quantity, model number, size, and accessories furnished.
- B. Samples: For each exposed product and for each color and texture specified. Actual size of smallest diffuser indicated.
- C. Samples for Initial Selection: For diffusers with factory-applied color finishes. Actual size of smallest diffuser indicated.
- D. Samples for Verification: For diffusers, in manufacturer's standard sizes to verify color selected. Actual size of smallest diffuser indicated.

1.4 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Reflected ceiling plans, drawn to scale, on which the following items are shown and coordinated with each other, using input from installers of the items involved:
 - 1. Ceiling suspension assembly members.
 - 2. Method of attaching hangers to building structure.
 - 3. Size and location of initial access modules for acoustical tile.
 - 4. Ceiling-mounted items including lighting fixtures, diffusers, grilles, speakers, sprinklers, access panels, and special moldings.
 - 5. Duct access panels.
- B. Source quality-control reports.

PART 2 - PRODUCTS

2.1 RECTANGULAR AND SQUARE CEILING DIFFUSERS

- A. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - 1. Price Industries.
 - 2. Titus, a division of Air System Components; Johnson Controls, Inc.
- B. Devices shall be specifically designed for variable-air-volume flows.
- C. Material: Steel.
- D. Finish: Baked enamel, white unless otherwise indicated.
- E. Insulated back: Yes
- F. Face Size: As indicated on the schedules.
- G. Face Style: Plaque.
- H. Mounting: To match ceiling the devices are installed in.
- I. Pattern: Fixed.
- J. Dampers: Radial opposed blade where indicated.

2.2 LINEAR SLOT DIFFUSERS

- A. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - 1. Price Industries.
 - 2. Titus, a division of Air System Components; Johnson Controls, Inc.
- B. Devices shall be specifically designed for variable-air-volume flows.
- C. Material - Shell: Aluminum, insulated.
- D. Material - Pattern Controller and Tees: Aluminum.
- E. Finish - Face and Shell: Baked enamel, black.
- F. Finish - Pattern Controller: Baked enamel, black.
- G. Finish - Tees: Baked enamel, white.
- H. With Insulated plenum.
- I. Slot Width: As indicated on the schedules.
- J. Number of Slots: As indicated on the schedules .

- K. Length: As indicated on the schedules .

2.3 SOURCE QUALITY CONTROL

- A. Verification of Performance: Rate diffusers according to ASHRAE 70, "Method of Testing for Rating the Performance of Air Outlets and Inlets."

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine areas where diffusers are installed for compliance with requirements for installation tolerances and other conditions affecting performance of equipment.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Install diffusers level and plumb.
- B. Ceiling-Mounted Outlets and Inlets: Drawings indicate general arrangement of ducts, fittings, and accessories. Air outlet and inlet locations have been indicated to achieve design requirements for air volume, noise criteria, airflow pattern, throw, and pressure drop. Make final locations where indicated, as much as practical. For units installed in lay-in ceiling panels, locate units in the center of panel. Where architectural features or other items conflict with installation, notify Architect for a determination of final location.
- C. Install diffusers with airtight connections to ducts and to allow service and maintenance of dampers, air extractors, and fire dampers.

3.3 ADJUSTING

- A. After installation, adjust diffusers to air patterns indicated, or as directed, before starting air balancing.

END OF SECTION 23 3713.13

SECTION 23 3713.23 - REGISTERS AND GRILLES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Adjustable blade face registers and grilles.
 - 2. Fixed face registers and grilles.
- B. Related Requirements:
 - 1. Section 23 3300 "Air Duct Accessories" for fire and smoke dampers and volume-control dampers not integral to registers and grilles.
 - 2. Section 23 3713.13 "Air Diffusers" for various types of air diffusers.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.
 - 1. Data Sheet: Indicate materials of construction, finish, and mounting details; and performance data including throw and drop, static-pressure drop, and noise ratings.
 - 2. Register and Grille Schedule: Indicate drawing designation, room location, quantity, model number, size, and accessories furnished.

1.4 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Reflected ceiling plans, drawn to scale, on which the following items are shown and coordinated with each other, using input from installers of the items involved:
 - 1. Ceiling suspension assembly members.
 - 2. Method of attaching hangers to building structure.
 - 3. Size and location of initial access modules for acoustical tile.
 - 4. Ceiling-mounted items including lighting fixtures, diffusers, grilles, speakers, sprinklers, access panels, and special moldings.
 - 5. Duct access panels.
- B. Source quality-control reports.

PART 2 - PRODUCTS

2.1 REGISTERS

- A. Adjustable Blade Face Register:
 - 1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. Price Industries.
 - b. Titus, a division of Air System Components; Johnson Controls, Inc.
 - 2. Material: Aluminum.
 - 3. Finish: Baked enamel, white unless otherwise indicated.
 - 4. Face Blade Arrangement: As indicated on the schedules.
 - 5. Core Construction: Integral.
 - 6. Rear-Blade Arrangement: As indicated on the schedules .

7. Frame: 1 inch wide unless otherwise indicated.
8. Mounting: To match the surface it is installed in.
9. Damper Type: Adjustable opposed blade.

B. Fixed Face Register:

1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. Price Industries.
 - b. Titus, a division of Air System Components; Johnson Controls, Inc.
2. Material: Aluminum.
3. Finish: Baked enamel, white unless otherwise indicated.
4. Face Blade Arrangement: As indicated on the schedules.
5. Core Construction: Integral.
6. Frame: 1 inch wide unless otherwise indicated.
7. Mounting: To match the surface it is installed in.
8. Damper Type: Adjustable opposed blade.

2.2 GRILLES

A. Fixed Face Grille:

1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. Price Industries.
 - b. Titus, a division of Air System Components; Johnson Controls, Inc.
2. Material: Aluminum.
3. Finish: Baked enamel, white unless otherwise indicated.
4. Face Blade Arrangement: As indicated on the schedules.
5. Core Construction: Integral.
6. Frame: 1 inch wide unless otherwise indicated.
7. Mounting: To match the surface it is installed in.

2.3 SOURCE QUALITY CONTROL

- A. Verification of Performance: Rate registers and grilles according to ASHRAE 70, "Method of Testing for Rating the Performance of Air Outlets and Inlets."

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine areas where registers and grilles are installed for compliance with requirements for installation tolerances and other conditions affecting performance of equipment.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Install registers and grilles level and plumb.
- B. Outlets and Inlets Locations: Drawings indicate general arrangement of ducts, fittings, and accessories. Air outlet and inlet locations have been indicated to achieve design requirements for air volume, noise criteria, airflow pattern, throw, and pressure drop. Make final locations where indicated, as much as practical. For units installed in lay-in ceiling panels, locate units in the center of panel. Where architectural features or other items conflict with installation, notify Architect for a determination of final location.

- C. Install registers and grilles with airtight connections to ducts and to allow service and maintenance of dampers, air extractors, and fire dampers.

3.3 ADJUSTING

- A. After installation, adjust registers and grilles to air patterns indicated, or as directed, before starting air balancing.

END OF SECTION 23 3713.23

SECTION 23 7416.13 - PACKAGED, LARGE-CAPACITY, ROOFTOP AIR-CONDITIONING UNITS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes packaged, large-capacity, rooftop air conditioning units (RTUs) with the following components:
 - 1. Casings.
 - 2. Fans, drives, and motors.
 - 3. Coils.
 - 4. Refrigerant circuit components.
 - 5. Air filtration.
 - 6. Gas furnaces.
 - 7. Dampers.
 - 8. Electrical power connections.
 - 9. Controls.
 - 10. Roof curbs.
 - 11. Accessories.

1.2 DEFINITIONS

- A. RTU: Rooftop unit. As used in this Section, this abbreviation means packaged, large-capacity, rooftop air-conditioning units. This abbreviation is used regardless of whether the unit is mounted on the roof or on a concrete base on ground.

1.3 ACTION SUBMITTALS

- A. Product Data: For each RTU.
 - 1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes.
 - 2. Include rated capacities, dimensions, required clearances, characteristics, furnished specialties, and accessories.
 - 3. Include unit dimensions and weight.
 - 4. Include cabinet material, metal thickness, finishes, insulation, and accessories.
 - 5. Fans:
 - a. Include certified fan-performance curves with system operating conditions indicated.
 - b. Include certified fan-sound power ratings.
 - c. Include fan construction and accessories.
 - d. Include motor ratings, electrical characteristics, and motor accessories.
 - 6. Include certified coil-performance ratings with system operating conditions indicated.
 - 7. Include filters with performance characteristics.
 - 8. Include gas furnaces with performance characteristics.
 - 9. Include dampers, including housings, linkages, and operators.
- B. Shop Drawings: For each packaged, large-capacity, rooftop air-conditioning units.
 - 1. Include plans, elevations, sections, and mounting details.

2. Include details of equipment assemblies. Indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
3. Include diagrams for power, signal, and control wiring.

1.4 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Floor plans and other details, or BIM model, drawn to scale, showing the items described in this Section, and coordinated with all building trades.
- B. Sample Warranty: For manufacturer's warranty.
- C. Source quality-control reports.

1.5 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For RTUs to include in emergency, operation, and maintenance manuals.

1.6 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 1. Filters: One set(s) of filters for each unit.
 2. Gaskets: One set(s) for each access door.

1.7 WARRANTY

- A. Warranty: Manufacturer agrees to repair or replace components of outdoor, semi-custom, air-handling unit that fail in materials or workmanship within specified warranty period.
 1. Warranty Period: One year(s) from date of Substantial Completion.
 2. Warranty Period for Compressors: Manufacturer's standard, but not less than 5 years from date of Substantial Completion.
 3. Warranty Period for Parts: Manufacturer's standard, but not less than 3 years from date of substantial Completion.
 4. Warranty Period for Heat Exchangers: Manufacturer's standard, but not less than 10 years from date of Substantial Completion

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by an NRTL, and marked for intended location and application.
- B. NFPA Compliance: Comply with NFPA 90A for design, fabrication, and installation of RTUs and components.

- C. ASHRAE 62.1 Compliance: Applicable requirements in ASHRAE 62.1, Section 5 - "Systems and Equipment" and Section 7 - "Construction and Startup."
- D. ASHRAE 15 Compliance: For refrigeration system safety.
- E. ASHRAE/IES 90.1 Compliance: Applicable requirements in ASHRAE/IES 90.1, Section 6 - "Heating, Ventilating, and Air-Conditioning."
- F. UL Compliance: Comply with UL 1995.

2.2 CHARACTERISTICS

- A. Supply-Air Fan:
 - 1. Fan Type: Direct drive, backward curved, centrifugal.
 - 2. Airflow: As indicated on project schedules.
 - 3. External Static Pressure: As indicated on project schedules.
 - 4. Fan Speed: Single Zone VAV.
- B. Condenser fan:
 - 1. Variable speed ECM
- C. Economizer Barometric Relief..
- D. Supply-Air Refrigerant Coil:
- E. Outdoor-Air Refrigerant Coil:
- F. Compressors:
 - 1. Number of Compressors: Two
 - 2. Compressor stages: One at two stage and one at single stage
 - 3. Compressor Type: Scroll
 - 4. Integrated Energy-Efficiency Ratio (IEER): As indicated on project schedules.
- G. Gas Furnace:
 - 1. Stainless Steel tubes and burners
 - 2. Induced draft combustion blower.
- H. Gas Control Valve: Modulating gas valve. Air Filters:
 - 1. Minimum Efficiency Reporting Value:
 - 2. MERV Rating: MERV 13, according to ASHRAE 52.2.
- I. BACnet Compatible
- J. Electrical Characteristics for Single-Point Connection:
 - 1. Voltage: As indicated on project schedules.
 - 2. Phase: As indicated on project schedules.
 - 3. Hertz: 60.
 - 4. 115-volt outlet, prewired.

2.3 PACKAGED, LARGE-CAPACITY, ROOFTOP AIR-CONDITIONING UNITS

- A. Basis-of-Design Product: Subject to compliance with requirements, provide Trane; Precedent or a comparable product by one of the following:

1. [AAON.](#)
2. [Carrier Global Corporation.](#)
3. [Lennox Industries, Inc.; Lennox International.](#)

2.4 Unit Casings:

- A. General Fabrication Requirements for Casings: Formed and reinforced double-wall insulated panels, fabricated to allow removal for access to internal parts and components, with joints between sections sealed.
- B. Single-Wall Construction:
 1. Outside Casing Wall: Galvanized steel, minimum 18 gauge thick with manufacturer's standard finish, with pitched roof panels and knockouts with grommet seals for electrical and piping connections and lifting lugs.
 2. Floor Plate: G90 galvanized steel, minimum 18 gauge thick.
 3. Casing Insulation: Materials: non-hygroscopic fiberglass insulation.
- C. Airstream Surfaces: Surfaces in contact with airstream to comply with requirements in ASHRAE 62.1.
- D. Panels and Doors:
 1. Panels:
 - a. Fabrication: Tool less hinged access panels/doors. Formed and reinforced with same materials and insulation thickness as casing.
 - b. Gasket: Neoprene, applied around entire perimeters of panel frames.
 - c. Size: Large enough to allow inspection and maintenance of air-handling unit's internal components.
- E. Condensate Drain Pans:
 1. Location: Each type of cooling coil.
 2. Construction:
 - a. Single-wall, stainless-steel or noncorrosive polymer sheet.
 3. Drain Connection:
 - a. Located at lowest point of pan and sized to prevent overflow. Terminate with threaded nipple on one end of pan.
 4. Slope: Minimum 0.125-in./ft. slope, to comply with ASHRAE 62.1, in at least two planes to collect condensate from cooling coils (including coil piping connections, coil headers, and return bends) and from humidifiers and to direct water toward drain connection.
 5. Length: Extend drain pan downstream from leaving face for distance to comply with ASHRAE 62.1.
 6. Width: Entire width of water producing device.
 7. Depth: A minimum of 2 inches deep.
 8. Pan-Top Surface Coating for Galvanized-Steel Drain Pans: Asphaltic waterproofing compound.
 - a. Units with stacked coils must have an intermediate drain pan to collect condensate from top coil.

2.5 FANS, DRIVES, AND MOTORS

- A. Fan and Drive Assemblies: Statically and dynamically balanced and designed for continuous operation at maximum-rated fan speed and motor horsepower.

- B. Supply-Air Fans: Centrifugal, rated according to AMCA 210; galvanized or painted steel; mounted on solid-steel shaft.
 - 1. Shafts: With field-adjustable alignment.
 - a. Turned, ground, and polished hot-rolled steel with keyway.
 - 2. Shaft Bearings:
 - a. Heavy-duty, self-aligning, pillow-block type with an L-50 rated life of minimum 100,000 hours according to ABMA 9.
 - 3. Housings: Formed- and reinforced-steel panels to form curved scroll housings with shaped cutoff and spun-metal inlet bell.
 - a. Bracing: Steel angle or channel supports for mounting and supporting fan scroll, wheel, motor, and accessories.
 - 4. Centrifugal Fan Wheels: Inlet flange, backplate, and shallow blades with inlet and tip curved forward in direction of airflow and mechanically fastened to flange and backplate; steel or aluminum hub swaged to backplate and fastened to shaft with setscrews.
 - 5. Mounting: For internal vibration isolation. Factory-mount fans with manufacturer's standard vibration isolation mounting devices having a minimum static deflection of 1 inch.
 - 6. Flexible Connector: Factory fabricated with a fabric strip minimum 3-1/2 inches wide, attached to two strips of minimum 2-3/4-inch-wide by 0.028-inch-thick, galvanized-steel sheet.
 - a. Flexible Connector Fabric: Glass fabric, double coated with neoprene. Fabrics, coatings, and adhesives to comply with UL 181, Class 1.
- C. Drives, Variable Speed, Direct: Factory-mounted, direct drive.
- D. Condenser-Coil Fan: Variable-speed propeller, mounted on shaft of permanently lubricated ECM motors.
- E. Motors:
 - 1. Motor Sizes: Minimum size as indicated. If not indicated, large enough so driven load will not require motor to operate in service factor range above 1.0.
 - 2. Enclosure Type: Totally enclosed, fan cooled.
 - 3. Efficiency: Premium efficient as defined in NEMA MG 1.
 - a. Controllers, Electrical Devices, and Wiring: Comply with requirements for electrical devices and connections specified in electrical Sections.

2.6 Coils:

- A. General Requirements for Coils:
 - 1. Comply with AHRI 410.
 - 2. Fabricate coils section to allow removal and replacement of coil for maintenance and to allow in-place access for service and maintenance of coil(s).
 - 3. Coils shall not act as structural component of unit.
- B. Supply-Air Refrigerant Coil:
 - 1. Tubes: Flat extrusion tube.
 - 2. Fins: Material: Aluminum.
 - 3. Fin and Tube Joints: Mechanical bond.
 - 4. Headers: Seamless-copper headers with brazed connections.
 - 5. Ratings: Designed, tested, and rated according to ASHRAE 33 and AHRI 410.
 - a. Working Pressure: Minimum 300 psig.
- C. Outdoor-Air Refrigerant Coil:
 - 1. Tubes: Flat extrusion tube.
 - 2. Fins: Material: Aluminum.

3. Fin and Tube Joints: Mechanical bond.
4. Headers: Aluminum.
5. Ratings: Designed, tested, and rated according to ASHRAE 33 and AHRI 410.
 - a. Working Pressure: Minimum 300 psig.

2.7 REFRIGERANT CIRCUIT COMPONENTS

- A. Compressor: Hermetic, One (1) two-speed scroll and one (1) single speed scroll, mounted on vibration isolators; with internal overcurrent and high-temperature protection, internal pressure relief, and crankcase heater.
 1. Compressors to be located in isolated compartments. Compressors located in condenser section will not be allowed.
- B. Refrigeration Specialties:
 1. Refrigerant: R-410A.
 2. Expansion valve with replaceable thermostatic element.
 3. Refrigerant filter/dryer.
 4. Manual-reset high-pressure safety switch.
 5. Automatic-reset low-pressure safety switch.
 6. Minimum off-time relay.
 7. Automatic-reset compressor motor thermal overload.
 8. Brass service valves installed in compressor suction and liquid lines.

2.8 AIR FILTRATION

- A. Panel Filters:
 1. Description: Pleated factory-fabricated, self-supported, disposable air filters with holding frames.
 2. Filter Unit Class: UL 900.
 3. Media: Interlaced glass, synthetic or cotton fibers coated with nonflammable adhesive and antimicrobial coating.
 4. Filter-Media Frame: Beverage board with perforated metal retainer, or metal grid, on outlet side.
 5. MERV Rating: MERV 13.

2.9 GAS FURNACES

- A. Description: Factory assembled, piped, and wired; complying with ANSI Z21.47/CSA 2.3 and NFPA 54.
- B. CSA Approval: Designed and certified by and bearing label of CSA.
- C. Burners: Stainless steel.
 1. Fuel: Natural gas.
 2. Ignition: Electronically controlled electric spark or hot-surface igniter with flame sensor.
 3. Gas Control Valve: Modulating.
 4. Gas Train: Single-body, regulated, redundant, 24-V ac gas valve assembly containing pilot solenoid valve, pilot filter, pressure regulator, pilot shutoff, and manual shutoff.
- D. Heat-Exchanger: Stainless steel.

- E. Venting, Power: Power vented, with integral, motorized centrifugal fan interlocked with gas valve.
 - F. Gas Valve Train: Single-body, regulated, redundant, 24-V ac gas valve assembly containing pilot solenoid valve, pilot filter, pressure regulator, pilot shutoff, and manual shutoff.
 - G. Safety Controls:
 - 1. Gas Manifold: Safety switches and controls complying with ANSI standards.
- 2.10 Dampers:
- a.
- 2.11 Electrical Power Connections:
- A. RTU is to have a single connection of power to unit with unit-mounted disconnect switch accessible from outside unit and control-circuit transformer with built-in overcurrent protection. Electrical connection through the unit base.
- 2.12 Controls:
- A. Unit shall be for standalone operation with BACnet interface for future connection to campus/building controls.
- 2.13 Roof Curbs:
- A. Materials: Galvanized steel with corrosion-protection coating, watertight gaskets, and factory-installed wood nailer; complying with NRCA standards.
 - 1. Curb Insulation and Adhesive: Comply with NFPA 90A or NFPA 90B.
 - a. Materials: ASTM C1071, Type I or II.
 - b. Thickness: 1 inch.
 - 2. Application: Factory applied with adhesive and mechanical fasteners to the internal surface of curb.
 - a. Liner Adhesive: Comply with ASTM C916, Type I.
 - b. Mechanical Fasteners: Galvanized steel, suitable for adhesive attachment, mechanical attachment, or welding attachment to duct without damaging liner when applied as recommended by manufacturer and without causing leakage in cabinet.
 - c. Liner materials applied in this location to have airstream surface coated with a temperature-resistant coating or faced with a plain or coated fibrous mat or fabric depending on service air velocity.
- 2.14 Accessories:
- A. Duplex, 115-V, ground-fault-interrupter outlet with 15-A overcurrent protection. Include transformer if required. Outlet shall be energized even if the unit main disconnect is open.
 - B. Filter differential pressure switch with sensor tubing on either side of filter. Set for final filter pressure loss.
 - C. Remote potentiometer to adjust minimum economizer damper position.

- D. Return-air bypass damper.
- E. Factory- or field-installed demand-controlled ventilation.
- F. Safeties:
 - 1. Smoke detector.
 - 2. Condensate overflow switch.
 - 3. Phase-loss and reversal protection.
 - 4. High and low pressure control.
 - 5. Gas furnace airflow-proving switch.
- G. Hail guards of galvanized steel, painted to match casing.
- H. Door switches to disable heating or reset set point when open.
- I. Outdoor air intake weather hood with moisture eliminator.

2.15 SOURCE QUALITY CONTROL

- A. AHRI Compliance:
 - 1. Comply with AHRI 340/360 for testing and rating energy efficiencies for RTUs.
 - 2. Comply with AHRI 270 for testing and rating sound performance for RTUs.
- B. AMCA Compliance:
 - 1. Comply with AMCA 11 and bear the AMCA-Certified Ratings Seal for air and sound performance according to AMCA 211 and AMCA 311.
 - 2. Damper leakage tested in accordance with AMCA 500-D.
 - 3. Operating Limits: Classify according to AMCA 99.
- C. ASHRAE Compliance:
 - 1. Comply with ASHRAE 15 for refrigeration system safety.
 - 2. Comply with ASHRAE 33 for methods of testing cooling and heating coils.

END OF SECTION 23 7416.13

SECTION 23 8126 - SPLIT-SYSTEM AIR-CONDITIONERS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes split-system air-conditioning and heat-pump units consisting of separate evaporator-fan and compressor-condenser components.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated. Include rated capacities, operating characteristics, and furnished specialties and accessories. Include performance data in terms of capacities, outlet velocities, static pressures, sound power characteristics, motor requirements, and electrical characteristics.
- B. Shop Drawings: Include plans, elevations, sections, details, and attachments to other work.
 - 1. Detail equipment assemblies and indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
 - 2. Wiring Diagrams: For power, signal, and control wiring.

1.3 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For split-system air-conditioning units to include in emergency, operation, and maintenance manuals.

1.4 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 - 1. Filters: One set(s) for each air-handling unit.

1.5 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. ASHRAE Compliance:
 - 1. Fabricate and label refrigeration system to comply with ASHRAE 15, "Safety Standard for Refrigeration Systems."
- C. ASHRAE/IESNA Compliance: Applicable requirements in ASHRAE/IESNA 90.1.

1.6 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace components of split-system air-conditioning units that fail in materials or workmanship within specified warranty period.
 - 1. Warranty Period:
 - a. For Compressor: Five year(s) from date of Substantial Completion.
 - b. For Parts: Five year(s) from date of Substantial Completion.
 - c. For Labor: One year(s) from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
1. Daikin.
 2. LG.
 3. Mitsubishi Electric & Electronics USA, Inc.
 4. Trane.
 5. YORK; a Johnson Controls company.

2.2 INDOOR UNITS (5 TONS OR LESS)

- A. Concealed Evaporator-Fan Components:
1. Chassis: Galvanized steel with flanged edges, removable panels for servicing, and insulation on back of panel.
 2. Insulation: Faced, glass-fiber duct liner.
 3. Refrigerant Coil: Copper tube, with mechanically bonded aluminum fins and thermal-expansion valve. Comply with ARI 206/110.
 4. Fan: Forward-curved, double-width wheel of galvanized steel; directly connected to motor.
 5. Fan Motors:
 - a. Comply with NEMA designation, temperature rating, service factor, enclosure type, and efficiency requirements specified in Section 23 0513 "Common Motor Requirements for HVAC Equipment."
 - b. Multitapped, multispeed with internal thermal protection and permanent lubrication.
 - c. Wiring Terminations: Connect motor to chassis wiring with plug connection.
 6. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1.
 7. Filters: Permanent, cleanable.
 8. Provide with condensate pump where indicated on drawings.
 9. Provide high condensate unit shutoff
 10. Condensate Drain Pans:
 - a. Fabricated with one percent slope in at least two planes to collect condensate from cooling coils (including coil piping connections, coil headers, and return bends) and humidifiers, and to direct water toward drain connection.
 - 1) Length: Extend drain pan downstream from leaving face to comply with ASHRAE 62.1.
 - 2) Depth: A minimum of 2 inches deep.
 - b. Double-wall, stainless-steel sheet with space between walls filled with foam insulation and moisture-tight seal.
 - c. Drain Connection: Located at lowest point of pan and sized to prevent overflow. Terminate with threaded nipple on one end of pan.
 - 1) Minimum Connection Size: NPS 1.
 - d. Pan-Top Surface Coating: Asphaltic waterproofing compound.
 - e. Units with stacked coils shall have an intermediate drain pan to collect condensate from top coil.

2.3 OUTDOOR UNITS (5 TONS OR LESS)

- A. Air-Cooled, Compressor-Condenser Components:

1. Casing: Steel, finished with baked enamel in color selected by Architect, with removable panels for access to controls, weep holes for water drainage, and mounting holes in base. Provide brass service valves, fittings, and gage ports on exterior of casing. Casing shall be tested in accordance with ASTM B-117 salt spray test procedure for a minimum of 1000 hours.
2. Compressor: Hermetically sealed with crankcase heater and mounted on vibration isolation device. Compressor motor shall have thermal- and current-sensitive overload devices, start capacitor, relay, and contactor.
 - a. Compressor Type: Digitally-controlled inverter scroll.
 - b. Refrigerant Charge: R-410A.
 - c. Refrigerant Coil: Copper tube, with mechanically bonded aluminum fins and liquid subcooler. Comply with ARI 206/110.
3. Heat-Pump Components: Reversing valve and low-temperature-air cutoff thermostat.
4. Fan: Aluminum-propeller type, directly connected to motor.
5. Motor: Permanently lubricated, with integral thermal-overload protection.
6. Low Ambient Kit: Permits operation down to 0 deg F.
7. Coils shall be copper tube with mechanically bonded aluminum fins with corrosion resistant hydrophilic silica gel coating.

2.4 ACCESSORIES

- A. Control equipment and sequence of operation are specified in Section 23 0900 "Direct Digital Control (DDC) System for HVAC".
- B. Thermostat: Wireless infrared functioning to remotely control compressor and evaporator fan, with the following features:
 1. Compressor time delay.
 2. 24-hour time control of system stop and start.
 3. Liquid-crystal display indicating temperature, set-point temperature, time setting, operating mode, and fan speed.
 4. Fan-speed selection including auto setting.
- C. Automatic-reset timer to prevent rapid cycling of compressor.
- D. Refrigerant Line Kits: Soft-annealed copper suction and liquid lines factory cleaned, dried, pressurized, and sealed; factory-insulated suction line with flared fittings at both ends.
- E. Drain Hose: For condensate.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install units level and plumb.
- B. Install evaporator-fan components using manufacturer's standard mounting devices securely fastened to building structure.
- C. Equipment Mounting:
 1. Comply with requirements for vibration isolation devices specified in Section 23 0548.13 "Vibration Controls for HVAC."
- D. Install and connect precharged refrigerant tubing to component's quick-connect fittings. Install tubing to allow access to unit.

3.2 CONNECTIONS

- A. Piping installation requirements are specified in other Sections. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Where piping is installed adjacent to unit, allow space for service and maintenance of unit.

3.3 FIELD QUALITY CONTROL

- A. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect, test, and adjust components, assemblies, and equipment installations, including connections.
- B. Perform tests and inspections.
 - 1. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect components, assemblies, and equipment installations, including connections, and to assist in testing.
- C. Tests and Inspections:
 - 1. Leak Test: After installation, charge system and test for leaks. Repair leaks and retest until no leaks exist.
 - 2. Operational Test: After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation.
 - 3. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.
- D. Remove and replace malfunctioning units and retest as specified above.
- E. Prepare test and inspection reports.

3.4 STARTUP SERVICE

- A. Engage a factory-authorized service representative to perform startup service.
 - 1. Complete installation and startup checks according to manufacturer's written instructions.

3.5 DEMONSTRATION

- A. Train Owner's maintenance personnel to adjust, operate, and maintain units.

END OF SECTION 23 8126

SECTION 23 8219 - FAN COIL UNITS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Ducted fan coil units.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product.
 - 1. Include rated capacities, operating characteristics, and furnished specialties and accessories.
- B. Shop Drawings:
 - 1. Include details of equipment assemblies. Indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
 - 2. Include diagrams for power, signal, and control wiring.

1.3 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For fan coil units to include in emergency, operation, and maintenance manuals.
 - 1. In addition to items specified in Section 01 7823 "Operation and Maintenance Data," include the following:
 - a. Maintenance schedules and repair part lists for motors, coils, integral controls, and filters.

1.4 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 - 1. Fan Coil Unit Filters: Furnish 1 spare filters for each filter installed.

1.5 QUALITY ASSURANCE

- A. Comply with NFPA 70.
- B. ASHRAE Compliance: Applicable requirements in ASHRAE 62.1, Section 5 - "Systems and Equipment" and Section 7 - "Construction and Startup."
- C. ASHRAE/IES 90.1 Compliance: Applicable requirements in ASHRAE/IES 90.1, Section 6 - "Heating, Ventilating, and Air-Conditioning."

1.6 COORDINATION

- A. Coordinate layout and installation of fan coil units and suspension system components with other construction that penetrates or is supported by ceilings, including light fixtures, HVAC equipment, fire-suppression-system components, and partition assemblies.

PART 2 - PRODUCTS

2.1 SYSTEM DESCRIPTION

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Factory-packaged and -tested units rated according to AHRI 440, ASHRAE 33, and UL 1995.

2.2 DUCTED FAN COIL UNITS

- A. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - 1. Carrier Global Corporation.
 - 2. ENVIRO-TEC; brand of Johnson Controls International plc, Building Solutions North America.
 - 3. Greenheck Fan Corporation.
- B. Coil Section Insulation:
 - 1. 1-inch- Insert dimension thick, closed cell insulation..
 - 2. Surface-Burning Characteristics: Insulation and adhesive shall have a combined maximum flame-spread index of 25 and smoke-developed index of 50 when tested according to ASTM E84 by a qualified testing agency.
 - 3. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1.
- C. Drain Pans: Plastic. Fabricate pans and drain connections to comply with ASHRAE 62.1.
- D. Chassis: Galvanized steel where exposed to moisture, with baked-enamel finish and removable access panel , with powder-coat finish and removable access panel.
- E. Cabinets: Steel with baked-enamel finish in manufacturer's standard paint color.
- F. Filters: Minimum arrestance and a minimum efficiency reporting value (MERV) according to ASHRAE 52.2 and all addendums.
- G. MERV Rating: 6 when tested according to ASHRAE 52.2.
- H. Electric-Resistance Heating Coils: Nickel-chromium heating wire, free of expansion noise and hum, mounted in ceramic inserts in a galvanized-steel housing; with fuses in terminal box for overcurrent protection and limit controls for high-temperature protection of heaters. Terminate elements in stainless-steel machine-staked terminals secured with stainless-steel hardware.
- I. Direct-Driven Fans: Double width, forward curved, centrifugal; with permanently lubricated, multispeed motor resiliently mounted in the fan inlet. Aluminum or painted-steel wheels, and painted-steel or galvanized-steel fan scrolls.

1. Motors: Comply with requirements in Section 23 0500 "Common Work Results for HVAC."
- J. Terminal Controller: DDC.
 1. Scheduled Operation: Occupied and unoccupied periods on seven-day clock with a minimum of four programmable periods per day.
 2. Unit Supply-Air Fan Operation:
 - a. All Periods: When outside air is below 25F (adjustable), Fan runs continuously.
 3. Heating-Coil Operation: When outside air is below 25F (adjustable).
 - a. All Periods: Energize electric-resistance coil to provide heating. Shut control valve when outside air rises above 28F (adjustable)
 4. Controller shall have volatile-memory backup.
- K. Interface with DDC System for HVAC Requirements:
 1. Provide BACnet interface for future connection to central DDC system.
- L. Electrical Connection: Factory wire motors and controls for a single electrical connection.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine areas, with Installer present, to receive fan coil units for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
- B. Examine roughing-in for electrical connections to verify actual locations before fan coil unit installation.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION OF FAN COIL UNITS

- A. Install fan coil units level and plumb.
- B. Install fan coil units to comply with NFPA 90A.
- C. Suspend fan coil units from structure with elastomeric hangers.
- D. Install new filters in each fan coil unit within two weeks after Substantial Completion.

3.3 CONNECTIONS

- A. Connect supply-air ducts to fan coil units with flexible duct connectors specified in Section 23 3300 "Air Duct Accessories." Comply with safety requirements in UL 1995 for duct connections.
- B. Ground equipment according to Section 26 0526 "Grounding and Bonding for Electrical Systems."
- C. Connect wiring according to Section 26 0519 "Low-Voltage Electrical Power Conductors and Cables."

3.4 FIELD QUALITY CONTROL

- A. Perform the following tests and inspections:
 - 1. Operational Test: After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation.
 - 2. Test and adjust controls and safety devices. Replace damaged and malfunctioning controls and equipment.
- B. Remove and replace malfunctioning units and retest as specified above.
- C. Prepare test and inspection reports.

3.5 ADJUSTING

- A. Adjust initial temperature set points.

3.6 DEMONSTRATION

- A. Train Owner's maintenance personnel to adjust, operate, and maintain fan coil units.

END OF SECTION 23 8219

SECTION 26 0519 - LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Copper building wire.
 - 2. Metal-clad cable, Type MC.
 - 3. Connectors and splices.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product.

PART 2 - PRODUCTS

2.1 COPPER BUILDING WIRE

- A. Description: Flexible, insulated and uninsulated, drawn copper current-carrying conductor with an overall insulation layer or jacket, or both, rated 600 V or less.
- B. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1. [Alpha Wire Company.](#)
 - 2. [American Bare Conductor.](#)
 - 3. [Belden Inc.](#)
 - 4. [Cerro Wire LLC.](#)
 - 5. [Encore Wire Corporation.](#)
 - 6. [General Cable; Prysmian Group North America.](#)
 - 7. [Service Wire Co.](#)
 - 8. [Southwire Company.](#)
 - 9. [WESCO.](#)
- C. Standards:
 - 1. Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and use.
 - 2. Conductor and Cable Marking: Comply with wire and cable marking according to UL's "Wire and Cable Marking and Application Guide."
- D. Conductors: Copper, complying with ASTM B3 for bare annealed copper and with ASTM B8 for stranded conductors.
- E. Conductor Insulation:
 - 1. Type THHN and Type THWN-2: Comply with UL 83.
 - 2. Type XHHW-2: Comply with UL 44.

2.2 METAL-CLAD CABLE, TYPE MC

- A. Description: A factory assembly of one or more current-carrying insulated conductors in an overall metallic sheath.
- B. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
 - 1. [Alpha Wire Company.](#)

2. [American Bare Conductor.](#)
3. [Belden Inc.](#)
4. [Encore Wire Corporation.](#)
5. [General Cable; Prysmian Group North America.](#)
6. [Service Wire Co.](#)
7. [Southwire Company.](#)
8. [WESCO.](#)

C. Standards:

1. Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and use.
2. Comply with UL 1569.
3. Conductor and Cable Marking: Comply with wire and cable marking according to UL's "Wire and Cable Marking and Application Guide."

D. Circuits:

1. Single circuit and multicircuit with color-coded conductors.
2. Power-Limited Fire-Alarm Circuits: Comply with UL 1424.

E. Conductors: Copper, complying with ASTM B3 for bare annealed copper and with ASTM B8 for stranded conductors.

F. Ground Conductor: Insulated.

G. Conductor Insulation:

1. Type TFN/THHN/THWN-2: Comply with UL 83.

H. Armor: Steel, interlocked.

I. Jacket: PVC applied over armor.

2.3 CONNECTORS AND SPLICES

A. Description: Factory-fabricated connectors, splices, and lugs of size, ampacity rating, material, type, and class for application and service indicated; listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and use.

B. [Manufacturers:](#) Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:

1. [3M Electrical Products.](#)
2. [ABB, Electrification Business.](#)
3. [AFC Cable Systems; Atkore International.](#)
4. [Hubbell Utility Solutions; Hubbell Incorporated.](#)
5. [ILSCO.](#)
6. [NSi Industries LLC.](#)
7. [O-Z/Gedney; Emerson Electric Co., Automation Solutions, Appleton Group.](#)
8. [Service Wire Co.](#)

C. Jacketed Cable Connectors: For steel jacketed cables, designed to connect conductors specified in this Section.

D. Lugs: One piece, seamless, designed to terminate conductors specified in this Section.

1. Material: Copper.
2. Type: Two hole with standard barrels.
3. Termination: Compression.

PART 3 - EXECUTION

3.1 CONDUCTOR MATERIAL APPLICATIONS

- A. Feeders:
 - 1. Copper; solid for No. 10 AWG and smaller; stranded for No. 8 AWG and larger.
- B. Branch Circuits:
 - 1. Copper. Solid for No. 12 AWG and smaller; stranded for No. 10 AWG and larger.

3.2 CONDUCTOR INSULATION AND MULTICONDUCTOR CABLE APPLICATIONS AND WIRING METHODS

- A. Service Entrance: Type THHN/THWN-2, single conductors in raceway.
- B. Exposed Feeders: Type THHN/THWN-2, single conductors in raceway.
- C. Feeders Concealed in Ceilings, Walls, Partitions, and Crawlspace: Type THHN/THWN-2, single conductors in raceway.
- D. Feeders Concealed in Concrete, below Slabs-on-Grade, and Underground: Type THHN/THWN-2, single conductors in raceway.
- E. Exposed Branch Circuits, Including in Crawlspace: Type THHN/THWN-2, single conductors in raceway.
- F. Branch Circuits Concealed in Ceilings, Walls, and Partitions: Type THHN/THWN-2, single conductors in raceway.
- G. Branch Circuits Concealed in Concrete, below Slabs-on-Grade, and Underground: Type THHN/THWN-2, single conductors in raceway.
- H. Cord Drops and Portable Appliance Connections: Type SO, hard service cord with stainless steel, wire-mesh, strain relief device at terminations to suit application.

3.3 INSTALLATION, GENERAL

- A. Conceal cables in finished walls, ceilings, and floors unless otherwise indicated.
- B. Complete raceway installation between conductor and cable termination points according to Section 260533 "Raceways and Boxes for Electrical Systems" prior to pulling conductors and cables.
- C. Use manufacturer-approved pulling compound or lubricant where necessary; compound used must not deteriorate conductor or insulation. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- D. Use pulling means, including fish tape, cable, rope, and basket-weave wire/cable grips, that will not damage cables or raceway.
- E. Install exposed cables parallel and perpendicular to surfaces of exposed structural members, and follow surface contours where possible.
- F. Support cables according to Section 260529 "Hangers and Supports for Electrical Systems."

3.4 CONNECTIONS

- A. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A-486B.
- B. Make splices, terminations, and taps that are compatible with conductor material.
- C. Wiring at Outlets: Install conductor at each outlet, with at least 6 inch of slack.

3.5 IDENTIFICATION

- A. Identify and color-code conductors and cables according to Section 260553 "Identification for Electrical Systems."
- B. Identify each spare conductor at each end with identity number and location of other end of conductor, and identify as spare conductor.

3.6 SLEEVE AND SLEEVE-SEAL INSTALLATION FOR ELECTRICAL PENETRATIONS

- A. Install sleeves and sleeve seals at penetrations of exterior floor and wall assemblies.

3.7 FIRESTOPPING

- A. Apply firestopping to electrical penetrations of fire-rated floor and wall assemblies to restore original fire-resistance rating of assembly.

3.8 FIELD QUALITY CONTROL

- A. Tests and Inspections:
 - 1. After installing conductors and cables and before electrical circuitry has been energized, test service entrance and feeder conductors for compliance with requirements.
 - 2. Perform each of the following visual and electrical tests:
 - a. Inspect exposed sections of conductor and cable for physical damage and correct connection according to the single-line diagram.
 - b. Test bolted connections for high resistance using one of the following:
 - 1) A low-resistance ohmmeter.
 - 2) Calibrated torque wrench.
 - c. Inspect compression-applied connectors for correct cable match and indentation.
 - d. Inspect for correct identification.
 - e. Inspect cable jacket and condition.
 - f. Insulation-resistance test on each conductor for ground and adjacent conductors. Apply a potential of 500 V(dc) for 300 V rated cable and 1000 V(dc) for 600 V rated cable for a one-minute duration.
 - g. Continuity test on each conductor and cable.
 - h. Uniform resistance of parallel conductors.
- B. Cables will be considered defective if they do not pass tests and inspections.
- C. Prepare test and inspection reports to record the following:
 - 1. Procedures used.
 - 2. Results that comply with requirements.
 - 3. Results that do not comply with requirements, and corrective action taken to achieve compliance with requirements.

END OF SECTION 26 0519

SECTION 26 0526 - GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes grounding and bonding systems and equipment.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.

1.3 INFORMATIONAL SUBMITTALS

- A. Field quality-control reports.

PART 2 - PRODUCTS

2.1 SYSTEM DESCRIPTION

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Comply with UL 467 for grounding and bonding materials and equipment.

2.2 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 1. ABB (Electrification Products Division).
 2. Advanced Lightning Technology, Ltd.
 3. Appleton - O-Z/Gedney; Emerson Electric Co., Automation Solutions.
 4. Burndy; Hubbell Incorporated, Construction and Energy.
 5. Dossert; AFL Telecommunications LLC.
 6. Fushi Copperweld Inc.
 7. Galvan Industries, Inc.; Electrical Products Division, LLC.
 8. Harger Lightning & Grounding.
 9. ILSCO.
 10. nVent (ERICO).
 11. Robbins Lightning, Inc.
 12. Siemens Industry, Inc., Energy Management Division.

2.3 CONDUCTORS

- A. Insulated Conductors: Copper wire or cable insulated for 600 V unless otherwise required by applicable Code or authorities having jurisdiction.
- B. Bare Copper Conductors:
 1. Solid Conductors: ASTM B3.
 2. Stranded Conductors: ASTM B8.
 3. Tinned Conductors: ASTM B33.
 4. Bonding Conductor: As Shown on drawing.

2.4 CONNECTORS

- A. Listed and labeled by an NRTL acceptable to authorities having jurisdiction for applications in which used and for specific types, sizes, and combinations of conductors and other items connected.
- B. Welded Connectors: Exothermic-welding kits of types recommended by kit manufacturer for materials being joined and installation conditions.
- C. Bus-Bar Connectors: Mechanical type, cast silicon bronze, solderless compression-type wire terminals, and long-barrel, two-bolt connection to ground bus bar.
- D. Cable-to-Cable Connectors: Compression type, copper or copper alloy.
- E. Conduit Hubs: Mechanical type, terminal with threaded hub.
- F. Ground Rod Clamps: Mechanical type, copper or copper alloy, terminal with hex head bolt.
- G. Service Post Connectors: Mechanical type, bronze alloy terminal, in short- and long-stud lengths, capable of single and double conductor connections.

2.5 GROUNDING ELECTRODES

- A. Ground Rods: Copper-clad; 3/4 inch by 10 feet

PART 3 - EXECUTION

3.1 APPLICATIONS

- A. Conductors: Install solid conductor for grounding electrode conductor, size shown on drawing..
- B. Grounding Conductors: Green-colored insulation.
- C. Conductor Terminations and Connections:
 - 1. Pipe and Equipment Grounding Conductor Terminations: Bolted connectors.
 - 2. Underground Connections: Welded connectors except at test wells and as otherwise indicated.
 - 3. Connections to Ground Rods at Test Wells: Bolted connectors.
 - 4. Connections to Structural Steel: Welded connectors.

3.2 EQUIPMENT GROUNDING

- A. Install insulated equipment grounding conductors with all feeders and branch circuits.

3.3 INSTALLATION

- A. Grounding Conductors: Route along shortest and straightest paths possible unless otherwise indicated or required by Code. Avoid obstructing access or placing conductors where they may be subjected to strain, impact, or damage.
- B. Tests and Inspections:
 - 1. Inspect physical and mechanical condition. Verify tightness of accessible, bolted, electrical connections with a calibrated torque wrench according to manufacturer's written instructions.

END OF SECTION 26 0526

SECTION 26 0529 - HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Steel slotted support systems.
 - 2. Conduit and cable support devices.
 - 3. Mounting, anchoring, and attachment components, including powder-actuated fasteners, mechanical expansion anchors, concrete inserts, clamps, through bolts, toggle bolts, and hanger rods.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product.
 - 1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for the following:
 - a. Slotted support systems, hardware, and accessories.
 - b. Clamps.
 - c. Hangers.
 - d. Sockets.
 - e. Eye nuts.
 - f. Fasteners.
 - g. Anchors.
 - h. Saddles.
 - i. Brackets.
 - 2. Include rated capacities and furnished specialties and accessories.
 - 3. Slotted support systems.
 - 4. Equipment supports.

PART 2 - PRODUCTS

2.1 SUPPORT, ANCHORAGE, AND ATTACHMENT COMPONENTS

- A. Steel Slotted Support Systems: Preformed steel channels and angles with minimum 13/32-inch-diameter holes at a maximum of 8 inches o.c. in at least one surface.
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. ABB (Electrification Products Division).
 - b. Atkore International (Allied Tube & Conduit).
 - c. Atkore International (Unistrut).
 - d. Eaton (B-line).
 - e. Flex-Strut Inc.
 - f. Gripple Inc.
 - g. GS Metals Corp.
 - h. G-Strut.
 - i. Haydon Corporation.
 - j. Metal Ties Innovation.
 - k. MIRO Industries.
 - l. nVent (CADDY).
 - m. Wesanco, Inc.
 - 2. Standard: Comply with MFMA-4 factory-fabricated components for field assembly.
 - 3. Material for Channel, Fittings, and Accessories: Plain steel.
 - 4. Channel Width: 1-1/4 inches.
 - 5. Metallic Coatings: Hot-dip galvanized after fabrication and applied according to MFMA-4.

6. Nonmetallic Coatings: Manufacturer's standard PVC, polyurethane, or polyester coating applied according to MFMA-4.
 7. Painted Coatings: Manufacturer's standard painted coating applied according to MFMA-4.
 8. Protect finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.
- B. Conduit and Cable Support Devices: Steel hangers, clamps, and associated fittings, designed for types and sizes of raceway or cable to be supported.
- C. Structural Steel for Fabricated Supports and Restraints: ASTM A36/A36M steel plates, shapes, and bars; black and galvanized.
- D. Mounting, Anchoring, and Attachment Components: Items for fastening electrical items or their supports to building surfaces include the following:
1. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete, steel, or wood, with tension, shear, and pullout capacities appropriate for supported loads and building materials where used.
 - a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1) Hilti, Inc.
 - 2) ITW Ramset/Red Head; Illinois Tool Works, Inc.
 - 3) MKT Fastening, LLC.
 - 4) Simpson Strong-Tie Co., Inc.
 2. Mechanical-Expansion Anchors: Insert-wedge-type, zinc-coated steel, for use in hardened portland cement concrete, with tension, shear, and pullout capacities appropriate for supported loads and building materials where used.
 - a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1) Eaton (B-line).
 - 2) Empire Tool and Manufacturing Co., Inc.
 - 3) Hilti, Inc.
 - 4) ITW Ramset/Red Head; Illinois Tool Works, Inc.
 - 5) MKT Fastening, LLC.
 3. Concrete Inserts: Steel or malleable-iron, slotted support system units are similar to MSS Type 18 units and comply with MFMA-4 or MSS SP-58.
 4. Clamps for Attachment to Steel Structural Elements: MSS SP-58 units are suitable for attached structural element.
 5. Through Bolts: Structural type, hex head, and high strength. Comply with ASTM F3125/F3125M, Grade A325.
 6. Toggle Bolts: All-steel springhead type.
 7. Hanger Rods: Threaded steel.

PART 3 - EXECUTION

3.1 APPLICATION

- A. Comply with the following standards for application and installation requirements of hangers and supports, except where requirements on Drawings or in this Section are stricter:
1. NECA 1.
 2. NECA 101
 3. NECA 120.
- B. Comply with requirements in Section 078400 "Firestopping" for firestopping materials and installation for penetrations through fire-rated walls, ceilings, and assemblies.

- C. Comply with requirements for raceways and boxes specified in Section 260533 "Raceways and Boxes for Electrical Systems."
- D. Maximum Support Spacing and Minimum Hanger Rod Size for Raceways: Space supports for EMT, IMC as required by NFPA 70. Minimum rod size shall be 1/4 inch in diameter.
- E. Multiple Raceways or Cables: Install trapeze-type supports fabricated with steel slotted support system, sized so capacity can be increased by at least 25 percent in future without exceeding specified design load limits.
 - 1. Secure raceways and cables to these supports with two-bolt conduit clamps.
- F. Spring-steel clamps designed for supporting single conduits without bolts may be used for 1-1/2-inch and smaller raceways serving branch circuits and communication systems above suspended ceilings, and for fastening raceways to trapeze supports.

3.2 SUPPORT INSTALLATION

- A. Comply with NECA 1 and NECA 101 for installation requirements except as specified in this article.
- B. Raceway Support Methods: In addition to methods described in NECA 1, EMT IMC may be supported by openings through structure members, according to NFPA 70.
- C. Strength of Support Assemblies: Where not indicated, select sizes of components so strength will be adequate to carry present and future static loads within specified loading limits. Minimum static design load used for strength determination shall be weight of supported components plus 200 lb.
- D. Mounting and Anchorage of Surface-Mounted Equipment and Components: Anchor and fasten electrical items and their supports to building structural elements by the following methods unless otherwise indicated by code:
 - 1. To Wood: Fasten with lag screws or through bolts.
 - 2. To New Concrete: Bolt to concrete inserts.
 - 3. To Masonry: Approved toggle-type bolts on hollow masonry units and expansion anchor fasteners on solid masonry units.
 - 4. To Existing Concrete: Expansion anchor fasteners.
 - 5. Instead of expansion anchors, powder-actuated driven threaded studs provided with lock washers and nuts may be used in existing standard-weight concrete 4 inches thick or greater. Do not use for anchorage to lightweight-aggregate concrete or for slabs less than 4 inches thick.
 - 6. To Steel: Beam clamps (MSS SP-58, Type 19, 21, 23, 25, or 27), complying with MSS SP-69.
 - 7. To Light Steel: Sheet metal screws.
 - 8. Items Mounted on Hollow Walls and Nonstructural Building Surfaces: Mount cabinets, panelboards, disconnect switches, control enclosures, pull and junction boxes, transformers, and other devices on slotted-channel racks attached to substrate.
- E. Drill holes for expansion anchors in concrete at locations and to depths that avoid the need for reinforcing bars.
 - 1.

3.3 PAINTING

- A. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A780.

END OF SECTION 26 0529

SECTION 26 0533 - RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Type EMT-S raceways and elbows.
 - 2. Fittings for conduit, tubing, and cable.
 - 3. Termination boxes.
 - 4. Cabinets, cutout boxes, junction boxes, pull boxes, and miscellaneous enclosures.

1.2 ACTION SUBMITTALS

- A. Product Data: For the following:
 - 1. Raceways, fittings
 - 2. Cabinets, cutout boxes, and miscellaneous enclosures.

PART 2 - PRODUCTS

2.1 TYPE EMT-S RACEWAYS AND ELBOWS

- A. Steel Electrical Metal Tubing (EMT-S) and Elbows:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Atkore International (Allied Tube & Conduit).
 - b. Atkore International (Calconduit).
 - c. Emerson Electric Co.
 - d. Nucor Corporation (Nucor Tubular Products - Republic).
 - e. Topaz Lighting & Electric.
 - f. Zekelman Industries (Picoma).
 - g. Zekelman Industries (Western Tube).
 - h. Zekelman Industries (Wheatland Tube).
 - 2. Applicable Standards:
 - a. Regulatory Requirements: Listed and labeled in accordance with NFPA 70 and marked for intended location and use.
 - b. General Characteristics:
 - 1) Reference Standards: UL 797 and UL Category Control Number FJMX.
 - 2) Material: Steel.
 - 3) Exterior Coating: Zinc.
 - 4) Interior Coating: Zinc
 - c. Options:
 - 1) Minimum Trade Size: 1/2 inch for power/lighting circuits
 - 2) Minimum Trade Size: 1" for communications circuits

2.2 FITTINGS FOR CONDUIT, TUBING, AND CABLE

- A. Fittings for Type EMT Raceways:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. ABB (Electrification Products Division).
 - b. Appleton - EGS; Emerson Electric Co., Automation Solutions.
 - c. Appleton - O-Z/Gedney; Emerson Electric Co., Automation Solutions.
 - d. Atkore International (Allied Tube & Conduit).
 - e. Atkore International (Calconduit).

- f. Eaton (Crouse-Hinds).
 - g. Raco Taymac Bell; Hubbell Incorporated, Commercial and Industrial.
 - h. Southwire Company.
 - i. Topaz Lighting & Electric.
- 2. Applicable Standards:
 - a. Regulatory Requirements: Listed and labeled in accordance with NFPA 70 and marked for intended location and use.
 - b. General Characteristics:
 - 1) Reference Standards: UL 514B and UL Category Control Number FKAV.
 - 2) Material: Steel.
 - 3) Coupling Method: Compression.

2.3 CABINETS, CUTOUT BOXES, JUNCTION BOXES, PULL BOXES, AND MISCELLANEOUS ENCLOSURES

- A. Indoor Sheet Metal Cabinets:
 - 1. Description: Enclosure provided with frame, mat, or trim in which swinging door or doors are or can be hung.
 - 2. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. ABB (Electrification Products Division).
 - b. Adalet.
 - c. Eaton (B-line).
 - d. Eaton (Crouse-Hinds).
 - e. Erickson Electrical Equipment Company.
 - f. FSR Inc.
 - g. Killark; Hubbell Incorporated, Construction and Energy.
 - h. Milbank Manufacturing Co.
 - i. N J Sullivan Company.
 - j. nVent (Hoffman).
 - k. Raco Taymac Bell; Hubbell Incorporated, Commercial and Industrial.
 - l. Robroy Industries (Robroy Enclosures).
 - m. Schneider Electric USA (Square D).
 - n. Siemens Industry, Inc. (Building Technologies Division).
 - 3. Applicable Standards:
 - a. Regulatory Requirements: Listed and labeled in accordance with NFPA 70 and marked for intended location and use.
 - b. General Characteristics:
 - 1) Reference Standards: UL Category Control Number CYIV.
 - a) Non-Environmental Characteristics: UL 50.
 - b) Environmental Characteristics: UL 50E.
 - c. Options:
 - 1) Degree of Protection: Type 1.

PART 3 - EXECUTION

3.1 SELECTION OF RACEWAYS

- A. Unless more stringent requirements are specified in Contract Documents or manufacturers' written instructions, comply with NFPA 70 for selection of raceways. Consult Architect for resolution of conflicting requirements.
- B. Indoors:
 - 1. Exposed and Subject to Physical Damage: ERM. Raceway locations include the following:

- a. Loading docks.
 - b. Mechanical rooms.
 - c. Electrical Rooms
 2. Exposed, Not Subject to Physical Damage: EMT
 3. Concealed in Ceilings and Interior Walls and Partitions: EMT.
 4. Flexible conduits in mechanical rooms, damp or wet areas: LFMC
- C. Stub-ups to Above Recessed Ceilings: Provide EMT, IMC, or ERMC for raceways.
- D. Raceway Fittings: Select fittings in accordance with NEMA FB 2.10 guidelines.
1. ERMC: Provide threaded type fittings unless otherwise indicated.

3.2 SELECTION OF BOXES AND ENCLOSURES

- A. Unless more stringent requirements are specified in Contract Documents or manufacturers' written instructions, comply with NFPA 70 for selection of boxes and enclosures. Consult Architect for resolution of conflicting requirements.
- B. Degree of Protection:
1. Indoors:
 - a. Type 1 unless otherwise indicated.
- C. Exposed Boxes Installed Less Than 6.5 ft. Above Floor:
1. Boxes with knockouts or unprotected openings are prohibited.
 2. Provide exposed cover. Flat covers with angled mounting slots or knockouts are prohibited.

3.3 INSTALLATION OF RACEWAYS

- A. Installation Standards:
1. Unless more stringent requirements are specified in Contract Documents or manufacturers' written instructions, comply with NFPA 70 for installation of raceways. Consult Architect for resolution of conflicting requirements.
 2. Comply with NFPA 70 limitations for types of raceways allowed in specific occupancies and number of floors.
 3. Comply with requirements in Section 260529 "Hangers and Supports for Electrical Systems" for hangers and supports.
 4. Comply with NECA NEIS 101 for installation of steel raceways.
 5. Install raceways square to the enclosure and terminate at enclosures without hubs with locknuts on both sides of enclosure wall. Install locknuts hand tight, plus one-quarter turn more.
 6. Terminate threaded conduits into threaded hubs or with locknuts on inside and outside of boxes or cabinets. Install bushings on conduits up to 1-1/4 inch trade size and insulated throat metal bushings on 1-1/2 inch trade size and larger conduits terminated with locknuts. Install insulated throat metal grounding bushings on service conduits.
- B. General Requirements for Installation of Raceways:
1. Complete raceway installation before starting conductor installation.
 2. Provide stub-ups through floors with coupling threaded inside for plugs, set flush with finished floor. Plug coupling until conduit is extended above floor to final destination or a minimum of 2 ft. above finished floor.
 3. Install no more than equivalent of three 90-degree bends in conduit run. Support within 12 inch of changes in direction.

4. Make bends in raceway using large-radius preformed ells except for parallel bends. Field bending must be in accordance with NFPA 70 minimum radii requirements. Provide only equipment specifically designed for material and size involved.
5. Conceal conduit within finished walls, ceilings, and floors unless otherwise indicated. Install conduits parallel or perpendicular to building lines.
6. Support conduit within 12 inch of enclosures to which attached.
7. Install raceway sealing fittings at accessible locations in accordance with NFPA 70 and fill them with listed sealing compound. For concealed raceways, install fitting in flush steel box with blank cover plate having finish similar to that of adjacent plates or surfaces. Install raceway sealing fittings in accordance with NFPA 70.
8. Install devices to seal raceway interiors at accessible locations. Locate seals so no fittings or boxes are between the seal and the following changes of environments. Seal interior of raceways at the following points:
 - a. Where conduits pass from warm to cold locations, such as boundaries of refrigerated spaces.
 - b. Where an underground service raceway enters a building or structure.
 - c. Conduit extending from interior to exterior of building.
 - d. Conduit extending into pressurized duct and equipment.
 - e. Conduit extending into pressurized zones that are automatically controlled to maintain different pressure set points.
 - f. Where otherwise required by NFPA 70.
9. Do not install conduits within 2 inch of the bottom side of a metal deck roof.
10. Keep raceways at least 6 inch away from parallel runs of flues and steam or hot-water pipes. Install horizontal raceway runs above water and steam piping.
11. Cut conduit perpendicular to the length. For conduits 2 inch trade size and larger, use roll cutter or a guide to make cut straight and perpendicular to the length. Ream inside of conduit to remove burrs.
12. Install pull wires in empty raceways. Provide polypropylene or monofilament plastic line with not less than 200 lb tensile strength. Leave at least 12 inch of slack at both ends of pull wire. Cap underground raceways designated as spare above grade alongside raceways in use.

C. Requirements for Installation of Specific Raceway Types:

1. Types ERM and IMC:
 - a. Threaded Conduit Joints, Exposed to Wet, Damp, Corrosive, or Outdoor Conditions: Apply listed compound that maintains electrical conductivity to threads of raceway and fittings before making up joints. Follow compound manufacturer's written instructions.

D. Raceway Fittings: Install fittings in accordance with NEMA FB 2.10 guidelines.

1. EMT: Provide Compression fittings. Comply with NEMA FB 2.10.
2. Flexible Conduit: Provide only fittings listed for use with flexible conduit type. Comply with NEMA FB 2.20.

E. Raceways Penetrating Rooms or Walls with Acoustical Requirements:

1. Seal raceway openings on both sides of rooms or walls with acoustically rated putty or firestopping

3.4 FIRESTOPPING

- A. Install firestopping at penetrations of fire-rated floor and wall assemblies.

3.5 PROTECTION

- A. Protect coatings, finishes, and cabinets from damage and deterioration.

1. Repair damage to galvanized finishes with zinc-rich paint recommended by manufacturer.
2. Repair damage to PVC coatings or paint finishes with matching touchup coating recommended by manufacturer.

3.6 CLEANING

- A. Boxes: Remove construction dust and debris from device boxes, outlet boxes, and floor-mounted enclosures before installing wallplates, covers, and hoods.

END OF SECTION 26053

SECTION 26 0544 - SLEEVES AND SLEEVE SEALS FOR ELECTRICAL RACEWAYS AND CABLING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Sleeves for raceway and cable penetration of non-fire-rated construction walls and floors.
 - 2. Sleeve-seal fittings.
 - 3. Grout.
 - 4. Silicone sealants.
- B. Related Requirements:
 - 1. Section 078400 "Firestopping" for penetration firestopping installed in fire-resistance-rated walls, horizontal assemblies, and smoke barriers, with and without penetrating items.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product.

PART 2 - PRODUCTS

2.1 SLEEVES

- A. Wall Sleeves:
 - 1. Steel Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, zinc coated, plain ends.
- B. Sleeves for Conduits Penetrating Non-Fire-Rated Gypsum Board Assemblies: Galvanized-steel sheet; 0.0239-inch minimum thickness; round tube closed with welded longitudinal joint, with tabs for screw-fastening the sleeve to the board.
- C. Sleeves for Rectangular Openings:
 - 1. Material: Galvanized sheet steel.
 - 2. Minimum Metal Thickness:
 - a. For sleeve cross-section rectangle perimeter less than 50 inches and with no side larger than 16 inches, thickness shall be 0.052 inch.
 - b. For sleeve cross-section rectangle perimeter 50 inches or more and one or more sides larger than 16 inches, thickness shall be 0.138 inch.

2.2 SLEEVE-SEAL FITTINGS

- A. Description: Manufactured plastic, sleeve-type, waterstop assembly made for embedding in concrete slab or wall. Unit shall have plastic or rubber waterstop collar with center opening to match piping OD.
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Presealed Systems.

2.3 GROUT

- A. Description: Nonshrink; recommended for interior and exterior sealing openings in non-fire-rated walls or floors.

- B. Standard: ASTM C 1107/C 1107M, Grade B, post-hardening and volume-adjusting, dry, hydraulic-cement grout.
- C. Design Mix: 5000-psi, 28-day compressive strength.
- D. Packaging: Premixed and factory packaged.

PART 3 - EXECUTION

3.1 SLEEVE INSTALLATION FOR NON-FIRE-RATED ELECTRICAL PENETRATIONS

- A. Comply with NECA 1.
- B. Sleeves for Conduits Penetrating Above-Grade Non-Fire-Rated Concrete and Masonry-Unit Floors and Walls:
 - 1. Interior Penetrations of Non-Fire-Rated Walls and Floors:
 - a. Seal annular space between sleeve and raceway or cable, using joint sealant appropriate for size, depth, and location of joint. Comply with requirements in Section 079200 "Joint Sealants."
 - b. Seal space outside of sleeves with mortar or grout. Pack sealing material solidly between sleeve and wall so no voids remain. Tool exposed surfaces smooth; protect material while curing.
 - 2. Size pipe sleeves to provide 1/4-inch annular clear space between sleeve and raceway or cable unless sleeve seal is to be installed.
 - 3. Install sleeves for wall penetrations unless core-drilled holes or formed openings are used. Install sleeves during erection of walls. Cut sleeves to length for mounting flush with both surfaces of walls. Deburr after cutting.
- C. Sleeves for Conduits Penetrating Non-Fire-Rated Gypsum Board Assemblies:
 - 1. Use circular metal sleeves unless penetration arrangement requires rectangular sleeved opening.
 - 2. Seal space outside of sleeves with approved joint compound for gypsum board assemblies.
- D. Roof-Penetration Sleeves: Seal penetration of individual raceways and cables with flexible boot-type flashing units applied in coordination with roofing work.
- E. Aboveground, Exterior-Wall Penetrations: Seal penetrations using cast-iron pipe sleeves and mechanical sleeve seals. Select sleeve size to allow for 1-inch annular clear space between pipe and sleeve for installing mechanical sleeve seals.

3.2 SLEEVE-SEAL-SYSTEM INSTALLATION

- A. Install sleeve-seal systems in sleeves in exterior concrete walls and slabs-on-grade at raceway entries into building.
- B. Install type and number of sealing elements recommended by manufacturer for raceway or cable material and size. Position raceway or cable in center of sleeve. Assemble mechanical sleeve seals and install in annular space between raceway or cable and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

3.3 SLEEVE-SEAL-FITTING INSTALLATION

- A. Install sleeve-seal fittings in new walls and slabs as they are constructed.

- B. Assemble fitting components of length to be flush with both surfaces of concrete slabs and walls. Position waterstop flange to be centered in concrete slab or wall.
- C. Secure nailing flanges to concrete forms.
- D. Using grout, seal the space around outside of sleeve-seal fittings.

END OF SECTION 26 0544

SECTION 26 0553 - IDENTIFICATION FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Identification for raceways.
 - 2. Identification of power and control cables.
 - 3. Identification for conductors.
 - 4. Warning labels and signs.
 - 5. Equipment identification labels, including arc-flash warning labels.
 - 6. Miscellaneous identification products.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product.
 - 1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for electrical identification products.

1.3 PERFORMANCE REQUIREMENTS

- A. Comply with ASME A13.1 and IEEE C2.
- B. Comply with NFPA 70.
- C. Comply with 29 CFR 1910.144 and 29 CFR 1910.145.
- D. Comply with ANSI Z535.4 for safety signs and labels.
- E. Adhesive-attached labeling materials, including label stocks, laminating adhesives, and inks used by label printers, shall comply with UL 969.
- F. Thermal Movements: Allow for thermal movements from ambient and surface temperature changes.
 - 1. Temperature Change: 120 deg F, ambient; 180 deg F, material surfaces.

1.4 COLOR AND LEGEND REQUIREMENTS

- A. Raceways and Cables Carrying Circuits at 600 V or Less:
 - 1. Black letters on an orange field.
 - 2. Legend: Indicate voltage and system or service type.
- B. Warning labels and signs shall include, but are not limited to, the following legends:
 - 1. Workspace Clearance Warning: "WARNING - OSHA REGULATION - AREA IN FRONT OF ELECTRICAL EQUIPMENT MUST BE KEPT CLEAR FOR 36 INCHES."

1.5 LABELS

- A. Vinyl Labels for Raceways Carrying Circuits at 600 V or Less: Preprinted, flexible labels laminated with a clear, weather- and chemical-resistant coating and matching wraparound clear adhesive tape for securing label ends.
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Brady Corporation.

- b. Champion America.
 - c. emedco.
 - d. Grafoplast Wire Markers.
 - e. LEM Products Inc.
 - f. Marking Services, Inc.
 - g. Panduit Corp.
 - h. Seton Identification Products.
 - B. Snap-Around Labels for Raceways and Cables Carrying Circuits at 600 V or Less: Slit, pretensioned, flexible, preprinted, color-coded acrylic sleeves, with diameters sized to suit diameters of raceways they identify, and that stay in place by gripping action.
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Brady Corporation.
 - b. Marking Services, Inc.
 - c. Panduit Corp.
 - d. Seton Identification Products.
 - C. Self-Adhesive Labels:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. A'n D Cable Products.
 - b. Brady Corporation.
 - c. Brother International Corporation.
 - d. emedco.
 - e. Grafoplast Wire Markers.
 - f. Ideal Industries, Inc.
 - g. LEM Products Inc.
 - h. Marking Services, Inc.
 - i. Panduit Corp.
 - j. Seton Identification Products.
 - 2. Preprinted, 3-mil- thick, vinyl flexible label with acrylic pressure-sensitive adhesive.
 - a. Self-Lamination: Clear; UV-, weather- and chemical-resistant; self-laminating, protective shield over the legend. Labels sized to fit the raceway diameter, such that the clear shield overlaps the entire printed legend.
 - 3. Vinyl, thermal, transfer-printed, 3-mil- thick, multicolor, weather- and UV-resistant, pressure-sensitive adhesive labels, configured for display on front cover, door, or other access to equipment unless otherwise indicated.
 - a. Nominal Size: 3.5-by-5-inch.
 - 4. Marker for Tags: Permanent, waterproof, black ink marker recommended by tag manufacturer.
 - 5. Marker for Tags: Machine-printed, permanent, waterproof, black ink recommended by printer manufacturer.
- 1.6 BANDS AND TUBES:
- A. Snap-Around, Color-Coding Bands for Raceways and Cables: Slit, pretensioned, flexible, solid-colored acrylic sleeves, 2 inches long, with diameters sized to suit diameters of raceways or cables they identify, and that stay in place by gripping action.
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Brady Corporation.
 - b. Marking Services, Inc.
 - c. Panduit Corp.

- B. Heat-Shrink Preprinted Tubes: Flame-retardant polyolefin tubes with machine-printed identification labels, sized to suit diameters of and shrunk to fit firmly around cables they identify. Full shrink recovery occurs at a maximum of 200 deg F. Comply with UL 224.
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Brady Corporation.
 - b. Panduit Corp.

1.7 TAPES AND STENCILS:

- A. Marker Tapes: Vinyl or vinyl-cloth, self-adhesive wraparound type, with circuit identification legend machine printed by thermal transfer or equivalent process.
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Carlton Industries, LP.
 - b. Champion America.
 - c. Ideal Industries, Inc.
 - d. Marking Services, Inc.
 - e. Panduit Corp.
- B. Self-Adhesive Vinyl Tape: Colored, heavy duty, waterproof, fade resistant; not less than 3 mils thick by 1 to 2 inches wide; compounded for outdoor use.
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Brady Corporation.
 - b. Carlton Industries, LP.
 - c. emedco.
 - d. Marking Services, Inc.
- C. Tape and Stencil for Raceways Carrying Circuits 600 V or Less: 4-inch-wide black stripes on 10-inch centers placed diagonally over orange background that extends full length of raceway or duct and is 12 inches wide. Stop stripes at legends.
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. LEM Products Inc.
 - b. Marking Services, Inc.
 - c. Seton Identification Products.
- D. Floor Marking Tape: 2-inch-wide, 5-mil pressure-sensitive vinyl tape, with yellow and black stripes and clear vinyl overlay.
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Carlton Industries, LP.
 - b. Seton Identification Products.

1.8 Signs

- A. Baked-Enamel Signs:
 - 1. Preprinted aluminum signs, punched or drilled for fasteners, with colors, legend, and size required for application.
 - 2. 1/4-inch grommets in corners for mounting.
 - 3. Nominal Size: 7 by 10 inches.
 - 4. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Carlton Industries, LP.
 - b. Champion America.

- c. emedco.
 - d. Marking Services, Inc.
 - B. Metal-Backed Butyrate Signs:
 - 1. Weather-resistant, nonfading, preprinted, cellulose-acetate butyrate signs, with 0.0396-inch galvanized-steel backing and with colors, legend, and size required for application.
 - 2. 1/4-inch grommets in corners for mounting.
 - 3. Nominal Size: 10 by 14 inches.
 - 4. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Brady Corporation.
 - b. Champion America.
 - c. emedco.
 - d. Marking Services, Inc.
 - C. Laminated Acrylic or Melamine Plastic Signs:
 - 1. Engraved legend.
 - 2. Thickness:
 - a. For signs up to 20 sq. inches, minimum 1/16-inch.
 - b. For signs larger than 20 sq. inches, 1/8 inch thick.
 - c. Engraved legend with black letters on white face.
 - d. Punched or drilled for mechanical fasteners.
 - e. Framed with mitered acrylic molding and arranged for attachment at applicable equipment.
 - 3. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Brady Corporation.
 - b. Carlton Industries, LP.
 - c. emedco.
 - d. Marking Services, Inc.
- 1.9 CABLE TIES
- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1. Ideal Industries, Inc.
 - 2. Marking Services, Inc.
 - 3. Panduit Corp.
 - B. General-Purpose Cable Ties: Fungus inert, self-extinguishing, one piece, self-locking, Type 6/6 nylon.
 - 1. Minimum Width: 3/16 inch.
 - 2. Tensile Strength at 73 deg F according to ASTM D 638: 12,000 psi.
 - 3. Temperature Range: Minus 40 to plus 185 deg F.
 - 4. Color: Black, except where used for color-coding.
 - C. UV-Stabilized Cable Ties: Fungus inert, designed for continuous exposure to exterior sunlight, self-extinguishing, one piece, self-locking, Type 6/6 nylon.
 - 1. Minimum Width: 3/16 inch.
 - 2. Tensile Strength at 73 deg F according to ASTM D 638: 12,000 psi.
 - 3. Temperature Range: Minus 40 to plus 185 deg F.
 - 4. Color: Black.
 - D. Plenum-Rated Cable Ties: Self-extinguishing, UV stabilized, one piece, self-locking.
 - 1. Minimum Width: 3/16 inch.
 - 2. Tensile Strength at 73 deg F according to ASTM D 638: 7000 psi.

3. UL 94 Flame Rating: 94V-0.
4. Temperature Range: Minus 50 to plus 284 deg F.
5. Color: Black.

1.10 MISCELLANEOUS IDENTIFICATION PRODUCTS

- A. Paint: Comply with requirements in painting Sections for paint materials and application requirements. Retain paint system applicable for surface material and location (exterior or interior).
- B. Fasteners for Labels and Signs: Stainless-steel machine screws with nuts and flat and lock washers.

PART 2 - EXECUTION

2.1 PREPARATION

- A. Self-Adhesive Identification Products: Before applying electrical identification products, clean substrates of substances that could impair bond, using materials and methods recommended by manufacturer of identification product.

2.2 INSTALLATION

- A. Verify and coordinate identification names, abbreviations, colors, and other features with requirements in other Sections requiring identification applications, Drawings, Shop Drawings, manufacturer's wiring diagrams, and operation and maintenance manual. Use consistent designations throughout Project.
- B. Install identifying devices before installing acoustical ceilings and similar concealment.
- C. Verify identity of each item before installing identification products.
- D. Install identification materials and devices at locations for most convenient viewing without interference with operation and maintenance of equipment. Install access doors or panels to provide view of identifying devices.
- E. Apply identification devices to surfaces that require finish after completing finish work.
- F. Attach signs and plastic labels that are not self-adhesive type with mechanical fasteners appropriate to the location and substrate.
- G. Attach plastic raceway and cable labels that are not self-adhesive type with clear vinyl tape, with adhesive appropriate to the location and substrate.
- H. Cable Ties: For attaching tags. Use general-purpose type, except as listed below:
 1. Outdoors: UV-stabilized nylon.
 2. In Spaces Handling Environmental Air: Plenum rated.
- I. Painted Identification: Comply with requirements in painting Sections for surface preparation and paint application.
- J. Aluminum Wraparound Marker Labels and Metal Tags: Secure tight to surface of conductor or cable at a location with high visibility and accessibility.

- K. System Identification Color-Coding Bands for Raceways and Cables: Each color-coding band shall completely encircle cable or conduit. Place adjacent bands of two-color markings in contact, side by side. Locate bands at changes in direction, at penetrations of walls and floors, at 50-foot maximum intervals in straight runs, and at 25-foot maximum intervals in congested areas.

2.3 IDENTIFICATION SCHEDULE

- A. Accessible Raceways and Metal-Clad Cables, 600 V or Less, for Service, Feeder, and Branch Circuits, More Than 30 A and 120 V to Ground: Identify with self-adhesive vinyl tape applied in bands. Install labels at 30-foot maximum intervals.
- B. Accessible Raceways and Cables within Buildings: Identify the covers of each junction and pull box of the following systems with self-adhesive vinyl labels containing the wiring system legend and system voltage. System legends shall be as follows:
 - 1. "POWER."
- C. Power-Circuit Conductor Identification, 600 V or Less: For conductors in vaults, pull and junction boxes, manholes, and handholes, use color-coding conductor tape to identify the phase.
 - 1. Color-Coding for Phase- and Voltage-Level Identification, 600 V or Less: Use colors listed below for ungrounded service, feeder, and branch-circuit conductors.
 - a. Color shall be factory applied or field applied for sizes larger than No. 8 AWG if authorities having jurisdiction permit.
 - b. Colors for 208/120-V Circuits:
 - 1) Phase A: Black.
 - 2) Phase B: Red.
 - 3) Phase C: Blue.
 - c. Field-Applied, Color-Coding Conductor Tape: Apply in half-lapped turns for a minimum distance of 6 inches from terminal points and in boxes where splices or taps are made. Apply last two turns of tape with no tension to prevent possible unwinding. Locate bands to avoid obscuring factory cable markings.
- D. Install instructional sign, including the color code for grounded and ungrounded conductors using adhesive-film-type labels.
- E. Control-Circuit Conductor Identification: For conductors and cables in pull and junction boxes, manholes, and handholes, use self-adhesive vinyl labels with the conductor or cable designation, origin, and destination.
- F. Control-Circuit Conductor Termination Identification: For identification at terminations, provide heat-shrink preprinted tubes with the conductor designation.
- G. Conductors To Be Extended in the Future: Attach marker tape to conductors and list source.
- H. Auxiliary Electrical Systems Conductor Identification: Identify field-installed alarm, control, and signal connections.
 - 1. Identify conductors, cables, and terminals in enclosures and at junctions, terminals, and pull points. Identify by system and circuit designation.
 - 2. Use system of marker-tape designations that is uniform and consistent with system used by manufacturer for factory-installed connections.
 - 3. Coordinate identification with Project Drawings, manufacturer's wiring diagrams, and operation and maintenance manual.
- I. Workspace Indication: Install floor marking tape to show working clearances in the direction of access to live parts. Workspace shall comply with NFPA 70 and 29 CFR 1926.403 unless

otherwise indicated. Do not install at flush-mounted panelboards and similar equipment in finished spaces.

- J. Warning Labels for Indoor Cabinets, Boxes, and Enclosures for Power and Lighting: Self-adhesive warning labels.
 - 1. Comply with 29 CFR 1910.145.
 - 2. Identify system voltage with black letters on an orange background.
 - 3. Apply to exterior of door, cover, or other access.
 - 4. For equipment with multiple power or control sources, apply to door or cover of equipment, including, but not limited to, the following:
 - a. Power-transfer switches.
 - b. Controls with external control power connections.
- K. Arc Flash Warning Labeling: Self-adhesive thermal transfer vinyl labels.
 - 1. Comply with NFPA 70E and ANSI Z535.4.
- L. Equipment Identification Labels: On each unit of equipment, install unique designation label that is consistent with wiring diagrams, schedules, and operation and maintenance manual. Apply labels to disconnect switches and protection equipment, central or master units, control panels, control stations, terminal cabinets, and racks of each system. Systems include power, lighting, control, communication, signal, monitoring, and alarm unless equipment is provided with its own identification.
 - 1. Labeling Instructions:
 - a. Indoor Equipment: Engraved, laminated acrylic or melamine plastic label, punched or drilled for mechanical fasteners. Unless otherwise indicated, provide a single line of text with 1/2-inch-high letters on 1-1/2-inch-high label; where two lines of text are required, use labels 2 inches high.
 - b. Outdoor Equipment: Engraved, laminated acrylic or melamine label.
 - c. Elevated Components: Increase sizes of labels and letters to those appropriate for viewing from the floor.
 - d. Unless labels are provided with self-adhesive means of attachment, fasten them with appropriate mechanical fasteners that do not change the NEMA or NRTL rating of the enclosure.
 - 2. Equipment To Be Labeled:
 - a. Panelboards: Typewritten directory of circuits in the location provided by panelboard manufacturer. Panelboard identification shall be in the form of a engraved, laminated acrylic or melamine label.
 - b. Enclosures and electrical cabinets.
 - c. Access doors and panels for concealed electrical items.
 - d. Switchboards.
 - e. Enclosed switches.
 - f. Enclosed circuit breakers.
 - g. Enclosed controllers.
 - h. Variable-speed controllers.
 - i. Push-button stations.
 - j. Contactors.
 - k. Remote-controlled switches, dimmer modules, and control devices.
 - l. Battery-inverter units.
 - m. Monitoring and control equipment.

END OF SECTION 26 0553

SECTION 26 0923 - LIGHTING CONTROL DEVICES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Photoelectric switches.
 - 2. Indoor occupancy and vacancy sensors.
 - 3. Switchbox-mounted occupancy sensors.
- B. Related Requirements:
 - 1. Section 262726 "Wiring Devices" for wall-box dimmers, non-networkable wall-switch occupancy sensors, and manual light switches.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.
- B. Shop Drawings:
 - 1. Show installation details for the following:
 - a. Occupancy sensors.
 - b. Vacancy sensors.
 - 2. Interconnection diagrams showing field-installed wiring.
 - 3. Include diagrams for power, signal, and control wiring.

1.4 INFORMATIONAL SUBMITTALS

- A. Field quality-control reports.
- B. Sample Warranty: For manufacturer's warranties.

1.5 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For each type of lighting control device to include in operation and maintenance manuals.

1.6 WARRANTY

- A. Manufacturer's Warranty: Manufacturer and Installer agree to repair or replace lighting control devices that fail(s) in materials or workmanship within specified warranty period.
 - 1. Failures include, but are not limited to, the following:
 - a. Faulty operation of lighting control devices.
 - 2. Warranty Period: Two year(s) from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 OUTDOOR PHOTOELECTRIC SWITCHES

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
1. Cooper Industries, Inc.
 2. Intermatic, Inc.
 3. Leviton Manufacturing Co., Inc.
 4. NSi Industries LLC.
 5. TE Connectivity Ltd.
- B. Description: Solid state, with DPST dry contacts rated for 1000 W incandescent or 1800 VA inductive, to operate connected relay, contactor coils, or microprocessor input; complying with UL 773A, and compatible with ballasts and LED lamps.
1. Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
 2. Light-Level Monitoring Range: 1.5 to 10 fc, with an adjustment for turn-on and turn-off levels within that range, and a directional lens in front of the photocell to prevent fixed light sources from causing turn-off.
 3. Time Delay: Fifteen-second minimum, to prevent false operation.
 4. Surge Protection: Metal-oxide varistor.
 5. Mounting: Twist lock complies with NEMA C136.10, with base-and-stem mounting or stem-and-swivel mounting accessories as required to direct sensor to the north sky exposure.
 6. Failure Mode: Luminaire stays ON.

2.2 INDOOR OCCUPANCY AND VACANCY SENSORS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
1. Cooper Industries, Inc.
- B. General Requirements for Sensors:
1. Ceiling-mounted, solid-state indoor occupancy and vacancy sensors.
 2. Dual technology.
 3. Integrated power pack.
 4. Hardwired connection to switch ; and BAS and lighting control system.
 5. Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
 6. Operation:
 - a. Occupancy Sensor: Unless otherwise indicated, turn lights on when coverage area is occupied, and turn them off when unoccupied; with a time delay for turning lights off, adjustable over a minimum range of 1 to 15 minutes.
 - b. Vacancy Sensor: Unless otherwise indicated, lights are manually turned on and sensor turns lights off when the room is unoccupied; with a time delay for turning lights off, adjustable over a minimum range of 1 to 15 minutes.
 - c. Combination Sensor: Unless otherwise indicated, sensor shall be programmed to turn lights on when coverage area is occupied and turn them off when unoccupied, or to turn off lights that have been manually turned on; with a time delay for turning lights off, adjustable over a minimum range of 1 to 15 minutes.
 7. Power: POE.
 8. Power Pack: Dry contacts rated for 20-A LED load at 120- and 277-V ac, for 13-A tungsten at 120-V ac, and for 1 hp at 120-V ac. Sensor has 24-V dc, 150-mA, Class 2 power source, as defined by NFPA 70.
 9. Mounting:

- a. Sensor: Suitable for mounting in any position on a standard outlet box.
 - b. Relay: Externally mounted through a 1/2-inch knockout in a standard electrical enclosure.
 - c. Time-Delay and Sensitivity Adjustments: Recessed and concealed behind hinged door.
 10. Indicator: Digital display, to show when motion is detected during testing and normal operation of sensor.
 11. Bypass Switch: Override the "on" function in case of sensor failure.
 12. Automatic Light-Level Sensor: Adjustable from 2 to 200 fc; turn lights off when selected lighting level is present.
- C. Dual-Technology Type: Ceiling mounted; detect occupants in coverage area using PIR and ultrasonic detection methods. The particular technology or combination of technologies that control on-off functions is selectable in the field by operating controls on unit.
1. Sensitivity Adjustment: Separate for each sensing technology.
 2. Detector Sensitivity: Detect occurrences of 6-inch- minimum movement of any portion of a human body that presents a target of not less than 36 sq. in., and detect a person of average size and weight moving not less than 12 inches in either a horizontal or a vertical manner at an approximate speed of 12 inches/s.
 3. Detection Coverage (Standard Room): Detect occupancy anywhere within a circular area of 1000 sq. ft. when mounted on a 96-inch- high ceiling.
 4. Detection Coverage (Room, Wall Mounted): Detect occupancy anywhere within a 180-degree pattern centered on the sensor over an area of 3000 square feet when mounted 48 inches above finished floor.

2.3 SWITCHBOX-MOUNTED OCCUPANCY SENSORS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to the following:
1. Cooper Industries, inc.
- B. General Requirements for Sensors: Automatic-wall-switch occupancy sensor with manual on-off switch, suitable for mounting in a single gang switchbox, with provisions for connection to BAS.
1. Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
 2. Occupancy Sensor Operation: Unless otherwise indicated, turn lights on when coverage area is occupied, and turn lights off when unoccupied; with a time delay for turning lights off, adjustable over a minimum range of 1 to 15 minutes.
 3. Operating Ambient Conditions: Dry interior conditions, 32 to 120 deg F.
 4. Switch Rating: Not less than 800-VA LED load at 120 V, 1200-VA LED load at 277 V, and 800-W incandescent.
 5. Dimming Capability: Ability to dim controlled fixtures at least 50% of the max lumen output.
- C. Wall-Switch Sensor:
1. Standard Range: 180-degree field of view, field adjustable from 180 to 40 degrees; with a minimum coverage area of 2100 sq. ft.
 2. Sensing Technology: Dual technology - PIR and ultrasonic.
 3. Switch Type: SP, dual circuit.
 4. Capable of controlling load in three-way application.
 5. Voltage: Dual voltage - 120 and 277 V.
 6. Ambient-Light Override: Concealed, field-adjustable, light-level sensor from 10 to 150 fc. The switch prevents the lights from turning on when the light level is higher than the set point of the sensor.
 7. Concealed, "off" time-delay selector at 30 seconds and 5, 10, and 20 minutes.

8. Adaptive Technology: Self-adjusting circuitry detects and memorizes usage patterns of the space and helps eliminate false "off" switching.
9. Color: White.
10. Faceplate: Color matched to switch.

2.4 CONDUCTORS AND CABLES

- A. Utilize wiring Cat 5 as required by Cooper Industries, inc.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine lighting control devices before installation. Reject lighting control devices that are wet, moisture damaged, or mold damaged.
- B. Examine walls and ceilings for suitable conditions where lighting control devices will be installed.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 SENSOR INSTALLATION

- A. Comply with NECA 1.
- B. Coordinate layout and installation of ceiling-mounted devices with other construction that penetrates ceilings or is supported by them, including light fixtures, HVAC equipment, smoke detectors, fire-suppression systems, and partition assemblies.
- C. Install and aim sensors in locations to achieve not less than 90-percent coverage of areas indicated. Do not exceed coverage limits specified in manufacturer's written instructions.

3.3 CONTACTOR INSTALLATION

- A. Comply with NECA 1.

3.4 WIRING INSTALLATION

- A. Comply with NECA 1.
- B. Wiring Method: Comply with Section 26 0519 "Low-Voltage Electrical Power Conductors and Cables." Minimum conduit size is 3/4 inch.
- C. Wiring within Enclosures: Comply with NECA 1. Separate power-limited and nonpower-limited conductors according to conductor manufacturer's written instructions.
- D. Size conductors according to lighting control device manufacturer's written instructions unless otherwise indicated.
- E. Splices, Taps, and Terminations: Make connections only on numbered terminal strips in junction, pull, and outlet boxes; terminal cabinets; and equipment enclosures.

3.5 IDENTIFICATION

- A. Identify components and power and control wiring according to Section 26 0553 "Identification for Electrical Systems."
 - 1. Identify controlled circuits in lighting contactors.
 - 2. Identify circuits or luminaires controlled by photoelectric and occupancy sensors at each sensor.
- B. Label time switches and contactors with a unique designation.

3.6 FIELD QUALITY CONTROL

- A. Perform the following tests and inspections with the assistance of a factory-authorized service representative:
 - 1. Operational Test: After installing time switches and sensors, and after electrical circuitry has been energized, start units to confirm proper unit operation.
 - 2. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.
- B. Lighting control devices will be considered defective if they do not pass tests and inspections.
- C. Prepare test and inspection reports.

3.7 ADJUSTING

- A. Occupancy Adjustments: When requested within 12 months from date of Substantial Completion, provide on-site assistance in adjusting lighting control devices to suit actual occupied conditions. Provide up to two visits to Project during other-than-normal occupancy hours for this purpose.
 - 1. For occupancy and motion sensors, verify operation at outer limits of detector range. Set time delay to suit Owner's operations.

3.8 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain lighting control devices.

END OF SECTION 26 0923

SECTION 26 2413 - SWITCHBOARDS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Service and distribution switchboards rated 600 V and less.
 - 2. Disconnecting and overcurrent protective devices.
 - 3. Instrumentation.
 - 4. Control power.
 - 5. Accessory components and features.
 - 6. Identification.

1.3 ACTION SUBMITTALS

- A. Product Data: For each switchboard, overcurrent protective device, surge protection device, ground-fault protector, accessory, and component.
 - 1. Include dimensions and manufacturers' technical data on features, performance, electrical characteristics, ratings, accessories, and finishes.
- B. Shop Drawings: For each switchboard and related equipment.
 - 1. Include dimensioned plans, elevations, sections, and details, including required clearances and service space around equipment. Show tabulations of installed devices, equipment features, and ratings.
 - 2. Detail enclosure types for types other than NEMA 250, Type 1.
 - 3. Detail bus configuration, current, and voltage ratings.
 - 4. Detail short-circuit current rating of switchboards and overcurrent protective devices.
 - 5. Include descriptive documentation of optional barriers specified for electrical insulation and isolation.
 - 6. Include evidence of NRTL listing for series rating of installed devices.
 - 7. Detail features, characteristics, ratings, and factory settings of individual overcurrent protective devices and auxiliary components.
 - 8. Include time-current coordination curves for each type and rating of overcurrent protective device included in switchboards. Submit on translucent log-log graph paper; include selectable ranges for each type of overcurrent protective device.
 - 9. Include schematic and wiring diagrams for power, signal, and control wiring.

1.4 INFORMATIONAL SUBMITTALS

- A. Qualification Data: For testing agency.
- B. Field Quality-Control Reports:
 - 1. Test procedures used.
 - 2. Test results that comply with requirements.
 - 3. Results of failed tests and corrective action taken to achieve test results that comply with requirements.

1.5 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For switchboards and components to include in emergency, operation, and maintenance manuals.
 - 1. In addition to items specified in Section 01 7800 "Closeout Submittals," include the following:
 - a. Routine maintenance requirements for switchboards and all installed components.
 - b. Manufacturer's written instructions for testing and adjusting overcurrent protective devices.
 - c. Time-current coordination curves for each type and rating of overcurrent protective device included in switchboards. Submit on translucent log-log graph paper; include selectable ranges for each type of overcurrent protective device.

1.6 QUALITY ASSURANCE

- A. Installer Qualifications: An employer of workers qualified as defined in NEMA PB 2.1 and trained in electrical safety as required by NFPA 70E.
- B. Testing Agency Qualifications: Accredited by NETA.
 - 1. Testing Agency's Field Supervisor: Certified by NETA to supervise on-site testing.

1.7 DELIVERY, STORAGE, AND HANDLING

- A. Deliver switchboards in sections or lengths that can be moved past obstructions in delivery path.
- B. Handle and prepare switchboards for installation according to NEMA PB 2.1.

1.8 FIELD CONDITIONS

- A. Installation Pathway: Remove and replace access fencing, doors, lift-out panels, and structures to provide pathway for moving switchboards into place.
- B. Environmental Limitations:
 - 1. Do not deliver or install switchboards until spaces are enclosed and weathertight, wet work in spaces is complete and dry, work above switchboards is complete, and HVAC system is operating and maintaining ambient temperature and humidity conditions at occupancy levels during the remainder of the construction period.
 - 2. Rate equipment for continuous operation under the following conditions unless otherwise indicated:
 - a. Ambient Temperature: Not exceeding 104 deg F.
 - b. Altitude: Not exceeding 6600 feet.
- C. Unusual Service Conditions: NEMA PB 2, as follows:
 - 1. Ambient temperatures within limits specified.
 - 2. Altitude not exceeding 6600 feet.

1.9 COORDINATION

- A. Coordinate layout and installation of switchboards and components with other construction that penetrates walls or is supported by them, including electrical and other types of equipment, raceways, piping, encumbrances to workspace clearance requirements, and adjacent surfaces. Maintain required workspace clearances and required clearances for equipment access doors and panels.

1.10 WARRANTY

- A. Manufacturer's Warranty: Manufacturer agrees to repair or replace switchboard enclosures, buswork, overcurrent protective devices, accessories, and factory installed interconnection wiring that fail in materials or workmanship within specified warranty period.
1. Warranty Period: **Three** years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Seismic Performance: Switchboards shall withstand the effects of earthquake motions determined according to ASCE/SEI 7.
1. Basis for Certification: Indicate whether withstand certification is based on actual test of assembled components or on calculation. Shake-table testing shall comply with ICC-ES AC156.
 2. The term "withstand" means "the unit will remain in place without separation of any parts from the device when subjected to the seismic forces specified."

2.2 SWITCHBOARDS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
1. ABB, Electrification Business.
 2. Eaton.
 3. Siemens Industry, Inc., Energy Management Division.
 4. Square D; Schneider Electric USA.
- B. Source Limitations: Obtain switchboards, overcurrent protective devices, components, and accessories from single source from single manufacturer.
- C. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- D. Comply with NEMA PB 2.
- E. Comply with NFPA 70.
- F. Comply with UL 891.
- G. Front-Connected, Front-Accessible Switchboards:
1. Main Devices: Panel mounted.
 2. Branch Devices: Panel mounted.
 3. Sections front and rear aligned.
- H. Nominal System Voltage: 208Y/120V.
- I. Main-Bus Continuous: 800A.
- J. Indoor Enclosures: Steel, NEMA 250, Type 1.
- K. Enclosure Finish for Indoor Units: Factory-applied finish in manufacturer's standard gray finish over a rust-inhibiting primer on treated metal surface.
- L. Barriers: Between adjacent switchboard sections.

- M. Insulation and isolation for main bus of main section and main and vertical buses of feeder sections.
- N. Service Entrance Rating: Switchboards intended for use as service entrance equipment shall contain from one to six service disconnecting means with overcurrent protection, a neutral bus with disconnecting link, a grounding electrode conductor terminal, and a main bonding jumper.
- O. Bus Transition and Incoming Pull Sections: Matched and aligned with basic switchboard.
- P. Hinged Front Panels: Allow access to circuit breaker, metering, accessory, and blank compartments.
- Q. Buses and Connections: Three phase, four wire unless otherwise indicated.
 - 1. Provide phase bus arrangement A, B, C from front to back, top to bottom, and left to right when viewed from the front of the switchboard.
 - 2. Phase- and Neutral-Bus Material: Hard-drawn copper of 98 percent conductivity, silver-plated.
 - 3. Copper feeder circuit-breaker line connections.
 - 4. Load Terminals: Insulated, rigidly braced, runback bus extensions, of same material as through buses, equipped with mechanical connectors for outgoing circuit conductors. Provide load terminals for future circuit-breaker positions at full-ampere rating of circuit-breaker position.
 - 5. Ground Bus: Minimum-size required by UL 891, hard-drawn copper of 98 percent conductivity, equipped with mechanical connectors for feeder and branch-circuit ground conductors.
 - 6. Main-Phase Buses and Equipment-Ground Buses: Uniform capacity for entire length of switchboard's main and distribution sections. Provide for future extensions from both ends.
 - 7. Disconnect Links:
 - a. Isolate neutral bus from incoming neutral conductors.
 - b. Bond neutral bus to equipment-ground bus for switchboards utilized as service equipment or separately derived systems.
 - 8. Neutral Buses: 100 percent of the ampacity of phase buses unless otherwise indicated, equipped with **mechanical** connectors for outgoing circuit neutral cables. Brace bus extensions for busway feeder neutral bus.
 - 9. Isolation Barrier Access Provisions: Permit checking of bus-bolt tightness.
- R. Future Devices: Equip compartments with mounting brackets, supports, bus connections, and appurtenances at full rating of circuit-breaker compartment.
- S. Bus-Bar Insulation: Factory-applied, flame-retardant, tape wrapping of individual bus bars or flame-retardant, spray-applied insulation. Minimum insulation temperature rating of 105 deg C.

2.3 DISCONNECTING AND OVERCURRENT PROTECTIVE DEVICES

- A. Molded-Case Circuit Breaker (MCCB): Comply with UL 489, with interrupting capacity to meet available fault currents.
 - 1. Thermal-Magnetic Circuit Breakers: Inverse time-current element for low-level overloads and instantaneous magnetic trip element for short circuits. Adjustable magnetic trip setting for circuit-breaker frame sizes 250 A and larger.
 - 2. Electronic trip circuit breakers with rms sensing; field-replaceable rating plug or field-replicable electronic trip; and the following field-adjustable settings:
 - a. Instantaneous trip.
 - b. Long- and short-time pickup levels.
 - c. Long and short time adjustments.
 - d. Ground-fault pickup level, time delay, and I^2t response.

3. MCCB Features and Accessories:
 - a. Standard frame sizes, trip ratings, and number of poles.
 - b. Lugs: Mechanical style, suitable for number, size, trip ratings, and conductor material.
 - c. Application Listing: Appropriate for application; Type SWD for switching fluorescent lighting loads; Type HID for feeding fluorescent and high-intensity discharge (HID) lighting circuits.
 - d. Ground-Fault Protection: Integrally mounted relay and trip unit with adjustable pickup and time-delay settings, push-to-test feature, and ground-fault indicator.
- B. Insulated-Case Circuit Breaker (ICCB): **100** percent rated, sealed, insulated-case power circuit breaker with interrupting capacity rating to meet available fault current.
 1. **Fixed** circuit-breaker mounting.
 2. Two-step, stored-energy closing.
 3. **Standard**-function, microprocessor-based trip units with interchangeable rating plug, trip indicators, and the following field-adjustable settings:
 - a. Instantaneous trip.
 - b. Time adjustments for long- and short-time pickup.
 - c. Ground-fault pickup level, time delay, and I^2t response.
 4. Zone-Selective Interlocking: Integral with electronic trip unit; for interlocking ground-fault protection function.
 5. Remote trip indication and control.

2.4 INSTRUMENTATION

- A. Multifunction Digital-Metering Monitor: Microprocessor-based unit suitable for three- or four-wire systems and with the following features:
 1. Switch-selectable digital display of the following values with maximum accuracy tolerances as indicated:
 - a. Phase Currents, Each Phase: Plus or minus 0.5 percent.
 - b. Phase-to-Phase Voltages, Three Phase: Plus or minus 0.5 percent.
 - c. Phase-to-Neutral Voltages, Three Phase: Plus or minus 0.5 percent.
 - d. Megawatts: Plus or minus 1 percent.
 - e. Megavars: Plus or minus 1 percent.
 - f. Power Factor: Plus or minus 1 percent.
 - g. Frequency: Plus or minus 0.1 percent.
 - h. Accumulated Energy, Megawatt Hours: Plus or minus 1 percent; accumulated values unaffected by power outages up to 72 hours.
 - i. Megawatt Demand: Plus or minus 1 percent; demand interval programmable from five to 60 minutes.
 - j. Contact devices to operate remote impulse-totalizing demand meter.
 2. Mounting: Display and control unit flush or semiflush mounted in instrument compartment door.
- B. Voltmeters: Cover an expanded-scale range of nominal voltage plus 10 percent.
- C. Watt-Hour Meters and Wattmeters:
 1. Comply with ANSI C12.1.
 2. Three-phase induction type with two stators, each with current and potential coil, rated 5 A, 120 V, 60 Hz.
 3. Suitable for connection to three- and four-wire circuits.
 4. Potential indicating lamps.
 5. Adjustments for light and full load, phase balance, and power factor.
 6. Four-dial clock register.
 7. Integral demand indicator.
 8. Contact devices to operate remote impulse-totalizing demand meter.

9. Ratchets to prevent reverse rotation.
10. Removable meter with drawout test plug.
11. Semiflush mounted case with matching cover.
12. Appropriate multiplier tag.

2.5 IDENTIFICATION

- A. Service Equipment Label: NRTL labeled for use as service equipment for switchboards with one or more service disconnecting and overcurrent protective devices.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Receive, inspect, handle, and store switchboards according to NEMA PB 2.1.
 1. Lift or move panelboards with spreader bars and manufacturer-supplied lifting straps following manufacturer's instructions.
 2. Use rollers, slings, or other manufacturer-approved methods if lifting straps are not furnished.
 3. Protect from moisture, dust, dirt, and debris during storage and installation.
 4. Install temporary heating during storage per manufacturer's instructions.
- B. Examine switchboards before installation. Reject switchboards that are moisture damaged or physically damaged.
- C. Examine elements and surfaces to receive switchboards for compliance with installation tolerances and other conditions affecting performance of the Work or that affect the performance of the equipment.
- D. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Install switchboards and accessories according to NEMA PB 2.1.
- B. Temporary Lifting Provisions: Remove temporary lifting eyes, channels, straps and brackets, and temporary blocking of moving parts from switchboard units and components.
- C. Install filler plates in unused spaces of panel-mounted sections.
- D. Install overcurrent protective devices, surge protection devices, and instrumentation.
 1. Set field-adjustable switches and circuit-breaker trip ranges.
- E. Comply with NECA 1.

3.3 CONNECTIONS

- A. Bond conduits entering underneath the switchboard to the equipment ground bus with a bonding conductor sized per NFPA 70.
- B. Support and secure conductors within the switchboard according to NFPA 70.
- C. Extend insulated equipment grounding cable to busway ground connection and support cable at intervals in vertical run.

3.4 IDENTIFICATION

- A. Identify field-installed conductors, interconnecting wiring, and components; provide warning signs complying with requirements for identification specified in Section 26 0553 "Identification for Electrical Systems."
- B. Switchboard Nameplates: Label each switchboard compartment with a nameplate complying with requirements for identification specified in Section 26 0553 "Identification for Electrical Systems."
- C. Device Nameplates: Label each disconnecting and overcurrent protective device and each meter and control device mounted in compartment doors with a nameplate complying with requirements for identification specified in Section 26 0553 "Identification for Electrical Systems."

3.5 FIELD QUALITY CONTROL

- A. Perform tests and inspections with the assistance of a factory-authorized service representative.
- B. Tests and Inspections:
 - 1. Acceptance Testing:
 - a. Test insulation resistance for each switchboard bus, component, connecting supply, feeder, and control circuit. Open control and metering circuits within the switchboard, and remove neutral connection to surge protection and other electronic devices prior to insulation test. Reconnect after test.
 - b. Test continuity of each circuit.
 - 2. Perform each visual and mechanical inspection and electrical test stated in NETA Acceptance Testing Specification. Certify compliance with test parameters.
 - 3. Correct malfunctioning units on-site where possible, and retest to demonstrate compliance; otherwise, replace with new units and retest.
 - 4. Test and adjust controls, remote monitoring, and safeties. Replace damaged and malfunctioning controls and equipment.
- C. Switchboard will be considered defective if it does not pass tests and inspections.
- D. Prepare test and inspection reports, including a certified report that identifies switchboards included and that describes scanning results. Include notation of deficiencies detected, remedial action taken, and observations after remedial action.

3.6 ADJUSTING

- A. Adjust moving parts and operable components to function smoothly, and lubricate as recommended by manufacturer.

END OF SECTION 26 2413

SECTION 26 2416 - PANELBOARDS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Distribution panelboards.
 - 2. Lighting and appliance branch-circuit panelboards.

1.3 DEFINITIONS

- A. ATS: Acceptance testing specification.
- B. GFCI: Ground-fault circuit interrupter.
- C. GFEP: Ground-fault equipment protection.
- D. HID: High-intensity discharge.
- E. MCCB: Molded-case circuit breaker.
- F. SPD: Surge protective device.
- G. VPR: Voltage protection rating.

1.4 ACTION SUBMITTALS

- A. Product Data: For each type of panelboard.
 - 1. Include materials, switching and overcurrent protective devices, SPDs, accessories, and components indicated.
 - 2. Include dimensions and manufacturers' technical data on features, performance, electrical characteristics, ratings, and finishes.
- B. Shop Drawings: For each panelboard and related equipment.
 - 1. Include dimensioned plans, elevations, sections, and details.
 - 2. Show tabulations of installed devices with nameplates, conductor termination sizes, equipment features, and ratings.
 - 3. Detail enclosure types including mounting and anchorage, environmental protection, knockouts, corner treatments, covers and doors, gaskets, hinges, and locks.
 - 4. Detail bus configuration, current, and voltage ratings.
 - 5. Short-circuit current rating of panelboards and overcurrent protective devices.
 - 6. Detail features, characteristics, ratings, and factory settings of individual overcurrent protective devices and auxiliary components.
 - 7. Include wiring diagrams for power, signal, and control wiring.
 - 8. Include time-current coordination curves for each type and rating of overcurrent protective device included in panelboards. Submit on translucent log-log graft paper; include selectable ranges for each type of overcurrent protective device. Include an Internet link for electronic access to downloadable PDF of the coordination curves.

1.5 INFORMATIONAL SUBMITTALS

- A. Qualification Data: For testing agency.
- B. Panelboard Schedules: For installation in panelboards.

1.6 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For panelboards and components to include in emergency, operation, and maintenance manuals. In addition to items specified in Section 01 7800 "Closeout Submittals," include the following:
 - 1. Manufacturer's written instructions for testing and adjusting overcurrent protective devices.
 - 2. Time-current curves, including selectable ranges for each type of overcurrent protective device that allows adjustments.

1.7 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 - 1. Keys: Two spares for each type of panelboard cabinet lock.

1.8 QUALITY ASSURANCE

- A. Manufacturer Qualifications: ISO 9001 or ISO 9002 certified.

1.9 DELIVERY, STORAGE, AND HANDLING

- A. Remove loose packing and flammable materials from inside panelboards; install temporary electric heating (250 W per panelboard) to prevent condensation.
- B. Handle and prepare panelboards for installation according to NEMA PB 1.

1.10 FIELD CONDITIONS

- A. Environmental Limitations:
 - 1. Do not deliver or install panelboards until spaces are enclosed and weathertight, wet work in spaces is complete and dry, work above panelboards is complete, and temporary HVAC system is operating and maintaining ambient temperature and humidity conditions at occupancy levels during the remainder of the construction period.
 - 2. Rate equipment for continuous operation under the following conditions unless otherwise indicated:
 - a. Ambient Temperature: Not exceeding minus 22 deg F to plus 104 deg F.
 - b. Altitude: Not exceeding 6600 feet.
- B. Interruption of Existing Electric Service: Do not interrupt electric service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary electric service according to requirements indicated:
 - 1. Notify Owner no fewer than two days in advance of proposed interruption of electric service.
 - 2. Do not proceed with interruption of electric service without **Owner's** written permission.
 - 3. Comply with NFPA 70E.

1.11 WARRANTY

- A. Manufacturer's Warranty: Manufacturer agrees to repair or replace panelboards that fail in materials or workmanship within specified warranty period.
 - 1. Panelboard Warranty Period: 18 months from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 PANELBOARDS COMMON REQUIREMENTS

- A. Product Selection for Restricted Space: Drawings indicate maximum dimensions for panelboards including clearances between panelboards and adjacent surfaces and other items. Comply with indicated maximum dimensions.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- C. Comply with NEMA PB 1.
- D. Comply with NFPA 70.
- E. Enclosures: Flush and Surface-mounted, dead-front cabinets.
 - 1. Rated for environmental conditions at installed location.
 - a. Indoor Dry and Clean Locations: NEMA 250, Type 1.
 - 2. Height: 84 inches maximum.
 - 3. Front: Secured to box with concealed trim clamps. For surface-mounted fronts, match box dimensions; for flush-mounted fronts, overlap box. Trims shall cover all live parts and shall have no exposed hardware.
 - 4. Finishes:
 - a. Panels and Trim: Steel, factory finished immediately after cleaning and pretreating with manufacturer's standard two-coat, baked-on finish consisting of prime coat and thermosetting topcoat.
 - b. Back Boxes: Same finish as panels and trim.
- F. Incoming Mains:
 - 1. Location: Top.
 - 2. Main Breaker: Main lug interiors up to 400 amperes shall be field convertible to main breaker.
- G. Phase, Neutral, and Ground Buses:
 - 1. Material: Hard-drawn copper, 98 percent conductivity.
 - a. Plating shall run entire length of bus.
 - b. Bus shall be fully rated the entire length.
 - 2. Interiors shall be factory assembled into a unit. Replacing switching and protective devices shall not disturb adjacent units or require removing the main bus connectors.
 - 3. Equipment Ground Bus: Adequate for feeder and branch-circuit equipment grounding conductors; bonded to box.
 - 4. Full-Sized Neutral: Equipped with full-capacity bonding strap for service entrance applications. Mount electrically isolated from enclosure. Do not mount neutral bus in gutter.
- H. Conductor Connectors: Suitable for use with conductor material and sizes.
 - 1. Material: Hard-drawn copper, 98 percent conductivity.
 - 2. Terminations shall allow use of 75 deg C rated conductors without derating.

3. Size: Lugs suitable for indicated conductor sizes, with additional gutter space, if required, for larger conductors.
 4. Main and Neutral Lugs: Mechanical type, with a lug on the neutral bar for each pole in the panelboard.
 5. Ground Lugs and Bus-Configured Terminators: Mechanical type, with a lug on the bar for each pole in the panelboard.
- I. NRTL Label: Panelboards or load centers shall be labeled by an NRTL acceptable to authority having jurisdiction for use as service equipment with one or more main service disconnecting and overcurrent protective devices. Panelboards or load centers shall have meter enclosures, wiring, connections, and other provisions for utility metering. Coordinate with utility company for exact requirements.
- J. Future Devices: Panelboards or load centers shall have mounting brackets, bus connections, filler plates, and necessary appurtenances required for future installation of devices.
- K. Panelboard Short-Circuit Current Rating: Rated for series-connected system with integral or remote upstream overcurrent protective devices and labeled by an NRTL. Include label or manual with size and type of allowable upstream and branch devices listed and labeled by an NRTL for series-connected short-circuit rating.
1. Panelboards rated 240 V or less shall have short-circuit ratings as shown on Drawings, but not less than 10,000 A rms symmetrical.

2.2 POWER PANELBOARDS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
1. [ABB, Electrification Business.](#)
 2. [Eaton.](#)
 3. [ESL Power Systems, Inc.](#)
 4. [Mersen USA.](#)
 5. [Siemens Industry, Inc., Energy Management Division.](#)
 6. [Square D; Schneider Electric USA.](#)
- B. Panelboards: NEMA PB 1, distribution type.
- C. Doors: Secured with vault-type latch with tumbler lock; keyed alike.
1. For doors more than 36 inches high, provide two latches, keyed alike.
- D. Mains: Circuit breaker.
- E. Branch Overcurrent Protective Devices for Circuit-Breaker Frame Sizes 125 A and Smaller: Bolt-on circuit breakerslug-in circuit breakers where individual positive-locking device requires mechanical release for removal.
- F. Branch Overcurrent Protective Devices for Circuit-Breaker Frame Sizes Larger Than 125 A: Bolt-on circuit breakers.

2.3 LIGHTING AND APPLIANCE BRANCH-CIRCUIT PANELBOARDS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
1. [ABB, Electrification Business.](#)
 2. [Bender Inc / Isotrol.](#)
 3. [Eaton.](#)

4. [Siemens Industry, Inc., Energy Management Division.](#)
5. [Square D; Schneider Electric USA.](#)

- B. Panelboards: NEMA PB 1, lighting and appliance branch-circuit type.
- C. Mains: Circuit breaker or lugs only. Refer panel schedules.
- D. Branch Overcurrent Protective Devices: **Bolt-on** circuit breakers, replaceable without disturbing adjacent units.
- E. Doors: Concealed hinges; secured with flush latch with tumbler lock; keyed alike.

2.4 DISCONNECTING AND OVERCURRENT PROTECTIVE DEVICES

- A. [Manufacturers:](#) Subject to compliance with requirements, provide products by one of the following:
 1. [ABB, Electrification Business.](#)
 2. [Eaton.](#)
 3. [Siemens Industry, Inc., Energy Management Division.](#)
 4. [Square D; Schneider Electric USA.](#)
- B. MCCB: Comply with UL 489, with interrupting capacity to meet available fault currents.
 1. Thermal-Magnetic Circuit Breakers:
 - a. Inverse time-current element for low-level overloads.
 - b. Instantaneous magnetic trip element for short circuits.
 - c. Adjustable magnetic trip setting for circuit-breaker frame sizes 250 A and larger.
 2. Adjustable Instantaneous-Trip Circuit Breakers: Magnetic trip element with front-mounted, field-adjustable trip setting.
 3. GFCI Circuit Breakers: Single- and double-pole configurations with Class A ground-fault protection (6-mA trip).
 4. MCCB Features and Accessories:
 - a. Standard frame sizes, trip ratings, and number of poles.
 - b. Breaker handle indicates tripped status.
 - c. UL listed for reverse connection without restrictive line or load ratings.
 - d. Lugs: Mechanical style, suitable for number, size, trip ratings, and conductor materials.

2.5 IDENTIFICATION

- A. Panelboard Label: Manufacturer's name and trademark, voltage, amperage, number of phases, and number of poles shall be located on the interior of the panelboard door.
- B. Breaker Labels: Faceplate shall list current rating, UL and IEC certification standards, and AIC rating.
- C. Circuit Directory: Computer-generated circuit directory mounted inside panelboard door with transparent plastic protective cover.
 1. Circuit directory shall identify specific purpose with detail sufficient to distinguish it from all other circuits.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Verify actual conditions with field measurements prior to ordering panelboards to verify that equipment fits in allocated space in, and comply with, minimum required clearances specified in NFPA 70.
- B. Receive, inspect, handle, and store panelboards according to NEMA PB 1.1.
- C. Examine panelboards before installation. Reject panelboards that are damaged, rusted, or have been subjected to water saturation.
- D. Examine elements and surfaces to receive panelboards for compliance with installation tolerances and other conditions affecting performance of the Work.
- E. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Coordinate layout and installation of panelboards and components with other construction that penetrates walls or is supported by them, including electrical and other types of equipment, raceways, piping, encumbrances to workspace clearance requirements, and adjacent surfaces. Maintain required workspace clearances and required clearances for equipment access doors and panels.
- B. Comply with NECA 1.
- C. Install panelboards and accessories according to NEMA PB 1.1.
- D. Equipment Mounting:
 - 1. Attach panelboard to the vertical finished or structural surface behind the panelboard.
- E. Temporary Lifting Provisions: Remove temporary lifting eyes, channels, and brackets and temporary blocking of moving parts from panelboards.
- F. Mount top of trim 90 inches above finished floor unless otherwise indicated.
- G. Mount panelboard cabinet plumb and rigid without distortion of box.
- H. Mount surface-mounted panelboards on exterior walls to steel slotted supports 1-1/4 inch in depth.
- I. Install overcurrent protective devices and controllers not already factory installed.
 - 1. Set field-adjustable, circuit-breaker trip ranges.
 - 2. Tighten bolted connections and circuit breaker connections using calibrated torque wrench or torque screwdriver per manufacturer's written instructions.
- J. Install filler plates in unused spaces.
- K. Flush mounted panelboards: Stub four 1-inch empty conduits from panelboard into accessible ceiling space or space designated to be ceiling space in the future.

- L. Arrange conductors in gutters into groups and bundle and wrap with wire ties.

3.3 IDENTIFICATION

- A. Create a directory to indicate installed circuit loads; incorporate Owner's final room designations. Obtain approval before installing. Handwritten directories are not acceptable. Install directory inside panelboard door.
- B. Panelboard Nameplates: Label each panelboard with a nameplate complying with requirements for identification specified in Section 260553 "Identification for Electrical Systems."
- C. Install warning signs complying with requirements in Section 260553 "Identification for Electrical Systems" identifying source of remote circuit.

3.4 FIELD QUALITY CONTROL

- A. Acceptance Testing Preparation:
 - 1. Test insulation resistance for each panelboard bus, component, connecting supply, feeder, and control circuit.
 - 2. Test continuity of each circuit.
- B. Panelboards will be considered defective if they do not pass tests and inspections.
- C. Prepare test and inspection reports, including a certified report that identifies panelboards included. Include notation of deficiencies detected, remedial action taken, and observations after remedial action.

3.5 ADJUSTING

- A. Adjust moving parts and operable components to function smoothly, and lubricate as recommended by manufacturer.

END OF SECTION 26 2416

SECTION 26 2726 - WIRING DEVICES

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. General-use switches, dimmer switches, and fan-speed controller switches.
 - 2. General-grade single straight-blade receptacles.
 - 3. General-grade duplex straight-blade receptacles.
 - 4. Receptacles with arc-fault and ground-fault protective devices.
 - 5. Locking receptacles.
 - 6. Connectors, cords, and plugs.
- B. Related Requirements:
 - 1. Section 26 0923 "Lighting Control Devices" for occupancy sensors, timers, control-voltage switches, and control-voltage dimmers.
- C. UL 1472 Type I Dimmer: Dimmer in which air-gap switch is used to energize preset lighting levels.

1.2 ACTION SUBMITTALS

- A. Product Data:
 - 1. Toggle switches.
 - 2. Dimmer switches.
 - 3. Single straight-blade receptacles
 - 4. Duplex straight-blade receptacles.
 - 5. Receptacles with GFCI device.
 - 6. Locking receptacles.
 - 7. Cord connectors.

PART 2 - PRODUCTS

2.1 GENERAL-USE SWITCHES, DIMMER SWITCHES, AND FAN-SPEED CONTROLLER SWITCHES

- A. Toggle Switch:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Arrow Hart, Wiring Devices; Eaton, Electrical Sector.
 - b. Leviton Manufacturing Co., Inc.
 - c. Pass & Seymour; Legrand North America, LLC.
 - d. Wiring Device-Kellems; Hubbell Incorporated, Commercial and Industrial.
 - 2. Regulatory Requirements:
 - a. Listed and labeled in accordance with NFPA 70, by qualified electrical testing laboratory recognized by authorities having jurisdiction, and marked for intended location and application.
 - 3. General Characteristics:
 - a. Reference Standards: UL CCN WMUZ and UL 20.
 - 4. Options:
 - a. Device Color: White.
 - b. Configuration:
 - 1) General-duty, 120-277 V, 20 A, single pole, three way or four way.
 - 5. Accessories:

- a. Cover Plate: 0.060 inch thick, high-impact thermoplastic (nylon) with smooth finish and color matching wiring device; from same manufacturer as wiring device.
 - b. Securing Screws for Cover Plate: Metal with head color matching wallplate finish.
- B. Type I Dimmer Switch:
- 1. **Manufacturers:** Subject to compliance with requirements, provide products by one of the following:
 - a. [Arrow Hart, Wiring Devices; Eaton, Electrical Sector.](#)
 - b. [GE Lighting; General Electric Company.](#)
 - c. [Leviton Manufacturing Co., Inc.](#)
 - d. [Lutron Electronics Co., Inc.](#)
 - e. [Pass & Seymour; Legrand North America, LLC.](#)
 - f. [Wiring Device-Kellems; Hubbell Incorporated, Commercial and Industrial.](#)
 - 2. Regulatory Requirements:
 - a. Listed and labeled in accordance with NFPA 70, by qualified electrical testing laboratory recognized by authorities having jurisdiction, and marked for intended location and application.
 - 3. General Characteristics:
 - a. Reference Standards: UL CCN EOYX and UL 1472 Type I dimmer.
 - 4. Options:
 - a. Device Color: White.
 - b. Switch Style: **Rocker**.
 - c. Dimming Control Style: **Slide**.
 - 5. Accessories:
 - a. Cover Plate: 0.060 inch thick, high-impact thermoplastic (nylon) with smooth finish and color matching wiring device; from same manufacturer as wiring device.
 - b. Securing Screws for Cover Plate: Metal with head color matching wallplate finish.

2.2 GENERAL-GRADE SINGLE STRAIGHT-BLADE RECEPTACLES

- A. Single Straight-Blade Receptacle:
- 1. **Manufacturers:** Subject to compliance with requirements, provide products by one of the following:
 - a. [Arrow Hart, Wiring Devices; Eaton, Electrical Sector.](#)
 - b. [Leviton Manufacturing Co., Inc.](#)
 - c. [Pass & Seymour; Legrand North America, LLC.](#)
 - d. [Wiring Device-Kellems; Hubbell Incorporated, Commercial and Industrial.](#)
 - 2. Regulatory Requirements:
 - a. Listed and labeled in accordance with NFPA 70, by qualified electrical testing laboratory recognized by authorities having jurisdiction, and marked for intended location and application.
 - 3. General Characteristics:
 - a. Reference Standards: UL CCN RTRT and UL 498.
 - 4. Options:
 - a. Device Color: White.
 - b. Configuration:
 - 1) General-duty, NEMA 5-20R.
 - 2) General-duty, NEMA 14-50R (Range).
 - 3) Heavy-duty, NEMA 6-30R, NEMA 6-50R.
 - 5. Accessories:
 - a. Cover Plate: 0.060 inch thick, high-impact thermoplastic (nylon) with smooth finish and color matching wiring device; from same manufacturer as wiring device.
 - b. Securing Screws for Cover Plate: Metal with head color matching wallplate finish.

2.3 GENERAL-GRADE DUPLEX STRAIGHT-BLADE RECEPTACLES

- A. Duplex Straight-Blade Receptacle:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Arrow Hart, Wiring Devices; Eaton, Electrical Sector.
 - b. Leviton Manufacturing Co., Inc.
 - c. Pass & Seymour; Legrand North America, LLC.
 - d. Wiring Device-Kellems; Hubbell Incorporated, Commercial and Industrial.
 2. Regulatory Requirements:
 - a. Listed and labeled in accordance with NFPA 70, by qualified electrical testing laboratory recognized by authorities having jurisdiction, and marked for intended location and application.
 3. General Characteristics:
 - a. Reference Standards: UL CCN RTRT and UL 498.
 4. Options:
 - a. Device Color: White.
 - b. Configuration:
 - 1) General-duty, **NEMA 5-20R**.
 5. Accessories:
 - a. Cover Plate: 0.060 inch thick, high-impact thermoplastic (nylon) with smooth finish and color matching wiring device; from same manufacturer as wiring device.
 - b. Securing Screws for Cover Plate: Metal with head color matching wallplate finish.

2.4 RECEPTACLES WITH GROUND-FAULT PROTECTIVE DEVICES

- A. General-Grade, Weather-Resistant, Tamper-Resistant Duplex Straight-Blade Receptacle with GFCI Device:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Arrow Hart, Wiring Devices; Eaton, Electrical Sector.
 - b. Leviton Manufacturing Co., Inc.
 - c. Pass & Seymour; Legrand North America, LLC.
 - d. Wiring Device-Kellems; Hubbell Incorporated, Commercial and Industrial.
 2. Regulatory Requirements:
 - a. Listed and labeled in accordance with NFPA 70, by qualified electrical testing laboratory recognized by authorities having jurisdiction, and marked for intended location and application.
 3. General Characteristics:
 - a. Reference Standards: UL CCN KCXS, UL 498, and UL 943.
 4. Options:
 - a. Device Color: White.
 - b. Configuration: Heavy-duty, **NEMA 5-20R**.
 5. Accessories:
 - a. Cover Plate: 0.060 inch thick, high-impact thermoplastic (nylon) with smooth finish and color matching wiring device; from same manufacturer as wiring device.
 - b. Securing Screws for Cover Plate: Metal with head color matching wallplate finish.

2.5 LOCKING RECEPTACLES

- A. NEMA, 125 V, Locking Receptacle:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Arrow Hart, Wiring Devices; Eaton, Electrical Sector.
 - b. Leviton Manufacturing Co., Inc.
 - c. Pass & Seymour; Legrand North America, LLC.

- d. [Wiring Device-Kellems; Hubbell Incorporated, Commercial and Industrial.](#)
 2. Regulatory Requirements:
 - a. Listed and labeled in accordance with NFPA 70, by qualified electrical testing laboratory recognized by authorities having jurisdiction, and marked for intended location and application.
 3. General Characteristics:
 - a. Reference Standards: UL CCN RTRT and UL 498.
 4. Options:
 - a. Device Color: Black with yellow voltage indication on face.
 - b. Configuration: 2 pole, 3 wire, grounding, **NEMA L5-30R**.
- B. NEMA, 250 V, Locking Receptacle:
1. [Manufacturers:](#) Subject to compliance with requirements, provide products by one of the following:
 - a. [Arrow Hart, Wiring Devices; Eaton, Electrical Sector.](#)
 - b. [Leviton Manufacturing Co., Inc.](#)
 - c. [Pass & Seymour; Legrand North America, LLC.](#)
 - d. [Wiring Device-Kellems; Hubbell Incorporated, Commercial and Industrial.](#)
 2. Regulatory Requirements:
 - a. Listed and labeled in accordance with NFPA 70, by qualified electrical testing laboratory recognized by authorities having jurisdiction, and marked for intended location and application.
 3. General Characteristics:
 - a. Reference Standards: UL CCN RTRT and UL 498.
 4. Options:
 - a. Device Color: Black with blue voltage indication on face.
 - b. Configuration:
 - 1) 2 pole, 3 wire, grounding, **NEMA L6-30R**.
- C. Spring-Driven Commercial/Industrial-Use Cord Reel, No. 12 AWG Conductors:
1. [Manufacturers:](#) Subject to compliance with requirements, provide products by one of the following:
 - a. [Appleton; Emerson Electric Co., Automation Solutions.](#)
 - b. [Ericson Manufacturing Company.](#)
 - c. [Gleason Reel; Hubbell Incorporated, Commercial and Industrial.](#)
 - d. [Reelcraft; Madison Industries.](#)
 2. Regulatory Requirements: Listed and labeled in accordance with NFPA 70, by qualified electrical testing laboratory recognized by authorities having jurisdiction, and marked for intended location and application.
 3. General Characteristics:
 - a. Reference Standards: UL CCN SBCV and UL 355.
 - b. Spring take-up retraction mechanism.
 4. Options:
 - a. Electrical Rating with Cable: 600 V, **20 A**.
 - b. Color: Black.
 - c. Enclosure Degree of Protection: **Type 4**.
 - d. Ball stop.
 - e. Pivot base.
 - f. Spool Capacity:
 - 1) No. 12 AWG, two wires and equipment ground, **45 ft**.
 - 2)

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Receptacles:
 - 1. Verify that receptacles to be procured and installed for Owner-furnished equipment are compatible with mating attachment plugs on equipment.
- B. Cord Reels:
 - 1. Examine roughing-in for cord reel mounting and power connections to verify actual locations of mounts and power connections before cord reel installation.
 - 2. Examine walls, floors, and ceilings for suitable conditions where cord reel will be installed.
 - 3. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION OF SWITCHES

- A. Comply with manufacturer's instructions.
- B. Reference Standards:
 - 1. Unless more stringent requirements are specified in Contract Documents or manufacturers' instructions, comply with installation instructions in NECA NEIS 130.
 - 2. Mounting Heights: Unless otherwise indicated in Contract Documents, comply with mounting heights recommended in NECA NEIS 1.
 - 3. Consult Architect for resolution of conflicting requirements.

3.3 INSTALLATION OF STRAIGHT-BLADE RECEPTACLES

- A. Comply with manufacturer's instructions.
- B. Reference Standards:
 - 1. Unless more stringent requirements are specified in Contract Documents or manufacturers' instructions, comply with installation instructions in NECA NEIS 130.
 - 2. Mounting Heights: Unless otherwise indicated in Contract Documents, comply with mounting heights recommended in NECA NEIS 1.
 - 3. Receptacle Orientation: Unless otherwise indicated in Contract Documents, orient receptacle to match configuration diagram in NEMA WD 6.
 - 4. Consult Architect for resolution of conflicting requirements.
- C. Identification:
 - 1. Identify cover or cover plate for device with panelboard identification and circuit number in accordance with Section 260553 "Identification for Electrical Systems."
 - a. Mark cover or cover plate using hot, stamped, or engraved machine printing with **black**-filled lettering, and provide durable wire markers or tags inside device box or outlet box.

3.4 INSTALLATION OF LOCKING RECEPTACLES

- A. Comply with manufacturer's instructions.
- B. Reference Standards:
 - 1. Unless more stringent requirements are specified in Contract Documents or manufacturers' instructions, comply with installation instructions in NECA NEIS 130.
 - 2. Mounting Heights: Unless otherwise indicated in Contract Documents, comply with mounting heights recommended in NECA NEIS 1.

3. Receptacle Orientation: Unless otherwise indicated in Contract Documents, orient receptacle to match configuration diagram in NEMA WD 6.
4. Consult Architect for resolution of conflicting requirements.

C. Identification:

1. Identify cover or cover plate for device with panelboard identification and circuit number in accordance with Section 260553 "Identification for Electrical Systems."
 - a. Mark cover or cover plate using hot, stamped, or engraved machine printing with **black**-filled lettering, and provide durable wire markers or tags inside device box or outlet box.

3.5 INSTALLATION OF CONNECTORS, CORDS, AND PLUGS

- A. Comply with manufacturer's instructions.
- B. Reference Standards:
 1. Consult Architect for resolution of conflicting requirements.

3.6 FIELD QUALITY CONTROL OF SWITCHES

- A. Tests and Inspections:
 1. Perform tests and inspections in accordance with manufacturers' instructions.
- B. Nonconforming Work:
 1. Unit will be considered defective if it does not pass tests and inspections.
 2. Remove and replace defective units and retest.
- C. Assemble and submit test and inspection reports.

3.7 FIELD QUALITY CONTROL OF STRAIGHT-BLADE RECEPTACLES

- A. Tests and Inspections:
 1. Insert and remove test plug to verify that device is securely mounted.
 2. Verify polarity of hot and neutral pins.
 3. Measure line voltage.
 4. Measure percent voltage drop.
 5. Measure grounding circuit continuity; impedance must be not greater than 2 ohms.
 6. Perform additional installation and maintenance inspections and diagnostic tests in accordance with NECA NEIS 130 and manufacturers' instructions.
- B. Nonconforming Work:
 1. Device will be considered defective if it does not pass tests and inspections.
 2. Remove and replace defective units and retest.
- C. Assemble and submit test and inspection reports.

3.8 FIELD QUALITY CONTROL OF LOCKING RECEPTACLES

- A. Tests and Inspections:
 1. Insert and remove test plug to verify that device is securely mounted.
 2. Verify polarity of hot and neutral pins.
 3. Measure line voltage.
 4. Measure percent voltage drop.
 5. Measure grounding circuit continuity; impedance must be not greater than 2 ohms.

6. Perform additional installation and maintenance inspections and diagnostic tests in accordance with NECA NEIS 130 and manufacturers' instructions.

B. Nonconforming Work:

1. Device will be considered defective if it does not pass tests and inspections.
2. Remove and replace defective units and retest.

C. Assemble and submit test and inspection reports.

3.9 FIELD QUALITY CONTROL OF CONNECTORS, CORDS, AND PLUGS

A. Tests and Inspections:

1. Perform tests and inspections indicated in manufacturer's instructions.

B. Nonconforming Work:

1. Unit will be considered defective if it does not pass tests and inspections.
2. Remove and replace defective units and retest.

C. Assemble and submit test and inspection reports.

3.10 PROTECTION

A. Devices:

1. Schedule and sequence installation to minimize risk of contamination of wires and cables, devices, device boxes, outlet boxes, covers, and cover plates by plaster, drywall joint compound, mortar, cement, concrete, dust, paint, and other materials.
2. After installation, protect wires and cables, devices, device boxes, outlet boxes, covers, and cover plates from construction activities. Remove and replace items that are contaminated, defaced, damaged, or otherwise caused to be unfit for use prior to acceptance by Owner.

B. Connectors, Cords, and Plugs:

1. After installation, protect connectors, cords, and plugs from construction activities. Remove and replace items that are contaminated, defaced, damaged, or otherwise caused to be unfit for use prior to acceptance by Owner.

END OF SECTION 26 2726

SECTION 26 4313 - SURGE PROTECTIVE DEVICES FOR LOW-VOLTAGE ELECTRICAL POWER CIRCUITS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes:
 - Type 2 surge protective devices.
 - Enclosures.
 - Conductors and cables.

1.2 DEFINITIONS

- B. Inominal: Nominal discharge current.
- C. MCOV: Maximum continuous operating voltage.
- D. Mode(s), also Modes of Protection: air of electrical connections where the VPR applies.
- E. MOV: Metal-oxide varistor; an electronic component with a significant non-ohmic current-voltage characteristic.
- F. NRTL: Nationally recognized testing laboratory.
- G. OCPD: Overcurrent protective device.
- H. SCCR: Short-circuit current rating.
- I. SPD: Surge protective device.
- J. Type 1 SPDs: Permanently connected SPDs intended for installation between the secondary of the service transformer and the line side of the service disconnect overcurrent device.
- K. Type 2 SPDs: Permanently connected SPDs intended for installation on the load side of the service disconnect overcurrent device, including SPDs located at the branch panel.
- L. Type 3 SPDs: Point of utilization SPDs.
- M. Type 4 SPDs: Component SPDs, including discrete components, as well as assemblies.
- N. Type 5 SPDs: Discrete component surge suppressors, such as MOVs that may be mounted on a printed wiring board, connected by its leads or provided within an enclosure with mounting means and wiring terminations.
- O. VPR: Voltage protection rating.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product.
 - Include electrical characteristics, specialties, and accessories for SPDs.
 - NRTL certification of compliance with UL 1449.
 - a. Tested values for VPRs.
 - b. Inominal ratings.
 - c. MCOV, type designations.
 - d. OCPD requirements.

- e. Manufacturer's model number.
- f. System voltage.
- g. Modes of protection.

1.3 INFORMATIONAL SUBMITTALS

- A. Field quality-control reports.
- B. Sample Warranty: For manufacturer's special warranty.

1.4 CLOSEOUT SUBMITTALS

- A. Maintenance Data: For SPDs to include in maintenance manuals.

1.5 WARRANTY

- A. Manufacturer's Warranty: Manufacturer agrees to repair or replace SPDs that fail in materials or workmanship within **10** years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 TYPE 2 SURGE PROTECTIVE DEVICES (SPDs)

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - ABB (Electrification Products Division).
 - Advanced Protection Technologies Inc. (APT).
 - ALLTEC.
 - Citel, Inc.
 - Eaton.
 - Leviton Manufacturing Co., Inc.
 - Liebert; a brand of Vertiv.
 - Mersen USA.
 - Schneider Electric USA, Inc.
 - Siemens Industry, Inc., Energy Management Division.
 - SSI, an ILSCO Company.
- B. Source Limitations: Obtain devices from single source from single manufacturer.
- C. Standards:
 - Listed and labeled by an NRTL acceptable to authorities having jurisdiction as complying with UL 1449, Type 2.
 - Comply with UL 1283.
- D. Product Options:
 - Include LED indicator lights for power and protection status.
 - Include internal thermal protection that disconnects the SPD before damaging internal suppressor components.
 - Include NEMA ICS 5, dry Form C contacts rated at **2 A and 24 V ac** for remote monitoring of protection status.
 - Include surge counter.
- E. Performance Criteria:

MCOV: Not less than 125 percent of nominal system voltage for 208Y/120 V and 120/240 V power systems, and not less than 115 percent of nominal system voltage for 480Y/277 V power systems.

Peak Surge Current Rating: Minimum single-pulse surge current withstand rating per phase must not be less than **100 kA**. Peak surge current rating must be arithmetic sum of the ratings of individual MOVs in a given mode.

Protection modes and UL 1449 VPR for grounded wye circuits with **480Y/277 V and 208Y/120 V**, three-phase, four-wire circuits must not exceed the following:

- a. Line to Neutral: 700 V for 208Y/120 V.
- b. Line to Ground: 700 V for 208Y/120 V.
- c. Neutral to Ground: 700 V for 208Y/120 V.
- d. Line to Line: 1200 V for 208Y/120 V.

SCCR: Equal or exceed **100 kA**.

Inominal Rating: **10 kA**.

2.2 TYPE 3, TYPE 4, AND TYPE 5 SURGE PROTECTIVE DEVICES (SPDs)

- A. Type 3, Type 4, and Type 5 SPDs are not approved for field installation.

2.3 ENCLOSURES

- A. Indoor Enclosures: NEMA 250, Type 1.

2.4 CONDUCTORS AND CABLES

- A. Power Wiring: Same size as SPD leads, complying with Section 26 0519 "Low-Voltage Electrical Power Conductors and Cables."

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Comply with NECA 1.
- B. Provide OCPD and disconnect for installation of SPD in accordance with UL 1449 and manufacturer's written instructions.
- C. Install leads between disconnects and SPDs short, straight, twisted, and in accordance with manufacturer's written instructions. Comply with wiring methods in Section 26 0519 "Low-Voltage Electrical Power Conductors and Cables."
 - Do not splice and extend SPD leads unless specifically permitted by manufacturer.
 - Do not exceed manufacturer's recommended lead length.
 - Do not bond neutral and ground.
- D. Use crimped connectors and splices only. Wire nuts are unacceptable.

3.2 FIELD QUALITY CONTROL

- A. Perform the following tests and inspections with the assistance of a factory-authorized service representative:
 - Compare equipment nameplate data for compliance with Drawings and the Specifications.
 - Inspect anchorage, alignment, grounding, and clearances.
 - Verify that electrical wiring installation complies with manufacturer's written installation requirements.

- B. SPDs that do not pass tests and inspections will be considered defective.
- C. Prepare test and inspection reports.

3.3 STARTUP SERVICE

- A. Complete startup checks in accordance with manufacturer's written instructions.
- B. Do not perform insulation-resistance tests of the distribution wiring equipment with SPDs installed. Disconnect SPDs before conducting insulation-resistance tests; reconnect them immediately after the testing is over.
- C. Energize SPDs after power system has been energized, stabilized, and tested.

3.4 DEMONSTRATION

- A. **Engage a factory-authorized service representative to train** Owner's maintenance personnel to operate and maintain SPDs.

END OF SECTION 26 4313

SECTION 26 5119 - LED INTERIOR LIGHTING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Downlight.
 - 2. Linear industrial.
 - 3. Recessed, linear.
 - 4. Strip light.
 - 5. Surface mount, linear.
 - 6. Surface mount, nonlinear.
 - 7. Suspended, linear.
 - 8. Suspended, nonlinear.
 - 9. Materials.
 - 10. Luminaire support.
- B. Related Requirements:
 - 1. Section 26 0923 "Lighting Control Devices" for automatic control of lighting, including time switches, photoelectric relays, occupancy sensors, and multipole lighting relays and contactors.

1.2 DEFINITIONS

- A. CCT: Correlated color temperature.
- B. CRI: Color Rendering Index.
- C. Fixture: See "Luminaire."
- D. IP: International Protection or Ingress Protection Rating.
- E. LED: Light-emitting diode.
- F. Lumen: Measured output of lamp and luminaire, or both.
- G. Luminaire: Complete lighting unit, including lamp, reflector, and housing.

1.3 ACTION SUBMITTALS:

- A. Product Data: For each type of product.
 - 1. Arrange in order of luminaire designation.
 - 2. Include data on features, accessories, and finishes.
 - 3. Include physical description and dimensions of luminaires.
 - 4. Include emergency lighting units, including batteries and chargers.
 - 5. Include life, output (lumens, CCT, and CRI), and energy-efficiency data.
 - 6. Photometric data and adjustment factors based on laboratory tests, complying with IES "Lighting Measurements Testing and Calculation Guides" for each luminaire type. The adjustment factors shall be for lamps and accessories identical to those indicated for the luminaire as applied in this Project.
 - a. Manufacturers' Certified Data: Photometric data certified by manufacturer's laboratory with a current accreditation under the National Voluntary Laboratory Accreditation Program for Energy Efficient Lighting Products.

- b. Testing Agency Certified Data: For indicated luminaires, photometric data certified by a qualified independent testing agency. Photometric data for remaining luminaires shall be certified by manufacturer.
 - B. Shop Drawings: For nonstandard or custom luminaires.
 - 1. Include plans, elevations, sections, and mounting and attachment details.
 - 2. Include details of luminaire assemblies. Indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
 - 3. Include diagrams for power, signal, and control wiring.
- 1.4 INFORMATIONAL SUBMITTALS
 - A. Qualification Data: For testing laboratory providing photometric data for luminaires.
 - B. Product Certificates: For each type of luminaire.
 - C. Product Test Reports: For each type of luminaire, for tests performed by manufacturer and witnessed by a qualified testing agency.
 - D. Sample warranty.
- 1.5 CLOSEOUT SUBMITTALS
 - A. Operation and Maintenance Data: For luminaires and lighting systems to include in operation and maintenance manuals.
 - 1. Provide a list of all lamp types used on Project; use ANSI and manufacturers' codes.
- 1.6 QUALITY ASSURANCE
 - A. Luminaire Photometric Data Testing Laboratory Qualifications:
 - 1. Luminaire manufacturer's laboratory that is accredited under the NVLAP for Energy Efficient Lighting Products.
 - 2. Provided by an independent agency, with the experience and capability to conduct the testing indicated, that is an NRTL as defined by OSHA in 29 CFR 1910.7, accredited under the NVLAP for Energy Efficient Lighting Products, and complying with the applicable IES testing standards.
 - B. Provide luminaires from a single manufacturer for each luminaire type.
 - C. Each luminaire type shall be binned within a three-step MacAdam Ellipse to ensure color consistency among luminaires.
- 1.7 DELIVERY, STORAGE, AND HANDLING
 - A. Protect finishes of exposed surfaces by applying a strippable, temporary protective covering before shipping.
- 1.8 WARRANTY
 - A. Warranty: Manufacturer and Installer agree to repair or replace components of luminaires that fail in materials or workmanship within specified warranty period.
 - B. Warranty Period: **Five** year(s) from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Ambient Temperature: **41 to 104 deg F.**
 - 1. Relative Humidity: Zero to 95 percent.
- B. Altitude: Sea level to **1000 feet.**

2.2 LUMINAIRE REQUIREMENTS

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Factory-Applied Labels: Comply with UL 1598. Include recommended lamps. Locate labels where they will be readily visible to service personnel, but not seen from normal viewing angles when lamps are in place.
 - 1. Label shall include the following lamp characteristics:
 - a. CCT and CRI.
- C. Recessed luminaires shall comply with NEMA LE 4.

2.3 DOWNLIGHT.

- A. Manufacturers: Provide basis of designed product as indicated on drawing. Substitutions may be made if pre-approval is received.

2.4 LINEAR INDUSTRIAL.

- A. Manufacturers: Provide basis of designed product as indicated on drawing. Substitutions may be made if pre-approval is received.

2.5 LOWBAY

- A. Manufacturers: Provide basis of designed product as indicated on drawing. Substitutions may be made if pre-approval is received.

2.6 RECESSED, LINEAR.

- A. Manufacturers: Provide basis of designed product as indicated on drawing. Substitutions may be made if pre-approval is received.

2.7 STRIP LIGHT.

- A. Manufacturers: Provide basis of designed product as indicated on drawing. Substitutions may be made if pre-approval is received.

2.8 SURFACE MOUNT, LINEAR.

- A. Manufacturers: Provide basis of designed product as indicated on drawing. Substitutions may be made if pre-approval is received.

2.9 SURFACE MOUNT, NONLINEAR

- A. Manufacturers: Provide basis of designed product as indicated on drawing. Substitutions may be made if pre-approval is received.

2.10 SUSPENDED, LINEAR

- A. Manufacturers: Provide basis of designed product as indicated on drawing. Substitutions may be made if pre-approval is received.
 - 1. UL Listing: Listed for damp location.

2.11 SUSPENDED, NONLINEAR

- A. Manufacturers: Provide basis of designed product as indicated on drawing. Substitutions may be made if pre-approval is received.

2.12 MATERIALS

- A. Metal Parts:
 - 1. Free of burrs and sharp corners and edges.
 - 2. Sheet metal components shall be steel unless otherwise indicated.
 - 3. Form and support to prevent warping and sagging.
- B. Steel:
 - 1. ASTM A36/A36M for carbon structural steel.
 - 2. ASTM A568/A568M for sheet steel.
- C. Stainless Steel:
 - 1. Manufacturer's standard grade.
 - 2. Manufacturer's standard type, ASTM A240/240M.
- D. Galvanized Steel: ASTM A653/A653M.
- E. Aluminum: ASTM B209.

2.13 METAL FINISHES

- A. Variations in finishes are unacceptable in the same piece. Variations in finishes of adjoining components are acceptable if they are within the range of approved Samples and if they can be and are assembled or installed to minimize contrast.

2.14 LUMINAIRE SUPPORT

- A. Comply with requirements in Section 260529 "Hangers and Supports for Electrical Systems" for channel and angle iron supports and nonmetallic channel and angle supports.
- B. Single-Stem Hangers: 1/2-inch steel tubing with swivel ball fittings and ceiling canopy. Finish same as luminaire.
- C. Wires: ASTM A641/A641M, Class 3, soft temper, zinc-coated steel, **12 gage**.
- D. Rod Hangers: 3/16-inch minimum diameter, cadmium-plated, threaded steel rod.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
- B. Examine roughing-in for luminaire to verify actual locations of luminaire and electrical connections before luminaire installation.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 TEMPORARY LIGHTING

- A. If approved by the Architect, use selected permanent luminaires for temporary lighting. When construction is sufficiently complete, clean luminaires used for temporary lighting.

3.3 INSTALLATION

- A. Comply with NECA 1.
- B. Install luminaires level, plumb, and square with ceilings and walls unless otherwise indicated.
- C. Supports:
 - 1. Sized and rated for luminaire weight.
 - 2. Able to maintain luminaire position after cleaning and relamping.
 - 3. Provide support for luminaire without causing deflection of ceiling or wall.
 - 4. Luminaire-mounting devices shall be capable of supporting a horizontal force of 100 percent of luminaire weight and a vertical force of 400 percent of luminaire weight.
- D. Flush-Mounted Luminaires:
 - 1. Secured to outlet box.
 - 2. Attached to ceiling structural members at four points equally spaced around circumference of luminaire.
 - 3. Trim ring flush with finished surface.
- E. Wall-Mounted Luminaires:
 - 1. Attached to structural members in walls .
 - 2. Do not attach luminaires directly to gypsum board.
- F. Suspended Luminaires:
 - 1. Ceiling Mount:
 - a. Two 5/32-inch diameter aircraft cable supports **adjustable to 10 feet in length**.
 - b. Hook mount.
 - 2. Pendants and Rods: Where longer than 48 inches, brace to limit swinging.
 - 3. Stem-Mounted, Single-Unit Luminaires: Suspend with twin-stem hangers. Support with approved outlet box and accessories that hold stem and provide damping of luminaire oscillations. Support outlet box vertically to building structure using approved devices.
 - 4. Continuous Rows of Luminaires: Use tubing or stem for wiring at one point and **tubing or rod** for suspension for each unit length of luminaire chassis, including one at each end.
 - 5. Do not use ceiling grid as support for pendant luminaires. Connect support wires or rods to building structure.
- G. Ceiling-Grid-Mounted Luminaires:
 - 1. Secure to any required outlet box.

2. Secure luminaire to the luminaire opening using approved fasteners in a minimum of four locations, spaced near corners of luminaire.
 3. Use approved devices and support components to connect luminaire to ceiling grid and building structure in a minimum of four locations, spaced near corners of luminaire.
- H. Comply with requirements in Section 26 0519 "Low-Voltage Electrical Power Conductors and Cables" for wiring connections.

3.4 IDENTIFICATION

- A. Identify system components, wiring, cabling, and terminals. Comply with requirements for identification specified in Section 26 0553 "Identification for Electrical Systems."

3.5 FIELD QUALITY CONTROL

- A. Perform the following tests and inspections:
1. Operational Test: After installing luminaires, switches, and accessories, and after electrical circuitry has been energized, test units to confirm proper operation.
 2. Test for Emergency Lighting: Interrupt power supply to demonstrate proper operation. Verify transfer from normal power to battery power and retransfer to normal.
- B. Luminaire will be considered defective if it does not pass operation tests and inspections.
- C. Prepare test and inspection reports.

END OF SECTION 26 5119

SECTION 26 5213 - EMERGENCY AND EXIT LIGHTING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Exit signs.
 - 2. Materials.
 - 3. Luminaire support components.

1.2 DEFINITIONS

- A. CCT: Correlated color temperature.
- B. CRI: Color Rendering Index.
- C. Emergency Lighting Unit: A lighting unit with internal or external emergency battery powered supply and the means for controlling and charging the battery and unit operation.
- D. Fixture: See "Luminaire" Paragraph.
- E. Lumen: Measured output of lamp and luminaire, or both.
- F. Luminaire: Complete lighting unit, including lamp, reflector, and housing.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of emergency lighting unit, exit sign, and emergency lighting support.
 - 1. Include data on features, accessories, and finishes.
 - 2. Include physical description of the unit and dimensions.
 - 3. Include life, output of luminaire (lumens, CCT, and CRI), and energy-efficiency data.
 - 4. Include photometric data and adjustment factors based on laboratory tests, complying with IES LM-45, for each luminaire type.
 - a. Testing Agency Certified Data: For indicated **signs**, photometric data certified by a qualified independent testing agency. Photometric data for remaining **signs** shall be certified by manufacturer.
 - b. Manufacturers' Certified Data: Photometric data certified by manufacturer's laboratory with a current accreditation under the National Voluntary Laboratory Accreditation Program for Energy Efficient Lighting Products.
- B. Shop Drawings: For nonstandard or custom luminaires.
 - 1. Include plans, elevations, sections, and mounting and attachment details.
 - 2. Include details of equipment assemblies. Indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
 - 3. Include diagrams for power, signal, and control wiring.
- C. Product Schedule:
 - 1. For exit signs. Use same designations indicated on Drawings.

1.4 INFORMATIONAL SUBMITTALS

- A. Qualification Data: For testing laboratory providing photometric data for luminaires.

- B. Product Certificates: For each type of luminaire.
- C. Sample Warranty: For manufacturer's **special** warranty.

1.5 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For luminaires and lighting systems to include in emergency, operation, and maintenance manuals.
 - 1. Provide a list of all lamp types used on Project; use ANSI and manufacturers' codes.

1.6 QUALITY ASSURANCE

- A. Luminaire Photometric Data Testing Laboratory Qualifications: **Luminaire manufacturer's laboratory** that is accredited under National Volunteer Laboratory Accreditation Program for Energy Efficient Lighting Products and complying with applicable IES testing standards.

1.7 DELIVERY, STORAGE, AND HANDLING

- A. Protect finishes of exposed surfaces by applying a strippable, temporary protective covering before shipping.

1.8 WARRANTY

- A. Warranty: Manufacturer and Installer agree to repair or replace components of luminaires that fail in materials or workmanship within specified warranty period.
 - 1. Warranty Period: **Two** year(s) from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 EXIT SIGNS

- A. General Requirements for Exit Signs: Comply with UL 924; for sign colors, visibility, luminance, and lettering size, comply with authorities having jurisdiction.
- B. Internally Lighted Signs:
 - 1. Manufacturers: Provide basis of designed product as indicated on drawing. Substitutions may be made if pre-approval is received.

2.2 MATERIALS

- A. Metal Parts:
 - 1. Free of burrs and sharp corners and edges.
 - 2. Sheet metal components shall be steel unless otherwise indicated.
 - 3. Form and support to prevent warping and sagging.
- B. Doors, Frames, and Other Internal Access:
 - 1. Smooth operating, free of light leakage under operating conditions.
 - 2. Designed to permit relamping without use of tools.
 - 3. Designed to prevent doors, frames, lenses, diffusers, and other components from falling accidentally during relamping and when secured in operating position.
- C. Conduit: Electrical metallic tubing, minimum 3/4 inch in diameter.

2.3 METAL FINISHES

- A. Appearance of Finished Work: Noticeable variations in same piece are not acceptable. Variations in appearance of adjoining components are acceptable if they are within the range of approved Samples and are assembled or installed to minimize contrast.

2.4 LUMINAIRE SUPPORT COMPONENTS

- A. Comply with requirements in Section 26 0529 "Hangers and Supports for Electrical Systems" for channel and angle iron supports and nonmetallic channel and angle supports.
- B. Support Wires: ASTM A641/A641M, Class 3, soft temper, zinc-coated steel, **12 gage**.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for conditions affecting performance of luminaires.
- B. Examine roughing-in for luminaire to verify actual locations of luminaire and electrical connections before luminaire installation.
- C. Examine walls, floors, roofs, and ceilings for suitable conditions where emergency lighting luminaires will be installed.
- D. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Comply with NECA 1.
- B. Install luminaires level, plumb, and square with ceilings and walls unless otherwise indicated.
- C. Ceiling Grid Mounted Luminaires:
 - 1. Secure to any required outlet box.
 - 2. Secure emergency power unit using approved fasteners in a minimum of four locations, spaced near corners of emergency power unit.
 - 3. Use approved devices and support components to connect luminaire to ceiling grid and building structure in a minimum of four locations, spaced near corners of luminaire.

3.3 IDENTIFICATION

- A. Identify system components, wiring, cabling, and terminals. Comply with requirements for identification specified in Section 26 0553 "Identification for Electrical Systems."

3.4 FIELD QUALITY CONTROL

- A. Perform the following tests and inspections:
 - 1. Test for Emergency Lighting: Interrupt power supply to demonstrate proper operation. Verify transfer from normal power to battery power and retransfer to normal. If power is supplied via inverter, instead of fixture built in battery, verify that inverter will transfer from normal power to batter power and retransfer to normal.
- B. Luminaire will be considered defective if it does not pass operation tests and inspections.

- C. Prepare test and inspection reports.

3.5 STARTUP SERVICE

- A. Perform startup service:
 - 1. Charge **emergency power units and batteries** minimum of one hour and depress switch to conduct short-duration test.

3.6 ADJUSTING

- A. Adjustments: Within **12** months of date of Substantial Completion, provide on-site visit to do the following:
 - 1. Inspect all luminaires. Replace lamps, **batteries, signs** that are defective.
 - a. Parts and supplies shall be manufacturer's authorized replacement parts and supplies.
 - 2. Conduct short-duration tests on all emergency lighting.

END OF SECTION 26 5213

SECTION 27 0528 - PATHWAYS FOR COMMUNICATIONS SYSTEMS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Metal conduits and fittings.
 - 2. Hooks.
 - 3. Boxes, enclosures, and cabinets.

1.3 DEFINITIONS

- A. GRC: Galvanized rigid conduit.
- B. IMC: Intermediate metal conduit.

1.4 ACTION SUBMITTALS

- A. Product data for the following:
 - 1. Wireways and fittings.
 - 2. Boxes, enclosures, and cabinets.

PART 2 - PRODUCTS

2.1 METAL CONDUITS AND FITTINGS

- A. Description: Metal raceway of circular cross section with manufacturer-fabricated fittings.
- B. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1. AFC Cable Systems; a part of Atkore International.
 - 2. Allied Tube & Conduit; a part of Atkore International.
 - 3. Alpha Wire.
 - 4. Anamet Electrical, Inc.
 - 5. Electri-Flex Company.
 - 6. O-Z/Gedney; a brand of Emerson Industrial Automation.
 - 7. Picoma Industries, Inc.
 - 8. Plasti-Bond.
 - 9. Republic Conduit.
 - 10. Southwire Company.
 - 11. Thomas & Betts Corporation; A Member of the ABB Group.
 - 12. Western Tube and Conduit Corporation.
 - 13. Wheatland Tube Company.
- C. General Requirements for Metal Conduits and Fittings:
 - 1. Listed and labeled as defined in NFPA 70, by a nationally recognized testing laboratory, and marked for intended location and application.
 - 2. Comply with TIA-569-D.

- D. GRC: Comply with ANSI C80.1 and UL 6.
- E. IMC: Comply with ANSI C80.6 and UL 1242.
- F. EMT: Comply with ANSI C80.3 and UL 797.
- G. Fittings for Metal Conduit: Comply with NEMA FB 1 and UL 514B.
 - 1. Fittings for EMT:
 - a. Material: Steel.
 - b. Type: Compression.
 - 2. Expansion Fittings: Steel, complying with UL-467, rated for environmental conditions where installed, and including flexible external bonding jumper.
- H. Joint Compound for IMC or GRC: Approved, as defined in NFPA 70, by authorities having jurisdiction for use in conduit assemblies, and compounded for use to lubricate and protect threaded conduit joints from corrosion and to enhance their conductivity.

2.2 HOOKS

- A. Description: Prefabricated sheet metal cable supports for telecommunications cable.
- B. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1. MonoSystems, Inc.
 - 2. Panduit Corp.
 - 3. Wiremold / Legrand.
- C. Listed and labeled as defined in NFPA 70, by an NRTL, and marked for intended location and application.
- D. Comply with TIA-569-D.
- E. Galvanized steel.
- F. J shape.

2.3 BOXES, ENCLOSURES, AND CABINETS

- A. Description: Enclosures for communications.
- B. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1. Adalet.
 - 2. Carlson; a brand of Thomas & Betts Corporation.
 - 3. Crouse-Hinds, an Eaton business.
 - 4. EGS/Appleton Electric.
 - 5. Erickson Electrical Equipment Company.
 - 6. FSR Inc.
 - 7. Hoffman; a brand of Pentair Equipment Protection.
 - 8. Milbank Manufacturing Co.
 - 9. Molex Industrial Products Group; Woodhead Brand.
 - 10. MonoSystems, Inc.
 - 11. Oldcastle Enclosure Solutions.
 - 12. O-Z/Gedney; a brand of Emerson Industrial Automation.
 - 13. Plasti-Bond.

14. [Quazite: Hubbell Power Systems, Inc.](#)
 15. [RACO; Hubbell.](#)
 16. [Spring City Electrical Manufacturing Company.](#)
 17. [Stahlin Non-Metallic Enclosures.](#)
 18. [Thomas & Betts Corporation; A Member of the ABB Group.](#)
 19. [Wiremold / Legrand.](#)
- C. General Requirements for Boxes, Enclosures, and Cabinets:
1. Comply with TIA-569-D.
 2. Boxes, enclosures, and cabinets installed in wet locations shall be listed and labeled as defined in NFPA 70, by an NRTL, and marked for use in wet locations.
 3. Box extensions used to accommodate new building finishes shall be of same material as recessed box.
 4. Device Box Dimensions: 4-11/16 inches square by 2-1/2 inches deep.
 5. Gangable boxes are prohibited.
- D. Sheet Metal Outlet and Device Boxes: Comply with NEMA OS 1 and UL 514A.
- E. Cast-Metal Outlet and Device Boxes: Comply with NEMA FB 1, aluminum, Type FD, with gasketed cover.
- F. Metal Floor Boxes:
1. Material: Sheet metal.
 2. Type: Fully adjustable.
 3. Shape: Rectangular.
 4. Metal floor boxes shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- G. Small Sheet Metal Pull and Junction Boxes: NEMA OS 1.

PART 3 - EXECUTION

3.1 PATHWAY APPLICATION

- A. Indoors: Apply pathway products as specified below unless otherwise indicated:
1. Exposed, Not Subject to Physical Damage: EMT.
 2. Exposed, Not Subject to Severe Physical Damage: EMT.
 3. Exposed and Subject to Severe Physical Damage: GRC or IMC. Pathway locations include the following:
 - a. Loading dock.
 - b. Corridors used for traffic of mechanized carts, forklifts, and pallet-handling units.
 - c. Mechanical rooms.
 4. Concealed in Ceilings and Interior Walls and Partitions: EMT.
 5. Damp or Wet Locations: GRC or IMC.
 6. Pathways for Optical-Fiber or Communications Cable in Spaces Used for Environmental Air: EMT.
 7. Pathways for Concealed General-Purpose Distribution of Optical-Fiber or Communications Cable: EMT.
 8. Boxes and Enclosures: NEMA 250, Type 1, except use NEMA 250, Type 4 stainless steel units in institutional and commercial kitchens and damp or wet locations.
- B. Minimum Pathway Size: 1-inch trade size for copper and aluminum cables, and 1 inch for optical-fiber cables.
- C. Pathway Fittings: Compatible with pathways and suitable for use and location.

1. Rigid and Intermediate Steel Conduit: Use threaded rigid steel conduit fittings unless otherwise indicated. Comply with NEMA FB 2.10.
 2. EMT: Use compression fittings. Comply with NEMA FB 2.10.
- D. Do not install aluminum conduits, boxes, or fittings.
- E. Do not install nonmetallic conduit.

3.2 INSTALLATION

- A. Comply with the following standards for installation requirements except where requirements on Drawings or in this Section are stricter:
1. NECA 1.
 2. NECA/BICSI 568.
 3. TIA-569-D.
 4. NECA 101
 5. NECA 111.
- B. Comply with NFPA 70 limitations for types of pathways allowed in specific occupancies and number of floors.
- C. Comply with requirements in Section 078400 "Firestopping" for firestopping materials and installation for penetrations through fire-rated walls, ceilings, and assemblies.
- D. Comply with requirements in Section 260529 "Hangers and Supports for Electrical Systems" for hangers and supports.
- E. Comply with requirements in Section 260544 "Sleeves and Sleeve Seals for Electrical Raceways and Cabling" for sleeves and sleeve seals for communications.
- F. Keep pathways at least 6 inches away from parallel runs of flues and steam or hot-water pipes. Install horizontal pathway runs above water and steam piping.
- G. Complete pathway installation before starting conductor installation.
- H. Arrange stub-ups so curved portions of bends are not visible above finished slab.
- I. Install no more than the equivalent of two 90-degree bends in any pathway run. Support within 12 inches of changes in direction. Utilize long radius ells for all optical-fiber cables.
- J. Conceal rigid conduit and EMT within finished walls, ceilings, and floors unless otherwise indicated. Install conduits parallel or perpendicular to building lines.
- K. Support conduit within 12 inches of enclosures to which attached.
- L. Stub-ups to Above Recessed Ceilings:
1. Use EMT, IMC, or RMC for pathways.
 2. Use a conduit bushing or insulated fitting to terminate stub-ups not terminated in hubs or in an enclosure.
- M. Threaded Conduit Joints, Exposed to Wet, Damp, Corrosive, or Outdoor Conditions: Apply listed compound to threads of pathway and fittings before making up joints. Follow compound manufacturer's written instructions.

- N. Terminate threaded conduits into threaded hubs or with locknuts on inside and outside of boxes or cabinets. Install insulated bushings on conduits terminated with locknuts.
- O. Install pathways square to the enclosure and terminate at enclosures with locknuts. Install locknuts hand tight plus one additional quarter-turn.
- P. Do not rely on locknuts to penetrate nonconductive coatings on enclosures. Remove coatings in the locknut area prior to assembling conduit to enclosure, to assure a continuous ground path.
- Q. Cut conduit perpendicular to the length. For conduits of 2-inch trade size and larger, use roll cutter or a guide to ensure cut is straight and perpendicular to the length.
- R. Install pull wires in empty pathways. Use polypropylene or monofilament plastic line with not less than 200-lb tensile strength. Leave at least 12 inches of slack at each end of pull wire. Secure pull wire, so it cannot fall into conduit. Cap pathways designated as spare alongside pathways in use.
- S. Install pathway-sealing fittings at accessible locations according to NFPA 70 and fill them with listed sealing compound. For concealed pathways, install each fitting in a flush steel box with a blank cover plate having a finish similar to that of adjacent plates or surfaces. Install pathway-sealing fittings according to NFPA 70.
- T. Install devices to seal pathway interiors at accessible locations. Locate seals, so no fittings or boxes are between the seal and the following changes of environments. Seal the interior of all pathways at the following points:
 - 1. Where conduits pass from warm to cold locations, such as boundaries of refrigerated spaces.
 - 2. Where an underground service pathway enters a building or structure.
 - 3. Where otherwise required by NFPA 70.
- U. Hooks:
 - 1. Size to allow a minimum of 25 percent future capacity without exceeding design capacity limits.
 - 2. Shall be supported by dedicated support wires. Do not use ceiling grid support wire or support rods.
 - 3. Hook spacing shall allow no more than 6 inches of slack. The lowest point of the cables shall be no less than 6 inches adjacent to ceilings, mechanical ductwork and fittings, luminaires, power conduits, power and telecommunications outlets, and other electrical and communications equipment.
 - 4. Space hooks no more than 5 feet o.c.
 - 5. Provide a hook at each change in direction.
- V. Mount boxes at heights indicated on Drawings. If mounting heights of boxes are not individually indicated, give priority to ADA requirements. Install boxes with height measured to bottom of box unless otherwise indicated.
- W. Recessed Boxes in Masonry Walls: Saw-cut opening for box in center of cell of masonry block and install box flush with surface of wall. Prepare block surface to provide a flat surface for a raintight connection between box and cover plate or supported equipment and box.
- X. Horizontally separate boxes mounted on opposite sides of walls, so they are not in the same vertical channel.
- Y. Support boxes of three gangs or more from more than one side by spanning two framing members or mounting on brackets specifically designed for the purpose.

- Z. Fasten junction and pull boxes to or support from building structure. Do not support boxes by conduits.

- AA. Set metal floor boxes level and flush with finished floor surface.

3.3 SLEEVE AND SLEEVE-SEAL INSTALLATION FOR COMMUNICATIONS PENETRATIONS

- A. Install sleeves and sleeve seals at penetrations of exterior floor and wall assemblies. Comply with requirements in Section 260544 "Sleeves and Sleeve Seals for Electrical Raceways and Cabling."

3.4 FIRESTOPPING

- A. Install firestopping at penetrations of fire-rated floor and wall assemblies. Comply with requirements in Section 078400 "Firestopping."

3.5 PROTECTION

- A. Protect coatings, finishes, and cabinets from damage or deterioration.
 - 1. Repair damage to galvanized finishes with zinc-rich paint recommended by manufacturer.
 - 2. Repair damage to paint finishes with matching touchup coating recommended by manufacturer.

END OF SECTION 27 0528

SECTION 27 1513 - COMMUNICATIONS COPPER HORIZONTAL CABLING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Category 6 twisted pair cable.
 - 2. Twisted pair cable hardware, including plugs and jacks.
 - 3. Cabling identification products.
 - 4. Grounding provisions for twisted pair cable.
 - 5. Source quality control requirements for twisted pair cable.

1.3 DEFINITIONS

- A. Cross-Connect: A facility enabling the termination of cable elements and their interconnection or cross-connection.
- B. EMI: Electromagnetic interference.
- C. FTP: Shielded twisted pair.
- D. F/FTP: Overall foil screened cable with foil screened twisted pair.
- E. F/UTP: Overall foil screened cable with unscreened twisted pair.
- F. IDC: Insulation displacement connector.
- G. LAN: Local area network.
- H. Jack: Also commonly called an "outlet," it is the fixed, female connector.
- I. Plug: Also commonly called a "connector," it is the removable, male telecommunications connector.
- J. RCDD: Registered Communications Distribution Designer.
- K. Screen: A metallic layer, either a foil or braid, placed around a pair or group of conductors.
- L. Shield: A metallic layer, either a foil or braid, placed around a pair or group of conductors.
- M. S/FTP: Overall braid screened cable with foil screened twisted pair.
- N. S/UTP: Overall braid screened cable with unscreened twisted pairs.
- O. UTP: Unscreened (unshielded) twisted pair.

1.4 COPPER HORIZONTAL CABLING DESCRIPTION

- A. Horizontal cable cabling system shall provide interconnections between Distributor A, Distributor B, or Distributor C, and the equipment outlet, otherwise known as "Cabling Subsystem 1," in the telecommunications cabling system structure. Cabling system consists of horizontal cables, intermediate and main cross-connects, mechanical terminations, and patch cords or jumpers used for horizontal-to-horizontal cross-connection.
 - 1. TIA-568-C.1 requires that a minimum of two equipment outlets be installed for each work area.
 - 2. Horizontal cabling shall contain no more than one transition point or consolidation point between the horizontal cross-connect and the telecommunications equipment outlet.
 - 3. Bridged taps and splices shall not be installed in the horizontal cabling.
- B. A work area is approximately 100 sq. ft. and includes the components that extend from the equipment outlets to the station equipment.
- C. The maximum allowable horizontal cable length is 295 feet. This maximum allowable length does not include an allowance for the length of 16 feet to the workstation equipment or in the horizontal cross-connect.

1.5 ACTION SUBMITTALS

- A. Product Data: For each type of product.
- B. Shop Drawings:
 - 1. System Labeling Schedules: Electronic copy of labeling schedules, in software and format as indicated by ANSI/TIA-606-b, Administration Standard for Commercial Telecommunication Infrastructure.
- C. Twisted pair cable testing plan.

1.6 INFORMATIONAL SUBMITTALS

- A. Qualification Data: For Installer, installation supervisor, and field inspector.
- B. Product Certificates: For each type of product.
- C. Source quality-control reports.
- D. Field quality-control reports.

1.7 QUALITY ASSURANCE

- A. Installer Qualifications: Cabling Installer must have personnel certified by BICSI on staff.
 - 1. Layout Responsibility: Preparation of Shop Drawings, cabling administration Drawings, and field testing program development by an RCDD.
 - 2. Installation Supervision: Installation shall be under the direct supervision of Technician, who shall be present at all times when Work of this Section is performed at Project site.
 - 3. Testing Supervisor: Currently certified by BICSI as an RCDD to supervise on-site testing.
- B. Testing Agency Qualifications: Testing agency must have personnel certified by BICSI on staff.
 - 1. Testing Agency's Field Supervisor: Currently certified by BICSI as an RCDD.

1.8 DELIVERY, STORAGE, AND HANDLING

- A. Test cables upon receipt at Project site.
 - 1. Test each pair of twisted pair cable for open and short circuits.

1.9 PROJECT CONDITIONS

- A. Environmental Limitations: Do not deliver or install cables and connecting materials until wet work in spaces is complete and dry, and temporary HVAC system is operating and maintaining ambient temperature and humidity conditions at occupancy levels during the remainder of the construction period.

1.10 COORDINATION

- A. Coordinate layout and installation of telecommunications pathways and cabling with Owner's telecommunications and LAN equipment and service suppliers.
- B. Coordinate telecommunications outlet/connector locations with location of power receptacles at each work area.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. General Performance: Horizontal cabling system shall comply with transmission standards in TIA-568-C.1, when tested according to test procedures of this standard.
- B. Telecommunications Pathways and Spaces: Comply with TIA-569-D.
- C. Grounding: Comply with TIA-607-B.

2.2 GENERAL CABLE CHARACTERISTICS

- A. Listed and labeled by an NRTL acceptable to authorities having jurisdiction as complying with the applicable standard and NFPA 70 for the following types:
 - 1. Communications Plenum Rated: Type CMP complying with UL 1685.
- B. Surface-Burning Characteristics: Comply with ASTM E84; testing by a qualified testing agency. Identify products with appropriate markings of applicable testing agency.
 - 1. Flame-Spread Index: 25 or less.
 - 2. Smoke-Developed Index: 50 or less.
- C. RoHS compliant.

2.3 CATEGORY 6 TWISTED PAIR CABLE

- A. Description: Four-pair, balanced-twisted pair cable, certified to meet transmission characteristics of Category 6 cable at frequencies up to 250MHz.
- B. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1. 3M.
 - 2. AMP NETCONNECT; a TE Connectivity Ltd. company.
 - 3. Belden CDT Networking Division/NORDX.
 - 4. Berk-Tek Leviton; a Nexans/Leviton alliance.

5. [CommScope, Inc.](#)
6. [Draka USA.](#)
7. [General Cable; General Cable Corporation.](#)
8. [Genesis Cable Products; Honeywell International, Inc.](#)
9. [Hitachi Cable America Inc.](#)
10. [Mohawk; a division of Belden Networking, Inc.](#)
11. [Superior Essex Inc.](#)
12. [SYSTIMAX Solutions; a CommScope Inc. brand.](#)

- C. Standard: Comply with NEMA WC 66/ICEA S-116-732 and TIA-568-C.2 for Category 6 cables.
- D. Conductors: 100-ohm, 23 AWG solid copper.
- E. Cable Rating: Plenum.
- F. Jacket: Blue thermoplastic.

2.4 TWISTED PAIR CABLE HARDWARE

- A. Plugs and Plug Assemblies:
 1. Male; eight position; color-coded modular telecommunications connector designed for termination of a single four-pair, 100-ohm, unshielded or shielded twisted pair cable.
 2. Standard: Comply with TIA-568-C.2.
 3. Marked to indicate transmission performance.
- B. Jacks and Jack Assemblies:
 1. Female; eight position; modular; fixed telecommunications connector designed for termination of a single four-pair, 100-ohm, unshielded or shielded twisted pair cable.
 2. Designed to snap-in to a patch panel or faceplate.
 3. Standard: Comply with TIA-568-C.2.
 4. Marked to indicate transmission performance.
- C. Faceplate:
 1. Two port, vertical single gang faceplates designed to mount to single gang wall boxes.
 2. Plastic Faceplate: High-impact plastic. Coordinate color with Section 262726 "Wiring Devices."
 3. Metal Faceplate: Stainless steel, complying with requirements in Section 262726 "Wiring Devices."
 4. For use with snap-in jacks accommodating any combination of twisted pair, optical fiber, and coaxial work area cords.
 - a. Flush mounting jacks, positioning the cord at a 45-degree angle.
- D. Legend:
 1. Machine printed, in the field, using adhesive-tape label.
 2. Snap-in, clear-label covers and machine-printed paper inserts.

2.5 IDENTIFICATION PRODUCTS

- A. Comply with TIA-606-B and UL 969 for a system of labeling materials, including label stocks, laminating adhesives, and inks used by label printers.

2.6 GROUNDING

- A. Comply with requirements in Section 260526 "Grounding and Bonding for Electrical Systems" for grounding conductors and connectors.

- B. Comply with TIA-607-B.

2.7 SOURCE QUALITY CONTROL

- A. Testing Agency: Engage a qualified testing agency to evaluate cables.
- B. Factory test cables on reels according to TIA-568-C.1.
- C. Factory test twisted pair cables according to TIA-568-C.2.
- D. Cable will be considered defective if it does not pass tests and inspections.
- E. Prepare test and inspection reports.

PART 3 - EXECUTION

3.1 WIRING METHODS

- A. Wiring Method: Install cables in raceways and cable trays, except within consoles, cabinets, desks, and counters. Conceal raceway and cables, except in unfinished spaces.
 - 1. Install plenum cable in environmental air spaces, including plenum ceilings.
 - 2. Comply with requirements for raceways and boxes specified in Section 270528 "Pathways for Communications Systems."
- B. Wiring Method: Conceal conductors and cables in accessible ceilings, walls, and floors where possible.
- C. Wiring within Enclosures: Bundle, lace, and train cables within enclosures. Connect to terminal points with no excess and without exceeding manufacturer's limitations on bending radii. Provide and use lacing bars and distribution spools. Install conductors parallel with or at right angles to sides and back of enclosure.

3.2 INSTALLATION OF PATHWAYS

- A. Comply with Section 270528 "Pathways for Communications Systems."
- B. Comply with Section 260529 "Hangers and Supports for Electrical Systems."
- C. Drawings indicate general arrangement of pathways and fittings.

3.3 INSTALLATION OF TWISTED-PAIR HORIZONTAL CABLES

- A. Comply with NECA 1 and NECA/BICSI 568.
- B. General Requirements for Cabling:
 - 1. Comply with TIA-568-C.0, TIA-568-C.1, and TIA-568-C.2.
 - 2. Comply with BICSI's "Information Transport Systems Installation Methods Manual (ITSIMM), Ch. 5, "Copper Structured Cabling Systems," "Cable Termination Practices" Section.
 - 3. Install 110-style IDC termination hardware unless otherwise indicated.
 - 4. Do not untwist twisted pair cables more than 1/2 inch from the point of termination to maintain cable geometry.
 - 5. Terminate all conductors; no cable shall contain unterminated elements. Make terminations only at indicated outlets, terminals, cross-connects, and patch panels.

6. Consolidation points may be used only for making a direct connection to equipment outlets:
 - a. Do not use consolidation point as a cross-connect point, as a patch connection, or for direct connection to workstation equipment.
 - b. Locate consolidation points for twisted-pair cables at least 49 feet from communications equipment room.
 7. Cables may not be spliced. Secure and support cables at intervals not exceeding 30 inches and not more than 6 inches from cabinets, boxes, fittings, outlets, racks, frames, and terminals.
 8. Install lacing bars to restrain cables, prevent straining connections, and prevent bending cables to smaller radii than minimums recommended by manufacturer.
 9. Bundle, lace, and train conductors to terminal points without exceeding manufacturer's limitations on bending radii, but not less than radii specified in BICSI Information Transport Systems Installation Methods Manual, Ch. 5, "Copper Structured Cabling Systems," "Cable Termination Practices" Section. Use lacing bars and distribution spools.
 10. Do not install bruised, kinked, scored, deformed, or abraded cable. Do not splice cable between termination, tap, or junction points. Remove and discard cable if damaged during installation and replace it with new cable.
 11. Cold-Weather Installation: Bring cable to room temperature before dereeling. Heat lamps shall not be used for heating.
 12. In the communications equipment room, install a 10-foot- long service loop on each end of cable.
 13. Pulling Cable: Comply with BICSI Information Transport Systems Installation Methods Manual, Ch. 5, "Copper Structured Cabling Systems," "Pulling and Installing Cable" Section. Monitor cable pull tensions.
- C. Open-Cable Installation:
1. Install cabling with horizontal and vertical cable guides in telecommunications spaces with terminating hardware and interconnection equipment.
 2. Suspend twisted pair cabling, not in a wireway or pathway, a minimum of 8 inches above ceilings by cable supports not more than 60 inches apart.
 3. Cable shall not be run through structural members or in contact with pipes, ducts, or other potentially damaging items.
- D. Group connecting hardware for cables into separate logical fields.
- E. Separation from EMI Sources:
1. Comply with recommendations from BICSI's "Telecommunications Distribution Methods Manual" and TIA-569-D for separating unshielded copper communication cable from potential EMI sources, including electrical power lines and equipment.
 2. Separation between open communications cables or cables in nonmetallic raceways and unshielded power conductors and electrical equipment shall be as follows:
 - a. Electrical Equipment Rating Less Than 2 kVA: A minimum of 5 inches.
 - b. Electrical Equipment Rating between 2 and 5 kVA: A minimum of 12 inches.
 - c. Electrical Equipment Rating More Than 5 kVA: A minimum of 24 inches.
 3. Separation between communications cables in grounded metallic raceways and unshielded power lines or electrical equipment shall be as follows:
 - a. Electrical Equipment Rating Less Than 2 kVA: A minimum of 2-1/2 inches.
 - b. Electrical Equipment Rating between 2 and 5 kVA: A minimum of 6 inches.
 - c. Electrical Equipment Rating More Than 5 kVA: A minimum of 12 inches.
 4. Separation between communications cables in grounded metallic raceways, power lines, and electrical equipment located in grounded metallic conduits or enclosures shall be as follows:
 - a. Electrical Equipment Rating Less Than 2 kVA: No requirement.
 - b. Electrical Equipment Rating between 2 and 5 kVA: A minimum of 3 inches.
 - c. Electrical Equipment Rating More Than 5 kVA: A minimum of 6 inches.

5. Separation between Communications Cables and Electrical Motors and Transformers, 5 kVA or HP and Larger: A minimum of 48 inches.
6. Separation between Communications Cables and Fluorescent Fixtures: A minimum of 5 inches.

3.4 FIRESTOPPING

- A. Comply with requirements in Section 0784 "Firestopping."
- B. Comply with TIA-569-D, Annex A, "Firestopping."
- C. Comply with "Firestopping Systems" Article in BICSI's "Telecommunications Distribution Methods Manual."

3.5 GROUNDING

- A. Install grounding according to the "Grounding, Bonding, and Electrical Protection" chapter in BICSI's "Telecommunications Distribution Methods Manual."
- B. Comply with TIA-607-B and NECA/BICSI-607.

3.6 IDENTIFICATION

- A. Identify system components, wiring, and cabling complying with TIA-606-B. Comply with requirements for identification specified in Section 260553 "Identification for Electrical Systems."
 1. Administration Class: Class 3.
 2. Color-code cross-connect fields and apply colors to voice and data service backboards, connections, covers, and labels.
- B. Paint and label colors for equipment identification shall comply with TIA-606-B for Class 3 level of administration.
- C. Cable and Wire Identification:
 1. Label each cable within 4 inches of each termination and tap, where it is accessible in a cabinet or junction or outlet box, and elsewhere as indicated.
 2. Each wire connected to building-mounted devices is not required to be numbered at the device if wire color is consistent with associated wire connected and numbered within panel or cabinet.
 3. Exposed Cables and Cables in Cable Trays and Wire Troughs: Label each cable at intervals not exceeding 15 feet.
 4. Label each terminal strip, and screw terminal in each cabinet, rack, or panel.
 - a. Individually number wiring conductors connected to terminal strips, and identify each cable or wiring group, extended from a panel or cabinet to a building-mounted device, with the name and number of a particular device.
 - b. Label each unit and field within distribution racks and frames.
 5. Identification within Connector Fields in Equipment Rooms and Wiring Closets: Label each connector and each discrete unit of cable-terminating and -connecting hardware. Where similar jacks and plugs are used for both voice and data communication cabling, use a different color for jacks and plugs of each service.
 6. Color-Coding: Provide color-coded UTP cables for various systems as follows:
 - a. Voice: Gray.
 - b. Data: Blue.
 - c. Fire Alarm: Red.
 - d. Lighting Control: Violet.
 - e. Access Control: White

f. CATV/CCTV: Black.

- D. Labels shall be preprinted or computer-printed type, with a printing area and font color that contrast with cable jacket color but still comply with TIA-606-B requirements for the following:
1. Cables use flexible vinyl or polyester that flexes as cables are bent.

3.7 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Tests and Inspections:
1. Visually inspect jacket materials for NRTL certification markings. Inspect cabling terminations in communications equipment rooms for compliance with color-coding for pin assignments, and inspect cabling connections for compliance with TIA-568-C.1.
 2. Visually inspect cable placement, cable termination, grounding and bonding, equipment and patch cords, and labeling of all components.
 3. Test twisted pair cabling for DC loop resistance, shorts, opens, intermittent faults, and polarity between conductors. Test operation of shorting bars in connection blocks. Test cables after termination but not cross-connection.
 - a. Test instruments shall meet or exceed applicable requirements in TIA-568-C.2. Perform tests with a tester that complies with performance requirements in "Test Instruments (Normative)" Annex, complying with measurement accuracy specified in "Measurement Accuracy (Informative)" Annex. Use only test cords and adapters that are qualified by test equipment manufacturer for channel or link test configuration.
- C. Data for each measurement shall be documented. Data for submittals shall be printed in a summary report that is formatted similarly to Table 10.1 in BICSI's "Telecommunications Distribution Methods Manual," or shall be transferred from the instrument to the computer, saved as text files, printed, and submitted.
- D. Remove and replace cabling where test results indicate that they do not comply with specified requirements.
- E. End-to-end cabling will be considered defective if it does not pass tests and inspections.
- F. Prepare test and inspection reports.

END OF SECTION 27 1513

SECTION 28 3111
FIRE ALARM SYSTEM, VOICE EVACUATION TYPE

PART 1 - GENERAL

1.1 SUMMARY

- A. This specification section includes the requirements for the qualifications, submittals, products, installation, and testing of the new fire alarm system to be provided throughout the renovated Student Union located in Goodwell, OK.
- B. Contractor must provide a complete, compliant, and functional fire alarm system.
- C. The scope of this specification includes all fire alarm system components, wiring, devices, and accessories.

1.2 RELATED DOCUMENTS

- A. Drawings and general provisions of the contract, including general and supplementary conditions and Division 1 General Requirements Specification Sections, apply to this Section.
- B. All electrical work referenced in this specification must also comply with Division 26 Electrical Specification Sections.

1.3 CONFLICT RESOLUTION

- A. If conflict occurs between these specifications and the drawings or other specification sections, the Contractor must immediately notify the Engineer.
- B. For conflicts of differing specificity, the more specific criteria are applicable.
- C. For conflicts of the same specificity, the more restrictive criteria are applicable.
- D. For conflicts involving the OSU EH&S Standards, the AHJ will determine ruling criteria. The Engineer has made good faith effort to include all relevant requirements from the OSU EH&S Standards into these specifications and the associated plans.

1.4 DEFINITIONS

- A. Contractor: The company, appropriately licensed by the Oklahoma Department of Labor in accordance with the Alarm and Locksmith Industry Act, which is contracted to perform the fire alarm system scope of work for this project.
- B. Technician: The individual, appropriately licensed by the Oklahoma Department of Labor in accordance with the Alarm and Locksmith Industry Act, who has obtained NICET III or IV Certification in Fire Alarm Systems, who is an employee of the Contractor. This individual may be the "Manager" or a "Technician" as defined by the Alarm and Locksmith Industry Act.
- C. Engineer: The Oklahoma-licensed engineering firm which developed the fire alarm specifications and drawings for this project, Rated Engineering PLLC.
- D. AHJ: The Authority Having Jurisdiction ("AHJ") as defined by NFPA. The AHJ for this project are:
 - 1. Oklahoma State University Fire Marshal

1.5 APPLICABLE CODES AND STANDARDS

- A. Addressable Fire Alarm System Standard, Oklahoma State University Environmental Health & Safety, October 2018
- B. International Fire Code, 2018 edition, with OUBCC Amendments
- C. NFPA 72 National Fire Alarm and Signaling Code, 2016
- D. NFPA 70 National Electrical Code, 2017

1.6 QUALIFICATIONS

- A. The contractor shall be a stocking distributor of all fire alarm system equipment included in the system to allow for immediate replacement of parts.

- B. The contractor shall provide on-call service 24 hours per day, 7 days per week. Service personnel shall be available at any time for emergency service.
- C. The Contractor must have been actively engaged in projects with the characteristics listed below for a period of not less than 10 years preceding bid date:
 - 1. Contractor's scope included the design, installation, and testing of the fire alarm system.
 - 2. Fire alarm system was the In-Building Fire Emergency Voice/Alarm Communications System type, as defined by NFPA 72.
 - 3. Building(s) included high quality interior finishes.
 - 4. Projects located within 90 miles of this project.
- D. The Contractor must have been in full compliance with the Oklahoma Alarm and Locksmith Industry Act for at least the continuous ten-year period preceding submission of bid on this project.
- E. The Contractor and Technician must not have been fined by the Oklahoma Department of Labor for any violation of the Alarm and Locksmith Industry Act within the three years preceding submission of bid on this project.
- F. The Technician must have obtained NICET III or IV Certification in Fire Alarm Systems and must maintain this degree of certification throughout the course of the project.

1.7 QUALITY CONTROL

- A. Design and Submittals
 - 1. The Technician must review and approve each submittal prior to its submittal.
- B. Construction and Testing
 - 1. The Contractor must ensure compliance with the Alarm and Locksmith Industry Act rules regarding the experience, qualifications, testing, licensing, and supervision of staff performing the fire alarm system installation. Any representative of the Owner may request confirmation of compliance with these rules at any time.
- C. Construction Observation by Owner's Representatives
 - 1. The Owner may perform additional construction observations at any time.
- D. Contractor Tests
 - 1. Prior to requesting the Pre-AHJ Testing, the Contractor must inspect and test their system for compliance with the contract and code requirements.
- E. Pre-AHJ Tests
 - 1. Upon successful completion of the Contractor Testing, the Contractor must invite the Engineer to witness the final acceptance testing prior to inviting the AHJ to witness the final acceptance testing. Review the submittal requirements below to ensure compliance with test plan, test notice, and test report requirements.
- F. AHJ Tests
 - 1. Upon successful completion of the Pre-AHJ Testing, the contractor must invite the AHJ to witness any tests requested or required by the AHJ. This must not occur prior to the Pre-AHJ Testing.

1.8 SUBMITTALS

- A. Format of submittals:
 - 1. All submittals must be submitted electronically.
 - 2. All submitted files must be in .PDF file format.
 - 3. All submittals must generated electronically; files which are scans or photocopies of physical documents are prohibited.
 - 4. Files must be logically separated and electronically bookmarked.

5. Files must be flattened so that content cannot be accidentally modified or deleted.
- B. Sequence of submittals:
 1. Submittals must be submitted to the Engineer and approved by the Engineer prior to submission to the AHJ.
 2. Shop drawings, product data, and calculations must be submitted simultaneously.
 3. Submittals must be approved by the AHJ prior to ordering any equipment.
- C. Shop Drawings:
 1. Comply with NFPA 72 Paragraph 7.4 Shop Drawings (Installation Documents), IFC Paragraph 907.1.1 Construction Documents, and IFC Paragraph 907.1.2 Fire alarm shop drawings.
 2. Include component layout drawing of each cabinet, panel, and enclosure which accurately reflects their final configuration. Disembodied panel configuration details diagrammatically connected does not satisfy this requirement.
 3. Shop drawings must indicate approval by the Technician.
- D. Product Data:
 1. Include manufacturer's data sheet for each product intended to be used in the fire alarm system.
 2. Annotate each data sheet to indicate the selected model, finishes, features, and values.
 3. If requested by the Engineer, the Contractor must also provide the manufacturer's installation manual.
 4. Product data must indicate approval by the Technician.
- E. Calculations:
 1. Battery calculations must be provided which demonstrate the ability of the system to operate on battery capacity for at least 24 hours of standby followed immediately by 15 minutes of alarm.
 2. Voltage drop calculations must be provided which demonstrate the ability of the system to deliver at least the minimum required operating voltage to each notification appliance. The starting voltage for these calculations must be the voltage of the batteries at the end of their useful life (typically 20.4 VDC). Voltage drop calculations must use the point-to-point or end-loading method. Where Class A notification appliance circuits are planned, voltage drop calculations must be submitted to confirm the worst case circuit length in a single open condition.
 3. Amplifier loading calculations must be provided which demonstrate that no amplifier is loaded beyond 75% of its listed capacity, measured at the speaker tap settings indicated on the approved shop drawings.
 4. Calculations may be submitted as sheets within the shop drawing set or as individual 8.5" x 11" calculation sheets.
 5. Calculations must indicate approval by the Technician.
- F. Firestop
 1. Include listed assembly for each type of penetration through fire rated construction. Note that simply including firestop product data does not satisfy the requirement of submitting an appropriate firestop assembly.
 2. Include product data for each firestop assembly component, including but not limited to the sealant and backer material.
- G. Pre-AHJ Test Plan
 1. Submit a plan for all fire alarm system initial acceptance tests required by NFPA 72.
 2. The test plan must indicate approval by the Technician.

3. The test plan must include the following information, at a minimum:
 - a. Approved shop drawings, updated to reflect any changes which have occurred since approval
 - b. Address, label, and location of each addressable device
 - c. Source panel, circuit number, number of devices, and type of each circuit
 - d. Schedule of batteries including which cabinets and components they power
 - e. Sequence and duration of each acceptance test
 - f. Pass/fail criteria of each acceptance test
 - g. Equipment required for each acceptance test and whether or not it requires calibration
 - h. Preliminary copy of NFPA 72 Record of Completion forms
 - H. Pre-AHJ Test - Request to Schedule:
 1. Submit notification to the Engineer at least ten business days prior to requested date of final acceptance testing of the new fire alarm system.
 - I. Pre-AHJ Test - Acceptance Testing Report:
 1. Within five business days of successful completion of acceptance testing, submit a test report to the Engineer.
 - J. AHJ Acceptance Testing:
 1. Upon successful completion of the Pre-AHJ acceptance testing (i.e. that attended by the Engineer), the Contractor may request to schedule acceptance testing with the AHJ.
 2. The Contractor must coordinate AHJ testing schedule with the AHJ and ensure the AHJ is permitted to witness all tests they require.
 3. The Contractor must be prepared to perform any testing requested by the AHJ at the AHJ acceptance test.
 4. The Contractor must notify the Engineer of the date of the AHJ acceptance testing.
 - K. Completion Documentation
 1. Within ten business days of successful completion of the AHJ Acceptance Testing, submit Completion Documentation compliant with NFPA 72 Paragraph 7.5 Completion Documentation.
 2. Additionally, include individual factory-issued manuals containing all technical and programming information on each piece of equipment installed. In the event such manuals are not obtainable from the factory, it shall be the responsibility of the contractor to compile and include them. Advertising brochures or operational instructions shall not be used in lieu of the required technical manuals.
 3. Include an electronic copy of the site-specific software on a flash drive.
- 1.9 SPARE PARTS**
- A. After successful acceptance testing, leave spare parts with owner's representative which match the products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 1. Smoke detectors: ten percent of final approved quantity (round up to nearest whole number)
 2. Notification appliances: ten percent of final approved quantity (round up to nearest whole number)
 3. Isolation modules and surge protective devices: ten percent of final approved quantity (round up to nearest whole number)

1.10 WARRANTY

- A. Contractor shall provide a warranty for all system failures as a result of manufacturing, installation, or workmanship. The warranty period shall be one year from the date of completion (established by the Architect). Include the warranty statement in the O&M manual.
- B. Warranty claims which are necessary for proper system operation shall be responded to, and their repair scheduled, within 24 hours of warranty claim (the actual time allowed for the repair work shall be negotiated with the building owner at the time of warranty claim).
- C. Warranty claims which are not necessary for proper system operation shall be responded to, and their repair scheduled, within one week of warranty claim (the actual time allowed for the repair work shall be negotiated with the building owner at the time of warranty claim).

PART 2 - PRODUCTS

2.1 ACCEPTABLE PRODUCTS

- A. All products permitted by NFPA 72 are acceptable, except where prohibited or otherwise specified herein.
- B. Fire alarm system must be manufactured by Simplex or Notifier.
- C. It is the contractor's responsibility to provide all system components necessary to accomplish the input/output function on the contract drawings.
- D. All devices must be listed to operate within the temperature, humidity, and airborne particulate environment expected to be present.
- E. All products must be new and shall be in current production as of the date of shop drawing submittal.
- F. Products which have been refurbished or previously installed are prohibited.

2.2 FIRE-ALARM CONTROL UNIT

- A. The fire alarm control unit (FACU) must be:
 - 1. Simplex 4100ES or Notifier NFS2-3030; no exceptions will be granted.
 - 2. Be capable of performing all functions indicated on the sequence of operations matrix.
 - 3. Be listed for releasing service.
 - 4. Capable of delivering live and pre-recorded voice messages and the associated alert tones.
 - 5. Capable of storing up to 8 pre-recorded voice messages and the associated alert tones.
 - 6. Capable of utilizing alarm verification for all smoke detectors.
 - 7. Capable of indicating and controlling sensitivity values of all smoke detectors.
 - 8. Provided with smoke detector output control function simulation by software control from the FACU.
 - 9. Provided with notification appliance circuit bypass via software control functions.
 - 10. Provided with addressable relay function bypass via software control functions.
- B. Audio system
 - 1. The amplifier and speaker system shall be designed to operate at 70, 70.7, or 75 Volts.
- C. Enclosure
 - 1. The fire alarm and voice evacuation processor, microphone, message buttons, and zone selection buttons must be provided by the manufacturer in a single, combined enclosure. Remote power supplies and amplifiers may be in separate enclosure(s).
- D. Display requirements:
 - 1. The FACU must be provided with an integral LCD display which displays a minimum of two rows of 40 characters (minimum 80-character display).

2. The display must be visible with the panel door open or closed.
 3. Normal conditions must be indicated by a green light; trouble conditions must be indicated by an amber light; fire conditions must be indicated by a red light.
 4. Trouble indicating lights must automatically reset when the trouble condition is cleared.
 5. Fire indicating lights must remain lit at the FACU until manually reset.
 - E. Keyboards:
 1. The FACU must be provided with an integral keyboard which allows full system programming capability, secured from unauthorized access.
 - F. Interface Capability with Other Systems:
 1. The FACU must supervise all fire sprinkler system devices.
 2. The FACU must interface with other building systems to perform the associated emergency control function interface.
 - G. Positive Alarm Sequence:
 1. The FACU must be capable of positive alarm sequence in accordance with NFPA 72 paragraph 23.8.1.2.
 - H. Pre-Recorded Messages: All pre-recorded messages must be professionally recorded using sound studio equipment.
 1. Fire Evacuation:
 - a. Alert Tone: 2,000 Hz temporal-three alert tone
 - b. Pre-Recorded Message: In a female voice, "MAY I HAVE YOUR ATTENTION PLEASE. MAY I HAVE YOUR ATTENTION PLEASE. A FIRE EMERGENCY HAS BEEN REPORTED IN THE BUILDING. PLEASE GO TO THE NEAREST EXIT AND LEAVE THE BUILDING. DO NOT USE THE ELEVATORS."
 - c. Sequence: Two cycles of alert tone followed by two cycles of the pre-recorded message; repeat until manually stopped.
 - I. Instructions:
 1. Provide printed and laminated instructions permanently attached to the FACU or immediately adjacent to the FACU which plainly describe the following:
 - a. Basic function and operations of system
 - b. Positive alarm sequence
 - c. Delivery of live voice message
 - d. Delivery of pre-recorded message
 2. Instructions must be visible to the user while the action is being taken.
- 2.3 EMERGENCY NOTIFICATION INTERIOR SYSTEM INTERFACE**
- A. The emergency notification interior system interface shall be the American Signal Corporation (ASC) Model RTU-ISI and will be provided by the Owner.
- 2.4 SPARE CAPACITY**
- A. No power supply, amplifier, notification appliance circuit, signaling line circuit, battery, or similar component shall be loaded beyond 75% of its listed capacity.
- 2.5 AMPLIFIERS**
- A. No single amplifier shall be larger than 100 watts nominal capacity.
- 2.6 REMOTE POWER SUPPLIES (RPS)**
- A. Each RPS must include at least four 24-volt outputs.
 - B. All RPS must be configured so that they are activated by the FACU (direct trip by field initiating devices is prohibited).

- C. Each RPS must supervise 1) loss of primary power 2) secondary power status 3) all output circuits open and short faults and 4) ground faults.

2.7 CABINETS

- A. The FACU must be provided in a side-hinged cabinet of steel or durable plastic construction.
- B. All FACU controls, display, and visual indicators must be located behind a locked glass or plastic vision panel.
- C. The remote power supply, amplifier, battery, supervising station communications system, and similar components must each be provided in steel, side hinged cabinets with cylinder lock.
- D. All cabinets must be factory-painted a color as approved by the architect.
- E. All cabinets must be of the NEMA enclosure rating acceptable for their environment.

2.8 CIRCUITS AND WIRING

- A. General
 - 1. Circuits must be Class B minimum except that the network riser must be Class X.
 - 2. Conductors, insulation, and shielding must be compliant with NFPA 72, NFPA 70, and the requirements of the manufacturer of the devices to which it connects.
 - 3. All fire alarm circuits must be FPLP. Use of non-power limited materials and methods on power limited fire alarm circuits is prohibited.
 - 4. All circuits and wiring must be color-coded by function. Color-code must be consistent throughout the building, modification of color code is prohibited.
 - 5. All conductors must be solid copper.
- B. Signaling Line Circuits and Initiating Device Circuits
 - 1. No special wiring sequence shall be required on addressable device circuits.
 - 2. An unlimited number of wiring branches must be permitted with no loss of supervision.
- C. SLC must be solid copper, shielded, FPLP, 18 AWG minimum.
- D. Horn and strobe NAC must be solid copper, FPLP, 14 AWG minimum.
- E. Speaker Circuits must be solid copper, shielded, FPLP, 14 AWG minimum.
- F. Accessory circuits must be solid copper, FPLP, 14 AWG minimum
- G. Network riser conductors must be metallic.

2.9 CONDUIT

- A. All conduit must be ¾-inch minimum EMT or more resilient, and must be suitable for the conditions and atmosphere in which it installed, per NFPA 70.
- B. Conduit expansion couplings must designed specifically for use on the conduit system in which they are installed. These must be designed to permit linear movement without damaging the connected conduit or conductors passing through. The basis of design product is the Eaton XJG Conduit Expansion Coupling; other product may be used, this is included herein simply for demonstration of intent.

2.10 SUPERVISING STATION COMMUNICATIONS SYSTEM

- A. The protected premises fire alarm system must communicate with the Oklahoma Panhandle State University supervising station by ethernet. Communications must be via a compatible communications protocol; contact closure interface is not acceptable.
- B. The existing OPSU supervising station is a Simplex TrueSite Work Station.
- C. The contractor must coordinate with OSU EHS and OSU IT departments to ensure the final solution satisfies all parties.

2.11 MANUAL FIRE ALARM PULL STATIONS

- A. Manual pull stations must be Notifier BNG-1R, Fire Lite BG-8, or Simplex 4099-9021 No Grip.

- B. Manual fire alarm pull stations must be the addressable, dual-action type, without break-rod.
- C. Devices must be red with engraved or raised white letters.
- D. The use of a key or wrench shall be required to reset the pull station.

2.12 SPOT-TYPE SMOKE DETECTORS

- A. All spot-type smoke detectors must comply with UL 268, 7th edition.
- B. Spot-type smoke detectors must be the photoelectric, addressable type.
- C. Detector sensitivity must be viewable and adjustable from the FACU.
- D. Detectors must be provided with an integral LED indicator visible from the floor.

2.13 DUCT-TYPE SMOKE DETECTORS

- A. Duct Smoke Detectors: Photoelectric type complying with UL 268A.
 - 1. Detector address shall be accessible from fire-alarm control unit and shall be able to identify the detector's location within the system and its sensitivity setting.
 - 2. An operator at fire-alarm control unit, having the designated access level, shall be able to manually access the following for each detector:
 - a. Primary status.
 - b. Device type.
 - c. Present average value.
 - d. Present sensitivity selected.
 - e. Sensor range (normal, dirty, etc.).
 - 3. Weatherproof Duct Housing Enclosure: NEMA 250, Type 4X; NRTL listed for use with the supplied detector for smoke detection in HVAC system ducts.
 - 4. Each sensor shall have multiple levels of detection sensitivity.
 - 5. Sampling Tubes: Design and dimensions as recommended by manufacturer for specific duct size, air velocity, and installation conditions where applied.
 - 6. Relay Fan Shutdown: Fully programmable relay rated to interrupt fan motor-control circuit.

2.14 ADDRESSABLE MODULES

- A. Modules shall contain an integral LED visible through the module cover plate that flashes each time the module is polled.
- B. Module LEDs shall illuminate solid upon activation of the supervised device.

2.15 SPEAKERS, STROBES, AND SPEAKER STROBES

- A. Speakers must:
 - 1. Be UL 1480 listed.
 - 2. Have field-selectable tap settings of 1/4, 1/2, 1, and 2 watts
- B. Devices must be capable of installation in a standard 4-inch square electrical box.
- C. Devices must be provided with factory-painted white faceplates.
- D. Speakers are not required to be labeled.
- E. Strobes and speaker/strobes must be labeled "ALERT" in red, factory-applied letters.

2.16 EXTERIOR LOCAL WATERFLOW ALARM

- A. Exterior local waterflow alarm shall be the weatherproof horn/strobe type with red housing.

2.17 LOCAL OPERATORS CONSOLE (LOC)

- A. The LOC must include the following features:
 - 1. LCD display including at least two rows of 40 characters per row.

2. Silence and reset operator functions.
 3. Handheld push-to-talk microphone.
- B. The microphone and buttons must be secured behind a locked door.
 - C. The silence and reset operator functions must require key or pin to access.
 - D. The microphone, buttons, display, silence, and reset features may be provided in a single LOC assembly. Or, the microphone and buttons may be provided in an assembly with lockable door with the annunciator (including silence and reset features) as a separate assembly without lockable door.
 - E. All components of the LOC must be the recessed type.
 - F. All LOC cabinets and trim must be factory-painted red or beige.

2.18 SECONDARY POWER SUPPLY

- A. Batteries must be the valve-regulated lead-acid (VRLA) battery type with absorbent gas mat (AGM) type.
- B. Batteries must be sized to provide 24 hours of standby followed by 15 minutes of alarm.
- C. Batteries must be not less than 7 amp-hour.
- D. All battery chargers must be the automatic tapering type, sized to fully recharge the required battery capacity within 12 hours.
- E. All secondary power supplies must be configured so that connections, fuser, breaker, and battery condition are supervised and product a trouble signal when any condition occurs that would prevent operation of the secondary power supply.

2.19 DOCUMENT CABINET

- A. The document cabinet must be located and contain information as required by NFPA 72.
- B. The document cabinet must be a steel, side-hinged enclosure designed for this specific purpose, similar to the Space Age System Document Box.

PART 3 - EXECUTION

3.1 GENERAL

- A. The contractor must install all system components in accordance with NFPA 72, NFPA 70, the manufacturer's instructions, and these specifications.
- B. The contractor must maintain the manufacturer's installation instructions for each system component on-site during installation of the component.
- C. All system components must be installed parallel or perpendicular to the building structure or associated finish materials and features.
- D. Upon completion, all system components must be in the 'like-new' condition. If any components are damaged during construction, they must be replaced with new components.
- E. All system components must be installed in a neat and workman like manner consistent with the high quality interior finishes present in this building.
- F. Examine roughing-in for electrical connections to verify actual locations of connections before installation; proceed with installation only after unsatisfactory conditions have been corrected.
- G. Where installation of components requiring access is required above monolithic ceilings or in walls, the contractor must coordinate their location with the access panels specified in section 08 3113 ACCESS DOORS AND FRAMES. Coordinate to ensure the access panels are of proper location, size, and shape to allow the required access.

3.2 FIELD QUALITY CONTROL

- A. Installation must not begin without approval of all shop drawings by the University Architect and the Owner's Safety Department.

- B. Fire alarm cables must be pulled by individuals who have been awareness-level trained by the Contractor in the basic purpose and intent of the various cables including their path, type, color code, and labeling requirements.
- C. Conduit and backbox system installation may be performed by the electrician.
- D. All terminations and programming must be performed by manufacturer trained and certified technicians licensed by the State of Oklahoma for fire alarm installation. All terminations must be performed by, or under the supervision of, the Technician.
- E. Testing must be conducted in the sequence identified in QUALITY CONTROL in Part I of this specification.
- F. Technician supervision of system installation must be conducted in accordance with QUALITY CONTROL in Part I of this specification.
- G. Reacceptance Testing: Perform reacceptance testing to verify the proper operation of added or replaced devices and appliances.
- H. Fire alarm system will be considered defective if it does not pass tests and inspections.
- I. Prepare test and inspection reports as required in SUBMITTALS in PART I of this specification.

3.3 PRIMARY POWER SUPPLY (120V)

- A. All fire alarm equipment utilizing 120V primary power supply must be supplied by a panelboard fed by the emergency generator. Refer to electrical for source panels.
- B. Each control unit requiring 120V primary power may use its own dedicated branch circuit or may share a branch circuit with other fire alarm equipment if provided with adequate capacity.
- C. Where feasible, the panelboard serving the fire alarm control equipment must be located on the same floor as the fire alarm control equipment.
- D. Provide surge suppression on each branch circuit in accordance with the surge suppressor manufacturer's installation instructions and NFPA 72.

3.4 CIRCUITS AND PATHWAYS

- A. All new circuits must be provided in metallic conduit in accordance with NFPA 70. Except where flexible metallic conduit is permitted herein, all conduit must be EMT or more physically resilient metallic conduit in accordance with NFPA 70 criteria.
- B. Couplings and fittings may be the set screw or compression type.
- C. All terminations and splices must take place at panel terminals, device terminals, or terminal strips located in a Hoffman box in an accessible location. Wire nuts and slip connectors are prohibited.
- D. Field t-taps are permitted; t-taps originating at panel terminals are prohibited.
- E. All conduit must be concealed behind walls or ceilings where possible.
- F. All SLC circuits must be Class B.
- G. SLC must be routed in its own dedicated grounded conduit.
- H. All IDC circuits longer than 6 feet must be Class B; IDC circuits shorter than 6 feet may be Class B.
- I. All NAC circuits must be Class B.
- J. Flexible metallic conduit in lengths of up to 6 feet is permitted to serve individual devices.
- K. At each location where the metallic conduit system passes the expansion joint, a conduit expansion coupling must be utilized.
- L. Conduit fill must not exceed 40 percent.

3.5 EMERGENCY CONTROL FUNCTION INTERFACE WIRING

- A. HVAC fan shutdown, fire door release, access control door unlock, fire/smoke damper control, natural gas shutoff (if required), and related emergency control function interfaces must be achieved by the use of addressable relay control modules.
- B. Each emergency control function interface output control module must be dedicated to the piece of equipment which it serves; no more than one piece of equipment may be controlled by any one output module.

3.6 FIRESTOPPING

- A. All new penetrations through fire- and/or smoke-resistant rated construction must be firestopped with a listed firestop assembly appropriate for the installation. Refer to code plans for location and type of rated construction.
- B. Refer to architectural plans and specifications for additional criteria.
- C. All firestop materials and assemblies must be of a consistent manufacturer as specified by architectural.
- D. All firestop must be installed by individuals who have attended and passed technical firestop assembly selection and installation training provided by the firestop manufacturer.

3.7 EQUIPMENT INSTALLATION

- A. FACU, annunciator, ethernet supervising station equipment (if separate panel), remote power supplies (if necessary), devices, and modules must be installed recessed where installed in finished areas.
- B. Where installed on masonry construction in unfinished areas, panels and devices may be installed surface-mount. If installed surface-mount, ensure adequate clearance and working space is provided.
- C. Manual Fire-Alarm Boxes:
 - 1. Mount manual fire-alarm box on a background of a contrasting color.
 - 2. The operable part of manual fire-alarm box shall be between 42 inches and 48 inches above floor level. All devices shall be mounted at the same height unless otherwise indicated.
- D. Detector Spacing:
 - 1. Comply with the "Smoke-Sensing Fire Detectors" section in the "Initiating Devices" chapter in NFPA 72, for smoke-detector spacing.
 - 2. Lighting Fixtures: Locate detectors not closer than 12 inches from any part of a lighting fixture and not directly above pendant mounted or indirect lighting.
 - 3. Smoke detectors must not be located:
 - a. Within 3 ft of air-supply diffuser or return-air opening.
 - b. Within 10 ft horizontally of a fixed cooking appliance.
 - c. Within 3 ft horizontally of a door to a bathroom containing a shower or tub.
 - d. Within 3 ft from the tip of ceiling fan blades
 - e. Farther than 5 feet horizontally from smoke damper.
- E. Install a cover on each smoke detector that is not placed in service during construction. Cover shall remain in place except during system testing. Remove cover prior to system turnover.
- F. Duct Smoke Detectors: Comply with NFPA 72 and the International Mechanical Code. Install sampling tubes so they extend the full width of duct. Tubes more than 36 inches long shall be supported at both ends.
 - 1. Do not install smoke detector in duct smoke-detector housing during construction. Install detector only during system testing and prior to system turnover.

- G. Install document cabinet adjacent to the fire alarm control unit, in an accessible location, with its top not more than 6 feet above finished floor.

3.8 EXTERIOR LOCAL WATERFLOW ALARM

- A. Install the local waterflow alarm directly above the FDC. This device must be a horn/strobe and must only activate upon waterflow switch activation. This device must be red with white factory applied letters which read “FIRE.”

3.9 IDENTIFICATION

- A. All field labels must be typed; handwritten labels are not permitted.
- B. Panel labels must be engraved or stamped plastic or metal with contrasting letters.
- C. Device labels must be typewritten stickers.
- D. Circuit labels must be typewritten stickers; sleeve-type labels are prohibited.
- E. Label each addressable initiating device with its device number as programmed in the panel.
- F. Each circuit must be labeled with a typed shrink-wrap label indicating the circuit type and number near its terminals in the FACU or remote power supply.
- G. Within each cabinet, identify the location of the primary power supply and associated surge protector.
- H. All junction box covers shall be painted red and provided with labels reading “FIRE ALARM.”

3.10 FIRESTOPPING

- A. All new penetrations through fire- and/or smoke-resistant rated construction must be firestopped with a listed firestop assembly appropriate for the installation. Refer to code plans for location and type of rated construction.
- B. Refer to architectural plans and specifications for additional criteria.
- C. All firestop materials and assemblies must be of a consistent manufacturer as specified by architectural.

3.11 CLEANING

- A. Clean dirt and debris from all components prior to installation.
- B. Clean dirt and debris from all components prior to final testing.
- C. Clean dirt and debris from all components after final testing.

3.12 TESTING

- A. Contractor must perform all testing required by NFPA 72 and as specified on the plans and herein.
- B. Contractor must coordinate with other trades as necessary to ensure connected systems are fully tested.
- C. Contractor must perform their internal testing, then must perform Pre-AHJ Testing, then must perform AHJ testing.
- D. Contractor must be prepared to conduct all tests requested by the owner’s representative at Pre-AHJ Testing and by the AHJ at AHJ Testing at no additional cost to the owner.
- E. Contractor must provide all personnel, equipment, materials, utilities, and other supplies necessary to conduct all tests required herein.
- F. Intelligibility testing
 1. Intelligibility must be measured for each Acoustically Distinguishable Space (ADS) using test equipment and methods as specified by NFPA 72 Annex D.
 2. Testing must be performed after all furniture and finishes have been completed, with typical background mechanical and electrical noise.
 3. Input the STIPA test signal into a system microphone using a talkbox.

4. Adjust sound pressure of STIPA test signal until it matches the sound pressure of the fire alarm evacuation pre-recorded voice signal.
5. Within each ADS, obtain measurements at representative occupiable locations with the meter approximately 5.5 feet above the walking surface. At each measurement location, calculate the average of three readings.
6. Each ADS requiring intelligibility must achieve a 0.7 CIS minimum.
7. Record all values digitally on a .pdf drawing file and include in test reports.
8. Qualitative intelligibility must also be performed for all ADS using pre-recorded messages and live voice input from all system microphones.

3.13 TRAINING

- A. Contractor must conduct two training sessions for building staff. Each training session must be identical. Coordinate the timing of the two required training sessions with the owner.
- B. Training must address, at a minimum:
 1. Review of the approved completion documentation submittal including:
 - a. Record (as-built drawings)
 - b. Product data sheets for major system components
 - c. Narrative of system inputs, outputs, emergency control function interfaces, expansion capability.
 - d. Operator instructions for basic system operations
 - e. Routine maintenance and testing
 2. Demonstration of all FACU operator buttons, microphones, and annunciator functions.
 3. Demonstration of location of equipment which is concealed or not easily identifiable from as-built drawings.

3.14 WARRANTY PERIOD INSPECTION TESTING AND MAINTENANCE

- A. Maintenance Test and Inspection: Perform tests and inspections listed for quarterly, and semiannual periods. Use forms developed for initial tests and inspections. It may be assumed that the owner will perform the required more frequent visual inspections.
- B. Initial Maintenance Service: Beginning at Substantial Completion, maintenance service shall include 12 months' full maintenance by skilled employees of manufacturer's designated service organization. Include preventive maintenance, repair or replacement of worn or defective components, lubrication, cleaning, and adjusting as required for proper operation. Parts and supplies shall be manufacturer's authorized replacement parts and supplies.
 1. Include visual inspections according to the "Visual Inspection Frequencies" table in the "Testing" paragraph of the "Inspection, Testing and Maintenance" chapter in NFPA 72.
 2. Perform tests in the "Test Methods" table in the "Testing" paragraph of the "Inspection, Testing and Maintenance" chapter in NFPA 72.
 3. Perform tests per the "Testing Frequencies" table in the "Testing" paragraph of the "Inspection, Testing and Maintenance" chapter in NFPA 72.
- C. Annual Test and Inspection: One year after date of Substantial Completion, test fire-alarm system complying with visual and testing inspection requirements in NFPA 72. Use forms developed for initial tests and inspections.

3.15 SOFTWARE SERVICE AGREEMENT

- A. Comply with UL 864.
- B. Technical Support: Beginning at Substantial Completion, service agreement shall include software support for two years.

- C. Upgrade Service: At Substantial Completion, update software to latest version. Install and program software upgrades that become available within two years from date of Substantial Completion. Upgrading software shall include operating system and new or revised licenses for using software.
 - 1. Upgrade Notice: At least 30 days to allow Owner to schedule access to system and to upgrade computer equipment if necessary.

END OF SECTION 28 3111