MAIN BUILDING

www.myTSCstore.com

GALVANIZED GENERAL CONTRACTOR

HEATING, VENTILATING

ON CENTER

PLYWOOD

PAINTED

RADIUS

PAVEMENT

REQUIRED RIGHT OF WAY

SANITARY

SCHEDULE

STANDARD

WITHOUT

STRUCTURAL

TRANSFORMER

WATER HEATER

WELDED WIRE FABRIC

REFLECTED CEILING PLAN

POWER POLE

PROPERTY LINE

Q4 2023 G+

HUDSON, COLORADO

HUDSON, COLORADO HUDSON, CO 34669

OWNER / DEVELOPER

ATWATER HUDSON COLORADO, LLC 162 W GRAND AVE. SUITE 200 CHICAGO, IL 60654 OWNER'S REPRESENTATIVE

KUNAL RELWANI relwani@atwatergroup.com 312.480.7736

TENANT

TRACTOR SUPPLY CO.

5401 VIRGINIA WAY BRENTWOOD, TN 37027

PROJECT MANAGER MIKE ZAVILLA mzavilla@tractorsupply.com 949.395.7155

ARCHITECT



OXFORD ARCHITECTURE

2934 SIDCO DRIVE, SUITE 120 NASHVILLE, TN 37204

ARCHITECT GLEN P. OXFORD, AIA 615.256.3455 x 10 glen@oxfordarchitecture.com

PROJECT MANAGER **BRAD MATUZAK** 615.256.3455 x 15 brad@oxfordarchitecture.com

CIVIL ENGINEER

SGM INC

118 W. SIXTH STREET, SUITE 200 GLENWOOD SPRINGS, CO 81601 JEVON POSTON, PE 970.384.9058 JEVONP@SGM-INC.COM

STRUCTURAL ENGINEER

BENNETT & PLESS INC.

565 MARRIOTT DRIVE, SUITE 300 NASHVILLE, TN 37214

ENGINEER OF RECORD PROJECT MANAGER FREDERICK A. WEIS, P.E. JARROD FINGER

615.878.2206 615.450.0834 fweis@bennett-pless.com jfinger@bpl-enclosure.com

MECHANICAL & PLUMBING

SCHELTON ENGINEERING

1163 WEST MAIN STREET FRANKLIN, TN 37064 PROJECT MANAGER GARY SCHELTON, P.E., LEED AP 615.730.9111 gary@scheltonengineering.com

ELECTRICAL ENGINEER

PARSONS ENGINEERING

4751 TROUSDALE DRIVE, SUITE 202 NASHVILLE, TN 37203

PROJECT MANAGER


RODNEY RUNIONS, P.E. 615.386.9396

rrunions@parsonsengineering.com

PROJECT SUMMARY

TRACTOR SUPPLY COMPANY (TSC) IS A RETAILER TARGETING THE HOBBY FARMER. ITEMS SOLD AT TSC INCLUDE CLOTHING, FENCING, HARDWARE, BIRD FEED AND EQUINE PRODUCTS.

GRAPHIC SYMBOLS

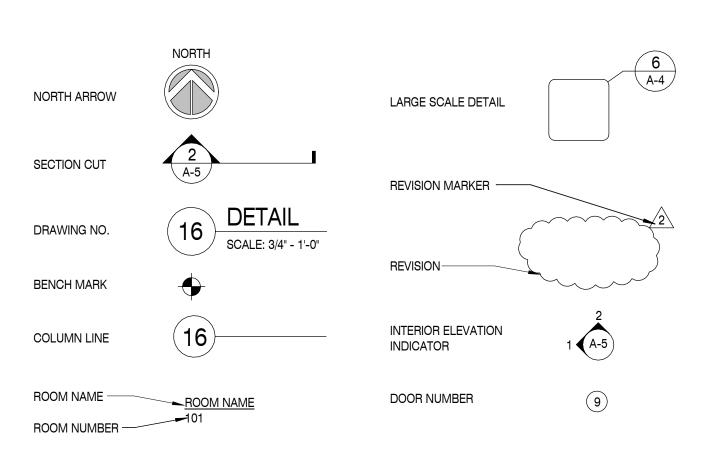

WALL TYPES

CMU WALL

— — FIXTURE WALI

METAL STUD WALL TO 6" ABOVE CEILING METAL STUD AND FINISH BOTH SIDES TO ROOF DECK; SEE A5.1 FOR MOD. CONDITIONS PET WASH WALL, SEE A5.1 METAL STUD AND FINISH BOTH SIDES TO ROOF DECK W/ SOUND INSULATION TO ABOVE CEILING

ABBREVIATIONS

	DITE VIATIONO	
ABV:	ABOVE	GAL
ACT:	ACCOUSTICAL CEILING TILE	GC:
ADA:	AMERICANS WITH	GD:
, LD, 1.	DISABILITIES ACT	GYF
ADJ:	ADJACENT	HC:
AFF:	ABOVE FINISH FLOOR	HGT
ALUM:	ALUMINUM	HM:
APPROX:	APPROXIMATE	HT:
BLDG:	BUILDING	HVA
BRG:	BEARING	,
BRK:	BRICK	HW'
BTM:	BOTTOM	MTE
CER:	CERAMIC	OC:
CJ:	CONTROL JOINT	PL:
CL:	CENTER LINE	PLY
CLG:	CEILING	PP:
CMU:	CONCRETE MASONRY UNIT	PR:
C.O.:	CASED OPENING	PSI:
CO:	CLEANOUT	PT:
CONC:	CONCRETE	PTD
COOR:	CORRIDOR	PVM
CT:	CERAMIC TILE	RAD
D.F.:	DRINKING FOUNTAIN	RCF
DIA:	DIAMETER	REC
DIM:	DIMENSION	ROV
D.S:	DOWNSPOUT	SAN
DWG:	DRAWING	SCH
EIFS:	EXTERIOR INSULATION	SPE
	& FINISH SYSTEM	SQ:
INSUL:	INSULATION	STD
JAN:	JANITOR	STR
MECH:	MECHANICAL	TRA
MFG:	MANUFACTURER	VCT
MH:	MANHOLE	VES
MO:	MASONRY OPENING	W/:
EJ:	EXPANSION JOINT	W/C
FD:	FIRE DEPARTMENT	WD
FFE:	FINISH FLOOR ELEVATION	WH:
FH:	FIRE HYDRANT	WW
FINI:	FINISH	YD.

FIRE RESISTIVE TREATED

FIBERGLASS REINFORCED PANEL

FLOOR


FEET

FOOTING

FIRE RATED

F.R.T.:

DRAWING INDEX

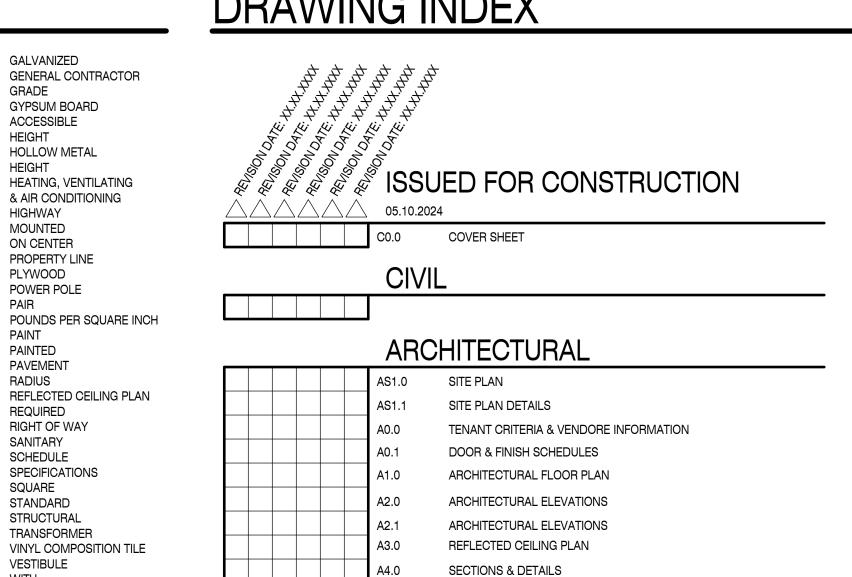

INTERIOR PLANS, ELEVATIONS, & DETAILS PET WASH PLAN, ELEVATIONS, & DETAILS INTERIOR ELEVATIONS SECTIONS, DETAILS & ELEVATIONS RECEIVING / SERVICE COUNTER DTLS ROOF SPECIFICATIONS LIFE SAFETY PLAN / FIXTURE PLAN ARCHITECTURAL COMCHECK ARCHITECTURAL COMCHECK

STRUCTURAL

0111	OOTOTAL
S1.0	FOUNDATION PLAN
S1.1	FORAGE SHED PLAN & DETAILS - PEMB
S2.0	ROOF FRAMING PLAN
S2.1	ROOF FRAMING PLAN, CONT.
S3.0	DETAILS
S4.0	DETAILS
S4.1	DETAILS
S4.2	DETAILS
S4.3	DETAILS
S5.0	STRUCTURAL GENERAL NOTES
S5.1	STRUCTURAL GENERAL NOTES, CONT.
S5.3	QUALITY ASSURANCE/PROPOSED STATEMENT OF SPECIAL INSPECTIONS, CONT.
S5.2	QUALITY ASSURANCE / PROPOSED STATEMENT OF SPECIAL INSPECTIONS
S5.4	CONCRETE SPECIFICATIONS
 __\	

MECHANICAL MECHANICAL FLOOR PLAN

MECHANICAL SCHEDULES, DETAILS, AND SPECIFICATIONS **PLUMBING**

PLUMBING SCHEDULES AND DETAILS

PLUMBING FLOOR PLAN

PLUMBING RISERS AND SPECIFICATIONS

FIRE PROTECTION FIRE PROTECTION PLAN **ELECTRICAL**


			ES1.0	ELECTRICAL SITE PLAN
			E1.0	GENERAL LIGHTING PLAI
			E2.0	GENERAL POWER PLAN
			E3.1	ELEC. SYSTEM/VENDOR
			E3.2	ELEC. SYSTEM/VENDOR
			E4.0	ELEC. LEGEND & DETAIL

GENERAL LIGHTING PLAN GENERAL POWER PLAN ELEC. SYSTEM/VENDOR DETAILS ELEC. SYSTEM/VENDOR DETAILS ELEC. LEGEND & DETAILS

SYSTEMS FLOOR PLAN SYSTEMS FLOOR NOTES

PHOTOMETRIC PHOTOMETRIC

VICINITY MAP

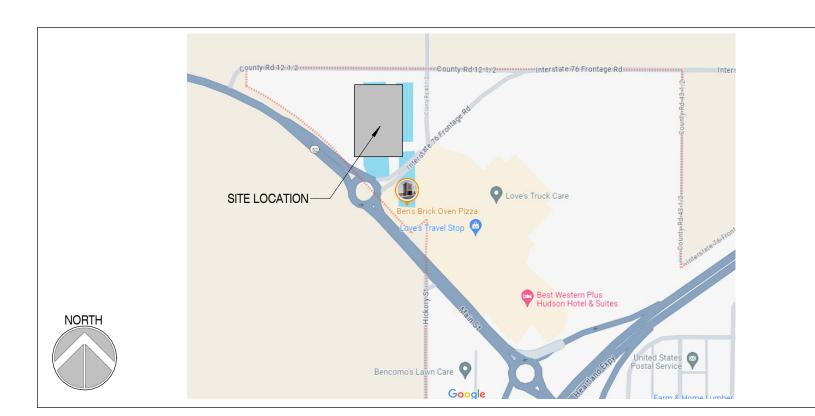

PROJECT DATA

THIS PROJECT IS BASED ON THE REQUIREMENTS OF THE FOLLOWING CODES:


2006 INTERNATIONAL BUILDING CODE 2021 INTERNATIONAL PLUMBING CODE 2006 INTERNATIONAL MECHANICAL CODE 2023 NATIONAL ELECTRICAL CODE

2021 INTERNATIONAL ENERGY CODE

2021 INTERNATIONAL GAS CODE OCCUPANCY CLASSIFICATION = M / S-1 - NON-SEPARATED MIXED USE CONSTRUCTION TYPE = FIRE SUPPRESSION = **BUILDING AREA** VESTIBULE = RETAIL SALES = 15,416 SQ. FT. / 30 = 513.8 OR 514 OFFICE CORE & WALLS = 946 SQ. FT. / 100 = 9.46 OR 10 STOCKROOM = 4,945 SQ. FT. / 300 = 16.5 OR 17 TOTAL BUILDING AREA = 21,930 SQ. FT.

TOTAL OCCUPANT LOAD BUILDING HEIGHT = 1 STORY, 21'-4" A.F.F. @ FRONT MASONRY WALL ALLOWABLE AREA CALCULATIONS = Aa = At + [At x If] + [At x Is] $Aa = 12,500 + [12,500 \times 0] + [12,500 \times 3]$ Aa = 12,500 + [0] + [37,500]Aa = 50,000 SQ. FT. Aa = 50,000 SQ. FT. > 21,930 SQ. FT

HUDSON, COLORADO

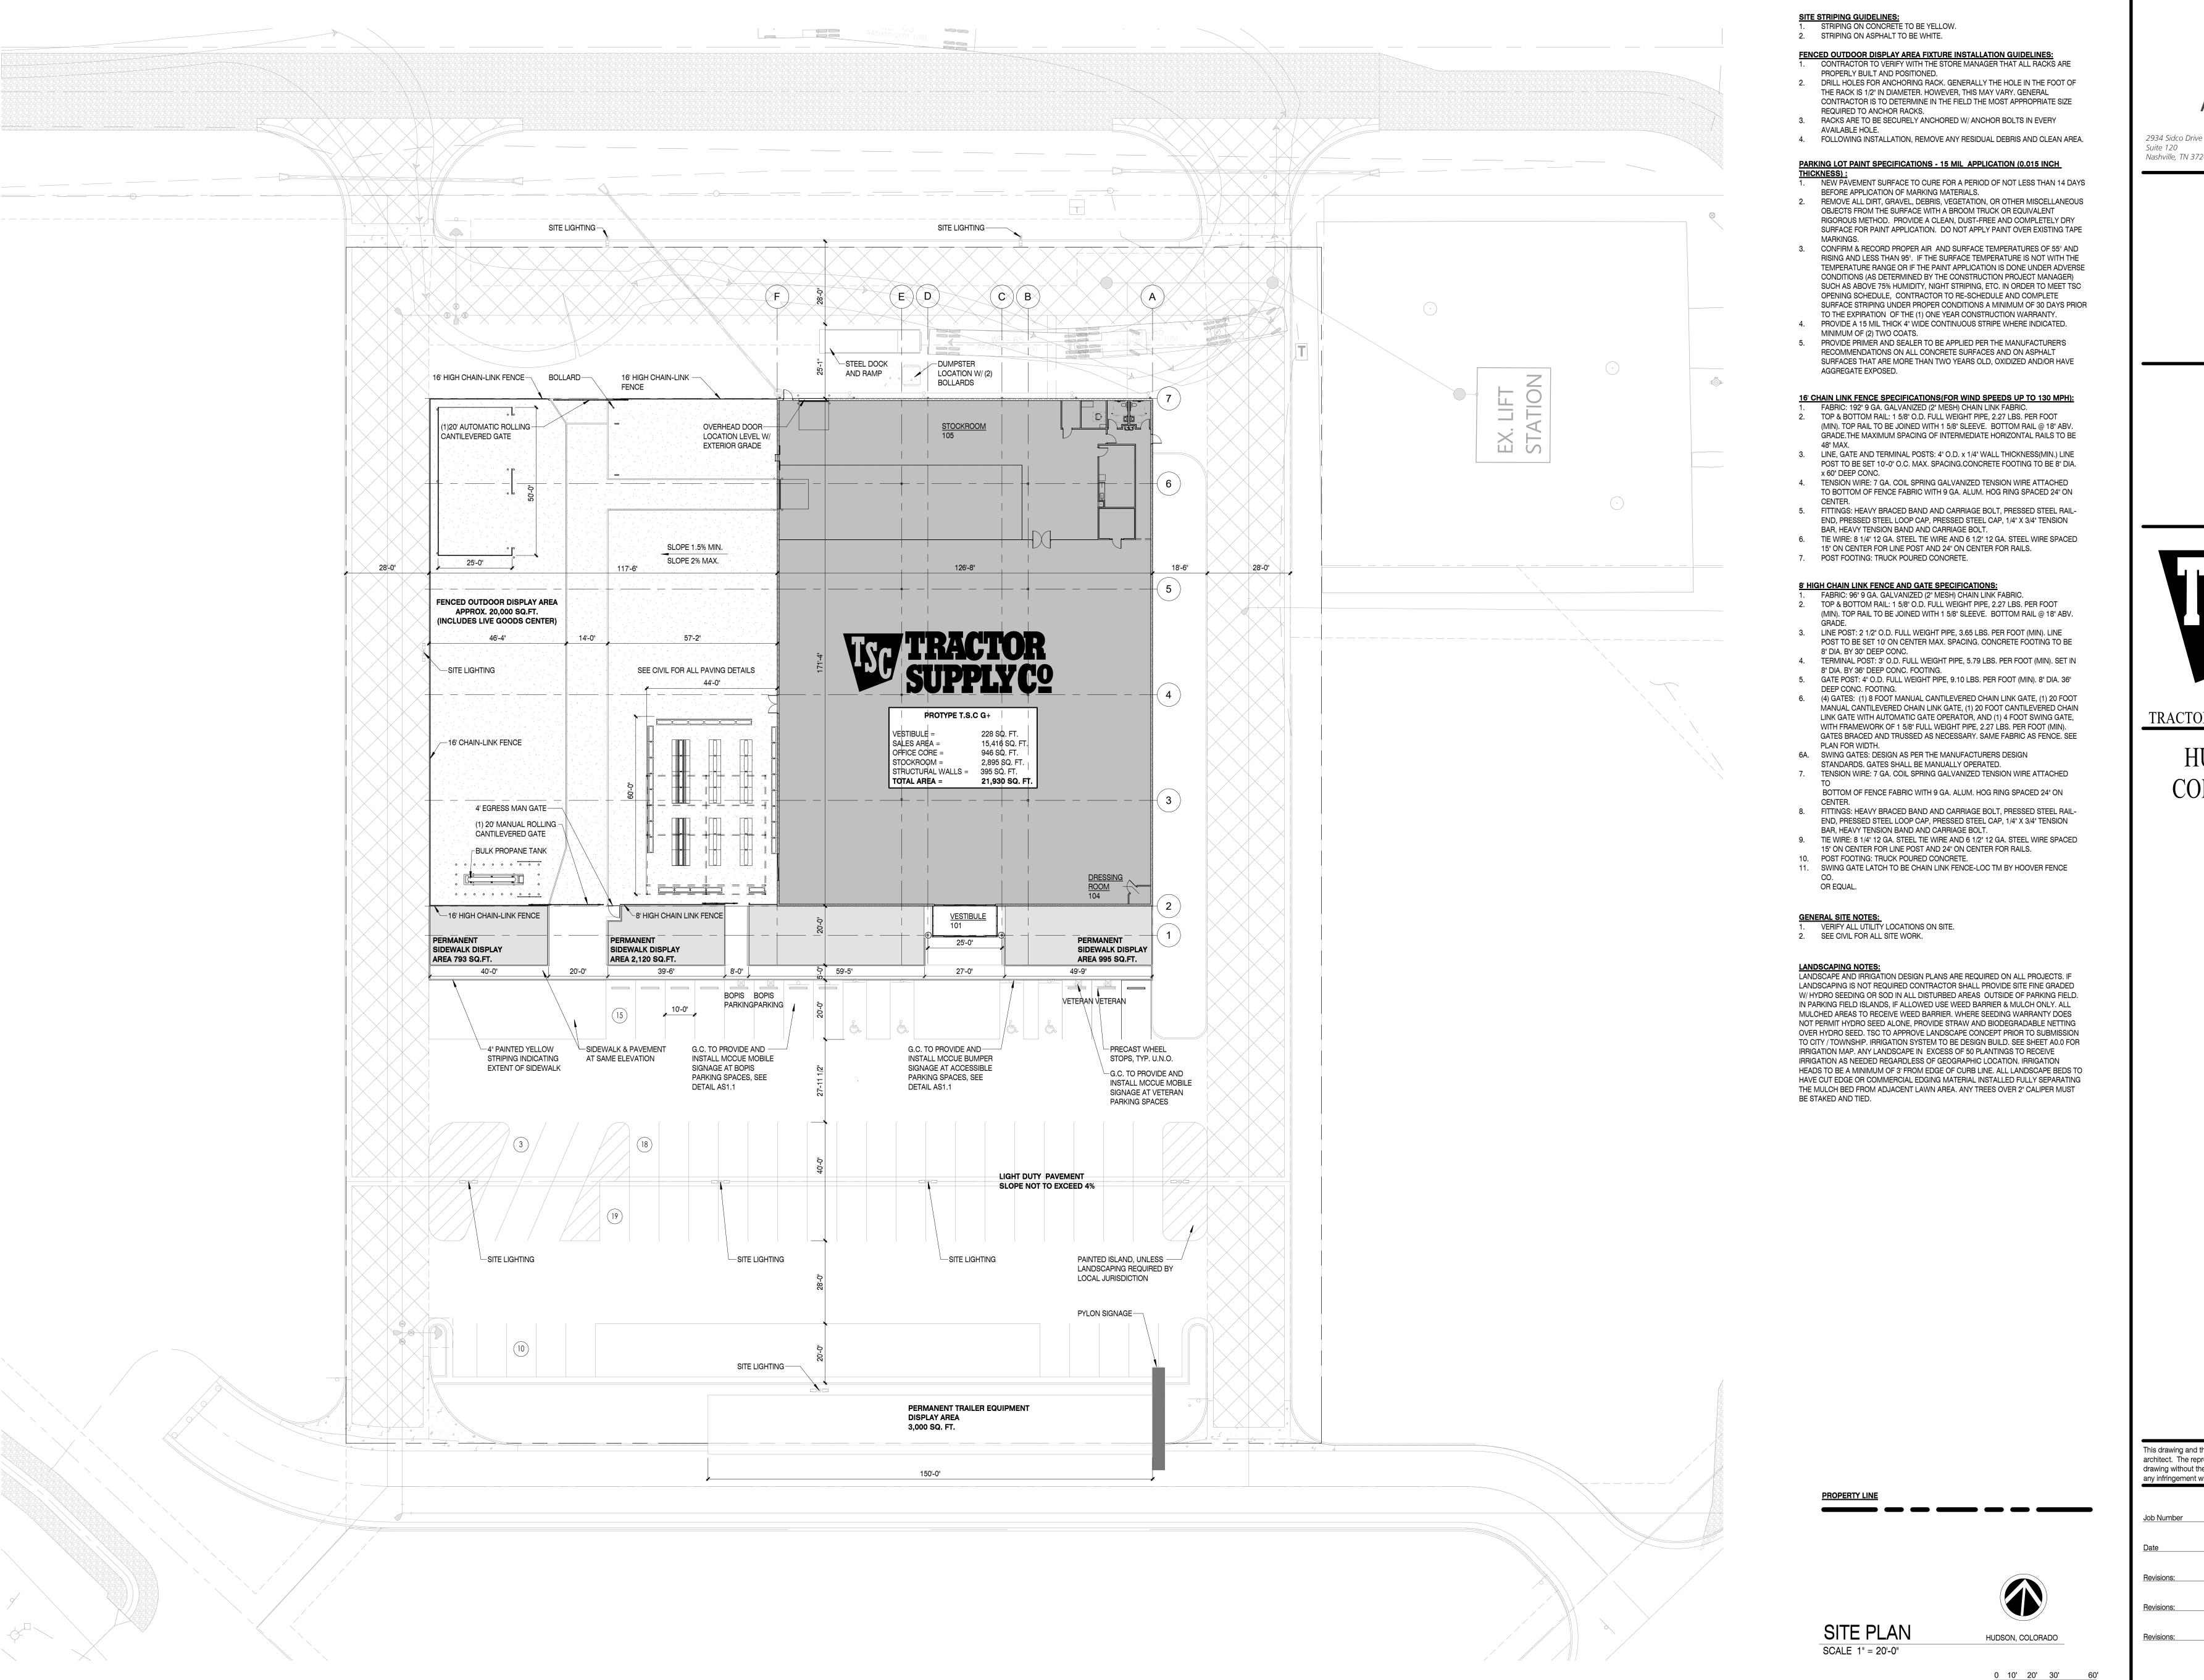



Nashville, TN 37204 Interior Architecture

TRACTOR SUPPLY COMPANY


HUDSON, COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

05.10.2024

Revisions:


SITE PLAN

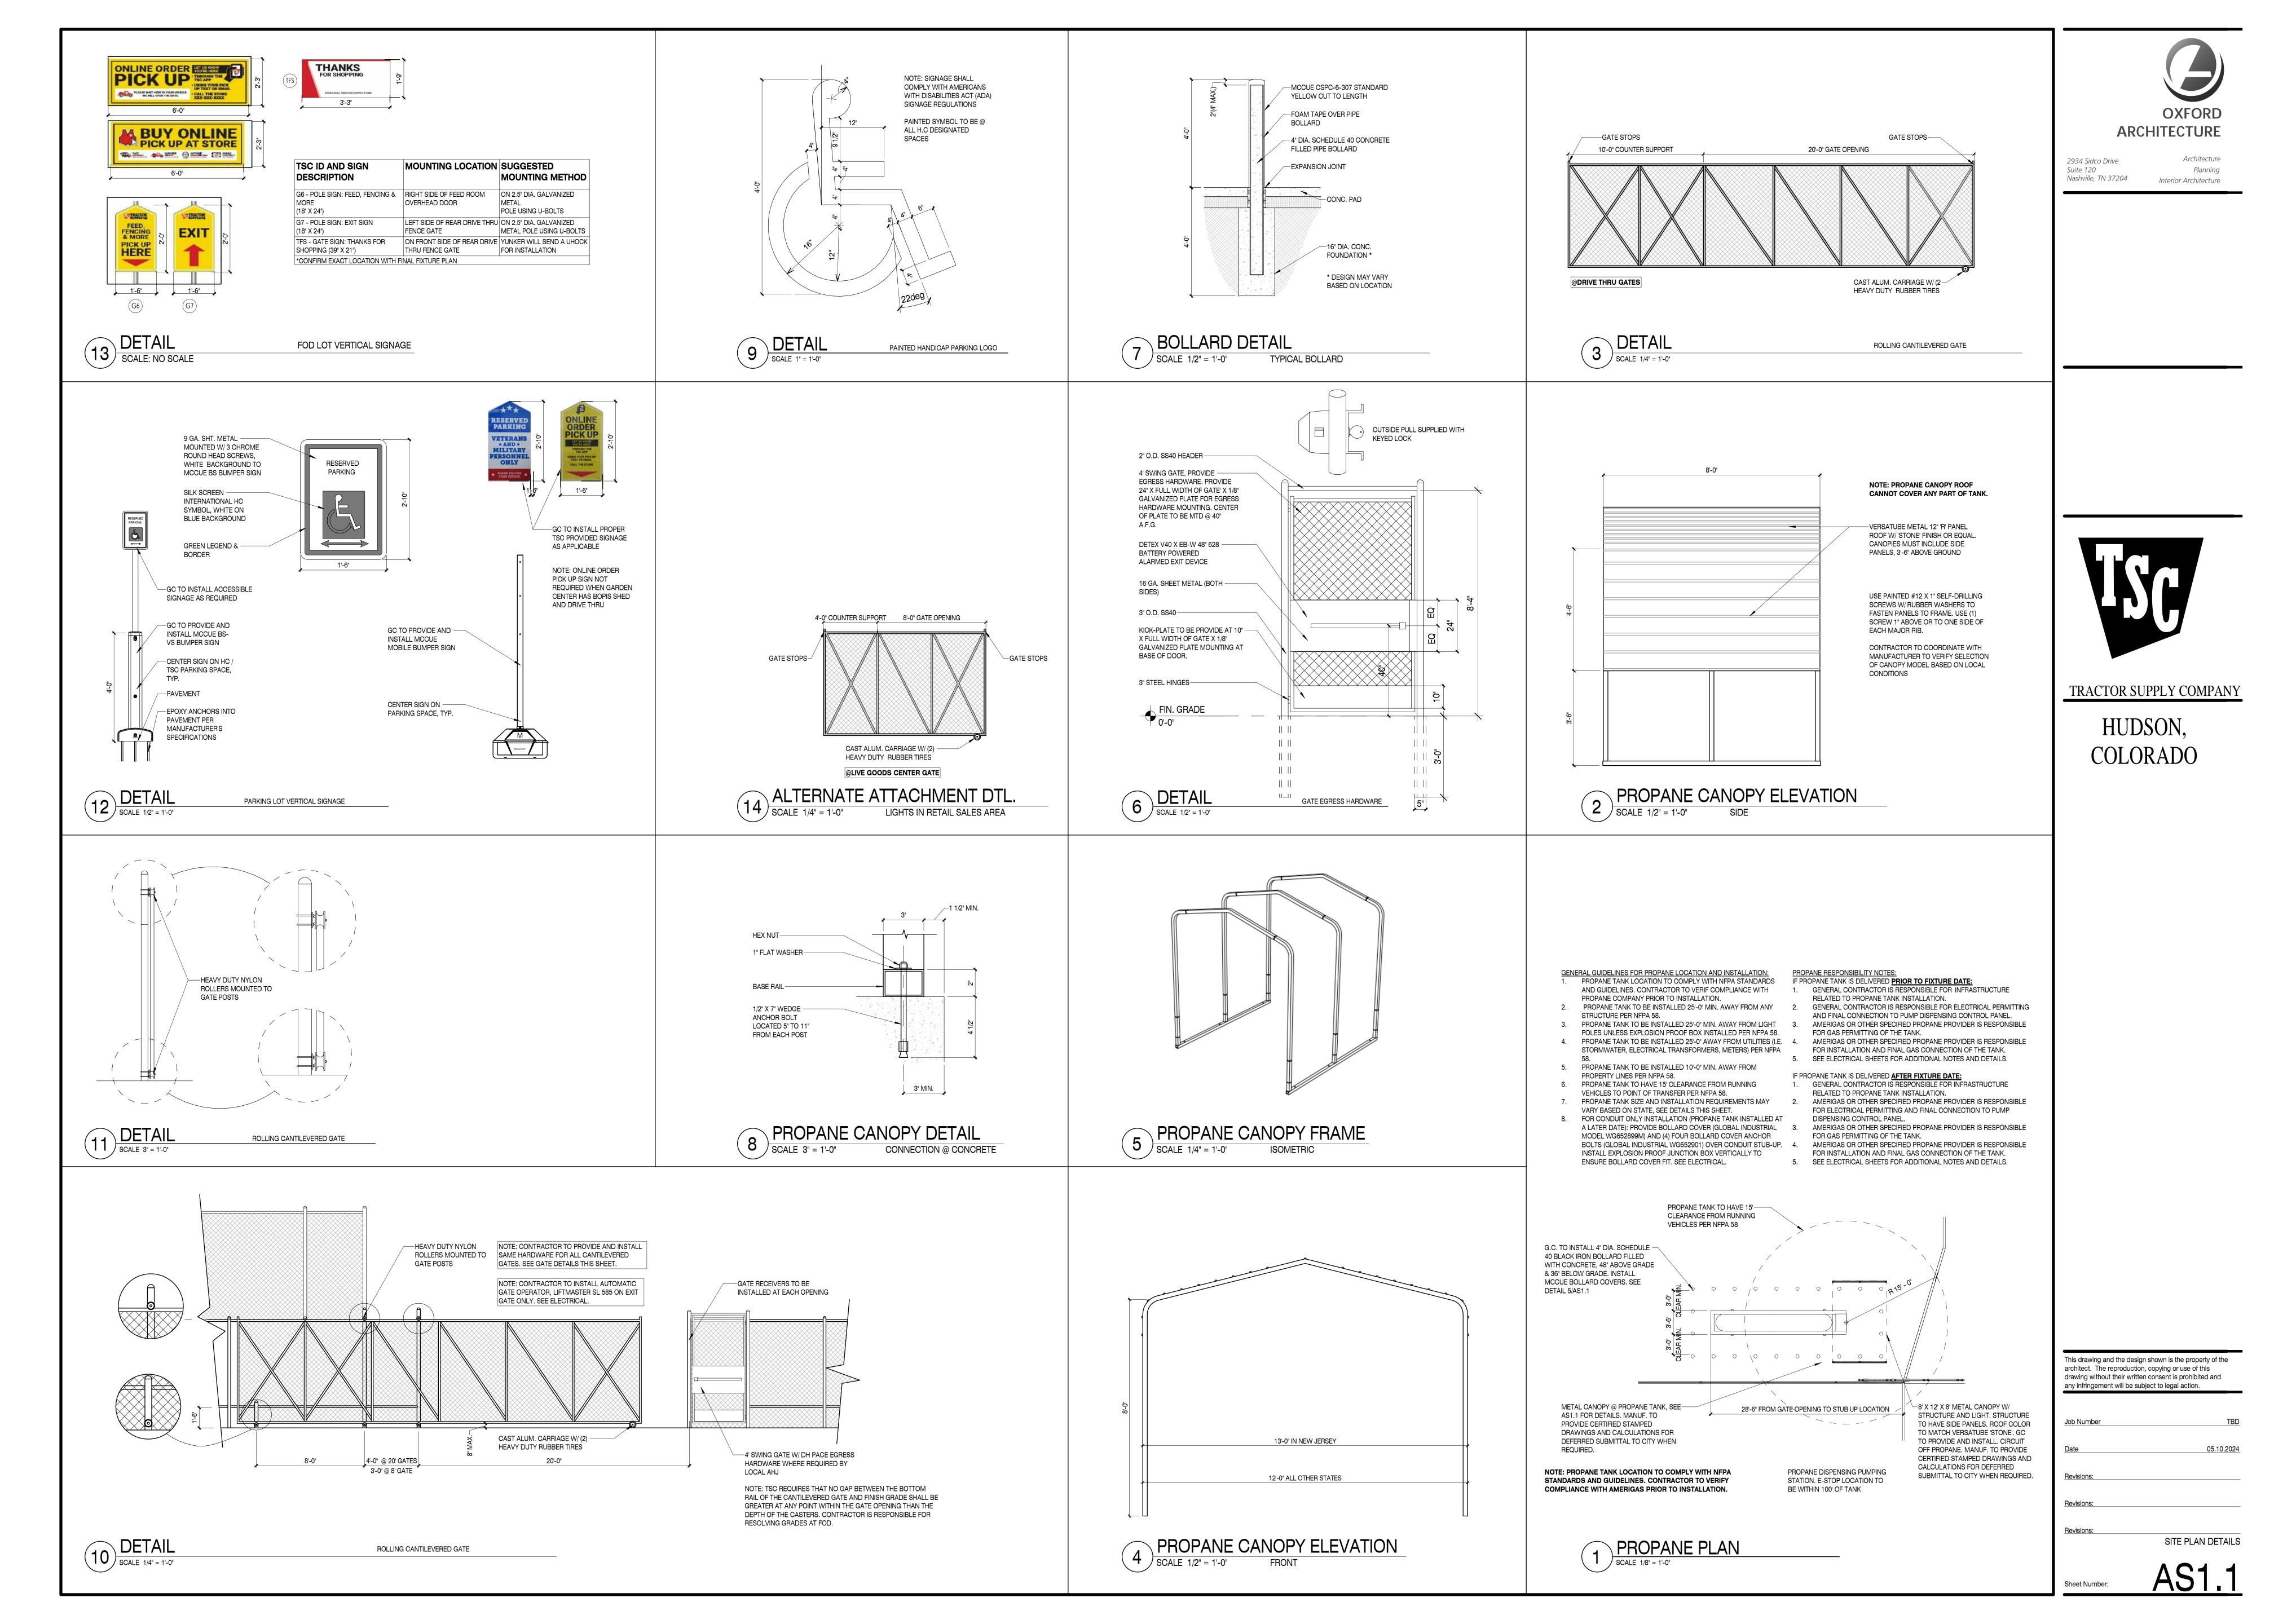


LVW RESPONSIBILITY AND TIMING PLAN

LVVV RESPONSIBILITY AND THVIING PLAN LATEST - Q4 2023								
PROTOTYPE								
ACTION	BY WHO	WHEN	SPECIAL NOTES					
STORE ADDED TO SOS	TSC REAL ESTATE	1ST MONDY OF EACH MONTH						
CODES AND BUILDING TYPE (CONTACT TSC PM AS NECESSARY) RESEARCHED, BA AND FA PLANS COMPLETED	JCI/ADT	WITHIN 30 DAYS AFTER ADDED TO THE SOS	PLEASE BE SURE TO VERIFY HVAC SYSTEMS (GROUND MOUNT VS. ROOF MOUNT, ETC) P1 TO IDENTIFY EXISTING HVAC UNITS BY LL PER THE P1 CHECKLIST					
PROTECTION ONE COMPLETES PLANS SENDS TO EDDIE FOLEY AND TSC PM	JCI/ADT	ON 30TH DAY AFTER ADDED TO SOS						
PLANS FORWARDED TO LL AND/OR THEIR ARCHITECT, IF KNOWN	TSC PM	31 DAYS						
TSC TO REVIEW LL PLANS FOR ACCURACY	TSC PM	WHEN SENT BY LL PRIOR TO CONSTRUCTION START						
LL TO COMPLETE ALL LVW SOW PER PLANS USING TSC VENDOR	MERCURY TECH	NO LESS THAN 2 WEEKS PRIOR TO FD FROM 2 WEEKS						
PROTECTION ONE TO INSTALL THEIR EQUIPMENT AND MAKE TERMINATIONS	JCI/ADT	STARTING APPROXIMATELY 3 WEEKS FROM FD TO BE DONE LAST AS LVW VENDOR COMPLETES NO LATER THAN 2 WEEKS PRIOR TO FD.						
INSTALLATION OF PA SYSTEM, PHONE SYSTEM, SPEAKERS, OUTSIDE HORNS, PHONES, PATCH PANEL, AP'S W/ ANTENNAS	STAN KOLIC / MERCURY TECH	MONDAY AND TUESDAY BEFORE FD						
INSTALLATION OF POS SYSTEMS AT ALL LOCATIONS AND TESTING OF AP SYSTEM	STAN KOLIC / MERCURY TECH	TUESDAY BEFORE FD						

ON DEVELOPER OWNED PROJECTS, DEVELOPER IS RESPONSIBLE FOR 100 % OF COST OF LVW VENDOR AND WIRING.

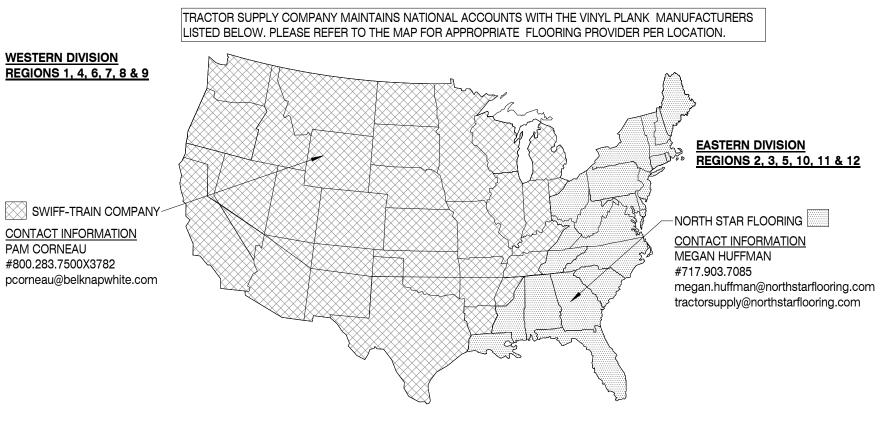


NOTE: TRACTOR SUPPLY COMPANY REQUIRES IRRIGATION TO BE INCORPORATED INTO DESIGN IN ALL SOUTHERN STATES AND ALL STATES WITH 50 OR MORE PLANTS. SEE MAP BELOW FOR LOCATIONS. CONTRACTOR TO INCLUDE NOTES FOR TRAINING STORE MANAGER ON WORKING IRRIGATION SYSTEM. (DESIGN PROFESSIONALS TO DETERMINE USE ALONG BORDER LINE)

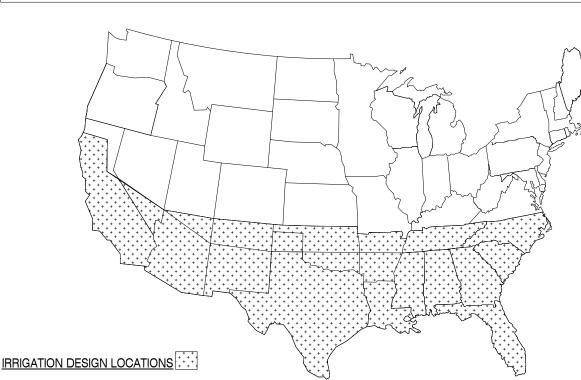

igotimes ID associates-CONTACT INFORMATION Deanna Payne dpayne@idassociatesinc.com OFFICE: 334.836.1400 ext. 122 MOBILE: 334.805.1012 BILL HOLLAND jholland@idassociates.com OFFICE: 334.836.1400 MOBILE: 334.791.0108

TRACTOR SUPPLY COMPANY MAINTAINS NATIONAL ACCOUNTS WITH THE SIGNAGE MANUFACTURERS LISTED BELOW. PLEASE REFER TO THE MAP FOR APPROPRIATE SIGNAGE PROVIDER PER LOCATION.

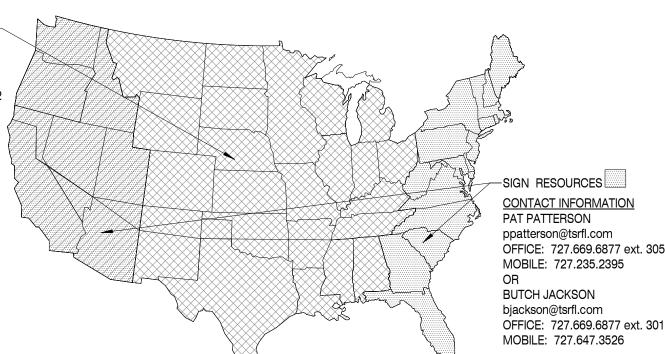

ALL CONSTRUCTION AND DETAILS SHALL COMPLY WITH ALL APPLICABLE STATE AND LOCAL BUILDING CODES AND ORDINANCES AS OF THE DATE OF THE

DRAWINGS. ANY DEVIATIONS FROM BUILDING CODES REQUIRES NOTIFICATION AND APPROVAL FROM TSC PROJECT MANAGER. THE CONTRACTOR SHALL VERIFY EXISTING CONDITIONS OF THE SITE. DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT & OWNER PRIOR TO PROCEEDING WITH CONSTRUCTION.

REMOVE ALL CONSTRUCTION AND DEMOLITION DEBRIS FROM JOB SITE DAILY. MAKE JOB PREMISES CLEAN AT COMPLETION OF PROJECT. FIRE EXTINGUISHERS SHALL BE INSTALLED IN ACCORDANCE WITH THE LOCAL FIRE DEPARTMENT PRIOR TO COMPLETION OF CONSTRUCTION.

ALL DIMENSIONS ARE FACE OF DRYWALL AT NEW WALLS AND TO FINISHED FACE AT MASONRY WALLS UNLESS NOTED OTHERWISE. NOTED DIMENSIONS TAKE PRECEDENCE OVER SCALED DRAWINGS. CONTRACTOR SHALL VERIFY ALL DIMENSIONS. IF DISCREPANCIES ARE FOUND, THE ARCHITECT AND OWNER SHALL BE NOTIFIED IMMEDIATELY

THRESHOLDS SHALL NOT EXCEED 1/2 INCH IN HEIGHT. DRYWALL TO BE HELD UP 1/2" ABOVE CONCRETE FLOOR.

THE FOLLOWING ITEMS ARE FURNISHED BY T.S.C. AND INSTALLED BY THE CONTRACTOR.

RESTROOM ACCESSORIES (NOT INCLUDING MIRRORS) FIRE EXTINGUISHERS **BRAILLE SIGNAGE**

11. THE FOLLOWING ITEMS ARE FURNISHED AND INSTALLED BY T.S.C. QUANTITY ITEM
1 "OPEN" SIGN

"CUB CADET" SIGN

T.S.C. ROAD SIGN, GENERAL CONTRACTOR TO PROVIDE POWER TO SIGN BASE. COORDINATE WITH SIGN COMPANY ASSIGNED TO THIS LOCATION

SECURITY VENDOR WORK (NOT INCLUDING LVW) PAID BY TSC

SPECIFIC MANUFACTURERS AND PRODUCTS ARE NAMED ON THE DRAWINGS TO INDICATE THE MINIMUM ACCEPTABLE LEVEL OF QUALITY. EQUAL OR BETTER PRODUCTS WILL BE CONSIDERED, SUBSTITUTES MUST BE APPROVED BY TSC PM. ALL OFFICE WALLS TO BE INSULATED.

CONCEAL ALL PIPING IN WALLS. WHERE PIPING IS TOO LARGE WALLS ARE TO BE FURRED OUT A MINIMUM TO CONCEAL PIPING.

PROVIDE WATER RESISTANT GYPSUM BOARD BEHIND ALL PLUMBING FIXTURES. 16. ALL COUNTERTOPS TO BE 2'-0" IN DEPTH UNLESS OTHERWISE NOTED.

PROVIDE SOLID BLOCKING FOR WALL HUNG CABINETS. PLUMBING FIXTURES, ACCESSORIES AND MILLWORK. 18. ALL MATERIALS USED BY ALL TRADES SHALL BE LISTED AND LABELED BY AN APPROVED AGENCY AND INSTALLED PER THE MANUFACTURES

19. TSC RESERVES THE RIGHT TO REVIEW THE BUILDING ON OR BEFORE THE EXPIRATION OF THE LL'S ONE YEAR WARRANTY. IF ANY WARRANTY OR PUNCH

LIST ITEMS ARE FOUND THE LL SHALL IMMEDIATELY CORRECT THE CONDITION AT ITS' EXPENSE WHEN SOS TRUCK COMES AS SCHEDULED, GENERAL CONTRACTOR TO ASSIST TSC STORE MANAGER WITH THE UNLOADING AND STORAGE OF ALL SOS TRUCK CONTENTS. IF GENERAL CONTRACTOR REQUESTS SOS TRUCK EARLY, GENERAL CONTRACTOR IS RESPONSIBLE FOR ALL LABOR AND EQUIPMENT

REQUIRED TO UNLOAD AND PROPER PLACEMENT AND STORAGE OF CONTENTS ONCE OFF SOS TRUCK. 21. GENERAL CONTRACTOR TO PROVIDE 2 COPIES OF SITE PLAN AND ELEVATIONS TO SIGN COMPANY ASSIGNED TO THIS PROJECT, VERIFY SIGN COMPANY W/TSC. 1 COPY OF ELEVATIONS TO POP SOLUTIONS, RICK TOWNE @ 901.795.5936 -- ARCHITECT TO E-MAIL CAD BASE OF FLOOR PLAN TO THOMAS PAYNE, THPAYNE@TRACOTORSUPPLY.COM, NO LATER THAN TWO WEEKS OP STARTING 22. GENERAL CONTRACTOR SHALL COORDINATE ENTIRE PROJECT AND SCHEDULE THE ALARM COMPANY FOR ALL ROUGH-IN AND FINAL CONNECTIONS AND

INSPECTIONS, CONTACT TSC, RICH WOOD 615,440,4721 FOR THE ALARM COMPANY ASSIGNED TO THIS LOCATION NO LATER THAN TWO WEEKS AFTER CONSTRUCTION START. REFER TO THE SECURITY VENDOR PRE-CONSTRUCTION AND PRE-INSTALLATION CHECKLIST. CLOSE-OUT REQUIREMENTS, REFER TO LEASE / CONTRACT. FOR QUESTIONS, CONTACT JULIE BANE @ 615.440.4795.

24. THE MECHANICAL CONTRACTOR SHALL FURNISH AND INSTALL ANY DUCT SMOKE DETECTOR FOR NEW WORK ONLY. COORDINATE WITH THE ASSIGNED 25. THE GENERAL CONTRACTOR SHALL PAY FOR ALL UTILITY COST DURING CONSTRUCTION AND CONTACT DEEANA GHOLSON AT ECOVA, INC. #509.329.7516

TWO WEEKS PRIOR TO FIXTURE DATE FOR TRANSFER TO TSC. DOCK ACCESS FROM ROAD MUST BE ACHIEVED 3 WEEKS PRIOR TO FIXTURE DATE.

27. THE GENERAL CONTRACTOR OR LANDLORD SHALL SUBMIT A REPORT, ON A WEEKLY BASIS INDICATING THE PERCENT COMPLETE FOR EACH LINE ITEM ON THE SCHEDULE USING THE TSC WEEKLY PROGRESS REPORT ALONG WITH PHOTOS PER PHOTO LOG ON THE BLANK REPORTS PROVIDED BY TSC. 28. THE GENERAL CONTRACTOR SHALL PROVIDE FOR INDEPENDENT INSPECTION AND CERTIFICATION FOR FOOTING COMPACTION, AND CONCRETE QUALITY AND STRENGTH. THE RESULTS ARE TO BE SUBMITTED TO THE OWNER THE G.C. SHALL LIKEWISE PROVIDE AN INDEPENDENT INSPECTOR TO CERTIFY

29. FOR RED STRIPING, CONTACT POP SOLUTIONS AT 901-795-5936, ACCOUNT REP.: RICK TOWNE. 30. LANDLORD/LANDLORD GENERAL CONTRACTOR TO VERIFY WITH LOCAL POSTMASTER IF A MAILBOX IS REQUIRED. IF SO, GENERAL CONTRACTOR TO INSTALL MAILBOX TYPE AND LOCATION PER THE POSTMASTER RECOMMENDATION AND PER USPS STANDARDS.

'J' MOLD TO BE USED AT ALL INTERSECTIONS OF GYPSUM BOARD AND ANY OTHER NON-GYPSUM MATERIAL. CORNER GUARDS TO BE USED AT ALL INTERIOR 'OUTSIDE' CORNER CONDITIONS.

PROPER INSTALLATION OF THE STRUCTURAL STEEL OR PRE-ENGINEERED METAL BUILDING SYSTEM.

33. DURING CONSTRUCTION, ANY PARTIALLY COMPLETED MASONRY WALLS (CMU, BRICK, ETC.) SHALL BE COVERED WITH STRONG WEATHER RESISTIVE MATERIAL DURING ALL TIMES WHEN CONSTRUCTION IS NOT IN PROGRESS AND ESPECIALLY AT THE END OF EACH WORK DAY. THE COVER SHALL BE DRAPED OVER THE WALL AND EXTEND A MINIMUM OF (2) TWO FEET DOWN FROM BOTH SIDES AND SECURELY HELD IN PLACE.

34. FOR SOS TRUCK DELIVERIES ON RELO STORES, COORDINATE WITH TSC STORE SERVICES SPECIALIST [CAROLINE RICE (CRICE@tractorsupply.com)] FOR RENTAL TOW-MOTOR DROP. RENTAL TOW-MOTOR SHOULD ARRIVE NO LATER THAN THE WEDNESDAY PRIOR TO FIXTURE DATE. THE RENTAL TOW-MOTOR WILL BE PICKED-UP THE MONDAY FOLLOWING THE STORE'S SOFT OPENING DATE.

35. FINISHED SPACE SHALL BE PROVIDED IN A MANNER THAT PREVENTS RODENT INTRUSION. SEAL PENETRATIONS THROUGH EXTERIOR WALL SURFACES WITH AN AEROSOL, MOISTURE-CURING POLYURETHANE FOAM SIMILAR TO "PUR BLACK" BY TODOL PRODUCTS, INC. (508.651.3818) OR APPROVED EQUAL. 36. CONCRETE MASONRY UNITS AND EXTERIOR CONCRETE MOISTURE CONTENT CRITERIA. GENERAL CONTRACTOR, OR, THE OWNERS TESTING COMPANY SHALL PROVIDE MOISTURE TESTING OF ALL CMU AND CONCRETE EXTERIOR WALL PER ASTM D4263 PRIOR TO APPLICATION OF PAIN

TSC PROJECT MANAGER MUST APPROVE THE APPLICATION OF PAINT IN WRITING, IF THE MOISTURE CONTENT IS ABOVE 15%. 38. GENERAL CONTRACTOR TO HAVE A LOCAL CONTACT WITHIN 2-HOURS FOR ALL (NON)WARRANTY ELECTRICAL AND/OR PLUMBING CALL BACK REPAIRS 39. ADD STEEL WOOL AT ALL CONDUIT/PIPE PENETRATIONS AT EXTERIOR WALLS AND ADD ESCUTCHEON PLATE AND PROVIDE SEALANT AT ALL ESCUTCHEON

FDGFS TO PREVENT RODENT INTRUSION 40. AT EXISTING HVAC CURBS, CONTRACTOR TO INSTALL STEEL WOOL AND CLOSED-CELL SPRAY FOAM AT ALL CURB PENETRATIONS TO PREVENT RODENT INTRUSION. CONTRACTOR TO VERIFY ALL WARRANTIES REMAIN INTACT AND APPROVED BY LANDLORD.

FINAL FIXTURE PLAN TO BE RECEIVED BY CONTRACTOR AND/OR LL APPROXIMATELY 8 WEEKS PRIOR TO FIXTURE DATE TO ESTABLISH PROPER PLACEMENT OF ALL COUNTERS, POWER POLES, AND WOOD GRAIN FLOORING

ON TSC OWNED PROJECTS ONLY. AN EXTREME WEATHER EVENT AND/ OR WEATHER RELATED CONDITIONS TO BE CONSIDERED FOR A CHANGE RDER TO THE BASE CONTRACT MUST BE SUBSTANTIATED AS AN EVENT EXCEEDING THE PRIOR 3 YEAR AVERAGE OF SUCH AN EVENT VIA ACCUWEATHER.COM FOR THE SPECIFIC LOCATION AND SCHEDULE OF THIS PROJECT. PROPOSED CHANGE ORDERS OR CHARGES FOR WEATHER

CLOSE-OUT BINDER REQUIREMENTS

RELATED ISSUES MUST EXCEED THAT 3 YEAR AVERAGE IN ORDER TO BE CONSIDERED.

PM X=REQUIRED			STORE # CITY/STATE SO
		RED	
PROTOTYPE	RETROFIT		CONTRACTOR SHALL PROVIDE OWNER WITH TWO CLOSE-OUT BINDERS WHICH SHALL INCLUDE THE FOLLOWING. THE CLOSE-OUT BINDERS SHALL BE SENT TO THE CONSTRUCTION COORDINATOR AT THE OWNER'S ADDRESS, 5401 VIRGINIA WAY, BRENTWOOD, TN 37027. TWO IDENTICATION CLOSE-OUT BINDERS ARE REQUIRED, EXCEPT AS PROVIDED UNDER ITEM # 6 BELOW.
Х	Х	1.	NAME, ADDRESS AND TELEPHONE NUMBER OF THE CONTRACTOR AND ALL SUBCONTRACTORS.
Χ	Х	2.	THE FINAL CERTIFICATE OF OCCUPANCY OR THE EQUIVALENT THEREOF DESCRIBED IN ARTICLE 15.5.2(b)
Х	Х	3.	AN ASSIGNMENT BY CONTRACTOR OF ALL GUARANTEES AND WARRANTIES FROM ALL SUBCONTRACTORS, VENDORS, SUPPLIERS AND MANUFACTURERS, TOGETHER WITH ORIGINALS OF ALL SUCH GUARANTEES AND WARRANTIES. (E.G. HVAC, ROOF, DOORS, WATER HEATER, ETC. AS APPLICABLE).
Х	Х	4.	COMPLETE LIST OF EQUIPMENT - COMPLETE TEMPLATE.
Х	Х	5.	CONFIRMATION IN WRITING FROM THE INSTALLER OF THE HVAC SYSTEM OR COMPONENTS THEREOF CONFIRMING THAT THE PROPER START-UP PROCEDURES WERE FOLLOWED WITH RESPECT TO SUCH SYSTEM AND ALL COMPONENTS THEREOF, IF APPLICABLE.
N/A	Х	6.	COMPLETE RETROFIT HVAC BREAKDOWN OF COSTS - COMPLETE TEMPLATE.
Χ	N/A	7.	COMPLETE PROTOTYPE HVAC INFORMATION - COMPLETE TEMPLATE.
N/A	Х	8.	CERTIFICATE OF SEWER CLEAN-OUT BY THE PERSON WHO PERFORMED THE SAME.
Х	Х	9.	DISABILITY ACCESSIBILITY INSPECTION REPORTS SENT TO THE TEXAS DEPARTMENT OF LICENSING AND REGULATION (FOR TEXAS STORES ONLY)
Х	Х	10.	A COPY OF THE PUNCH LIST SIGNED BY THE OWNER (OR STORE MANAGER, IF SO AUTHORIZED BY OWNER) CONFIRMING ALL PUNCH LIST ITEMS ARE COMPLETED.
Х	Х	11.	(1) PDF CONTAINING WORKING DRAWINGS AND PLANS AND SPECIFICATIONS REFLECTING 'AS-BUILT' CONDITIONS, WITH A SUMMARY LIST OF CHANGES, INCLUDING IN .PDF FORMAT.
Х	Х	12.	A COMPLETE SET OF FIRE SPRINKLER SHOP DRAWINGS, IF APPLICABLE.
N/A	Х	13.	A CERTIFICATE EVIDENCING THAT INSURANCE REQUIRED UNDER THE CONTRACT DOCUMENTS SHALL REMAIN IN FORCE AFTER FINAL PAYMENT AND SHALL NOT BE CANCELED, REDUCED OR ALLOWED TO EXPIRE UNTIL AT LEAST 30 DAYS PRIOR WRITTEN NOTICE HAS BEEN GIVEN TO THE OWNER.
Х	X	14.	CERTIFICATION OF WATER WELLS AN/OR SEPTIC SYSTEMS THAT DEMONSTRATE INSPECTION AND ACCEPTANCE BY THE MUNICIPALITY. THIS SHOULD INCLUDE ANY ONGOING TESTING AND/OR INSPECTIONS THAT ARE REQUIRED AS WELL AS THE INTERVAL AT WHICH TESTING AND/OR INSPECTION MUST BE COMPLETED.
N/A	Х	15.	DIGITAL PHOTOGRAPHS OF THE 'BEFORE' AND 'AFTER' OF THE FRONT VIEW OF THE STORE.
Х	Х	16.	ROOFING INSPECTION REPORT FROM THE ROOFING MANUFACTURER (SHOULD REFLECT ROOF PROPERLY INSTALLED AND AS SUCH WARRANTY 100% IN TACT).
Х	N/A	17.	CERTIFICATION FROM THE PROJECT CIVIL ENGINEER THAT THE STORM WATER DRAINAGE SYSTEM HAS BEEN CONSTRUCTED AND INSTALLED IN ACCORDANCE WITH THE APPROVED PLANS AND ALL APPLICABLE LAWS (SEE LEASE EXHIBIT).

NOTE: GENERAL CONTRACTOR / LANDLORD TO SEE LEASE / CONTRACT FOR SPECIFIC CHECKLIST

EXHIBIT H-1: TRAINING CERTIFICATION

COPY OF THIS EXECUTED DOCUMENT TO BE INCLUDED IN THE CLOSE OUT DOCUMENTS PROVIDED BY THE GENERAL CONTRACTOR (FOR RETRO FIT BY TENANT) OR LANDLORD (RETRO FIT BY LL AND GROUND UP PROJECTS) TO TRACTOR SUPPLY COMPANY!

	1520115 (11211	TO THE PERMITS GROUND OF THIS EAST OF THE POST OF THE
INITIAL TSC STORE MANAGER	INITIAL GC	TRAINING HAS BEEN COMPLETED WITH THE STORE MANAGER BY THE GENERAL CONTRACTOR ON HOW TO USE, OPERATE AND MAINTAIN:
		THE IRRIGATION SYSTEM. ALSO, THE TSC STORE MANAGER HAS BEEN ADVISED THAT THE STORE IS RESPONSIBLE FOR MAINTAINING ALL LANDSCAPING STARTING AT EITHER FIXTURE DATE OR COMPLETION DATE, THE LATTER OF THE TWO DATES.
		THE LIGHT TIMER SYSTEM INCLUDING REVIEW OF THE SCHEDULE
		THE HVAC SYSTEM OPERATION INCLUDING HOW TO ADJUST THE PROGRAMMABLE THERMOSTATS.
		THE AUTOMATIC FRONT DOORS OPERATIONS INCLUDING SENSOR ADJUSTMENTS.
		THE OVERHEAD DOORS OPERATIONS INCLUDING TIMER, TIMER OVERRIDE, AND SAFETY EDGE.
		THE DELAY EGRESS DOOR (THE RESET BUTTON IS IN THE CONTROL BOX AND HAS TO BE RESET ANY TIME POWER IS LOST).
		STORE #
		CITY/STATE
		STORE MANAGER
		GENERAL CONTRACTOR

TSC / VENDOR CONTACT INFORMATION

(CLOSED SPECS.)

TRACTOR SUPPLY FIXTURE PLANS

CARL ADLER, STORE PLANNING MANAGER #615.647.2641

caadler@tractorsupply.com

PEYTON TONEY, RETAIL STORE PLANNER ptoney@tractorsupply.com

DOORS, FRAMES, & DOOR HARDWARE

NATIONAL ACCOUNTS CONSTRUCTION TEAM (NAC)

DH PACE #888.722.3667X10031

tscdoors@dhpace.com LEAD TIME: 2 WEEKS - HOLLOW METAL FRAMES 3 WEEKS - PRE-PAINTED & HPI DOORS 6-8 WEEKS - WIND RATED ASSEMBLIES & COASTAL *DH PACE UNCRATING DOOR PACKAGE QR CODE:

SCAN WITH SMARTPHONE OR TABLET TO WATCH VIDEO

NATIONAL ACCOUNTS CONSTRUCTION TEAM (NAC)

DH PACE #888.722.3667X10031 tscdoors@dhpace.com

5-6 WEEKS - SECTIONAL & COILING DOORS *USE COILING DOORS IN HIGH IMPACT REGIONS

STOREFRONT DOORS

BILL GERARDIN, NATIONAL ACCOUNT MANAGER ALLEGION ACCESS TECHNOLOGIES

#480.257.0619 william.gerardin@allegion.com SAMANTHA FAULSTICK, NATIONAL ACCOUNTS PM ALLEGION ACCESS TECHNOLOGIES

#843.962.0996 samantha.faulstick@allegion.com LEAD TIME: 6 WEEKS

LIGHTING PROVIDER

VILLA LIGHTING SUPPLY, INC. #314.633.0546 bryan.birdwell@villalighting.com LEAD TIME: 3-5 DAYS - INT/EXT LIGHTING 3-4 WEEKS - SITE POLE LIGHTING

ADAM CARRIER, NATIONAL ACCOUNTS MANAGER VILLA LIGHTING SUPPLY, INC. #314.633.0532 adam.carrier@villalighting.com LEAD TIME:

- INT/EXT LIGHTING 3-5 DAYS 3-4 WEEKS - SITE POLE LIGHTING ANNE VOELKER, PRICING CONTACT

#314.633.0554 tractorsupply@villalighting.com - INT/EXT LIGHTING - SITE POLE LIGHTING 3-4 WEEKS

HVAC PROVIDER

VILLA LIGHTING SUPPLY, INC.

STEVEN PETER, NATIONAL ACCOUNTS #800.367.6285 NationalAccountRequest@lennoxind.com

LEAD TIME: 6 WEEKS ERIN DUNIGAN

#972.497.6709 Erin.dunigan@lennoxind.com LEAD TIME: 6 WEEKS

HVAC PROVIDER LISA JUMP, NATIONAL ACCOUNT SALES MANAGER

YORK / JOHNSON CONTROLS #800.481.9738 x 6531 TOLL FREE #405.419.6527 DIRECT

lisa.e.kuhns@jci.com be-na-tractorsupply@jci.com

LEAD TIME: 3-4 WEEKS

JOE RAY, SALES APPLICATION ENGINEER YORK / JOHNSON CONTROLS #405.419.6631 DIRECT

#1.800.481.9738 QUOTE REQUEST joe.ray@jci.com be-na-tractorsupply@jci.com LEAD TIME: 3-4 WEEKS

PROPANE COORDINATION

MOLLIE TRELOAR - BUYER - HEATING AND COOLING TRACTOR SUPPLY COMPANY

615.440.4230 mtreloar@tractorsupply.com

MARIAH CRAYTON - ASSOCIATE BUYER - HEATING AND TRACTOR SUPPLY COMPANY

mcrayton@tractorsupply.com LIVE GOODS CENTER

JALIYAH SANFORD MERCHNEY GREENHOUSES SCHEDULING & MATERIALS #864.314.0603

jaliyah@merchneygreenhouses.com

615.647.2639

| FIXTURE ANCHORING

BRENDON COLLINS, PROJECT TAMARACK GROVE #208.908.7874

brendon.collins@tamarackgrove.com

DANIEL CHAISSON, REGIONAL ACCOUNT EXECUTIVE THE SHERWIN-WILLIAMS COMPANY #901.484.3409

daniel.chaisson@sherwin.com TOM KERR, CORPORATE ACCOUNT MANAGER PPG PAINTS

#614.580.8305 thomas.kerr@ppg.com

UTILITY TRANSFER INFORMATION

JAMES MASTERS, TSC ENERGY MANAGER #615.440.4396

jmasters@tractorsupply.com

TractorSupplyOPCL.insight@engie.com (FOR LP ACCOUNTS FOR BUILDING HEAT CALL AMERIGAS)

RON KING, NATIONAL ACCOUNTS MANAGER

ADT

ronaldking@adt.com DUKE DAUGHTREY, PROJECT MANAGER

#229.896.5041

ddaughtrey@adt.com

gail.drake@jci.com

FIRE ALARM & SECURITY SYSTEMS

GAIL DRAKE, STRATEGIC ACCOUNT MANAGER #916.342.5277

tscsupport@jci.com BRIAN COUSINS, PROGRAM MANAGER

#720.313.3919 brian.cousins@jci.com

*NOTE: JCI CONTRACTS DIRECTLY WITH TSC FOR FIRE ALARM AND SECURITY SYSTEMS,

ELECTRIC PANEL CAMERON KEANE, ACCOUNT MANAGER

CAROLINA PRODUCTS, INC. (CPI) #704.364.9029 OFFICE #919.621.9038 CELL cameronk@cpipanels.com LEAD TIME: 6 WEEKS

GAGE PERRY PHILIPS TELETROL #603.716.0636

g.perry@brainboxai.com **LOW VOLTAGE PROVIDER**

TERRY L CORPENING MERCURY TECH PARTNERS, INC. #828.465.7348 x 221 terry@gomtp.com DUANE MULLINS

RESTROOM DRYERS

MERCURY TECH PARTNERS, INC.

WORLD DRYERS DISTRIBUTOR #800.459.7099 ashley.may@hjcinc.com

#828.465.7348 x 344

duane@gomtp.com

cory@jwrinc.net

CORY GARDNER, NATIONAL ACCOUNTS MANAGER JWR. INC. 888.699.2848

METAL RAMP DISTRIBUTOR

TONY HAMILTON QSI ENVIRONMENTAL & INDUSTRIAL STEEL FABRICATORS

#334.793.6878 thamilton@qsisteel.com LEAD TIME: 3 WEEKS

METAL RAMP DISTRIBUTOR

TONY HAMILTON QSI ENVIRONMENTAL & INDUSTRIAL STEEL #334.793.6878

PARKING SIGNS / BOLLARD COVERS

#404.405.8101 scoats@mccue.com

thamilton@qsisteel.com

LEAD TIME: 3 WEEKS

PROPANE CANOPY

SPENCER BRATTON VERSATUBE BUILDING SYSTEMS #901.614.2192

<u>SIGNS</u>

MIKE ZECK

YUNKER SIGNAGE #414.339.5349 mwendling@yunker.com

MICHELLE WENDLING, ACCOUNT MANAGER

#615.220.5320 ctolley@liftone.net

LIFTONE #615.295.9013 mzeck@liftone.net **BRANDEN HARRISON**

HYSTER YALE GROUP #252.364.6382 branden.harrison@hyster-yale.com

SIGNAGE MANUFACTURER REFER TO THE TERRITORY MAP FOR APPROPRIATE VENDOR, SEE THIS SHEET

VINYL PLANK FLOORING

APPROPRIATE VENDOR, SEE THIS SHEET

(RECOMMENDED ONLY) **RED STRIPING**

RICK TOWNE POP SOLUTIONS GROUP #901.483.5929 (CELL) #901.795.5936 x 19 (OFFICE) rtowne@popsolutionsgroup.com

WASTE AND RECYCLING VENDOR DIANE HUEFFMEIER, PROGRAM

SKYLIGHTS SUSAN FLANAGAN VELUX COMMERCIAL DAYLIGHTING #864.813.6896

susan.flanagan@velux.com

ROCKTENN COMPANY #314.292.3313

dhueffme@rocktenn.com

MANAGER

PRINTING SHERI RYDER PLAN EXPRESS #866.404.2614

gavin.1.ellis@jci.com

customerservice@planexpress.net FIRE SPRINKLER SYSTEMS

KAREN PATRICK, ACCOUNT MANAGER

#317.710.5137 karen.patrick@jci.com GAVIN ELLIS, NATIONAL ACCOUNT MANAGER #205.641.4031

Revisions: TENANT CRITERIA & VENDOR INFORMATION

This drawing and the design shown is the property of the

architect. The reproduction, copying or use of this

any infringement will be subject to legal action.

Job Number

Revisions:

Sheet Number:

drawing without their written consent is prohibited and

05.10.2024



2934 Sidco Drive

Nashville, TN 37204

Suite 120


Architecture

Interior Architecture


HUDSON,

TRACTOR SUPPLY COMPANY

ADA SIGNAGE

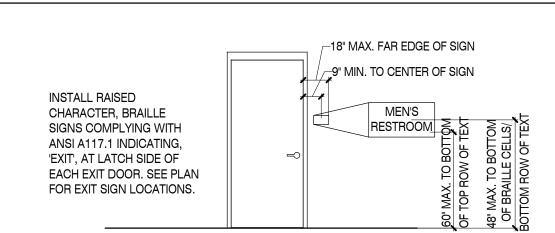

PET WASH STOREFRONT

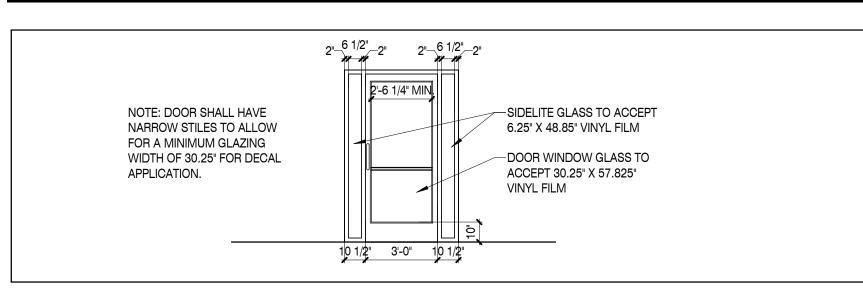

DRAIN MANAGEMENT PROGRAM

RETROFIT	NOTE:	
Х	1.	ALL DRAINS, VENTS, ETC. MUST BE TAPED OVER DURING CONSTRUCTION TO PREVENT DEBRIS FROM INFILTRATING THE LINES
Х	2.	GC/DEVELOPER IS REQUIRED TO SUBMIT PHOTOS OF TAPED DRAINS
Х	3.	GC WILL BE FINED \$150 PER DAY IF PHOTOS ARE NOT SUBMITTED BY THE BEGINNING OF WEEK TWO OF THE PROJECT OR IF ANY DRAIN IS DISCOVERED UNCOVERED DURING A PM SITE VISIT. FINES WILL TERMINATE ON THE DAY THAT PHOTOGRAPHIC EVIDENCE OF COMPLETION IS SUBMITTED TO AND VERIFIED BY THE TRACTOR SUPPLY PM.
Х	4.	GC/DEVELOPER WILL BE REQUIRED TO JET AND CAMERA ANY LINE IN WHICH THE DRAIN IS DISCOVERED UNCOVERED. RECEIPTS AND VIDEO MUST BE SUBMITTED TO TRACTOR SUPPLY FOR VERIFICATION.
Х	5.	DRAIN MANAGEMENT SIGNAGE WILL BE PROVIDED BY TRACTOR SUPPLY AND INSTALLED BY THE GC/DEVELOPER.
N/A	6.	IF SIGNAGE IS NOT INSTALLED @ PUNCH, CLEANING/CAMERA POLICY WILL APPLY.
	7.	GC WILL BE FINED \$150 PER DAY IF SIGNAGE IS NOT INSTALLED AT PUNCH. FINES WILL TERMINATE ON THE DAY THAT PHOTOGRAPHIC EVIDENCE OF COMPLETION IS SUBMITTED TO AND VERIFIED BY THE TRACTOR SUPPLY PM.
	x x x x x	X 1. X 2. X 3. X 4. X 5. N/A 6.

Tract	or Supply Co./Alarm Inte	egrator -	Pre-Installa	ition Check	list
Upon completion, FAX	s form must be obtained by the or e-mail the completed form Company Loss Prevention) at	to your P	roject Manage	er/Coordinato	r and to Rich
Store #/City:	Integrator	1			
Fixture Date: Key Contacts	Soft Open Date:		Retro Fit	or Prototype	
GC Site Super		_	Phone/Email:		
Alarm Site Rep:		_	Phone/Email:		
Alarm Proj Mgr:		_	Phone/Email:		
ATTICLE TO THE PARTY OF THE PAR	ich Wood, office 615-440-472	1, cell 330)-554-4757, r w	ood@tractors	supply.com
Pre-Construction Revie			· v-rankensaa vaaria	tors whereast agrees transportationers for	
	ractor?		Voltage Wirin		ete?
Who is responsible for tu	rning in the fire submittals?				
Is the Riser located in the	e Tractor Supply space?	YES	NO		
Can alarms connect to it	?	YES	NO		
What date will Riser poin	ts will be ready for connection?				
Any unusual HVAC issue	s with the building or from the I	andlord?	YES	NO	
ls Global Shutdown requ	ired at this site?		YES	NO	
> Who is respo	nsible for the Global Shutdown	GC or Med	chanical?		
> Company Na	me				
> What date wil	Duct Detectors be ready for co	onnection?			
> Does alarm v	endor have any additional resp	onsibilities	with HVAC uni	ts?	
What date will the Final I	nspection will be called for by G	C? (By Th	ursday before	Fixture)	
If there is any change of	A inspection will be completed or delay to the inspection date d immediatley via email and p	e by the G			notify TSC Project
Other Key Dates					
What date will Interior Pa	inting will be completed?			18	
What date is Site Floor P	reparation scheduled?	8			
What date will the Front I	Doors will be installed by?				
What date will the Delaye powered and be ready fo	Control of the Control of Control of the Control of				
PE Beam Details		E			
Will 3 PE Beams cover a	Il sides of the outdoor lot fence	line?	YES	NO	
> If not, how man	ny additional beams will be nee	ded?			
> What is the s	urface type of the fenced area?		Concrete	A sphalt	
	ttached to the store? UDE A DRAWING OF THE PR	ODOSED	ENCED ARE	A WITH THIS	CHECK! 161***

PE Beams are not authorized for detached lots without TSC SSC LP Approval.

Site Superintendent (Signature)

Was this Pre-Install Checklist completed by phone or by site visit?

Alarm Vendor Rep (Signature)

COLOR SCHEDULE

22 GAUGE GALVANIZED CORRUGATED STEEL PANEL. - 'MATTE / WEATHERED' FINISH

(16 MILS WET, 7.5 MILS PER DRY COAT)

GALVANIZED STANDING SEAM METAL ROOFING (ROOF AT VESTIBULE GABLE) METAL SIDING 26 GA. MTL. REVERSE "R" PANEL. - COLOR TO BE DETERMINED BASED ON BUILDING TYPE ON PRE ENGINEERED BUILDINGS CONCRETE MASONRY UNITS AND EXTERIOR CONCRETE MOISTURE CONTENT CRITERIA GENERAL CONTRACTOR, OR, THE OWNERS TESTING COMPANY SHALL PROVIDE MOISTURE TESTING OF ALL CMU AND CONCRETE EXTERIOR WALL PER ASTM D4263 PRIOR TO APPLICATION OF PAINT. TSC PROJECT MANAGER MUST APPROVE THE APPLICATION OF PAINT IN WRITING, IF THE MOISTURE CONTENT IS ABOVE 15%.

CONCRETE MASONRY UNITS FOR CONVENTIONAL BUILDINGS.

ELASTOMERIC SYSTEM FLAT FINISH - COLORS TO MATCH SW7513 SANDERLING TO 4'-0" A.F.F., SW7532 URBAN PUTT

FROM 4'-0" A.F.F. TO TOP OF C.M.U. ON ALL SIDES. 1ST COAT: S-W LOXON ACRYLIC BLOCK SURFACER, LX01W0200 (50-100 SQ FT/ GAL @ 16 MILS WET; 8 MILS DRY) 2ND COAT: S-W CONFLEX XL SMOOTH HIGH BUILD ACRYLIC COATING, CF11 SERIES 3RD COAT: S-W CONFLEX XL SMOOTH HIGH BUILD ACRYLIC COATING, CF11 SERIES

BRUSH, ROLLER OR AIRLESS SPRAYER; HOWEVER, ALL COATS MUST BE BACK-ROLLED. SEE SHERWIN WILLIAMS DATA SHEET APPLICATION

RED ACCENT STRIPE

HIGH GLOSS FINISH - COLOR TO MATCH SW4081 SAFETY RED FROM 10'-0" A.F.F. TO 10'-8" A.F.F., FRONT, LEFT, AND RIGHT SIDES 2 COATS: S-W ACROLON 100, B65R720 PART A SAFETY RED/ B65V720 PART B HARDENER - APPLY AS NEEDED FOR COMPLETE COVERAGE)

APPLY TO EXTERIOR RED STRIPE ONLY - CLEAR COAT GLOSS FINISH - DIAMOND-CLAD WB 3 COMPONENT, LOW VOC WATERBASED ACRYLIC POLYURETHANE CLEAR COAT DIAMOND-CLAD CLEAR COAT URETHANE GLOSS CLEAR PART A (B65T175

(ACCEPTABLE TOLERANCE IS 9-10 PINHOLES PER SQ. FT.

DIAMOND-CLAD CLEAR COAT URETHANE HARDNER PART B (B65V175) DIAMOND-CLAD CLEAR COAT URETHANE CATALYST PART C (B65C175) MIX COMPONENTS PER MANUFACTURERS SPECIFICATIONS COAT ACROLON WITHIN 48 HOURS RECOMMENDED SPREAD RATE (WET MILS: 2.4-4.8 AND DRY MILS: 1.0-2.0)

NOTE: CONTRACTOR TO ACCESS A0.0 ASD1.PDF ON PLAN EXPRESS FOR ALTERNATE PAINT SPECIFICATION BY PPG.

S-W KEM KROMIK UNIVERSAL METAL PRIMER, B50Z SERIES (6.0 -

S-W INDUSTRIAL ENAMEL HS, B54Z400 SERIES (2.0 - 4.0 MILS DRY

8.0 MLS WET / 3.0 -4.0 MLS DRY PER COAT) S-W INDUSTRIAL ENAMEL HS, B54Z400 SERIES

(APPLY AS NEEDED FOR COMPLETE COVERAGE)

RECOMMENDATIONS

NOTE: APPLICATIONS MAY UTILIZE

RED STRIPE BY POP SOLUTIONS AROUND VESTIBULE BUMP OUT TO MATCH RED STRIPE SW 4081 SAFETY RED LIGHTING POLE BASES LOADING DOCK GUARDRAILS. HOLLOW METAL DOOR & FRAMES COLOR TO BE SW4084 COLOR TO MATCH SW1012 POWER GREY GLOSS FINISH -

LX01W0200 (50-100 SQ FT GAL @ 16MILS WET; 8 MILS 2ND COAT: S-W CONFLEX XL SMOOTH HIGH BUILD ACRYLIC COATING, CF11 SERIES S-W CONFLEX XL SMOOTH

SAFETY YELLOW

BLOCK SURFACER,

1ST COAT: S-W LOXON ACRYLIC

HIGH BUILD ACRYLIC COATING, CF11 SERIES (APPLY AS NEEDED FOR COMPLETE COVERAGE PRODUCT IS PACKAGE SAFETY YELLOW; COLOF ACCEPTANCE SHOULD BE APPROVED BY TRACTOR SUPPLY.

PER COAT)

6" SCHEDULE 40 CONCRETE FILLED PIPE BOLLARD WITH MCCUE POST COVER CSPC-6-307 STOREFRONT FRAMING CLEAR ANODIZED ALUMINUM

INTERIOR FINISHES:

MASONRY (CONCRETE, SCORED, SMOOTH, HIGH/LOW DENSITY SEMI-GLOSS FINISH - COLOR TO MATCH SW7005 PURE WHITE 1ST COAT: S-W PREPRITE BLOCK FILLER B25W25 (75-125 SQ. FT./GAL @ 16 MILS WET; 8 MILS DRY) 2ND COAT: S-W PROMAR 400 ZERO VOC INTERIOR LATEX SEMI-GLOSS, B31W04651 SERIES 3RD COAT: S-W PROMAR 400 ZERO VOC INTERIOR LATEX SEMI-GLOSS, B31W04651 SERIES

NOTE: APPLICATIONS MAY UTILIZE BRUSH, ROLLER OR AIRLESS SPRAYER; HOWEVER, ALL COATS MUST BE BACK-ROLLED. SEE SHERWIN WILLIAMS DATA SHEET APPLICATION RECOMMENDATIONS

INTERIOR LATEX PRIMER, B28W02600

GC TO PAINT EXPOSED CONDUIT IN RETAIL SALES

RED ACCENT STRIPE (IN RETAIL SALES AREA - 10'-3" TO

1ST COAT: S-W PROMAR 200 ZERO VOC INTERIOR

2ND COAT: S-W PROMAR 200 ZERO VOC INTERIOR

3RD COAT: S-W PROMAR 200 ZERO VOC INTERIOR

LATEX PRIMER, B28W02600 (4 MILS. WET, 1.2 MILS

SEMI-GLOSS FINISH - SW 4081 SAFETY RED

AREA TO MATCH INTERIOR WALL FINISH

(4 MILS WET, 1.3 MILS DRY PER COAT)

OUTER CORE AREAS DRYWALL AND INTERIOR DRESSING ROOM WALLS SEMI-GLOSS FINISH - SW 4081 SAFETY RED 1ST COAT: S-W PROMAR 200 ZERO VOC INTERIOR LATEX PRIMER, B28W02600

(4 MILS. WET, 1.2 MILS DRY) 2ND COAT: S-W PROMAR 200 ZERO VOC INTERIOR LATEX SEMI-GLOSS, B31R02658 3RD COAT: S-W PROMAR 200 ZERO VOC INTERIOR LATEX SEMI-GLOSS, B31R02658 RED ACCENT STRIPE (IN RETAIL SALES AREA - 10'-3" TO BOTTOM OF STRIPE, 12" STRIPE) INNER CORE AREAS

SEMI-GLOSS FINISH - (COLOR TO MATCH SW7036 ACCESSIBLE BEIGE.) 1ST COAT: S-W PROMAR 200 ZERO VOC INTERIOR LATEX PRIMER, B28W02600 (4 MILS WET, 1.3 MILS DRY PER COAT) 2ND COAT: S-W PROMAR 400 ZERO VOC INTERIOR LATEX SEMI-GLOSS. B31W04651 SERIES

3RD COAT: S-W PROMAR 400 ZERO VOC INTERIOR LATEX SEMI-GLOSS, B31W04651 SERIES (4 MILS WET, 1.3 MILS DRY PER COAT) WOOD (DOORS) SEMI-GLOSS FINISH - COLOR TO MATCH SW1012 POWER GREY 1ST COAT: S-W PREPRITE 200 ZERO VOC INTERIOR LATEX PRIMER, B28W02600

(4 MILS WET, 1.3 MILS DRY PER COAT) 2ND COAT: S-W PROMAR 400 ZERO VOC INTERIOR LATEX SEMI-GLOSS, B31W04651 SERIES 3RD COAT: S-W PROMAR 400 ZERO VOC INTERIOR LATEX SEMI-GLOSS, B31W04651 SERIES

(4 MILS WET, 1.3 MILS DRY PER COAT)

INTERIOR COLUMNS (METAL)

VINYL BASE

LATEX SEMI-GLOSS, B31R02658 EXPOSED DECK & JOISTS (PRE-PRIMED GREY) PREFERED OR AS APPROVED BY TSC EXTERIOR METAL AND INTERIOR WOOD DOORS: (COLOR TO MATCH SW1012, POWER GREY) 1ST COAT: S-W KEM KROMIK UNIVERSAL METAL PRIMER, B50Z SERIES (COLOR TO MATCH SW7513, SANDERLING @

BOTTOM OF STRIPE, 12" STRIPE)

(6.0 - 8.0 MILS WET / 3.0 - 4.0 MILS DRY PER COAT) 2ND COAT: S-W PROMAR 400 ZERO VOC INTERIOR LATEX SEMI-GLOSS, B31W04651 SERIES 3RD COAT: S-W PROMAR 400 ZERO VOC INTERIOR LATEX SEMI-GLOSS, B31W04651 SERIES (4 MILS WET, 1.3 MILS DRY PER COAT)

GLOSS FINISH - COLOR TO MATCH SW1012, POWER GREY

METAL DOOR FRAMES GLOSS FINISH - COLOR TO MATCH SW1012, POWER GREY COLOR TO MATCH SW7513, SANDERLING - @ DRESSING ROOM DOOR ONLY 1ST COAT: FACTORY PRIMED

2ND COAT: S-W PROMAR 400 ZERO VOC INTERIOR LATEX SEMI-GLOSS, B31W04651 SERIES 3RD COAT: S-W PROMAR 400 ZERO VOC INTERIOR LATEX SEMI-GLOSS, B31W04651 SERIES (4 MILS WET, 1.3 MILS DRY PER COAT)

DRESSING ROOM DOOR ONLY) FACTORY PRIMED REMAINING COATS: FACTORY FINISHED TOUCH-UP PAINT PROVIDED BY DH PACE METAL DOOR FRAMES - OPTION (HARDER FINISH AND BETTER

LATEX SEMI-GLOSS, B31R02658

1ST COAT: S-W PREPRITE 200 ZERO VOC

TSC TO PROVIDE AND INSTALL WALLPAPER

EXPOSED CONDUIT IN RETAIL SALES AREA

COLOR/GLOSS RETENTION) GLOSS FINISH - COLOR TO MATCH SW1012, POWER GREY COLOR TO MATCH SW7513, SANDERLING -@ DRESSING ROOM DOOR ONLY 1ST COAT: FACTORY PRIMED 2ND COAT: S-W PRO INDUSTRIAL WATERBASED ALKYD

URETHANE ENAMEL B53W01051 SERIES 3RD COAT: S-W PRO INDUSTRIAL WATERBASED ALKYD URETHANE ENAMEL B53W01051 SERIES (4 MILS WET, 1.6 MILS DRY PER COAT)

VINYL PLANK FLOORING SWIFF-TRAIN COMPANY EARTHWERKS "WOOD CLASSIC" GWT-C 9812 JOHNSONITE VINYL #40 BLACK IN ALL SPACES W/ PREFORMED INSIDE AND OUTSIDE CORNERS BASE WILSONART 4857-60 SHADOW ZEPHYR AT EMPLOYEE LOUNGE COUNTERTOP PROVIDED BY TSC LAY-IN CEILINGS & GRID (VESTIBULE) GRID STONE GYPSUM CEILING PANELS 1/2" X 2' X 4' LAY-IN CEILINGS & GRID (OFFICE CORE) ARMSTRONG DUNE 1776 2X4, WHITE, SQUARE LAY-IN, OR EQUAL

WAINSCOT TO 4' A.F.F. ON WALLS ADJACENT TO THE WATER FOUNTAIN AND ON NON-MASONRY WALLS IN RESTROOMS. SEE DETAILS A5.0 FOR MOP SINK CONDITION. FRP BY GLASTEEL, GLASLINER FRP, COLOR: XA WHITE, FINISH: TEXTURED.

FINISH SCHEDULE

ROOM NO.	ROOM	WALLS	CEILING	BASE	FLOOR	REMARKS
101	VESTIBULE	PTD. C.M.U. / STOREFRONT	GYP. BD. CEILING PANELS @ 10'-0" A.F.F.	-	POLISHED CONC.	6, 9
102	RETAIL SALES	PTD. GYP. / C.M.U. (SEMI-GLOSS, WHITE)	EXP. STRUCTURE FACTORY PRIMED (GRAY)	VINYL	POLISHED CONC./ VINYL PLANK	2, 3, 9
102	RETAIL SALES					
103	NOT USED	-	-	-	-	-
104	DRESSING ROOM	PTD. GYP. / C.M.U.	OPEN TO DECK ABOVE	VINYL	VINYL PLANK	2, 8
105	STOCKROOM	PTD. GYP. / C.M.U. / PLYWOOD (SEMI-GLOSS, WHITE)	EXP. STRUCTURE FACTORY PRIMED (GRAY)	-	POLISHED CONC.	9
106	CORRIDOR	PTD. GYP./ FRP/ C.M.U	A.C.T. @ 8'-0"	VINYL	POLISHED CONC.	1, 4, 7, 9
107	MGR'S OFFICE	PTD. GYP./C.M.U.	A.C.T. @ 8'-0"	VINYL	POLISHED CONC.	1, 4, 9
108	EMPLOYEE LOUNGE	PTD. GYP.	A.C.T. @ 8'-0"	VINYL	POLISHED CONC.	1, 4, 9
109	MEN	PTD. GYP./C.M.U./ FRP	A.C.T. @ 8'-0"	VINYL	POLISHED CONC.	1, 4, 5, 9
110	WOMEN	PTD. GYP./C.M.U./ FRP	A.C.T. @ 8'-0"	VINYL	POLISHED CONC.	1, 4, 5, 9
111	IT/ELEC. CLOSET	PTD. C.M.U. / PLYWOOD	EXP. STRUCTURE FACTORY PRIMED (GRAY)	-	POLISHED CONC.	9, 10
112	PET WASH	PTD. GYP. / FRP / AL. MESH	ALUMINUM MESH SCREEN @ 10'-0" A.F.F.	EPOXY	EPOXY	-
			J IAL FISSURED, MEDIUM TEXTURE, FLAME RE ELIVERED BY TSC, SUPPLIED, PURCHASED A			

BEVELED EDGE VINYL PLANK TO BE USED AT EXPOSED TRANSITION OF VINYL PLANK FLOORING TO CONCRETE.

RED ACCENT STRIPE @ 10'-3" FROM FINISH FLOOR TO BOTTOM OF STRIPE -1'-0" STRIPE WALL COLOR TO BE (SW7036 ACCESSIBLE BEIGE). TRIM AND DOORS TO BE (SW1012 POWER GRAY).

FRP WAINSCOT TO BE INSTALLED ON ALL NON-MASONRY WALLS 4'-0" A.F.F. COLOR: XA WHITE, FINISH: TEXTURED.

GRID STONE GYPSUM CEILING PANELS 1/2" X 2' X 4' FRP WAINSCOT TO BE INSTALLED BEHIND AND ON ALL SIDES OF THE WATER COOLER ALCOVE TO 4'-0" A.F.F. COLOR: XA WHITE, FINISH:

EXTERIOR DRESSING ROOM GYP. WALLS TO BE WALLPAPER PROVIDED AND INSTALLED BY TSC. GYP. WALL CAP AND EXTERIOR WALL EXTENDING ABOVE 9'-0" A.F.F. TO BE PAINTED PURE WHITE W/ RED STRIPE TO MATCH RETAIL SALES WALLS. WALLPAPER TO BE INSTALLED PRIOR

GENERAL CONTRACTOR RESPONSIBLE FOR ALL CONCRETE REPLACEMENT. TRENCH POUR BACKS AND FILLING/PATCHING BACK OF HOLES 3" OR LARGER AND IN-GROUND ELECTRICAL BOXES NOT IN USE.

DOOR SCHEDULE

MARK	SIZE	TYPE	MATERIAL	FRAME	HARDWARE SET	REMARKS
1	PKG 14'-0" X 7'-8"	Α	STOREFRONT GLASS	ALUM.	1A	SEE NOTES 10, 13 & 14
2	PKG 14'-0" X 7'-8"	Α	STOREFRONT GLASS	ALUM.	1B	SEE NOTES 10, 13 & 14
3	3'-0" X 7'-0"	С	H. MTL.	H. MTL.	10	SEE NOTE 2
3	3'-0" X 7'-0"	С	S.C. WOOD	H. MTL.	3	SEE NOTE 10
4	3'-0"X5'-8"	Н	S.C. WOOD	H. MTL.	4	SEE NOTE 21
5A	PR 3'-0" X 7'-0"	В	STOREFRONT GLASS	ALUM.	1C	SEE NOTES 4,10,17 & 22
6*	PR 3'-0" X 8'-0"	D	ALUM./GLASS	MTL.	2	SEE NOTE 18
7	CASED OPENING	-	-	-	-	FURR DOWN TO 7'-10"
8	3'-0" X 7'-0"	С	S.C. WOOD	H. MTL.	8	SEE NOTE 5
9	3'-0" X 7'-0"	С	S.C. WOOD	H. MTL.	8	SEE NOTE 5
10	3'-0" X 7'-0"	С	S.C. WOOD	H. MTL.	6	SEE NOTE 16
11	3'-0" X 7'-0"	С	S.C. WOOD	H. MTL.	7	SEE NOTE 16
12	3'-0" X 7'-0"	С	INSUL. MTL.	INSUL. MTL.	5	SEE NOTES 2,3 &10
13A	10'-0" X 10'-0"	E	INSUL. MTL.	MTL.	2	SEE NOTES 1,12 & 15
13B	10'-0" X 10'-0"	Е	INSUL. MTL.	MTL.	2	SEE NOTES 1,12 & 15
14	3'-0" X 7'-0"	G	S.C. WOOD	H. MTL.	6	SEE NOTE 20
15	3'-0" X 7'-0"	С	INSUL. MTL.	INSUL. MTL.	5B	SEE NOTES 2,10 & 11
16	3'-0" X 7'-0"	С	S.C. WOOD	H. MTL.	7	SEE NOTE 16
17	3'-0" X 7'-0"	F	STOREFRONT GLASS	ALUM.	1D	SEE NOTES 4, 10, 19 & 22
18	3'-0" X 3'-0"	С	INSUL MTL.	MTL.		SEE NOTE 23

WALL COVERING INSTALLATION GUIDELINES

. NEW DRYWALL: MAKE SURE THE DRYWALL IS FREE OF CONTAMINANTS SUCH AS DUST, DIRT AND MILDEW. JOINTS AND SPACKLED AREAS SHOULD BE THOROUGHLY CURED AND SANDED SMOOTH. BEST RESULTS ARE OBTAINED WHEN THE MOISTURE CONTENT OF THE DRYWALL IS AT OR LESS THAN 5 PERCENT. APPLY A GOOD QUALITY OPAQUE/WHITE PRIMEF

2. MOISTURE BEHIND DRYWALL CAN CAUSE THE DRYWALL PAPER TO RELEASE. WATCH FOR WALLS THAT BACK UP TO COOLING SYSTEMS, WATER PIPES, OVERHEAD WINDOWS OR WINDOWS THAT HAVE BEEN BOARDED UP. THESE AREAS ARE PRONE TO CONDENSATION THAT MAY NOT BE OBVIOUS AT THE TIME OF INSTALLATION (PLEASE TRY AND POINT

3. REPAIR ANY DAMAGE. WALL GRAPHICS WILL NOT ADHERE TO PEELING OR CHIPPED PAINT, DENTED WALL SURFACES, OR HOLES IN THE WALL. PLEASE BE SURE THAT ALL ITEMS THAT HAVE BEEN REPAIRED, ARE SANDED AND CLEANED SO THAT THERE IS A SMOOTH CLEAN SURFACE TO PAINT ON.

4. WE RECOMMEND THAT A GLOSS OR SEMI-GLOSS PAINT IS USED BECAUSE IT PROVIDES A SMOOTH, NON-POROUS SURFACE. FLAT OR SATIN FINISH PAINTS ARE NOT RECOMMENDED. PLEASE ADVISE IF CONSIDERING USING A FLAT OR SATIN FINISH PAINT. ALSO, PLEASE INFORM YUNKER IF YOU ARE USING A LOW TO 0 VOC PAINT SO THE APPROPRIATE VINYL CAN BE USED. CONTACT JULIE VENDEIRO: jvendeiro@yunker.com; 940.367.6680.

5. USE A DAMP CLOTH TO REMOVE ANY DUST OR DEBRIS FROM THE WALL.

6. FOR ALL NEW CONSTRUCTION ALL WALLS MUST BE PRIMED BEFORE PAINTING.

PLEASE NOTE: VINYL WILL NOT ADHERE TO A WALL THAT HAS ONLY BEEN PAINTED AND NOT PRIMED. 7. ALLOW NO LESS THAN 7 DAYS FOR THE PAINT TO CURE BEFORE APPLYING VINYL.

FLOOR SPECIFICATIONS

FLOOR IN VESTIBULE, SALES, RESTROOMS, CORRIDOR, MANAGER'S OFFICE, EMPLOYEE LOUNGE

CONCRETE FLOORING SPECIFICATIONS, PROVIDE THE FOLLOWING: ANY FLOOR AREAS OVER 3" ROUND WILL BE PREPPED BY THE "GC".

MECHANICALLY GROUND AND POLISHED FLOOR SURFACE TO A 400 GRIT RESIN DIAMOND FOLLOWED BY 800 GRIT DIAMOND PAD BURNISH FOR A MID LEVEL GLOSS. INCLUDED IN THIS PROCESS IS CONCRETE DENSIFICATION, JOINT/CRACK FILLING UP TO 1150 LF AND PATCHING OF HOLES SMALLER THAN 3" THAT POSE A TRIP HAZARD. PROCESS TO BE INSTALLED BY FLOORING SUBCONTRACTOR.

FLOOR IN STOCKROOM, IT ROOM CONCRETE FLOORING SPECIFICATIONS, PROVIDE THE FOLLOWING: 1 CUT GRIND THEN SEALED WITH GUARD/ SEALER INSTALLED BY FLOORING SUBCONTRACTOR.

CONCRETE FLOORING SPECIFICATIONS, PROVIDE THE FOLLOWING: DO NOT BROOM FINISH THIS AREA. PLACE AND FINISH CONCRETE AS SPECIFIED IN SECTION 3.04 "CONCRETE FINISHES AND TOLERANCES", PARAGRAPH A "GENERAL FINISHES". CURE USING "KUREZ DR VOX" OR "KUREZ DR 100" AT AN APPLICATION RATE OF

400 F/GALLON JOINT FILLING: FILL ALL CONTROL JOINTS AS SPECIFIED IN SECTION 3.07 "INTERIOR CONCRETE JOINT FILLER", PARAGRAPH B. SURFACE PREPARATION: EPOXY FLOOR COATING SYSTEM IS DESIGNED FOR APPLICATION ON CONCRETE SUBSTRATES. NEWLY PLACED CONCRETE SURFACES SHOULD BE CURED FOR A MINIMUM OF 28 DAYS PRIOR TO COATING. CONCRETE

SURFACES MUST BE STRUCTURALLY SOUND, FREE OF LOOSE OR DETERIORATED CONCRETE AND FREE OF DUST, DIRT, PAINT, EFFLORESCENCE, OIL AND OTHER CONTAMINANTS. MECHANICALLY ABRADE THE SURFACE TO ACHIEVE A SURFACE PROFILE EQUAL TO CSP 2-3 IN ACCORDANCE WITH ICRI GUIDELINE 310.2. PROPERLY CLEAN PROFILED AREA. THE pH OF THE SURFACE SHOULD BE CHECKED ACCORDING TO ASTM D 4262. FOLLOWING SURFACE PREPARATION, THE CLEANED SURFACE SHOULD HAVE A MINIMUM SURFACE-TENSILE STRENGTH OF 200 PSI WHEN TESTED WITH AN ELCOMETER OR SIMILAR PULL TESTER (ASTM D 4541). PRODUCTS:

a. INITIAL COAT: "INCRETE HIGH PERFORMANCE EPOXY" 1 GALLON KIT (GRAY COLOR) BY EUCLID CHEMICAL b. PIGMENTED CHIPS: "INCRETE GRANITE COAT CHIPS" (MICA COLOR) BY EUCLID CHEMICAL

c. GROUT COAT: "INCRETE HIGH PERFORMANCE EPOXY" 1 GALLON KIT (CLEAR COLOR) BY EUCLID CHEMICAL d. FINAL WEAR COAT: "INCRETE POLYSEAL POLYASPARTIC" 2 GALLON KIT (CLEAR COLOR) BY EUCLID CHEMICAL INITIAL COAT MIXING: PRE-MIX "INCRETE HIGH PERFORMANCE EPOXY" (GRAY) PART A AND PART B, THEN COMBINE 2 PARTS BY VOLUME OF PART A WITH ONE PART BY VOLUME OF PART B, AND THEN MIX THOROUGHLY USING A LOW-SPEED DRILL MOTOR AND A "JIFFY" TYPE MIXER. MIX ONLY THE AMOUNT OF MATERIAL THAT CAN BE APPLIED DURING THE POT LIFE. DO NOT AERATE THE MIX.

INITIAL COAT APPLICATION: APPLY "INCRETE HIGH PERFORMANCE EPOXY" (GRAY) AT 120 SF/GALLON. SPREAD THE MIXED EPOXY WITH A NOTCHED SQUEEGEE WHILE WEARING SPIKED SHOES. START FROM ONE END OF THE FLOOR AND WORK BACKWARDS AND SIDEWAYS TRYING TO KEEP A WET-TO-WET EDGE. THE COATING SHOULD THEN BE ROLLED IN ONE DIRECTION USING A 3/8" NAP, SHED-RESISTANT ROLLER. MAKE SURE THE MATERIAL IS APPLIED AS QUICKLY AS POSSIBLE WITHOUT LEAVING PUDDLES. PIGMENTED CHIP APPLICATION: BROADCAST UNTIL REFUSAL, "INCRETE GRANITE COAT CHIPS" (MICA) IN A HIGH ARCING

MOTION INTO THE WET EPOXY. ALLOW TO CURE. ONCE DRY, VACUUM/SCRAPE OFF EXCESS FLAKES. ALLOW TO DRY. GROUT COAT: APPLY "INCRETE HIGH PERFORMANCE EPOXY" (CLEAR) AT 120 SF/GALLON. ALLOW TO DRY. WEAR COAT: APPLY A FINAL COAT OF "INCRETE POLYSEAL POLYASPARTIC" (CLEAR) AT 120 SF/GALLON. ALLOW TO DRY.

COVE BASE: IN ADDITION TO THE SEAMLESS INTEGRAL FLOOR, PROVIDE A 4" COVE BASE FROM THE FLOOR TO THE FRP WALL TRANSITION. COVE BASE SHALL CONSIST OF A MIXTURE OF "INCRETE HIGH PERFORMANCE EPOXY" AND FINELY GRADED, CLEAN DRY, TROWELABLE AGGREGATES, TROWELED TO THE PREVIOUSLY INSTALLED VERTICAL CEMENT BOARD SURFACE, TO A HEIGHT OF 4 INCHES. CREATE A COVED, SEAMLESS, INTEGRAL TRANSITION AT JOINT BETWEEN WALL AND FLOOR. BROADCAST UNTIL REFUSAL, "INCRETE GRANITE COAT CHIPS" (MICA) INTO THE WET EPOXY. FINISH COVE BASE DETAIL WITH THE GROUT COAT AND WEAR COAT AS SPECIFIED HEREIN. ONCE COMPLETED, THE FLOOR AND COVE BASE SHALL BE SEAMLESS IN FUNCTION AND APPEARANCE.

a. INSTALL CEMENT WALL BOARD SO THAT THE BOTTOM EDGE IS FLUSH WITH THE FLOOR AS SPECIFIED. b. INSTALL CEMENT WALL BOARD TAPE, SIMILAR TO GOLDBLATT PROFESSIONAL CEMENT BOARD TAPE, TO ALL JOINT

OF CEMENT BOARD. c. INSTALL FIBER REINFORCED PANELS (FRP) AS REQUIRED. DO NOT APPLY ADHESIVE TO ANY AREAS CONTACTING THE 4" COVE BASE INSTALLATION. DO NOT APPLY WATER TO ANY OF THESE SURFACES PRIOR TO INSTALLATION OF THE EPOXY FLOOR OR COVE SYSTEM.

d. INSTALL 4" COVE BASE DIRECTLY TO CEMENT BOARD. COVE BASE SHALL COME IN DIRECT CONTACT WITH THE

BOTTOM EDGE OF THE FIBER REINFORCED PANELS SO THAT THE FLOOR AND COVE BASE SHALL BE SEAMLESS IN FUNCTION AND APPEARANCE.

DOOR-OPENING FORCE - FIRE DOORS SHALL HAVE THE MINIMUM OPENING FORCE ALLOWABLE BY THE APPROPRIATE ADMINISTRATIVE AUTHORITY. THE FORCE FOR PUSHING OR PULLING OPEN DOORS OTHER THAN FIRE DOORS SHALL BE AS

INTERIOR HINGED DOOR: 5.0 POUNDS MAXIMUM SLIDING OR FOLDING DOOR: 5.0 POUNDS MAXIMUM THESE FORCES DO NOT APPLY TO THE FORCE REQUIRED TO RETRACT LATCH BOLTS OR DISENGAGE OTHER DEVICES THAT HOLD THE DOOR IN A CLOSED POSITION.


ALL LOCKSETS WILL BE FURNISHED CONSTRUCTION KEYED. AT THE END OF THE CONSTRUCTION PERIOD. NEW PERMANENT CORES BY INSTAKEY WILL BE FURNISHED TO THE CONTRACTOR WHO WILL THEN CHANGE THEM OUT AND RETURN THE CONSTRUCTION CORES TO THE SUPPLIER. THERE WILL BE A SEALED CARTON WITH THE SHIPMENT. THE CONTRACTOR IS TO TURN THAT SEALED CARTON OVER TO THE TSC STORE MANAGER AND GET THEIR SIGNATURE ON THE ENCLOSED RECEIPT. FORWARD THAT RECEIPT ALONG WITH THE CONSTRUCTION CORES AND CONTROL KEYS TO THE SUPPLIER "MJW". THE ITEMS IN THE SEALED CARTON ARE FOR FUTURE STORE OPERATIONS AND ARE NOT CONSTRUCTION

HARDWARE SCHEDULE

SET#	DOORS	QUANTITY	ITEM	MANUFACTURER
1A	1	1 EA.	MORTISE CYLINDER 28107-1-26D	ILC
., ('	1 EA.	1CC7A2 (GREEN CONSTRUCTION CORE)-GREEN	BEST
		1 EA.	MORTISE THUMB TURN CYLINDER-26D	ILC
			BALANCE OF HARDWARE BY DOOR SUPPLIER	
1B	2	2 EA.	CYLINDER, DUMMY 7160DC-26D	ILC
			BALANCE OF HARDWARE BY DOOR SUPPLIER	
1C	5A	1 EA.	THUMB TURN -CYLINDER -26D	ILC
		1 EA.	MORTISE CYLINDER 28107-1-26D	ILC
		1 EA.	DRIP CAP 16A X 76 - A BALANCE OF HARDWARE BY DOOR SUPPLIER	NAT
10	17	1 EA.		ILC
1D	17	1 EA. 1 EA.	MORTISE CYLINDER 28107-1-26D THUMB TURN -CYLINDER -26D	ILC
		1 EA.	CYLINDER CORE 1CC7A2 (GREEN CONSTRUCTION CORE)	BEST
		I LA.	BALANCE OF HARDWARE BY DOOR SUPPLIER	BLOT
2	6, 13A, 13B,		ALL HARDWARE BY DOOR SUPPLIER	
3	NOT USED	3 EA.	HINGES MPB79 4 1/2 X 4 1/2 NRP- 26D	MCK
		1 EA.	SURFACE CLOSER SC81A RW/PA AS SPECIFIED- 689	FAL
		1 EA.	STOREROOM LOCKSET T581BD X D X 23981145 X 5164 X 1 3/4	
		1 EA.	WALL STOP WS407 - CCV-US32D	IVE
		3 EA.	SILENCERS SR64-GRY	IVE
4	4	1 EA.	CONTINUOUS HINGE 22HD	MCK
		1 EA.	PRIVACY LOCK T301S X D X 23981137 X 5164 X 1 3/4- 626	FAL
		3 EA.	SILENCER SR64- GRY	IVE
5	12	3 EA.	HINGES MPB79 4 1/2 X 4 1/2 NRP- 26D	MCK
		1 EA.	ALARMED EXIT DEVICE ECL-230D-GRAY	DET
		2 EA.	RIM CYLINDER R28207-9	ILC
		1 EA.	SURFACE PULL 8N US28	HAG
		1 EA.	CLOSER, PARALLEL ARM SC81 A X DS X SLIM-689	FAL
		1 EA.	THRESHOLD 896V- MILL	NAT
		1 EA.	DOOR BOTTOM 795WH- MILL	NAT
		1 EA.	WEATHERSTRIP 160V - MILL	NAT
		1 EA.	DRIP CAP 16A-A	NAT
		1 EA.	VIEWER U698 B26D (MOUNT 60" CL/A.F.F.) (DOOR 12 ONLY)	IVE
5B	15	3 EA.	HINGES MPB79 4 1/2 X 4 1/2 NRP- 26D	MCK
		1 EA,	RIM EXIT DEVICE V40 X DC X EE X TSC- 711	DET
		1 EA.	POWER TRANSFER PT5	DET
		1 EA.	MORTISE CYLINDER 28107-1-26D	ILC
		1 EA.	CLOSER, PARALLEL ARM SC81A X DS X SLIM-689	FAL
		1 EA.	THRESHOLD 896 V- MIL	NAT
		1 EA.	WEATHER STRIPING 160V- MILL	NAT
		1 EA.	DRIP CAP 16A-A	NAT
6	10,14	3 EA.	HINGES MPB79 4 1/2 X 4 1/2 NRP- 26D	MCK
		1 EA.	PUSH PLATE 8200 X 4 X 16 - US32D	IVE
		1 EA.	PULL PLATE 8302-0 X 4 X 16- US 32D	IVE
		1 EA.	CLOSER SC81A X RW/PA X SLIM - 689	FAL
		1 EA.	WALL STOP WS407-CCV-US32D	IVE
		3 EA.	SILENCERS SR64- GRY	IVE
7	11, 16	3 EA.	HINGES MPB79 4 1/2 X 4 1/2 NRP- 26D	MCK
		1 EA.	OFFICE LOCKSET T511 X D X 23981137 X 5164 X 1 3/4-626	FAL
		1 EA.	WALL STOP WS407-CCV-US32D	IVE
		3 EA.	SILENCERS SR64- GRY	IVE
8	8, 9	3 EA.	HINGE MPB79 4 1/2 X 4 1/2 NRP- 26D	MCK
		1 EA.	PRIVACY LOCKSET T301S X D 23981137 X 5164 X 1 3/4 - 626	FAL
		1 EA.	CLOSER, SC81A X RW/PA X SLIM - 689	FAL
		1 EA. 3 EA.	WALL STOP WS407-CCV - US32D SILENCER SR64-GRY	IVE IVE
CARLE				
GABLE FACADE		1 EA. 1 EA.	ACCESS PANEL BXTM-36X36-C DUMMY CYLINDER 7160DC-26D	BAB ILC
ACCESS		1 EA.	CYLINDER CORE 1CC7A2 (GREEN CONSTRUCTION CORE)	ILC
		1 EA.	BALANCE OF HARDWARE BY DOOR SUPPLIER	BEST
PANEL		L/\.		

ALL LOCKSETS WILL BE FURNISHED CONSTRUCTION KEYED. AT THE END OF THE CONSTRUCTION PERIOD NEW PERMANENT CORES BY INSTAKEY WILL BE FURNISHED TO THE CONTRACTOR WHO WILL THEN CHANGE THEM OUT AND RETURN THE CONSTRUCTION CORES TO THE SUPPLIER. THERE WILL BE A SEALED CARTON WITH THE SHIPMENT. THE CONTRACTOR IS TO TURN THAT SEALED CARTON OVER TO THE TSC STORE MANAGER AND GET THEIR SIGNATURE ON THE ENCLOSED RECEIPT. FORWARD THAT RECEIPT ALONG WITH THE CONSTRUCTION CORES AND CONTROL KEYS TO THE SUPPLIER "DH PACE". THE ITEMS IN THE SEALED CARTON ARE FOR FUTURE STORE OPERATIONS AND ARE NOT CONSTRUCTION RELATED.

NOTE: TRACTOR SUPPLY COMPANY HAS A NATIONAL ACCOUNT WITH DH PACE FOR DOOR HARDWARE. CONTACT: CHARLES GIRTMAN @ TSCDOORS@DHPACE.COM OR #816.221.0543

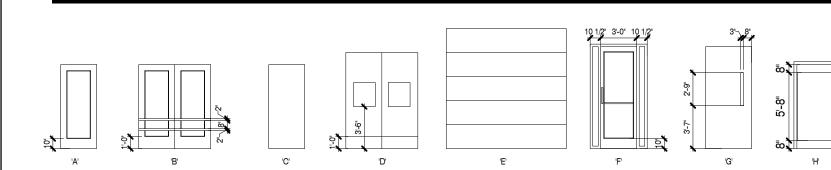

- 1. 10' WIDE X 10' HIGH INSULATED SECTIONAL DOOR W/ ELECTRIC OPERATOR, (2) RADIO REMOTES, TIMER, CHAIN KEEPER AND REVERSING SAFETY EDGE. OVERRIDE BUTTON TO BE SUPPLIED BY OVERHEAD DOOR VENDOR AND INSTALLED BY GENERAL CONTRACTOR'S ELECTRICIAN. COLOR TO BE FACTORY FINISHED WHITE; IMPACT RESISTANT COILING DOOR IN HIGH IMPACT ZONES.
- DOOR #12 TO HAVE DOOR BELL. RINGERS TO BE LOCATED @ RECEIVING DESK AND CASH REGISTER. "BIG EYE" VIEWER IN DOOR.
- DOOR #5A, #17 & #19 (& #22) TO HAVE 4" ALUM. HEAD AND THRESHOLD. SIGNAGE TO BE PROVIDED BY TSC.
- NOTE THAT DOORS REQUIRE A MINIMUM 10" BOTTOM RAIL TO RECEIVE KICK PLATES. ALL DOORS TO HAVE A.D.A. APPROVED HARDWARE.
- GENERAL CONTRACTOR TO CHANGE OUT CONSTRUCTION CORES OF ALL HARDWARE PRIOR TO TURNOVER OF STORE. KEY AND TURNOVER DOCUMENT TO BE SIGNED BY G.C. AND STORE MANAGER. 9. ALL LOCKSETS KEYED TO ESTABLISH TSC GRANDMASTER KEY. ESTABLISH A NEW MASTER KEY AND KEY INDIVIDUALLY AS DIRECTED TO
- OPERATE ALL CYLINDERS & LOCK SETS. FURNISH (4) COPIES OF THE MASTER KEY, FURNISH 2 KEYS PER LOCK. 10. DOOR #1, #2, #5A, #15 AND #17 KEYED ALIKE. DOOR #12 KEYED SEPARATELY. ELECTRICIAN RESPONSIBLE FOR MAKING FINAL CONNECTION BETWEEN SECURITY VENDOR WORK AND DOOR WIRING.
- 12. CONTRACTOR TO INSTALL PLASTIC AIR CURTAIN WITH 50% PANEL OVERLAP @ NEW MASONRY OPENING INSIDE NEW DOOR. AIR CURTAIN INCLUDED WITH OVERHEAD DOOR VENDOR PACKAGE. INCLUDES ALL OVERHEAD DOORS IN RETROFIT STORES.
- 13. CONTRACTOR TO PROVIDE AND INSTALL DOOR SWEEPS. 14. DOORS TO HAVE FLAT THRESHOLD PROVIDED BY DOOR MANUFACTURER. 15. THE CHANNELS THAT MAKE UP THE JAMBS AND HEAD FOR THE ROLLING SERVICE DOOR AND ITS ATTACHMENT POINTS SHOULD BE FLUSH
- AND SMOOTH WITH THE SURROUNDING INTERIOR WALLS AS WELL AS ABOVE THE INTERIOR OPENING. PROVIDE A STRUCTURAL SURFACE IN LINE WITH THE JAMBS THAT EXTENDS ABOVE THE OPENING FOR A MINIMUM OF 30" FOR ATTACHMENT POINTS. STRUCTURAL SURFACE TO BE CAPABLE OF WITHSTANDING 1850 LB. POINT FORCE IN EITHER TENSION, COMPRESSION OR SHEAR. 6. PROVIDE AND INSTALL "EMPLOYEES ONLY" SIGN WHERE INDICATED. 17. W/ 2 EACH CRASH RAILS ON INSIDE OF EACH DOOR.
- 18. 72" X 96", 72" X 84" OR 36" X 96" OPENINGS TO BE PROVIDED AS: P11PLUS, WITH 10" X 30" ADA COMPLIANT WINDOWS, 18" TALL BUMPERS, COLOR: RED. (OR) OPENINGS 96" X 120" TO BE: DURULITE STANDARD DOORS WITH 20" X 30" ADA COMPLIANT WINDOWS, 36" TALL BUMPERS,
- 19. INSTALL CLEAR ANODIZED STOREFRONT FRAMING WITH 1/4" TEMP. CLEAR GLASS SIDELIGHTS. DOOR TO SWING OPEN TO SALES AREA. SIDELIGHT GLASS TO ACCEPT 6.25" X 48.85" VINYL FILM. NARROW STILE DOOR WINDOW GLASS TO ACCEPT 30.25" X 57.825" VINYL FILM. 20. ANEMOSTAT WINDOW KIT WITH CLEAR TEMPERED 1/4" GLASS WITH GLAZING TAPE APPLIED (BOTH SHIPPED LOOSE). BY DH PACE. 21. CONTRACTOR TO PAINT FRAME SW7513 SANDERLING BOTH SIDES.
- 22. SFIC COMPATIBLE HARDWARE. 23. ACCESS PANEL TO BE SUPPLIED AND INSTALLED BY GC. SEE HARDWARE SCHEDULE FOR SPECIFICATIONS.




Architecture 2934 Sidco Drive Suite 120 Nashville, TN 37204 Interior Architecture

TRACTOR SUPPLY COMPANY

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

Job Number	TBD
Date	05.10.2024
Revisions:	

DOOR & FINISH SCHEDULES

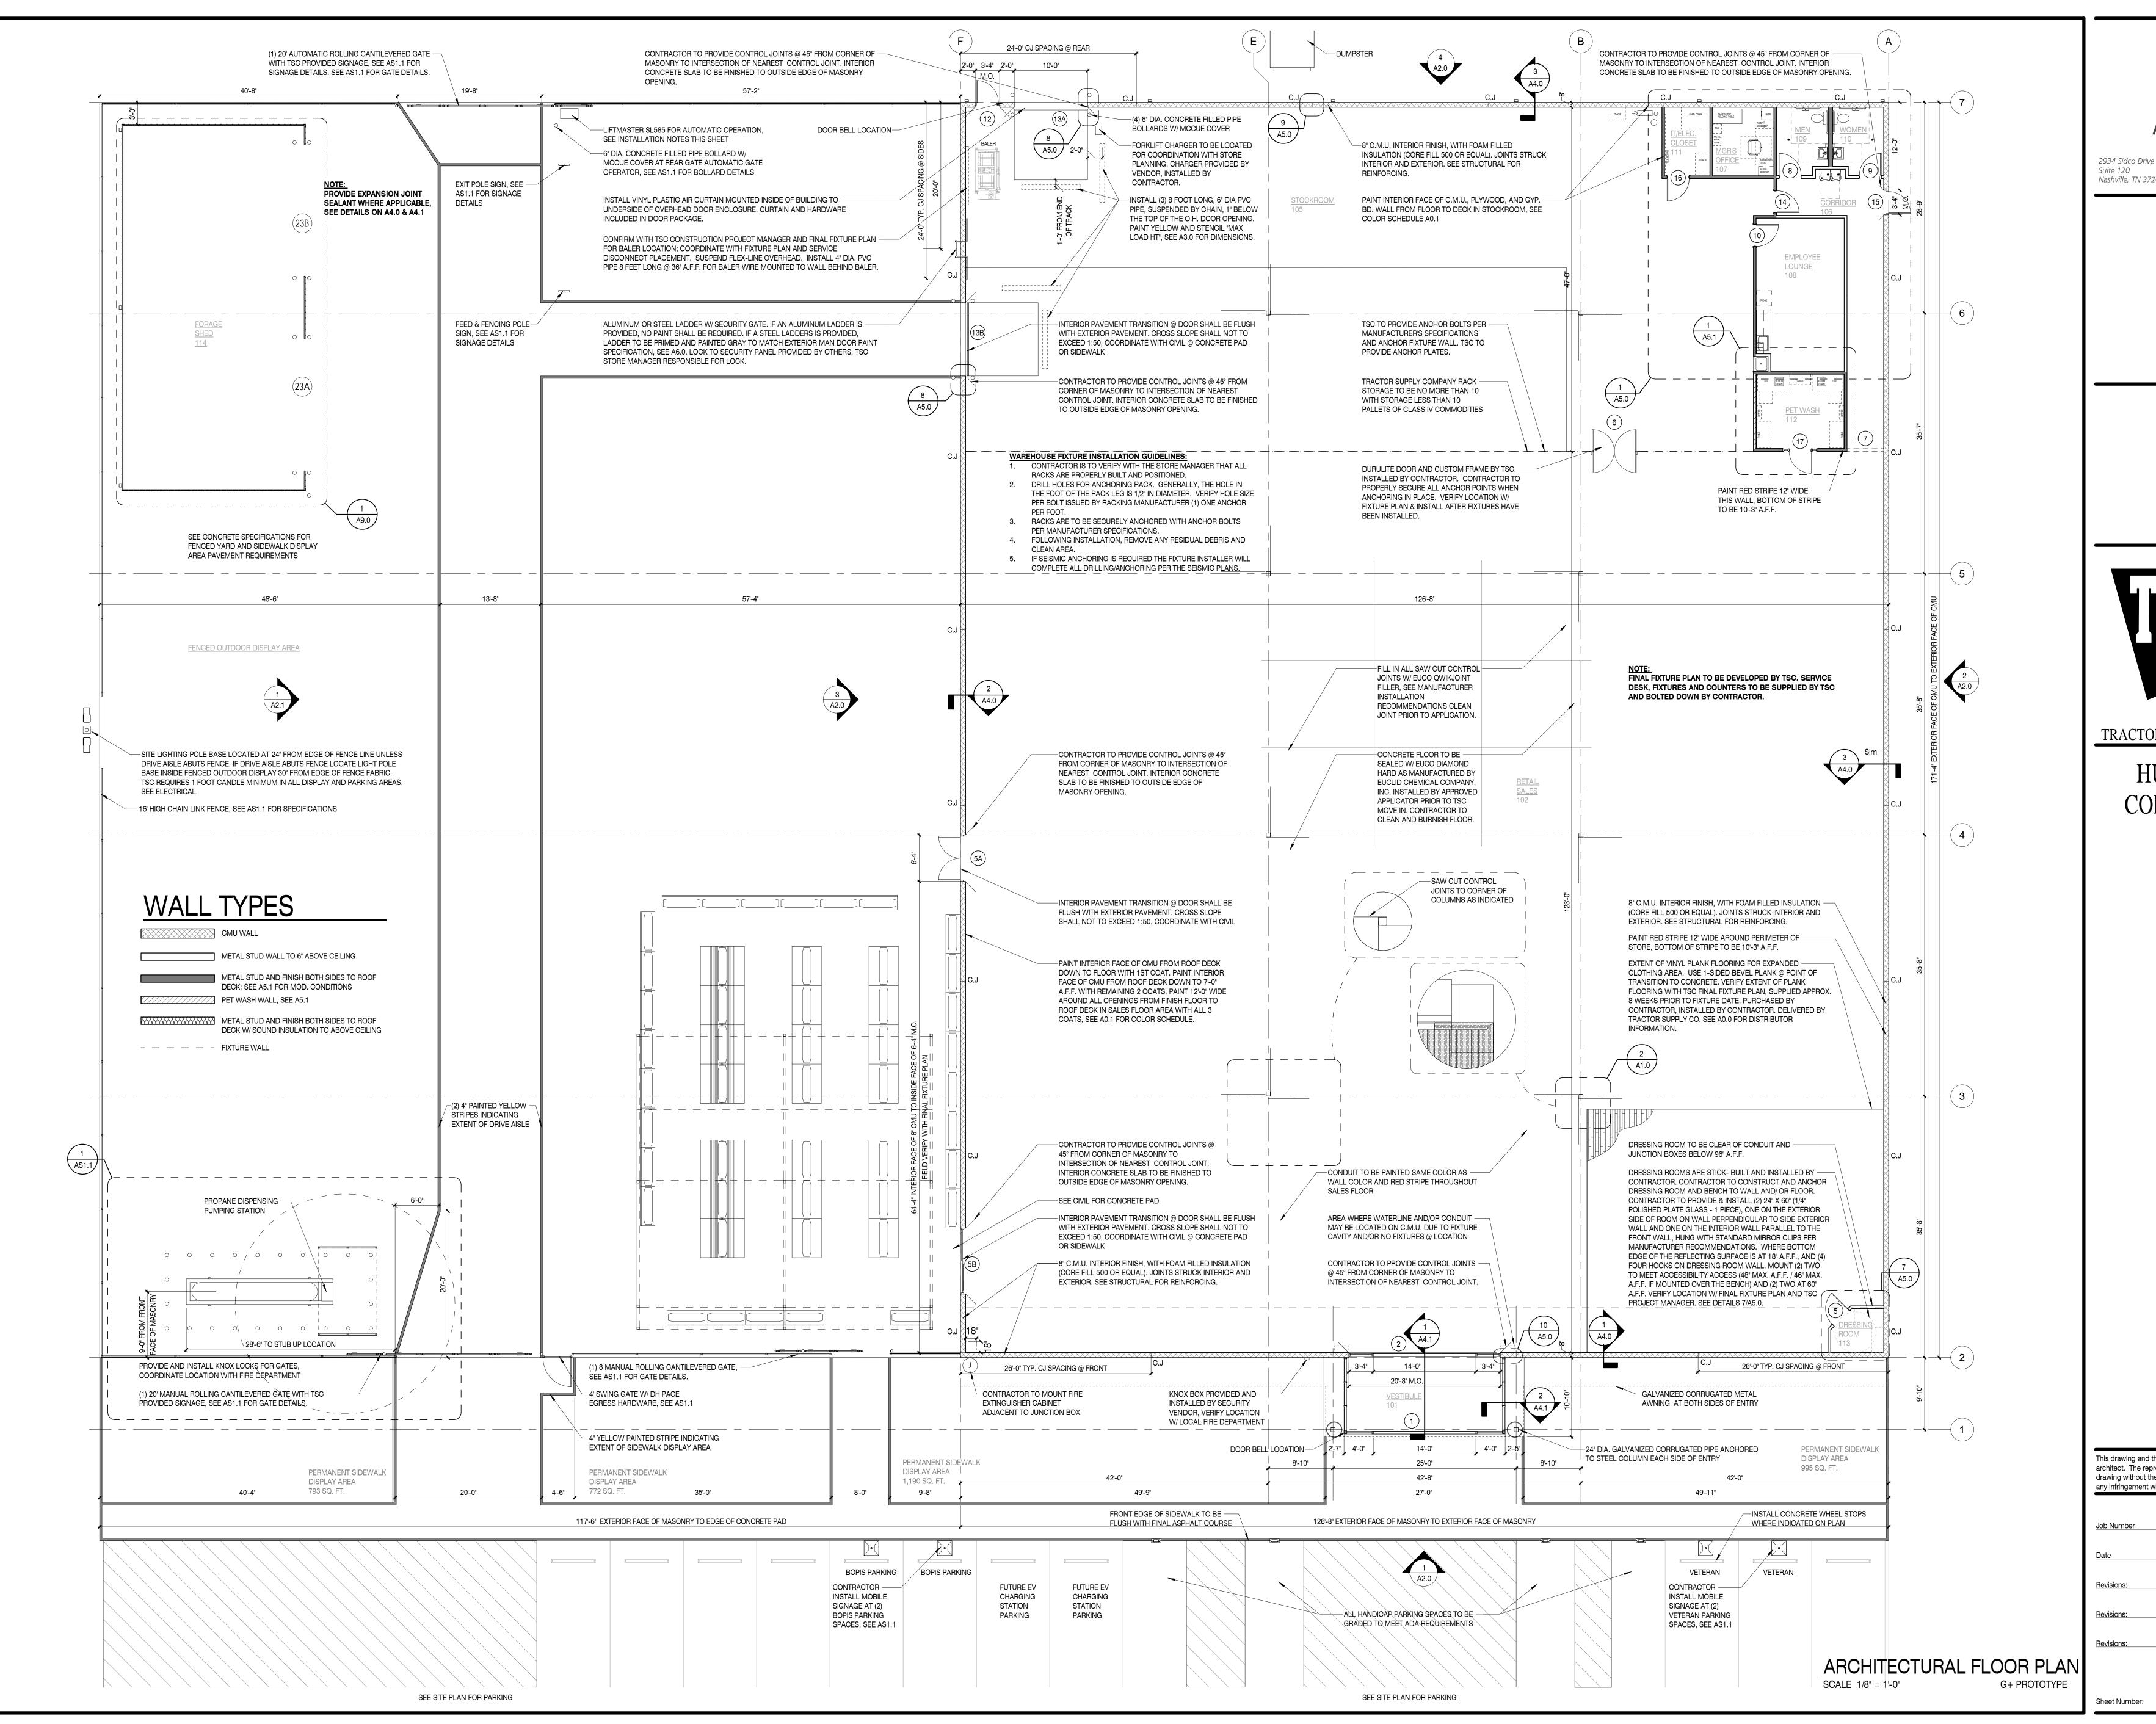



2934 Sidco Drive Arch Suite 120 F Nashville, TN 37204 Interior Arch

Planning 37204 Interior Architecture

TRACTOR SUPPLY COMPANY

HUDSON, COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

 Number
 TBD


 e
 05.10.2024

ate 09
evisions:

Revisions:

ARCHITECTURAL FLOOR PLAN

Δ1

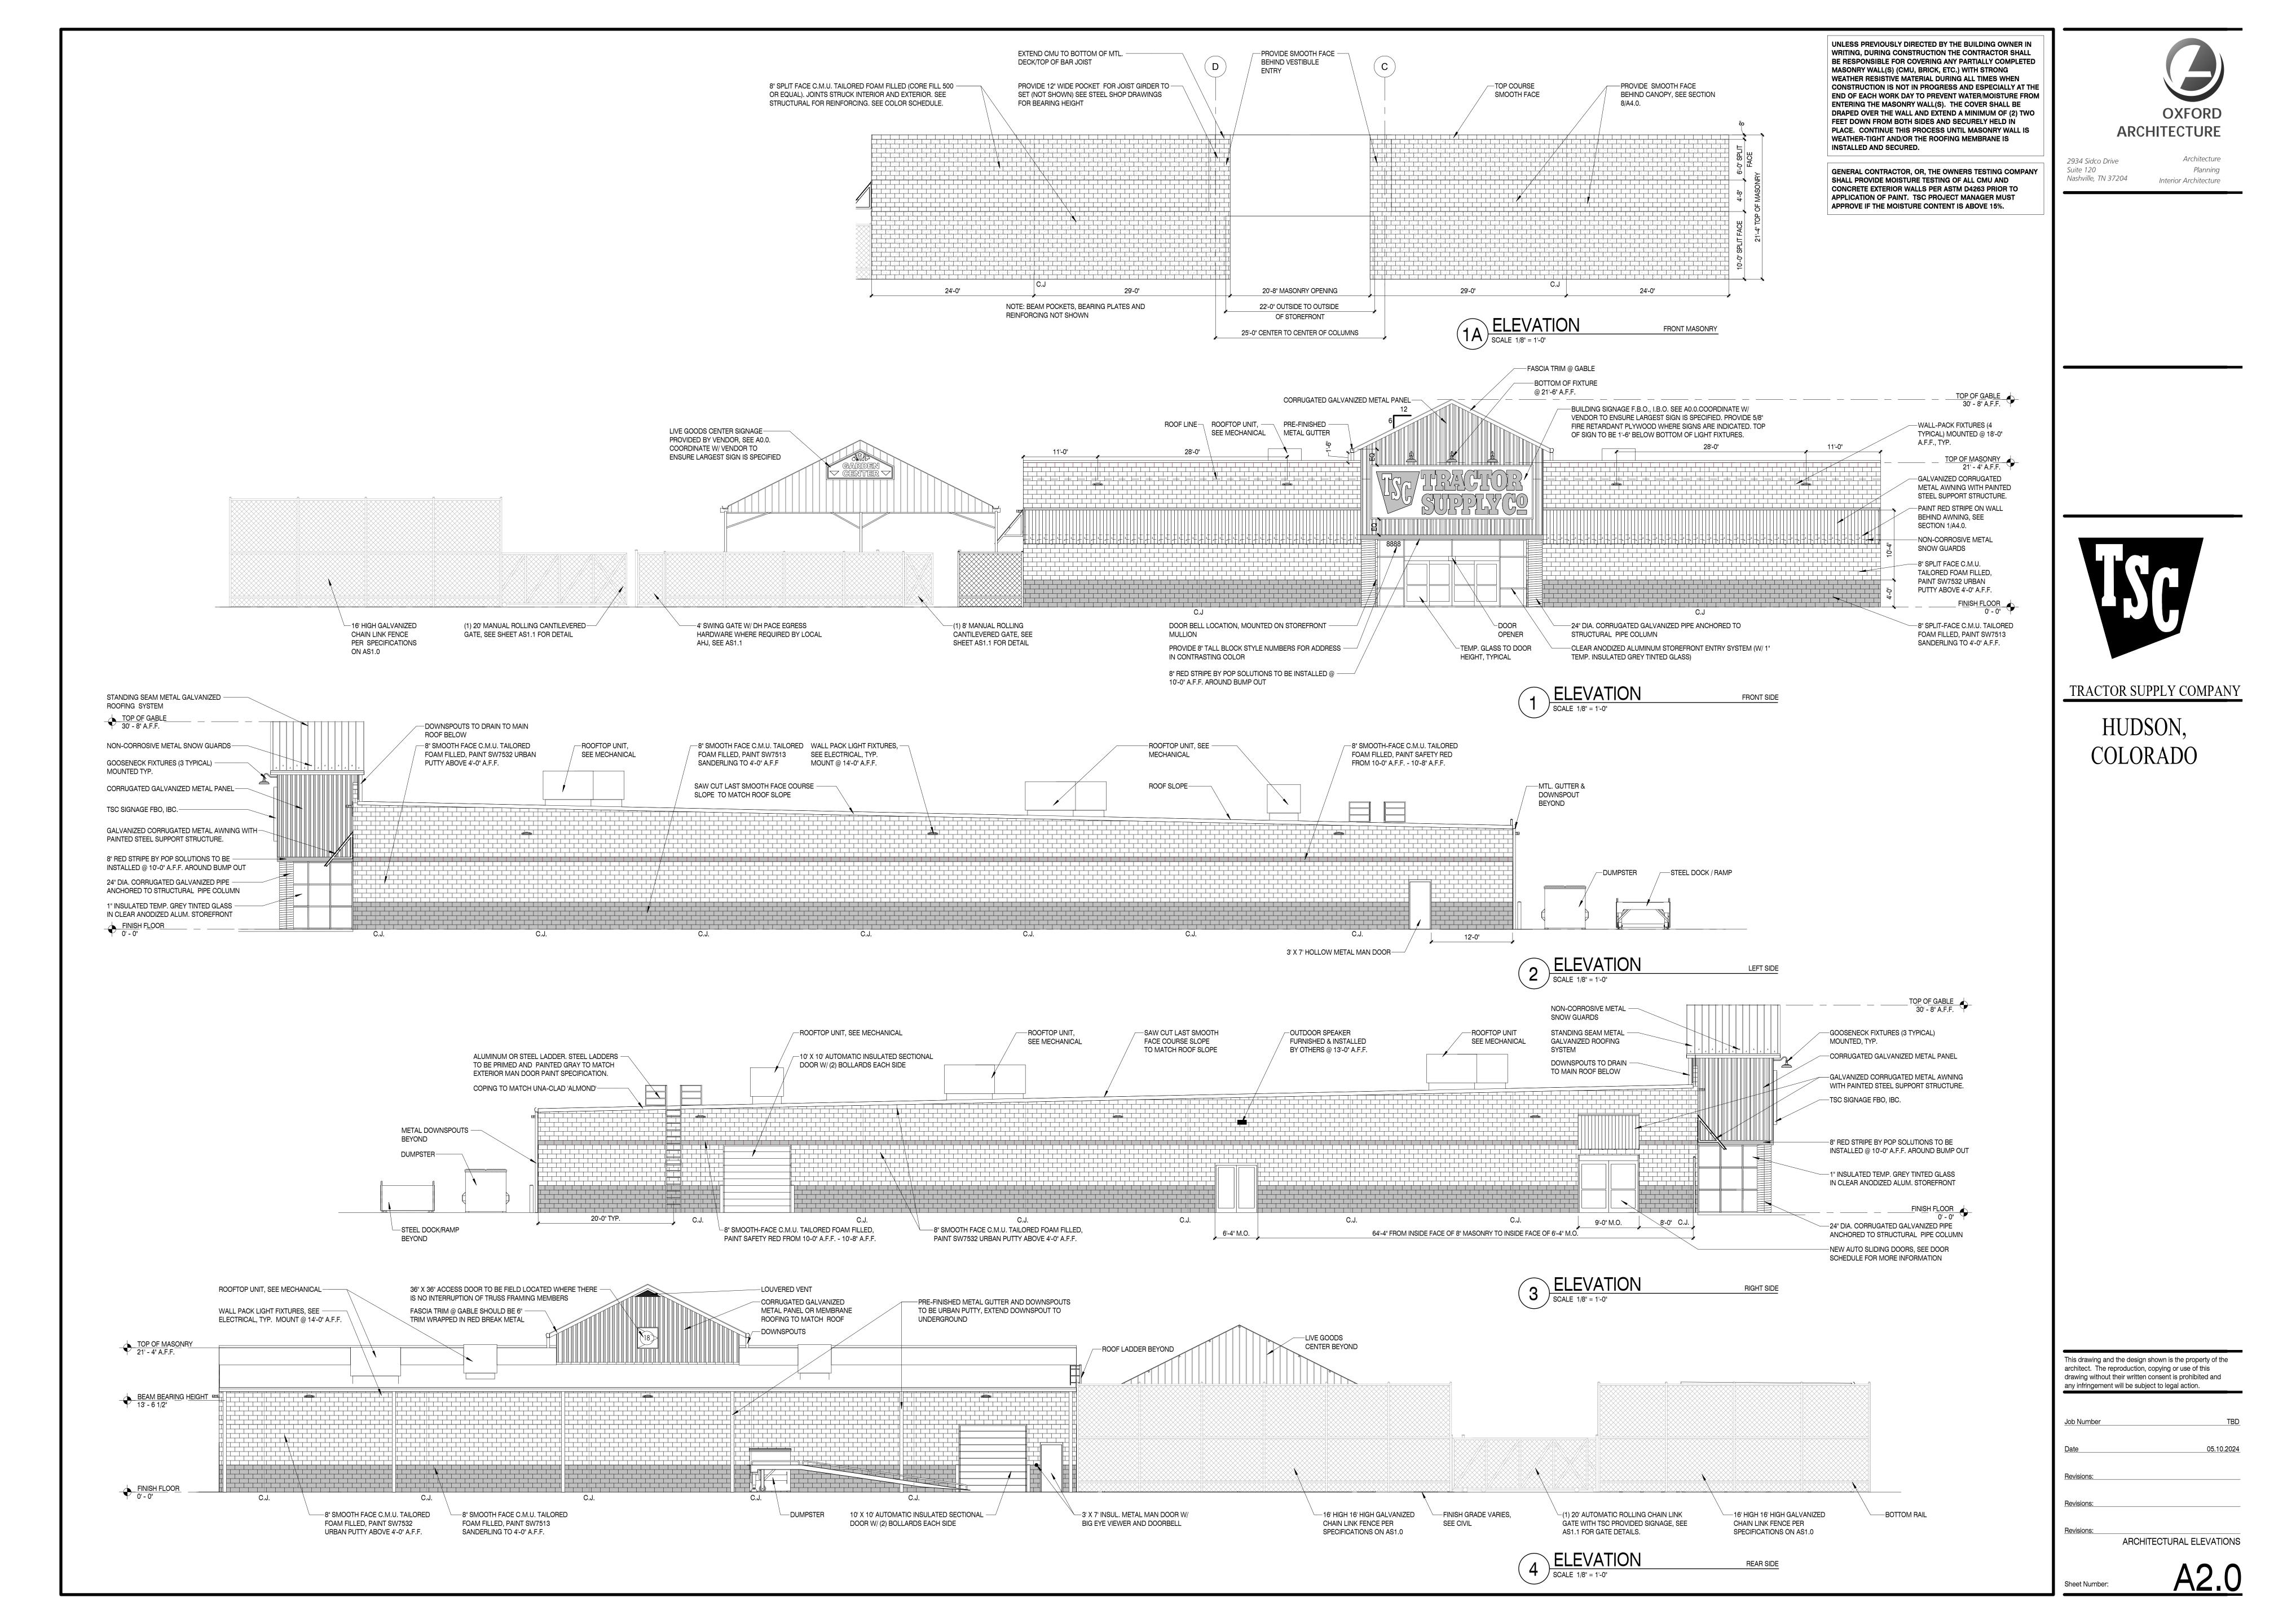




2934 Sidco Drive

Suite 120 Planning
Nashville, TN 37204 Interior Architecture



TRACTOR SUPPLY COMPANY HUDSON, COLORADO

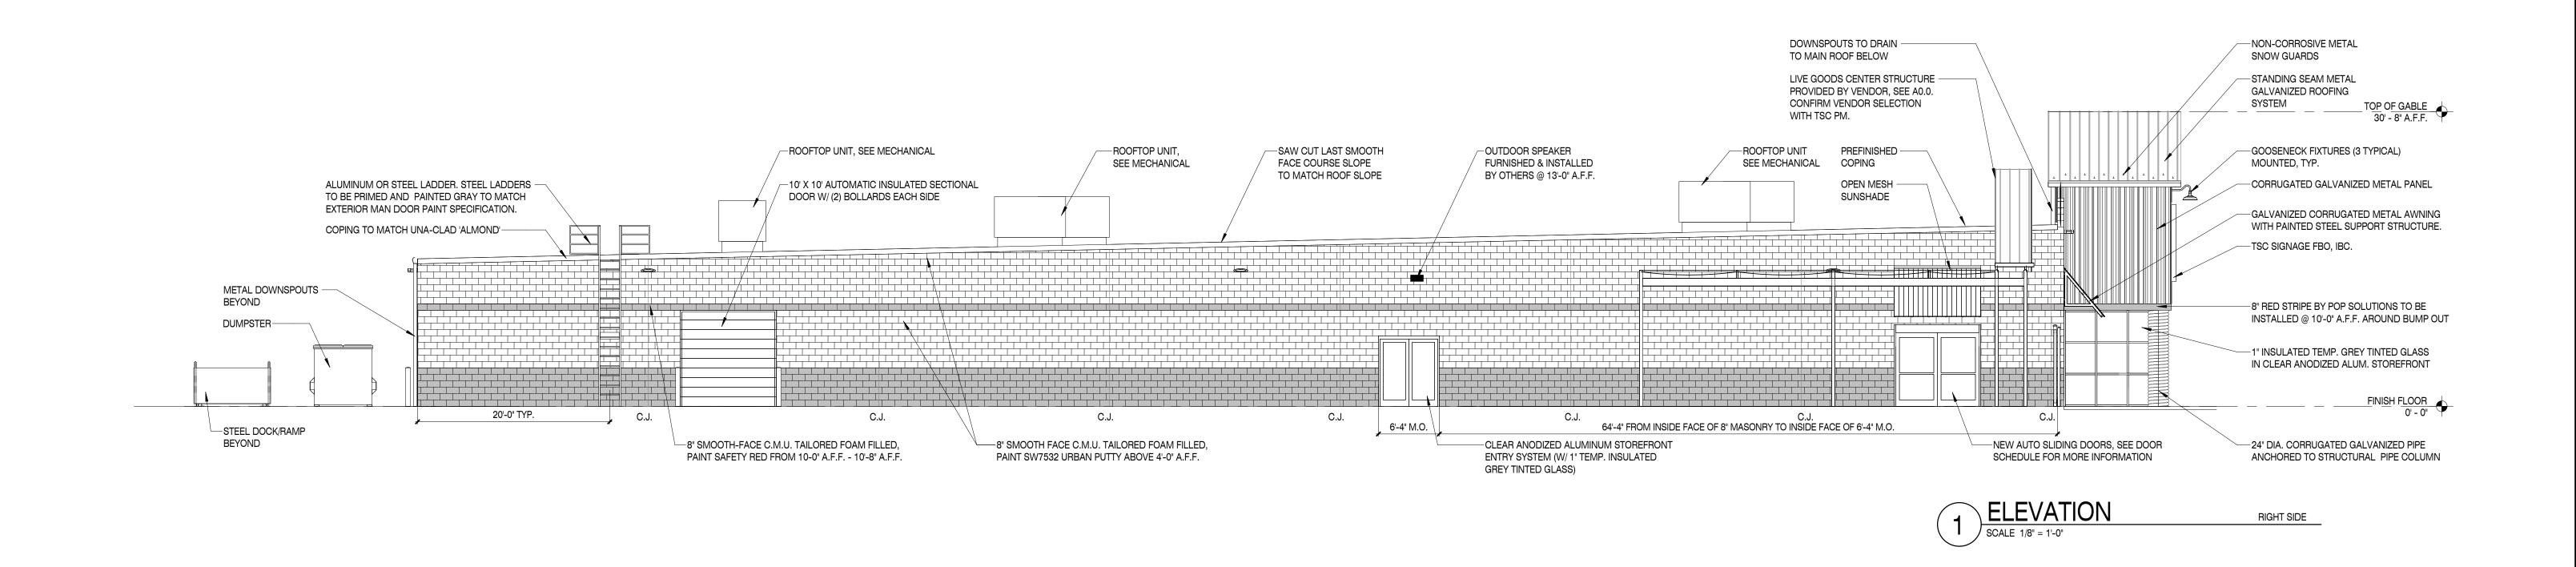



This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.


Job Number 05.10.2024


Revisions: Revisions:


Revisions: ARCHITECTURAL ELEVATIONS

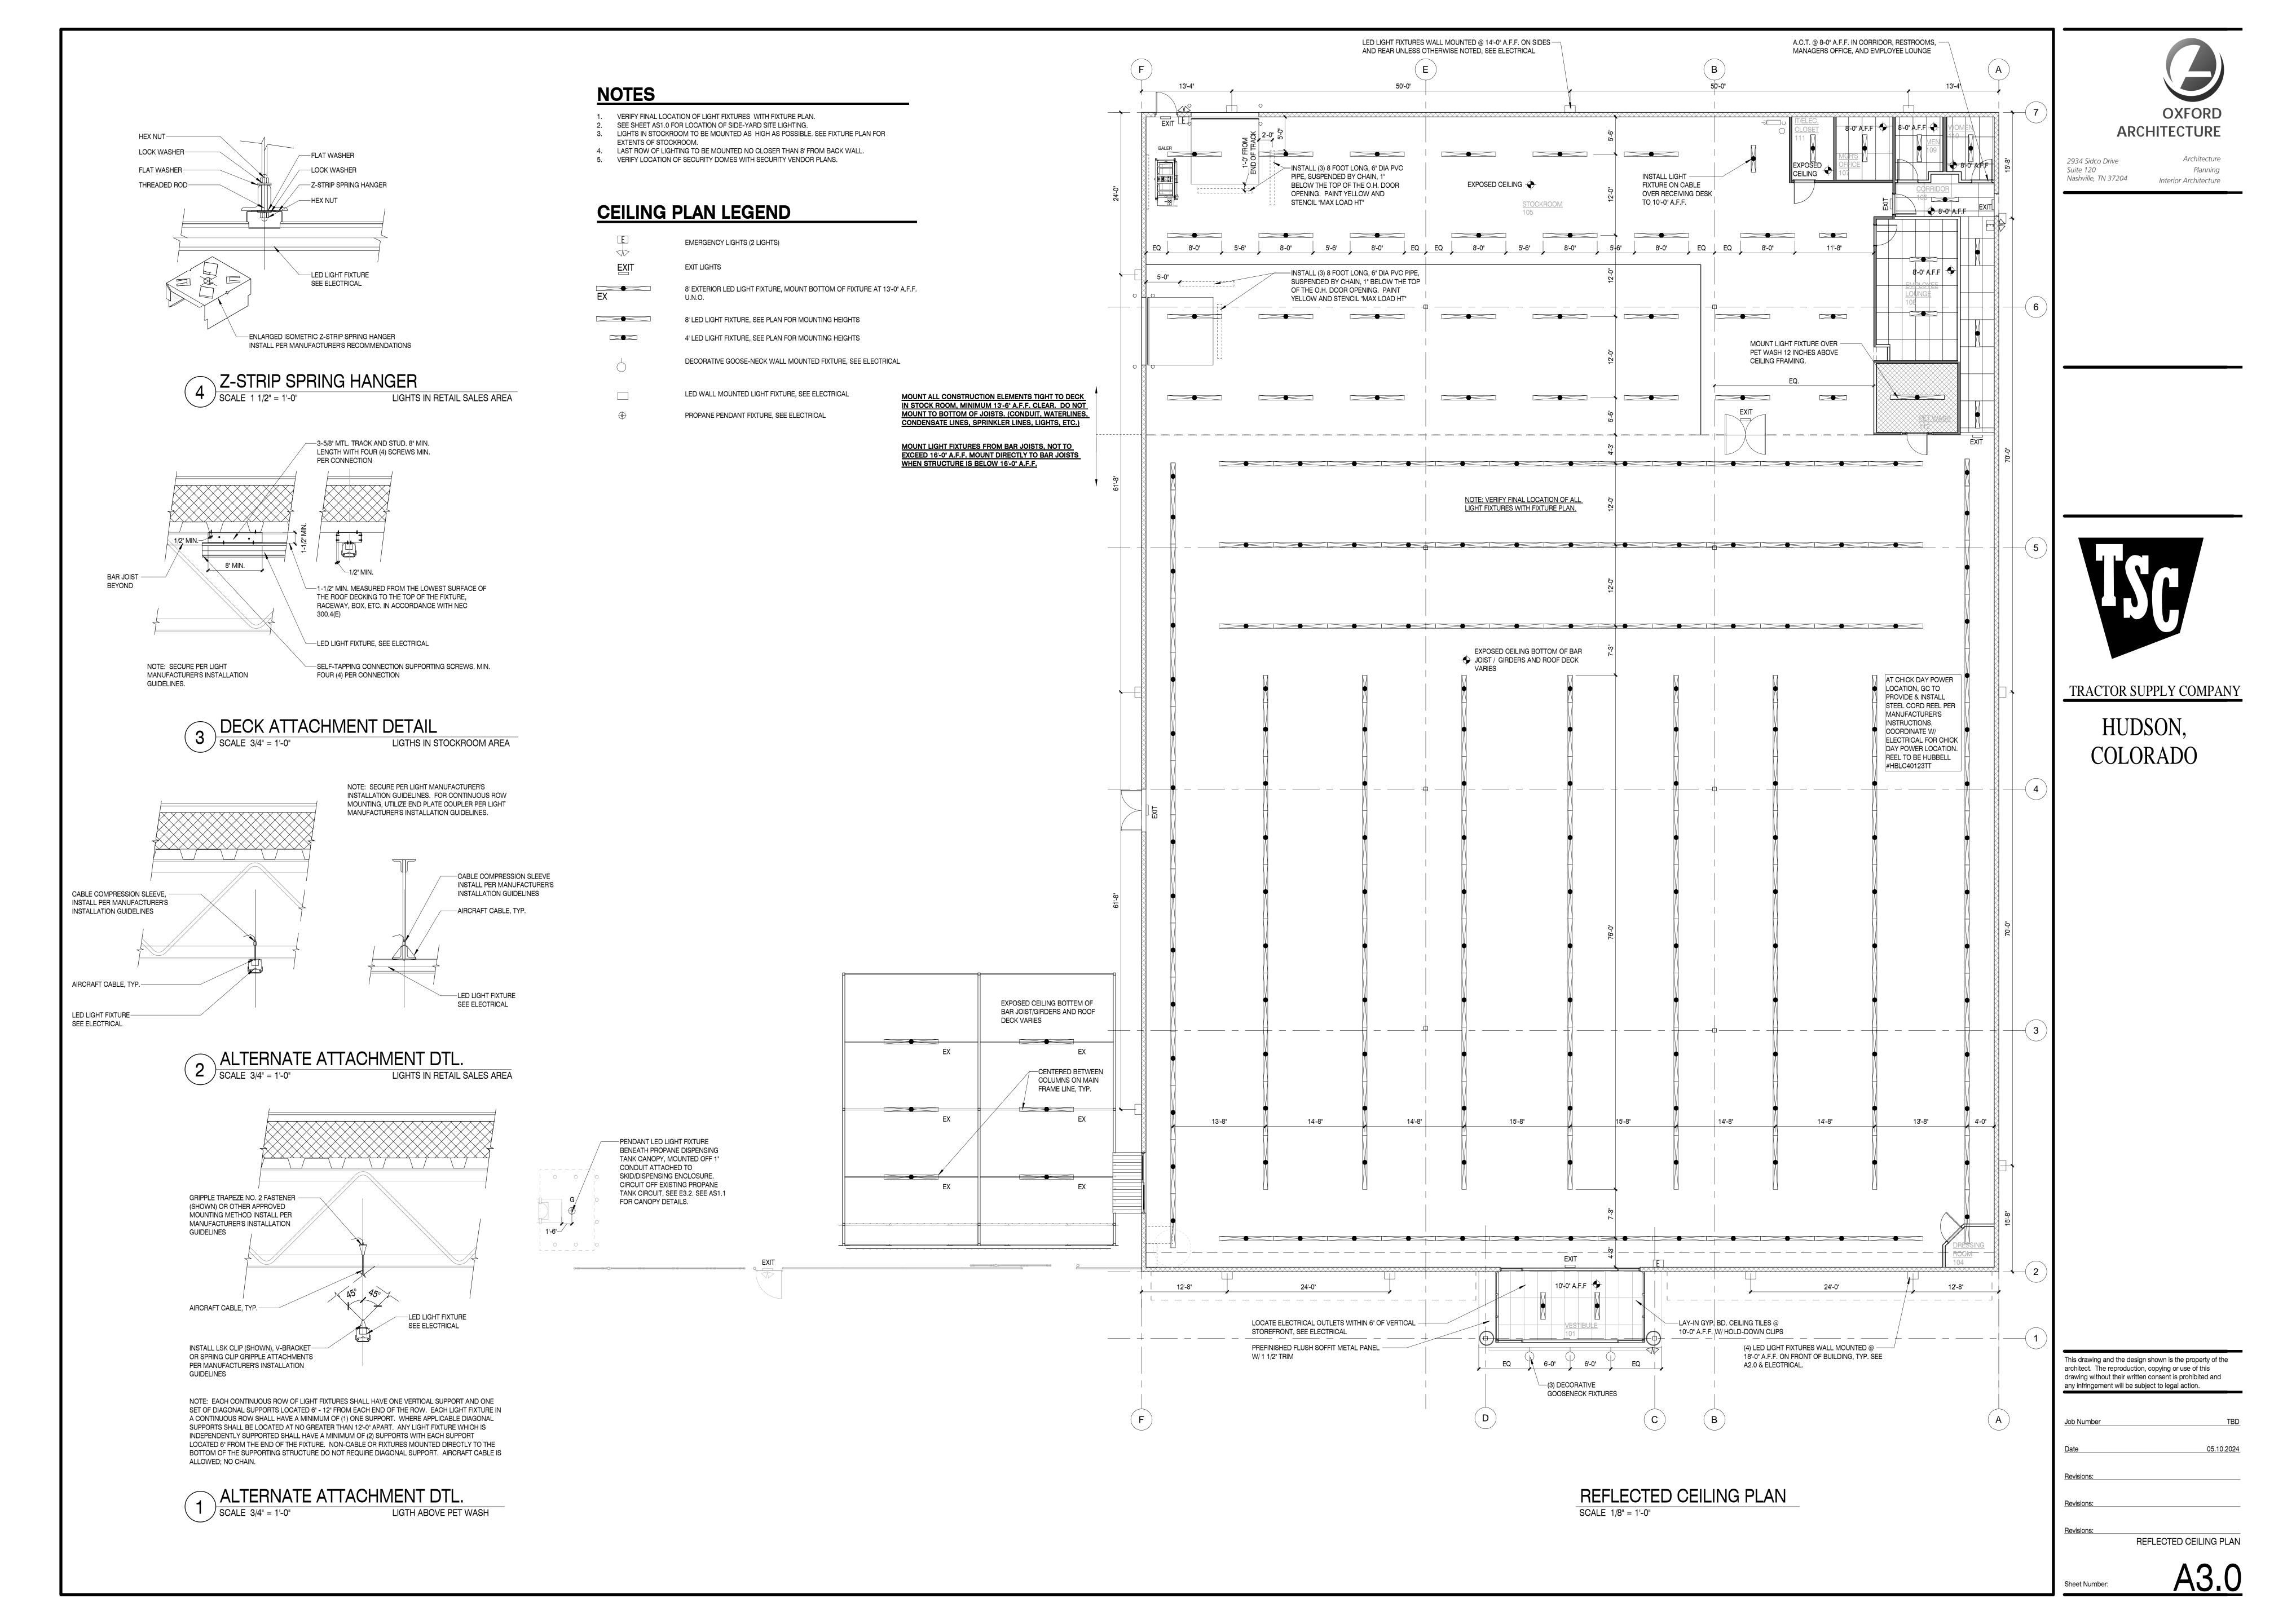


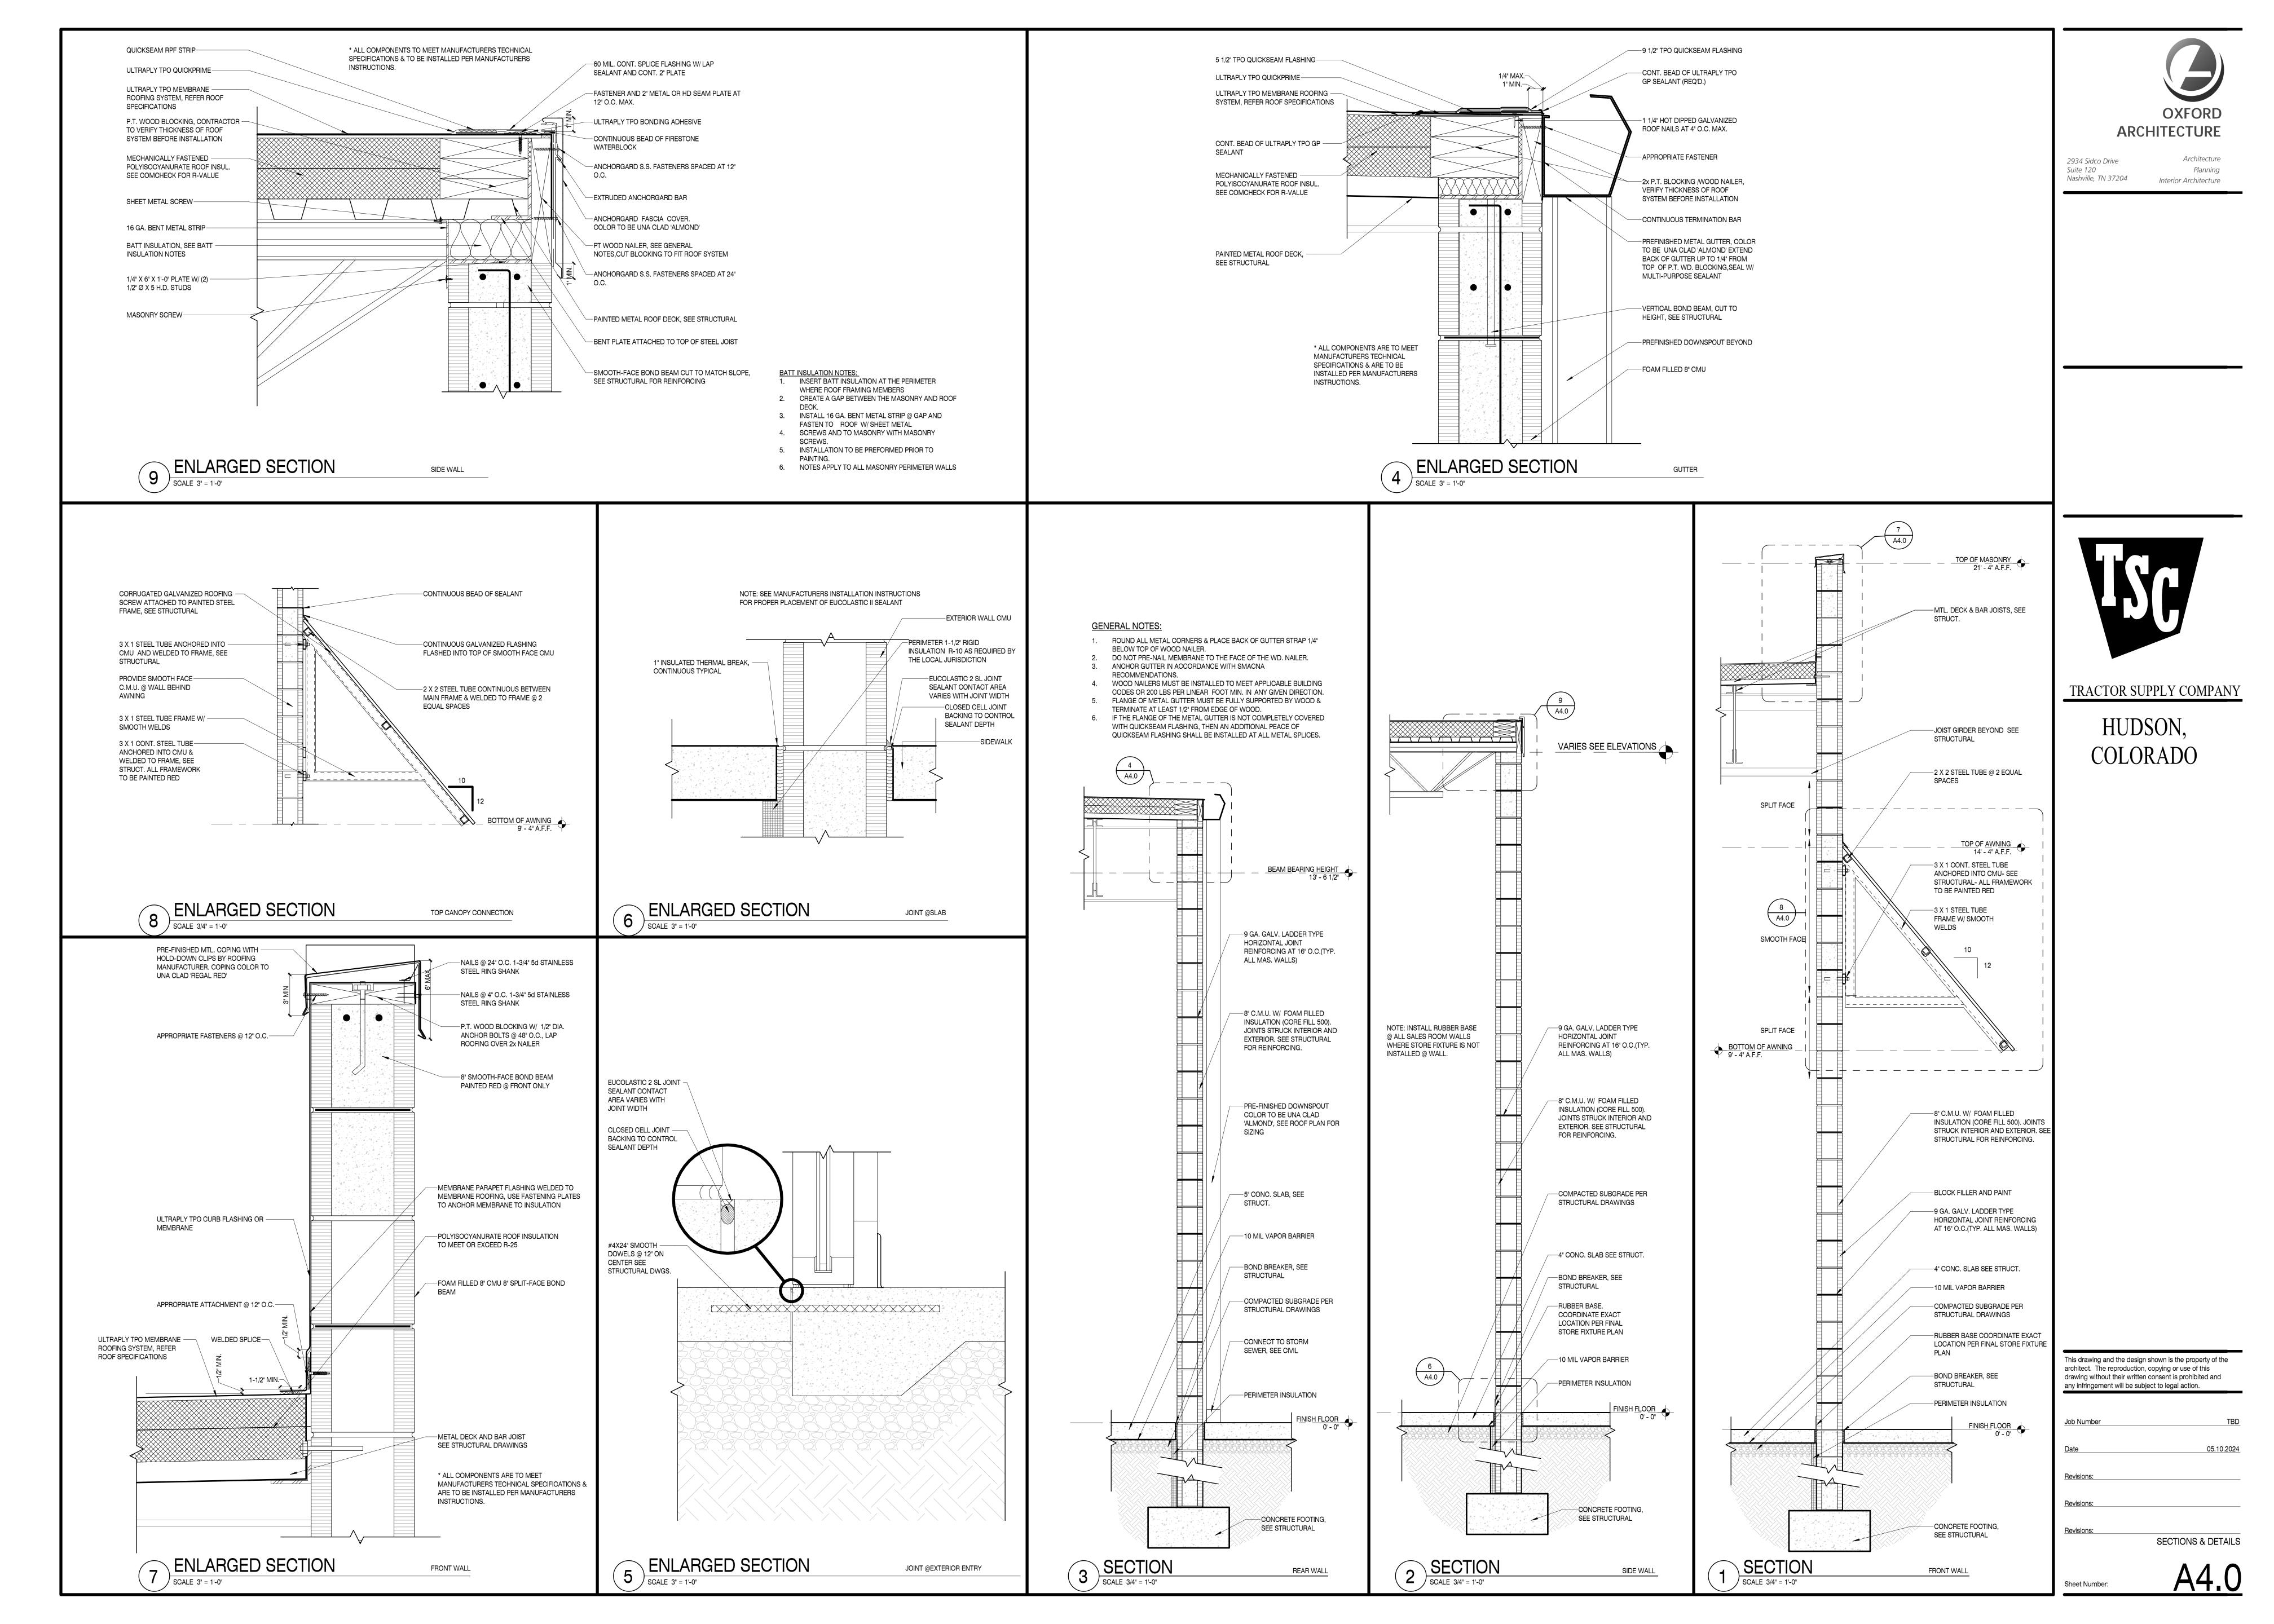


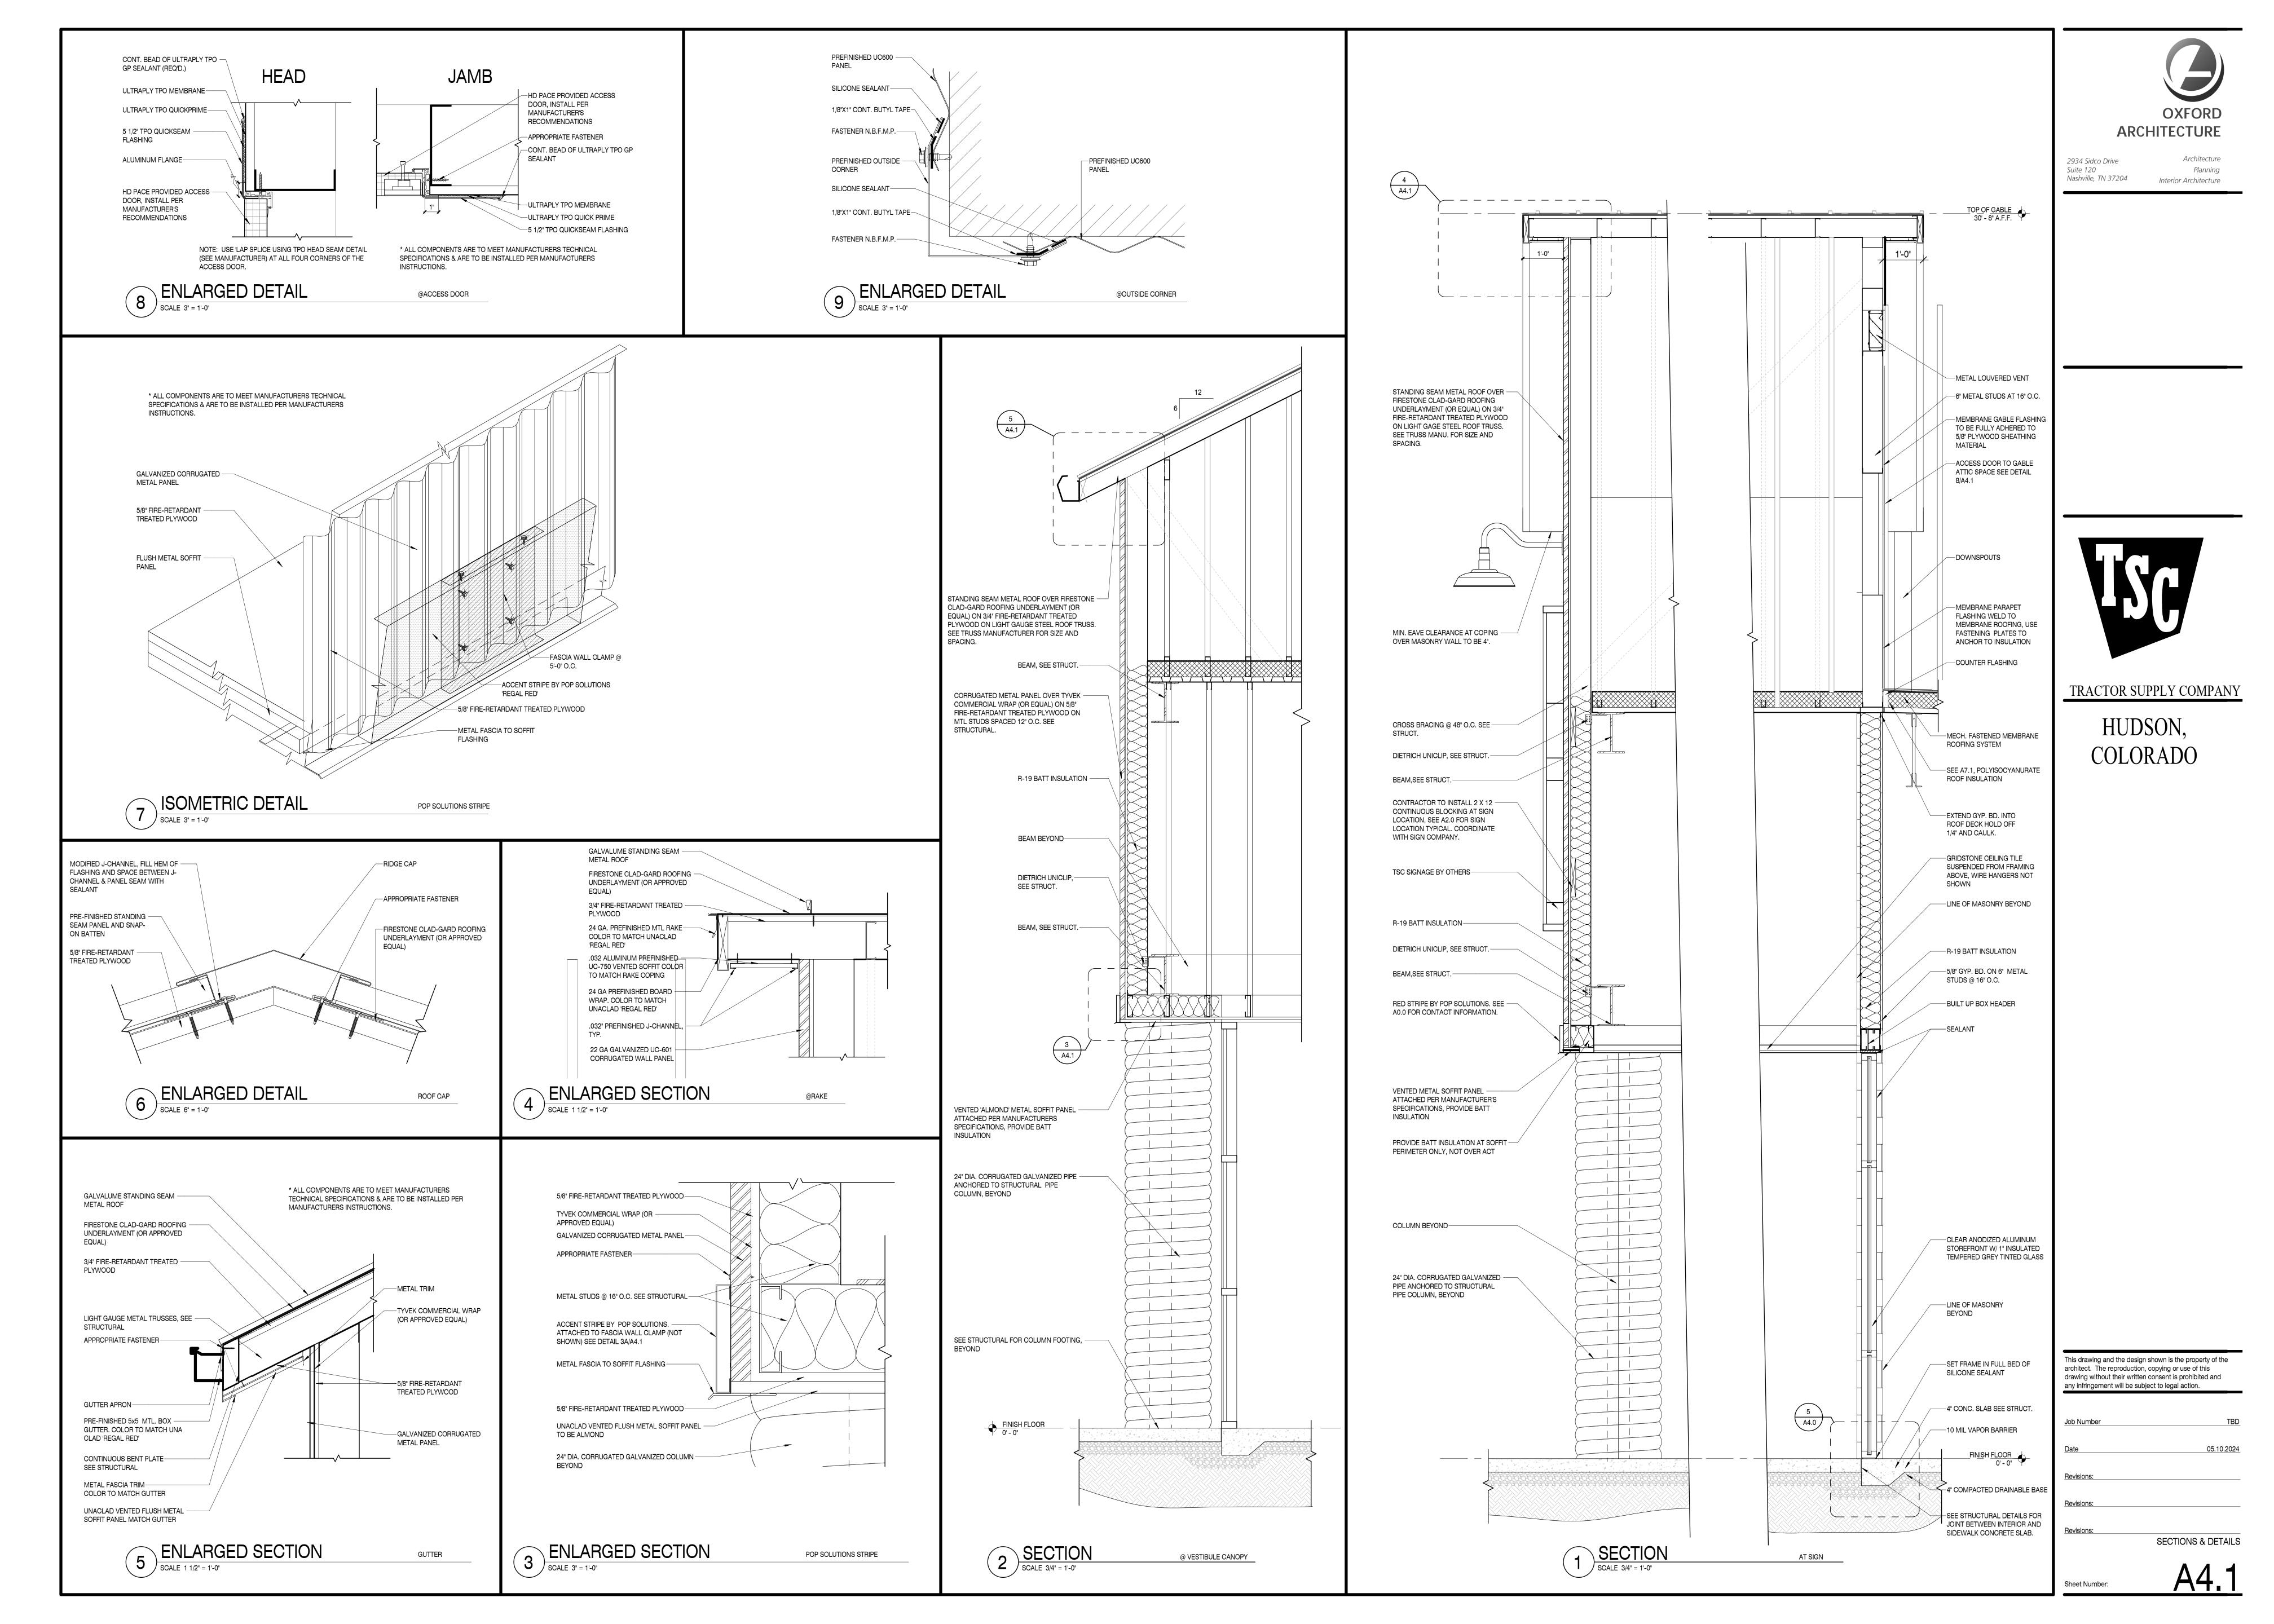

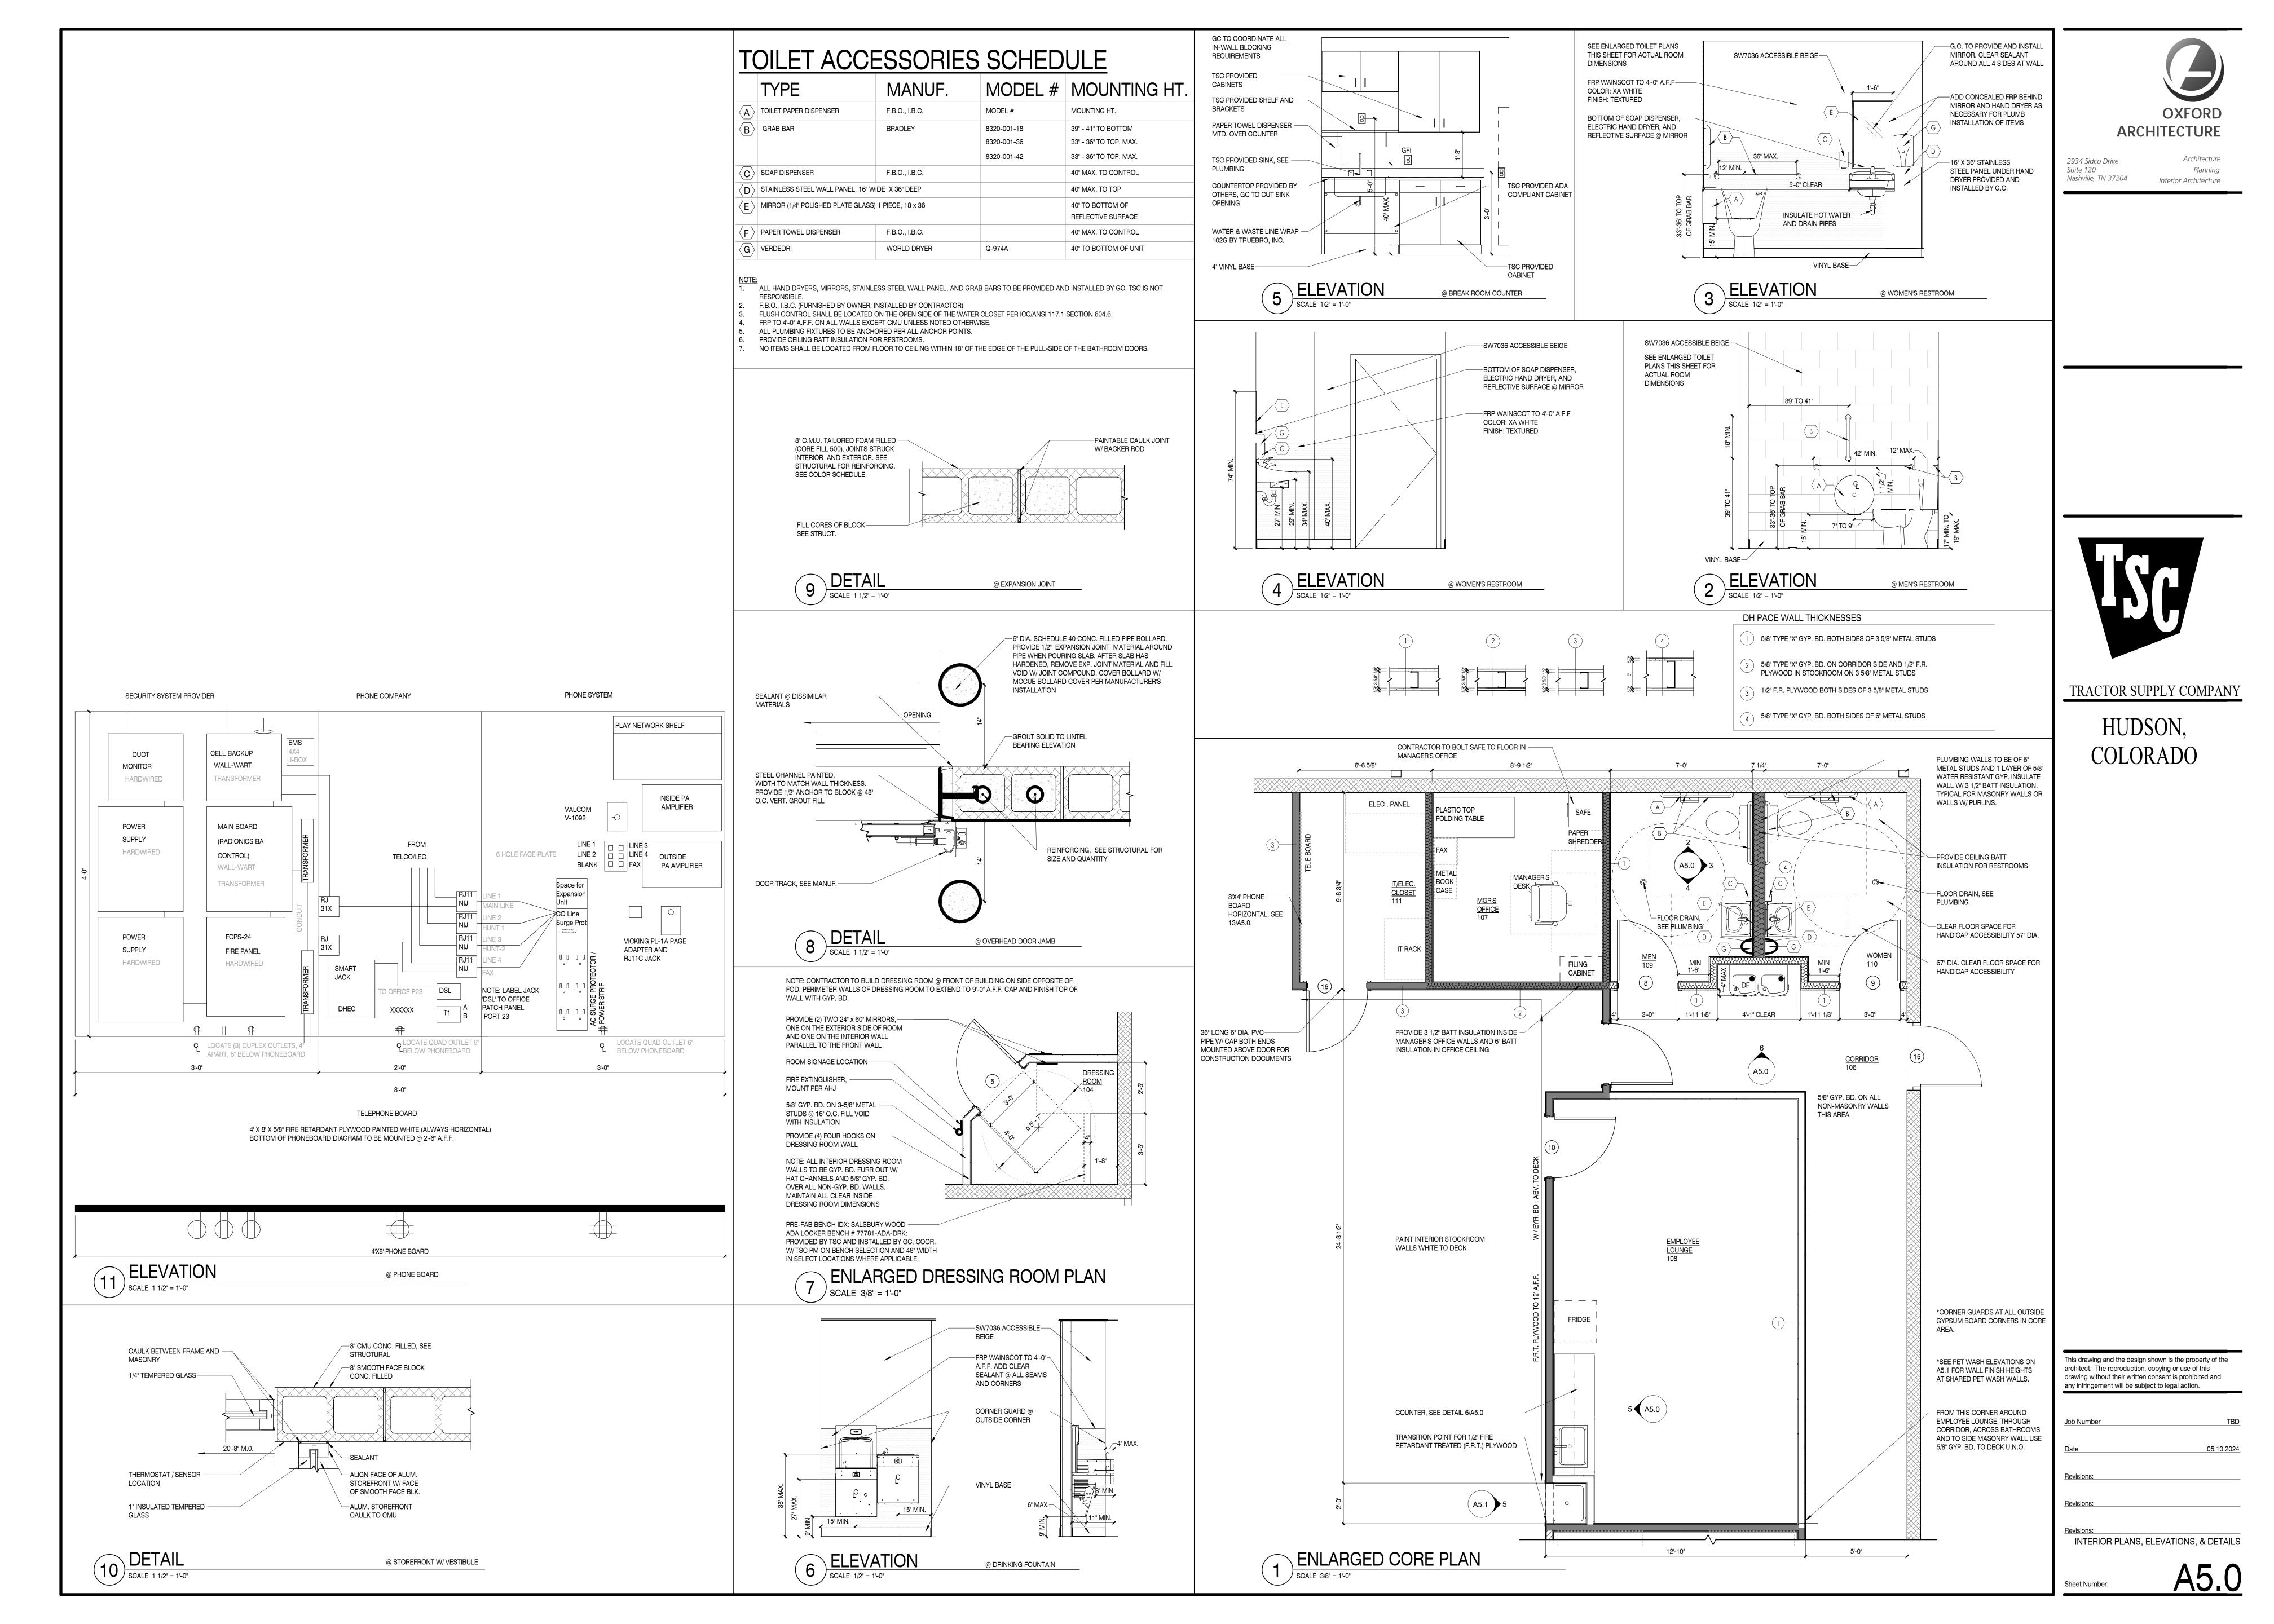

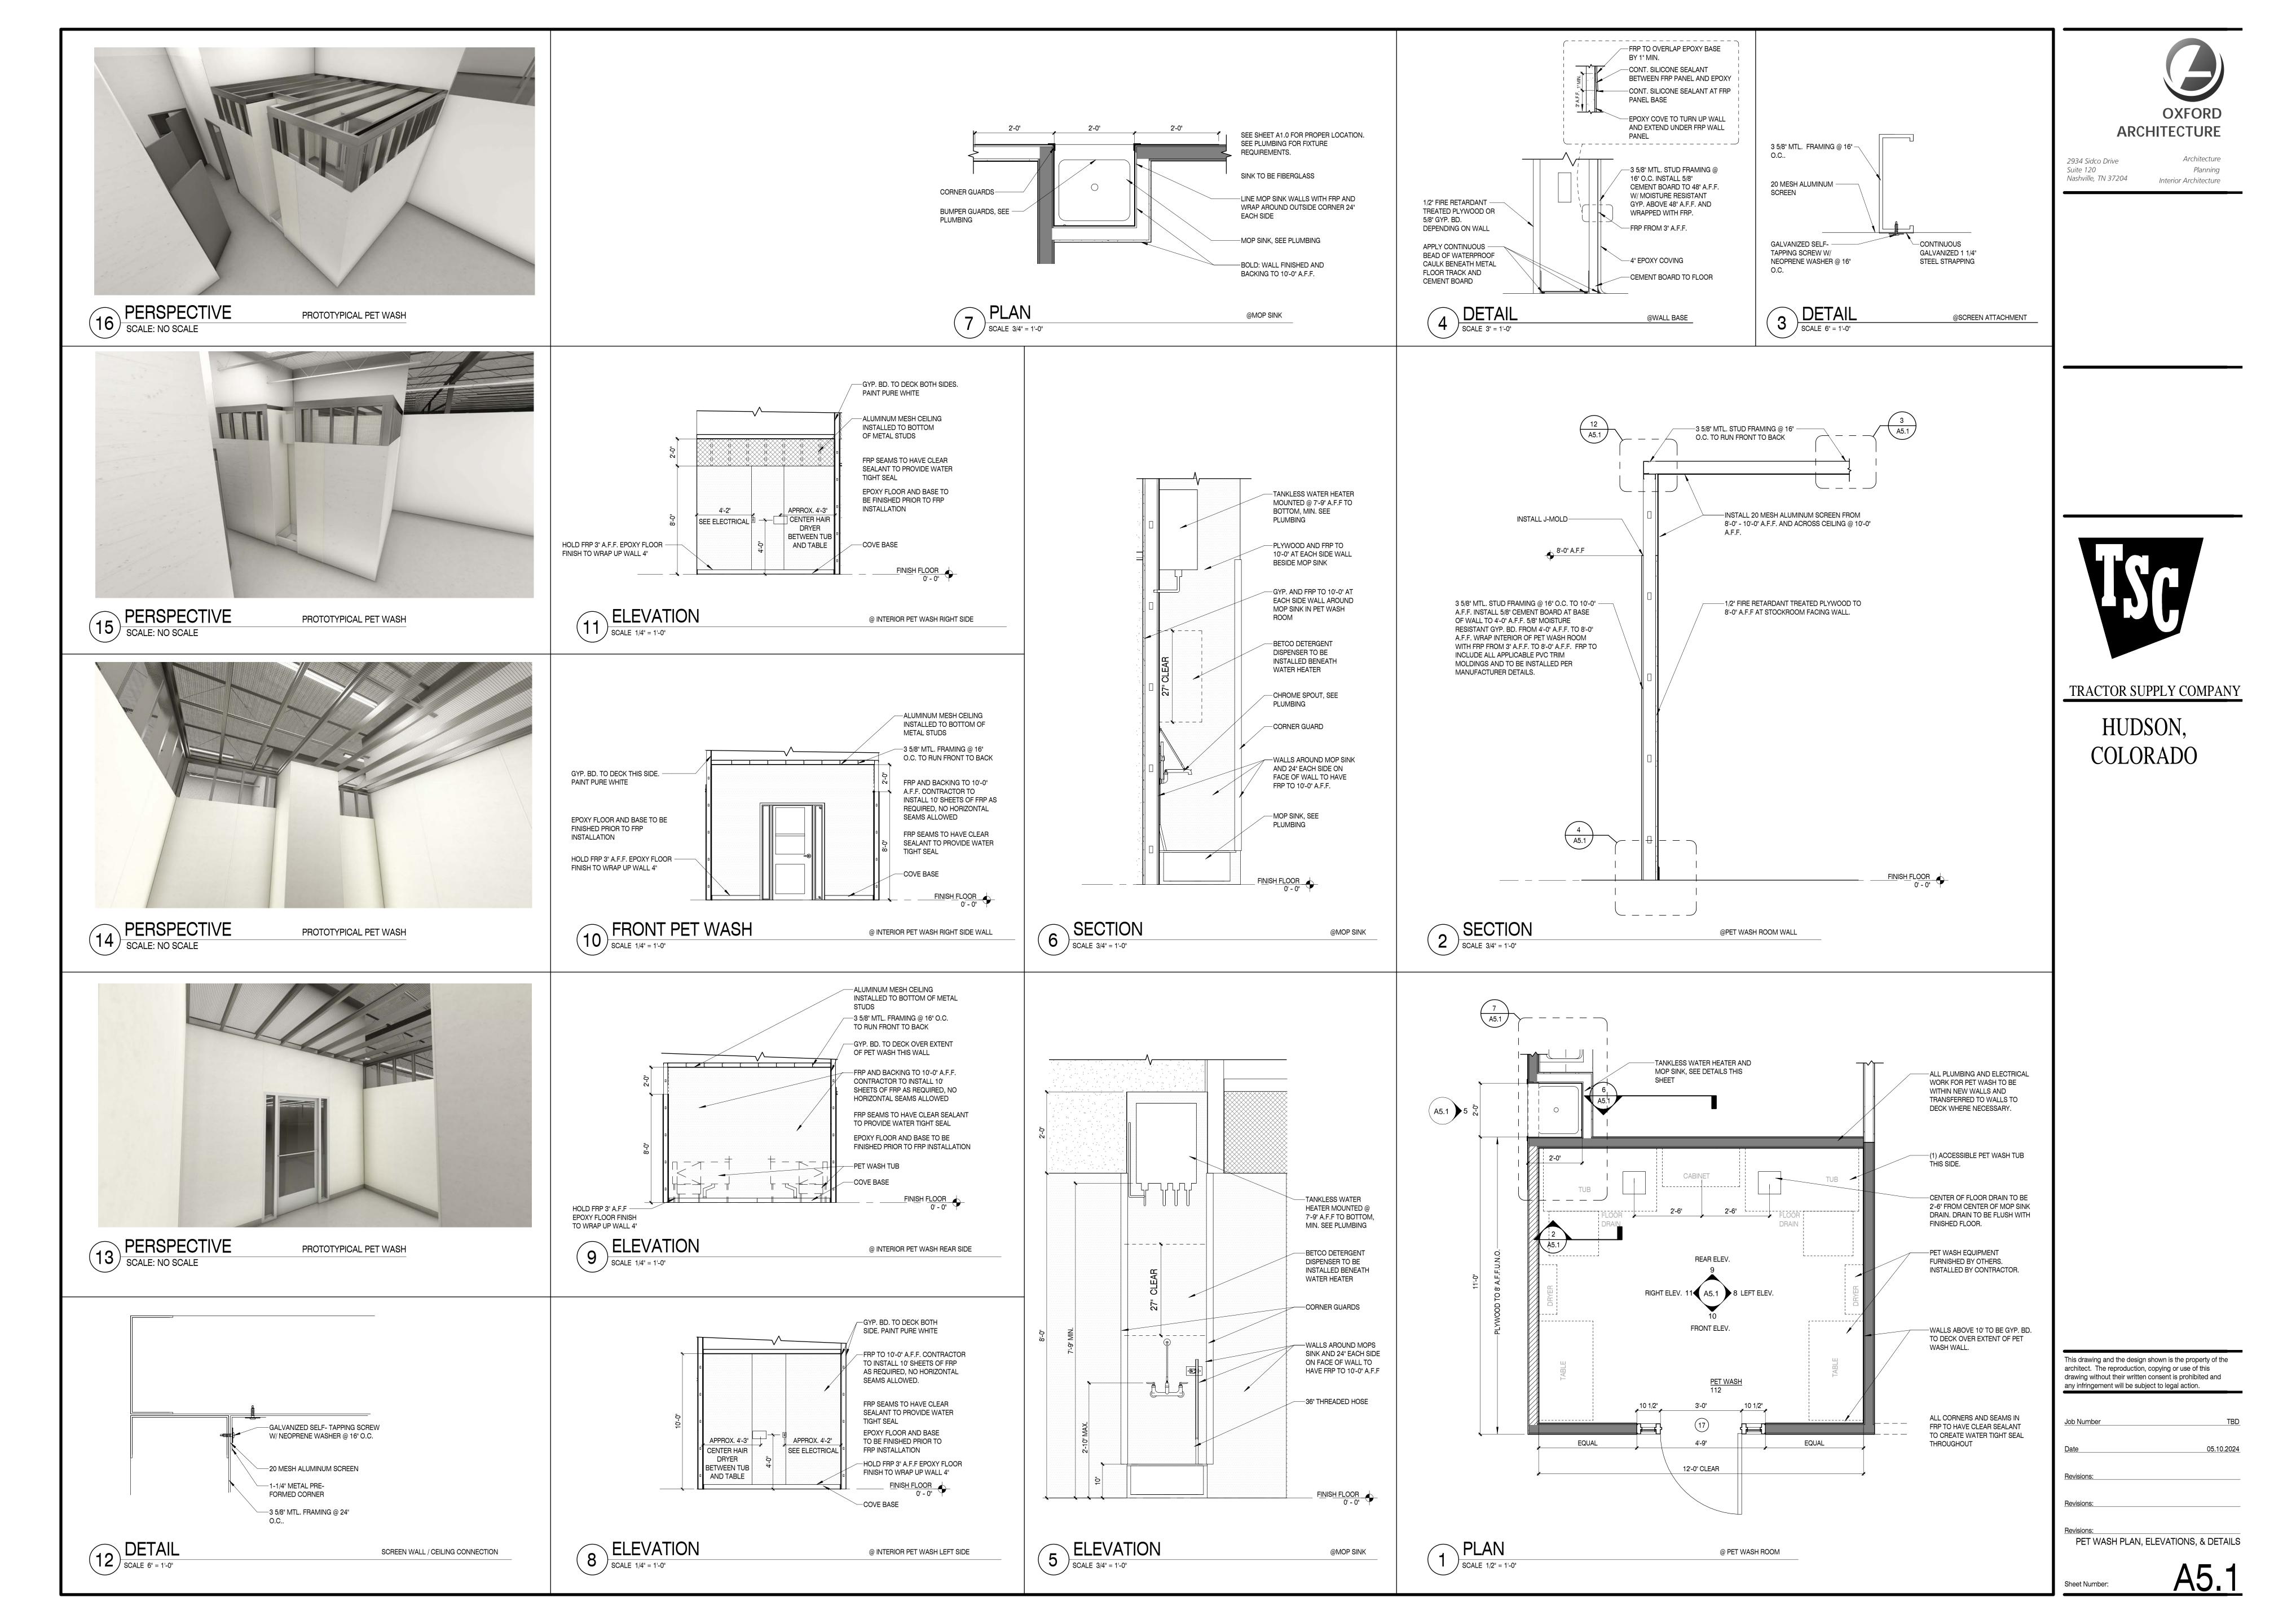

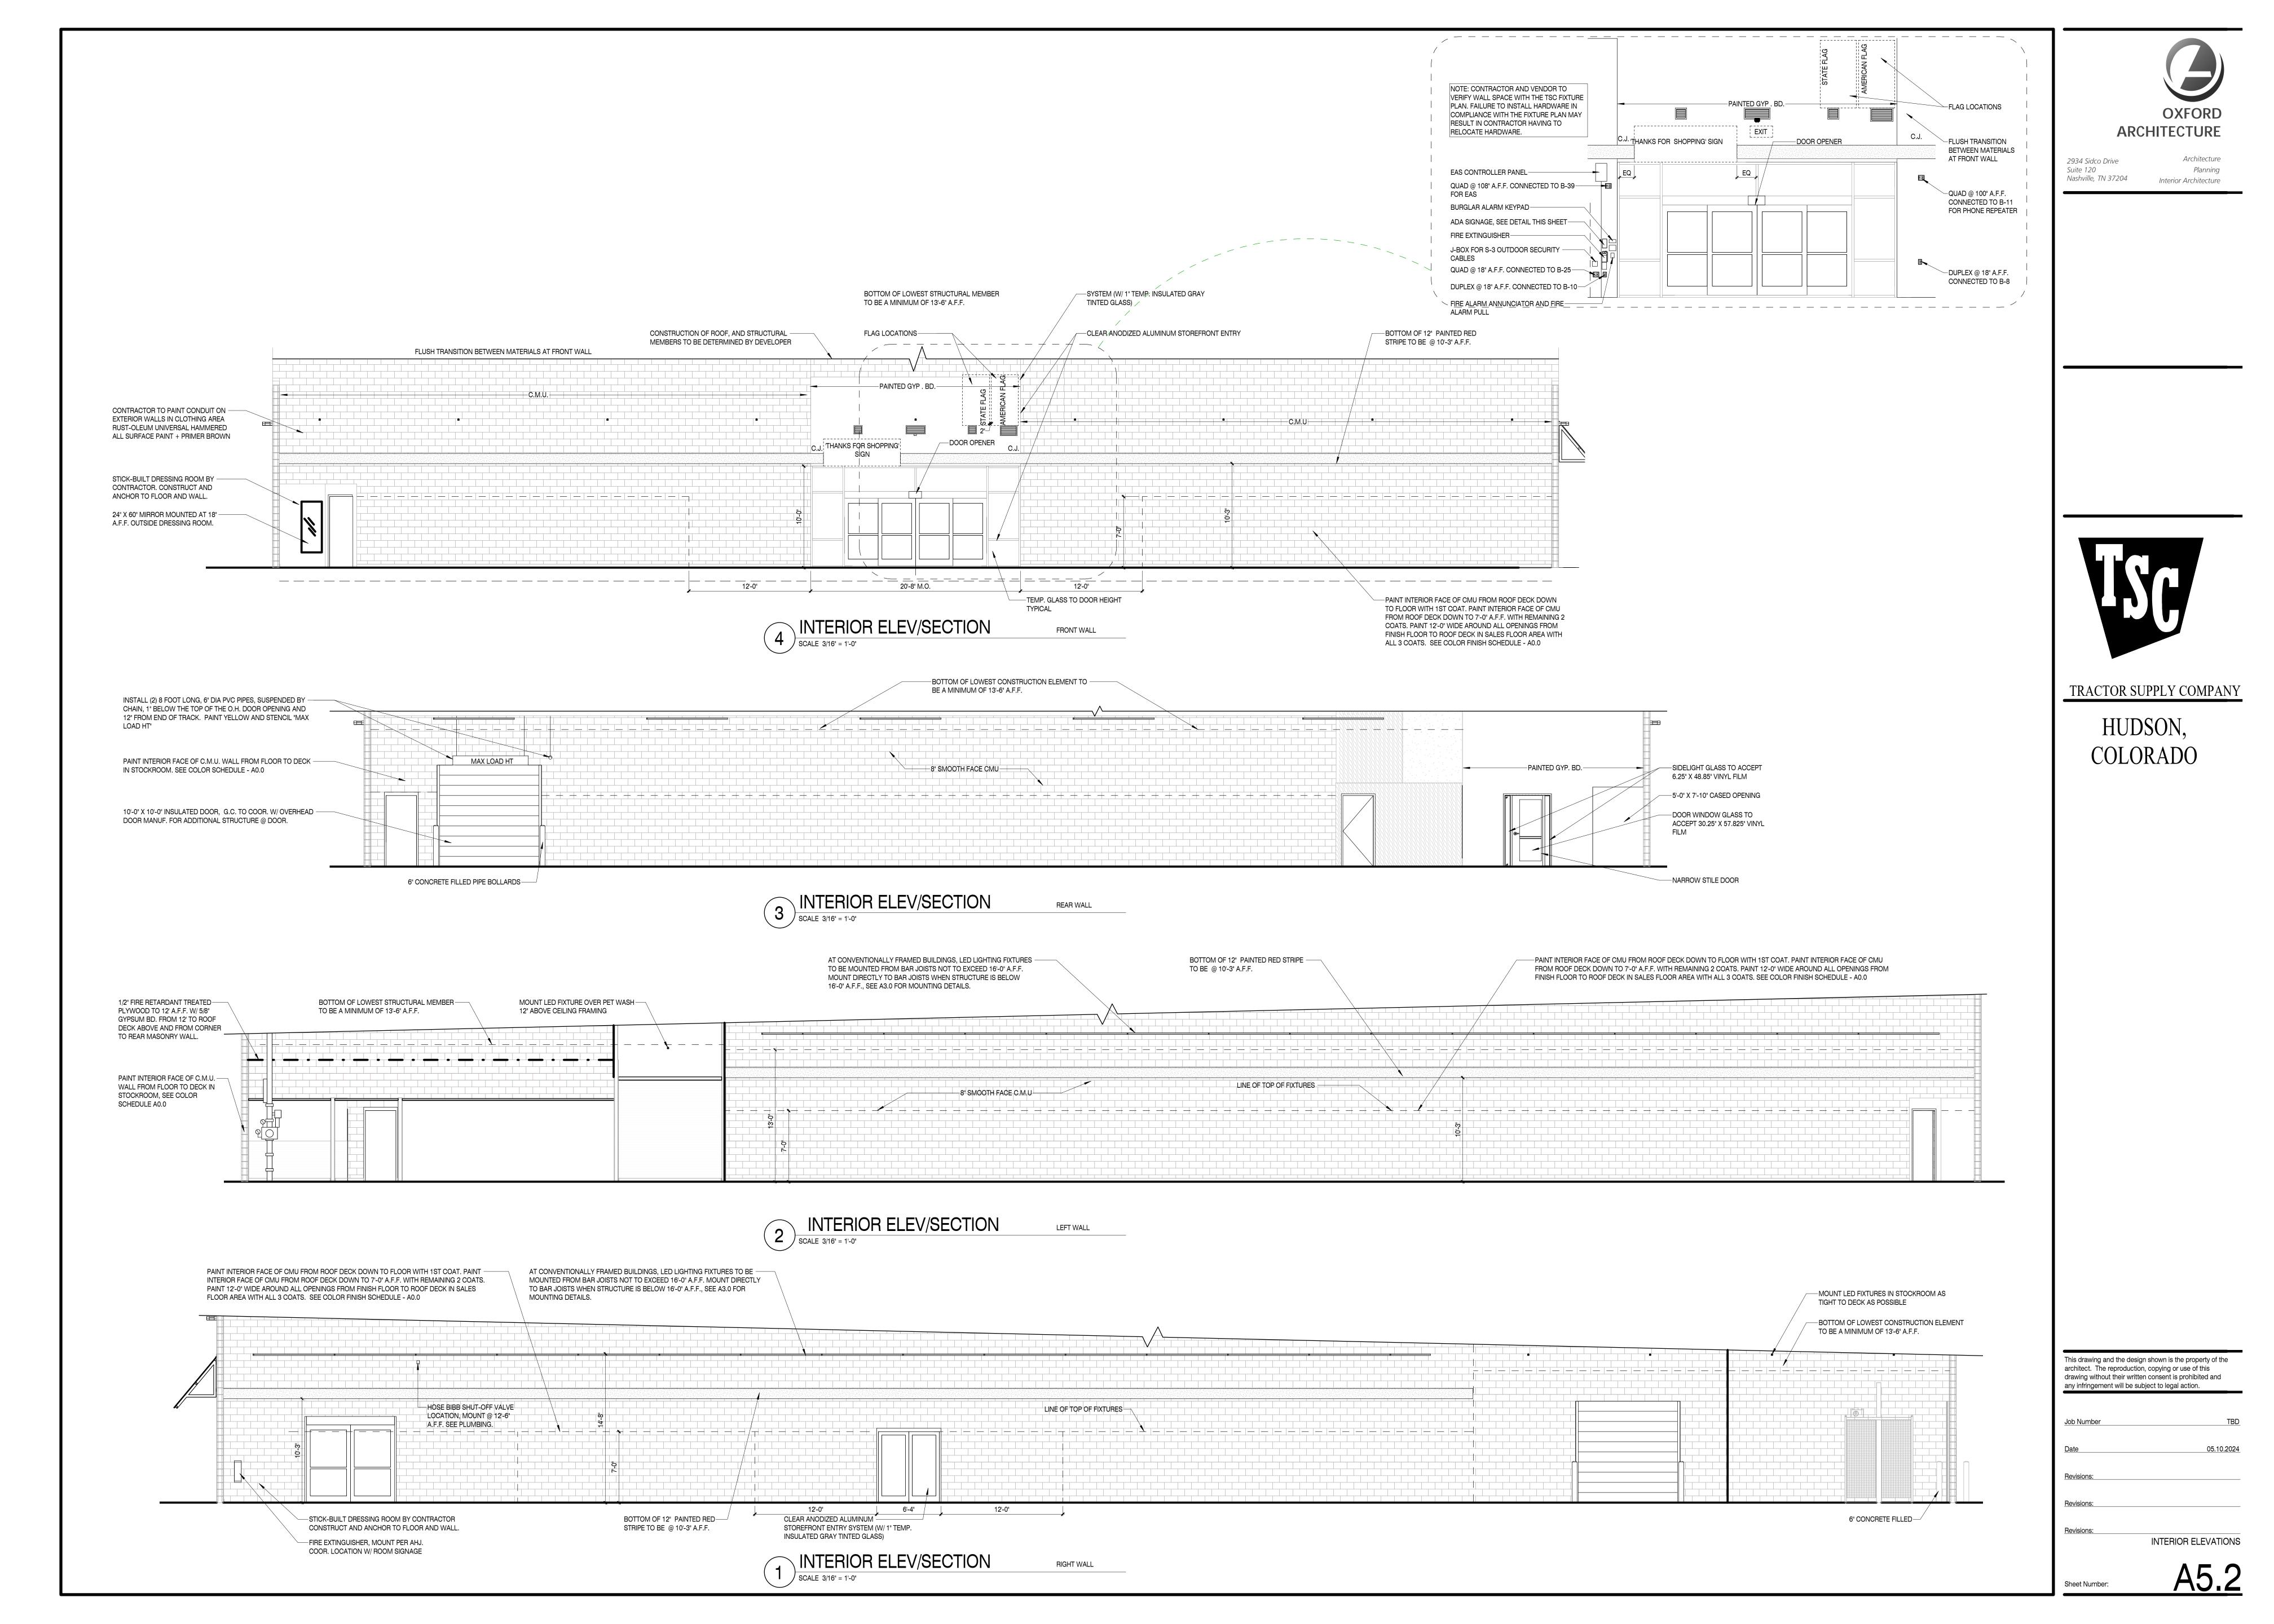

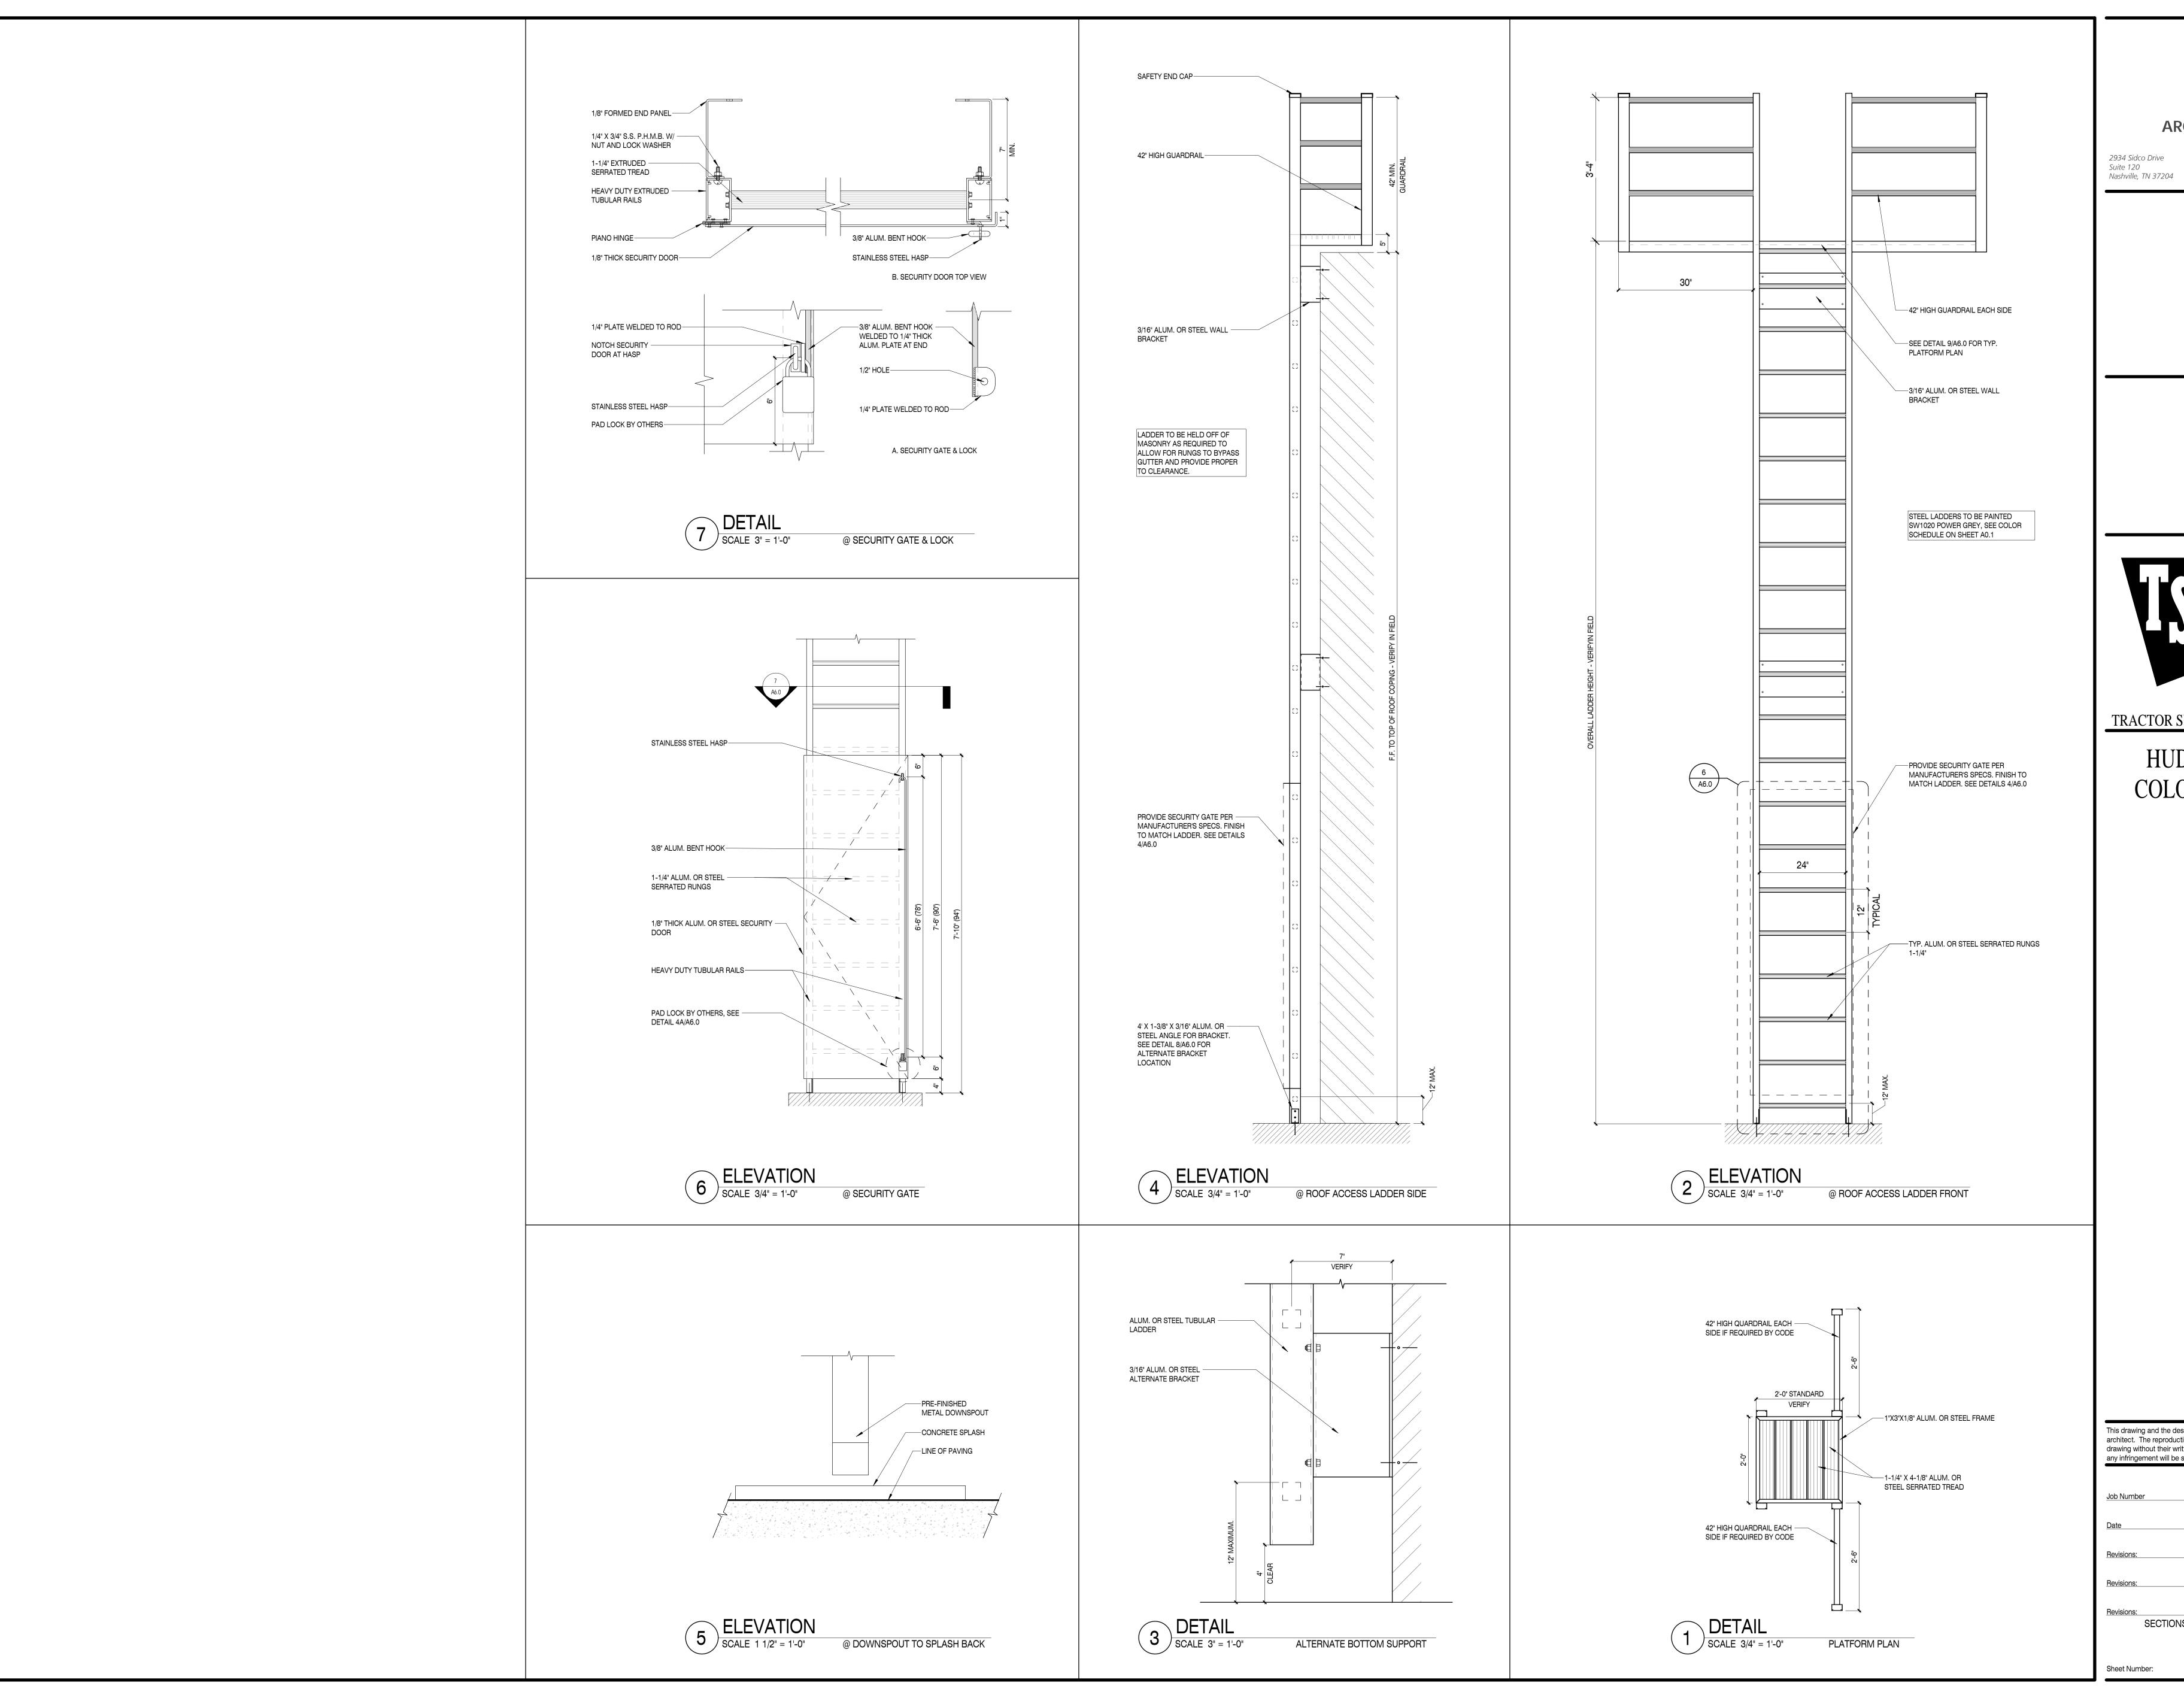



Architecture Interior Architecture


TRACTOR SUPPLY COMPANY


HUDSON, COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

05.10.2024

SECTIONS, DETAILS & ELEVATIONS

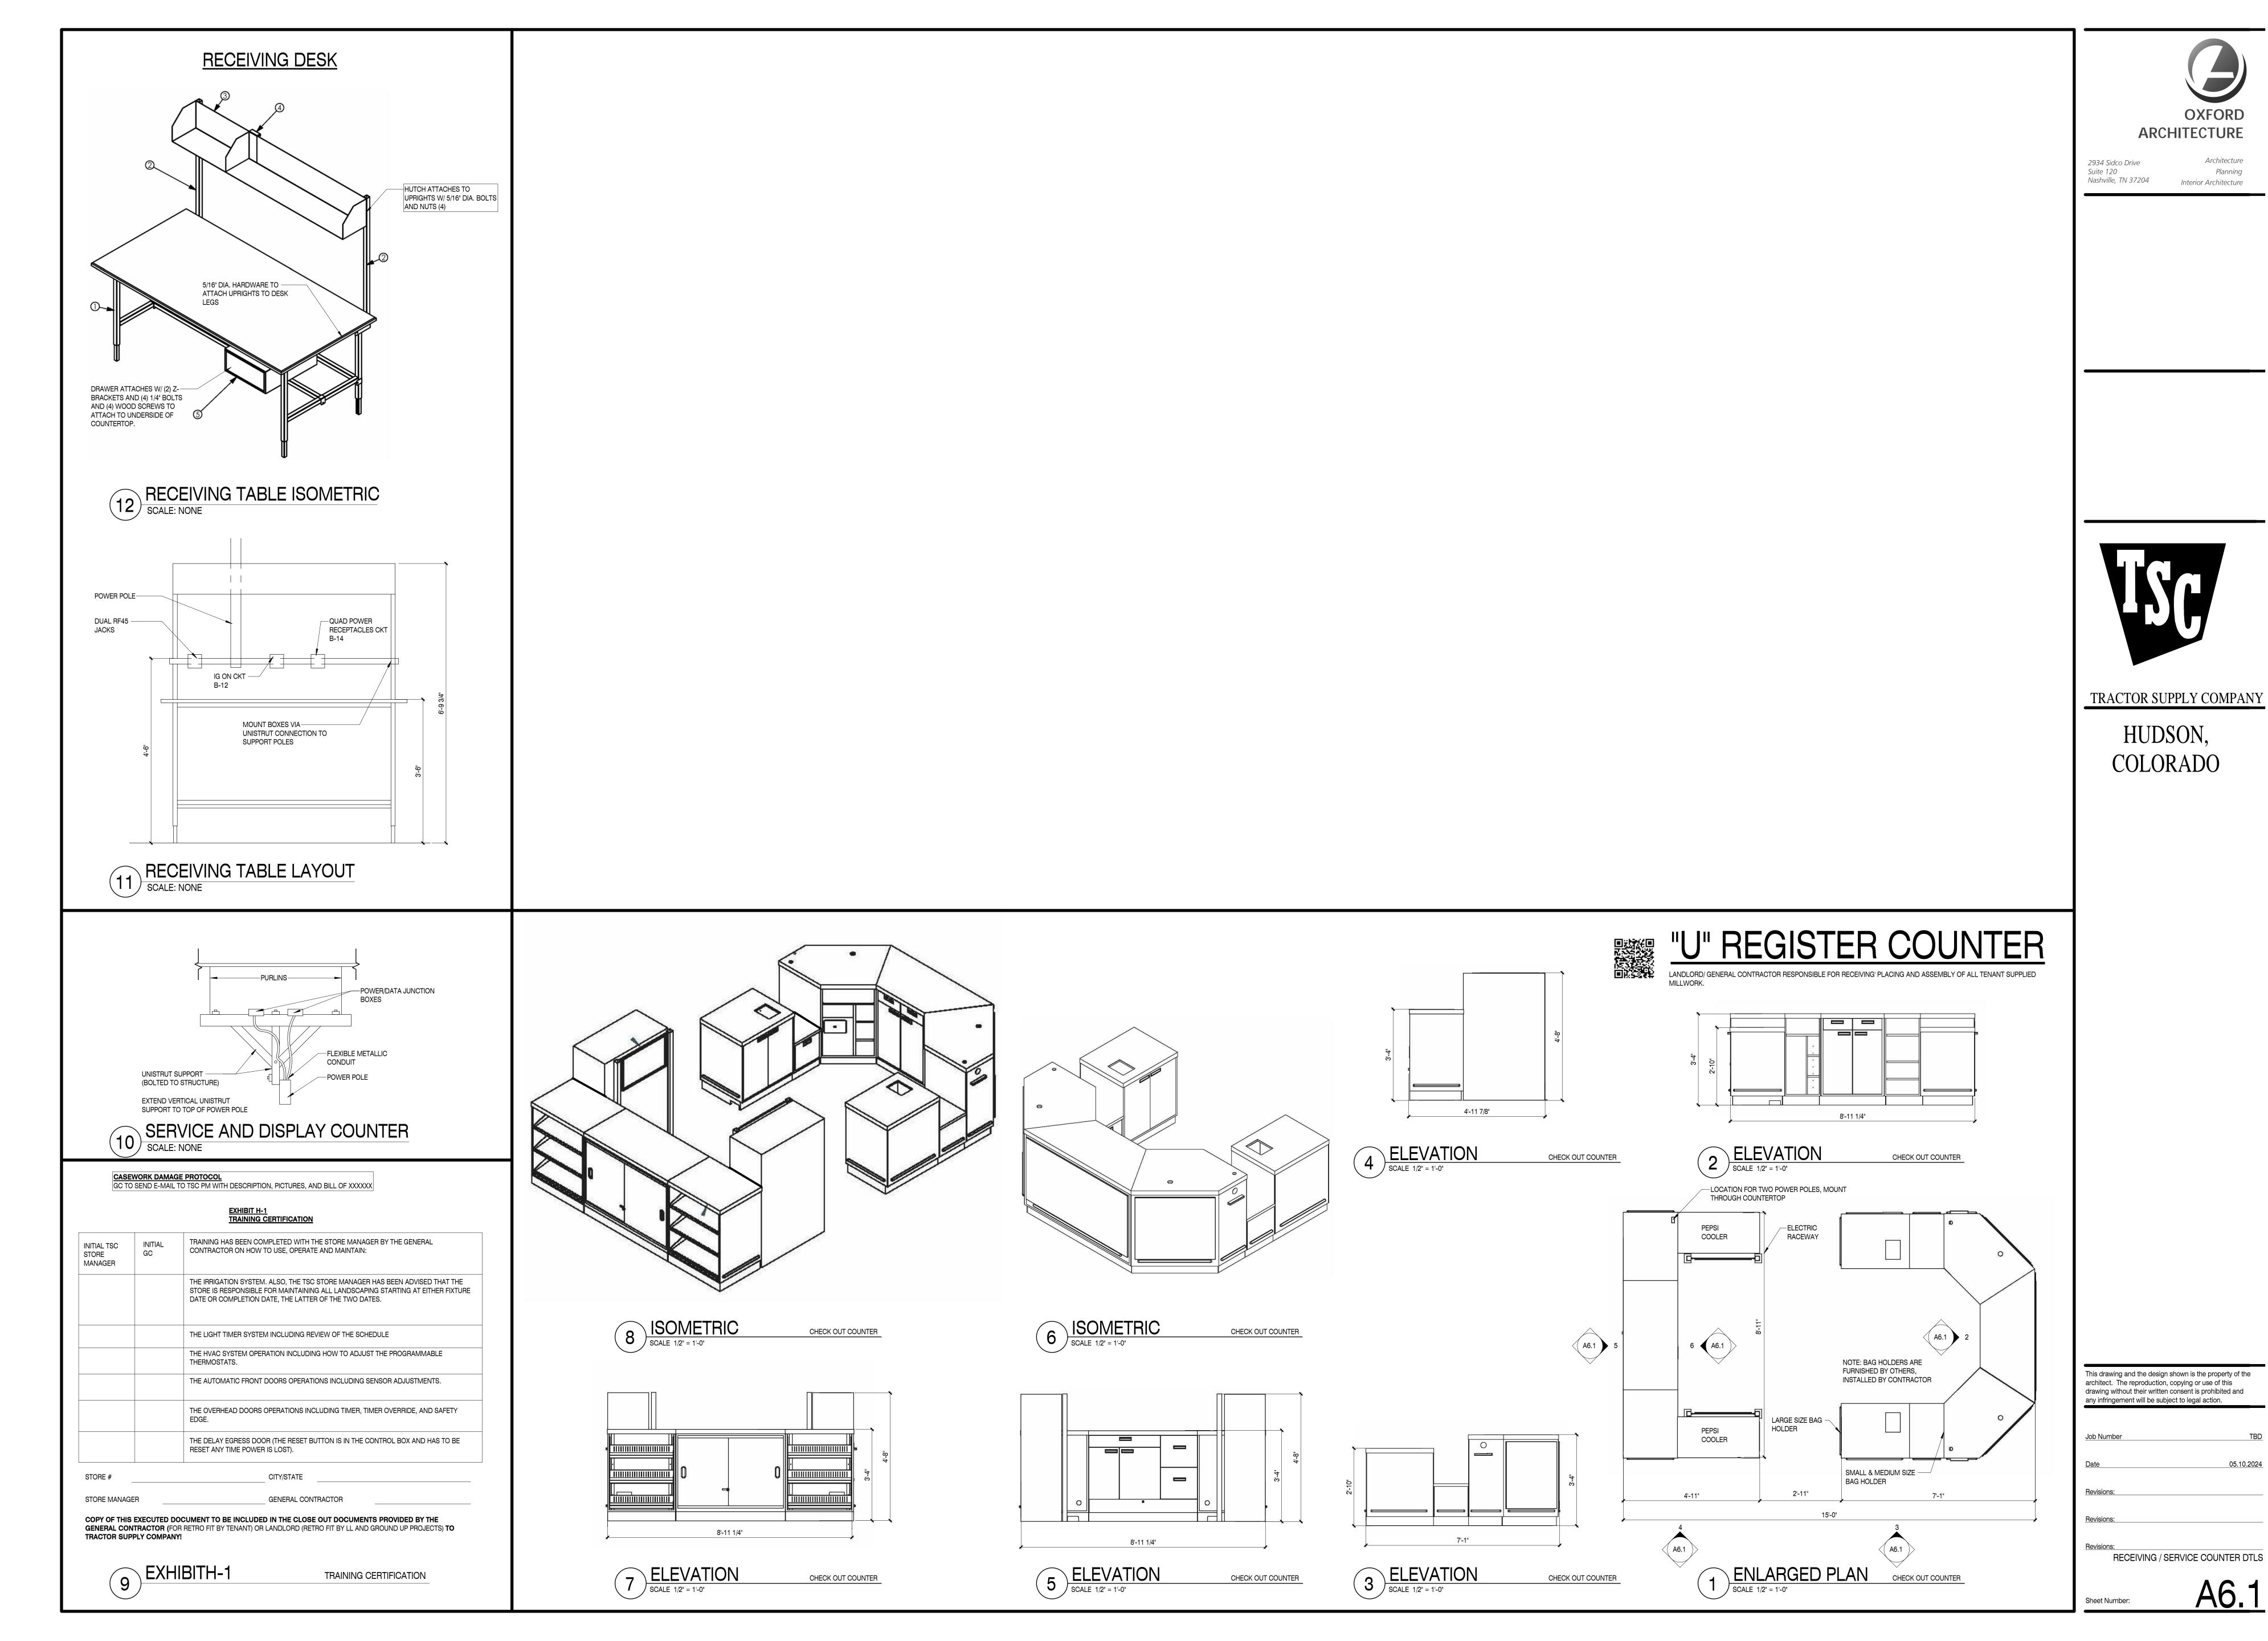

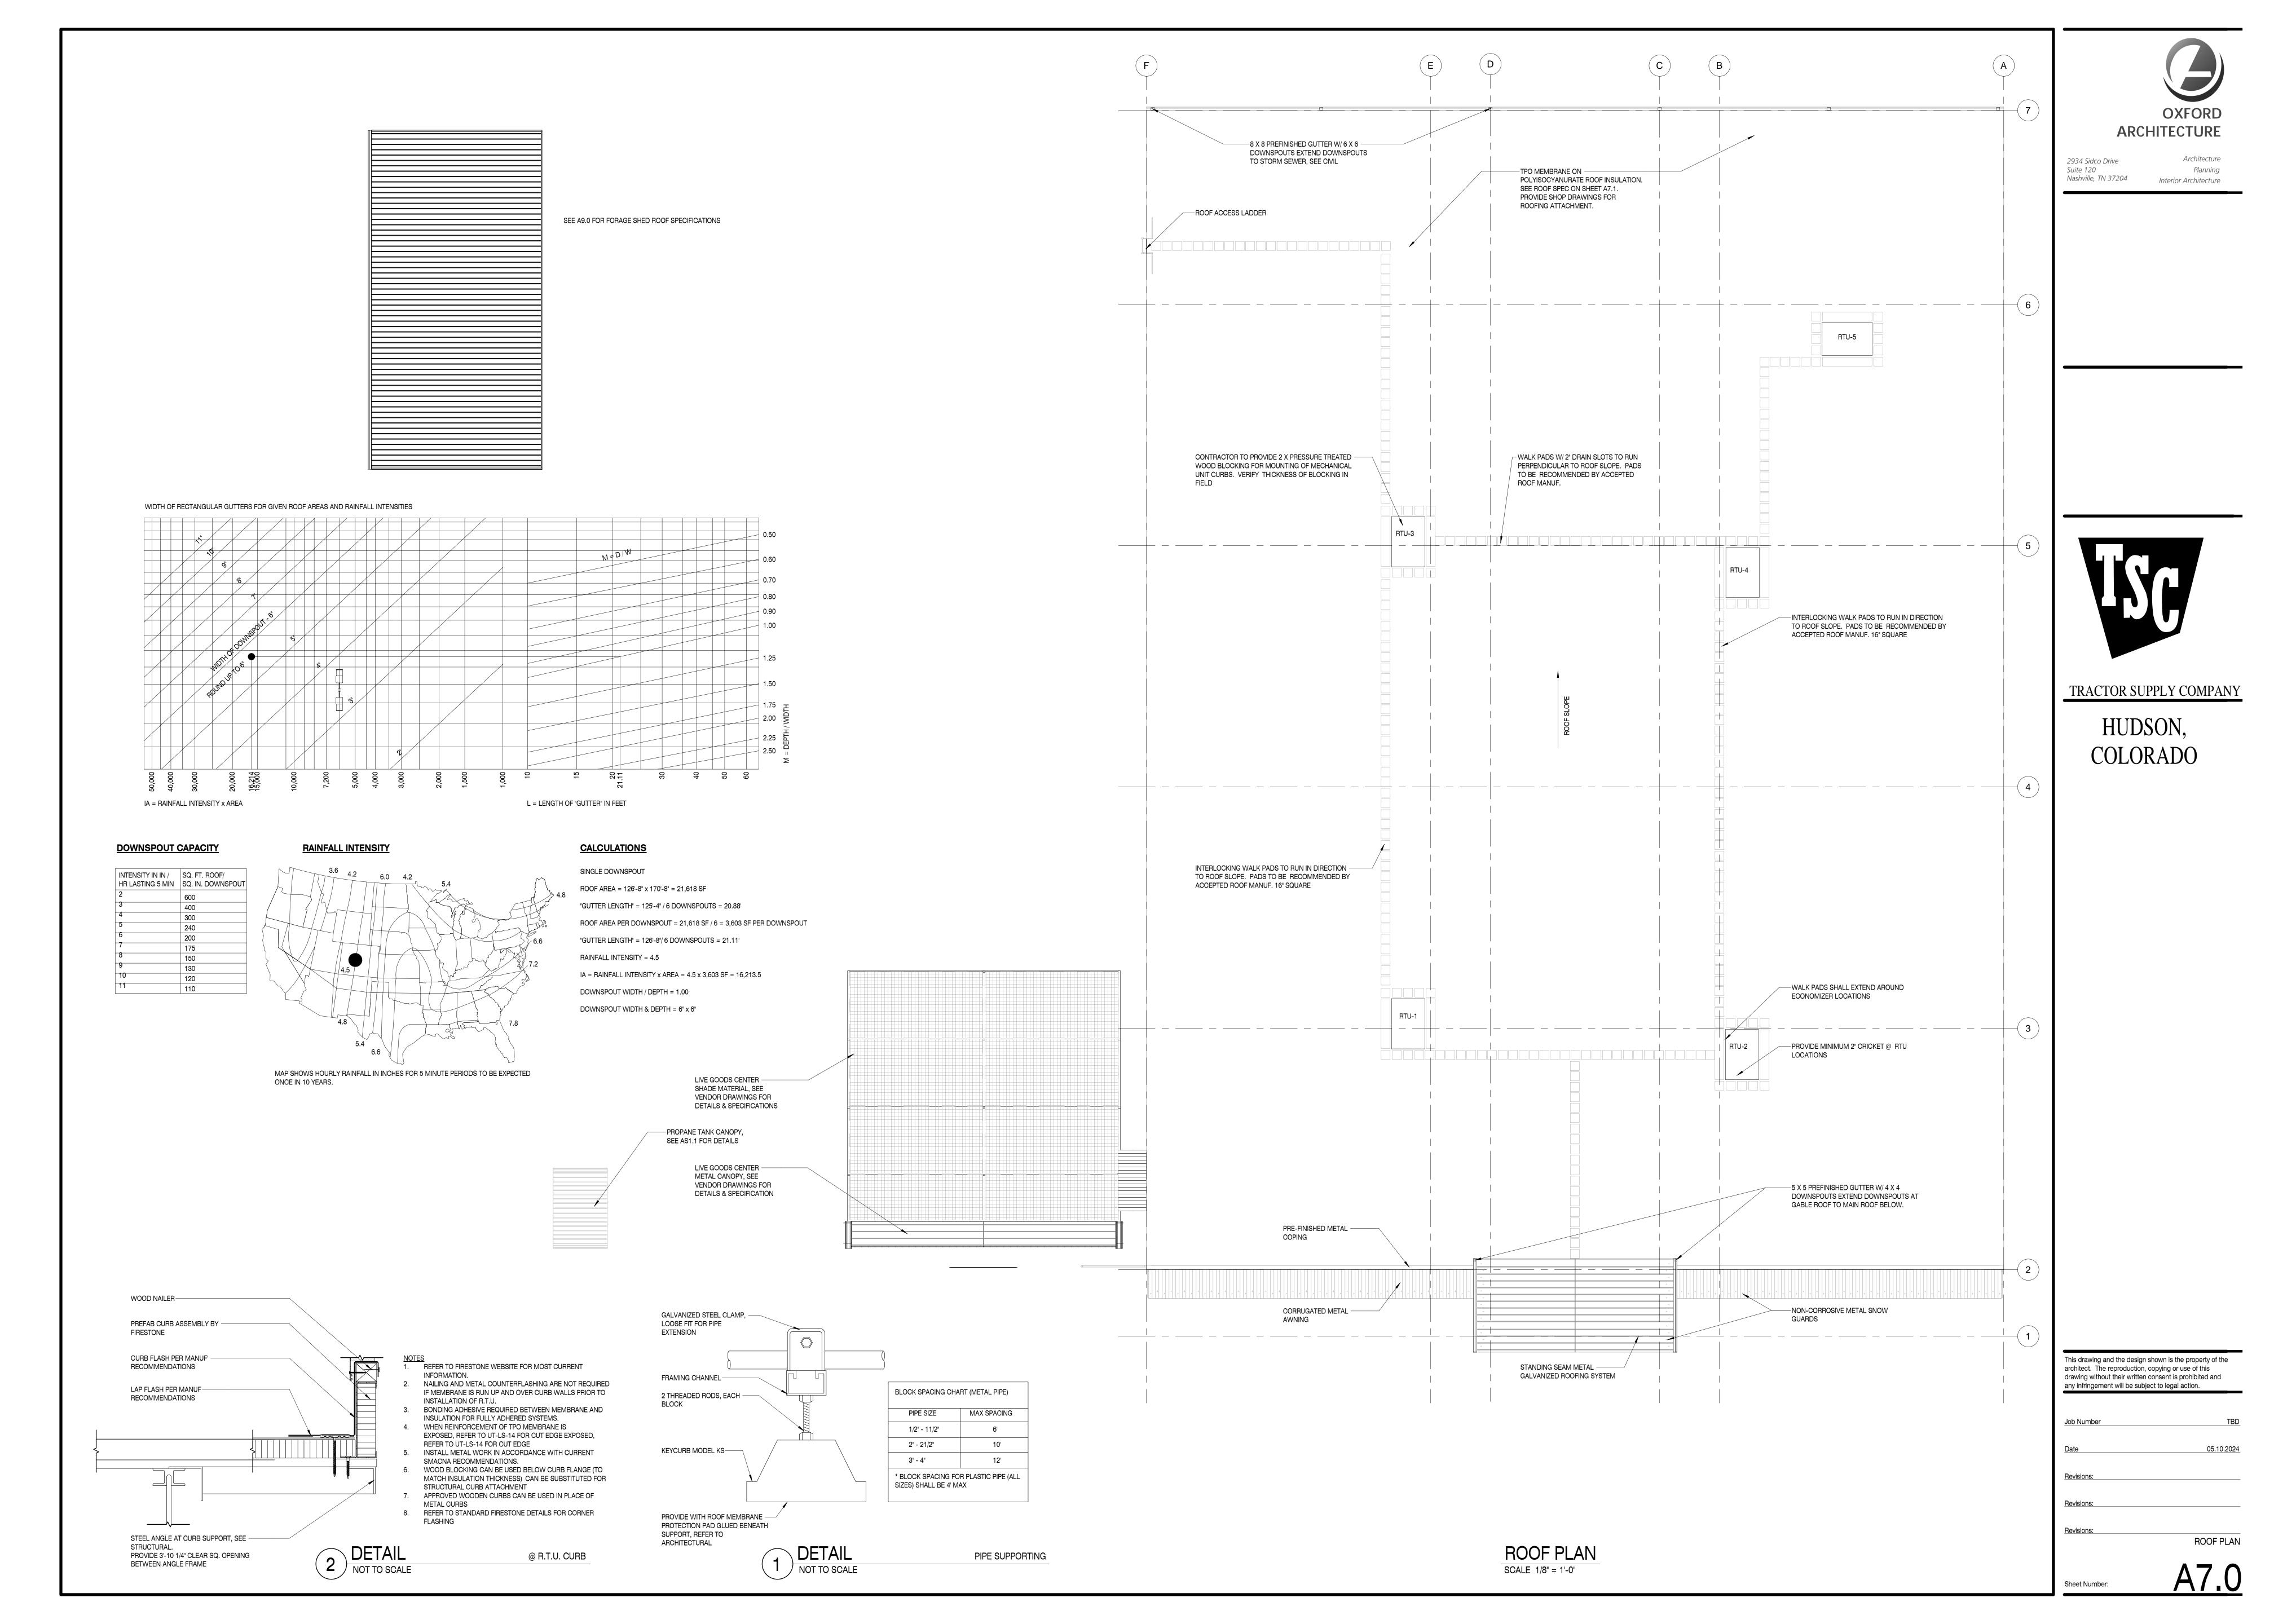

SECTION 07500

MEMBRANE ROOFING

PART 1 GENERAL 1.01 SUMMARY

- Project Name: Tractor Supply. Furnish and install elastomeric sheet roofing system, including:
- Roofing manufacturer's requirements for the specified warranty.
- Preparation of roofing substrates. Wood nailers for roofing attachment.
- Insulation. Elastomeric membrane roofing.
- Metal roof edging and copings.
- Flashings.
- Walkway pads. Other roofing-related items specified or indicated on the drawings or otherwise necessary to provide a complete weatherproof roofing system. Disposal of demolition debris and construction waste is the responsibility of Contractor. Perform disposal in manner complying with all applicable federal, state, and local
- Comply with the published recommendations and instructions of the roofing membrane manufacturer, at http://manual.fsbp.com.
- Commencement of work by the Contractor shall constitute acknowledgement by the Contractor that this specification can be satisfactorily executed, under the project conditions and with all necessary prerequisites for warranty acceptance by roofing membrane manufacturer. No modification of the Contract Sum will be made for failure to adequately examine the Contract Documents or the project conditions.

1.02 REFERENCES

- Referenced Standards: These standards form part of this specification only to the extent they are referenced as specification requirements. ASTM C 1289 - Standard Specification for Faced Rigid Cellular Polyisocyanurate Thermal Insulation Board; 2004.
- ASTM C 1549 Standard Test Method for Determination of Solar Reflectance Near Ambient Temperature Using a Portable Solar Reflectometer; 2004. ASTM D 751 - Standard Test Methods for Coated Fabrics
- ASTM D 1079 Standard Terminology Relating to Roofing, Waterproofing, and Bituminous Materials; 2005a.
- ASTM D 6878 Standard Specification for Thermoplastic Polyolefin Based Sheet Roofing; 2003.
- CAN-ULC-S770 Standard Test Method Determination of L-Term Thermal Resistance Of Closed-Cell Thermal Insulating Foams; 2003. FM 1-28 - Design Wind Loads; Factory Mutual System; 2002.
- FM 1-29 Roof Deck Securement and Above Deck Roof Components; Factory Mutual System; 2005. 10. SPRI ES-1 - Wind Design Standard for Edge Systems Used with Low Slope Roofing Systems; 2003. (ANSI/SPRI ES-1).

1.03 DEFINITIONS Roofing Terminology: Refer to ASTM D 1079 for definition of terms related to roofing work not otherwise defined in the section. 2. LTTR: Long Term Thermal Resistance, as defined by CAN-ULC S770.

1.04 SUBMITTALS Product Data:

- Provide membrane manufacturer's printed data sufficient to show that all components of roofing system, including insulation and fasteners, comply with the specified requirements and with the membrane manufacturer's requirements and recommendations for the system type specified; include data for each product used in conjunction with roofing membrane.
- Where UL or FM requirements are specified, provide documentation that shows that the roofing system to be installed is UL-Classified or FM-approved, as applicable; include data itemizing the components of the classified or approved system. Installation Instructions: Provide manufacturer's instructions to installer, marked up to show exactly how all components will be installed; where instructions allow
- installation options, clearly indicate which option will be used. Samples: Submit samples of each product to be used.
- Shop Drawings: Provide: The roof membrane manufacturer's standard details customized for this project for all relevant conditions, including flashings, base tie-ins, roof edges, terminations, expansion joints, penetrations, and drains.
- Specimen Warranty: Submit prior to starting work. Pre-Installation Notice: Copy to show that manufacturer's required Pre Installation Notice (PIN) has been accepted and approved by the manufacturer. Executed Warranty.

1.05 QUALITY ASSURANCE

- Applicator Qualifications: Roofing installer shall have the following:
- Current Firestone Master Contractor status. At least five years experience in installing specified system.

1.06 DELIVERY, STORAGE AND HANDLING

- Deliver products in manufacturer's original containers, dry and undamaged, with seals and labels intact and legible.
- Store materials clear of ground and moisture with weather protective covering. Keep combustible materials away from ignition sources.

- 1.07 WARRANTY Comply with all warranty procedures required by manufacturer, including notifications, scheduling, and inspections.
- Warranty: Firestone 15 year Red Shield Limited Warranty covering membrane, roof insulation, and membrane accessories. Limit of Liability: No dollar limitation.
- Scope of Coverage: Repair leaks in the roofing system caused by:
- Ordinary wear and tear of the elements. Manufacturing defect in Firestone brand materials.
- Defective workmanship used to install these materials.
- Damage due to winds up to 55 mph (88 km/h). Not Covered:
- Damage due to winds in excess of 55 mph (88 km/h).
- Damage due hurricanes or tornadoes.
- Intentional damage. e. Unintentional damage due to normal rooftop inspections, maintenance, or service.

PART 2 PRODUCTS 2.01 MANUFACTURERS

- Acceptable Manufacturer Roofing System: Firestone Building Products Co., Indianapolis, IN. www.firestonebpco.com. Roofing systems manufactured by others are acceptable provided the roofing system is completely equivalent in materials and warranty conditions and the manufacturer meets the following qualifications:
- Specializing in manufacturing the roofing system to be provided.
- Minimum ten years of experience manufacturing the roofing system to be provided. Able to provide a no dollar limit, single source roof system warranty that is backed by corporate assets in excess of one billion dollars.
- ISO 9002 certified. Able to provide isocyanurate insulation that is produced in own facilities.
- Roofing systems manufactured by the companies listed below are acceptable provided they are completely equivalent in materials and warranty conditions:
- Carlisle SynTec Systems.
- Manufacturer of Insulation and Cover Boards: Same manufacturer as roof membrane.
- Manufacturer of Metal Roof Edging: Same manufacturer as roof membrane. Metal roof edging products by other manufacturers are not acceptable.
- Substitution Procedures: See Instructions to Bidders.
- Submit evidence that the proposed substitution complies with the specified requirements.

2.02 ROOFING SYSTEM DESCRIPTION

- Roofing System: Membrane: Thermoplastic olefin (TPO).
- Thickness: As specified elsewhere. Membrane Attachment: Mechanically attached with plates in seams.
- Comply with applicable local building code requirements.
- Provide assembly having Underwriters Laboratories, Inc. (UL) Class A Fire Hazard Classification. Provide assembly complying with Factory Mutual Corporation (FM) Roof Assembly Classification, FM DS 1-28 and 1-29, and meeting minimum requirements of FM 1-75 wind uplift rating.
- Provide assembly to meet the following minimum design uplift-resistance capacities: See structural sheet S5.0.

- Total R Value: SEE COMCHECK. Maximum Board Thickness: 3.25 inches (63 mm); use as many layers as necessary; stagger joints in adjacent layers.
- Base Layer: Polyisocyanurate foam board, non-composite. Attachment: Loose laid, no attachment.
- Top Layer: Polyisocyanurate foam board, non-composite. Attachment: Mechanical fastening.

- 2.03 TPO MEMBRANE MATERIALS (THIS PROJECT REQUIRES 45 MIL. MEMBRANE)
- 1. Membrane: Flexible, heat weldable sheet composed of thermoplastic polyolefin polymer and ethylene propylene rubber; complying with ASTM D 6878, with polyester weft inserted reinforcement and the following additional characteristics:
- i. Thickness: 0.045 inch (1.14 mm) plus/minus 10 percent, with coating thickness over reinforcement of 0.015 inch (0.38 mm) for 45 mil and .021" (.53 mm) for 60 mil plus/minus 10 percent. Refer to ASTM D7635 Standard Test Method for Measurement of Thickness of Coatings Over Fabric Reinforcement. Sheet Width: Provide sheets of width necessary to accommodate batten spacing required by manufacturer for project conditions.
- Puncture Resistance: 265 lbf (1174 N), minimum, when tested in accordance FTM 101C Method 2031.
- Solar Reflectance: 0.79, minimum, when tested in accordance with ASTM C 1549.
- v. Color: White. Acceptable Product: ULTRAPLY TPO by Firestone.
 - Membrane Fasteners: Type and size as required by roof membrane manufacturer for roofing system and warranty to be provided; use only fasteners furnished by roof 3. Curb and Parapet Flashing: Same material as membrane, with encapsulated edge which eliminates need for seam sealing the flashing-to-roof splice; precut to 18
 - inches (457 mm) wide. Formable Flashing: Non-reinforced, flexible, heat weldable sheet, composed of thermoplastic polyolefin polymer and ethylene propylene rubber.
 - Thickness: 0.045 inch (1.14 mm) plus/minus 10 percent.
- Tensile Strength: 1550 psi (10.7 MPa), minimum, when tested in accordance with ASTM D 638 after heat aging. Elongation at Break: 650 percent, minimum, when tested in accordance with ASTM D 638 after heat aging.
- Tearing Strength: 12 lbf (53 N), minimum, when tested in accordance with ASTM D 1004 after heat aging. Color: White.
 - Acceptable Product: ULTRAPLY TPO Flashing by Firestone. Tape Flashing: 5-1/2 inch (140 mm) nominal wide TPO membrane laminated to cured rubber polymer seaming tape, overall thickness 0.065 inch (1.6 mm) nominal; TPO QuickSeam Flashing by Firestone.
 - Pourable Sealer: Two-part polyurethane, two-color for reliable mixing; Pourable Sealer by Firestone.
- Seam Plates: Steel with barbs and Galvalume coating; corrosion-resistance complying with FM 4470. Termination Bars: Aluminum bars with integral caulk ledge; 1.3 inches (33 mm) wide by 0.10 inch (2.5 mm) thick; Firestone Termination Bar by Firestone.
- Cut Edge Sealant: Synthetic rubber-based, for use where membrane reinforcement is exposed; UltraPly TPO Cut Edge Sealant by Firestone. General Purpose Sealant: EPDM-based, one part, white general purpose sealant; UltraPly TPO General Purpose Sealant by Firestone.
- UltraPly TPO Small and Large Pipe Flashing by Firestone. 12. Roof Walkway Pads: Non-reinforced TPO walkway pads, 0.130 inch (3 mm) by 30 inches (760 mm) by 50 feet (15.24 m) long with patterned traffic bearing surface; UltraPly TPO Walkway Pads by Firestone.

Molded Flashing Accessories: Unreinforced TPO membrane pre-molded to suit a variety of flashing details, including pipe boots, inside corners, outside corners, etc.;

2.04 ROOF INSULATION AND COVER BOARDS

- 1. Polyisocyanurate Board Insulation: Closed cell polyisocyanurate foam with black glass reinforced mat laminated to faces, complying with ASTM C 1289 Type I Class 1, with the following additional characteristics:
- Thickness: As indicated elsewhere. Size: 48 inches (1220 mm) by 96 inches (2440 mm), nominal. Exception: Insulation to be attached using adhesive or asphalt may be no larger than 48 inches (1220 mm) by 48 inches (1220 mm), nominal.
- 1.0 inch (25 mm) Thickness: 5.6, minimum.
- 1.5 inch (38 mm) Thickness: 8.5, minimum. 2.0 inch (51 mm) Thickness: 11.4, minimum. 2.5 inch (64 mm) Thickness: 14.4, minimum.
- Compressive Strength: 20 psi (138 kPa) when tested in accordance with ASTM C 1289. v. Ozone Depletion Potential: Zero; made without CFC or HCFC blowing agents.
- Recycled Content: 19 percent post-consumer and 15 percent post-industrial, average.
- . Insulation Fasteners: Type and size as required by roof membrane manufacturer for roofing system and warranty to be provided; use only fasteners furnished by roof membrane manufacturer.

2.05 METAL ACCESSORIES

R-Value (LTTR):

- 1. Metal Roof Edging and Fascia: Continuous metal edge member serving as termination of roof membrane and retainer for metal fascia; watertight with no exposed fasteners; mounted to roof edge nailer.
- Membrane Pull-Off Resistance: 100 lbs/ft (1460 N/m), minimum, when tested in accordance with ANSI/SPRI ES-1 Test Method RE-1, current edition.
- Fascia Pull-Off Resistance: At least the minimum required when tested in accordance with ANSI/SPRI ES-1 Test Method RE-2, current edition. Provide product listed in current Factory Mutual Research Corporation Approval Guide with at least FM 1-270 rating. Description: Two-piece; extruded aluminum T-shaped edge member securing top and bottom edges of flat-faced formed metal fascia; Firestone AnchorGard.
- Fascia Face Height: 5 inches (127 mm). iv. Edge Member Height Above Nailer: 1-1/4 inches (31 mm).
- v. Fascia Material and Finish: 0.040 inch (1.0 mm) thick formed aluminum, natural mill finish; matching concealed joint splice plates; factory-installed protective
- vi. Length: 120 inches (3048 mm). vii. Functional Characteristics: Fascia retainer supports while allowing for free thermal cycling of fascia.
- viii. Aluminum Bar: Continuous 6063-T6 alloy aluminum extrusion with pre-punched slotted holes; miters welded; injection molded EPDM splices to allow thermal
- ix. Anchor Bar Cleat: 20 gage, 0.036 inch (0.9 mm) G90 coated commercial type galvanized steel with pre-punched holes.
- x. Curved Applications: Factory modified. xi. Fasteners: Factory-provided corrosion resistant fasteners, with drivers; no exposed fasteners permitted. xii. Special Shaped Components: Provide factory-fabricated pieces necessary for complete installation, including miters, scuppers, and end caps; minimum 14 inch (355
- mm) long legs on corner pieces. xiii. Scuppers: Welded watertight.
- xiv. Accessories: Provide matching brick wall cap, downspout, extenders, and other special fabrications as shown on the drawings. 2. Parapet Copings: Formed metal coping with galvanized steel anchor/support cleats for capping any parapet wall; watertight, maintenance free, without exposed
- fasteners; butt type joints with concealed splice plates; mechanically fastened as indicated; Firestone PTCF. Wind Performance:
- a. At least the minimum required when tested in accordance with ANSI/SPRI ES-1 Test Method RE-3, current edition. Provide product listed in current Factory Mutual Research Corporation Approval Guide with at least FM 1-180 rating.
- Description: Coping sections allowed to expand and contract freely while locked in place on anchor cleats by mechanical pressure from hardened stainless steel springs factory attached to anchor cleats; 8 inch (200 mm) wide splice plates with factory applied dual non-curing sealant strips capable of providing watertight seal. Material and Finish: 24 GA. thick formed aluminum, clear anodized finish; matching concealed joint splice plates; factory-installed protective plastic film.
- iv. Dimensions: Wall Width: As indicated on the drawings.
- Piece Length: Minimum 120 inches (3048 mm).
- Curved Application: Factory fabricated in true radius. Anchor/Support Cleats: 20 gage, 0.036 inch (0.9 mm) thick prepunched galvanized cleat with 12 inch (305 mm) wide stainless steel spring mechanically locked to cleat at 72 inches (1820 mm) on center.
- vi. Special Shaped Components: Provide factory-fabricated pieces necessary for complete installation, including miters, corners, intersections, curves, pier caps, and end caps; minimum 14 inch (355 mm) long legs on corner, intersection, and end pieces. vii. Fasteners: Factory-furnished; electrolytically compatible; minimum pull out resistance of 240 pounds (109 kg) for actual substrate used; no exposed fasteners.

PART 3 INSTALLATION 3.01 GENERAL

- 1. Install roofing, insulation, flashings, and accessories in accordance with roofing manufacturer's published instructions and recommendations for the specified roofing system. Where manufacturer provides no instructions or recommendations, follow good roofing practices and industry standards. Comply with federal, state, and local regulations.
- 2. Obtain all relevant instructions and maintain copies at project site for duration of installation period.

- 3.02 EXAMINATION 1. Examine roof deck to determine that it is sufficiently rigid to support installers and their mechanical equipment and that deflection will no strain or rupture roof
- Verify that surfaces and site conditions are ready to receive work. Correct defects in the substrate before commencing with roofing work. Examine roof substrate to verify that it is properly sloped to drains.
- Verify that the specifications and drawing details are workable and not in conflict with the roofing manufacturer's recommendations and instructions; start of work constitutes acceptable of project conditions and requirements. Verify that wood nailers have been properly installed.

- Take appropriate measures to ensure that fumes from adhesive solvents are not drawn into the building through air intakes. Prior to proceeding, prepare roof surface so that it is clean, dry, and smooth, and free of sharp edges, fins, roughened surfaces, loose or foreign materials, oil, grease
- and other materials that may damage the membrane. Fill all surface voids in the immediate substrate that are greater than 1/4 inch (6 mm) wide with fill material acceptable insulation to membrane manufacturer. 4. Seal, grout, or tape deck joints, where needed, to prevent bitumen seepage into building.

3.04 INSULATION AND COVER BOARD INSTALLATION

- Install insulation in configuration and with attachment method(s) specified in PART 2, under Roofing System. Install only as much insulation as can be covered with the completed roofing system before the end of the day's work or before the onset of inclement weather.
- Lay roof insulation in courses parallel to roof edges. Neatly and tightly fit insulation to all penetrations, projections, and nailers, with gaps not greater than 1/4 inch (6 mm). Fill gaps greater than 1/4 inch (6 mm) with
- acceptable insulation. Do not leave the roofing membrane unsupported over a space greater than 1/4 inch (6 mm). Loose Laid Installation: Install insulation by laying loose over substrate without mechanical securement of any kind.
- Mechanical Fastening: Using specified fasteners and insulation plates engage fasteners through insulation into deck to depth and in pattern required by Factory Mutual for FM Class specified in PART 2 and membrane manufacturer, whichever is more stringent.

3.05 ELASTOMERIC MEMBRANE INSTALLATION Beginning at low point of roof, place membrane without stretching over substrate and allow to relax at least 30 minutes before attachment or splicing; in colder

- weather allow for longer relax time. Lay out the membrane pieces so that field and flashing splices are installed to shed water. Install membrane without wrinkles and without gaps or fishmouths in seams; bond and test seams and laps in accordance with membrane manufacturer's instructions
- Edge Securement: Secure membrane at all locations where membrane terminates or goes through an angle change greater than 2 in 12 inches (1:6) using mechanically fastened reinforced perimeter fastening strips, plates, or metal edging as indicated or as recommended by roofing manufacturer.
- Exceptions: Round pipe penetrations less than 18 inches (460 mm) in diameter and square penetrations less than 4 inches (200 mm) square. Metal edging is not merely decorative; ensure anchorage of membrane as intended by roofing manufacturer.

3.06 FLASHING AND ACCESSORIES INSTALLATION

- Install flashings, including laps, splices, joints, bonding, adhesion, and attachment, as required by membrane manufacturer's recommendations and details. Metal Accessories: Install metal edgings, gravel stops, and copings in locations indicated on the drawings, with horizontal leg of edge member over membrane and
- flashing over metal onto membrane. Follow roofing manufacturer's instructions.
- Remove protective plastic surface film immediately before installation.
- Install water block sealant under the membrane anchorage leg. Flash with manufacturer's recommended flashing sheet unless otherwise indicated.
- Where single application of flashing will not completely cover the metal flange, install additional piece of flashing to cover the metal edge. If the roof edge includes a gravel stop and sealant is not applied between the laps in the metal edging, install an additional piece of self-adhesive flashing membrane
- over the metal lap to the top of the gravel stop; apply seam edge treatment at the intersections of the two flashing sections. When the roof slope is greater than 1:12, apply seam edge treatment along the back edge of the flashing. Scuppers: Set in sealant and secure to structure; flash as recommended by manufacturer.
- Roofing Expansion Joints: Install as shown on drawings and as recommended by roofing manufacturer. Flashing at Walls, Curbs, and Other Vertical and Sloped Surfaces: Install weathertight flashing at all walls, curbs, parapets, curbs, skylights, and other vertical and
- sloped surfaces that the roofing membrane abuts to; extend flashing at least 8 inches (200 mm) high above membrane surface. Use the longest practical flashing pieces. Evaluate the substrate and overlay and adjust installation procedure in accordance with membrane manufacturer's recommendations.
- Complete the splice between flashing and the main roof sheet with specified splice adhesive before adhering flashing to the vertical surface. Provide termination directly to the vertical substrate as shown on roof drawings.
- Roof Drains: Taper insulation around drain to provide smooth transition from roof surface to drain. Use specified pre-manufactured tapered insulation with facer or suitable bonding surface to achieve slope; slope not to exceed manufacturer's recommendations

Position membrane, then cut a hole for roof drain to allow 1/2 to 3/4 inch (12 to 19 mm) of membrane to extend inside clamping ring past drain bolts.

- Make round holes in membrane to align with clamping bolts; do not cut membrane back to bolt holes. Apply sealant on top of drain bowl where clamping ring seats below the membrane
- Install roof drain clamping ring and clamping bolts; tighten clamping bolts to achieve constant compression.
- Flashing at Penetrations: Flash all penetrations passing through the membrane; make flashing seals directly to the penetration. Pipes, Round Supports, and Similar Items: Flash with specified pre-molded pipe flashings wherever practical; otherwise use specified self-curing elastomeric flashing. Pipe Clusters and Unusual Shaped Penetrations: Provide penetration pocket at least 2 inches (50 mm) deep, with at least 1 inch (25 mm) clearance from penetration,
- sloped to shed water. iii. Structural Steel Tubing: If corner radii are greater than 1/4 inch (6 mm) and longest side of tube does not exceed 12 inches (305 mm), flash as for pipes; otherwise,
- Flexible and Moving Penetrations: Provide weathertight gooseneck set in sealant and secured to deck, flashed as recommended by manufacturer. High Temperature Surfaces: Where the in-service temperature is, or is expected to be, in excess of 180 degrees F (82 degrees C), protect the elastomeric components from direct contact with the hot surfaces using an intermediate insulated sleeve as flashing substrate as recommended by membrane manufacturer.
- 3.07 FINISHING AND WALKWAY INSTALLATION Install walkways at access points to the roof, around rooftop equipment that may require maintenance, and where indicated on the drawings.
- Walkway Pads: Adhere to the roofing membrane, spacing each pad at minimum of 1.0 inch (25 mm) and maximum of 3.0 inches (75 mm) from each other to allow for
- Do not start work until Pre-Installation Notice has been submitted to manufacturer as notification that this project requires a manufacturer's warranty. Perform work using competent and properly equipped personnel. Temporary closures, which ensure that moisture does not damage any completed section of the new roofing system, are the responsibility of the applicator.
- Completion of flashings, terminations, and temporary closures shall be completed as required to provide a watertight condition. Install roofing membrane only when surfaces are clean, dry, smooth and free of snow or ice; do not apply roofing membrane during inclement weather or when ambient conditions will not allow proper application; consult manufacturer for recommended procedures during cold weather. Do not work with sealants and
- adhesives when material temperature is outside the range of 60 to 80 degrees F (15 to 25 degrees C). Protect adjacent construction, property, vehicles, and persons from damage related to roofing work; repair or restore damage caused by roofing work.
- Protect from spills and overspray from bitumen, adhesives, sealants and coatings. Particularly protect metal, glass, plastic, and painted surfaces from bitumen, adhesives, and sealants within the range of wind-borne overspray. Protect finished areas of the roofing system from roofing related work traffic and traffic by other trades.
- Until ready for use, keep materials in their original containers as labeled by the manufacturer. Consult membrane manufacturer's instructions, container labels, and Material Safety Data Sheets (MSDS) for specific safety instructions. Keep all adhesives, sealants, primers and cleaning materials away from all sources of ignition.

If installation of walkway pads over field fabricated splices or within 6 inches (150 mm) of a splice edge cannot be avoided, adhere another layer of flashing over the

splice and extending beyond the walkway pad a minimum of 6 inches (150 mm) on either side. Prime the membrane, remove the release paper on the pad, press in place, and walk on pad to ensure proper adhesion.

inspect installation for warranty purposes (i.e. not a sales person).

3. Remove leftover materials, trash, debris, equipment from project site and surrounding areas.

- 3.08 FIELD QUALITY CONTROL 1. Inspection by Manufacturer: Provide final inspection of the roofing system by a Technical Representative employed by roofing system manufacturer specifically to
- 2. Perform all corrections necessary for issuance of warranty.

components and surfaces.

3.09 CLEANING Clean all contaminants generated by roofing work from building and surrounding areas, including bitumen, adhesives, sealants, and coatings. Repair or replace building components and finished surfaces damaged or defaced due to the work of this section; comply with recommendations of manufacturers of

1. Where construction traffic must continue over finished roof membrane, provide durable protection and replace or repair damaged roofing to original condition.

END OF SECTION

2934 Sidco Drive Suite 120 Nashville, TN 37204 Interior Architecture

TRACTOR SUPPLY COMPANY

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

05.10.2024

Job Number

Revisions:

Revisions:

Sheet Number:


TRACTOR SUPPLY COMPANY REQUIRES THE ROOFING

ROOF SPECIFICATIONS

MEMBRANE TO BE WHITE

SCALE: NO SCALE

ROOF SPECIFICATIONS

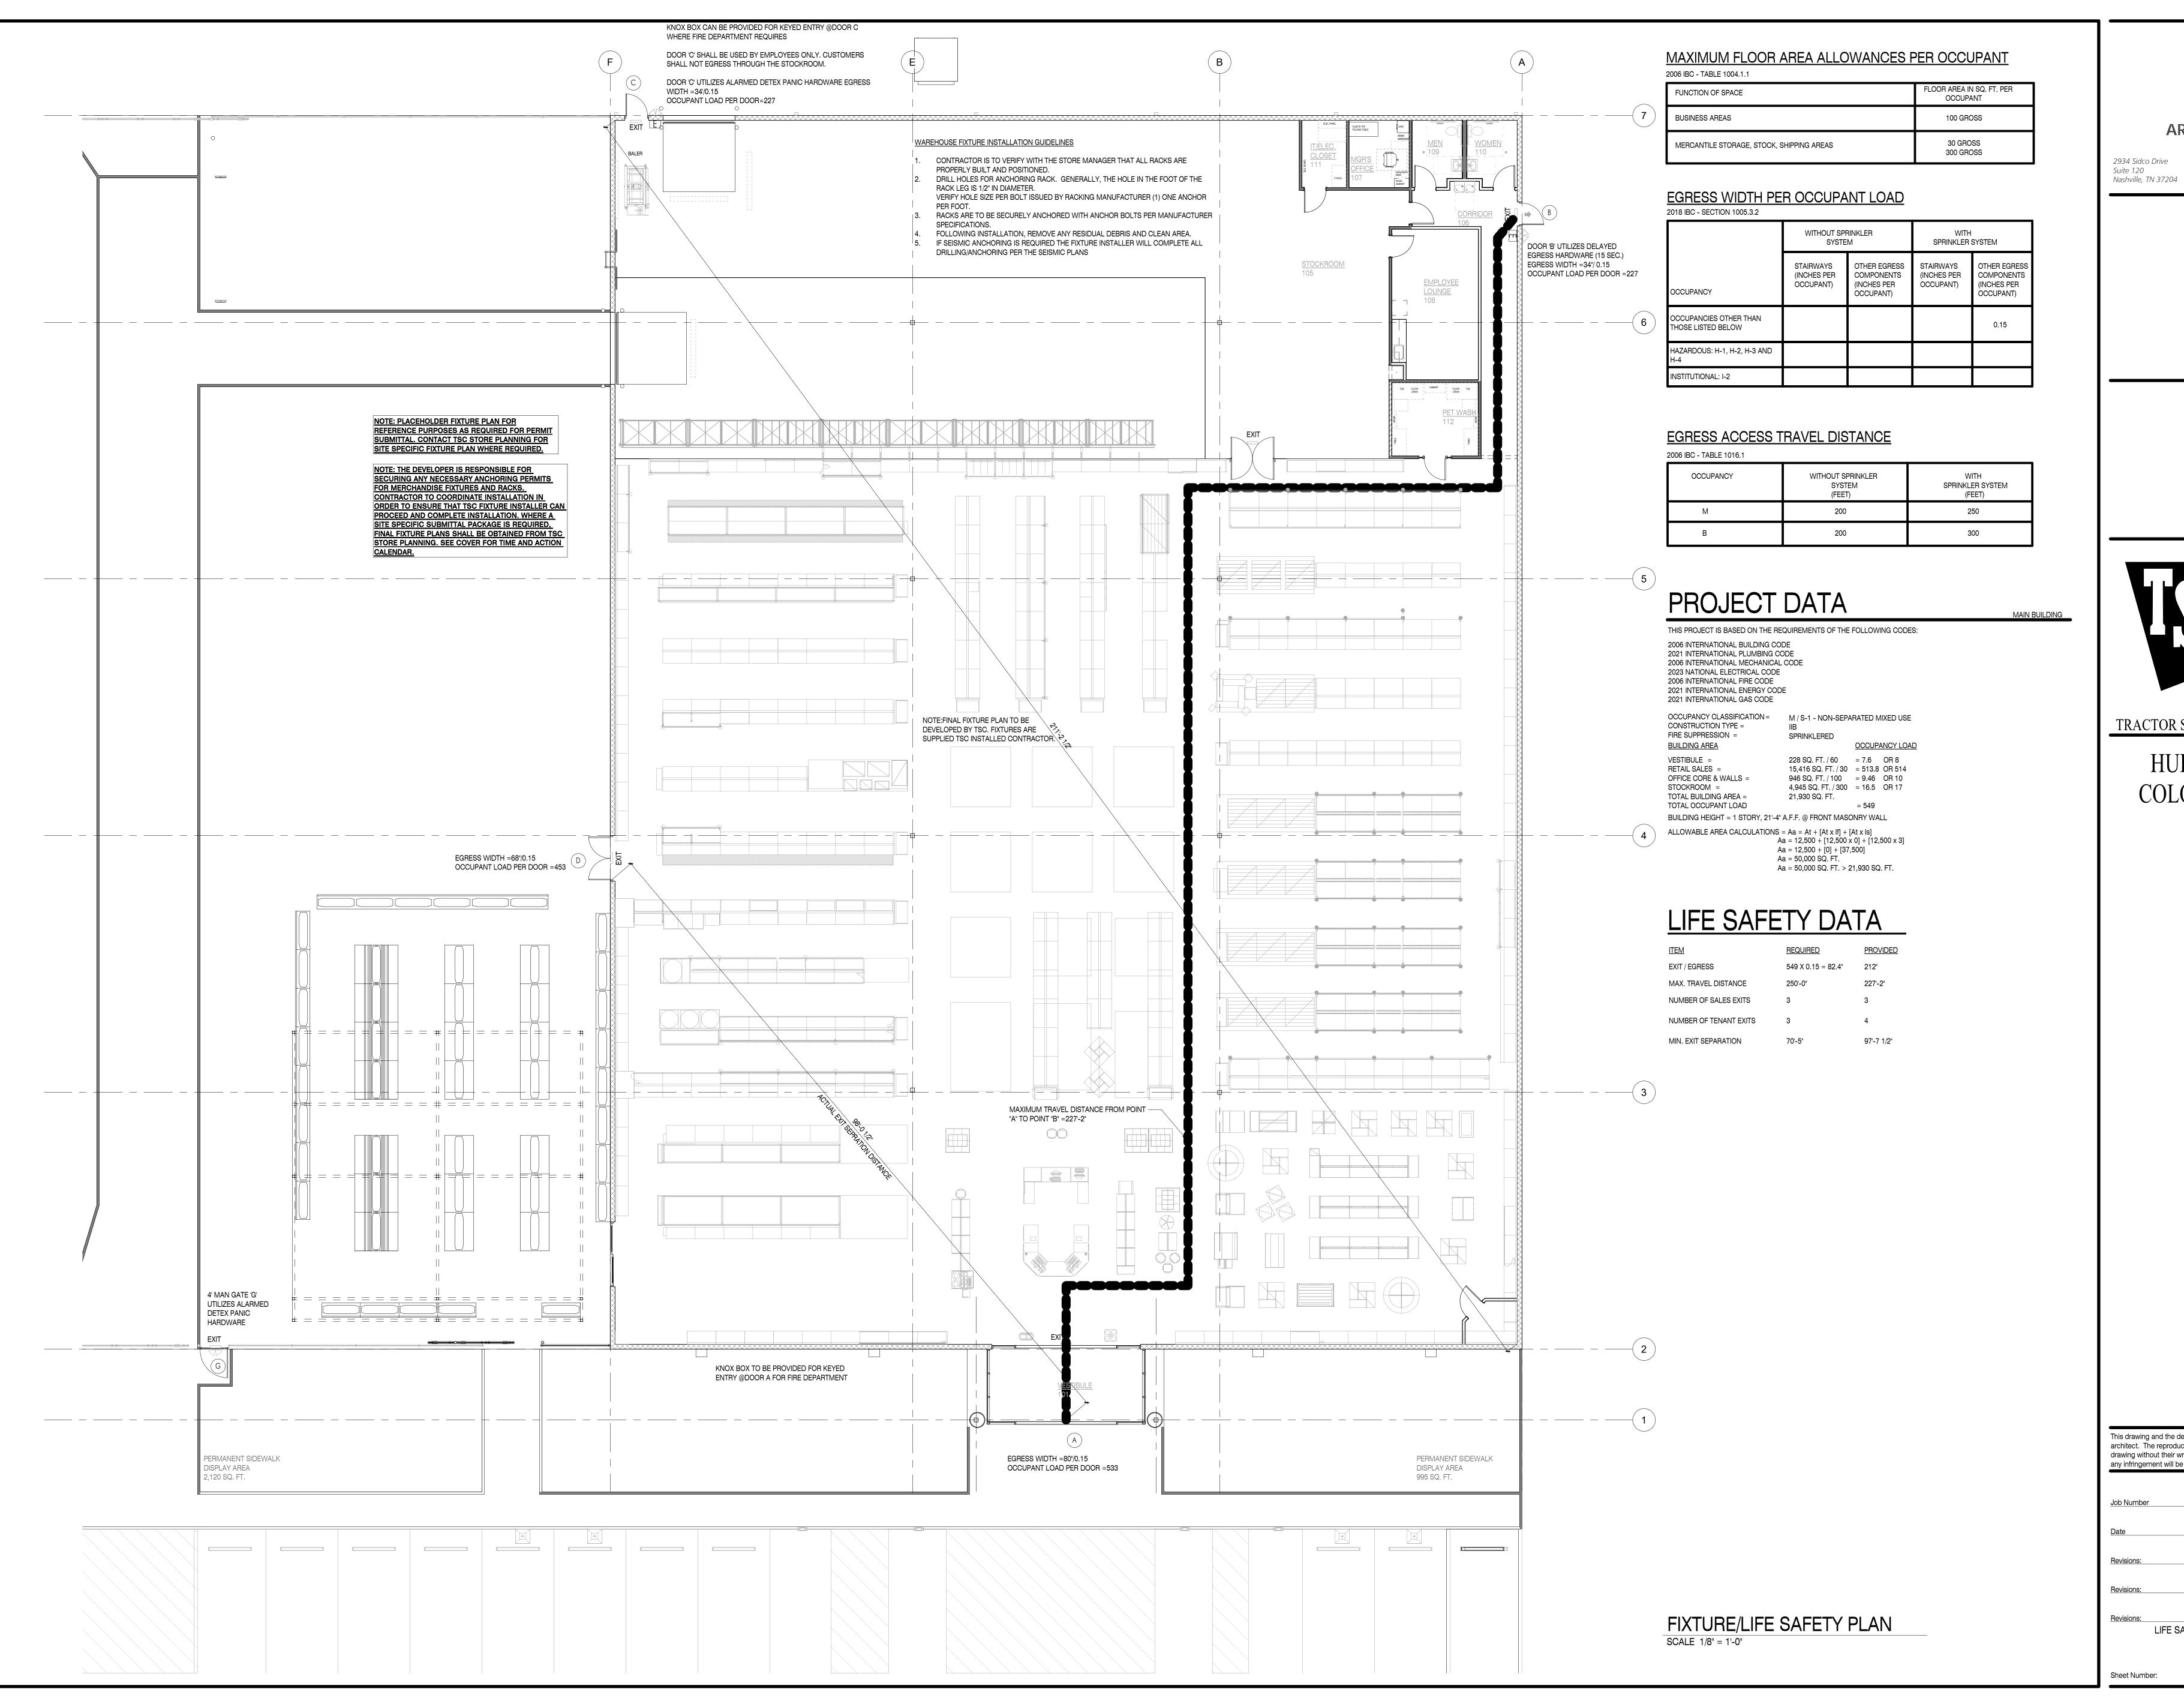



Architecture Interior Architecture


TRACTOR SUPPLY COMPANY


HUDSON, COLORADO


This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.


05.10.2024

LIFE SAFETY PLAN / FIXTURE PLAN

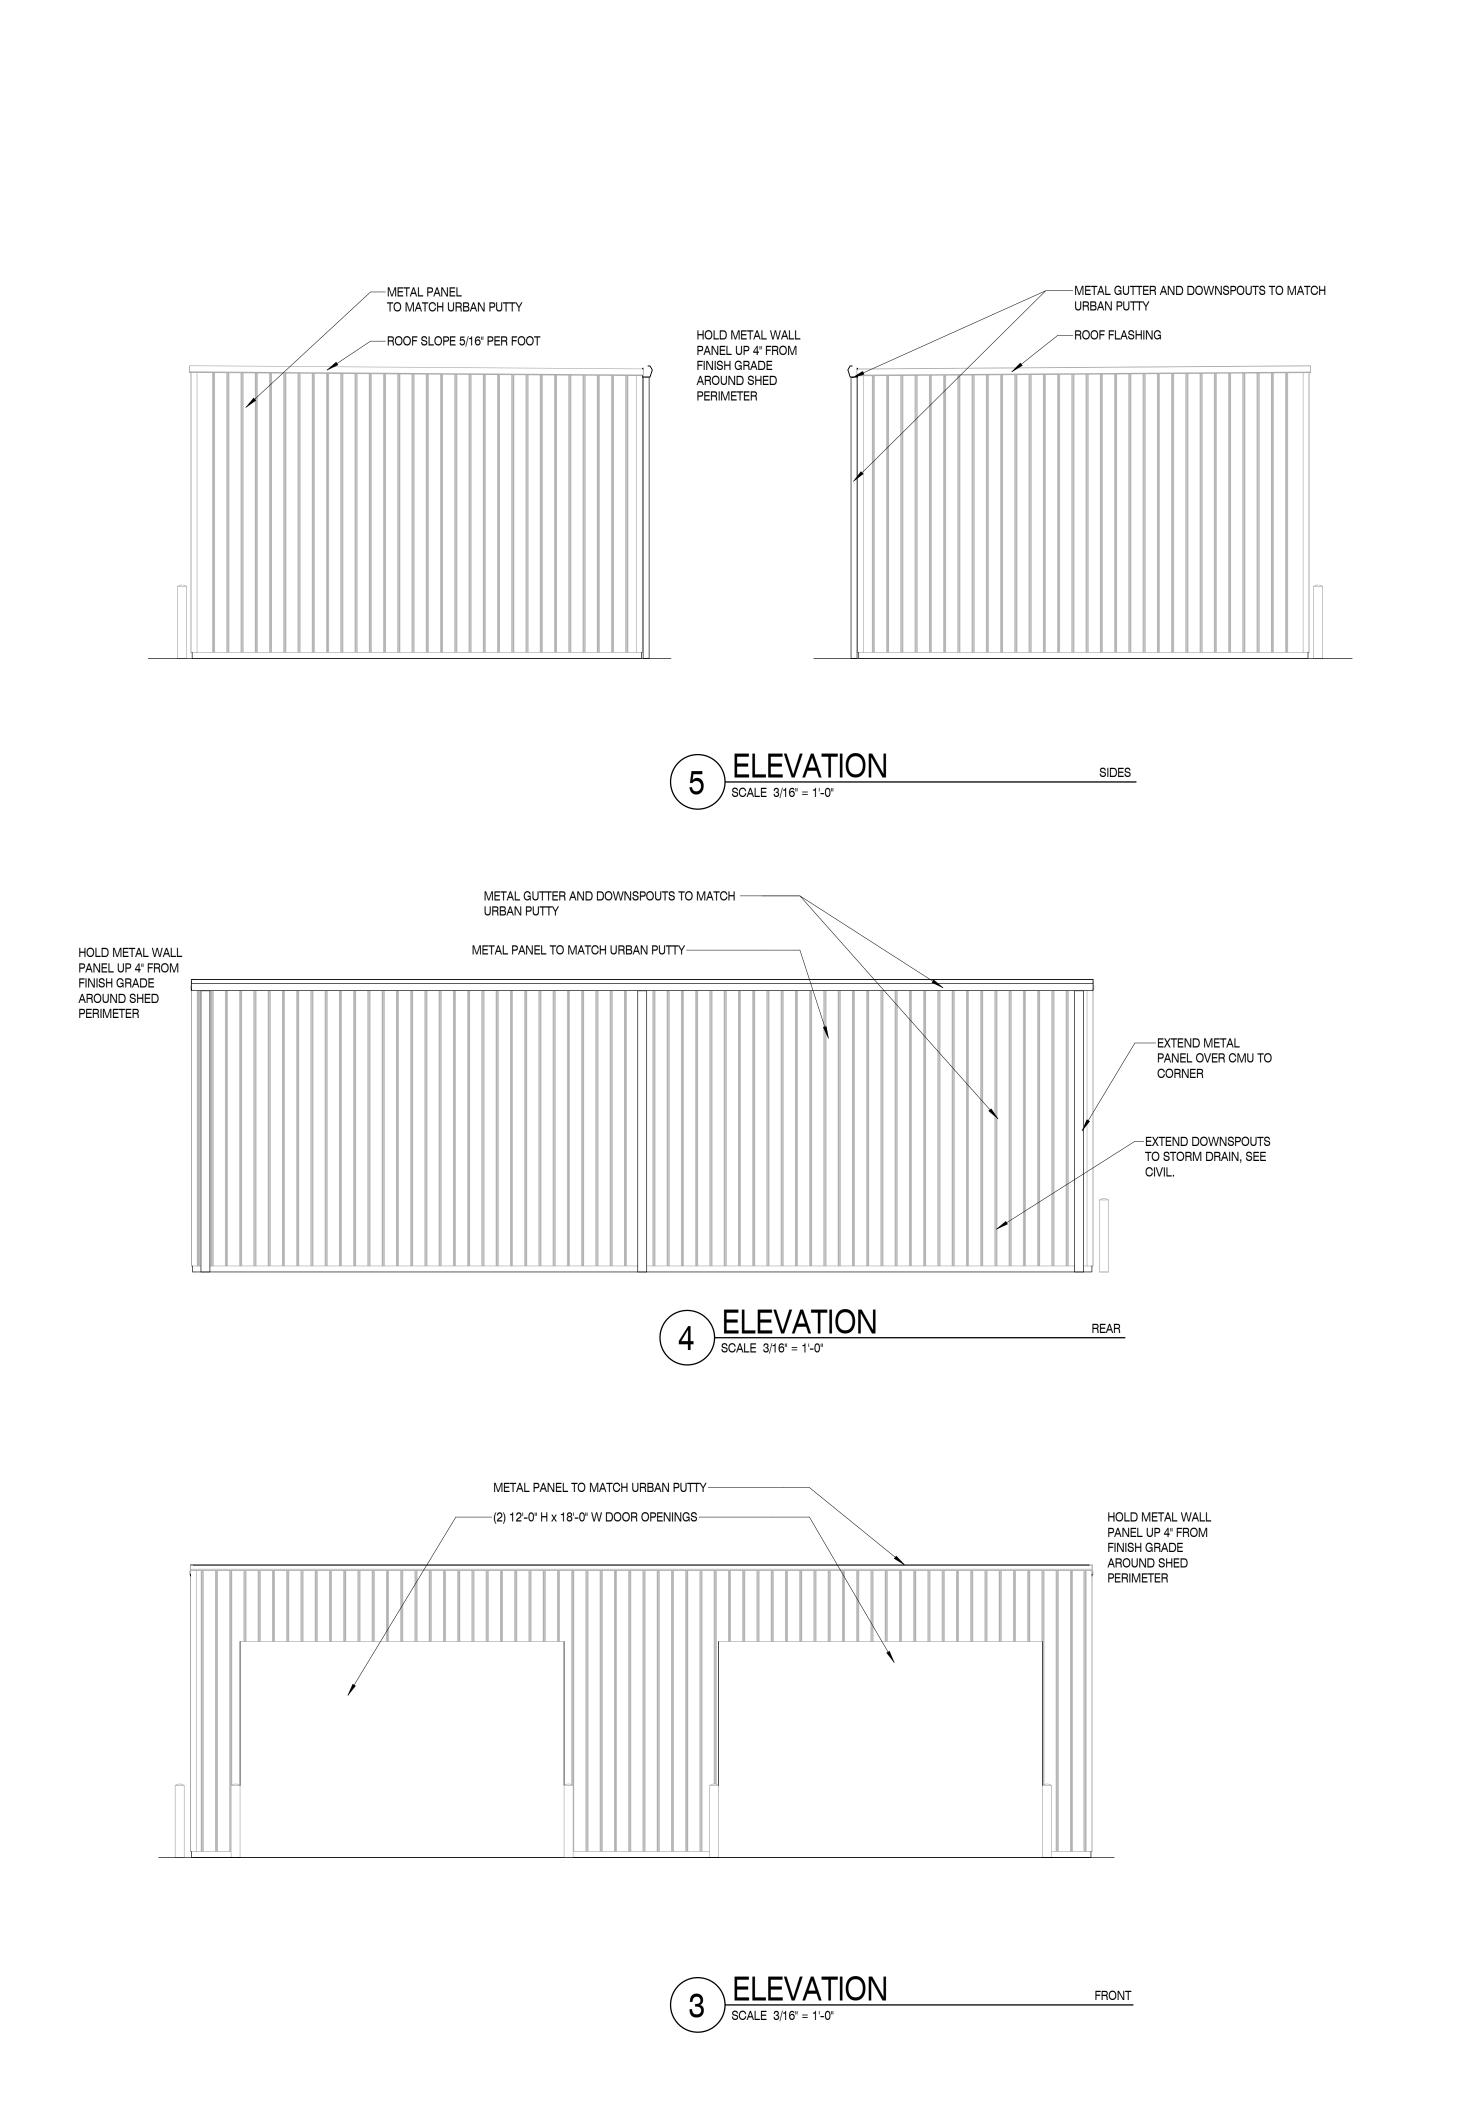

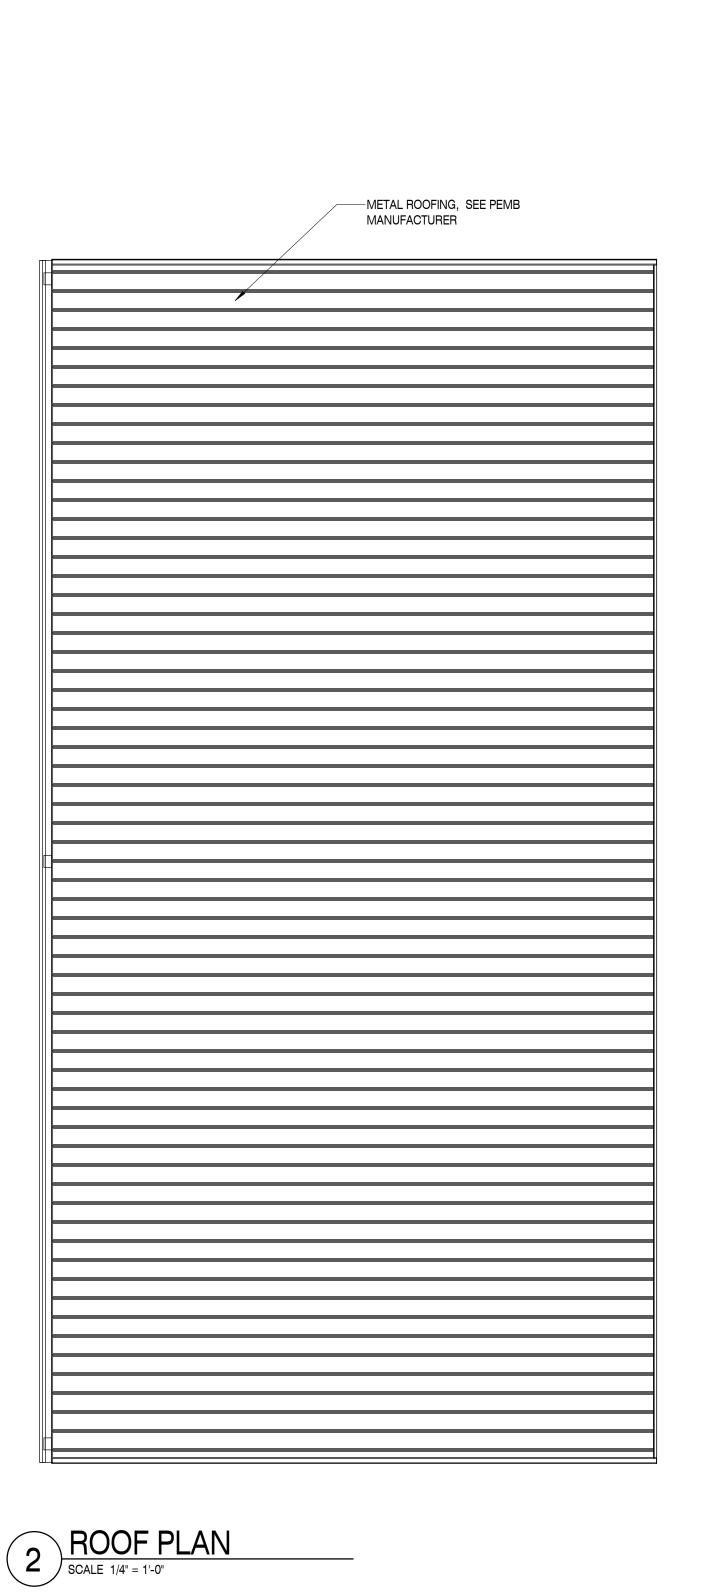

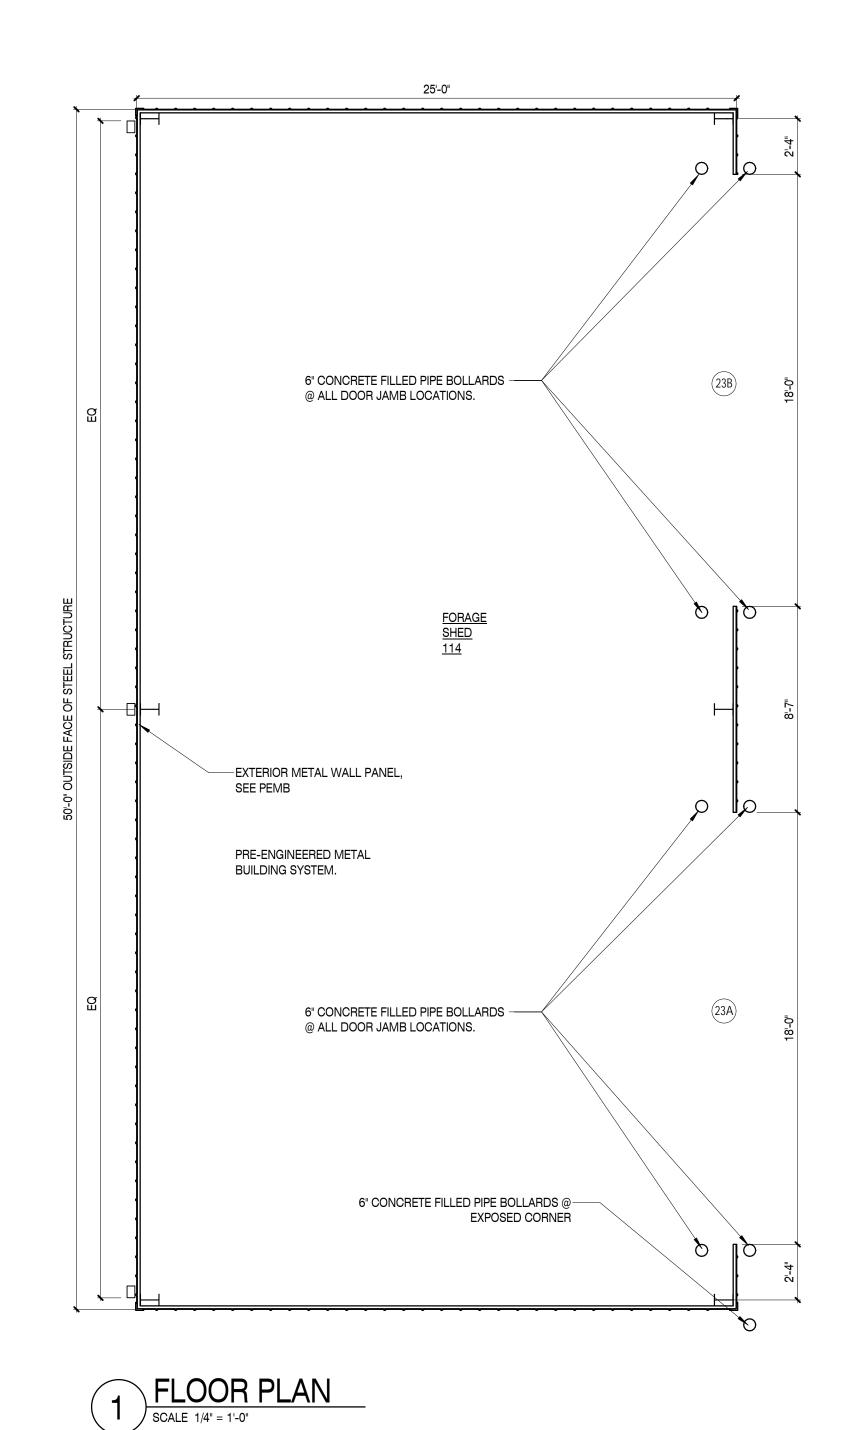

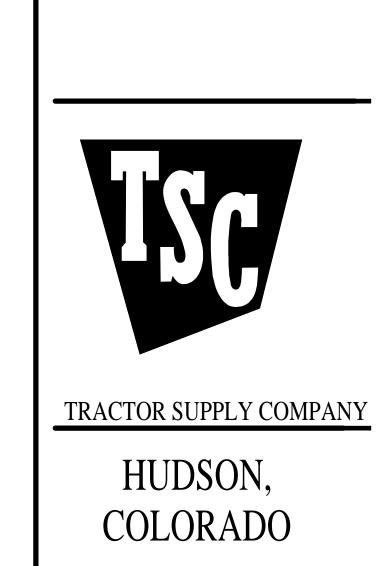

Interior Architecture

2934 Sidco Drive

Suite 120 Nashville, TN 37204

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

Job Number

TBD

Date

05.10.2024

Revisions:

Revisions:

Revisions:

FORAGE SHED

Project Information

2021 IECC Energy Code: Project Title: TSC - Hudson, CO Location: Hudson, Colorado Climate Zone: Project Type: **New Construction** Vertical Glazing / Wall Area:

Construction Site: Owner/Agent:

Designer/Contractor:

Additional Efficiency Package(s)
Credits: 10.0 Required 40.0 Proposed Reduced lighting power, 40.0 credit

Building Area Floor Area 1-Retail : Nonresidential 21702

Envelope Assemblies

Project Title: TSC - Hudson, CO

Data filename:

Assembly	Gross Area	Cavity	Cont.	Proposed U-Factor	Budget U-
	or Perimeter	R-Value	R-Value	U-Factor	Factor _(a)
Roof: Insulation Entirely Above Deck, [Bldg. Use 1 - Retail]	21702		30.0	0.032	0.032
Floor: Unheated Slab-On-Grade, Vertical 2 ft., [Bldg. Use 1 - Retail] (d)	596		15.0	0.520	0.520
NORTH Ext. Wall - Rear Wall - 8" CMU partially grouted, foam filled w/ CoreFill 500: Other Mass Wall, Heat capacity 7.6, [Bldg. Use 1 - Retail] (b)	1931			0.078	0.090
Door: Insulated Metal, Swinging, [Bldg. Use 1 - Retail]	21			0.920	0.370
Door: Insulated Metal, Non-Swinging, [Bldg. Use 1 - Retail]	100	1222		0.210	0.179
EAST Ext. Wall - Plan Right - 8" CMU partially grouted, foam filled w/ CoreFill 500: Other Mass Wall, Heat capacity 7.6, [Bldg. Use 1 - Retail] (b)	2913			0.078	0.090
Door 15: Insulated Metal, Swinging, [Bldg. Use 1 - Retail]	21	:555	0 000 0	0.920	0.370
SOUTH Ext. Wall - Front Wall - 8" CMU partially grouted, foam filled w/ CoreFill 500: Other Mass Wall, Heat capacity 7.6, [Bldg. Use 1 - Retail] (b)	2325		2 5	0.078	0.090
Door: Glass (over 50 Olazing): Metal Frame, Entrance Door, Perf. Specs.: Product ID Stanley, SHGC 0.25, [Bldg. Use 1 - Retail] (c)	206) <u>2004</u>)	0.770	0.630
WEST Ext. Wall - Plan Left - 8" CMU partially grouted, foam filled w/ CoreFill 500: Other Mass Wall, Heat capacity 7.6, [Bldg. Use 1 - Retail] (b)	2913	:	£ 277 8	0.078	0.090
Door 5A: Glass (over 50 Olazing): Metal Frame, Entrance Door, Perf. Specs.: Product ID Stanley, SHGC 0.25, [Bldg. Use 1 - Retail] (c)	42		(1969)	0.770	0.630

Section # & Req.ID	# Plan Review Complies?		Comments/Assumptions		
C402.4.2 [PR14] ¹	In enclosed spaces > 2,500 ft2 directly under a roof with ceiling heights >15 ft. and used as an office, lobby, atrium, concourse, corridor, storage, gymnasium/exercise center, convention center, automotive service, manufacturing, non-refrigerated warehouse, retail store, distribution/sorting area, transportation, or workshop, the following requirements apply: (a) the daylight zone under skylights is >= half the floor area; (b) the skylight area to daylight zone is >= 3 percent with a skylight VT >= 0.40; or a minimum skylight effective aperture >= 1 percent.	□Complies □Does Not □Not Observable □Not Applicable	Exception: Requirement does not apply.		
C406 [PR9] ¹	Plans, specifications, and/or calculations provide all information with which compliance can be determined for the additional energy efficiency package options.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.		

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

efficiency package options. Additional Comments/Assumptions:

Assembly	Gross Area or Perimeter	Cavity R-Value	Cont. R-Value	Proposed U-Factor	Budget U- Factor _(a)
Door 13B: Insulated Metal, Non-Swinging, [Bldg. Use 1 - Retail]	100			0.210	0.179
Door 5B: Glass (over 50 Olazing): Metal Frame, Non-Entrance Door, Perf. Specs.: Product ID STANLEY, SHGC 0.25, [Bldg. Use 1 - Retail] (c)	88		()	0.770	0.450
(a) Budget U-factors are used for software baseline calculation (b) 'Other' components require supporting documentation for p (c) Fenestration product performance must be certified in according to the composed and budget U-factors shown in taken the composed and the composed	oroposed U-fact ordance with NF	tors. FRC and red	6 (1956. * Herese (111.154.).716		entation.

Envelope PASSES: Design 1% better than code **Envelope Compliance Statement**

Compliance Statement: The proposed envelope design represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed envelope systems have been designed to meet the 2021 IECC requirements in COMcheck Version COMcheckWeb and to comply with any applicable mandatory requirements listed in the Inspection Checklist.

Bradley Matuzak - Project Manager Name - Title

Project Title: TSC - Hudson, CO Report date: 05/07/24 Data filename: Page 2 of 15

Section # & Req.ID	Footing / Foundation Inspection	Complies?	Comments/Assumptions
C303.2 [FO4] ²	Slab edge insulation installed per manufacturer's instructions.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.
C303.2.1 [FO6] ¹	Exterior insulation protected against damage, sunlight, moisture, wind, landscaping and equipment maintenance activities.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.
C105 [FO3] ²	Installed slab-on-grade insulation type and R-value consistent with insulation specifications reported in plans and COMcheck reports.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	See the Envelope Assemblies table for values.
C402.2.4 [FO7] ²	Slab edge insulation depth/length. Slab insulation extending away from building is covered by pavement or >= 10 inches of soil.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met. See the Envelope Assemblies table for values.

Additional Comments/Assumptions:

COMcheck Software Version COMcheckWeb Inspection Checklist

Energy Code: 2021 IECC

Requirements: 100.0% were addressed directly in the COMcheck software Text in the "Comments/Assumptions" column is provided by the user in the COMcheck Requirements screen. For each requirement, the user certifies that a code requirement will be met and how that is documented, or that an exception is being claimed. Where compliance is itemized in a separate table, a reference to that table is provided.

Section # & Req.ID	Plan Review	Complies?	Comments/Assumptions
C103.2 [PR1] ¹	Plans and/or specifications provide all information with which compliance can be determined for the building envelope and document where exceptions to the standard are claimed.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.
C103.2 [PR4] ¹	Plans, specifications, and/or calculations provide all information with which compliance can be determined for the interior lighting and electrical systems and equipment and document where exceptions to the standard are claimed. Information provided should include interior lighting power calculations, wattage of bulbs and ballasts, transformers and control devices.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.
C103.2 [PR8] ¹	Plans, specifications, and/or calculations provide all information with which compliance can be determined for the exterior lighting and electrical systems and equipment and document where exceptions to the standard are claimed. Information provided should include exterior lighting power calculations, wattage of bulbs and ballasts, transformers and control devices.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.
C402.4.1 [PR10] ¹	The vertical fenestration area <= 30 percent of the gross above-grade wall area.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.
C402.4.1 [PR11] ¹	The skylight area <= 3 percent of the gross roof area.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.

	1 High Impact (Tier 1)	2 Medium Impact (Tier 2)	3 Low Impact (Tier 3)
Project Title:	TSC - Hudson, CO		Report date: 05/07/24
Data filename	:		Page 7 of 15

Section # & Req.ID	Framing / Rough-In Inspection	Complies?	Comments/Assumptions
C402.4.5 [FR14] ²	U-factor of opaque swinging and nonswinging doors associated with the building thermal envelope meets requirements.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	See the Envelope Assemblies table for values.
C402.5.1. 4 [FR20] ¹		☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.
C402.5.4 [FR18] ³	Factory-built fenestration and doors are labeled as meeting air leakage requirements.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.

Additional Comments/Assumptions:

ARCHITECTURE

Architecture 2934 Sidco Drive Suite 120 Nashville, TN 37204 Interior Architecture

TRACTOR SUPPLY COMPANY

HUDSON, COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

Job Number

05.10.2024

Revisions: ARCHITECTURAL COMCHECK

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Report date: 05/07/24

Report date: 05/07/24

Page 1 of 15

Section # & Req.ID	Mechanical Rough-In Inspection	Complies?	Comments/Assumptions
C403.7.7 [ME58] ³	Outdoor air and exhaust systems have motorized dampers that automatically shut when not in use and meet maximum leakage rates. Check gravity dampers where allowed. Reference section language for operational details.		Exception: Gravity dampers acceptable in buildings 3 stories.

Additional Comments/Assumptions:

	1 High Impact (Tier 1)	2 Medium Impact (Tier 2)	3 Low Impact (Tier 3)	
Project Title:	TSC - Hudson, CO		Report	date: 05/07/24
Data filename:			Pa	ge 11 of 15

Section # & Req.ID	Insulation Inspection	Complies?	Comments/Assumptions
C303.1 [IN3] ¹	Roof insulation installed per manufacturer's instructions and is labeled with R-value or insulation certificate providing R-value and other relevant data. Blown or poured loosefill insulation is installed only where the roof slope is <=3 in 12.	□Complies □Does Not □Not Observable □Not Applicable	
C402.2.1 [IN20] ¹	Roof assembly meets minimal thermal resistance installed between roof framing or in a continuous fashion on the roof assembly as stipulated in Table C402.1.3. Requirements for above deck insulation, minimum thickness, suspended ceilings, staggered joints and skylight curbs will be met.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.
C303.2 [IN7] ¹	Above-grade wall insulation installed per manufacturer's instructions.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.
C402.1.3 [IN19] ³	Non-swinging opaque doors have R-4.75 insulation.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.
C105 [IN6] ¹	40	□Complies □Does Not □Not Observable □Not Applicable	See the Envelope Assemblies table for values.
C402.2.3 [IN8] ²	Installed floor insulation type and R-value consistent with insulation specifications reported in plans and COMcheck reports.	□Complies □Does Not □Not Observable □Not Applicable	See the Envelope Assemblies table for values.
C402.2.6 [IN18] ³	[4] 사람은 사람이 많아가면 있다. 전투 하기 5명하면 하기 되어 있어야 한다면 하게 다니다면 사람이 있었다면 하게 되었다면 하게 되었다	□Complies □Does Not □Not Observable □Not Applicable	Exception: Requirement does not apply.
C105 [IN2] ¹	Installed roof insulation type and R-value consistent with insulation specifications reported in plans and COMcheck reports. For some ceiling systems, verification may need to occur during Framing Inspection.	□Complies □Does Not □Not Observable □Not Applicable	See the Envelope Assemblies table for values.
C402.5.1. 1 [IN1] ¹	All sources of air leakage in the building thermal envelope are sealed, caulked, gasketed, weather stripped or wrapped with moisture vaporpermeable wrapping material to minimize air leakage.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.

1,44	mminize un	icunage.	
Additional	Commen	ts/Assum	ptions:

	1 High Impact (Tier 1) 2	Medium Impact (Tier 2)	3	Low Impact (Tier 3)]
Project Title:	TSC - Hudson, CO				Repor	t date: 05/07/24
Data filename:					F	Page 14 of 15

Section # & Req.ID	Rough-In Electrical Inspection	Complies?	Comments/Assumptions
C405.2.3. 1 [EL22] ¹	Spaces required to have light- reduction controls have a manual control that allows the occupant to reduce the connected lighting load in a reasonably uniform illumination pattern >= 50 percent.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.
C405.2.1, C405.2.1. 1 [EL18] ¹	Occupancy sensors installed in classrooms/lecture/training rooms, conference/meeting/multipurpose rooms, copy/print rooms, lounges/breakrooms, enclosed offices, open plan office areas, restrooms, storage rooms, locker rooms, corridors, warehouse storage areas, and other spaces <= 300 sqft that are enclosed by floor-to-ceiling height partitions. Reference section language C405.2.1.2 for control function in warehouses and section C405.2.1.3 for open plan office spaces.		Requirement will be met.
C405.2.1. 2 [EL19] ¹	Occupancy sensors control function in warehouses: In warehouses, the lighting in aisleways and open areas is controlled with occupant sensors that automatically reduce lighting power by 50% or more within 20 minutes of when the areas are unoccupied. The occupant sensors control lighting in each aisleway independently and do not control lighting beyond the aisleway being controlled by the sensor. Lights not turned off by occupant sensors is done so by timeswitch.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.
C405.2.1. 3 [EL20] ¹	Occupant sensor control function in open plan office areas: Occupant sensor controls in open office spaces >= 300 sq.ft. have controls 1) configured so that general lighting can be controlled separately in control zones with floor areas <= 600 sq.ft. within the space, 2) general lighting in each zone permitted to turn on upon occupancy in control zone, 3) automatically turn off general lighting in all control zones within 20 minutes after all occupants have left the space, 4) are configured so that general lighting power in each control zone is reduced by >= 80% of the full zone general lighting power within 20 minutes of all occupants leaving that control zone.		Requirement will be met.
C405.2.2, C405.2.2. 1 [EL21] ²	Each area not served by occupancy sensors (per C405.2.1.1) have timeswitch controls and functions detailed in sections C405.2.2.1.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.

	1 High Impact (Tier 1)	2 Medium Impact (Tier 2)	3 Low Impact (Tier 3)	
Project Title:	TSC - Hudson, CO		Report date:	05/07/24
Data filename:			Page 1	12 of 15

			T
Section # & Req.ID	Final Inspection	Complies?	Comments/Assumptions
C303.3, C408.2.5. 2 [FI17] ³	Furnished O&M instructions for systems and equipment to the building owner or designated representative.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.
C401.3 [FI58] ¹	A thermal envelope certificate will be supplied and completed by an approved third party.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.
C402.5.10 [FI26] ³	Recessed luminaires in thermal envelope to limit infiltration and be IC rated and labeled. Seal between interior finish and luminaire housing.	□Complies □Does Not □Not Observable □Not Applicable	Exception: Requirement does not apply.
C402.5.11 [FI59] ¹	Operable openings > 40 ft2 will be interlocked with heating and cooling systems to setback setpoint temperatures within 10 minutes of opening.	□Complies □Does Not □Not Observable □Not Applicable	Exception: Entrance doors located in exterior wall as part of a vestibule.
C402.5.8 [FI37] ¹	Weatherseals installed on all loading dock cargo door openings and provide direct contact along the top and sides of vehicles parked in the doorway.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Exception: Requirement does not apply.
C405.5.1 [FI19] ¹	Exterior lighting power is consistent with what is shown on the approved lighting plans, demonstrating proposed watts are less than or equal to allowed watts.	□Complies □Does Not □Not Observable □Not Applicable	See the Exterior Lighting fixture schedule for values.
C406.3 [FI67] ¹	Reduced lighting power - this credit specifies that the connected lighting power is >= 10% more efficient than 2021 IECC requirements.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	
C408.1.1 [FI57] ¹	Building operations and maintenance documents will be provided to the owner. Documents will cover manufacturers' information, specifications, programming procedures and means of illustrating to owner how building, equipment and systems are intended to be installed, maintained, and operated.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.
C408.2.5 [FI16] ³	Furnished as-built drawings for electric power systems within 90 days of system acceptance.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.
C408.3 [FI33] ¹	Lighting systems have been tested to ensure proper calibration, adjustment, programming, and operation.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.

Additional Comments/Assumptions:

	1 High Impact (Tier 1)	2	Medium Impact (Tier 2)	3	Low Impact (Tier 3)			
Project Title:	TSC - Hudson, CO				Repor	t date:	: 05/07	7/24
Data filename:	:				1	Page	15 of	15

Section # & Req.ID	Rough-In Electrical Inspection	Complies?	Comments/Assumptions
C405.2.4, C405.2.4. 1, C405.2.4. 2 [EL23] ²	Daylight zones provided with individual controls that control the lights independent of general area lighting. See code section C405.2.3 Daylight-responsive controls for applicable spaces, C405.2.3.1 Daylight responsive control function and section C405.2.3.2 Sidelit zone.	□Complies □Does Not □Not Observable □Not Applicable	Exception: Requirement does not apply.
C405.2.5 [EL27] ¹	Additional interior lighting power allowed for special functions per the approved lighting plans and is automatically controlled and separated from general lighting.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.
C405.2.7 [EL28] ¹	Automatic lighting controls for exterior lighting installed. Controls will be daylight controlled, set based on business operation time-of-day, or reduce connected lighting > 30%.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.
C405.7 [EL26] ²	Low-voltage dry-type distribution electric transformers meet the minimum efficiency requirements of Table C405.6.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.
C405.8 [EL27] ²	Electric motors meet the minimum efficiency requirements of Tables C405.7(1) through C405.7(4). Efficiency verified through certification under an approved certification program or the equipment efficiency ratings shall be provided by motor manufacturer (where certification programs do not exist).	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.
	Escalators and moving walks comply with ASME A17.1/CSA B44 and have automatic controls configured to reduce speed to the minimum permitted speed in accordance with ASME A17.1/CSA B44 or applicable local code when not conveying passengers.	□Complies □Does Not □Not Observable □Not Applicable	Exception: Requirement does not apply.
C405.10 [EL29] ²	Total voltage drop across the combination of feeders and branch circuits <= 5%.	☐Complies ☐Does Not ☐Not Observable ☐Not Applicable	Requirement will be met.
C405.1.1 [EL30] ²	At least 90% of dwelling unit permanently installed lighting shall have lamp efficacy >= 65 lm/W or luminaires with efficacy >= 45 lm/W or comply with C405.2.4 or C405.3.	□Complies □Does Not □Not Observable □Not Applicable	Exception: Requirement does not apply.
C405.11, C405.11.1 [EL31] ²	50% of 15/20 amp receptacles installed in enclosed offices, conference rooms, copy rooms, break rooms, classrooms and workstations and > 25% of branch circuit feeders for modular furniture will have automatic receptacle control in accordance with C405.11.1.	□Complies □Does Not □Not Observable □Not Applicable	Requirement will be met.

Additional Comments/Assumptions:

1	-	NA - 1' 1 /T' 0\	-	1 1 /T' 2\
1 High Impact (Tier 1)		Medium Impact (Tier 2)	3	Low Impact (Tier 3)

Report date: 05/07/24 Page 13 of 15 Project Title: TSC - Hudson, CO Data filename:



2934 Sidco Drive Architecture Suite 120 Planning Nashville, TN 37204 Interior Architecture Architecture


TRACTOR SUPPLY COMPANY HUDSON,

COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

Job Number 05.10.2024

ARCHITECTURAL COMCHECK

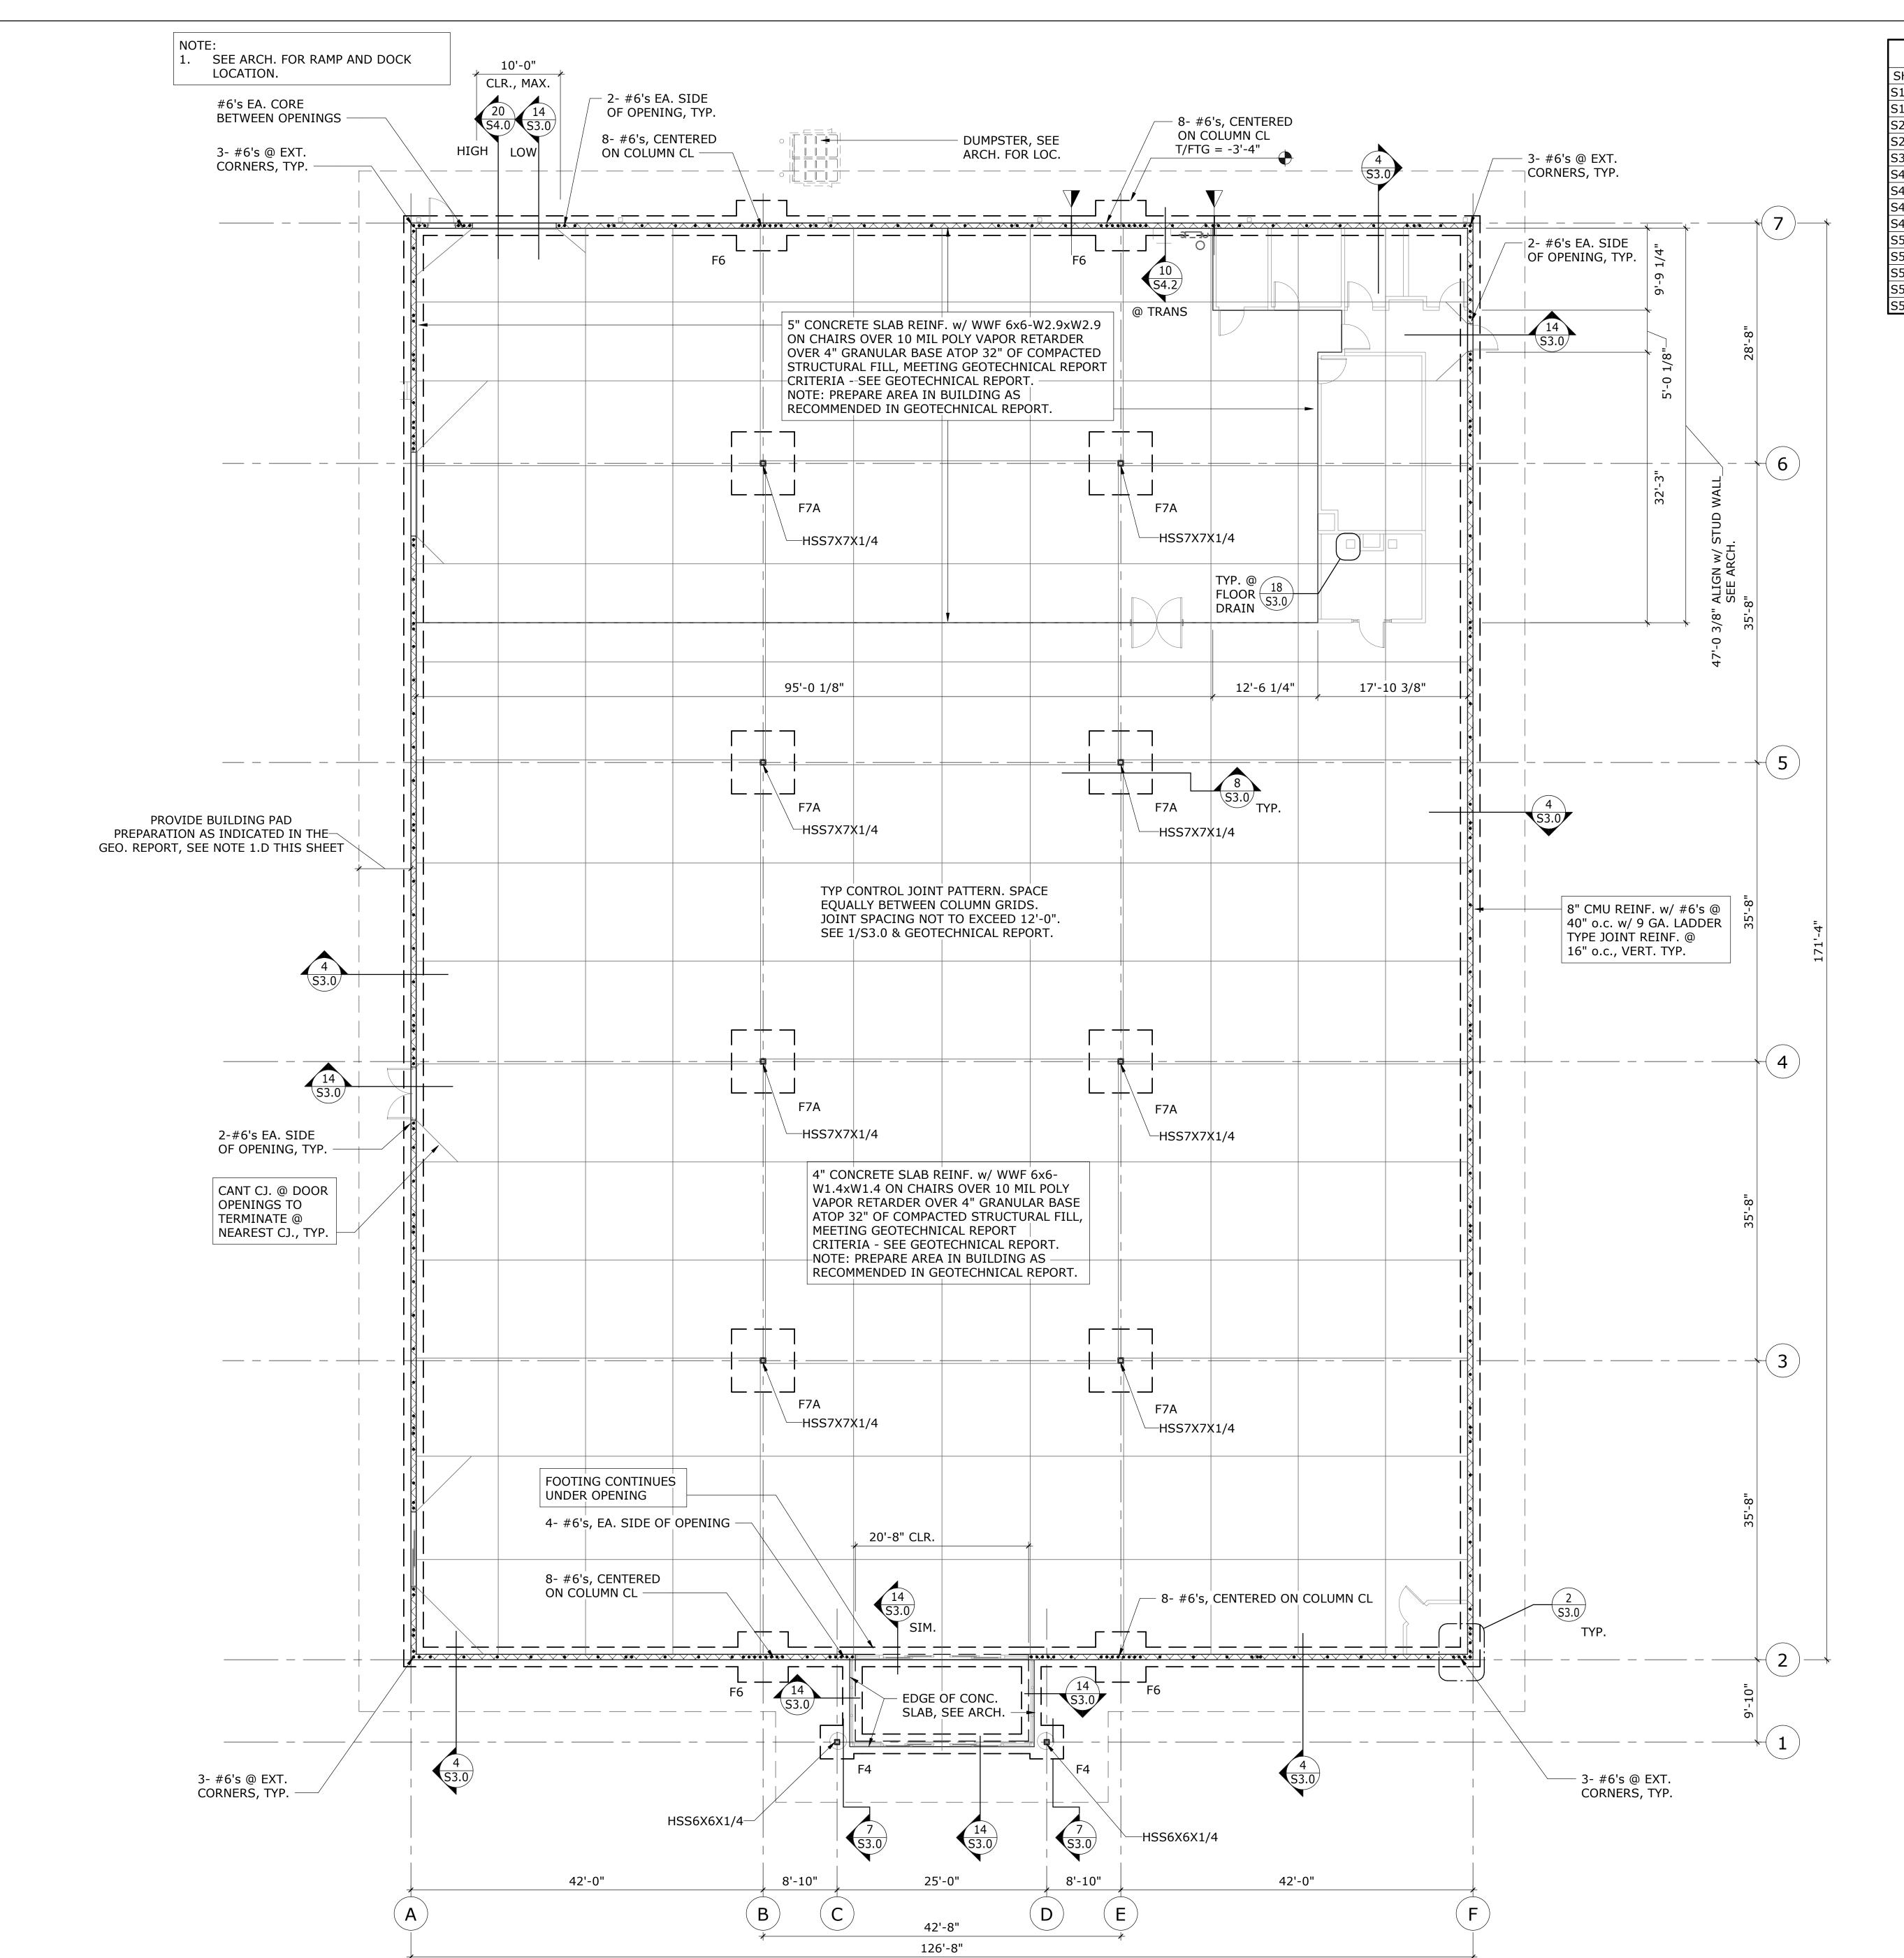

STRUCTURAL SHEET INDEX					
SHEET NO.	SHEET NAME				
S1.0	FOUNDATION PLAN				
S1.1	FORAGE SHED PLAN & DETAILS - PEMB				
S2.0	ROOF FRAMING PLAN				
S2.1	ROOF FRAMING PLAN, CONT.				
S3.0	DETAILS				
S4.0	DETAILS				
S4.1	DETAILS				
S4.2	DETAILS				
S4.3	DETAILS				
S5.0	STRUCTURAL GENERAL NOTES				
S5.1	STRUCTURAL GENERAL NOTES, CONT.				
S5.2	QUALITY ASSURANCE / PROPOSED STATEMENT OF SPECIAL INSPECTIONS				

CONCRETE SPECIFICATIONS

QUALITY ASSURANCE / PROPOSED STATEMENT OF SPECIAL INSPECTIONS, CONT.



2934 Sidco Drive Architecture Suite 120 Nashville, TN 37204 Interior Architecture

Experience Structural Expertise Atlanta, Boca Raton, Charlotte, Chattanooga, Knoxville, Nashville, Orlando, Raleigh **1964 - 2024 Celebrating** 60 **Years of Structural Excellence** 565 Marriott Drive, Suite 300 Nashville, Tennessee 37214

Copyright 2024 • Bennett & Pless, Inc. All Rights Reserved **B & P Job Number** 24.02.102

Tel 615 782 0100





TRACTOR SUPPLY COMPANY HUDSON, COLORADO

FOOTING SCHEDULE						
MARK		SIZE		REBAR	REMARKS	
	LENGTH	WIDTH	THICK.			
F4	4'-0"	4'-0"	1'-4"	5- #5's, EA. WAY, TOP & BTM.		
F6	6'-0"	6'-0"	1'-4"	6- #6's, EA. WAY, TOP & BTM.		
F7A	7'-6"	7'-6"	1'-4"	7- #6's, EA. WAY, TOP & BTM.		

UNDERCUT, FILL, PREPARE, TEST, AND REMEDIATE ALL SUBGRADE AS RECOMMENDED IN THE GEOTECHNICAL REPORT.

VERIFY SOIL BELOW SLAB AND FOOTINGS WITH GEOTECHNICAL

ENGINEER PRIOR TO PLACEMENT. SEE GEOTECHNICAL REPORT. IF AGGREGATE PIERS ARE REMOVE FROM PROJECT, ADJUSTMENT TO ISOLATED FOOTINGS WILL BE REQUIRED.

FOUNDATION PLAN

1. TOP OF FOOTING:

A. EXTERIOR ISOLATED FOOTINGS = -24" MINIMUM BELOW FINISH FLOOR OR GRADE, WHICHEVER IS LOWER.

B. CONTINUOUS WALL FOOTING = -24" MINIMUM BELOW FINISH FLOOR OR FINISH GRADE, WHICHEVER IS LOWER. C. INTERIOR ISOLATED FOOTINGS = -16" BELOW FINISH FLOOR.

D. ALL BUILDING FONDATIONS ARE DESIGNED TO BEAR ON AGGREGATE PIERS. SEE GEOTECHNICAL REPORT.

2. THE CONTRACTOR SHALL COORDINATE ANY UNDER SLAB PIPING, CONDUITS, AND/ OR UTILITIES PRIOR TO PLACING FOOTINGS. IMMEDIATELY REPORT ANY CONFLICTS TO THE ENGINEER.

SEE DETAIL 1 / S3.0 FOR SLAB CONTROL JOINTS. DOWELS SHOWN ON PLAN INDICATE GROUT FILLED REINFORCED


CORES. SEE DETAIL 13 / S3.0 & 11 / S3.0. 5. SEE 12 / S3.0 & 16 / S3.0 FOR ADDITIONAL REINFORCING AT WALL JOINTS. SEE ARCHITECTURAL DRAWINGS FOR CONTROL JOINT

LOCATIONS. —— INDICATES FOOTING STEP. G.C. SHALL COORDINATE REQUIRED STEPS WITH GRADING AND SUBGRADE SYSTEM

REQUIREMENTS SEE 3 / S3.0. 7. SEE DETAILS 7 / S4.2 , 8 / S4.2 , AND 9 / S4.2 FOR FOOTING CONDITIONS ADJACENT TO PLUMBING, ELECTRICAL, AND FIRE PROTECTION SYSTEMS.

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action

Job Number: 2387 05.10.2024 **Revisions: Revisions: Revisions:** FOUNDATION PLAN

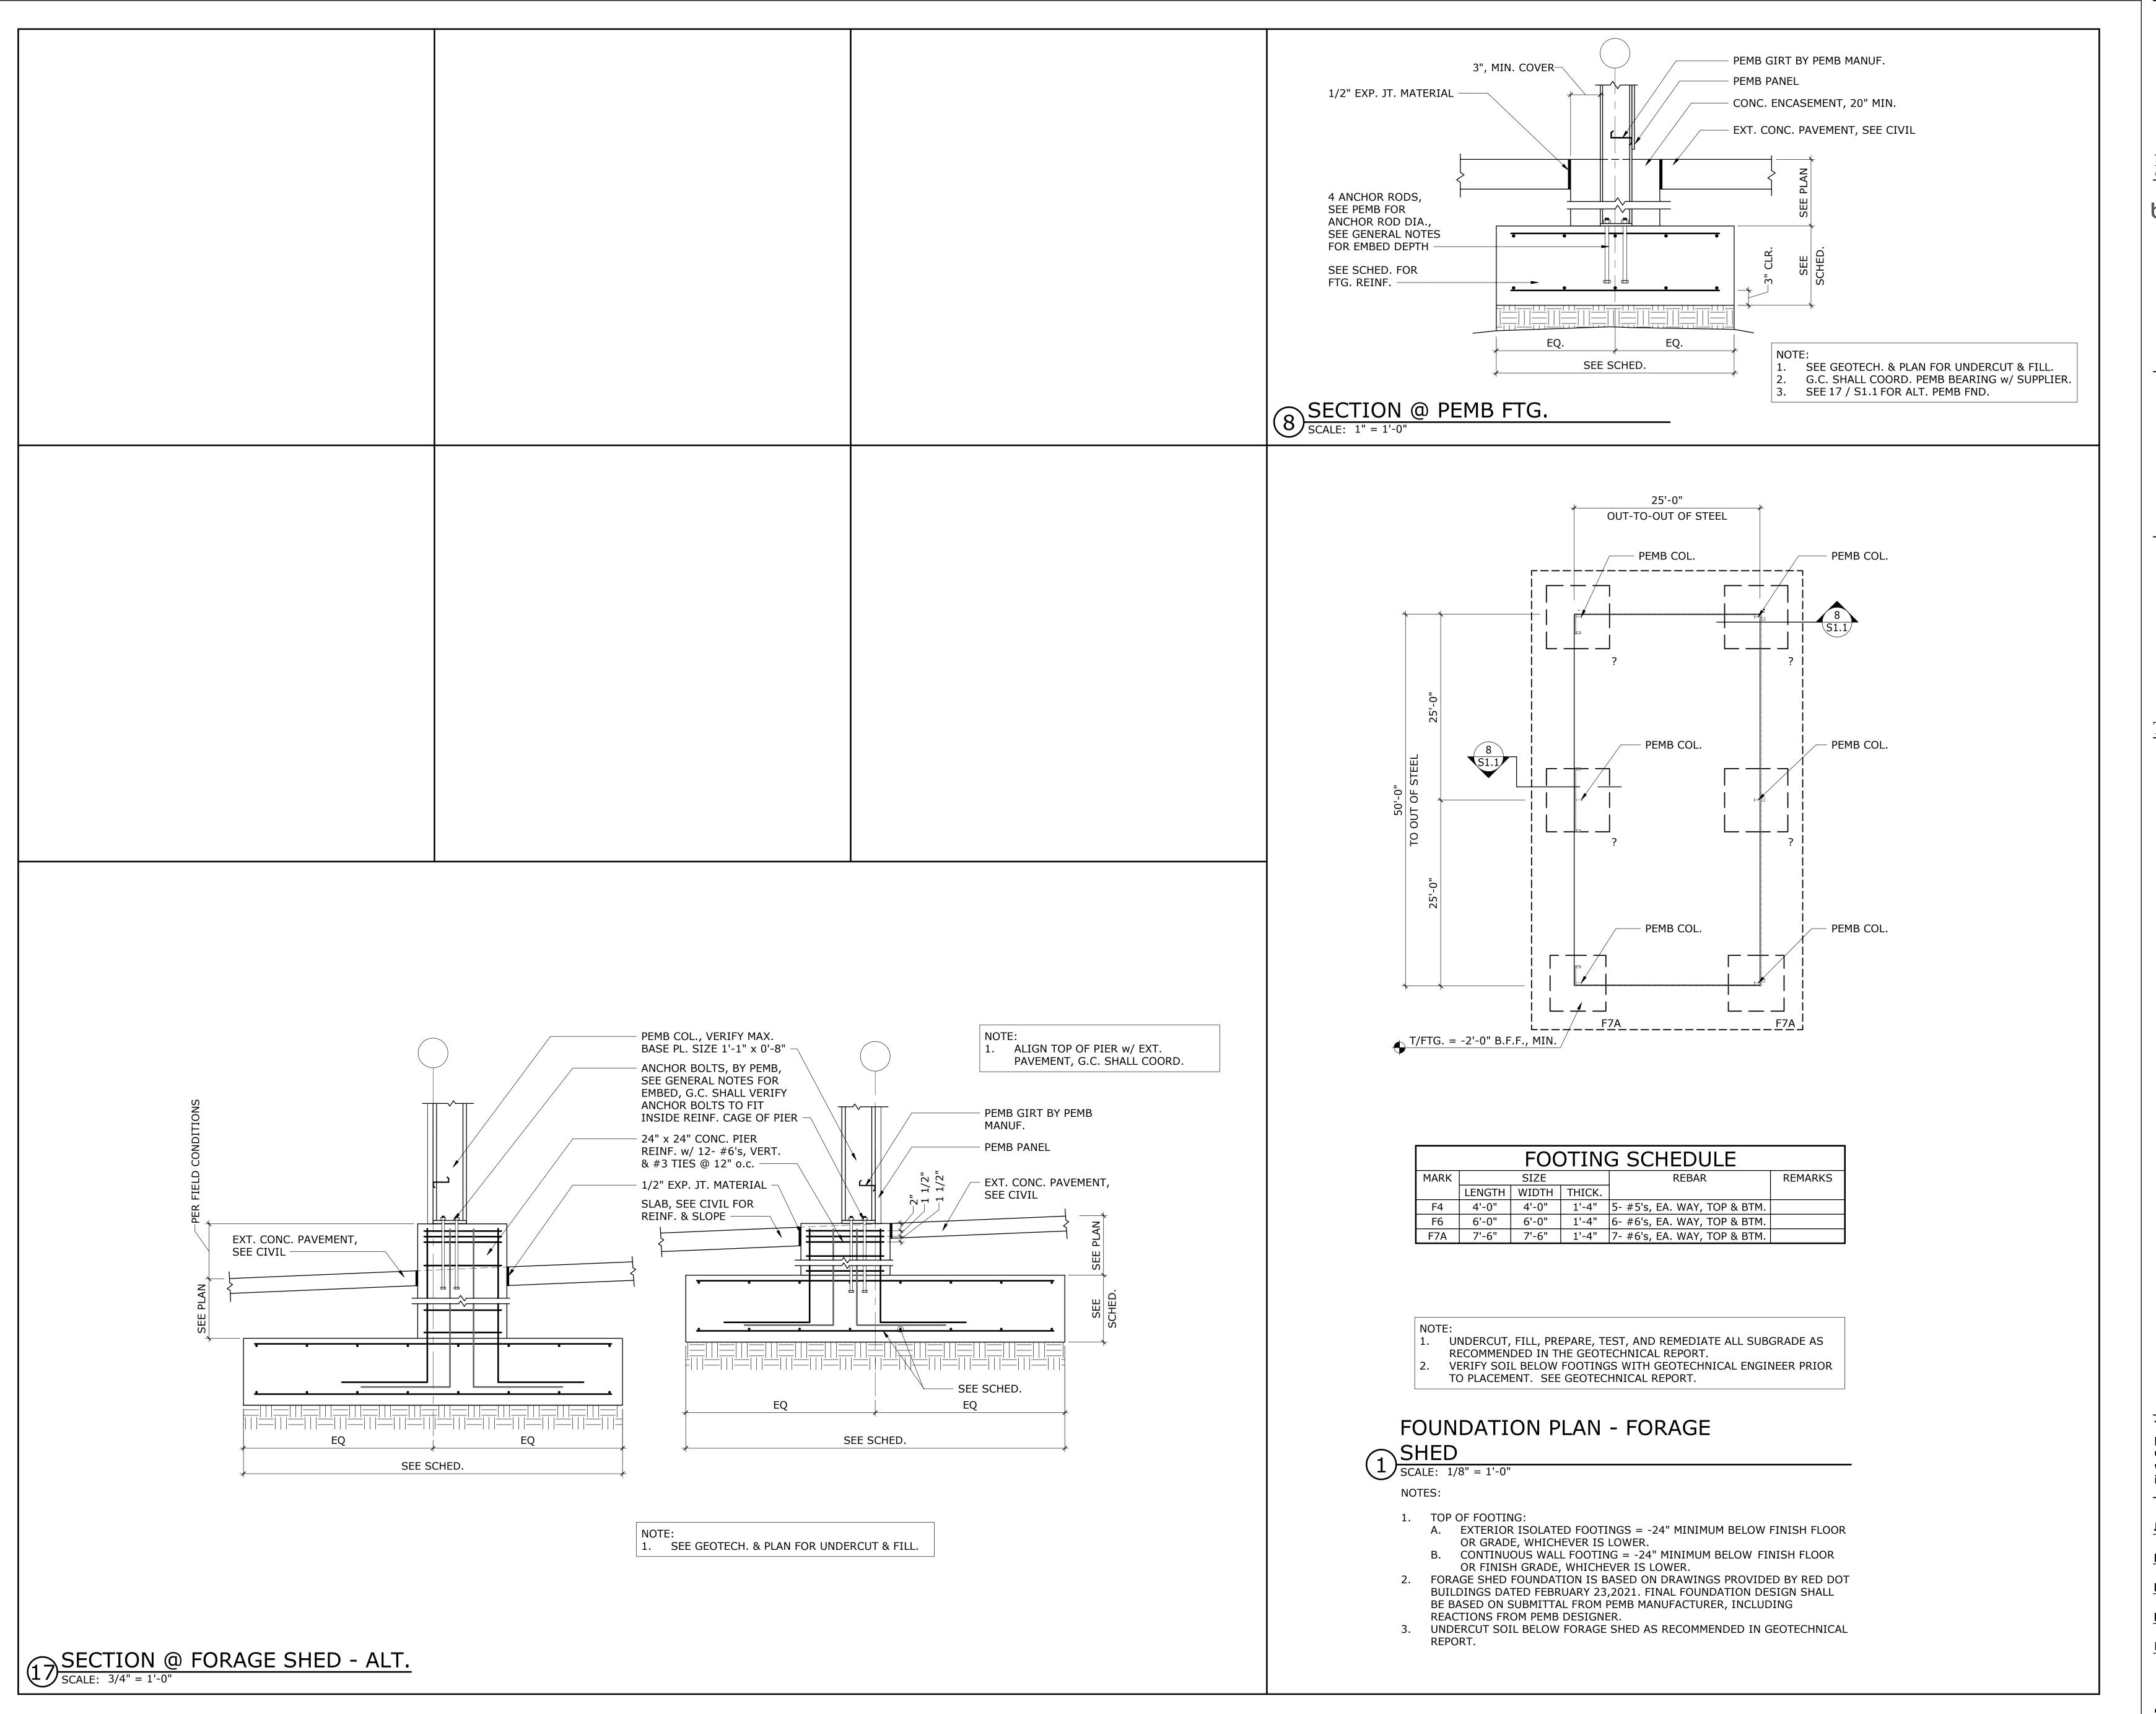




2934 Sidco Drive **Architecture** Suite 120 Nashville, TN 37204 Interior Architecture

formerly WiSEngineers **Experience Structural Expertise**

Atlanta, Boca Raton, Charlotte, Chattanooga, Knoxville, Nashville, Orlando, Raleigh **1964 - 2024 Celebrating** 60 **Years of Structural Excellence** 565 Marriott Drive, Suite 300 Nashville, Tennessee 37214 Tel 615 782 0100

Copyright 2024 • Bennett & Pless, Inc. All Rights Reserved **B & P Job Number** 24.02.102






TRACTOR SUPPLY COMPANY HUDSON, COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action

Job Number: 05.10.2024

Revisions: Revisions:

Revisions: FORAGE SHED PLAN & DETAILS -

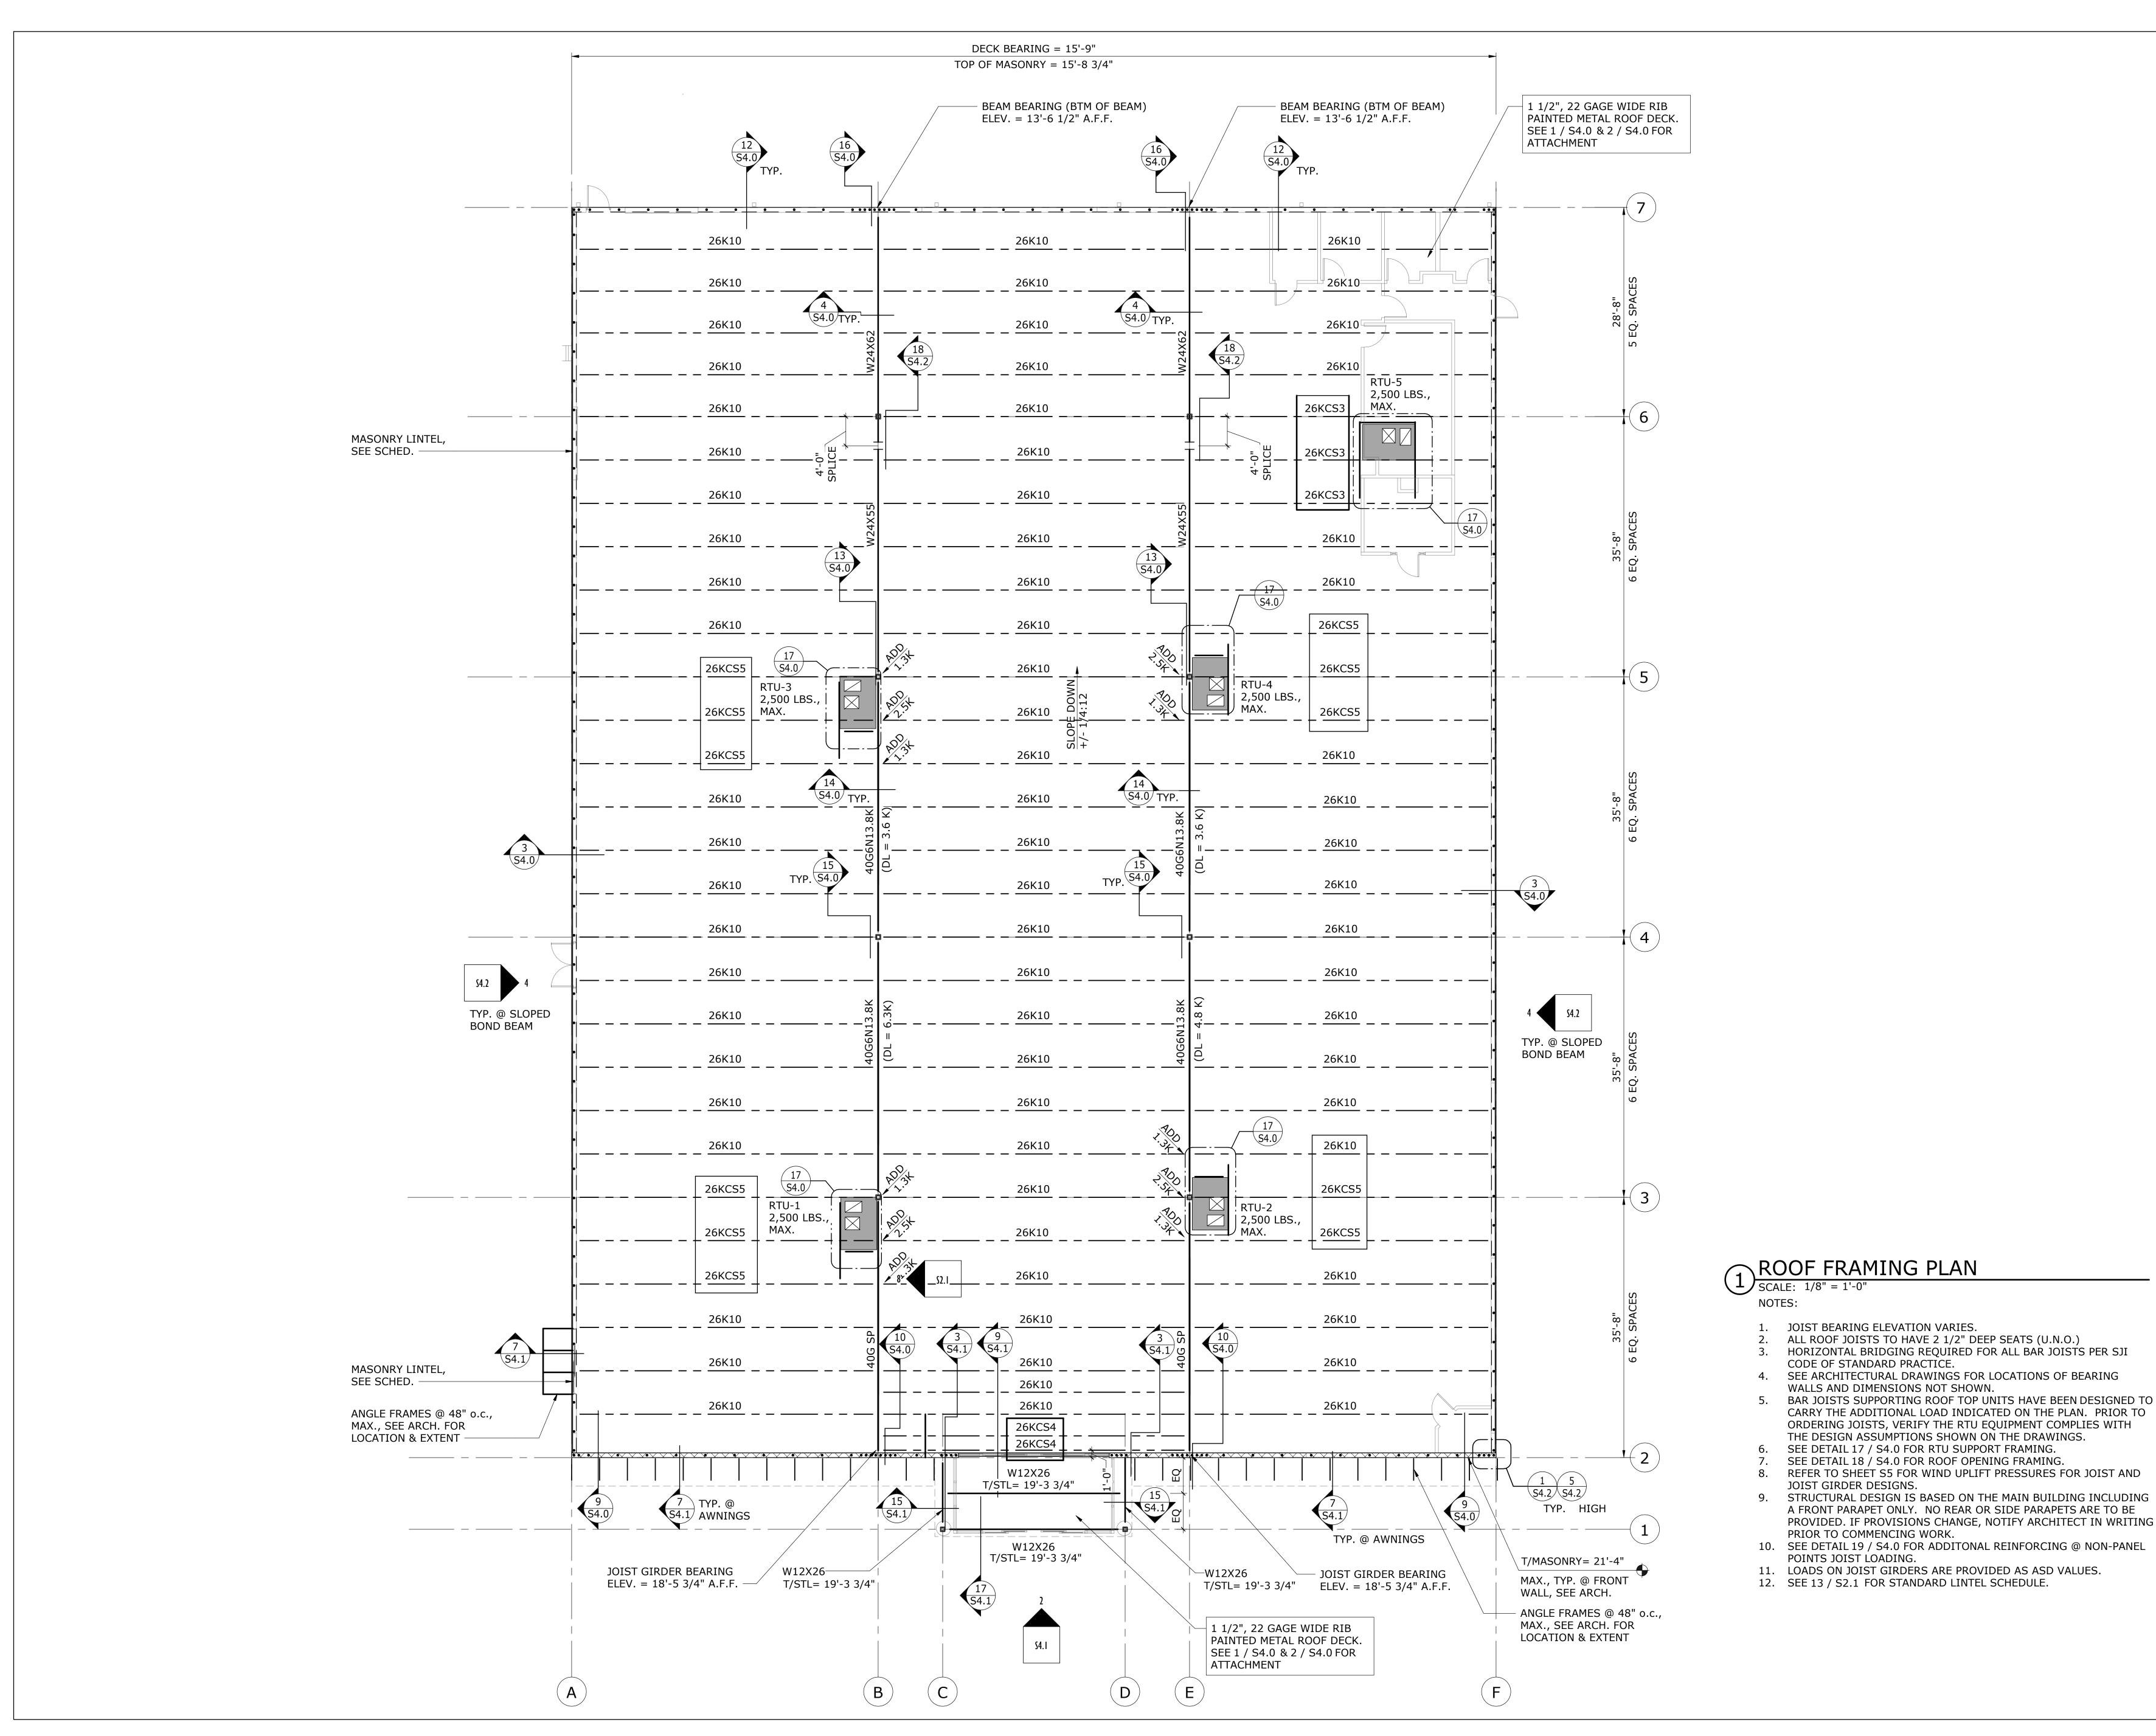



Interior Architecture

2934 Sidco Drive Suite 120 Nashville TN 37204

Nashville, TN 37204

ennett&pless formerly WiSEngineers

Experience Structural Expertise
Atlanta, Boca Raton, Charlotte, Chattanooga,
Knoxville, Nashville, Orlando, Raleigh

1964 - 2024 Celebrating 60
Years of Structural Excellence

565 Marriott Drive, Suite 300
Nashville, Tennessee 37214
Tel 615 782 0100

Copyright 2024 • Bennett & Pless, Inc.
All Rights Reserved
B & P Job Number 24.02.102





TRACTOR SUPPLY COMPANY
HUDSON,
COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any


infringement will be subject to legal action

NG Job Number: 2387

Date: 05.10.2024

Revisions:

Revisions: A ROOF FRAMING PLAN

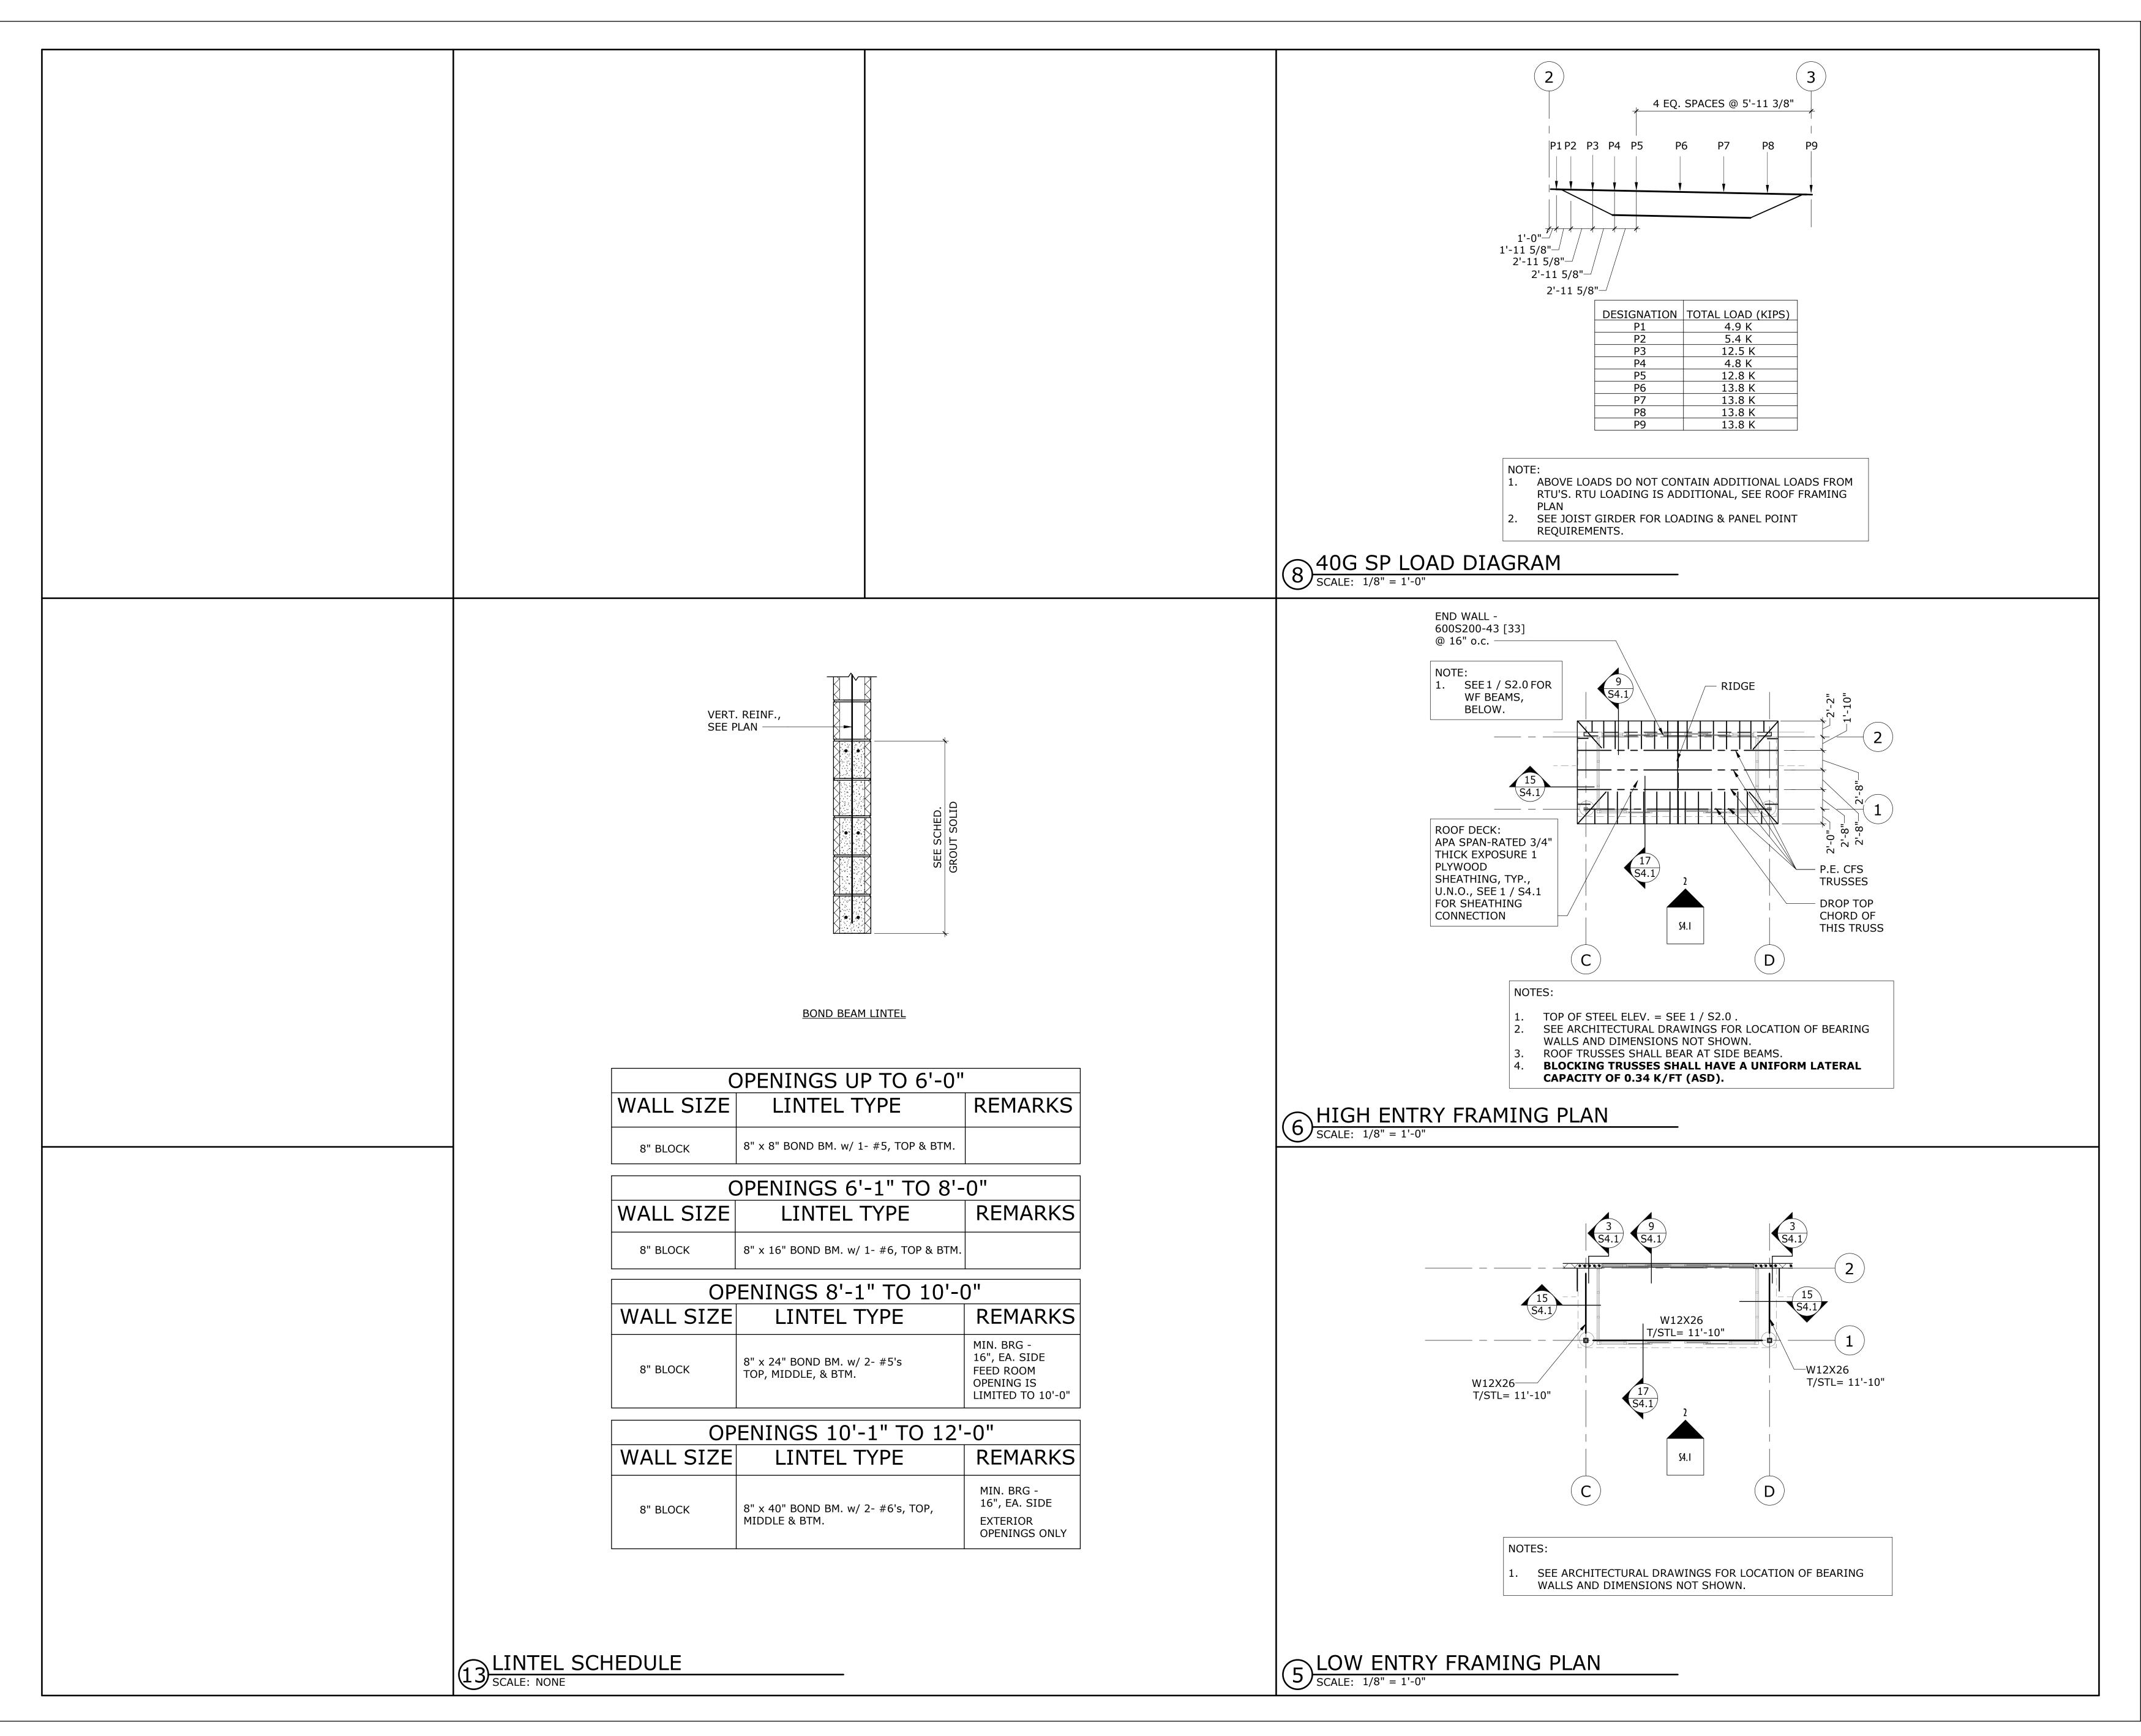



2934 Sidco Drive Architecture
Suite 120 Planning

Interior Architecture

bennett&pless formerly WiSEngineers

Nashville, TN 37204


Experience Structural Expertise
Atlanta, Boca Raton, Charlotte, Chattanooga,
Knoxville, Nashville, Orlando, Raleigh

1964 - 2024 Celebrating 60
Years of Structural Excellence

565 Marriott Drive, Suite 300
Nashville, Tennessee 37214
Tel 615 782 0100

Copyright 2024 • Bennett & Pless, Inc.
All Rights Reserved
B & P Job Number 24.02.102





TRACTOR SUPPLY COMPANY
HUDSON,
COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action

Job Number:


Date: 05.10.2024

Revisions:

Revisions: \triangle ROOF FRAMING PLAN, CONT.

Sheet Number:

S2

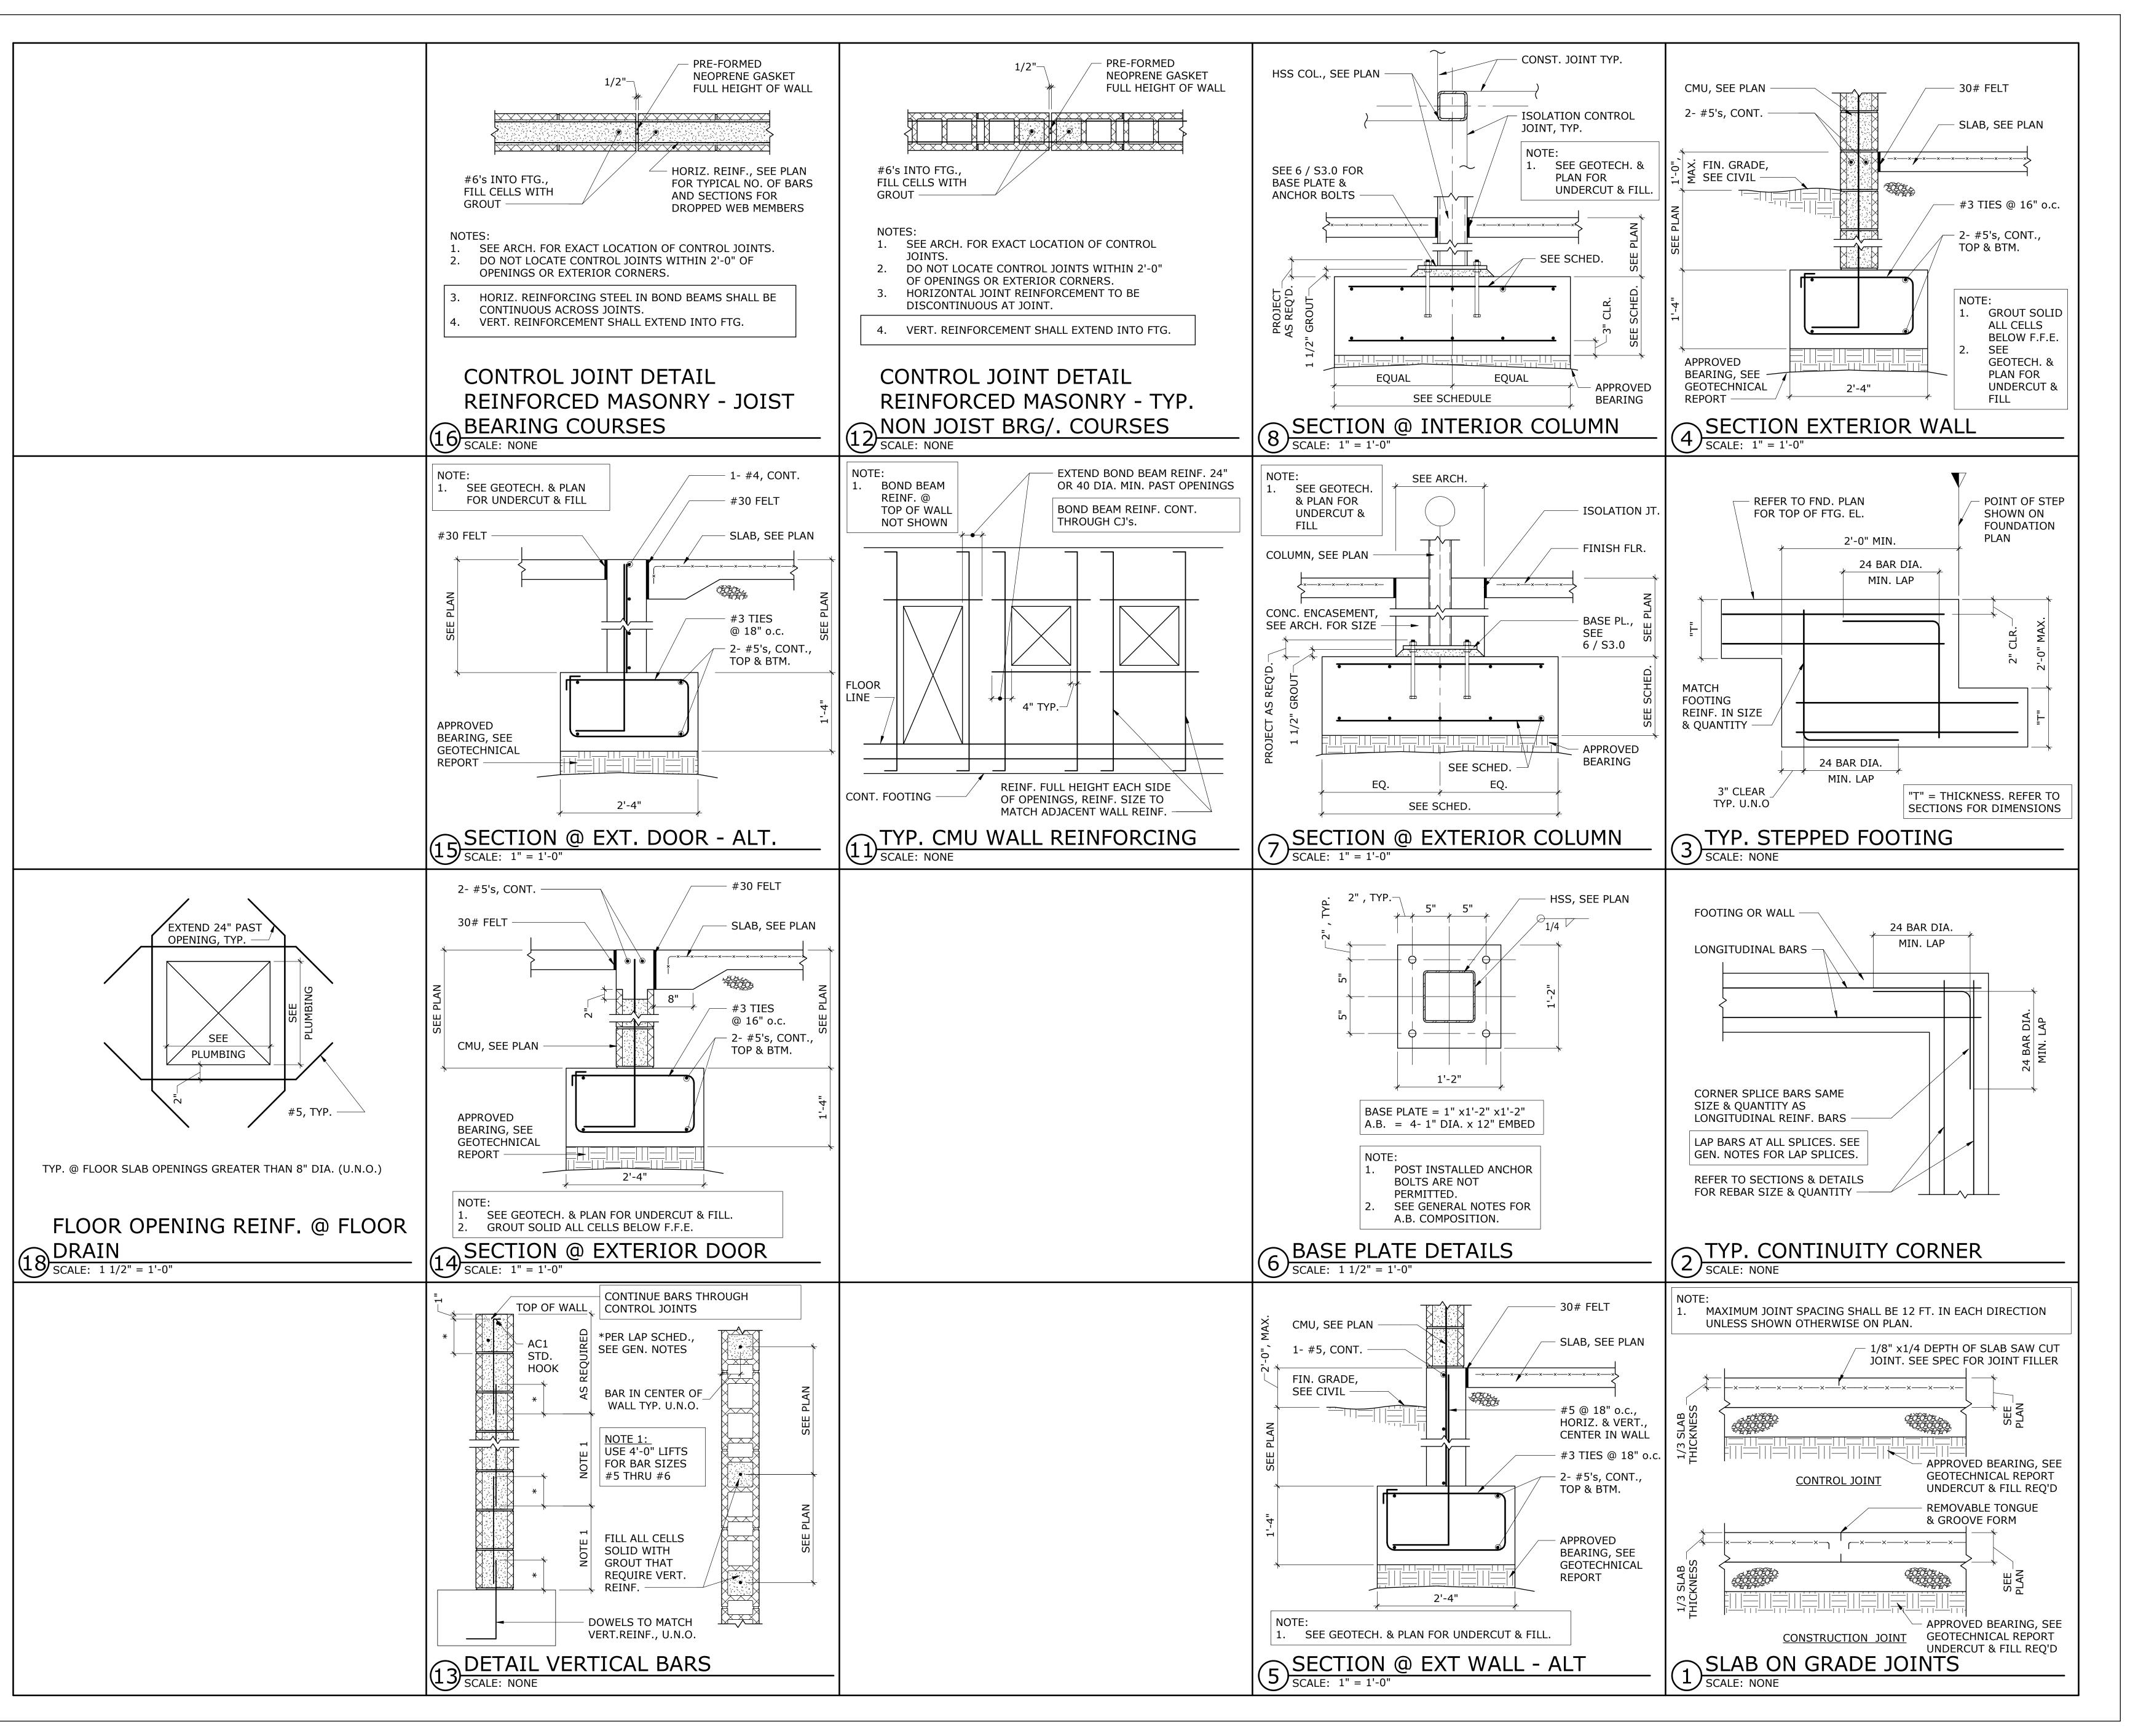



2934 Sidco Drive Suite 120 Nashville, TN 37204 Interior Architecture

Experience Structural Expertise


Atlanta, Boca Raton, Charlotte, Chattanooga

Knoxville, Nashville, Orlando, Raleigh

1964 - 2024 Celebrating 60 Years of Structural Excellence 565 Marriott Drive, Suite 300 Nashville, Tennessee 37214 Tel 615 782 0100

Copyright 2024 • Bennett & Pless, Inc. All Rights Reserved **B & P Job Number** 24.02.102





TRACTOR SUPPLY COMPANY HUDSON, COLORADO


This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action

Job Number:		
Date:		05.10
Revisions:	\triangle	

Revisions: Revisions:

DETAILS

S3.0

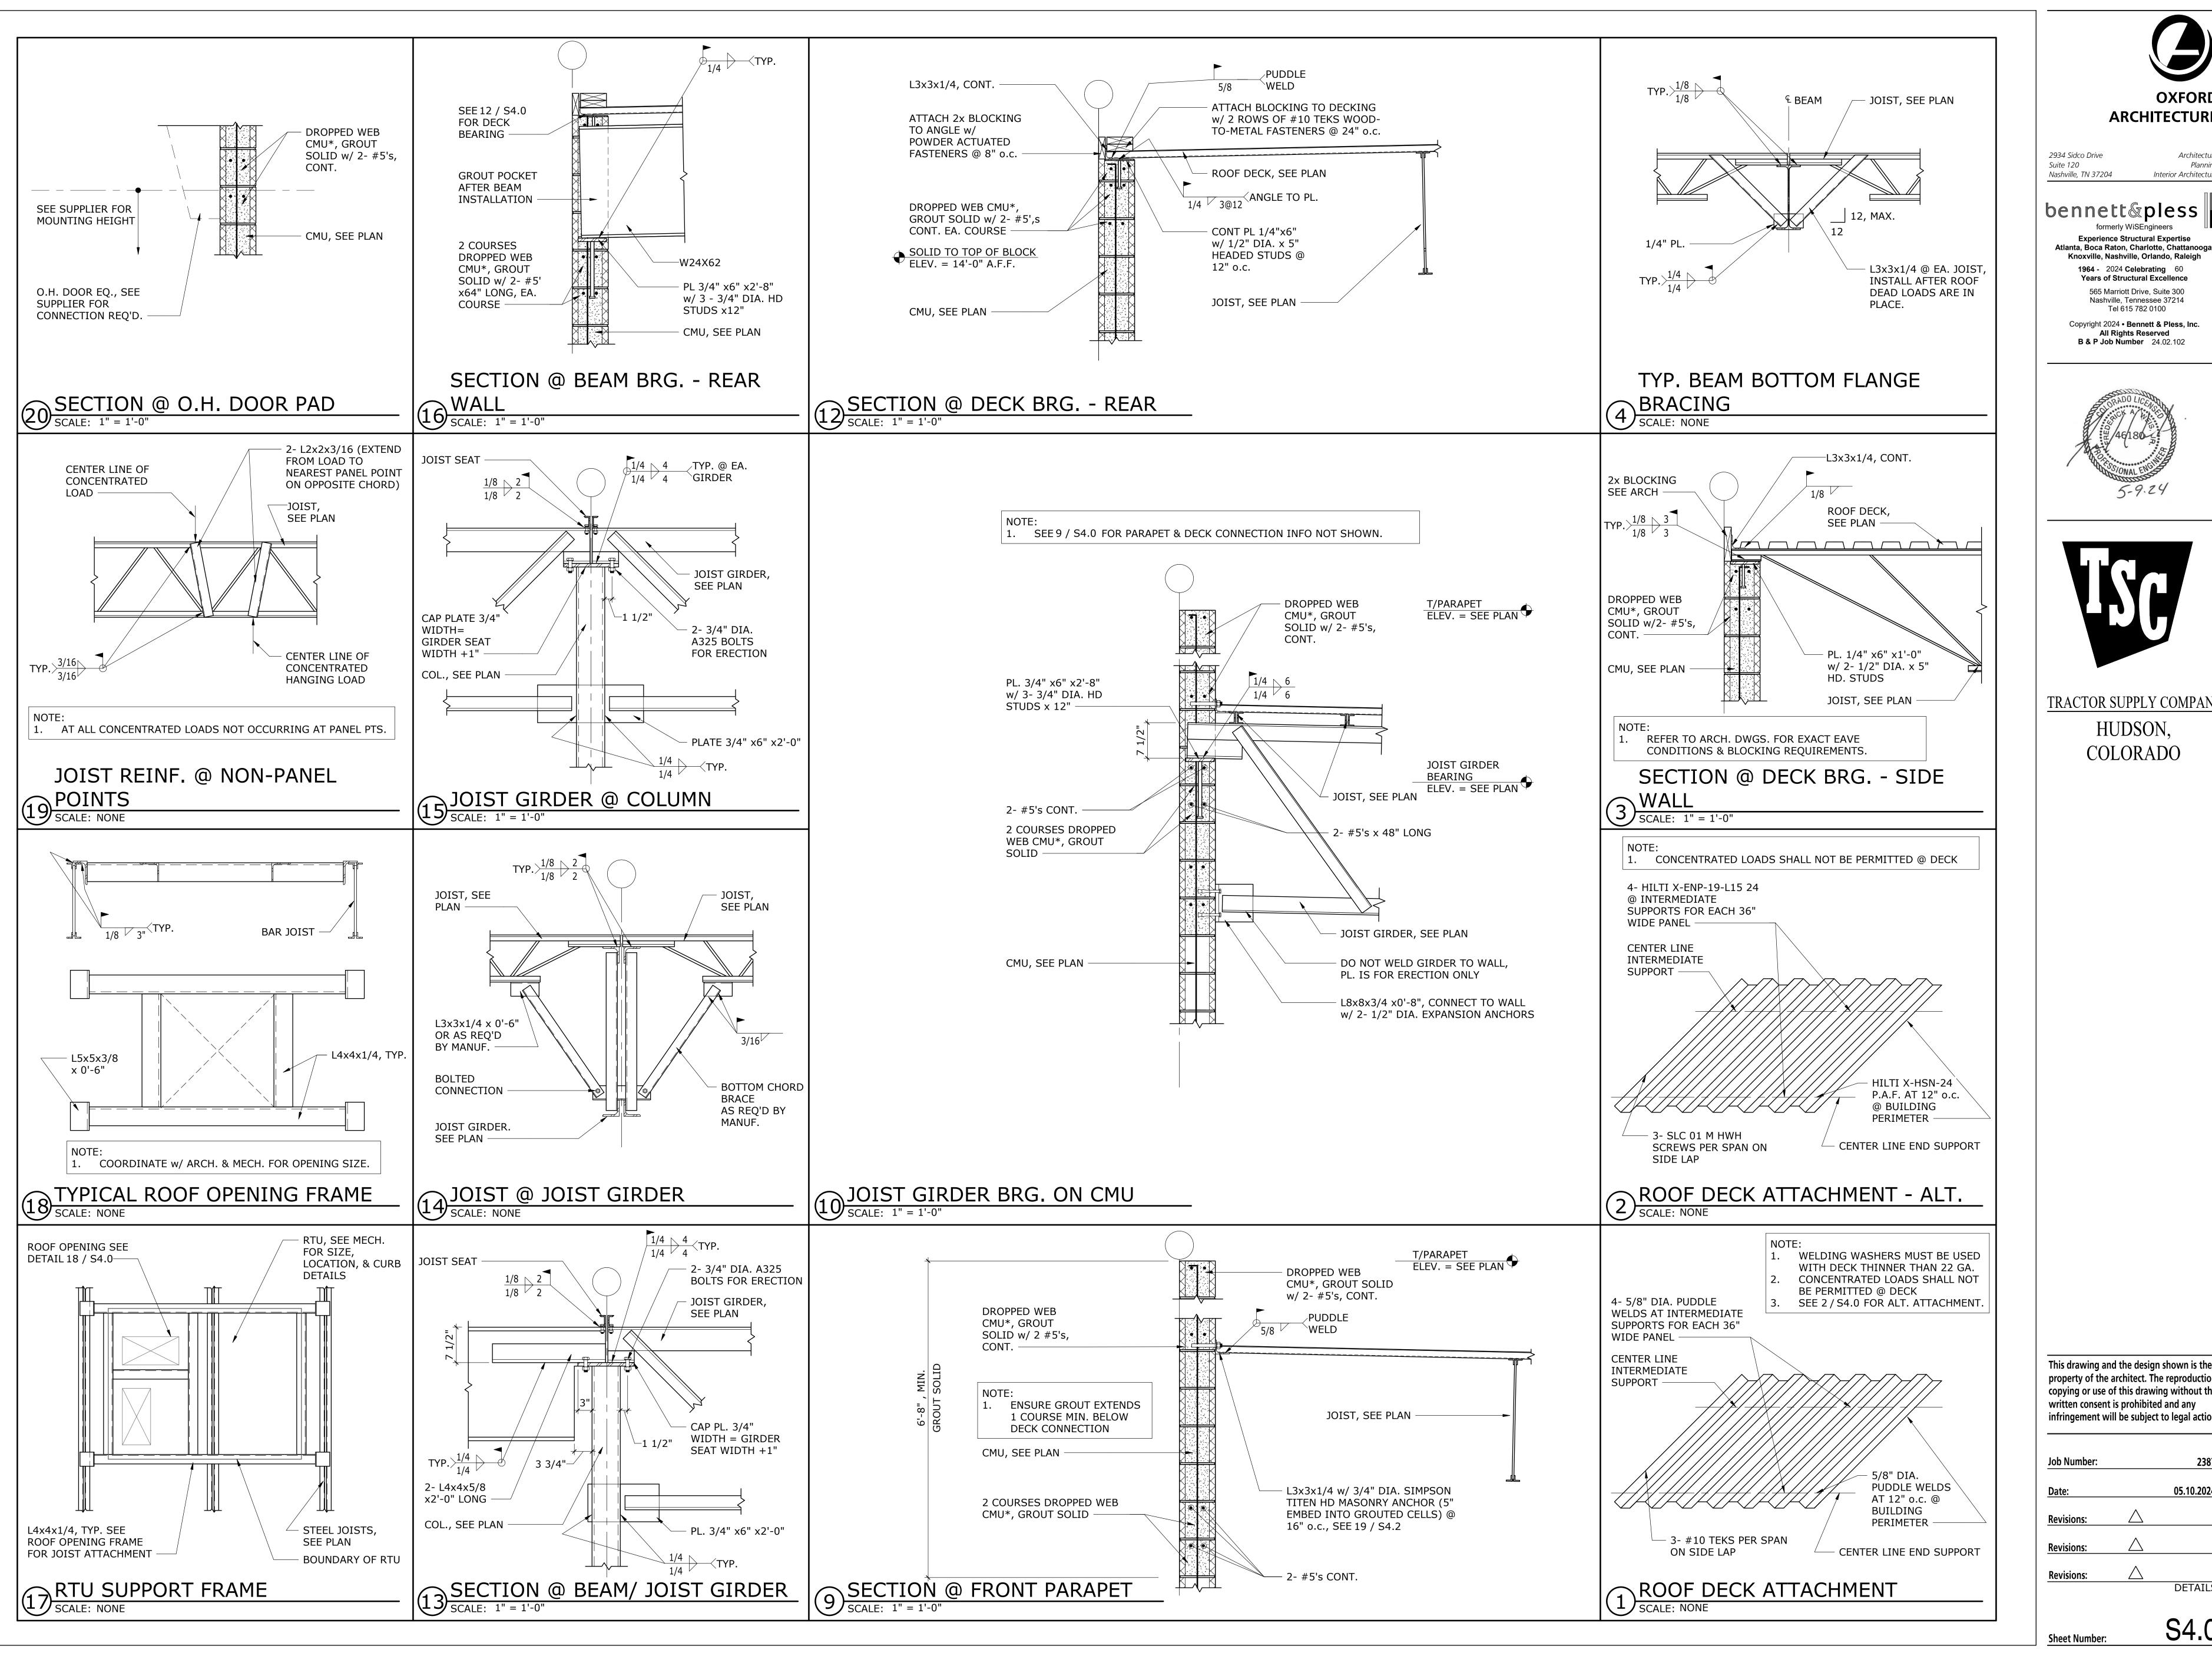



2934 Sidco Drive Suite 120 Nashville, TN 37204 Interior Architecture

formerly WiSEngineers **Experience Structural Expertise**

> **1964 - 2024 Celebrating** 60 Years of Structural Excellence 565 Marriott Drive, Suite 300 Nashville, Tennessee 37214 Tel 615 782 0100

Knoxville, Nashville, Orlando, Raleigh

Copyright 2024 • Bennett & Pless, Inc. All Rights Reserved **B & P Job Number** 24.02.102





TRACTOR SUPPLY COMPANY HUDSON, COLORADO


This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action

Job Number:		2
Date:		05.10.2
Revisions:	\triangle	
Revisions:	\triangle	

Revisions: DETAILS

Sheet Number:

S4.0

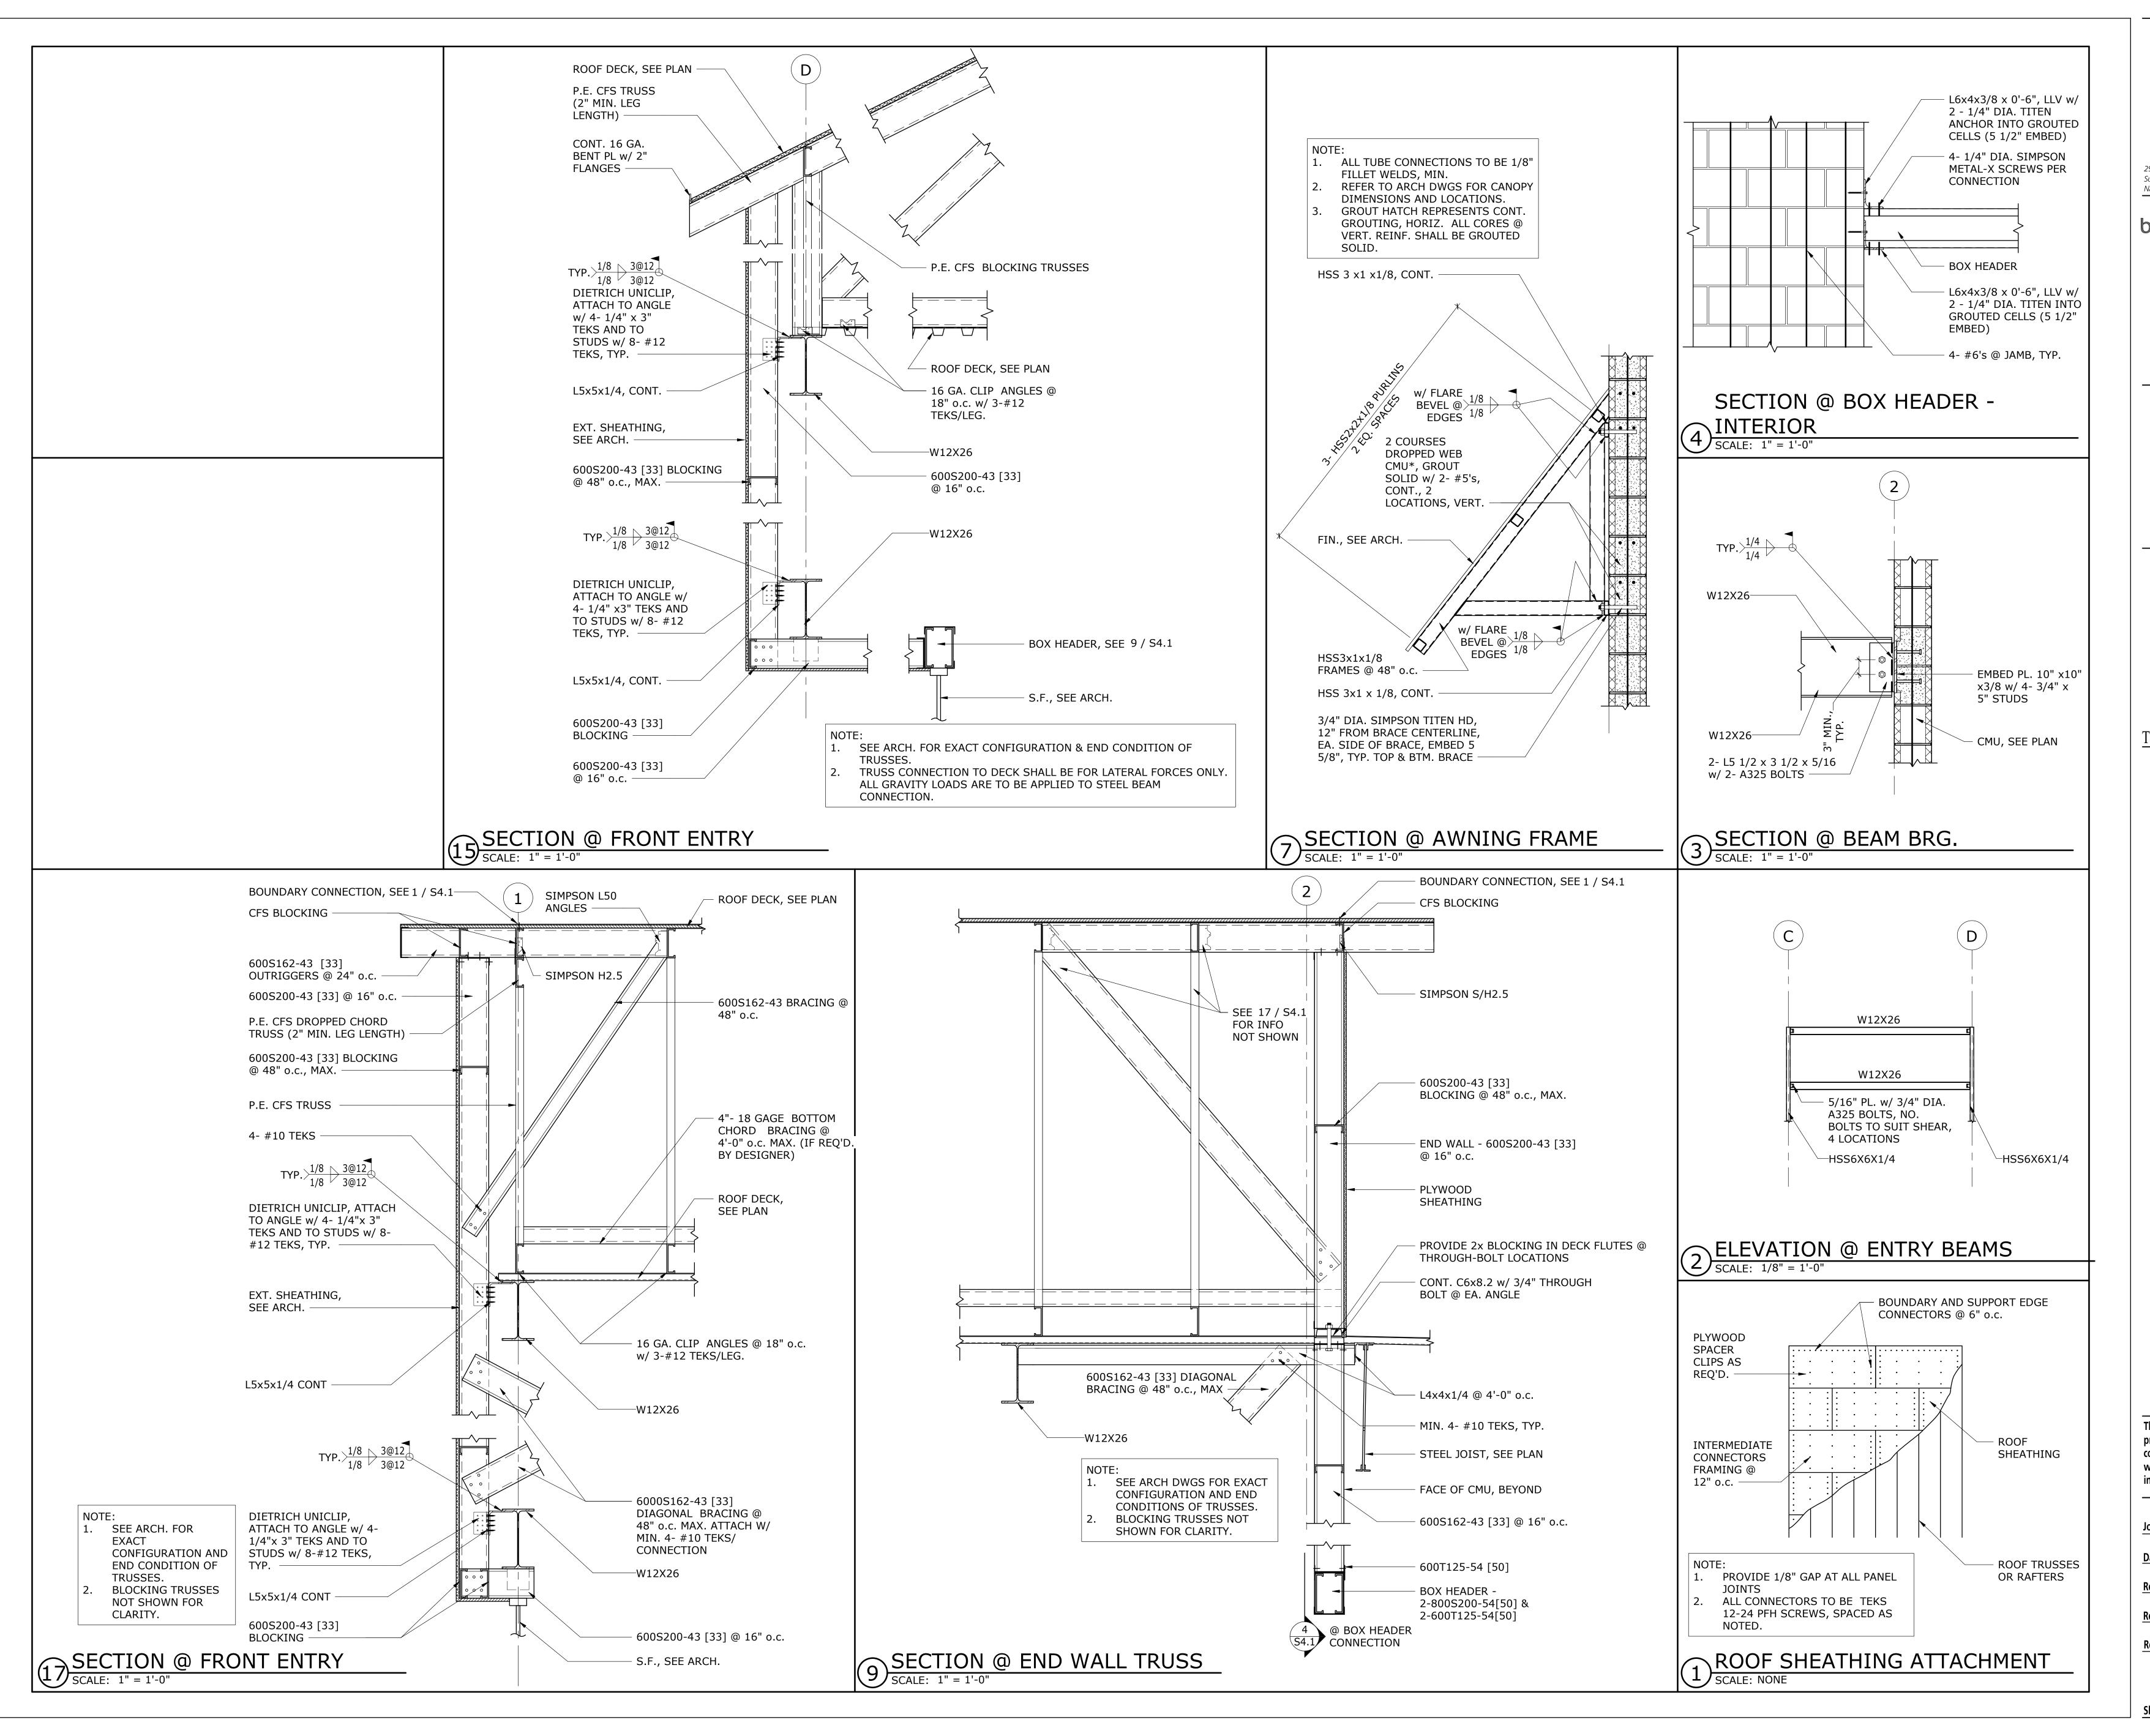



Interior Architecture

Planning

2934 Sidco Drive Suite 120 Nashville, TN 37204


formerly WiSEngineers

Experience Structural Expertise

Atlanta, Boca Raton, Charlotte, Chattanooga, Knoxville, Nashville, Orlando, Raleigh **1964 - 2024 Celebrating** 60 **Years of Structural Excellence** 565 Marriott Drive, Suite 300 Nashville, Tennessee 37214 Tel 615 782 0100

Copyright 2024 • Bennett & Pless, Inc. All Rights Reserved **B & P Job Number** 24.02.102






TRACTOR SUPPLY COMPANY HUDSON, COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action

Job Number:		23
Date:		05.10.2
Revisions:	\triangle	
	^	

Revisions: Revisions:

DETAILS

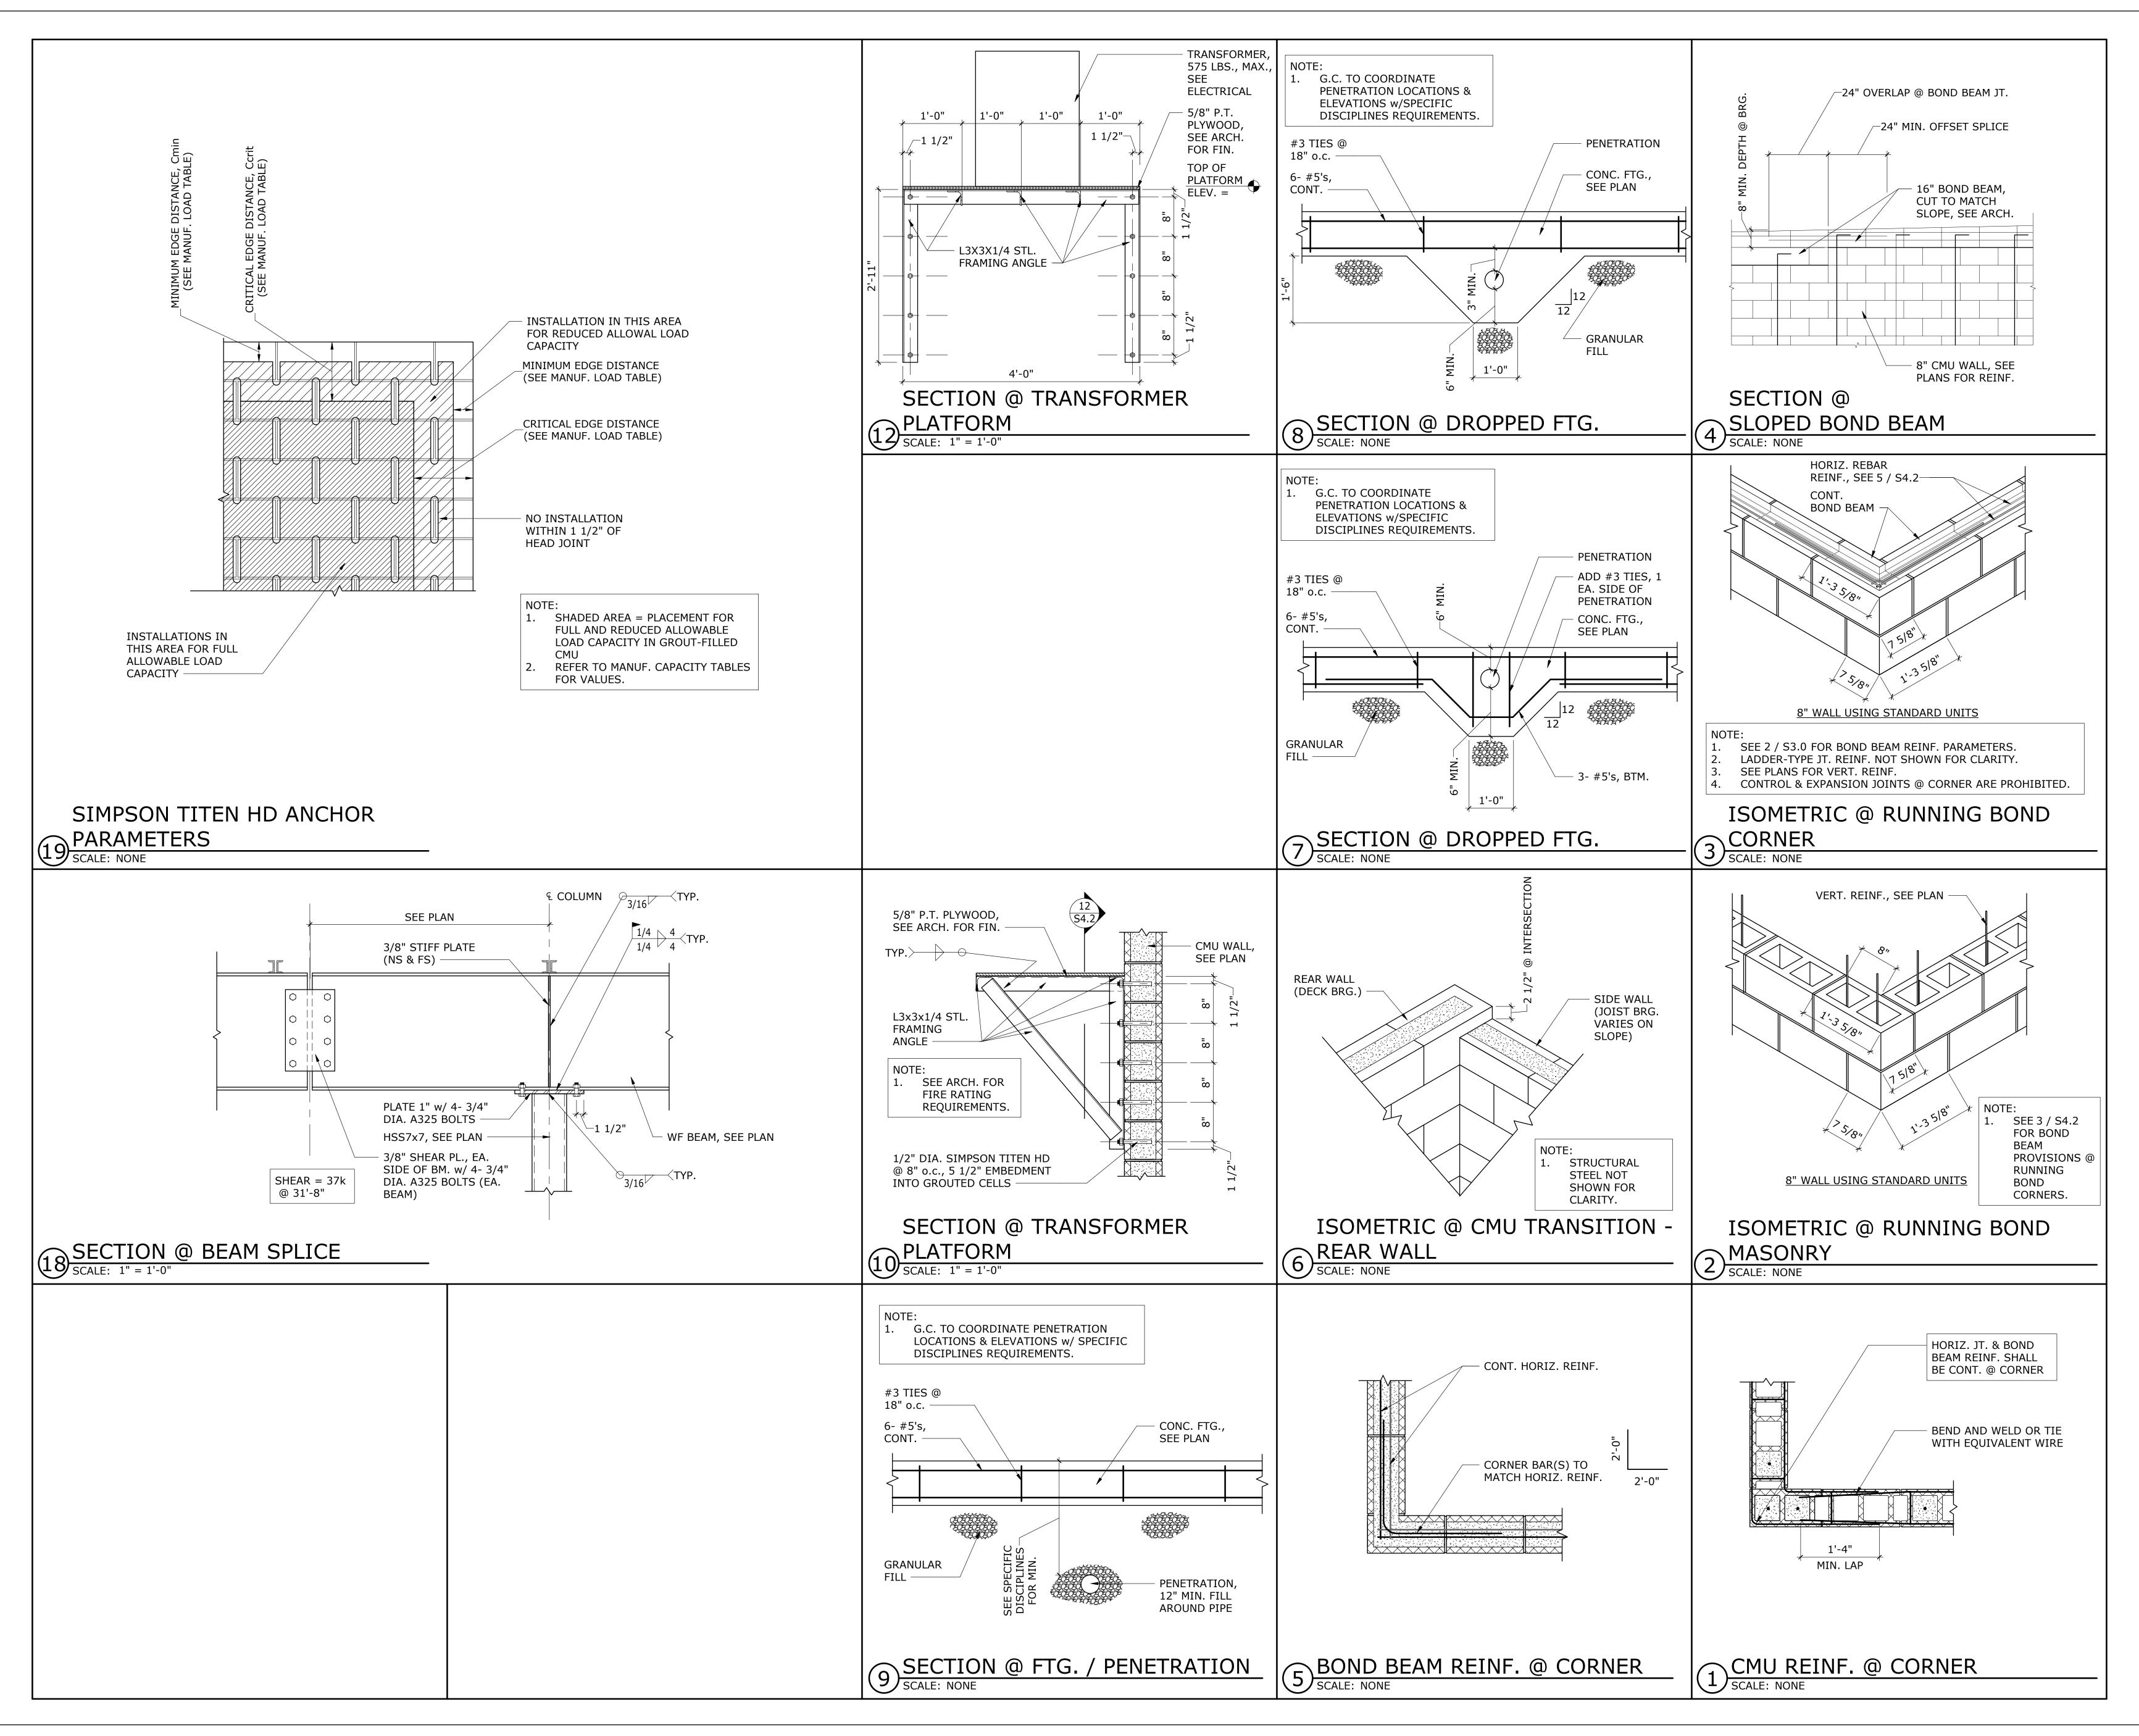



2934 Sidco Drive Suite 120 Nashville, TN 37204 Interior Architecture

formerly WiSEngineers **Experience Structural Expertise**

Atlanta, Boca Raton, Charlotte, Chattanooga, Knoxville, Nashville, Orlando, Raleigh **1964 - 2024 Celebrating** 60 **Years of Structural Excellence** 565 Marriott Drive, Suite 300 Nashville, Tennessee 37214 Tel 615 782 0100

Copyright 2024 • Bennett & Pless, Inc. All Rights Reserved **B & P Job Number** 24.02.102






TRACTOR SUPPLY COMPANY HUDSON, COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action

Job Number:		2387
Date:		05.10.2024
Revisions:	\triangle	
Revisions:	\triangle	
Revisions:	\triangle	

DETAILS

S4.2

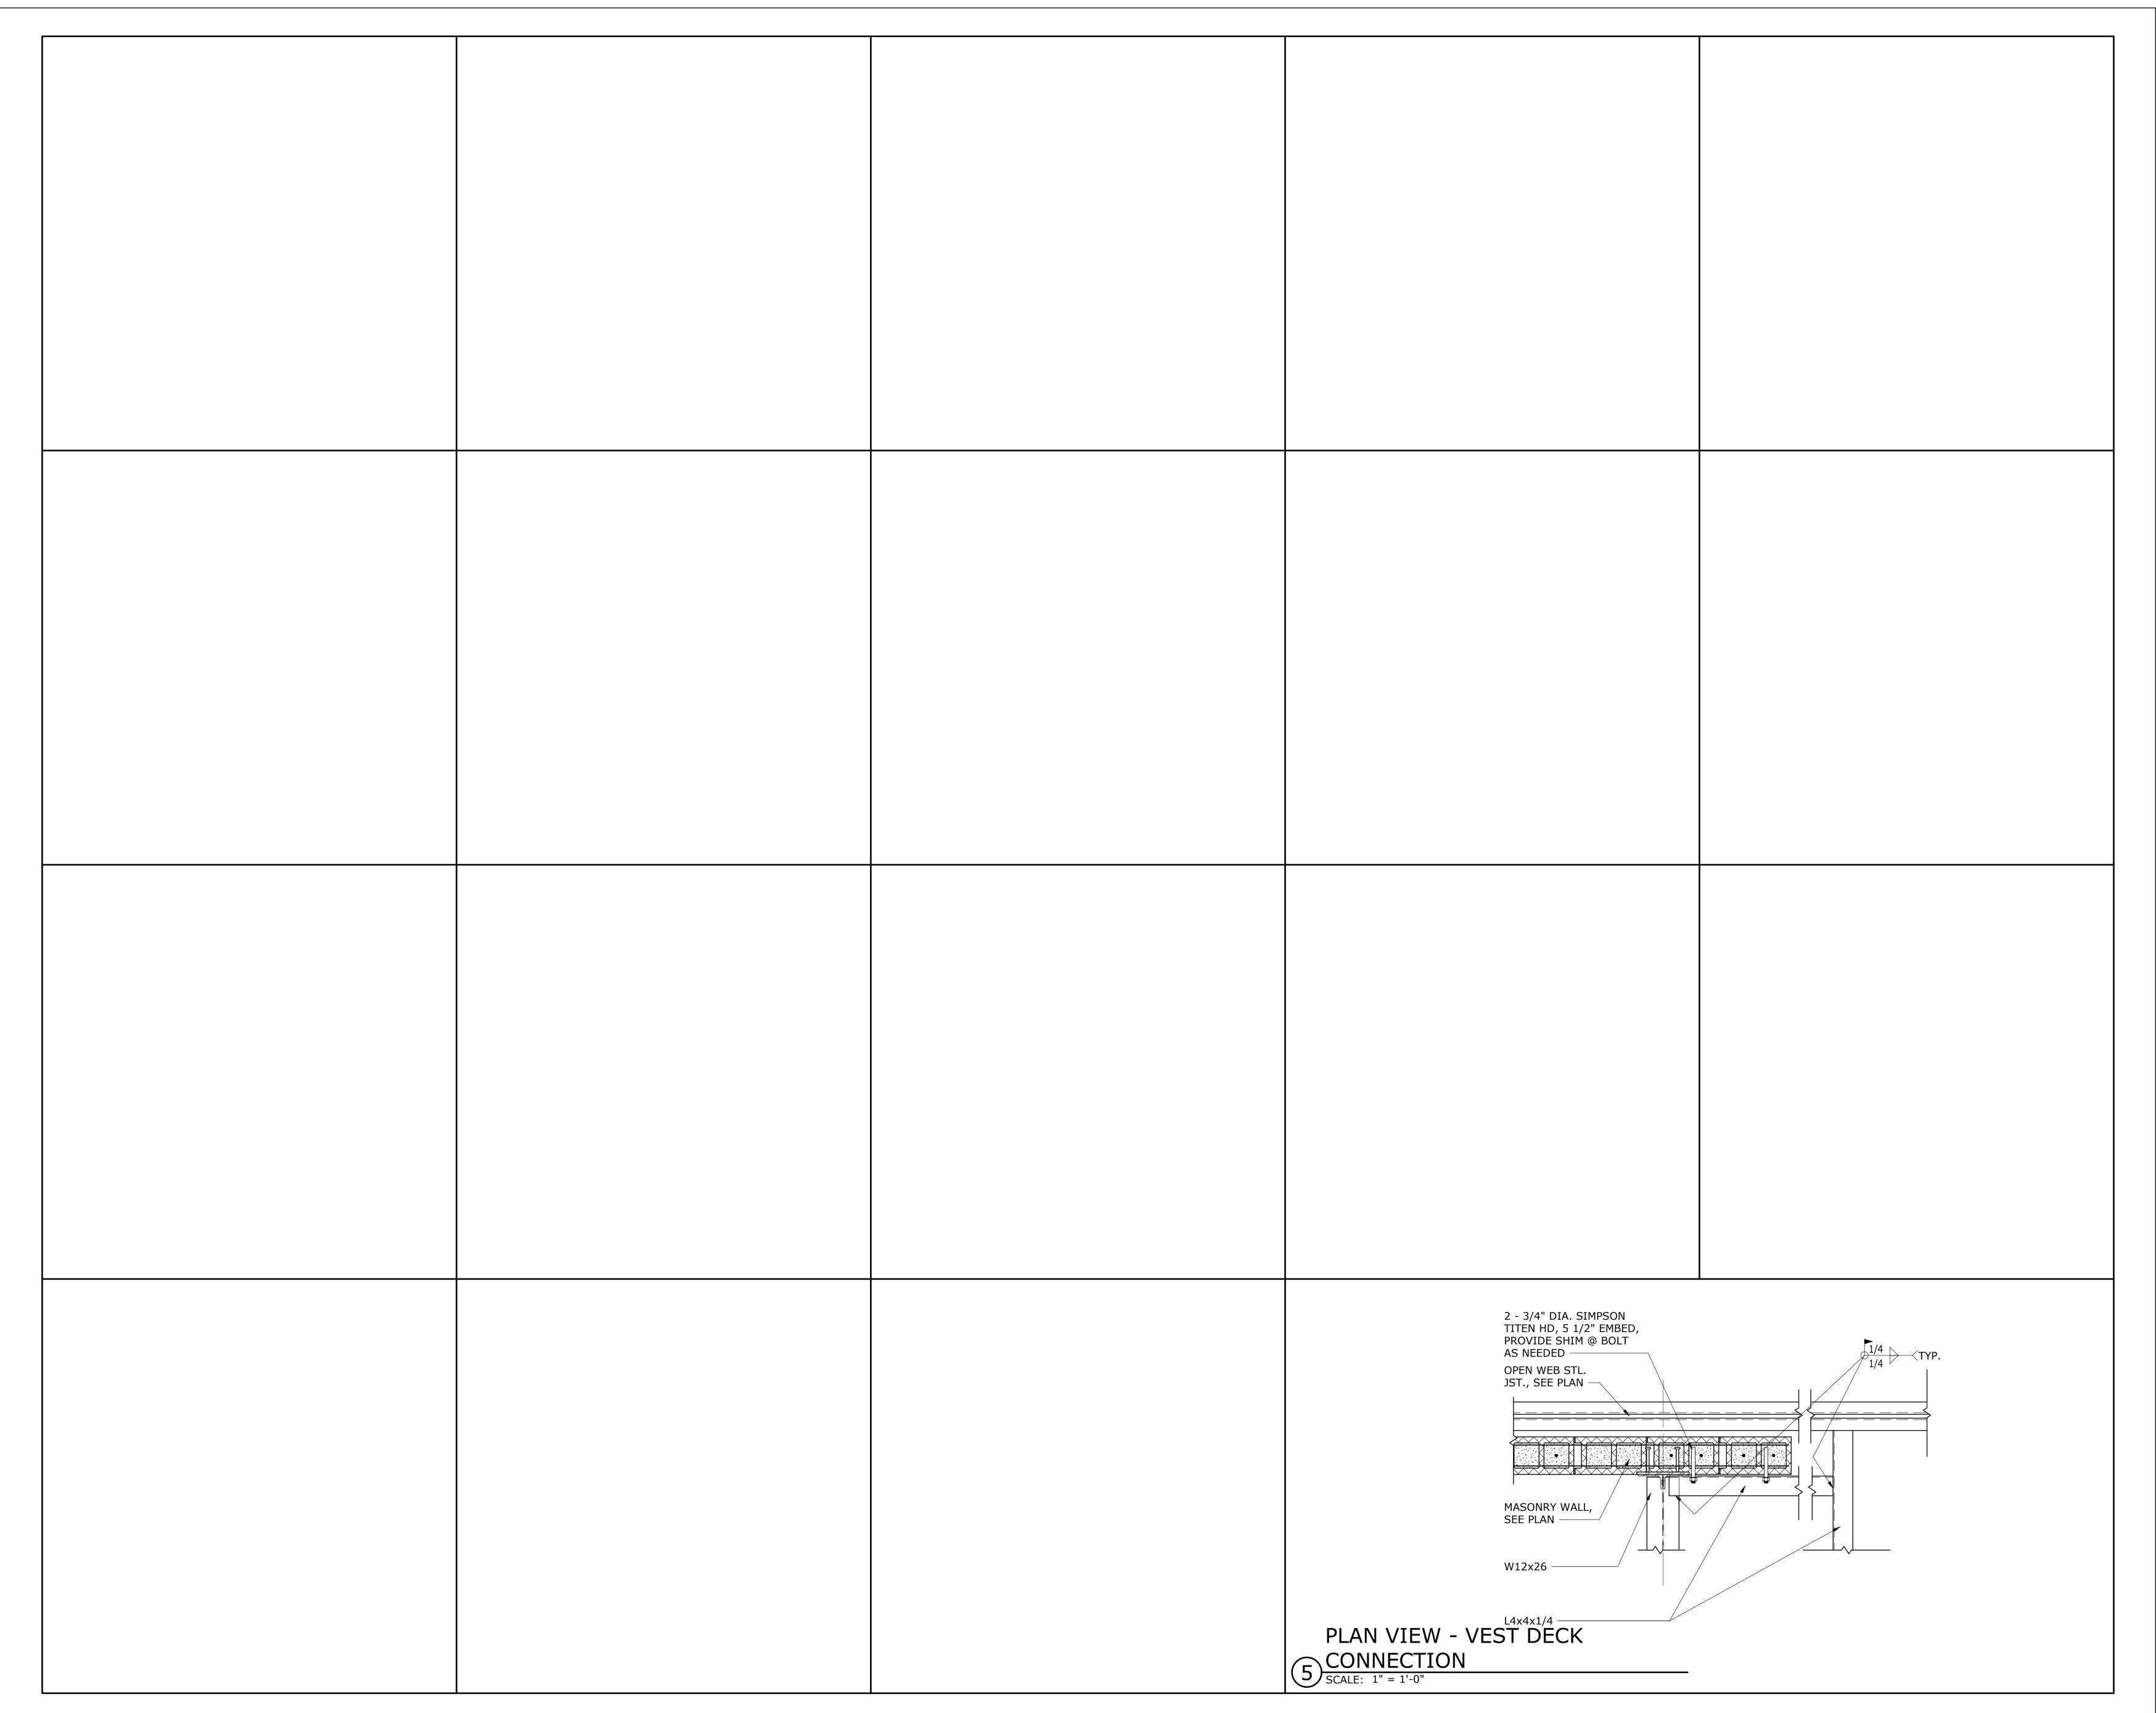



2934 Sidco Drive Architecture
Suite 120 Planning
Nashville, TN 37204 Interior Architecture

bennett@pless
formerly WiSEngineers

Experience Structural Expertise
Atlanta, Boca Raton, Charlotte, Chattanooga,
Knoxville, Nashville, Orlando, Raleigh

1964 - 2024 Celebrating 60
Years of Structural Excellence

565 Marriott Drive, Suite 300
Nashville, Tennessee 37214
Tel 615 782 0100

Copyright 2024 • Bennett & Pless, Inc.
All Rights Reserved
B & P Job Number 24.02.102





TRACTOR SUPPLY COMPANY
HUDSON,
COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action

Job Number:		
Date:		05.10
Revisions:	\triangle	
Revisions:	\triangle	
Revisions:	\triangle	

DETAILS

Sheet Number: S4.3

STRUCTURAL GENERAL NOTES

DESIGN AND CODE INFORMATION

- ALL CONSTRUCTION SHALL CONFORM TO THE INTERNATIONAL BUILDING CODE, 2018 EDITION.
- VERIFY EXISTING CONDITIONS AND ALL DIMENSIONS AND NOTIFY ARCHITECT OF ANY CONDITIONS WHICH CONFLICT WITH OTHER PLANS AND SPECIFICATIONS. STRUCTURAL DRAWINGS MUST BE COORDINATED WITH ARCHITECTURAL DRAWINGS. STRUCTURAL DRAWINGS ARE NOT INTENDED FOR BUILDING LAYOUT.
- SHOP DRAWINGS WILL NOT BE REVIEWED BY THE DESIGNER UNTIL AFTER THE GENERAL CONTRACTOR HAS THOROUGHLY REVIEWED THE SHOP DRAWINGS, VERIFIED EXISTING CONDITIONS, AND COORDINATED THE SHOP DRAWINGS WITH OTHER AFFECTED TRADES SUBMIT FOUR COPIES OF REVIEWED DRAWINGS FOR ENGINEER'S REVIEW. ONLY THREE SETS OF MARKED UP SHOP DRAWINGS SHALL BE RETURNED BY THE DESIGNER. REPRODUCTION OF STRUCTURAL DRAWINGS FOR SHOP DRAWINGS IS NOT PERMITTED.
- THE STRUCTURE IS UNSTABLE UNTIL ALL LOAD BEARING WALLS ARE ERECTED AND STEEL MEMBERS ARE ERECTED, CONNECTIONS ARE COMPLETELY BOLTED AND/OR WELDED AND INSPECTED, THE STEEL DECK ATTACHED TO THE STEEL FRAMING, AND THE CONCRETE FLOORS PLACED AND ATTAINS 75% OF 28-DAY STRENGTH. UNTIL SUCH TIME, TEMPORARY BRACING IS REQUIRED. THE DESIGN ADEQUACY OF TEMPORARY BRACING AND SHORING IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR.
- DO NOT SCALE STRUCTURAL DRAWINGS, AND FOR LOCATION OF MISCELLANEOUS ITEMS (OPENINGS, BENT PLATES, INSERTS, ETC.) AFFECTING STRUCTURAL WORK, SEE ARCHITECTURAL, MECHANICAL, PLUMBING AND ELECTRICAL DRAWINGS.
- RISK CATEGORY: II

LIVE	LOADS:
Λ	FLOODC

Α.	FLOORS:	100 PS
В.	STOCKROOM FLOOR:	250 PS
C.	ROOFS:	20 PSF
	a. UNIFORM LIVE LOAD FOR FUTURE SOLAR:	10 PSF

ROOF LOADS:


NO	OI LUADS.	
Α.	GROUND SNOW LOAD:	30 PSF
В.	SNOW EXPOSURE Ce:	1.0
C.	SNOW IMPORTANCE I:	1.0
_	THE EASTOR	4 0


FLAT ROOF SNOW LOAD: 30 PSF (NON-REDUCIBLE)

_	WIN	ID LOADS:	
•	Α.	BASIC WIND SPEED:	115 MPH (3-SEC GUST)
			•
	В.	IMPORTANCE FACTOR:	I=1.0
	C.	OCCUPANCY CATEGORY:	II
	D.	EXPOSURE CATEGORY:	С
	_	DACE CHEAD.	

BASE SHEAR:			
a.	MAIN BUILDING:	Vx = 84.8 K	
		VY = 82.4 K	

COMPONENTS & CLADDING (WALLS)					
AREA	GCp +/- GCpi				
	10 SF 100 SF 200 SF 500 SF				
NEGATIVE ZONE 4	-1.17	-1.01	-0.96	-0.90	
NEGATIVE ZONE 5	-1.44	-1.12	-1.03	-0.90	
POSITIVE ZONE 4 & 5	1.08 0.92 0.87 0.81				
AREA	SURFACE PRESSURE (PSF)				
	10 SF 100 SF 200 SF 500 SF				
NEGATIVE ZONE 4	-29.5	-25.5	-24.3	-22.7	
NEGATIVE ZONE 5	-36.3	-28.3	-25.9	-22.7	
POSITIVE ZONE 4 & 5	27.3	23.2	22.0	20.4	

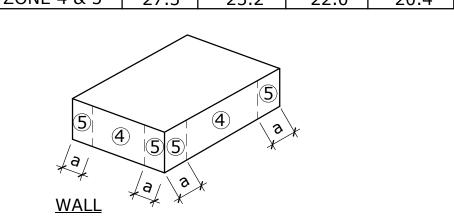

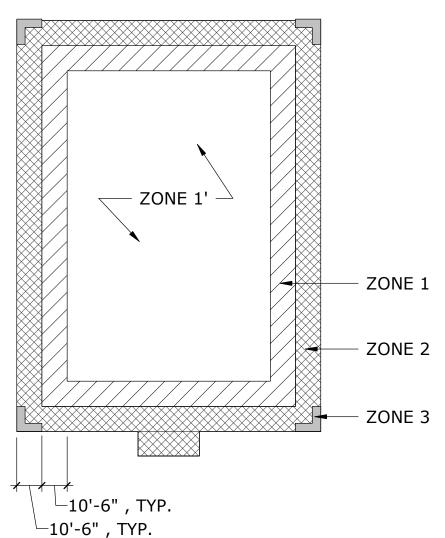

COMPONENTS	S & CLADDING (ROOF)	
AREA SURFACE PRESSURE (PSF		
	100 SF	
NEGATIVE ZONE 1	-37.00	
NEGATIVE ZONE 1'	-27.30	
NEGATIVE ZONE 2	-49.20	
NEGATIVE ZONE 3	-58.60	
POSITIVE ALL ZONES	16.00	

ROOF - NET - WIND UPLIFT **PRESSURES**

BASIC WIND SPEED: 115 MPH (3-SECOND GUST) EXPOSURE CATEGORY: C, Aeff > 100 SF FOR DL OF ROOF, USE 10 PSF "W" IS PROVIDED PER ASCE 7-16

DESIGN AND CODE INFORMATION, CONT.

10.	SEIS	SMIC DESIGN LOADS:		
	Α.	IMPORTANCE FACTOR:	I = 1.0	
	_			

RISK CATEGORY: MAPPED SPECTRAL RESPONSE ACCELERATIONS:

a. Ss = 0.16

S1 = 0.051SITE CLASS: DESIGN SPECTRAL RESPONSE ACCELERATIONS

SDs = 0.171SD1 = 0.082

DESIGN CATEGORY:

BASIC SEISMIC FORCE RESISTING SYSTEM: MAIN BUILDING: INTERMEDIATE REINFORCED MASONRY SHEAR WALLS

DESIGN BASE SHEAR: RESPONSE MODIFICATION FACTOR: R = 3.5

REDUNDANCY FACTOR: P = 1.00.049 RESPONSE COEFFICIENT Cs:

11. FLOOD LOADS (Fa):

A. THE STRUCTURE IS NOT IN A FLOOD ZONE PER FEMA FLOOD INSURANCE RATE MAP (FIRM) COMMUNITY PANEL NUMBER 0801520479F, DATED DECEMBER 2, 2021.

12. THE ROOF FRAMING SYSTEM HAS BEEN DESIGNED WITH THE UNDERSTANDING THAT THE DRAINAGE SYSTEM IS ADEQUATE TO PREVENT PONDING.

SPECIAL INSPECTIONS AND TESTING

THE OWNER SHALL EMPLOY AN INDEPENDENT TESTING COMPANY TO PERFORM THE ON SITE INSPECTIONS AND TESTING AS INDICATED ON SHEETS S5.2 & S5.3.

STRUCTURAL OBSERVATIONS

THE CONTRACTOR/OWNER SHALL EMPLOY A LICENSED STRUCTURAL ENGINEER OR ARCHITECT TO PERFORM PERIODIC VISUAL OBSERVATIONS OF THE STRUCTURE DURING CONSTRUCTION FOR GENERAL CONFORMANCE TO THE DESIGN DRAWINGS.

FOUNDATION NOTES

- FOUNDATION DESIGN IS BASED ON A REPORT PROVIDED BY CTL THOMPSON DATED NOVEMBER 1 2023 (REPORT NUMBER DN52, 053-115-R1).
- THE CONTINUOUS AND ISOLATED FOOTINGS ARE DESIGNED TO BEAR ON AGGREGATE PUERS CAPABLE OF SUPPORTING 2,000 PSF. UNDERCUT AND ENGINEERED FILL WILL BE REQUIRED FOR FOOTINGS AND SLAB ON GROUND PER GEOTECHNICAL REPORT. THE BOTTOM OF ALL EXTERIOR FOOTINGS SHALL BE 40" MINIMUM BELOW FINISHED GRADE. DESIGN ASSUMES DIFFERENTIAL AND TOTAL SETTLEMENT ARE WITHIN ACCEPTED TOLERANCES FOR THE TYPE OF CONSTRUCTION USED.
- WHERE FOOTING EXCAVATIONS ARE TO REMAIN OPEN AND MAY BE EXPOSED TO RAINFALL, THE EXCAVATIONS SHALL BE UNDERCUT AND A 3 INCH THICK MUD MAT OF 2000 PSI CONCRETE SHALL BE PLACED IN THE BOTTOM TO PROTECT THE BEARING SOILS.
- WHERE FOOTING STEPS ARE NECESSARY, THEY SHALL BE NO STEEPER THAN 1 VERTICAL TO 2 HORIZONTAL, UNLESS SHOWN OTHERWISE ON PLANS.

DELEGATED DESIGN

- THE FOLLOWING ELEMENTS SHALL BE CONSIDERED DELEGATED DESIGN AND SHALL REQUIRE SIGNED AND SEALED SHOP DRAWINGS AND CALCULATIONS PREPARED BY A PROFESSIONAL ENGINEER LICENSED IN THE PROJECT STATE.
- PRE-ENGINEERED METAL BUILDING
- PRE-ENGINEERED TRUSSES
- STOREFRONT OPENING SYSTEMS. LIVE GOODS FOUNDATION AND FRAMING
- AGGREGATE PIER FOUNDATION SUPPORT.

STRUCTURAL SUBMITTALS

- CONCRETE MIX DESIGNS
- CONCRETE REINFORCING FOR ALL FOUNDATION COMPONENTS CONCRETE MASONRY UNIT (CMU) REINFORCING FOR ALL MASONRY PORTIONS OF THE WORK.
- CONCRETE MASONRY UNIT (CMU) AND ACCESSORY PRODUCT DATA INCLUDING:
- COMPOSITION AND LEGACY TESTING DATA FOR CMU COMPOSITION AND LEGACY TESTING DATA FOR MORTAR
- COMPOSITION AND LEGACY TESTING DATA FOR GROUT
- LADDER-TYPE JOINT REINFORCING
- JOINT AND JOINT COVER MATERIAL 5. STRUCTURAL STEEL COLUMNS, BASE PLATES, CAP PLATES, SHEAR PLATES, CONNECTIONS BETWEEN / AMONG ALL STRUCTURAL STEEL MEMBERS.
- STRUCTURAL STEEL JOIST AND DECK, INCLUDING LAYOUT, COMPOSITION, AND CONNECTIONS COLD FORMED STEEL (CFS) PRE-ENGINEERED TRUSSES: MATERIALS
 - DESIGN DRAWINGS, STAMPED BY THE TRUSS DESIGNER, LICENSED IN THE PROJECT
- NON-LOAD BEARING COLD FORMED STEEL (CFS) PRE-ENGINEERED STUDS AND JOISTS.

REINFORCED CONCRETE

- ALL CONCRETE WORK SHALL CONFORM TO THE "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE," ACI 318-05.
- REINFORCING STEEL SHALL BE DEFORMED BARS ASTM A-615 (GRADE 60).
- THE COMPRESSIVE STRENGTH AT 28 DAYS OF ALL CAST IN PLACE CONCRETE SHALL BE 4000 PSI USING TYPE II, PORTLAND CEMENT. SEE CIVIL DRAWINGS FOR SITE CONCRETE FOUNDATION CONCRETE SHALL HAVE A 28-DAY COMPRESSIVE STRENGTH OF 4,000 PSI.
- LAP SPLICES FOR REINFORCING BARS SHALL BE CLASS B IN ACCORDANCE WITH ACI 318-05, UNLESS NOTED OTHERWISE.
- CLEAR CONCRETE COVER FOR REINFORCING STEEL: A. WALLS 2" EXTERIOR FACES
- 3/4" INTERIOR FACES MASONRY WALLS LOCATE IN CENTER OF WALL (U.N.O.) SLAB ON GRADE 3/4" TOP STEEL 1 1/2" BOTTOM STEEL
- D. FOOTINGS 2" FORMED EDGES
- 6. THE LONGITUDINAL REINFORCING STEEL IN BOND BEAMS, WALLS, AND FOOTINGS SHALL BE CONTINUOUS AROUND CORNERS. SEE TYPICAL DETAILS.
- MECHANICAL VIBRATORS SHALL VIBRATE ALL CONCRETE.
- UNLESS OTHERWISE DIRECTED BY THE OWNER, CONCRETE SLABS SHALL BE FINISHED TO THE FLATNESS CRITERIA NOTED IN THE CONCRETE SPECIFICATIONS ON SHEET S5.4, UNDER SECTION 3.04 - "CONCRETE FLOOR FINISHES AND TOLERANCES"
- 9. CONCRETE TESTING REPORTS SHALL BE KEPT ON FILE AT THE JOB SITE.

STRUCTURAL STEEL

- ALL STRUCTURAL STEEL WORK SHALL CONFORM TO THE ANSI/AISC SIXTEENTH EDITION, SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS.
- 2. STRUCTURAL STEEL ROLLED SHAPES SHALL BE ASTM A-992 GRADE 50 UNLESS NOTED OTHERWISE. STRUCTURAL STEEL PLATES AND ANGLES SHALL BE ASTM A-36.
- STRUCTURAL PIPE COLUMNS SHALL BE ASTM A500 ROUND, TYPE E OR S, GRADE C. STRUCTURAL TUBES SHALL BE ASTM A500, GRADE C.
- NON-SHRINK GROUT FOR PLACEMENT BELOW ALL STRUCTURAL STEEL BASE PLATES SHALL BE NON-SHRINK GROUT PROVIDED SPECIFICALLY FOR USE BELOW STRUCTURAL STEEL BASE PLATES AND ACHIEVE A COMPRESSIVE STRENGTH OF 10,000 PSI AT 28 DAYS. GROUT BELOW BASE PLATES SHALL CONFORM TO ASTM C-109.
- FRAMED BEAM CONNECTIONS SHALL DE DESIGNED BY A QUALIFIED PROFESSIONAL ENGINEER EMPLOYED BY THE FABRICATOR TO DEVELOP THE BEAM REACTIONS SHOWN ON STRUCTURAL PLANS. IN NO CASE SHALL THE LENGTH OF THE FRAMED CONNECTION BE LESS THAN 1/2 THE "T" DIMENSION OF THE BEAM WEB. WHERE REACTIONS ARE NOT SHOWN, THE BEAM END CONNECTIONS SHALL DEVELOP ONE HALF THE MAXIMUM ALLOWABLE UNIFORM LOAD FOR THE BEAM ASSUMING THE BEAM IS CONTINUOUSLY SUPPORTED LATERALLY.
- STEEL FRAMING CONNECTIONS SHALL BE BOLTED OR WELDED. BOLTS SHALL BE 3/4 INCH DIAMETER MINIMUM AND SHALL BE ASTM A-325-N, UNLESS NOTED OTHERWISE.
- 7. USE CALIBRATED WRENCHES OR DIRECT TENSION INDICATORS AND HARDENED WASHERS WITH ALL HIGH STRENGTH BOLTS OR USE LOAD INDICATOR BOLTS.
- STEEL JOISTS SHALL BE CAMBERED PER STEEL JOIST INSTITUTE SPECIFICATIONS. STEEL JOIST SHALL ALSO BE DESIGNED TO RESIST THE NEW WIND UPLIFT LOADS INDICATED ON UPLIFT PRESSURES DIAGRAM, THIS SHEET. FOR UPLIFT CALCULATIONS, DEAD LOAD OF ROOFING SYSTEM AND STEEL DECK IS ASSUMED TO BE 10 PSF.
- METAL DECK SHALL BE INSTALLED IN ACCORDANCE WITH THE STEEL DECK INSTITUTE SPECIFICATIONS, LATEST EDITION.
- 10. WELD WASHERS SHALL BE USED WITH METAL DECK THINNER THAN 22 GAUGE.
- 11. ANCHOR BOLTS SHALL BE F1554, GR 55 SUPPLEMENT 1 (WELDABLE) HEADED BOLTS. MINIMUM ANCHOR BOLT EMBEDMENT SHALL BE 12 BOLT DIAMETERS UNLESS NOTED OTHERWISE. CLEAN ANCHOR BOLTS OF ALL GREASE, DIRT, ETC., BEFORE INSTALLATION.
- 12. FRAMED BEAM CONNECTIONS SHALL DEVELOP ONE HALF OF THE ALLOWABLE UNIFORM LOAD FOR LATERALLY SUPPORTED BEAMS AS SHOWN IN PART 2 OF THE AISC MANUAL. IN NO CASE SHALL THE LENGTH OF THE CONNECTION BE LESS THAN THE "T" DIMENSION.
- 13. WELDS SHOWN ON THE STRUCTURAL DRAWINGS ARE THE MINIMUM REQUIRED BY DESIGN. THE FABRICATOR'S DRAWINGS SHALL SHOW WELDS AND THEY SHALL CONFORM TO AWS D1.1 STRUCTURAL WELDING CODE BY THE AMERICAN WELDING SOCIETY. ALL WELDING SHALL BE DONE WITH E-70 SERIES ELECTRODES.
- 14. HARDENED WASHERS SHALL BE INSTALLED OVER SHORT SLOTTED OR OVERSIZE HOLES OCCURRING IN AN OUTER PLY OF A CONNECTION.
- 15. THE STEEL JOIST & JOIST GIRDER MANUFACTURER SHALL DESIGN THE JOISTS & JOIST GIRDERS FOR A NET UPLIFT FORCE AS SHOWN ON THE UPLIFT DIAGRAM ON THIS SHEET, AND SHALL FURNISH THE NECESSARY FRAMING TO ENSURE PROPER JOIST & JOIST GIRDER PERFORMANCE UNDER UPLIFT DUE TO WIND AS WELL AS GRAVITY LOADING CONDITIONS.
- 16. PROVIDE SPECIAL JOIST SEATS WHERE REQUIRED BY NARROW BEARING CONDITIONS.
- 17. PAINT ALL STRUCTURAL STEEL WITH ONE COAT OF RUST-INHIBITIVE PRIMER 2.5 MILS IN THICKNESS THE COMPATIBILITY OF PRIMER AND ANY TOP COAT SHALL BE VERIFIED BEFORE ANY PAINTING IS PERFORMED. TOUCH-UP ALL EXPOSED METAL AFTER FIELD INSTALLATION. ALL STRUCTURAL STEEL WHICH IS EXPOSED TO THE ELEMENTS SHALL RECEIVE TWO COATS OF EXTERIOR ENAMEL WHICH IS COMPATIBLE WITH THE PRIMED SURFACE.
- 18. STRUCTURAL STEEL SHOP DRAWINGS SHALL INCLUDE COMPLETE DETAILS, CONNECTIONS, AND SCHEDULES FOR FABRICATION AND ASSEMBLY OF STRUCTURAL STEEL MEMBERS. STRUCTURAL STEEL SHOP DRAWINGS SHALL NOT INCLUDE MISCELLANEOUS STEEL. SHOP DRAWINGS WILL NOT BE REVIEWED BY THE DESIGNER UNTIL AFTER THE GENERAL CONTRACTOR HAS THOROUGHLY REVIEWED THE SHOP DRAWINGS, AND COORDINATED THE SHOP DRAWINGS WITH OTHER AFFECTED TRADES. ONLY THREE SETS OF MARKED UP SHOP DRAWINGS SHALL BE RETURNED BY THE DESIGNER. REPRODUCTION OF STRUCTURAL DRAWINGS FOR SHOP DRAWINGS IS NOT PERMITTED.
- 19. STEEL JOISTS AND JOIST GIRDER SHOP DRAWINGS SHALL BEAR THE SEAL AND SIGNATURE OF A REGISTERED ENGINEER IN THE PROJECT STATE CONFIRMING THE DESIGN OF JOISTS AND JOIST GIRDERS TO SJI SPECIFICATIONS AND FOR ALL LOADINGS SPECIFIED ON THE DRAWINGS. STEEL JOISTS SHOP DRAWINGS SHALL BE REVIEWED BY THE STRUCTURAL STEEL SUBCONTRACTOR PRIOR TO ENGINEER'S REVIEW.

OXFORD

ARCHITECTURE

Architecture

Interior Architecture

2934 Sidco Drive Suite 120


Nashville, TN 37204

Atlanta, Boca Raton, Charlotte, Chattanooga Knoxville, Nashville, Orlando, Raleigh 1964 - 2024 Celebrating 60 Years of Structural Excellence

> 565 Marriott Drive, Suite 300 Nashville, Tennessee 37214

Tel 615 782 0100 Copyright 2024 • Bennett & Pless, Inc. All Rights Reserved **B & P Job Number** 24.02.102





TRACTOR SUPPLY COMPANY HUDSON,

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action

05.10.2024

S5.0

Job Number:

Revisions:

Revisions: STRUCTURAL GENERAL NOTES

Revisions

STRUCTURAL GENERAL NOTES, CONT.

POST INSTALLED ANCHORS IN CONCRETE, CONCRETE MASONRY, AND ADHESIVE ANCHOR REINFORCING

- POST-INSTALLED ANCHORS AND ADHESIVE ANCHORED REINFORCING STEEL SHALL ONLY BE USED WHERE SPECIFIED ON THE CONSTRUCTION DOCUMENTS. THE GENERAL CONTRACTOR SHALL OBTAIN APPROVAL FROM THE STRUCTURAL ENGINEER OF RECORD PRIOR TO USING POST INSTALLED ANCHORS FOR MISSING OR MISPLACED CAST-IN-PLACE ANCHORS. CARE SHALL BE GIVEN TO AVOID CONFLICTS WITH EXISTING REINFORCING. HOLES SHALL BE DRILLED AND CLEANED PER THE MANUFACTURER'S PRINTED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S PRINTED INSTALLATION INSTRUCTIONS.
- 2. ALL POST INSTALLED ANCHORS AND ADHESIVES SHALL HAVE VALID AND CURRENT ICC-ESR REPORTS.
- SUBSTITUTION REQUESTS, FOR PRODUCTS OTHER THAN THOSE SPECIFIED, SHALL BE SUBMITTED TO THE ARCHITECT AND STRUCTURAL ENGINEER OF RECORD WITH CALCULATIONS THAT ARE PREPARED AND SEALED BY A REGISTERED DESIGN PROFESSIONAL IN THE STATE IN WHICH THE PROJECT IS LOCATED SHOWING THAT THE SUBSTITUTED PRODUCT WILL ACHIEVE AN EQUIVALENT CAPACITY USING THE APPROPRIATE DESIGN PROCEDURE REQUIRED BY THE REFERENCED BUILDING CODE.
- MECHANICAL ANCHORS FOR CONCRETE AS SHOWN ON THE CONSTRUCTION DOCUMENTS SHALL BE PROVIDED AS SPECIFIED WITHIN THE CONTRACT DOCUMENTS.
- IN ADDITION TO THE MANUFACTURER'S PRINTED INSTALLATION INSTRUCTIONS, THE FOLLOWING GUIDELINES SHALL BE FOLLOWED FOR INSTALLATION OF ADHESIVE ANCHORS:
- ADHESIVE ANCHORS SHALL BE INSTALLED IN CONCRETE HAVING A MINIMUM AGE OF 21 DAYS AT TIME
- OF ANCHOR INSTALLATION.
- ADHESIVE ANCHORS SHALL BE INSTALLED IN DRY CONCRETE, AND DURING DRY CONDITIONS. ADHESIVE ANCHORS SHALL BE INSTALLED IN HOLES PREDRILLED WITH A CARBIDE TIPPED DRILL BIT.
- ADHESIVE ANCHORS SHALL BE INSTALLED WITHIN THE TEMPERATURE RANGE SPECIFIED IN THE MANUFACTURER'S PRINTED INSTALLATION INSTRUCTIONS, BUT NOT OUTSIDE OF THE DESIGN TEMPERATURE RANGE. (ADHESIVE ANCHOR DESIGN TEMPERATURE RANGE IS 75 DEGREES FAHRENHEIT (LONG TERM) AND 104 DEGREES FAHRENHEIT (SHORT TERM)) LOADS SHALL NOT BE APPLIED TO ADHESIVE ANCHORS UNTIL THE FULL CURING TIME ASSOCIATED WITH THE INSTALLATION TEMPERATURE HAS ELAPSED.
- INSTALLATION OF ADHESIVE ANCHORS SHALL BE PERFORMED BY PERSONNEL CERTIFIED BY AN APPLICABLE CERTIFICATION PROGRAM. CERTIFICATION SHALL INCLUDE WRITTEN AND PERFORMANCE TESTS IN ACCORDANCE WITH THE ACI/CRSI ADHESIVE ANCHORS INSTALLER CERTIFICATION PROGRAM, OR EQUIVALENT.
- CONTINUOUS SPECIAL INSPECTIONS SHALL BE PROVIDED FOR POST-INSTALLED ANCHORS IN ACCORDANCE WITH THE ANCHOR MPII AND/OR EVALUATION REPORT, UNLESS MORE SPECIFIC REQUIREMENTS ARE SPECIFIED IN THE CONSTRUCTION DOCUMENTS.

CONCRETE MASONRY

- CONCRETE MASONRY SHALL CONFORM TO NATIONAL CONCRETE MSONRY ASSOCIATION SPECIFICATIONS FOR MASONRY STRUCTURES," AND SHALL HAVE A MINIMUM PRISM STRENGTH (F'M) OF 2,000 PSI.
- MASONRY WALL CONTROL JOINTS SHALL BE LOCATED AS SHOWN ON THE ARCHITECTURAL DRAWINGS.
- MASONRY UNITS SHALL CONFORM WITH ASTM C90 "STANDARD SPECIFICATIONS FOR LOADBEARING CONCRETE MASONRY UNITS" AND HAVE MINIMUM AVERAGE NET-AREA COMPRESSIVE STRENGTH OF 2150 PSI. MASONRY UNITS SHALL HAVE AN AVERAGE DENSITY WITHIN THE RANGE OF 105 TO 125 POUNDS PER CUBIC
- GROUT FOR FILLING CONCRETE MASONRY CELLS SHALL CONFORM TO ASTM C476-09, "STANDARD SPECIFICATION FOR GROUT FOR MASONRY," AND SHALL HAVE A COMPRESSIVE PRISM STRENGTH (F'M) OF 3000 PSI AT 28 DAYS. THE SLUMP SHALL BE BETWEEN 9 INCHES AND 11 INCHES. WHERE THE MINIMUM DIMENSION OF ANY CONTINUOUS VERTICAL CELL IS 3 INCHES OR LESS, USE FINE GROUT. OTHERWISE, USE COARSE (PEA GRAVEL) GROUT.
- MORTAR FOR CONCRETE MASONRY SHALL BE TYPE "S" AND SHALL CONFORM TO ASTM C270-08, "SPECIFICATION FOR MORTAR FOR UNIT MASONRY" AND HAVE A MINIMUM COMPRESSIVE STRENGTH OF 1800
- MASONRY CONSTRUCTION SHALL BE BUILT IN LIFTS NOT TO EXCEED 4 FEET PRIOR TO GROUTING CORES.

KEY NEXT GROUT LIFT INTO PRIOR LIFT BY STOPPING FIRST LIFT 2" BELOW TOP OF BLOCK.

- 7. ALL REINFORCING BARS IN FILLED CELLS SHALL BE DOWELED INTO FOOTINGS WITH STANDARD 90-DEGREE HOOKS AND DOWELED 7 INCHES INTO BOND BEAMS AT TOP OF WALLS.
- REINFORCEMENT IN WALLS SHALL BE PLACED IN THE CENTER OF THE WALL UNLESS NOTED OTHERWISE. SEE PLANS FOR REINFORCING.
- MASONRY LAP SPLICES: SEE TABLE BELOW.

CONCRETE MASONRY REINFORCING LAP LENGTH SCHEDULE			MINIMUM BEND DIAMETERS
BAR SIZE 8" WALL 12" WALL		MIN. DIA. 6d	
#3	16"	16"	NOTE:
#4	21"	21"	1. d= BAR DIAMETER. BARS REQUIRED TO BE FIELD
#5	26"	26"	BENT SHALL BE BENT COLD TO THE MINIMUM DIAMETER
#6	43"	40"	SPECIFIED. FIELD BENDING IN EXCESS OF A 90 DEGREE
#7	60"	46"	BEND IS PROHIBITED.

*WHERE DROPPED WEB MASONRY IS INDICATED, MASONRY BOND BEAMS WITH U-NOTCHES OR BOTTOMS REMOVED FOR PASSAGE OF GROUT & REINFORCING MAY BE SUBSTITUTED. WHERE DROPPED WEB MASONRY IS USED, PROVIDE ACI APPROVED SCREENING/GROUT RETENTION MATERIAL TO ENSURE STOPPAGE OF GROUT TO CELLS BELOW WHERE LIMIT OF GROUTED CELLS ARE INDICATED.

PRE-ENGINEERED COLD FORMED STEEL TRUSSES

- 1. ROOF TRUSSES SHALL BE DESIGNED TO SUPPORT THE FOLLOWING LOADS: DEAD LOAD - 17 PSF LIVE LOAD - 20 PSF SNOW LOAD - 47 PSF A. TOP CHORD: B. BOTTOM CHORD: DEAD LOAD - 8 PSF
- 2. IN ADDITION TO UNIFORM LOADING SPECIFIED FOR TRUSS DESIGN, THE TRUSS SUPPLIER SHALL INCLUDE ANY CONCENTRATED LOADS CAUSED BY ARCHITECTURAL FEATURES OR MECHANICAL EQUIPMENT IN THE TRUSS DESIGN.
- SEE ARCHITECTURAL DRAWINGS FOR TRUSS PROFILES, DIMENSIONS AND BEARING CONDITIONS.
- A REGISTERED ENGINEER IN THE PROJECT STATE SHALL DESIGN THE TRUSSES AND THEIR CONNECTIONS TO THE SUPPORTING STRUCTURES. SHOP DRAWINGS, INCLUDING TRUSS DESIGN AND LAYOUT, BEARING THE ENGINEER'S SEAL AND SIGNATURE, SHALL BE SUBMITTED FOR REVIEW.
- TRUSSES SHALL BE DESIGNED, FABRICATED, AND ERECTED IN ACCORDANCE WITH APPLICABLE STANDARDS OF THE AMERICAN IRON AND STEEL INSTITUTE "SPECIFICATIONS FOR THE DESIGN OF COLD FORMED STEEL STRUCTURAL MEMBERS" AND "DESIGN OF COLD-FORMED STEEL TRUSSES" AND THE LIGHT GAGE STEEL TRUSS ENGINEER'S ASSOCIATION "FIELD INSTALLATION GUIDE FOR COLD-FORMED STEEL TRUSSES".

COLD FORMED STUDS (CFS)

- ALL WORK SHALL CONFORM WITH THE FOLLOWING STANDARDS:
- AISI-2001 WITH 2004 SUPPLEMENT, "NORTH AMERICAN SPECIFICATION FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL MEMBERS."
- AISI S202-2001 WTIH 2004 SUPPLEMENT, "CODE OF STANDARD PRACTICE FOR COLD-FORMED STEEL FRAMING."
- AISI S220-2001 WTIH 2004 SUPPLEMENT, "NORTH AMERICAN STANDARD FOR COLD-
- FORMED STEEL FRAMING NON-STRUCTURAL MEMBERS" AISI S240-2001 WTIH 2004 SUPPLEMENT, "NORTH AMERICAN STANDARD FOR COLD-
- FORMED STEEL STRUCTURAL FRAMING."
- AISI S400-2001 WTIH 2004 SUPPLEMENT, "NORTH AMERICAN STANDARD FOR SEISMIC DESIGN OF COLD-FORMED STEEL STRUCTURAL SYSTEMS.
- COMPONENTS SHALL BE MADE OF COLD FORMED STEEL COMPLYING WITH ASTM A1003/A1003M WITH A GALVANIZED COATING. COATING SHALL BE G60 COATING WEIGHT MINIMUM, COMPLYING WITH ASTM C955. MINIMUM YIELD STRENGTH SHALL BE AS FOLLOWS: 33 KSI FOR 43 MIL (19 GAUGE) AND LIGHTER; 50 KSI FOR 5 MIL (16 GAUGE)
- COMPONENT SECTION PROPERTIES INCLUDING, BUT NOT LIMITED TO, AREA (A), MOMENT OF INERTIA (Ix AND Iy) AND RADIUS OF GYRATION (Rx, Ry) SHALL MEET OR EXCEED PUBLISHED VALUES BY CLARKDIETRICH BUILDING SYSTEMS FOR MEMBER SIZES INDICATED.
- PROVIDE FRAMING ACCESSORIES THAT MEET OR EXCEED BASIS OF DESIGN PRODUCTS BY CLARKDIETRICH BUILDING SYSTEMS. THESE PRODUCTS MAY INCLUDE BUT ARE NOT LIMITED TO:
- SUPPLEMENTARY FRAMING.
- BRACING, BRIDGING, AND SOLID BLOCKING.
- ANCHOR CLIPS. END CLIPS.
- FOUNDATION CLIPS.
- GUSSET PLATES.
- STUD KICKERS AND KNEE BRACES.
- JOIST HANGERS AND END CLOSURES.
- HOLE REINFORCING PLATES.
- BACKER PLATES.
- OTHER CONNECTORS FROM SIMPSON STRONG-TIE COMPANY MAY BE SPECIFIED ON THE
- SCREWS SHALL BE SELF-DRILLING, SELF-TAPPING STEEL SCREWS COMPLYING WITH ASTM C1513. GALVANIZED, PLATED OR OIL-PHOSPHATE COATING SHALL COMPLY WITH ASTM B633 AND BE PROVIDED AS NEEDED FOR REQUIRED CORROSION RESISTANCE.
- WELDING IS PERMITTED ON 18 GAUGE OR HEAVIER MATERIAL ONLY. QUALITY WELDING OPERATORS SHALL BE QUALIFIED IN ACCORDANCE WITH AWS D1.3-2008, "STRUCTURAL WELDING CODE—SHEET METAL." TOUCH UP ALL WELDS WITH ZINC RICH PAINT IN COMPLIANCE WITH ASTM A780.
- 8. THE JOIST ENDS SHALL BE REINFORCED TO ADEQUATELY STIFFEN THE JOIST WEB AND TRANSFER LOADS TO THE SUPPORTS. MINIMUM END BEARING SHALL BE 1 1/2 INCHES.
- STUDS SHALL SIT SQUARELY IN THE TOP AND BOTTOM RUNNER TRACK WITH FIRM ABUTMENT AGAINST TRACK WEBS. STUDS SHALL BE ALIGNED OR PLUMBED AND SECURELY FASTENED TO THE FLANGES OF BOTH TOP AND BOTTOM RUNNER TRACK. STUDS SHALL BE POSITIONED IN THE RUNNER TRACK SO AS TO BE ALIGNED DIRECTLY BELOW FLOOR ROOF OR CEILING FRAMING MEMBERS OVERHEAD. IF UNABLE TO CENTER AND DIRECTLY TRANSFER LOADS FROM FLOOR OR ROOF FRAMING (SUCH AS AT OPENINGS) TO THE STUDS, LINTELS SHALL BE PROVIDED.
- 10. JOINING OF FRAMING MEMBERS SHALL BE MADE WITH SELF-DRILLING SCREWS OR WELDING. WIRE TYING OF FRAMING MEMBERS IN STRUCTURAL APPLICATIONS SHALL NOT BE PERMITTED.
- 11. SPLICES IN STEEL JOISTS OR STUDS SHALL NOT BE PERMITTED.
- 12. DURING ERECTION, THE CONTRACTOR SHALL PROVIDE MEANS OF ADEQUATE DISTRIBUTION OF CONCENTRATED LOADS SO THAT THE LOAD CARRYING CAPACITYOF ANY STEEL MEMBER IS NOT EXCEEDED.
- 13. PERFORMANCE REQUIREMENTS
 - A. CALCULATE STRUCTURAL PROPERTIES PER AISI SPECIFICATIONS FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL MEMBERS, 2007.
- 14. SUBMITTALS
 - SUBMIT DOCUMENTATION.
 - PRODUCT DATA: MANUFACTURER'S DATA SHEETS ON EACH PRODUCT TO BE USED,
 - a. PREPARATION INSTRUCTIONS AND RECOMMENDATIONS.
 - STORAGE AND HANDLING REQUIREMENTS AND RECOMMENDATIONS.
 - INSTALLATION METHODS. STRUCTURAL CALCULATIONS:
 - a. ALL SHOP DRAWING SUBMITTALS SHALL BE SEALED BY A PROFESSIONAL ENGINEER REGISTERED IN THE PROVINCE OF THE PROJECT LOCATION. ENGINEER SHALL HAVE A MINIMUM OF 5 YEARS EXPERIENCE WITH PROJECTS OF SIMILAR SCOPE.
 - b. DESCRIPTION OF DESIGN CRITERIA.
 - c. SELECTION OF FRAMING COMPONENTS, ACCESSORIES AND WELDED
 - CONNECTION REQUIREMENTS.
 - d. VERIFICATION OF ATTACHMENTS TO STRUCTURE AND ADJACENT FRAMING COMPONENTS.

ABBREVIATIONS		
ARCH	ARCHITECT, ARCHITECTURAL	
BRG	BEARING	
C/L	CENTERLINE	
CFS	COLD FORMED STEEL	
CMU	CONCRETE MASONRY UNIT	
CONC	CONCRETE	
CONT	CONTINUOUS	
DIA	DIAMETER	
DWGS	DRAWINGS	
EL	ELEVATION	
FDN	FOUNDATION	
FFE	FINISHED FLOOR ELEVATION	
FTG	FOOTING	
FV	FIELD VERIFY	
INFO	INFORMATION	
JST	JOIST	
PEMB	PRE-ENGINEERED METAL BUILDING	
PL	PLATE	
REINF	REINFORCING	
RTU	ROOF TOP UNIT	
SHT	SHEET	
SPC	SPACING	
UNO	UNLESS NOTED OTHERWISE	
&	AND	
	'	



Architecture

2934 Sidco Drive Suite 120 Nashville, TN 37204 Interior Architecture

Atlanta, Boca Raton, Charlotte, Chattanooga

Knoxville, Nashville, Orlando, Raleigh

1964 - 2024 Celebrating 60 Years of Structural Excellence 565 Marriott Drive, Suite 300 Nashville. Tennessee 37214 Tel 615 782 0100

Copyright 2024 • Bennett & Pless, Inc. All Rights Reserved **B & P Job Number** 24.02.102





TRACTOR SUPPLY COMPANY HUDSON,

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action

05.10.2024

Job Number:

Revisions:

Revisions: STRUCTURAL GENERAL NOTES,

QUALITY ASSURANCE PLAN / PROPSED STATEMENT OF SPECIAL INSPECTION

STRUCTURAL SPECIAL INSPECTION STATEMENT

THIS STATEMENT OF SPECIAL INSPECTIONS IS SUBMITTED AS A CONDITION FOR PERMIT ISSUANCE IN ACCORDANCE WITH THE SPECIAL INSPECTION AND STRUCTURAL TESTING REQUIREMENTS OF THE BUILDING CODE. IT INCLUDES A SCHEDULE OF SPECIAL INSPECTION SERVICES APPLICABLE TO THIS PROJECT AS WELL AS THE NAME OF THE SPECIAL INSPECTOR TO BE RETAINED FOR CONDUCTING THESE INSPECTIONS AND TESTS. THIS STATEMENT OF SPECIAL INSPECTIONS ENCOMPASSES STRUCTURAL DISCIPLINE

THE SPECIAL INSPECTOR SHALL KEEP RECORDS OF ALL INSPECTIONS AND SHALL FURNISH INSPECTION REPORTS TO THE BUILDING OFFICIAL AND THE REGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE OF SPECIAL INSPECTION. DISCOVERED DISCREPANCIES SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE CONTRACTOR FOR CORRECTION. IF SUCH DISCREPANCIES ARE NOT CORRECTED, THE DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE BUILDING OFFICIAL AND THE REGISTERED DESIGN PROFESSIONAL RESPONSIBLE IN CHARGE OF SPECIAL INSPECTION. THE SPECIAL INSPECTION PROGRAM DOES NOT RELIEVE THE CONTRACTOR OF HIS OR HER RESPONSIBILITIES.

INTERIM REPORTS SHALL BE SUBMITTED TO THE BUILDING OFFICIAL AND THE REGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE OF SPECIAL INSPECTION AND THE ENGINEER OF RECORD.

A FINAL REPORT OF SPECIAL INSPECTIONS DOCUMENTING COMPLETION OF ALL REQUIRED SPECIAL INSPECTIONS, TESTING AND CORRECTION OF ANY DISCREPANCIES NOTES IN THE INSPECTIONS SHALL BE SUBMITTED BY ALL SPECIAL INSPECTORS AND THE DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE OF SPECIAL INSPECTIONS PRIOR TO ISSUANCE OF A CERTIFICATE OF USE AND OCCUPANCY.

JOB SITE SAFETY MEANS AND METHODS OF CONSTRUCTION ARE SOLELY THE RESPONSIBILITY OF THE CONTRACTOR.

THIS STATEMENT OF SPECIAL INSPECTIONS INCLUDES THE FOLLOWING BUILDING SYSTEMS:

☐ PILE FOUNDATIONS

☑ CONCRETE CONSTRUCTION

☐ PIER FOUNDATIONS

□ PRECAST CONCRETE ☑ MASONRY LEVEL 1 ☐ MASONRY LEVEL 2 STRUCTURAL STEEL ☐ COLD-FORMED STEEL FRAMING

☐ SEISMIC RESISTANCE ☐ WIND RESISTANCE ☐ WOOD CONSTRUCTION ☐ SPECIAL CASES ☐ OPEN-WEB STEEL JOISTS ☑ STEEL CONSTRUCTION: OTHER AND JOIST GIRDERS

REGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE**

RESPONSIBILITY	FIRM	ADDRESS AND TELEPHONE NUMBER
1.	-	-
2.	-	-
3.	-	-

- 1. **REGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE: A REGISTERED DESIGN PROFESSIONAL ENGAGED BY THE OWNER TO REVIEW AND COORDINATION THE SPECIAL INSPECTION AS DETERMINED BY THE BUILDING OFFICIAL, FOR COMPATIBILITY WITH THE DESIGN OF THE BUILDING OF STRUCTURE INCLUDING SUBMITTAL DOCUMENTS PREPARED BY OTHERS, DEFERRED SUBMITTAL DOCUMENTERS AND PHASED SUBMITTAL DOCUMENTS.
- 2. ENGINEER OF RECORD HAS NOT BEEN ENGAGED AS THE REGISTERED DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE OF SPECIAL INSPECTIONS.

SPECIAL INSPECTION AGENCIES

	<u> </u>	T
1.	-	-
2.	-	-
3.	-	-

NOTES:

- 1. THE INSPECTORS AND TESTING AGENCIES SHALL BE ENGAGED BY THE OWNER OR THE OWNER'S AGENT, AND NOT BY THE CONTRACTOR.
- 2. ANY CONFLICT OF INTEREST MUST BE DISCLOSED TO THE BUILDING OFFICIAL AND THE DESIGN PROFESSIONAL PRIOR TO COMMENCING WORK.
- 3. THE MINIMUM QUALIFICATIONS OF THE SPECIAL INSPECTOR(S) AND/OR TESTING AGENCIES SHALL BE THOSE LISTED IN THE MINIMUM SPECIAL INSPECTOR QUALIFICATIONS TABLE. THE QUALIFICATIONS OF THE SPECIAL INSPECTOR(S) AND/OR TESTING AGENCIES MAY BE SUBJECT TO THE APPROVAL OF THE BUILDING
- 4. INSPECTION OF FABRICATORS IS NOT REQUIRED WHERE THE FABRICATOR IS APPROVED IN ACCORDANCE WITH SECTION 1704.2.2 OF THE BUILDING CODE.

SPECIAL INSPECTION SCHEDULE: FABRICATORS

VERIFICATION AND INSPECTION TASK	APPLICABLE TO THIS PROJECT?	FREQI	JENCY
1. VERIFY FABRICATION AND IMPLEMENTATION PROCEDURES:	YES	CONTINUOUS	PERIODIC
A. STEEL CONSTRUCTION **	YES	-	X
B. CONCRETE CONSTRUCTION (INCLUDING REBAR FABRICATION)	YES	-	Х
C. WOOD CONSTRUCTION **	NO	-	X
D. COLD FORMED METAL CONSTRUCTION	YES	-	Х
E. OTHER CONSTRUCTION	YES	-	Х

**IF FABRICATOR IS NOT EXEMPT PER IBC CHAPTER 17.

SPECIAL INSPECTION SCHEDULE: SOILS APPLICABLE FREQUENCY VERIFICATION AND INSPECTION TASK TO THIS PROJECT? PERIODIC CONTINUOUS 1. VERIFY MATERIALS BELOW SHALLOW FOUNDATIONS ARE YES ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY. 2. VERIFY EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL 3. PERFORM CLASSIFICATION AND TESTING OF COMPACTED FILL YES MATERIALS. 4. VERIFY USE OF PROPER MATERIALS, DENSITIES AND LIFT YES THICKNESS DURING PLACEMENT AND COMPACTION OF COMPACTED FILL. 5. PRIOR TO PLACEMENT OF COMPACTED FILL, OBSERVE YES SUBGRADE AND VERIFY THAT SITE HAS BEEN PREPARED

SPECIAL INSPECTION SCHEDULE: CONCRETE CONSTRUCTION			
VERIFICATION AND INSPECTION TASK		FREQUENCY	
	PROJECT?	CONTINUOUS	PERIODIC
1. INSPECTION OF REINFORCING STEEL, INCLUDING PLACEMENT.	YES	-	X
2. INSPECTION OF REINFORCING STEEL WELDING IN ACCORDANCE WITH THE SPECIAL INSPECTION SCHEDULE: STEEL CONSTRUCTION OTHER THAN STRUCTURAL STEEL ITEM 3.	YES	-	X
3. INSPECTION OF ANCHORS CAST IN CONCRETE WHERE ALLOWABLE LOADS HAVE BEEN INCREASED OR WHERE STRENGTH DESIGN IS USED.	YES	-	X
4. INSPECTION OF ANCHORS POST-INSTALLED IN HARDENED CONCRETE MEMBERS.	YES	1	X
5. VERIFYING USE OF REQUIRED DESIGN MIX.	YES	-	X
6. AT THE TIME FRESH CONCRETE IS SAMPLED TO FABRICATE SPECIMENS FOR STRENGTH TESTS, PERFORM SLUMP AND AIR CONTENT TESTS, AND DETERMINE THE TEMPERATURE OF THE CONCRETE.	YES	X	-
7. INSPECTION OF CONCRETE AND SHOTCRETE PLACEMENT FOR PROPER APPLICATION TECHNIQUES	YES	Х	-
8. INSPECTION FOR MAINTENANCE OF SPECIFIED CURING TEMPERATURE AND TECHNIQUES.	YES	-	Х
9. INSPECTION OF PRESTRESSED CONCRETE: A. APPLICATION OF PRESTRESSING FORCES.	NO	X	-
B. GROUTING OF BONDED PRESTRESSING TENDONS IN THE SEISMIC- FORCE-RESISTING SYSTEM.	NO	X	-
10. ERECTION OF PRECAST CONCRETE MEMBERS.	NO	1	X
11. VERIFICATION OF IN-SITU CONCRETE STRENGTH, PRIOR TO STRESSING OF TENDONS IN POST-TENSIONED CONCRETE AND PRIOR TO REMOVAL OF SHORES AND FORMS FROM BEAMS AND STRUCTURAL SLABS.	YES	-	X
12. INSPECT FORMWORK FOR SHAPE, LOCATION AND DIMENSIONS OF THE CONCRETE MEMBER BEING FORMED.	YES	-	Х

PROPERLY.

SPECIAL INSPECTIONS FOR ISOLATED SPREAD CONCRETE FOOTINGS, CONTINUOUS CONCRETE FOOTINGS SUPPORTING WALLS, AND CONCRETE FOUNDATION WALLS SHALL BE IN ACCORDANCE WITH THIS TABLE.

SPECIAL INSPECTION SCHEDULE: MASONRY CONSTRUCTION - LEVEL 1

APPLICABLE

FREQUENCY

VERIFICATION AND INSPECTION TASK	TO THIS	FREQUENCY		
			CONTINUOUS	PERIODIO
(COMPLIANCE WITH REQUIRED INSPECTION PROVISIONS OF THE CONSTRUCTION DOCUMENTS AND THE APPROVED SUBMITTALS SHALL BE VERIFIED.	YES	-	Х
	VERIFICATION OF f'm AND f'AAC PRIOR TO CONSTRUCTION EXCEPT WHERE SPECIFICALLY EXEMPTED BY THE BUILDING CODE.	YES	-	X
	VERIFICATION OF SLUMP FLOW AND VSI AS DELIVERED TO THE SITE FOR SELF-CONSOLIDATING GROUT.	YES	X	-
E	AS MASONRY CONSTRUCTION BEGINS, THE FOLLOWING SHALL BE VERIFIED TO ENSURE COMPLIANCE: A. PROPORTIONS OF SITE-PREPARED MORTAR.	YES	-	Х
E	B. CONSTRUCTION OF MORTAR JOINTS.	YES	-	Х
(C. LOCATION OF REINFORCEMENT, CONNECTORS, ANCHORAGES.	YES	-	X
[D. PRESTRESSING TECHNIQUE.	NO	-	X
i	E. GRADE AND SIZE OF PRESTRESSING TENDONS AND ANCHORAGES.	NO	-	Х
١	OURING CONSTRUCTION, THE INSPECTION PROGRAM SHALL VERIFY: A. SIZE AND LOCATION OF STRUCTURAL ELEMENTS.	YES	-	Х
į.	B. TYPE, SIZE AND LOCATION OF ANCHORS, INCLUDING OTHER DETAILS OF ANCHORAGE OF MASONRY TO STRUCTURAL MEMBERS FRAMES OR OTHER CONSTRUCTION.	YES	-	X
(C. SPECIFIED SIZE, GRADE AND TYPE OF REINFORCEMENT.	YES	-	X
[D. WELDING OF REINFORCING BARS.	YES	Х	-
E	E. PREPARATION, CONSTRUCTION AND PROTECTION OF MASONRY DURING COLD WEATHER (TEMPERATURE BELOW 40°F) OR HOT WEATHER (TEMPERATURE ABOVE 90°F).	YES	-	Х
F	F. APPLICATION AND MEASUREMENT OF PRESTRESSING FORCE.	NO	-	X
E	PRIOR TO GROUTING, THE FOLLOWING SHALL BE VERIFIED TO ENSURE COMPLIANCE: A. GROUT SPACE IS CLEAN.	YES	-	Х
E	B. PLACEMENT OF REINFORCEMENT AND CONNECTORS.	YES	-	X
(C. PROPORTIONS OF SITE-PREPARED GROUT AND PRESTRESSING GROUT FOR BONDED TENDONS.	NO	-	Х
[D. CONSTRUCTION OF MORTAR JOINTS.	YES	-	X
	GROUT PLACEMENT SHALL BE VERIFIED TO ENSURE COMPLIANCE WITH CODE AND CONSTRUCTION DOCUMENT PROVISIONS.	YES	Х	-
/	A. GROUTING OF PRESTRESSING BONDED TENDONS.	NO	X	
	PREPARATION OF ANY REQUIRED GROUT SPECIMENS, MORTAR SPECIMENS AND/OR PRISMS SHALL BE OBSERVED.	YES	-	Х



Architecture


2934 Sidco Drive Suite 120

Nashville, TN 37204 Interior Architecture

Atlanta, Boca Raton, Charlotte, Chattanooga Knoxville, Nashville, Orlando, Raleigh Years of Structural Excellence 565 Marriott Drive, Suite 300 Nashville, Tennessee 37214 Tel 615 782 0100

Copyright 2024 • Bennett & Pless, Inc All Rights Reserved **B & P Job Number** 24.02.102



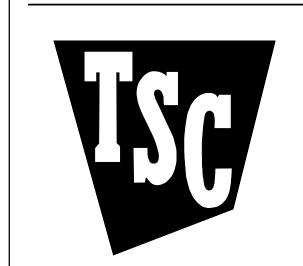

TRACTOR SUPPLY COMPANY HUDSON, COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action

05.10.2024

OUALITY ASSURANCE / PROPOSED STATEMENT OF SPECIAL **INSPECTIONS**

QUALITY ASSURANCE PLAN / PROPSED STATEMENT OF SPECIAL INSPECTION, CONT.

SPECIAL INSPECTION S STRUCTURAL STEEL CON			
VERIFICATION AND INSPECTION TASK	APPLICABLE TO THIS	FREQUENCY	
	PROJECT?	CONTINUOUS	PERIODIO
MATERIAL VERIFICATION OF HIGH-STRENGTH BOLTS, NUTS AND WASHERS: A. IDENTIFICATION MARKINGS TO CONFORM TO ASTM STANDARDS			
SPECIFIED IN THE APPROVED CONSTRUCTION DOCUMENTS.	YES	-	X
B. MANUFACTURER'S CERTIFICATE OF COMPLIANCE REQUIRED.	YES	-	X
2. INSPECTION OF HIGH-STRENGTH BOLTING:	YES	-	Х
A. PRETENSIONED AND SLIP CRITICAL JOINTS USING TURN- OF-NUT WITH MATCHMARKING, TWIST-OFF BOLT, CALIBRATED WRENCH, OR DIRECT TENSION INDICATOR METHODS OF INSTALLATION.	YES	-	X
B. PRETENSIONED AND SLIP-CRITICAL JOINTS USING TURN-OF- NUT WITHOUT MATCHMARKING OR CALIBRATED WRENCH METHODS OF INSTALLATION .	NO	Х	-
3. MATERIAL VERIFICATION OF STRUCTURAL STEEL: A. IDENTIFICATION MARKINGS TO CONFORM TO ASTM STANDARDS SPECIFIED IN THE APPROVED CONSTRUCTION DOCUMENTS AND AISC 360.	YES	-	X
B. MANUFACTURER'S CERTIFIED TEST REPORTS.	YES	-	X
4. MATERIAL VERIFICATION OF WELD FILLER MATERIALS: A. IDENTIFICATION MARKINGS TO CONFORM TO AWS SPECIFICATION IN THE APPROVED CONSTRUCTION DOCUMENTS	YES	-	Х
B. MANUFACTURER'S CERTIFICATE OF COMPLIANCE REQUIRED.	YES	-	X
5. INSPECTION OF WELDING, STRUCTURAL STEEL: A. COMPLETE AND PARTIAL PENETRATION GROOVE WELDS.	YES	Х	-
B. MULTIPASS FILLET WELDS	YES	Х	-
C. SINGLE-PASS FILLET WELDS > 5/16"	YES	X	-
D. SINGLE-PASS FILLET WELDS ≤ 5/16"	YES	-	X
6. INSPECTION OF STEEL FRAME JOINT DETAILS FOR COMPLIANCE WITH APPROVED CONSTRUCTION DOCUMENTS: A. DETAILS SUCH AS BRACING AND STIFFENING.	YES	-	Х
B. MEMBER LOCATIONS.	YES	-	X
C. APPLICATION OF JOINT DETAILS AT EACH CONNECTION.	YES	-	X

SPECIAL INSPECTION SCHEDULE: STEEL CONSTRUCTION OTHER THAN STRUCTURAL STEEL			
VERIFICATION AND INSPECTION TASK	APPLICABLE TO THIS		
	PROJECT?	CONTINUOUS	PERIODIC
1. MATERIAL VERIFICATION OF COLD-FORMED STEEL DECK: A. IDENTIFICATION MARKINGS TO CONFORM TO ASTM STANDARDS SPECIFIED IN THE APPROVED CONSTRUCTION DOCUMENTS.	YES	-	X
B. MANUFACTURER'S CERTIFICATE OF COMPLIANCE REQUIRED.	YES	-	X
2. INSPECTION OF WELDING, COLD-FORMED STEEL DECK: A. ROOF DECK WELDS.	YES	-	Х
3. INSPECTION OF WELDING, REINFORCING STEEL: A. VERIFICATION OF WELDABILITY OF REINFORCING STEEL OTHER THAN ASTM A 706.	YES	-	Х
B. REINFORCING STEEL RESISTING FLEXURAL AND AXIAL FORCES IN INTERMEDIATE AND SPECIAL MOMENT FRAMES, AND BOUNDARY ELEMENTS OF SPECIAL STRUCTURAL WALLS OF CONCRETE AND SHEAR REINFORCEMENT.	NO	X	-
C. SHEAR REINFORCEMENT.	YES	X	-
D. OTHER REINFORCING STEEL.	YES	-	X
4. INSPECTION OF COLD-FORMED STEEL TRUSSES: A. VERIFY TEMPORARY INSTALLATION RESTRAINT/BRACING ARE INSTALLED IN ACCORDANCE WITH APPROVED TRUSS SUBMITTAL PACKAGE.	YES	-	X
B. VERIFY PERMANENT INDIVIDUAL TRUSS MEMBER RESTRAINT/BRACING ARE INSTALLED IN ACCORDANCE WITH APPROVED TRUSS SUBMITTAL PACKAGE.	YES	-	X

SPECIAL INSPECTION SCHEDULE: OPEN-WEB STEEL JOISTS AND JOIST GIRDERS			
VERIFICATION AND INSPECTION TASK	APPLICABLE TO THIS PROJECT?	FREQUENCY	
		CONTINUOUS	PERIODIC
1. INSTALLATION OF OPEN-WEB STEEL JOISTS AND JOIST GIRDERS A. END CONNECTIONS - WELDING OR BOLTED.	YES	-	Х
B. BRIDGING - HORIZONTAL OR DIAGONAL	YES	-	X
2. STANDARD BRIDGING	YES	-	X
3. BRIDGING THAT DIFFERS FROM THE SJI SPECIFICATIONS LISTED IN SECTION 2207.1	YES	-	Х



Architecture

Interior Architecture

2934 Sidco Drive Suite 120 Nashville, TN 37204

Experience Structural Expertise Atlanta, Boca Raton, Charlotte, Chattanooga,

Knoxville, Nashville, Orlando, Raleigh **1964 - 2024 Celebrating** 60 Years of Structural Excellence 565 Marriott Drive, Suite 300 Nashville, Tennessee 37214 Tel 615 782 0100

Copyright 2024 • Bennett & Pless, Inc.
All Rights Reserved
B & P Job Number 24.02.102





TRACTOR SUPPLY COMPANY HUDSON, COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action

05.10.2024

QUALITY ASSURANCE / PROPOSED STATEMENT OF SPECIAL INSPECTIONS, CONT.

Sheet Number:

Sheet Number:

CONCRETE SPECIFICATIONS

PART 1 - GENERAL

1.01 QUALITY ASSURANCE

- Ready-Mix Concrete Supplier: A firm experienced in producing ready-mixed concrete that complies with ASTM C94 requirements for production facilities and equipment. Comply with ACI 301, "Specification for Structural Manufacturer certified according to NRMCA's "Certification of Ready-Mixed Concrete Production
- Facilities." Certification shall not be more than twelve months old. Concrete Contractor Qualification: Concrete contractor shall include in their bid package to the general contractor, a minimum of three similar and successful projects that clearly indicates the ability to successfully perform the work and to achieve the interior slab on ground tolerances required in this specification. The Concrete Contractor's team shall have participated in the majority of the referenced projects, and that team shall remain the same throughout the duration of this project. Concrete Contractor's qualification shall be submitted as part of the bid package. The Owner has rights to reject the Concrete Contractor.
- Testing Agency Qualifications: An independent agency, qualified according to ASTM C1077 and ASTM E329 for testing indicated, as documented according to ASTM E548. Personnel conducting field tests shall be qualified as ACI Concrete Field-Testing Technician, Grade 1, according to ACI CP-01 or an equivalent certification program.
- Concrete Laboratory Testing Technician Grade I. Testing Agency laboratory supervisor shall be an ACI-certified Concrete Laboratory Testing Technician - Grade II. Trained Applicator: General contractors bidding or negotiating a Tractor Supply project shall contact Euclid Chemical to obtain a list of Trained Applicators located within the geographic region of the project. General Contractors shall solicit and accept pricing only from those applicators as provided by Euclid Chemical. **The** Trained Applicator selected for the initial application of joint filler and liquid densifier/sealer shall

2. Personnel performing laboratory tests shall be ACI-certified Concrete Strength Testing Technician and

- be the same as for the polishing process and additional application of liquid densifier/sealer. Philip Brandt: Euclid Chemical - 877-438-3826 / pbrandt@euclidchemical.com Concrete Slab on Ground Pre-Installation Conference (Tractor Supply Requirement): At least 30 days prior to the start of concrete slab construction, the general contractor shall conduct a meeting to review the proposed concrete mix designs and to discuss the required methods and procedures
- to achieve the requirements of this specification. The general contractor shall send a pre-concrete conference agenda to all attendees 10 days prior to the scheduled date of the conference. The general contractor shall require responsible representatives of every party concerned with the concrete work to attend the conference, including, but not limited to the following:
 - General Contractor: Project Manager and Superintendent
 - **Ready-mix Concrete Producer: Quality Control Manager Concrete Contractor: Foreman**
 - Testing Agency: Project Manager and Field Rep for concrete mixes, quality control, floor tolerance testing, etc.
 - Owner Representative: If Required Trained Applicator: Liquid densifier sealer and joint filling applicator
- Phil Brandt: Euclid Chemical (877-438-3826) / pbrandt@euclidchemical.com Minutes of the meeting shall be recorded, typed, and printed by the general contractor and distributed to all concerned parties, including the architect, structural engineer, and Tractor Supply Project Manager, within three days of the meeting.
- The minutes shall include a statement by the ready-mix concrete supplier stating that the proposed concrete mix designs will produce the concrete quality required by these specifications.
- 4. The minutes shall include a statement by the concrete contractor that the proposed concrete mix designs will provide appropriate workability and setting times, to ensure that the concrete contractor can achieve the requirements of this specification.

PART 2 - PRODUCTS

2.01 MATERIALS

Concrete materials:

or Daracem series.

- Portland Cement: ASTM C150/C150M, Type I/II, or ASTM C-595, Type IL (Portland Limestone Cement). Use one brand of cement throughout the project. Coarse and Fine Aggregates: ASTM C 33. Combined aggregate gradation for slabs on grade and other designated concrete shall be 8% - 18% for large top size aggregates (1½") or 8% - 22% for smaller
- top size aggregates (1" or 34") retained on each sieve below the top size and above the No. 100 sieve. a. Footings and Piers: Unless indicated otherwise on drawings, footings and piers shall have a maximum aggregate size of 1" (#57 stone), and beams $\frac{3}{4}$ " (#67 stone). Interior Slab on Ground: Unless indicated otherwise on drawings, interior slab on ground shall
- have a maximum coarse aggregate size of 1" (#57 stone). Exterior Slab on Ground: Unless indicated otherwise on drawings, exterior slab on ground shall have a maximum coarse aggregate size of 1" (#57 stone).
- Water: complying with ASTM C94. Air-Entraining Admixture (Interior Slab on Ground): Air-entraining admixture shall not be used
- for interior slab on ground concrete work. Air-Entraining Admixture (Exterior Slab on Ground Concrete): ASTM C-260. Admixture
- manufacturer shall provide written certification that the air-entraining admixture is compatible with other required admixtures. All exterior slab on ground shall be air-entrained (4% - 6%). Acceptable products: Euclid Chemical AEA-92 or Air 40: Master Builders Micro Air: W.R. Grace Daravair or Darex. Water-Reducing Admixture: ASTM C494, Type A containing not more than 0.05% chloride ions. Acceptable products: Euclid Chemical Eucon series; Master Builders Pozzolith series; W.R. Grace WRDA
- Water-Reducing, Retarding Admixture: ASTM C494, Type D containing not more than 0.05% chloride ions, Acceptable products: Euclid Chemical Retarder 75; Master Builders Pozzolith series or Delvo; W.R. Grace Daratard 17.
- High Range Water-Reducing Admixture (Superplasticizer): ASTM C494, Type F or G containing not more than 0.05% chloride ions. Acceptable products: Euclid Chemical Eucon 37; Master Builders
- Rheobuild 1000; W.R. Grace Daracem-100. Water-Reducing, Non-Corrosive Accelerating Admixture: ASTM C494, Type C or E containing not more chloride ions than are present in municipal drinking water. The admixture manufacturer must have long-term, non-corrosive test data from an independent testing laboratory (of at least a year's duration) using an acceptable accelerated corrosion test method such as that using electrical potential
- Pozzutec 20; W.R. Grace Polarset. Prohibited admixtures: Calcium chloride or admixtures containing more than 0.05% chloride ions are not permitted.

measures. Acceptable products: Euclid Chemical Accelguard 80/90 or NCA; Master Builders NC534 or

- Fly ash is only permitted in exterior slab on ground subject to Alkali Silica Reactivity (ASR); up to 20% exchange by weight. 10. Macro-Synthetic fibers (Exterior Slab on Ground Concrete): Comply with ASTM C1116. "Structural" fibers shall be a patented coarse monofilament, self-fibrillating, polypropylene/polyethylene fiber with a minimum tensile strength of 73ksi and minimum length of 2 inches. Acceptable macro-synthetic fiber (No Substitutions): "Tuf-Strand SF" by Euclid Chemical. Phil Brandt 877-438-3826 / pbrandt@euclidchemical.com
- Related Materials: Evaporation Retarder: Waterborne, monomolecular film forming, manufactured for application to fresh
 - a. Acceptable manufacturer: "Eucobar" by Euclid Chemical. Interior Slab on Ground Curing: ASTM C309 with a maximum VOC content of 350g/l. The interior slab on ground shall be cured using a reduced odor, dissipating or removable liquid membrane forming curing compound.
 - Acceptable manufacturer: "Kurez DR VOX" or "Kurez DR 100" by Euclid Chemical. Interior Slab on Ground: Unless indicated otherwise on drawings, interior slab on ground shall have a maximum coarse aggregate size of 1" (#57 stone).
 - Exterior Slab on Ground: Unless indicated otherwise on drawings, exterior slab on ground shall have a maximum coarse aggregate size of 1" (#57 stone). Interior Slab on Ground Semi-Rigid Polyurea Joint Filler: Comply with ACI 302, shall be a two (2) component, 100% solids, UV Resistant compound, with minimum shore "A" hardness of 80. Color to
 - match adjacent concrete surfaces. Acceptable manufacturer: "QWIKjoint UVR" by Euclid Chemical. 4. Interior Slab on Ground Liquid Densifier/Sealer: Sodium siliconate containing at least 24% solids by
 - Acceptable manufacturer: "Euco Diamond Hard" by Euclid Chemical. Project service: General Contractor shall contact the Manufacturer prior to bidding for pricing and application requirements, and at least 10 days prior to application of liquid densifier and sealer, for jobsite service. If necessary, the representative will be on site during the first
 - application of liquid densifier/sealer. Exterior Slab on Ground Curing: ASTM C1315 with a maximum VOC content of 700 q/l. All exterior slab
 - on ground shall be cured using a liquid membrane-forming curing compound. Acceptable manufacturer: "Super Rez Seal" or "Super Diamond Clear VOX" by Euclid Chemical. Exterior Slab on Ground Urethane Joint Sealant: ASTM C920-86, Type S, Grade NS, and Class 25 Industrial gun grade polyurethane sealant shall exhibit a shore "A" hardness of 40 and an elongation of
 - a. Acceptable manufacturer: "Eucolastic 1 NS/SL" by Euclid Chemical.

2.02 CONCRETE MIXES

- A. Comply with ACI 301 requirements for concrete mixes. Concrete mixes shall be proportioned according to ACI 301, for normal-weight concrete determined by either laboratory trial mix or field test data.
- Compressive strength: Interior Slab on Ground: 4000 psi @ 28 days, with a maximum water/cement ratio of 0.53, unless otherwise Exterior Slab on Ground: 4000 psi @ 28 days, with a maximum water/cement ratio of 0.45, unless otherwise
- indicated on the drawings Concrete materials included in the mix design shall be the same materials provided to the project and shall be prepared by an independent testing laboratory approved by the Owner. Per ACI requirements, if sufficient backup data is not available, the laboratory mix shall exceed the desired job strength of concrete by 1,200 psi.

Slump: Concrete shall have a maximum slump of 5½" for the interior and exterior slabs on ground. Unless indicated

- on drawings, all other concrete shall not exceed a 4" slump. Macro-synthetic fiber addition: All exterior slab on ground shall contain the specified macro-synthetic fiber used at a rate of no less than 3.0 lbs./cyd. Actual fiber dosage may vary based on job-site conditions and shall be calculated by strength equivalency to conventional reinforcement requirements. Required information may include, but not be limited to site prep, subbase, and concrete properties, curing, and loading conditions. The "Engineer of Record" shall contact Euclid Chemical to discuss actual project conditions and the resultant required fiber dosage rate. Fibers may be added at plant location or jobsite and shall be mixed in concrete for a minimum of 4 minutes. Euclid Contact: Mike
- Mahoney: 216-692-8301 Adjustment to Concrete Mixes: Mix adjustments may be requested by the general contractor when characteristics of materials, job conditions, weather, test results or other circumstances warrant; at no additional cost to the Owner and as accepted by the Owner. Laboratory test data for revised mix and strength results must be submitted to and accepted by the Owner prior to work. Testing Agency and Concrete Contractor shall verify that the concrete mix design will produce concrete that will meet the specifications for this project. In addition, the General Contractor and Concrete Contractor shall verify that the workability, finishability and setting times are appropriate for concrete installations. Placement shall be made by concrete truck chute. If concrete pumping is required, the proportions established above shall not be altered to suit the capabilities of the pumping equipment. For concrete containing macro-synthetic fibers, additional water reducer may be necessary. The addition of water is not permitted into
- concrete mixture after the addition of macro-synthetic fibers. Interior Slab on Ground Concrete: Concrete shall be designed to meet 4000 psi compressive strength @ 28 days and exhibit ≤0.04% shrinkage @ 28 days. The mix shall contain approximately 12 cubic feet of 1" top size aggregate (#57 stone), the specified water reducing admixture, and achieve a w/cm ratio of 0.53 (max.). Air-entrainment is prohibited. Proposed mix design shall be similar to the following:

Prototype mix

12 cubic feet +/- .50 (#57 stone)

274 - 298 lbs. (or less)

7 cubic feet +/- (adjust as necessary)

3oz.-10oz./100wt +/- (mid-Range)

517-564 lbs.

3.0% (max.)

0.53 (max.)

5.5" (max.)

Prohibited

Interior Slab on Ground Prototype mix:

- Materials Cement Fly ash/slag
- Coarse aggregate Fine aggregate Water content Air content (Entrapped Air Only) Water Reducer (Type A/F)
- W/CM Ratio Initial slump (water) Final slump (with water reducer)
- **Maximum Shrinkage** < 0.04% @ 28 days **Exterior Slab on Ground Concrete:** Concrete shall be designed to meet 4000 psi compressive strength @ 28 days and exhibit ≤0.04% shrinkage @ 28 days. The mix shall contain approximately 12 cubic feet of 1" top size aggregate (#57 stone), the specified water reducing admixture and achieve a w/cm ratio of 0.45 (max.). Air-entrainment shall

be as specified. Proposed mix design shall be similar to the following: **Exterior Slab on Ground Prototype mix:**

- **Prototype mix** Materials Cement 517-564 lbs. Prohibited, Except in areas of known Alkali Silica Reactivity Fly ash/slag (Up to 20% by weight exchange) Coarse aggregate 12 cubic feet +/- .50 (#57 stone)
- 7 cubic feet +/- (adjust as necessary) Fine aggregate Water content 232-253 lbs. (or less) 6.0% (max.) Air content (Entrained Air) Water Reducer (Type A/F) 3oz.-10oz./100wt +/- (Mid-Range)
- W/CM Ratio 0.45 (max.) Initial slump (water) Final slump (with water reducer) 5.5" (max.) Macro Synthetic Fiber (Tuf-Strand SF) 3 lbs / cubic yard (min.)

Maximum Shrinkage < 0.04% @ 28 days

PART 3 - EXECUTION 3.01 INSTALLATION (GENERAL)

- Base Material: Local state department of transportation approved road base material with 100 percent passing the 1.5" (38 mm) sieve, 15 percent to 55 percent passing the No. 4 (4.75 mm) sieve, and less than 12 percent passing the No. 200 sieve). Install "crusher run" base type material to the minimum compacted thickness as indicated on the construction documents. Crushed stone shall be compacted to 98% Modified Proctor density in accordance with ASTM
- ASTM D1556, ASTM D2167, or ASTM D2922. One copy of test results shall be forwarded to the Owner. Formwork: Design, construct, erect, shore, brace, and maintain formwork according to ACI 301. 1. Form Work: Form all slabs, stairs and other formed concrete with metal forms or ¾" plywood. For

D1557. The in-place density shall be tested for compliance no more than 48 hours prior to concrete placement using

- exposed surfaces use forms with an undamaged face. Form ties used shall be snap ties. Concrete release agent shall be a VOC compliant, light viscosity, non-staining oil. Vapor Retarder: ASTM E1643 (if indicated on drawings): Install, protect, and repair vapor-retarder sheets; place
- sheets in position with longest dimension parallel with direction of pour Plastic vapor retarder for concrete floor slab shall be 10-mil (minimum) polyethylene. Seal vapor retarder completely around all pipes and conduits. Inspect vapor retarder thoroughly and repair all punctures and tears immediately prior to placing concrete. All laps shall be 18" minimum and sealed with a completely continuous pressure sensitive tape.
- Steel Reinforcement (if indicated on drawings): Comply with CRSI's "Manual of Standard Practice" for fabricating, placing, and supporting reinforcement. a. Do not cut or puncture vapor retarder. Repair damage and reseal vapor retarder before placing

secured with tie wires no more than 4 feet on center.

Install all anchors, ties, chairs, and other supports as per ACI 301/302 requirements, to ensure reinforcing is supported at proper locations. All reinforcing shall be wired in place using #16 annealed wire. Wood or clay brick chairs are not acceptable Welded wire fabric mesh (if indicated on drawings) shall be lapped a minimum of 6" at side laps and

3.02 CONCRETE PLACEMENT

- Carbon Monoxide / Carbon Dioxide Exposure: If the building is enclosed and the interior slab on ground is placed last, general contractor shall be responsible for monitoring interior slab on ground exposure to excessive exhaust gases containing carbon dioxide (CO₂) or carbon monoxide (CO). To minimize potential damage to the interior slab on ground during placement and curing periods, maximum CO₂ levels shall be 4,500 parts per million and maximum CO levels shall be 15 parts per million at concrete surface within 5 feet of any source of exhaust gases. Unvented combustion heaters shall not be in operation during concrete placement, and equipment inside the building during concrete placement shall be limited to the equipment necessary to place and finish concrete. Only one concrete truck shall be in the building at any given time, and under no circumstance shall there be any earth moving equipment, dump trucks, grading equipment, or any other motorized equipment in operation until after the interior slab on ground is placed and protected by specified curing method. Carbon Monoxide and Carbon Dioxide shall be checked using an appropriate meter from a company similar to the following: CEA Instruments, Inc., Phone (201-967-5660);
- website: HYPERLINK "http://www.ceainstr.com" www.ceainstr.com Comply with requirements in ACI 301 for measuring, mixing, transporting, and placing concrete. Cooperate with all other trades. Confer with electrical, mechanical, plumbing, carpenters, steel workers, etc. Make sure that all sleeves, anchor, insert, conduit, floor boxes, pipes, fittings, and other items are installed before placing concrete. Make provisions for door saddles, and thresholds
- General Contractor shall ensure the accuracy, placement, and alignment of all under-slab work. The placement of all boxes shall be square, level, and true in all respects.
- Concrete shall be mixed and delivered in accordance with the requirements of ASTM C94. Comply with ACI 305, "Hot Weather Concrete," and ACI 306, "Cold Weather Concrete" for protection during placing, finishing, and curing. Form-Release Agent: Coat all removable wood and metal forming with a VOC compliant, non-staining, concrete form-
- release agent and allow excess liquid to drain off before forms are placed. Transport: Place at point of use and consolidate with a concrete vibrator. Do not allow concrete to segregate. Maximum free fall for concrete is 3 feet. A vibrator is required for placement of concrete in walls, piers, footings, and
- Concrete Placement: Place on firm, undisturbed earth, or properly compacted fill. Consolidate by vibrating without segregation. Do not place concrete when temperature is 40°F and falling or when freezing weather is predicted within 24 hours.
- Place concrete within the minimum temperature range as specified in ACI 301. Protect concrete as required in ACI 301.
- Concrete shall not contain Type III, high early strength cement, calcium chloride, corrosive accelerators, or Concrete shall be placed before initial set occurs, and in no event after it has contained its water content for
- Unless otherwise specified, all concrete shall be placed upon clean, damp, smooth surfaces that are free from unning water. Subgrade and base shall be properly consolidated and rut-free Concrete shall not be placed upon soft mud or dry porous earth. The concrete shall be consolidated and
- worked, in an approved manner, into all corners and angles of the forms and around reinforcement and embedded fixtures in such a manner as to prevent segregation of the coarse aggregate as required in ACI 301. During concrete placement, carefully protect all masonry and metal building walls by covering with waterproof paper. Water may be added in accordance with ASTM C94. Water shall only be added at the job site under the direct supervision of a representative from the Testing Agency. Do not add more water than is indicated as allowable on the batch ticket. Water added at the job site shall be documented on the batch ticket.

3.03 FORMED SURFACE FINISHES

- Rough-Formed Finish: As-cast concrete texture imparted by form-facing material with tie holes and defective areas repaired and patched, and fins and other projections exceeding ¼" in height shall be rubbed down or chipped off.
- Apply to concrete surfaces not exposed to public view. Smooth-Formed Finish: As-cast concrete texture imparted by form-facing material, arranged in an orderly and symmetrical manner with a minimum of seams. Repair and patch tie holes and defective areas. Completely remove fins and other projections. All exposed concrete walls are to be grouted and hand rubbed. Apply to concrete surfaces exposed to public view or to be covered with a coating or covering material

final surface treatment of formed surfaces uniformly across adjacent unformed surfaces, unless otherwise

- applied directly to concrete, such as waterproofing, damp-proofing, veneer plaster, or painting. Do not apply rubbed finish to smooth-formed finish. Apply smooth-rubbed finish, defined in ACI 301, to smooth-formed finished concrete. Related Unformed Surfaces: At tops of walls, horizontal offsets, and similar unformed surfaces adjacent to formed surfaces, strike off smooth and finish with a texture matching adjacent formed surfaces. Continue
- 3.04 CONCRETE FINISHES AND TOLERANCES
- General: Unless otherwise noted by Owner, interior slab on ground shall be cast in one continuous placement Concrete shall be placed, screeded, re-straightened, and finished to meet the specified F_F and F_L tolerance requirements. Interior slab on ground machine trowel finish shall be achieved within a 2" tolerance of all walls, columns, and partitions. Do not wet concrete surfaces while finishing concrete. Laser screeds (required), vibratory screeds, highway straightedges and wood or resinous bull floats shall be used to initiate screeding and floating process to form a uniform and open-textured surface plane before excess moisture or bleed water appears on the surface. A back-up laser screed is

starting floating operations. Do not further disturb surfaces before starting finishing

operations. Highway straightedge operations shall continue before, during, and after troweling operation, until the minimum specified floor tolerances are achieved. Highway straightedge operations shall continue before, during, and after troweling operation, until the

required during concrete placement of the interior slab on ground. Remove excess water before

- minimum specified floor tolerances are achieved. Trowel finish (Interior Slab on Ground): Trowel surfaces with trowel machines equipped with adjustable blades. Trowel the surface sufficiently to produce a smooth, tight, abrasion resistant surface. Care shall be taken not to overwork or burn the surface. Use 6" wide finish style steelreinforced blades on final passes. Finishing blades shall be in new condition and completely clean of any deleterious materials.
- Trowel finish (Other Floor Areas): Apply a hard trowel finish to surfaces indicated and to floor and slab surfaces exposed to view or to be covered with resilient flooring, carpet, ceramic, or quarry tile set over a cleavage membrane, paint, or another thin film-finish coating system. Heavy broom finish: Side yard, main entry and exit vestibules, cart storage, ramps, aprons, and walks
- shall receive a heavy broom finish. Protection: Care shall be taken to protect newly placed concrete. Entrances shall include clean floor mats to prevent mud stains and all equipment on the floor shall be diapered to prevent spills. Cutting

Joint Filling: Fill all control joints as specified in paragraph B, Section 3.07, "Interior Slab on Ground

- oils are not allowed on the interior slab on ground at any time during the construction process. Pet Wash Area: Concrete Finish and Curing: Do not broom finish this area. Place and finish concrete as specified in paragraph A, "General Finishes," Section 3.04, "Concrete Finishes and Tolerances." After final troweling, cure using "Kurez DR VOX" or "Kurez DR 100" at an application rate of 400sf/gallon.
- Surface Preparation: Epoxy floor coating system is designed for application on concrete substrates. Newly placed concrete surfaces should be cured for a minimum of 28 days prior to coating. Concrete surfaces must be structurally sound, free of loose or deteriorated concrete and free of dust, dirt, paint efflorescence, oil, and other contaminants. Mechanically abrade the surface to achieve a surface profile equal to CSP 2-3 in accordance with ICRI Guideline 310.2. Properly clean profiled area. The pH of the surface should be checked according to ASTM D 4262. Following surface preparation, the cleaned surface should have a minimum surface-tensile strength of 200 psi when tested with an Elcometer or similar pull tester (ASTM D 4541).
- Initial Coat: "Increte High Performance Epoxy" 1-gallon kit (Gray Color) by Euclid Chemical. Pigmented Chips: "Increte Granite Coat Chips" (Mica Color) by Euclid Chemical. Grout Coat: "Increte High Performance Epoxy" 1-gallon kit (Clear Color) by Euclid Chemical.
- d. Final Wear Coat: "Increte Polyseal Polyaspartic" 2-gallon kit (Clear Color) by Euclid Chemical. Initial Coat Mixing: Pre-mix Increte High Performance Epoxy (Gray) Part A and Part B, then combine 2 parts by volume of Part A with one part by volume of Part B, and then mix thoroughly using a lowspeed drill motor and a "Jiffy" type mixer. Mix only the amount of material that can be applied during the pot life. Do not aerate the mix.
- mixed epoxy with a notched squeegee while wearing spiked shoes. Start from one end of the floor and work backwards and sideways trying to keep a wet-to-wet edge. Roll coating in one direction using a 3/8" nap, shed-resistant roller. Make sure the material is applied as quickly as possible without leaving puddles.

Initial Coat Application: Apply Increte High Performance Epoxy (Gray) at 120sf/gallon. Spread the

- Pigmented Chip Application: Broadcast until refusal, Increte Granite Coat Chips (Mica) in a high arcing motion into the wet epoxy. Allow to cure. Once dry, vacuum / scrape off excess flakes.
- Grout Coat: Apply Increte High Performance Epoxy (Clear) at 120sf/gallon. Allow to dry. Wear Coat: Apply a final coat of Increte Polyseal Polyaspartic (Clear) at 120sf/gallon. Allow to dry. Cove Base: In addition to the seamless integral floor, provide a 4" cove base from the floor to the "FRP" wall transition. Cove base shall consist of a mixture of Increte High Performance Epoxy and finely graded, clean dry, trowelable aggregates, troweled to the previously installed vertical cement board surface, to a height of 4". Create a coved, seamless, integral transition at joint between wall
- Base detail with the Grout Coat and Wear Coat as specified herein. Once completed, the floor and cove base shall be seamless in function and appearance. a. Install cement wall board so that the bottom edge is flush with the floor as specified. Install cement wall board tape, similar to Goldblatt Professional Cement Board Tape, to all

and floor. Broadcast until refusal, Increte Granite Coat Chips (Mica) into the wet epoxy. Finish Cove

- joints of cement board. Install Fiber Reinforced Panels (FRP) as required. Do not apply adhesive to any areas contacting the 4" cove base installation. Do not apply water to any of these surfaces prior to installation of the epoxy floor or cove system Install 4" cove base directly to cement board. Cove base shall come in direct contact with the
- bottom edge of the Fiber Reinforced Panels so that the floor and cove base shall be seamless in function and appearance. Tolerances: ACI 117, "Specifications for Tolerances for Concrete Construction & Materials." General contractor is responsible for all costs associated with floor tolerance testing. A copy of the final floor tolerance report shall be provided by the general contractor to Owner within 24 hours of receiving the report from the testing
 - All perimeter areas and edges of the interior floor shall exhibit the same final finish. Location Interior Slab on Ground Exterior Slab on Ground F_F Tolerance F_L Tolerance

3.05 CAST-IN-PLACE CONCRETE JOINTS

- General: Joints shall be cut as indicated on drawings, and as soon as the slab will support the weight of the saw and operator and when cutting action will not tear, abrade, or otherwise damage the concrete surface. Cuts must be made before concrete develops random contraction cracks. Employ sufficient number of saws and workers to complete cutting of saw joints within 2 hours after final finish of interior slab on ground. After saw cutting, immediately vacuum up and remove all residues completely. Construction Joints:
 - Construction joints shall be true to line with faces perpendicular to surface plane of concrete (refer to drawings), so as not to impair strength or appearance of concrete. Construction joints in slab on grade shall be butt joints with square plate dowels. Do not use
 - metal keyways. 2. Control Joints: Form weakened-plane control joints, sectioning concrete into areas as indicated: All saw cutting shall be accomplished with a "Soff-Cut" saw, by Husqvarna Construction Products (800-288-5040), equipped with a patented color-coded, diamond blade and skid plate in new condition. Concrete Subcontractor must have documented successful experience in the use of this method prior to this project. Using a 1/8" thick blade, cut the interior slab on ground a minimum of 1.25" deep for 4" thick slabs and 1.67" for 5" thick slabs. White chalk
 - lines and concrete dust shall be removed completely and immediately after cutting operation. Random depth checks shall be performed by an independent testing company to confirm that the specified depth of cut is made. Any cut(s) found to be less than proper depth shall be recut to the proper depth and filled with specified joint filler at the general contractor's expense.
 - Isolation Joints: Install joint-filler strips at junctions with slabs-on-grade and vertical surfaces, such as column pedestals, foundation walls, grade beams, and other locations, as indicated. a. Extend joint fillers full width and depth of joint, terminating flush with finished concrete surface, unless otherwise indicated.

3.06 INTERIOR SLAB ON GROUND PROTECTION AND CURING

- Protection: Protect freshly placed concrete from premature drying and excessive cold or hot temperatures. Comply with ACI 305 for hot-weather protection and ACI 306 for cold-weather protection during placing and curing. For concrete placement during hot, dry, and windy conditions, General Contractor shall use the specified evaporation retarder as per manufacturer instructions to maintain a moist condition and to minimize plastic drying shrinkage cracking.
- Interior Slab on Ground Concrete Curing: The interior slab on ground shall be cured using the specified dissipating liquid membrane-forming curing compound. All applications shall be made by a trained applicator immediately following final finish. The concrete and air temperature shall be above 50°F. Surface shall be damp, but not wet and can no longer be marred by walking workmen. Apply "Kurez DR VOX" or "Kurez DR
- 100" at an application rate of 400sf/gallon. **Interior Slab on Ground Protection**: Take the following measures to protect the interior slab on ground: Wrap or diaper all motorized and hydraulic equipment to prevent fluid leaks Provide non-marking tires on rubber-tired vehicles or equip rubber tires with tire boots made of nylon
- Provide mats at all entrances to prevent mud stains Exterior Slab on Ground Concrete Curing: All exterior slab on ground shall be cured using the specified liquid membrane-forming curing compound. Application shall be made by a trained applicator immediately following final finish. Concrete and air temperature shall be above 50°F. Surface shall be clean and damp, but not wet and can no longer be marred by walking workmen. Apply "Super Rez Seal" or "Super Diamond Clear VOX" at an application rate of 400sf/gallon.

3.07 INTERIOR SLAB ON GROUND JOINT FILLER

- General: Do not commence installation of semi-rigid polyurea joint filler, liquid densifier / sealer and polishing processes until the building is completely enclosed, permanent power and lighting is operating, and the building is thermostatically controlled. Installation of these materials shall commence approximately two weeks prior to "fixture date."
- Joint Filler Installation: Comply with ACI 302 as applicable to materials, applications, and conditions. Surface cleaning of joints: Clean joints immediately before installing joint filler. Remove foreign material that could interfere with adhesion of joint filler by brushing, grinding, blast cleaning, mechanical abrading, or a combination of these methods to produce a clean, sound substrate capable of developing optimum bond with joint filler. Remove loose particles remaining from above cleaning operations by vacuuming or blowing out joints with oil-free compressed air. Also remove all laitance and form-release agents from concrete surface. Clean nonporous surfaces with chemical cleaners or other means that do not stain, harm substrates, or leave residues could interfere with adhesion of joint sealants. All surfaces to be filled shall be clean and dry.
 - Mixing: Joint filler is a two-part product requiring machine mixing and placing. Premix Part "B"
 - separately before using. Follow pump manufacturer's equipment instructions. Placement: For proper load transfer, joints must be filled full depth, but in no case should the joint filler be any less than 1" deep in the joint. No backer rod is allowed. Joints should be overfilled and
 - shaved level with the surface, giving the floor joints a flat, smooth appearance. Joint filler separation: The trained joint filling applicator shall include in their bid a cost per linear foot to make one return trip to refill joints if joint filler sidewall separation or splitting exceeds 1/16", or if surface profile is concave, chattered or if voids occur. This shall take place one week prior to grand opening, or at Owner's request.
- Initial cleaning for liquid densifier and sealer application: thoroughly clean the interior slab on ground prior to the initial application of liquid densifier/sealer and polishing process. Completely remove the remnants of the specified dissipating or removable curing compound from the floor surface. The following floor stripper or removal solution shall be applied to the floor at the proper ratio to thoroughly strip, clean and remove all curing compound residue: a. "Euco Clean & Strip" by Euclid chemical
- Polishing process and application of liquid densifier / sealer: prior to application, inspect interior slab on ground to ensure that slab is clean and free of dust, grease, oils, or other contaminants that might prohibit
- the proper application and penetration of the liquid densifier and sealer. 1. The following process is provided as a guide. Many factors, including, but not limited to interior slab on ground finish, hardness and flatness will determine the initial diamond tooling, including additional grinding and/or polishing operations required to meet the requirements specified herein. The trained applicator shall provide a test polish, including application of liquid densifier/sealer to a designated area of the interior slab on ground, using the same equipment, tools and methods as will be used to polish the interior slab on ground. Floor polishing and application of liquid
- densifier/sealer shall not commence until general contractor has accepted the polished interior slab on ground test slab. Step one: using equipment with sufficient head pressure (≥ 150 psi), thoroughly clean, and then grind concrete floor with a combo set of 60 grit resin bond diamonds and 100 grit resin bond diamonds (not pads). Each pass must overlap 50% of the previous pass. Grind the concrete floor to
- allow for an even scratch pattern. Clean floor thoroughly after this pass. Step two: apply Euclid diamond hard liquid densifier/sealer at 225 square feet per gallon. Step three: using equipment with sufficient head pressure (≥ 150 psi) polish concrete floor with a combo set of 100 grit resin bond diamonds and 200 grit resin bond diamonds (not pads). Each pass
- must overlap 50% of the previous pass. Polish the concrete floor to allow for an even scratch pattern. Clean floor thoroughly after this pass. Step four: using equipment with sufficient head pressure (≥ 150 psi) polish concrete floor with 400 grit resin bond diamonds (not pads). Each pass must overlap 50% of the previous pass. Polish the
- concrete floor to allow for an even scratch pattern. Clean floor thoroughly after this pass. Step five: apply Euclid diamond hard liquid densifier/sealer at 700 square feet per gallon. Step six: burnish/polish concrete floor with 800 grit diamond impregnated pads
- Step seven: burnish/polish concrete floor with 1500 grit diamond impregnated pads Polish results: perform polishing process to reach a specified overall gloss value (SOGV) of ≥35 as measured with a HORIBA ig-320, and a specified minimum gloss reading (SMGV) of \geq 30. The trained applicator shall take four gloss measurement readings at 90° from each other, and then averaged for one reading at each location. A minimum of 25 readings shall be taken throughout the interior slab on ground. The overall measurement shall be reported to general contractor within 24 hours of the polishing process. Gloss shall be considered a quantitative value that expresses the degree of reflection when light hits the concrete floor surface. Gloss measurements will be taken independent of ambient lighting and will be taken within a sealed measurement window located

3.08 URETHANE EXPANSION JOINT SEALANT APPLICATION

- Urethane Joint Sealant Application: Apply joint sealants in accordance with manufacturer's written instructions.
- Back-up material a. Install appropriate size backer rod, larger than the joint where necessary per manufacturer's recommendations and in a manner to provide concave sealant profile. Where joint depth does not permit installation of backer rod, install adhesive-backed
- polyethylene bond-breaker tape along the entire back of joint to prevent 3-sided adhesion of Sealant: Verify that the temperature and moisture conditions are within manufacturer's acceptable limits. Using fresh sealant and equipment that is in proper working order, completely fill joint with
- sealant, filling from bottom up to avoid entrapping air. Using clean, dry tool with rounded edge and of appropriate width for each joint, tool freshly installed sealant to provide preferred concave profile, to ensure intimate contact between sealant and substrate and to provide neat appearance. Where surface aggregate does not permit proper tooling, install sealant and backer rod so that face of joint is recessed behind exposed aggregate and sealant is bonded to firm, even surface. Use dry tooling method. Do not use tooling agents such as soapy water or tooling agents that have not been approved by sealant manufacturer.

UNLESS OTHERWISE NOTED BY TSC, CONCRETE FLOOR SLAB SHALL BE CAST AS ONE CONTINUOUS POUR. CONTRACTOR SHALL PROVIDE TERMITE PROTECTION. APPLY TERMITICIDE TO SUB-BASE BEFORE CONCRETE IS POURED. PROVIDE ONE GALLON OF DILUTED TERMITICIDE PER 10 SQUARE FEET OF SLAB AREA. APPLY AN ADDITIONAL 2-4 GALLONS PER 10 LINEAR FEET AT THE FOUNDATION PERIMETER.

NOTE: THIS SPEC IS WRITTEN AROUND ASTM STANDARDS. GENERAL CONTRACTOR AND DEVELOPER SHALL BE RESPONSIBLE FOR OVERALL QUALITY OF PRODUCTS SELECTED AND WORKMANSHIP OF SLAB.

ARCHITECT AND CONTRACTOR TO PAY SPECIAL ATTENTION TO ACHIEVE DESIGN THAT PREVENTS THE CONCRETE FROM HEAVING AT ALL DOORWAYS ESPECIALLY IN COLD WEATHER LOCATIONS.

ARCHITECTURE

2934 Sidco Drive Architecture Suite 120 Nashville, TN 37204 Interior Architecture


formerly WiSEngineers **Experience Structural Expertise** Atlanta, Boca Raton, Charlotte, Chattanooga, Knoxville, Nashville, Orlando, Raleigh **1964 - 2024 Celebrating 60 Years of Structural Excellence**

Tel 615 782 0100 Copyright 2024 • Bennett & Pless, Inc. All Rights Reserved **B & P Job Number** 24.02.102

565 Marriott Drive, Suite 300

Nashville, Tennessee 37214





TRACTOR SUPPLY COMPANY

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action

Job Number: 05.10.2024

CONCRETE SPECIFICATIONS

UNIT NUMBER	RTU-1, 2, 3,	& 4	RTU-5			_	TOTA
AREA SERVED	RETAIL SALES	STOCKROOM	EMPLOYEE LOUNGE	OFFICE	CORRIDOR	I.T. CLOSET	
AREA (SQ. FT)	15,416	4,945	246	78	238	58	
NO. PEOPLE/1000 SQ. FT. (TABLE 403.3)	15	N/A	50	5	-	_	
PEOPLE QUANTITY	50***	N/A	10 *	1	_	_	
AIRFLOW PER PERSON (TABLE 403.3)	7.5	N/A	5	5	_	_	
CFM / SQ. FT.	.12	.12	.06	.06	.06	.06	
TOTAL O.A. REQUIRED (CFM)	2,225	NAT. VENTILATION**	65	10	15	5	2,320
WITH VENTILATION EFFICIENCY = .8	2,785	NAT. VENTILATION**	85	15	20	10	2,915
TOTAL O.A. PROVIDED (CFM)	2,790	NAT. VENTILATION**	85	15	20	10	2,920

** OPERABLE OPENING AREAS IN STOCKROOM EXCEEDS 4% OF FLOOR SPACE PER IMC SECTION 402.2.

*** MAXIMUM OCCUPANCY BASED ON OWNER FURNISHED DATA

	TRACTOR	SUPPLY LIGHTI	NG & HE	ATING S	3CHEDUL	.E	
		BUILDING LIGHTS WALL PACKS	BUSINESS LIGHTS	EMPLOYEE LIGHTS	HEATING	COOLING	SUNDAY
ON	DUSK (BY PHOTOCELL)	DUSK TO DAWN PHOTOCELL (ALWAYS ON DURING DARK)	7:30 AM	7:30 AM		74 DEGREES AT 8:00 AM	SAME TEMPS AT 10:00 AM
OFF	9:15 PM	DURING THE DAY	8:30 PM	8:30 PM		80 DEGREES AT 9:00 PM	SAME TEMPS AT 6:00 PM
LIGHTING CONTROL ZONE	LZ-3	LZ-2	LZ-1B	LZ-1A			
	THE SYSTEM CAN BE OVERI OR LATER THAN NORMAL S		SWITCH IN CA	SE THE STO	RE IS OPEN EA	ĀRLIER	•
CONTRACTOR		PROGRAMMING ALL NON EM	MS CONTROLLED D WITH OWNER	D THERMOSTA R/EMS SYSTEI	ATS AND LIGHTI M PROVIDER A		

CONS	TRUCI	ΓION	NOT	ES
00110				

- FURNISH AND INSTALL CONCENTRIC DIFFUSER AND PLENUM WITH 18"x28" SUPPLY AND RETURN CONNECTIONS BY RUSKIN ROOFTOP SYSTEMS MODEL 01-530-22 OR APPROVED EQUAL. REFER TO SHEET M2.0 "CONCENTRIC DIFFUSER DETAIL".
- FURNISH AND INSTALL 2'x2' ADJUSTABLE MODULATING SUPPLY AIR DEVICE, THERMA-FUSER BY ACUTHERM, MODEL TF-HC-8 WITH 8" COLLAR. SET AT 72°F HEATING AND COOLING AND 165 CFM MAX FLOW. FURNISH COMPLETE WITH INSULATED BACKING AND 10% ADJUSTABLE SCREW FLOW STOP.
- FURNISH AND INSTALL VAV DAMPER BY ZONEX, MODEL STMPD10, WITH SAMOD THERMOSTAT, TR-1 24V TRANSFORMER, AND TS-1 DUCT TEMPERATURE SENSOR. BALANCE SUPPLY AIRFLOW TO 290 CFM.
- ROUTE MCD LINE ON ROOF AT 1/8" PER FOOT TOWARD DRAIN. REFER TO DETAIL
- MOUNT THERMOSTAT 48" A.F.F.

FOR PIPE SUPPORT INSTALLATION.

- MOUNT THERMOSTAT 90" A.F.F. ON POLE FACING AWAY FROM NEAREST DIFFUSER.
- CONTRACTOR SHALL VERIFY SUPPLY AND RETURN DUCT FROM UNIT FALLS WITHIN CORE AREA WALLS TO DECK.
- EXTEND 4" SINGLE WALL POLYPROPYLENE VENT SYSTEM MEETING U.L. 1738 STANDARDS, FOR GAS FLUE AND COMBUSTION AIR INTAKE UP TO CONCENTRIC VENT KIT THRU ROOF. SIZE COMBUSTION AIR AND FLUE PIPING AND INSTALL CONCENTRIC VENT KIT THRU ROOF PER MANUFACTURER'S RECOMMENDATIONS.
- 9 10" Ø RETURN DUCT OPEN TO SPACE. CAP WITH WIRE MESH PROVIDE MANUAL VOLUME DAMPER IN RETURN AIR DUCT AND BALANCE FOR 290 CFM.
- SET THERMOSTAT 60°F HEATING WINTER, 78° COOLING SUMMER. MOUNT THERMOSTAT 72" A.F.F.
- 11) FURNISH AND INSTALL TYPE "B" DOUBLE WALL FLUE FROM GF-1 THRU BACK WALL OF VESTIBULE ABOVE MAIN ROOF A MINIMUM 12" ABOVE ANTICIPATED SNOW

LEVEL. SIZE FLUE PIPING PER MANUFACTURER'S RECOMMENDATIONS.

- FURNISH AND INSTALL 18"X14" SIDEWALL SUPPLY AIR GRILLE, TITUS MODEL 300FS OR APPROVED EQUAL. COLOR PER ARCHITECT. COORDINATE EXACT LOCATION WITH GRILLE MOUNTING DETAIL LOCATED ON SHEET A4.0
- 13 FURNISH AND INSTALL 24"X10" SIDEWALL RETURN AIR GRILLE, TITUS MODEL 350FL OR APPROVED EQUAL. BALANCE TO 1200 CFM. COLOR PER ARCHITECT. COORDINATE EXACT LOCATION WITH GRILLE MOUNTING DETAIL LOCATED ON SHEET
- FURNISH AND INSTALL 8"X10" SIDEWALL SUPPLY AIR GRILLE, TITUS MODEL 300FS WITH DOUBLE DEFLECTION DAMPER, OR APPROVED EQUAL. BALANCE TO 300 CFM. COLOR PER ARCHITECT. COORDINATE EXACT LOCATION WITH GRILLE MOUNTING
- FURNISH AND INSTALL TWO (2) 3'-6" LINEAR DIFFUSERS, 85 CFM PER FOOT, (3) 34" SLOTS, 600 TOTAL CFM. TITUS MODEL ML-38 OR APPROVED EQUAL WITH 12" DEEP PLENUM BOX. COLOR PER ARCHITECT.
- MOUNT THERMOSTAT 60" A.F.F.


DETAIL LOCATED ON SHEET A4.0


FURNISH AND INSTALL CONCENTRIC DIFFUSER AND PLENUM WITH 18"x32" SUPPLY AND RETURN CONNECTIONS BY RUSKIN ROOFTOP SYSTEMS MODEL 01-530-50 OR APPROVED EQUAL. REFER TO SHEET M2.0 "CONCENTRIC DIFFUSER DETAIL".

	MECHANICAL LEGEND				
SYMBOL	DESCRIPTION				
	NEW SUPPLY AIR DUCTWORK				
	NEW RETURN AIR DUCTWORK				
	NEW EXHAUST AIR DUCTWORK				
→	MANUAL VOLUME DAMPER				
	CEILING DIFFUSER				
	CEILING RETURN AIR GRILLE				
	CEILING MOUNTED EXHAUST FAN				
® 200 CFM	SUPPLY CFM				
A.F.F.	ABOVE FINISHED FLOOR				
O.A.	OUTSIDE AIR				
—мср—	MECHANICAL CONDENSATE DRAIN				
SD	DUCT MOUNTED SMOKE DETECTOR				
EF-1	EQUIPMENT LABEL (SEE MECH. SCHEDULE FOR INFO.)				
T	THERMOSTAT				
-	AIR FLOW				
Δ	UNDERCUT DOOR ¾"				

GENERAL NOTES: - THERMOSTATS SERVING RTU-1, 2, 3, & 4 SHALL BE INTERLOCKED IN ORDER TO PREVENT SIMULTANEOUS HEATING/COOLING. - REFER TO SHEET E3.1 FOR THERMOSTAT MOUNTING DETAILS. - RETURN AIR GRILLE FLOW QUANTITIES SHOWN INDICATE 100% AIR FLOW RETURN DURING UNOCCUPIED HOURS OF OPERATION

LIVE GOODS CENTER

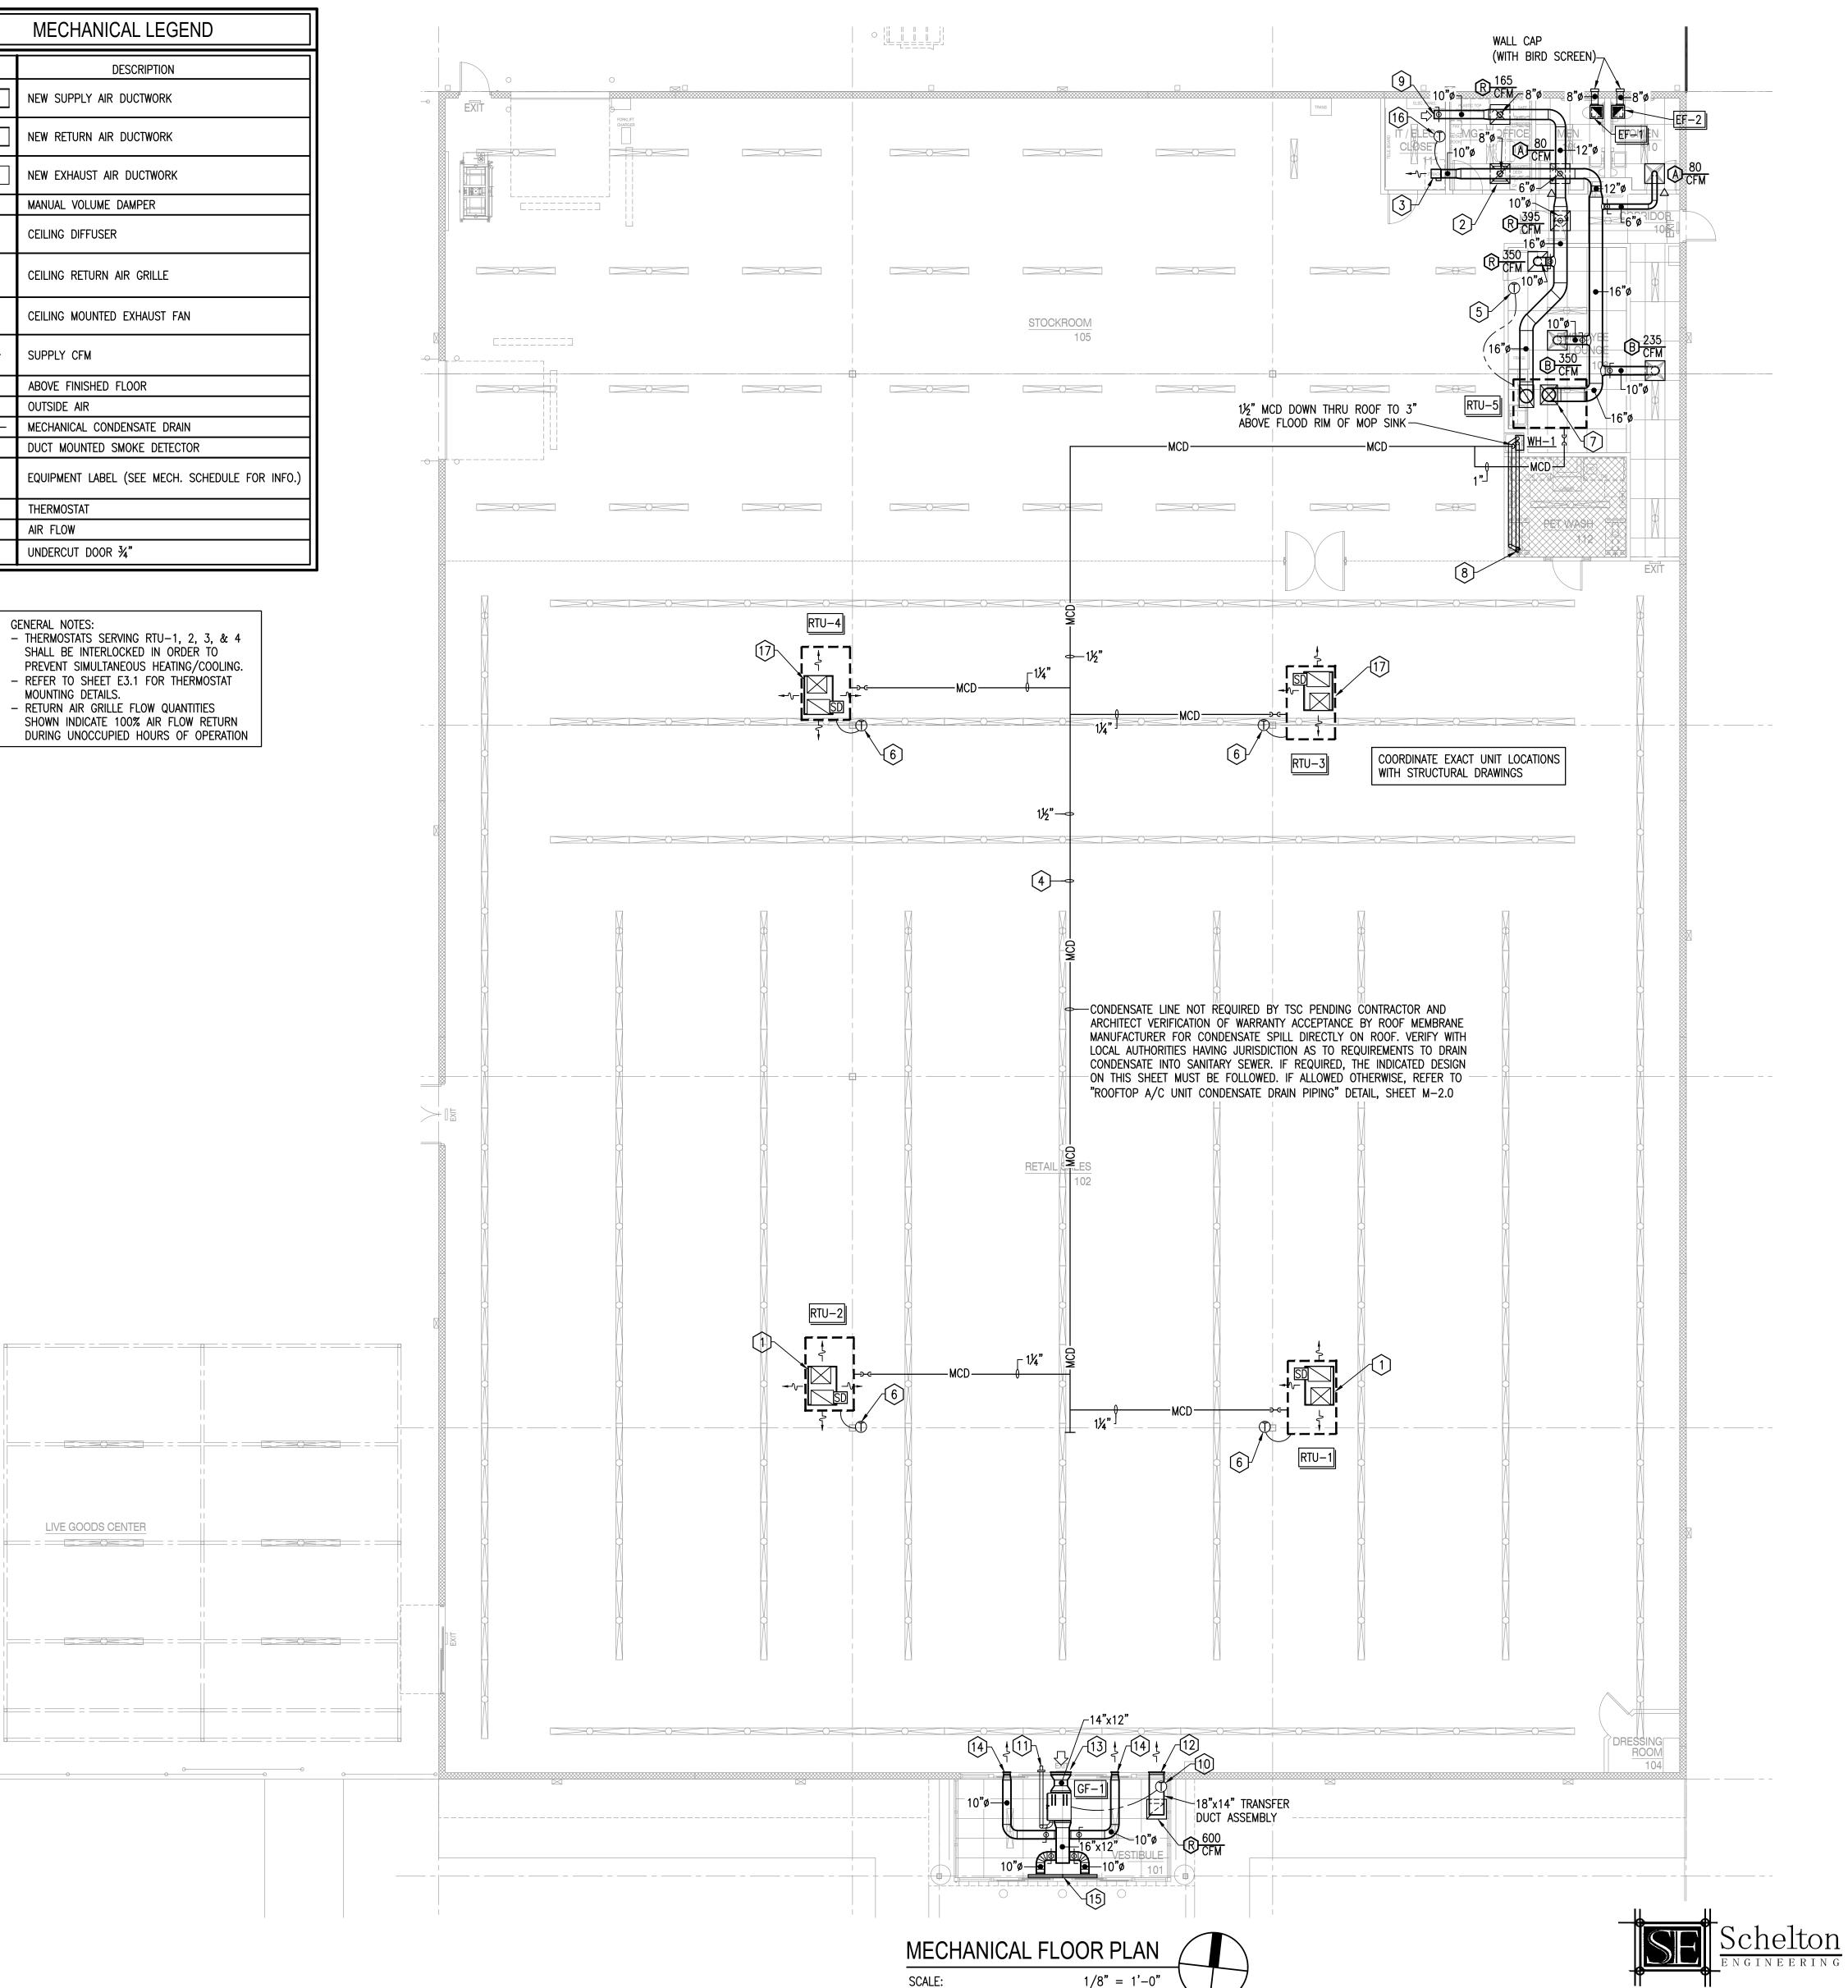



2934 Sidco Drive Suite 120 Nashville, TN 371204rior Architecture



This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

Job Number: 05.10.2024 Revisions: Revisions: MECHANICAL FLOOR PLAN

Sheet Number:

1163 West Main St. Franklin, TN 37064

Project #24-048

Tel: 615.730.9111 / Fax: 615.224.3599 gary@scheltonengineering.com

HEATING, VENTILATING AND AIR CONDITIONING SPECIFICATIONS

PART 1 GENERAL

- FURNISH ALL MATERIALS, LABOR, TOOLS, TRANSPORTATION AND INCIDENTALS TO COMPLETE IN EVERY DETAIL, AND LEAVE IN WORKING ORDER ALL ITEMS CALLED FOR HEREIN OR SHOWN ON THE ACCOMPANYING DRAWINGS.
- 2. IT IS THE RESPONSIBILITY OF CONTRACTOR TO READ ALL SPECIFICATIONS AND CONSULT ALL DRAWINGS WHICH MAY AFFECT THE INSTALLATION AND COORDINATION OF HIS WORK WITH OTHER TRADES. CONTRACTOR SHALL COORDINATE AND MAKE MINOR ADJUSTMENTS IN LOCATION OF EQUIPMENT AND MATERIALS AS NECESSARY TO SECURE COORDINATION.
- 3. LAYOUT SHOWN IN DRAWINGS IS BASED ON A PARTICULAR MAKE OF EQUIPMENT. CONTRACTOR SHALL PROVIDE SIX SUBMITTAL SETS OF SHOP DRAWINGS TO ENGINEER FOR APPROVAL PRIOR TO STARTING WORK. IF ANOTHER MAKE OF EQUIPMENT IS DESIRED, THESE SUBMITTALS SHALL ALSO SHOW ALL REQUIRED MODIFICATIONS AND CHANGES, INCLUDING THOSE INVOLVING OTHER TRADES, AND COST THEREOF SHALL BE INCLUDED IN HIS BID. REQUESTS FOR SUBSTITUTION OF PRODUCTS NOT SPECIFICALLY NAMED SHALL BE SUBMITTED IN WRITING A MINIMUM OF TEN (10) CALENDAR DAYS PRIOR TO THE BID DATE. REQUESTS SHALL INCLUDE DESCRIPTION OF ITEM(S), NAME OF MANUFACTURER TO BE SUBSTITUTED AND CATALOG DATA. REQUESTS SHALL BE REVIEWED ONLY TO APPROVE OR REJECT SUBMISSION OF PRODUCT. DETAILED SUBMITTALS SHALL BE SUBMITTED AS NOTED IN OTHER PORTIONS OF THIS SPECIFICATION. DO NOT SUBSTITUTE MATERIALS, EQUIPMENT OR METHODS UNLESS SUCH SUBSTITUTION HAS BEEN APPROVED IN WRITING. DO NOT ASSUME THAT MATERIALS, EQUIPMENT OR METHODS WILL BE APPROVED UNTIL SPECIFIC WRITTEN APPROVAL HAS BEEN GIVEN. THE BURDEN OF PROOF FOR REQUESTED SUBSTITUTIONS RESTS WITH THE CONTRACTOR. CONTRACTOR MUST RECEIVE APPROVED SUBMITTAL COPY, SIGNED BY ENGINEER BEFORE PROCEEDING WITH ANY MODIFICATIONS. WORK INSTALLED USING UNAPPROVED SUBSTITUTIONS SHALL BE REPLACED AT NO ADDITIONAL COST TO THE OWNER.
- 4. CONTRACTOR SHALL VISIT THE SITE AND FULLY INFORM HIMSELF CONCERNING ALL CONDITIONS AFFECTING SCOPE OF WORK, FAILURE TO DO SO SHALL NOT RELIEVE CONTRACTOR OF ANY RESPONSIBILITY IN THE PERFORMANCE OF HIS WORK. ALL WORKMANSHIP SHALL BE OF THE HIGHEST QUALITY IN ACCORDANCE WITH THE BEST PRACTICES OF THE TRADE BY CRAFTSMEN SKILLED IN THIS PARTICULAR WORK. CONTRACTOR SHALL FILE ALL DRAWINGS, PAY ALL FEES AND OBTAIN ALL PERMITS AND CERTIFICATES OF INSPECTION RELATIVE TO THIS
- COMPLETED INSTALLATION SHALL CONFORM TO ALL APPLICABLE FEDERAL, STATE AND LOCAL CODES AND ORDINANCES, INCLUDING BUT NOT LIMITED TO THE LATEST APPROVED EDITIONS OF THE FOLLOWING: STATE BUILDING CODE, INTERNATIONAL BUILDING CODE, INTERNATIONAL MECHANICAL CODE, INTERNATIONAL ENERGY CONSERVATION CODE
- NFPA-90A, NFPA-101, NFPA-54, ALL EQUIPMENT SHALL BE ARI CERTIFIED AND U.L. LISTED.
- SYSTEM LAYOUT IS SCHEMATIC AND EXACT LOCATIONS SHALL BE DETERMINED BY STRUCTURAL CONDITIONS, COORDINATION WITH OTHER TRADES, COORDINATION WITH FINISHES AND OTHER CONDITIONS. STRUCTURAL SUPPORTS SHALL NOT BE CUT OR ALTERED TO ASSURE FIT OF HVAC SYSTEM.
- CONTRACTOR SHALL BE RESPONSIBLE FOR ALL DEFECTS. REPAIRS AND REPLACEMENTS IN MATERIALS AND WORKMANSHIP FOR A PERIOD OF ONE (1) YEAR AFTER FINAL PAYMENT IS APPROVED. CONTRACTOR SHALL HONOR FACTORY WARRANTIES ON ALL EQUIPMENT PROVIDED AS PART OF THIS SYSTEM. COMPRESSORS SHALL BE PROVIDED WITH A MINIMUM OF FIVE (5) YEAR (PARTS ONLY) WARRANTY.
- 8. UPON COMPLETION OF PROJECT, ALL SYSTEM EQUIPMENT AND MATERIALS SHALL BE IN NEW, CLEAN CONDITION WITH ALL DAMAGE RESTORED TO ACCEPTABLE CONDITION. ALL EQUIPMENT, COMPONENTS AND DUCTWORK SHALL BE INSPECTED AND THOROUGHLY CLEANED, READY FOR USE. AT COMPLETION OF JOB, ALL MISCELLANEOUS TOOLS, SCAFFOLDING, SURPLUS MATERIALS, RUBBISH AND DEBRIS SHALL BE REMOVED BY CONTRACTOR.
- 9. IF HVAC EQUIPMENT IS USED FOR TEMPORARY HEATING, ETC., THE CONTRACTOR SHALL ASSUME THE RESPONSIBILITY FOR CLEANING FILTERS, COILS, ETC. FINAL PERMANENT CONNECTIONS OF SERVICES TO UNITS SHALL BE COMPLETE PRIOR TO ANY START-UP OF EQUIPMENT.
- 10. WHERE PIPES, DUCTS, ETC., ARE TO PASS THROUGH WALLS, FLOORS, ETC. SLEEVES SHALL BE PROVIDED PRIOR TO WALL CONSTRUCTION. SLEEVES SHALL BE OF EQUAL OR GREATER GAUGE METAL THAN PIPES OR DUCTS PASSING THROUGH. WHERE SLEEVES PENETRATE EXTERIOR SURFACES. VOIDS SHALL BE SEALED WATER TIGHT. WHERE SLEEVES PASS THROUGH RATED PARTITIONS, SLEEVE PACKING SHALL BE OF U.L. LISTED FIRE SAFE TYPE.
- 11. CONTRACTOR SHALL SUBMIT THREE SETS (3) OF INSTRUCTION BOOKS, INCLUDING INSTALLATION, OPERATION AND MAINTENANCE INSTRUCTIONS, PAMPHLETS OR BROCHURES AND ALL EQUIPMENT WARRANTIES OBTAINED FROM EACH MANUFACTURER OF EQUIPMENT.

PART 2 PRODUCTS

1. HEATING AND COOLING EQUIPMENT

SCALE:

- A. NEW ROOFTOP UNITS SHALL BE THE YORK PREDATOR/SUNLINE SERIES OR LENNOX "L SERIES" ROOFTOP UNITS WITH ELECTRIC COOLING AND GAS HEATING. THE MECHANICAL CONTRACTOR SHALL CONTACT YORK AT 405-419-6531 OR LENNOX AT 404-403-7083 TO REQUEST PRICING AND TECHNICAL SUPPORT ON THE TRACTOR SUPPLY COMPANY NATIONAL ACCOUNT.
- B. UNIT SHALL BE FACTORY ASSEMBLED, TESTED AND HAVE COMPLETE REFRIGERANT — 410A CHARGE, READY TO OPERATE. ALL TUBING JOINTS SHALL BE BRAZED. COIL SHALL BE MINIMUM OF 3-ROWS DEEP.

- C. FAN SHALL BE STATICALLY AND DYNAMICALLY BALANCED, DOUBLE INLET, FORWARD CURVED BLOWER CAPABLE OF DELIVERING DESIGN CFM. FAN SHALL BE QUIET IN OPERATION AND INTERNALLY VIBRATION ISOLATED.
- D. EQUIPMENT SHALL BE COMPLETELY FACTORY WIRED WITH ALL CONTROL AND PROTECTIVE DEVICES. ALL ROOFTOP EQUIPMENT 2000 CFM OR OVER SHALL HAVE SMOKE DETECTOR AND CONTROLS FOR SMOKE DETECTORS SHUTDOWN.
- E. FURNISH AND INSTALL CONDENSATE DRAIN PAN FLOAT SWITCH IN PRIMARY DRAIN PAN, DIVERSITECH MODEL CC-1 OR APPROVED EQUAL. INTERLOCK WITH DEDICATED UNIT FOR UNIT SHUTDOWN.
- A. FANS SHALL BE EQUAL TO THE MAKE AND MODEL(S) INDICATED AND SHALL BE LOCATED AS SHOWN ON DRAWINGS. FANS SHALL BE PENN, ACME, LOREN COOK OR GREENHECK.
- B. FANS SHALL BE FURNISHED COMPLETE WITH VIBRATION ISOLATION, PLUG TYPE DISCONNECT, NON-YELLOWING PLASTIC GRILLE, THERMAL OVER LOAD PROTECTION, AND INSULATED HOUSING.

ROOF CURBS

- A. CONTRACTOR SHALL PROVIDE ALL ROOF CURBS FOR ROOF MOUNTED EQUIPMENT. PREFAB ROOF CURB ASSEMBLIES SHALL BE GALVANIZED STEEL WITH WOOD NAILER STRIP. PITCHES SHALL MATCH SLOPE OF ROOF TO PROVIDE LEVEL EQUIPMENT MOUNTING.
- 4. DUCTWORK AND INSULATION
- A. ALL DUCTWORK SHALL BE SHEETMETAL EXCEPT AS NOTED. CONSTRUCTION STANDARDS AND RECOMMENDATIONS OF SMACNA SHALL BE FOLLOWED WITH RESPECT TO CONSTRUCTION, INSTALLATION AND SUPPORTING OF ALL DUCTWORK. ALL JOINTS LONGITUDINAL AND TRANSVERSE SEAMS SHALL BE SEALED WITH GASKETS, MASTICS (ADHESIVES), TAPES, ETC. ALL SEALANT MATERIAL SHALL BE LISTED IN ACCORDANCE WITH UL 181A OR 181B.
- B. DIMENSIONS FOR SHEETMETAL WORK ON DRAWINGS ARE INSIDE CLEAR UNLESS OTHERWISE NOTED.
- C. ALL CONCEALED SUPPLY AND RETURN DUCTS SHALL BE EXTERNALLY INSULATED WITH 2" THICK FIBERGLASS FLEXIBLE DUCT INSULATION WITH VAPOR BARRIER, MANVILLE CORPORATION, CERTAINTEED OR KNAUF. INSULATION MATERIALS AND COMPONENTS SHALL HAVE MAXIMUM COMPOSITE FIRE AND SMOKE HAZARD RATINGS OF 25 FLAME SPREAD, 50 SMOKE DEVELOPED AND 50 FOR FLAME SPREAD. APPLY VAPOR BARRIER JACKET TO COMPLETELY SEAL BARRIER AND REPAIR PUNCTURES. STAPLE ALL SEAMS AND SEAL WITH REINFORCED FOIL TAPE.
- D. EXPOSED SUPPLY AND RETURN DUCTS WITHIN CONDITIONED SPACE SHALL HAVE 1" THICK INTERNAL INSULATION AT 1.5 LB DENSITY, GLUED AND PINNED. WHERE INTERNAL LINER AND EXTERNAL WRAP MEET, THEY SHALL OVERLAP BY MINIMUM OF 6". INSULATION SHALL BE BY MANVILLE CORPORATION, CERTAINTEED OR KNAUF, PAINT PER ARCHITECT.
- E. TRUNK DUCTS SHALL BE ISOLATED FROM UNIT VIBRATION WITH THE USE OF NFPA AND U.L. APPROVED FLEXIBLE CONNECTORS IN BOTH SUPPLY AND RETURN.
- F. ALL ROUND DUCT SHALL BE SIZED AS SHOWN ON DRAWINGS. PROVIDE 2" THICK SLEEVE INSULATION TO PREVENT CONDENSATION. INSULATED FLEXIBLE DUCT MAY BE UTILIZED FOR CONNECTION TO GRILLES AND REGISTERS IN MAXIMUM LENGTHS OF 6'-0" PER BRANCH RUN. FLEXIBLE DUCT SHALL BE CERTAINTEED, WIREMOLD OR MANVILLE CORPORATION, FLEX METAL INSULATED WITH ACOUSTICAL VINYL VAPOR BARRIER, U.L. APPROVED WITH CONDUCTANCE .22 AT 75 DEGREES F. FLEXIBLE CONNECTIONS SHALL BE TESTED IN ACCORDANCE WITH UL181 AND LISTED AS CLASS 0 OR CLASS 1.
- G. ROUND PIPE TAKE-OFFS SHALL BE SPIN-IN OR AIR-TIGHT TYPE WITH DAMPERS, NO AIR SCOOPS. ALL ROUND PIPE TO BE CONNECTED WITH SHEET METAL SCREWS AND SUPPORTED WITH 1" METAL STRAP. RECTANGULAR TAKE-OFFS AND BRANCHES SHALL BE 45 DEGREE ANGLE BOOT OR TEE.
- H. RADIUSED DUCTWORK ELBOWS SHALL HAVE A CENTERLINE RADIUS OF 1.5 TIMES THE DUCT WIDTH (OR DIAMETER) UNLESS NOTED OTHERWISE.
- I. ALL MITERED ELBOWS (RECTANGULAR AND ROUND) SHALL HAVE DOUBLE THICKNESS TURNING VANES INSTALLED UNLESS NOTED OTHERWISE ON DRAWINGS.
- J. ALL DUCTWORK BRANCHES SHALL BE SUPPLIED WITH A VOLUME DAMPER FOR BALANCING. VOLUME DAMPER SHALL HAVE A 2" OFFSET TO ACCOMMODATE EXTERNAL INSULATION.

5. AIR DEVICES

- A. AIR DEVICES SHALL BE PRICE, TITUS OR METALAIRE WITH FRAME TYPE SUITABLE FOR CEILING FINISH. ALL CEILING DIFFUSERS WITHIN A SPACE SHALL HAVE UNIFORM FACE DIMENSIONS UNLESS OTHERWISE NOTED.
- B. CEILING DIFFUSERS SHALL BE SQUARE LOUVER TYPE WITH OPPOSED BLADE DAMPERS, OFF WHITE FINISH, SIZES AS SHOWN ON DRAWINGS.

C. SUPPLY AIR REGISTERS SHALL BE HORIZONTAL FACE TYPE WITH OPPOSED BLADE DAMPERS, ALUMINUM, OFF WHITE FINISH, SIZES AS SHOWN ON DRAWINGS.

- D. CEILING RETURN AIR AND EXHAUST GRILLES SHALL BE 1/2" x 1/2" EGGCRATE TYPE WITH OFF-WHITE FINISH, ALUMINUM, SIZES AS SHOWN ON DRAWINGS.
- E. SIDEWALL RETURN AIR GRILLES SHALL BE HORIZONTAL FACE TYPE OF ALUMINUM CONSTRUCTION, OFF-WHITE FINISH OR AS SPECIFIED BY OWNER, SIZE AS SHOWN ON DRAWINGS.

6. GAS FIRED EQUIPMENT

- A. ALL GAS FIRED EQUIPMENT SHALL BE AGA CERTIFIED.
- B. BURNERS SHALL BE EQUIPPED WITH CONTROLS AND SAFETIES REQUIRED FOR COMPLETE AND FULLY OPERATIONAL SYSTEM. PILOT SHALL BE INTERMITTENT ELECTRIC IGNITION TYPE.
- C. HEAT EXCHANGER SHALL BE PROVIDED WITH A MINIMUM TEN (10) YEAR (PARTS ONLY) WARRANTY.

7. FLUES AND VENTS

- A. CONTRACTOR SHALL FURNISH AND INSTALL ALL FLUES AND VENTS SERVING SEALED COMBUSTION FURNACES SHALL BE POLYPROPYLENE VENT SYSTEM MEETING U.L. 1738 STANDARDS. CENTROTHERM OR APPROVED EQUAL. FLUES AND VENTS SERVING 80% EFFICIENT ATMOSPHERIC BURNERS SHALL BE U.L. LISTED DOUBLE WALL TYPE B WITH SIZES AS INDICATED ON DRAWINGS. PROVIDE WINDPROOF VENT CAPS AT ALL FLUE OUTLETS.
- B. CONSTRUCTION AND HEIGHT OF FLUE ABOVE ROOF SHALL CONFORM TO REQUIREMENTS OF NFPA 54 AND LOCAL CODES.

8. SLEEVES

- A. PROVIDE 18 GAGE SLEEVING AT MASONRY WALLS, ETC.
- B. SEAL ALL PENETRATIONS OF RATED PARTITIONS WITH U.L. LISTED FIRE BARRIER MATERIAL.

9. CONTROLS

- A. LOW VOLTAGE VENDOR SHALL FURNISH. ROUTE, AND INSTALL CONTROL WIRING & THERMOSTATS FOR HVAC SYSTEMS INCLUDING GAS FURNACE, AND PACKAGED GAS UNITS. CONTROL WIRING CONNECTIONS TO BE MADE BY MECHANICAL CONTRACTOR. GC SHALL FURNISH AND INSTALL TEMPORARY THERMOSTATS.
- B. INSTALL THERMOSTATS AT 90" A.F.F. UNLESS NOTED OTHERWISE. THERMOSTAT LOCATIONS SHALL BE COORDINATED WITH FINAL LOCATIONS OF WALL-MOUNTED ARCHITECTURAL AND ELECTRICAL EQUIPMENT. FINAL LOCATIONS MUST BE APPROVED BY THE ARCHITECT AND OWNER. THERMOSTATS SHALL NOT BE INSTALLED ON EXTERIOR WALLS IF INTERIOR WALLS ARE AVAILABLE WITHIN SPACE SERVED BY THERMOSTAT. SHOULD THE THERMOSTAT REQUIRE INSTALLATION ON AN EXTERIOR WALL AN INSULATED BACKING PLATE MUST BE PROVIDED TO PREVENT FALSE READINGS BY THE THERMOSTAT.

10. CONDENSATE PIPING

A. CONDENSATE DRAINS SHALL BE CONSTRUCTED WITH SCHEDULE 40 PVC, CPVC PIPING, OR TYPE L HARD DRAWN COPPER, SIZE AND ROUTING INDICATED ON PLANS. COPPER DRAIN PIPE AND FITTINGS SHALL BE JOINED USING 95-5 SILVER SOLDER, PVC PIPE AND FITTINGS SHALL BE JOINED USING SOLVENT CEMENT. PROVIDE 1/2" THICK, CLOSED CELL ELASTOMERIC INSULATION, ARMAFLEX, RUBÁTEX OR APPROVED EQUAL, FROM UNIT CONNECTION TO DISCHARGE FOR ALL INTERIOR CONDENSATE DRAIN PIPING. PROVIDE P-TRAP WITH CLEANOUT AT EACH EQUIPMENT CONDENSATE DRAIN CONNECTION. PROVIDE POSITIVE SLOPE FOR CONDENSATE DRAIN PIPING FROM P-TRAP TO DISCHARGE, MINIMUM SLOPE 1/8" PER LINEAR HORIZONTAL FOOT. SUPPORT CONDENSATE PIPING AT 5'-0" MAXIMUM INTERVALS.

PART 3 EXECUTION

- 1. FURNISH AND INSTALL SYSTEM IN ACCORDANCE WITH REFERENCED STANDARDS, APPLICABLE CODES, MANUFACTURERS RECOMMENDATIONS AND AS INDICATED ON DRAWINGS.
- 2. CONTRACTOR SHALL TEST AND BALANCE MECHANICAL SYSTEM. CONTRACTOR SHALL PROVIDE ALTERNATE PRICE FOR 3RD PARTY AABC CERITFIED TEST & BALANCE TO ASSURE CONFORMANCE WITH DESIGN. CONTRACTOR SHALL SUBMIT WRITTEN TEST AND BALANCE REPORT TO LOCAL CODE OFFICIALS AS REQUIRED.
- CONTRACTOR SHALL INSTRUCT THE OWNER'S REPRESENTATIVE IN ALL MATTERS PERTAINING TO THE PROPER MAINTENANCE OF EQUIPMENT FURNISHED UNDER THIS CONTRACT.
- 4. CONTRACTOR SHALL PROGRAM ALL THERMOSTATS FOR OCCUPIED/UNOCCUPIED HOURS OF OPERATION. HOURS OF OPERATION AND TEMPERATURE SET POINTS PER OWNERS REQUEST. FAN SHALL RUN CONTINUOUSLY DURING OCCUPIED HOURS.

	FAN SCHEE		
	FAIN SCHEL		
N IDENTIFICATION	EF-1	EF-2	
NUFACTURER	GREENHECK	GREENHECK	
DEL NUMBER	SP-A190	SP-A190	
RVICE AREA	MEN'S RR	WOMEN'S RR	
n type	CABINET CENT.	CABINET CENT.	
M	150	150	
Р	0.35	0.35	
NES	1.5	1.5	
TOR POWER	46 WATTS	46 WATTS	
LTAGE/PHASE	115/60/1ø	115/60/1ø	
IGHT	17 LBS	17 LBS	
CESSORIES REQUIRED	A,B,C	A,B,C	
CESSORIES: : BACKDRAFT DAMPER : WALL CAP : VARIABLE SPEED CONTROLLER	2		
MARKS:			

GAS FURNACE SCHEDULE						
IDENTIFICATION	GF-1					
MANUFACTURER	YORK					
MODEL NO.	TG8S100					
CFM	1200					
MOTOR H.P.	1/3					
VOLTAGE	120/1ø					
FILTERS	N/A					
MBH INPUT/OUTPUT	100 / 80					
WEIGHT	108					
ACCESSORIES REQUIRED	A,B					
ACCESSORIES: A: THERMOSTAT WITH SUBBASE B: VIRRATION ISOLATION	(PER SPECIFICATIONS)					

- EF-1 & 2 SHALL BE INTERLOCKED WITH LIGHTSWITCH SERVING THEIR RESPECTIVE SPACES.

- B: VIBRATION ISOLATION
- HEATING CAPACITY BASE ON NATURAL GAS AT 1000 BTUH PER CUBIC FOOT AND .5 SPECIFIC GRAVITY. LOW VOLTAGE VENDOR TO PROVIDE, INSTALL AND PRE-WIRE FOR EMS. SEE DRAWING
- E-3A FOR DETAILS.

PACKA	GED GAS FIRE	D AC UNIT SCHEDU	LE 447 SQ FT. PER TON
IDENTIFICATION	RTU-1, 2	RTU-3, 4	RTU-5
MANUFACTURER	YORK	YORK	YORK
MODEL NUMBER	ZJ120N18	ZJ150N24	ZJ037N08
NOMINAL TONS	10	12-1/2	3
SEER	-	-	15.0
EER	12.0	12.0	12.2
VOLTAGE	480/3ø	480/3ø	480/3ø
UNIT M.C.A.	24.2	39.1	9.6
UNIT M.O.C.P.	30.0	50.0	15.0
TOTAL COOLING CAP. (MBH)	130.0	170.8	37.0
SENSIBLE COOLING CAP. (MBH)	96.0	121.3	26.8
FAN SECTION:			
CFM SUPPLY	4,000	5,000	1,200
CFM O.A. MIN	620	775	130
EVAP. FAN H.P.	3	5	1-1/2
ESP-IN WG.	.8	.8	.35
HEATING SECTION:			
FUEL	NAT. GAS	NAT. GAS	NATURAL GAS
HEATING INPUT (MBH)	180.0	240.0	80.0
HEATING OUTPUT MBH	144.0	192.0	65.0
FILTER	2"	2"	2"
OPERATING WT. (LBS.)	1,405	1,615	1,075
NOTES	1 THRU 22	1 THRU 22	1 THRU 8, 10 THRU 22

NOTES:

TRACTOR SUPPLY COMPANY HAS NATIONAL ACCOUNTS WITH YORK/JOHNSON CONTROLS & LENNOX. FOR YORK PLEASE EMAIL JOE.RAY@JCI.COM OR CALL 1-405-419-6613 FOR YORK/JOHNSON CONTROLS QUOTATIONS AND TECHNICAL SUPPORT. FOR LENNOX PLEASE EMAIL STEVEN.PETER@LENNOXIND.COM OR CALL 1-800-367-6285 FOR LENNOX QUOTATIONS AND TECHNICAL SUPPORT. ACCEPTABLE ALTERNATE MANUFACTURER: LENNOX 'L' SERIES. MUST BE COMPATIBLE WITH TSC FURNISHED EMS. MUST BE EQUAL TO OR BETTER THAN YORK PREDATOR/SUNLINE SERIES INCLUDING HINGED DOORS, HIGH EFFICIENCY, WARRANTY, AND MAINTENANCE REQUIREMENTS.

COOLING CAPACITIES BASED ON 80°F DB / 67°F WB ENTERING COIL, 95°F DB ENTERING CONDENSER. HEATING CAPACITY BASED ON NATURAL GAS AT 1000 BTU PER CUBIC FOOT AND 0.5 SPECIFIC GRAVITY.

- PROVIDE FACTORY FURNISHED 14" HIGH INSULATED ROOF CURB.
- PROVIDE FACTORY INSTALLED DIRTY FILTER SWITCH AND BLOWER PROVING SWITCH.
- PROVIDE 1 YEAR LABOR AND 3 YEAR PARTS WARRANTY. PROVIDE 5 YEAR PARTS WARRANTY ON COMPRESSORS.
- PROVIDE 10 YEAR HEAT EXCHANGER WARRANTY. 9. PROVIDE FACTORY INSTALLED SMOKE DETECTORS ON THE RETURN DUCT DISCHARGES.
- 10. PROVIDE FACTORY INSTALLED DIFFERENTIAL ENTHALPY ECONOMIZER AND BAROMETRIC RELIEF. O.A. DAMPER SHALL CLOSE DURING UNOCCUPIED HOURS.
- MECHANICAL CONTRACTOR SHALL PROVIDE A SECOND SET OF FILTERS TO BE INSTALLED PRIOR TO STORE OPENING. 2. UNIT SHALL USE R-410A REFRIGERANT (NO EXCEPTIONS).
- 13. MECHANICAL CONTRACTOR SHALL PROVIDE A START UP CHECKLIST CONFIRMING ALL UNITS HAVE BEEN PROPERLY
- STARTED AND CONFIRMED RUNNING PROPERLY. CHECKLIST MUST BE PROVIDED TO TSC VIA CLOSE-OUT BINDER. 14. STENCIL TAG NUMBER ON SIDE OF UNITS (FACING ROOF HATCH) WITH 3" HIGH LETTERS AND BLACK EXTERIOR PAINT.
- 15. NON-POWERED CONVENIENCE OUTLET. 16. PROVIDE COIL (HAIL) GUARDS.
- 7. ALL WORK TO INSTALL ALL CONTROL DEVICES AND WIRING SHALL BE COORDINATD BETWEEN THE GENERAL CONTRACTOR,
- MECHANICAL CONTRACTOR, ELECTRICAL CONTRACTOR, LOW VOLTAGE VENDOR, AND EMS VENDOR. 18. ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL ALL CONDUITS AND GANG BOXES FOR THERMOSTATS. SEE DRAWINGS E5.1
- FINAL CONNECTIONS TO FUTURE EMS. COORDINATE FINAL LOCATION OF EMX PANEL WITH EMS VENDOR. SEE DRAWING E5.1 FOR 20. MECHANICAL CONTRACTOR SHALL FURNISH AND INSTALL TEMPORARY THERMOSTATS AND WIRING FOR CONNECTION TO HVAC UNITS.
- VERIFY FINAL HEIGHT AND PROVIDE 5' OF ADDITIONAL COILED CABLE 1. LOW VOLTAGE VENDOR SHALL FURNISH AND INSTALL FINAL THERMOSTATS, CARBON DIOXIDE SENSORS, HUMIDITY SENSORS, AND PRE-WIRE FOR EMS. SEE DRAWINGS E5.1 FOR DETAILS.

19. ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL ALL CONDUITS AND GANG BOXES AS SHOWN ON E5.0. AS NECESSARY FOR I

REMARKS:

- PROVIDE POWER TO UNITS THROUGH KNOCK-OUTS, OR IN CURB. DO NOT PENETRATE ROOF. REFER TO E3.1 FOR THERMOSTAT MOUNTING INSTRUCTIONS.

22. FINAL CONTROL CONNECTIONS TO EMS PANEL TO BE MADE BY EMS VENDOR.

			AIR [DISTRIBUT	ION SCHE	DULE		
1	SYMBOL	MFGR. & MODEL #	DEVICE	FACE	DEVICE SIZE	VOLUME CONTROL	COLLAR SIZE	REMARKS
	A	TITUS MOD. TMSA-AA	SUPP. DIFF.	LOUVERED	24" x 24"	M.V.D.	6"ø	SEE NOTE 1-4
	B	TITUS MOD. TMSA-AA	SUPP. DIFF.	LOUVERED	24" x 24"	M.V.D.	10"ø	SEE NOTE 1-4
	R	TITUS MOD. 50 F	RET. GRILLE	EGGCRATE	24" x 24"			SEE NOTE 5

NO WOOD ALLOWED FOR PIPE SUPPORTS.

1. ALL AIR DEVICES TO HAVE COLOR PER ARCHITECT 2. PROVIDE ROUND NECK COLLARS FOR CEILING DIFFUSERS

- O.A. DAMPER SHALL CLOSE DURING UNOCCUPIED HOURS.

4. ALL SQUARE CEILING DIFFUSERS ARE TO BE FULL LOUVERED FACE (NO BLANK PANEL) 5. PROVIDE RETURN AIR GRILLES WITH NECK SIZE EQUIVALENT

UNLESS NOTED OTHERWISE. 3. PROVIDE LAY-IN TYPE BORDER FOR CEILING WITH ACOUSTICAL TO RUNOUT SHOWN ON DRAWING. TILE AND SURFACE MTD. TYPE BORDER FOR GYPBOARD CEILINGS (REFER ARCHITECTURAL DWG'S)

2934 Sidco Drive

Suite 120


ARCHITECTURE


Nashville, TN 3712004rior Architecture


Architecture



TRACTOR SUPPLY COMPANY

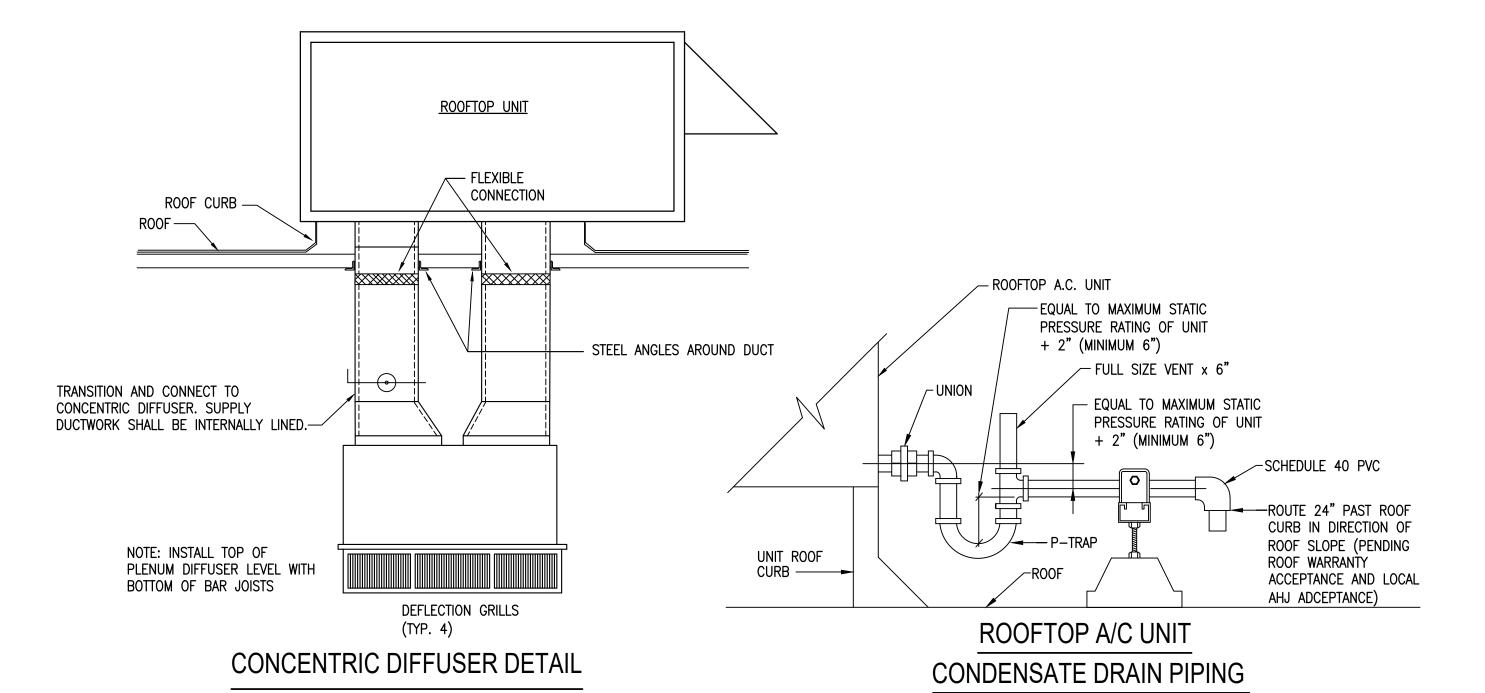

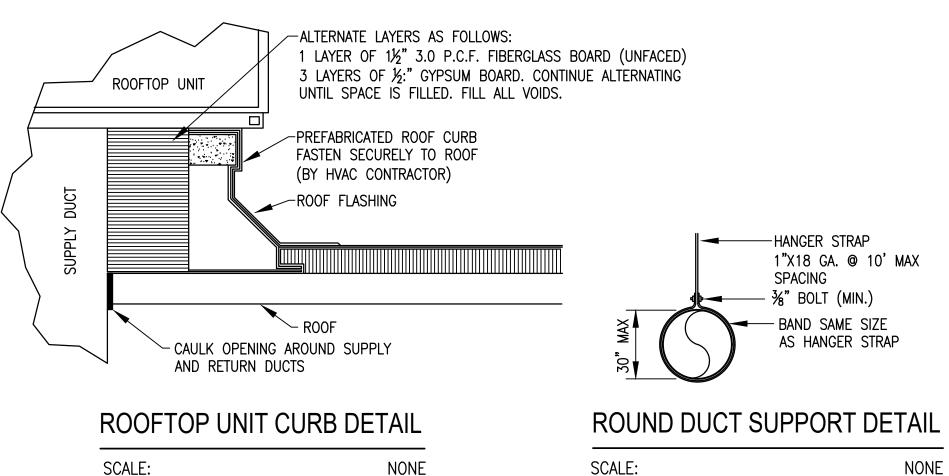

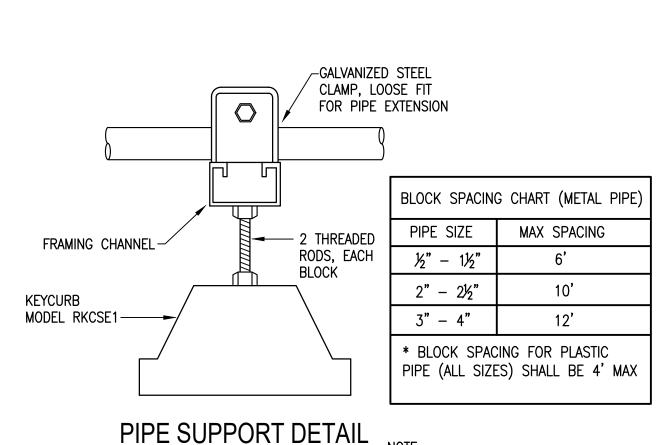




This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

05.10.2024 Revisions Revisions:

Job Number:

Revisions: MECHANICAL SCHEDULES, DETAILS, AND SPECIFICATIONS

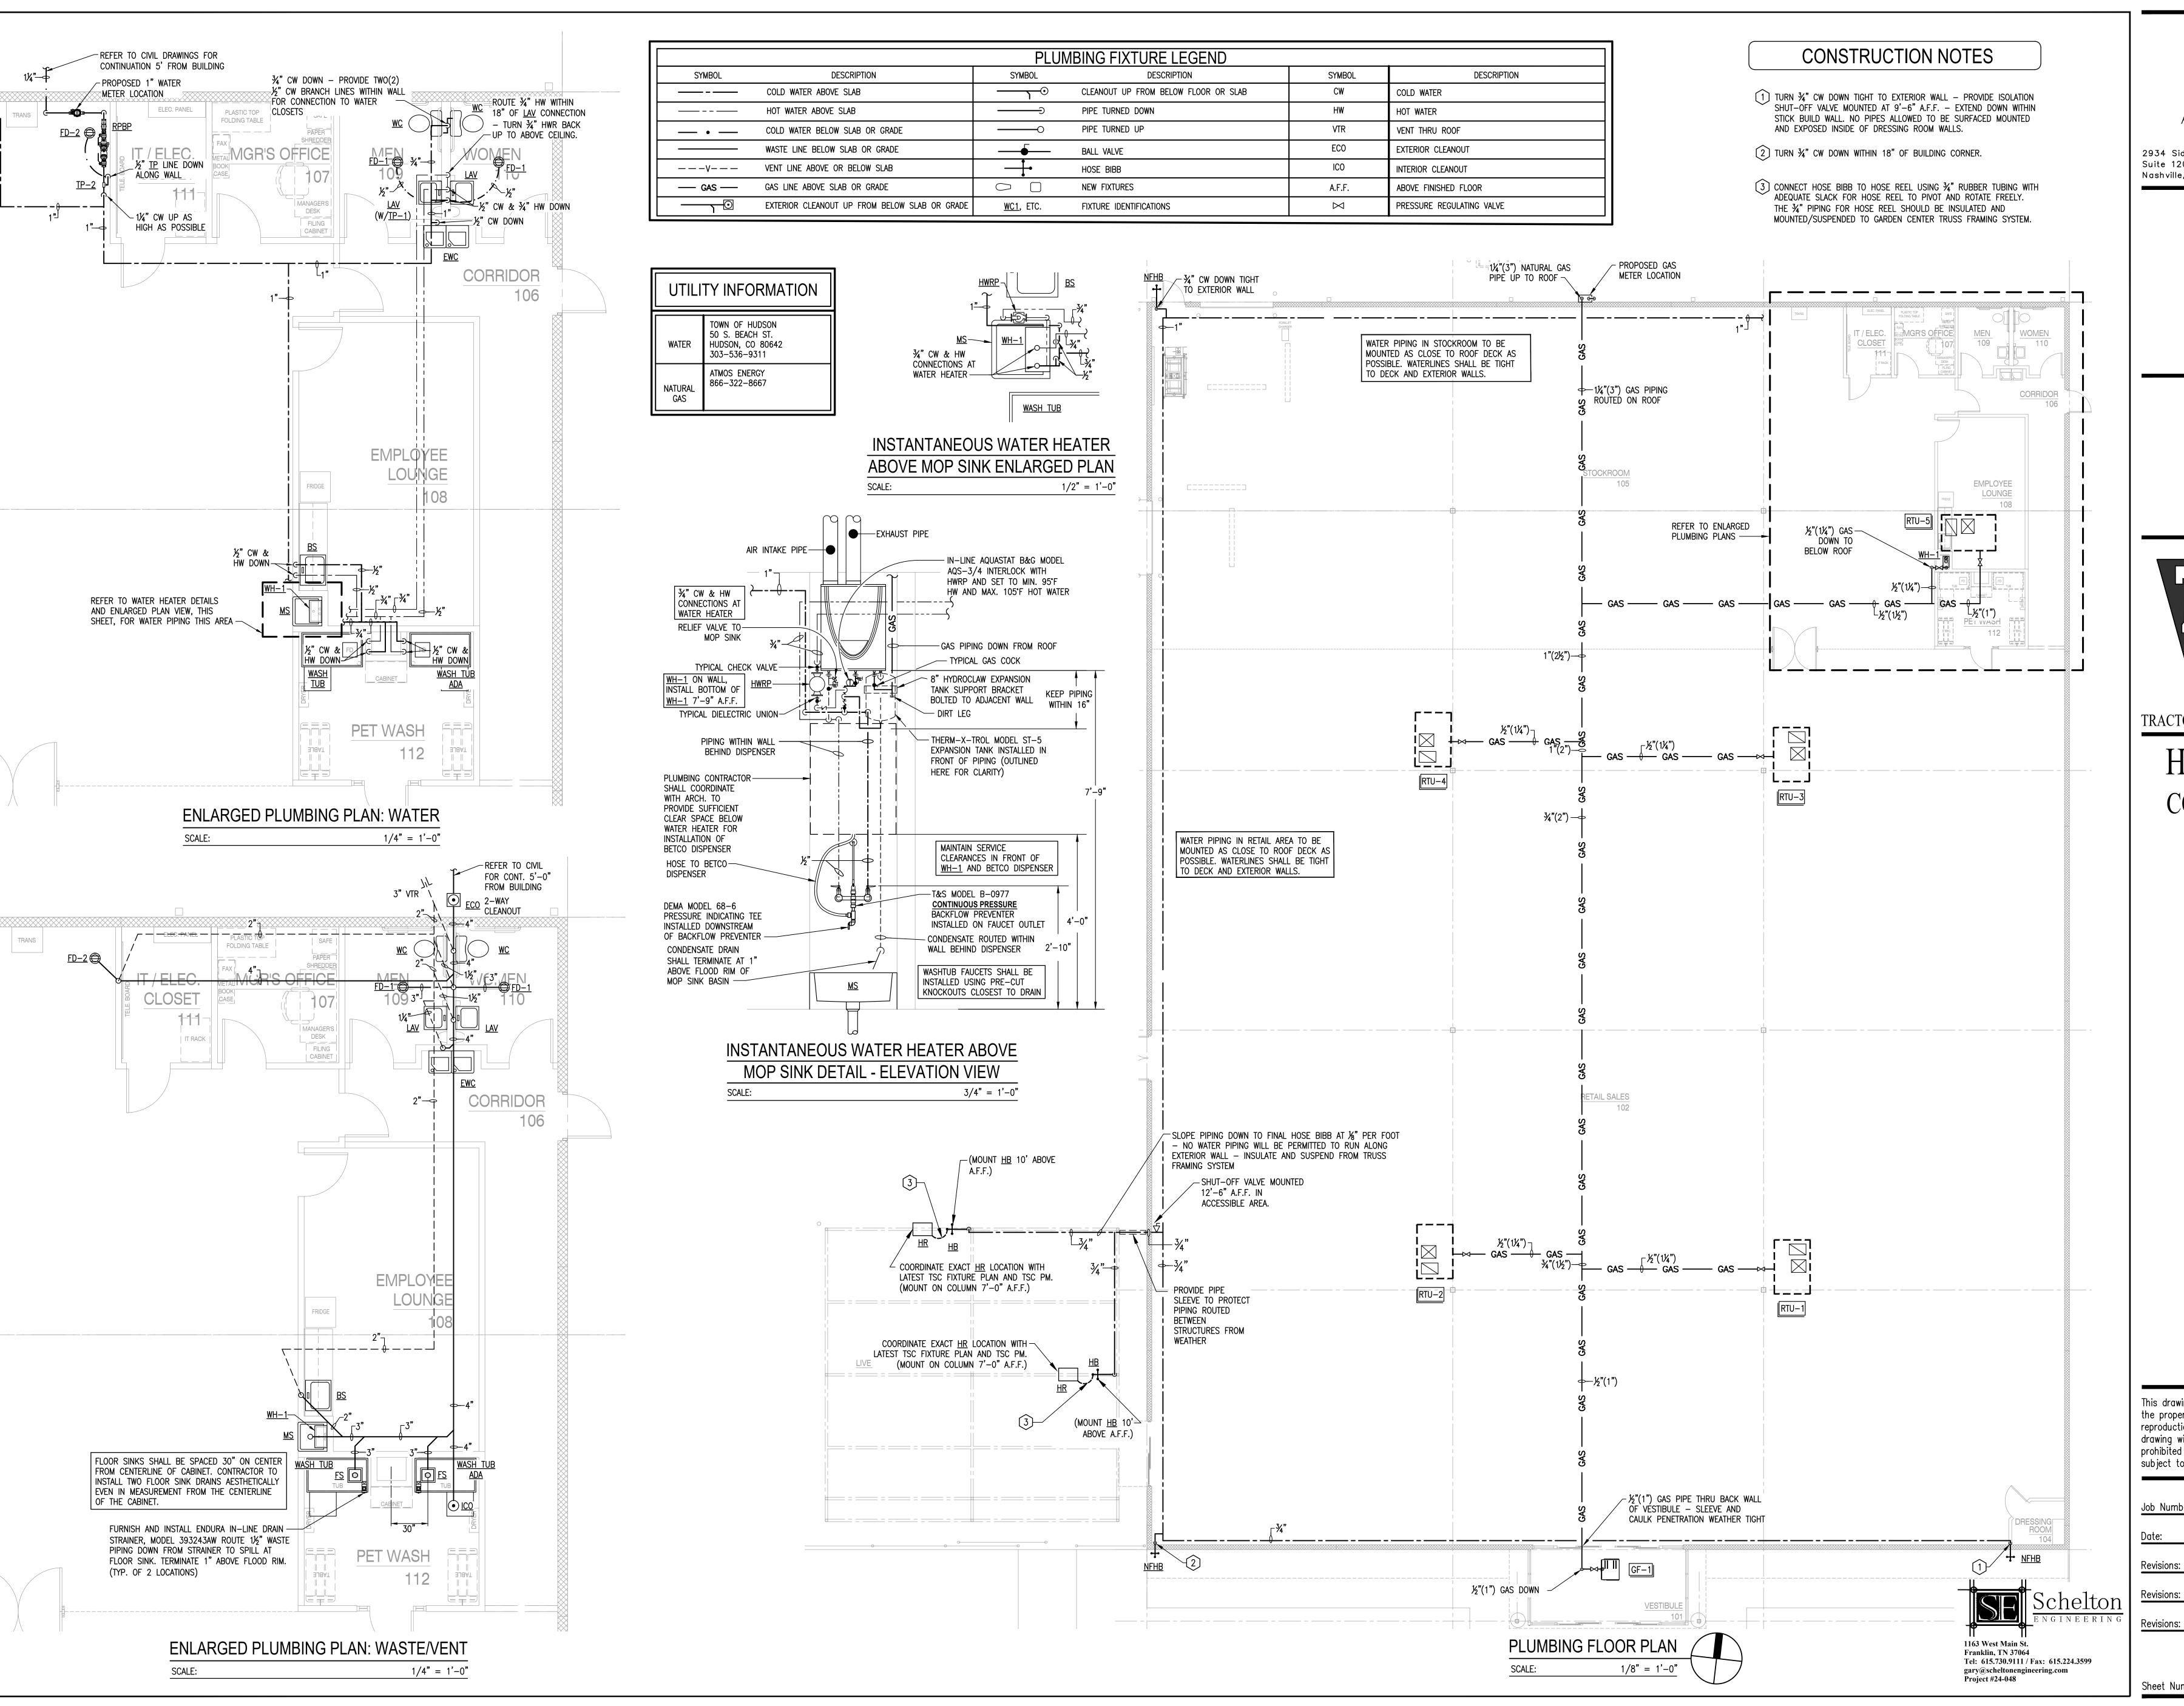



OXFORD ARCHITECTURE

2934 Sidco Drive Architecture Suite 120 Planning Nashville, TN 37½0¢4rior Architecture

TRACTOR SUPPLY COMPANY

HUDSON,

COLORADO


This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

 Job Number:
 23100


 Date:
 05.10.2024

evisions:


ions:
PLUMBING FLOOR PLAN

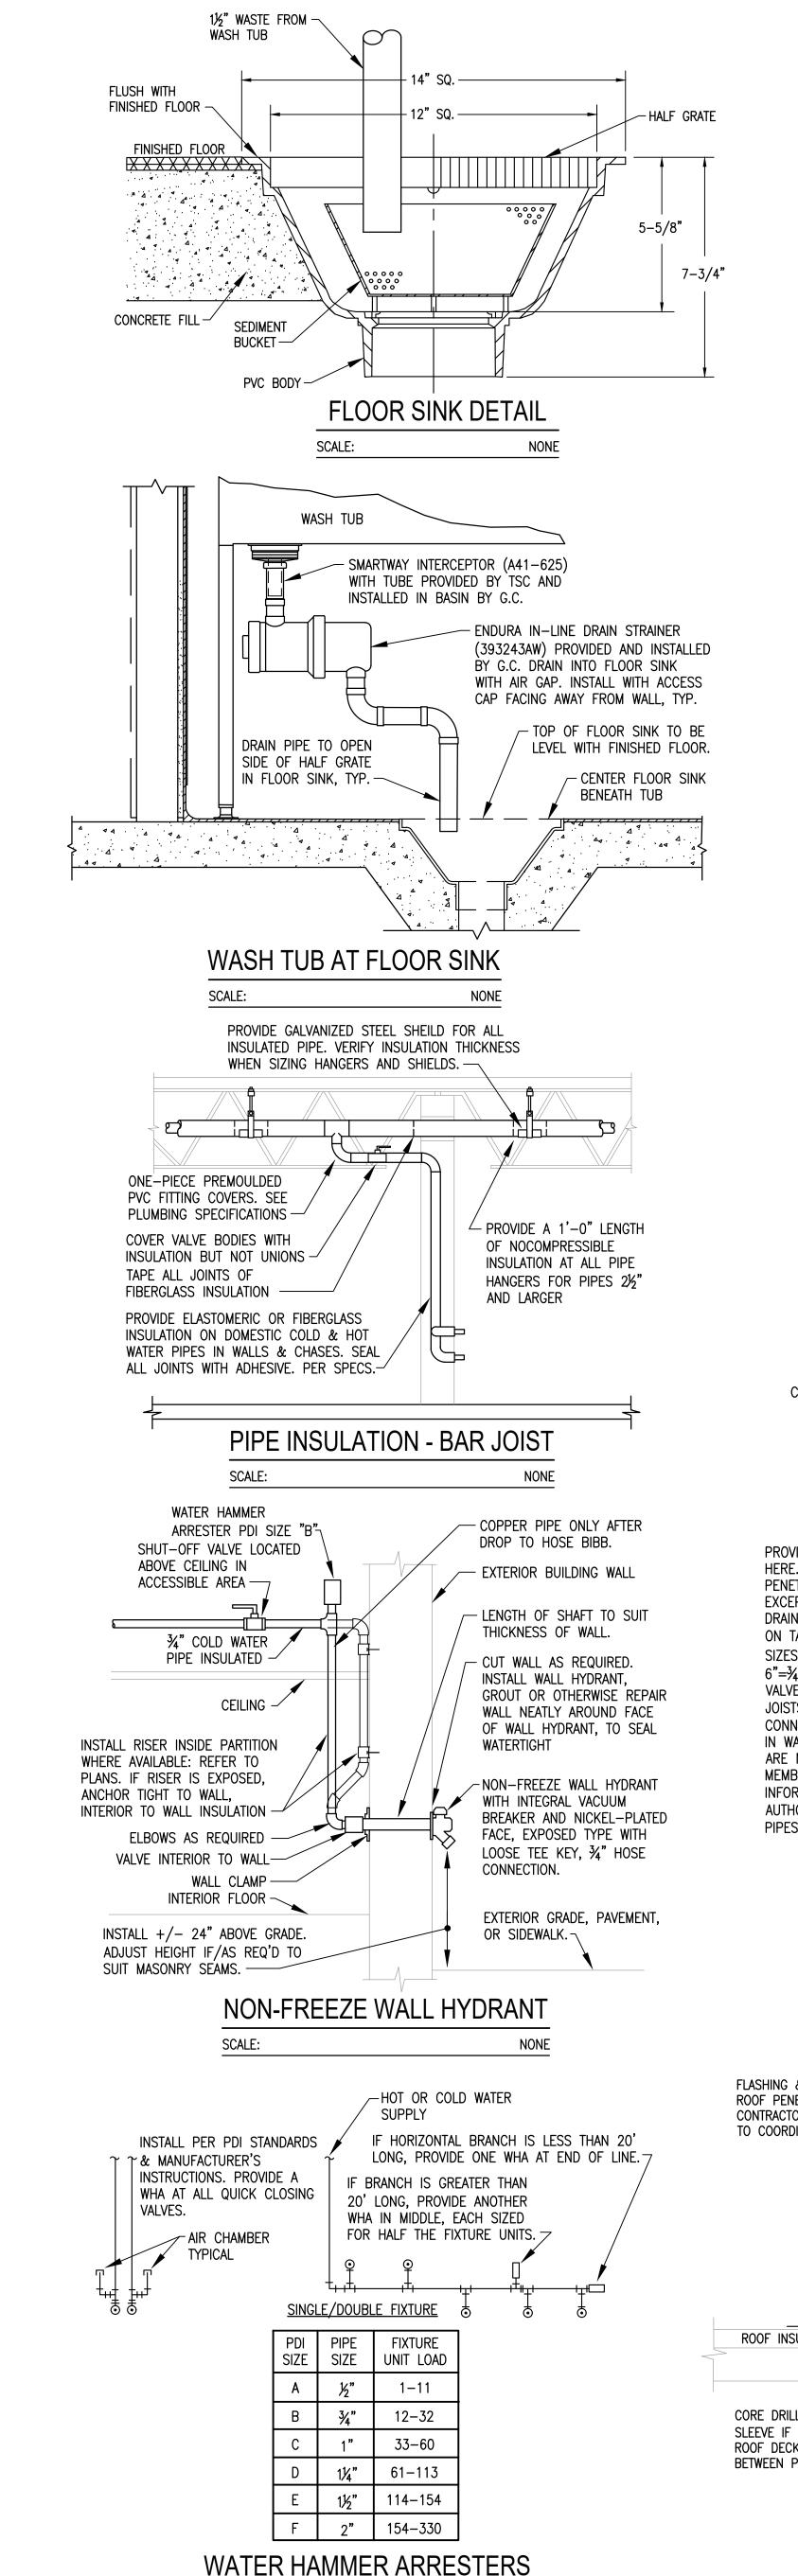

NONE

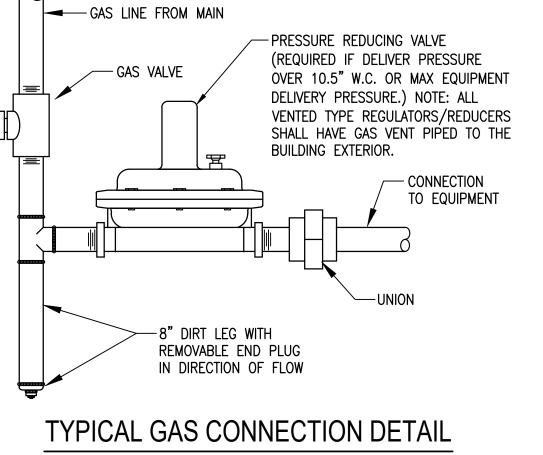


SCALE:

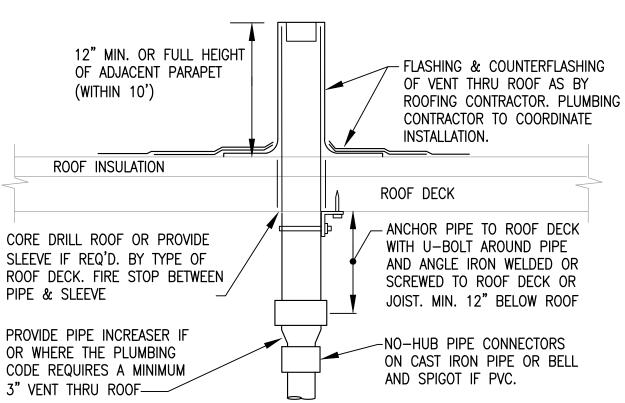

REFER TO PLANS FOR VTR PIPE SIZES AND LOCATIONS. LOCATE VTR MIN. THREE FEET FROM PROPERTY LINE, OR TEN FEET HORIZONTAL OR THREE FEET VERTICAL ABOVE ANY BUILDING OPENING OR FRESH AIR INTAKE, OR ONE FOOT FROM ANY VERTICAL SURFACE. LOCATE VTR MINIMUM 18" FROM PARAPET, EXPANSION JOINT, EQUIPMENT CURB, ETC. OFFSET IN CEILING SPACE WHERE REQUIRED TO MEET THESE CONDITIONS.

> VENT THRU ROOF - VTR SCALE: NONE

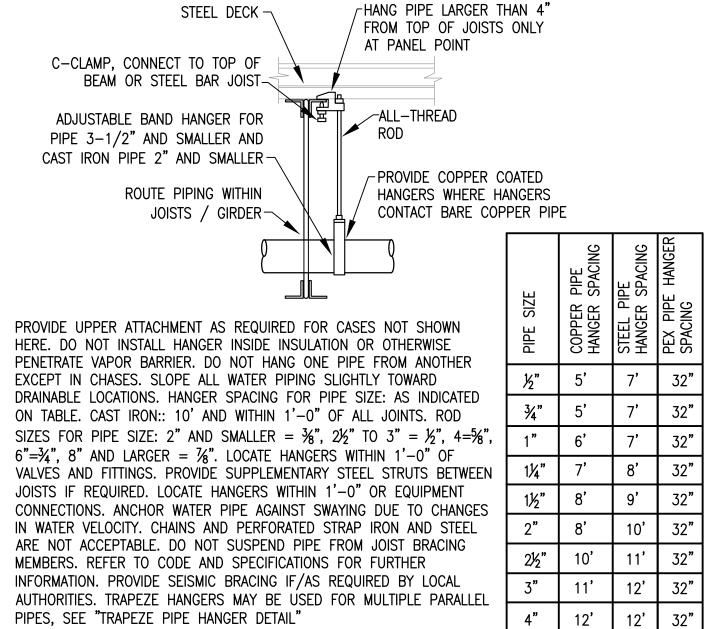



PIPE HANGER - BAR JOIST

SCALE:


NONE


NONE

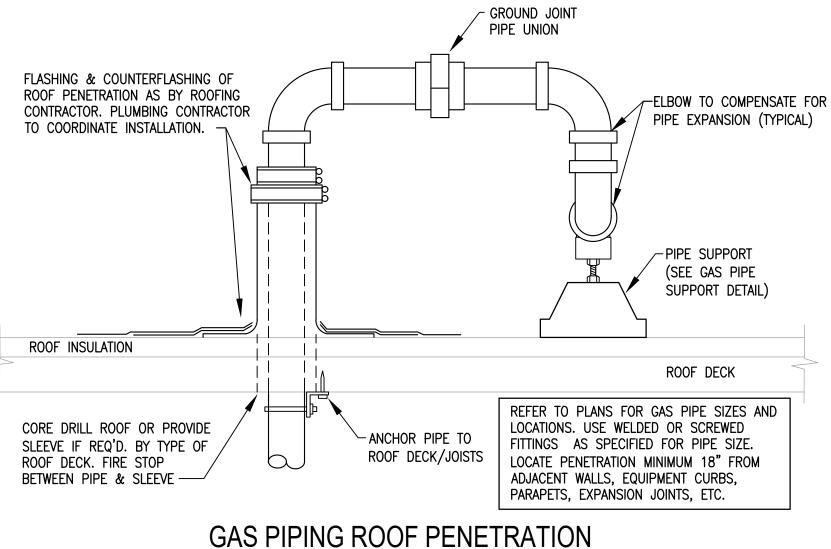

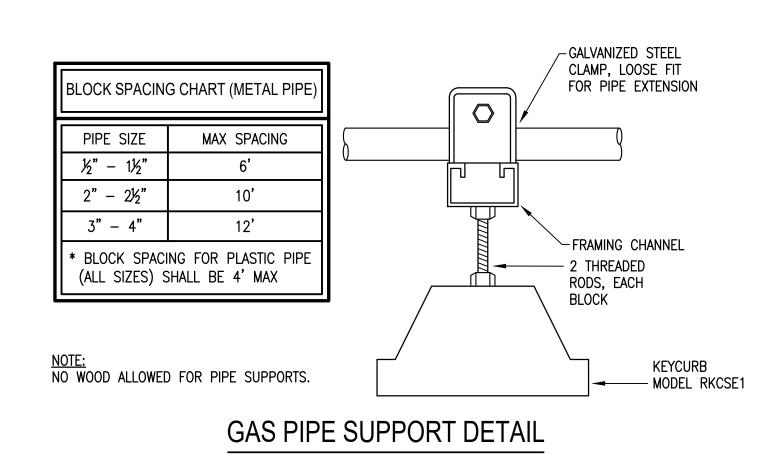

NONE

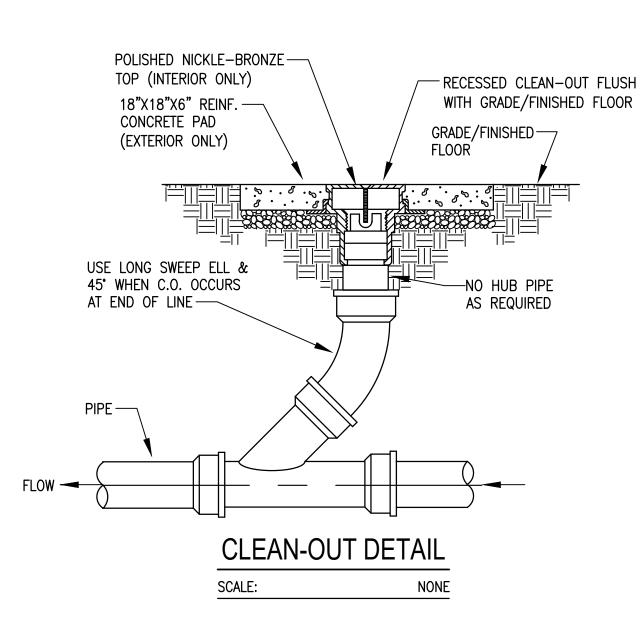

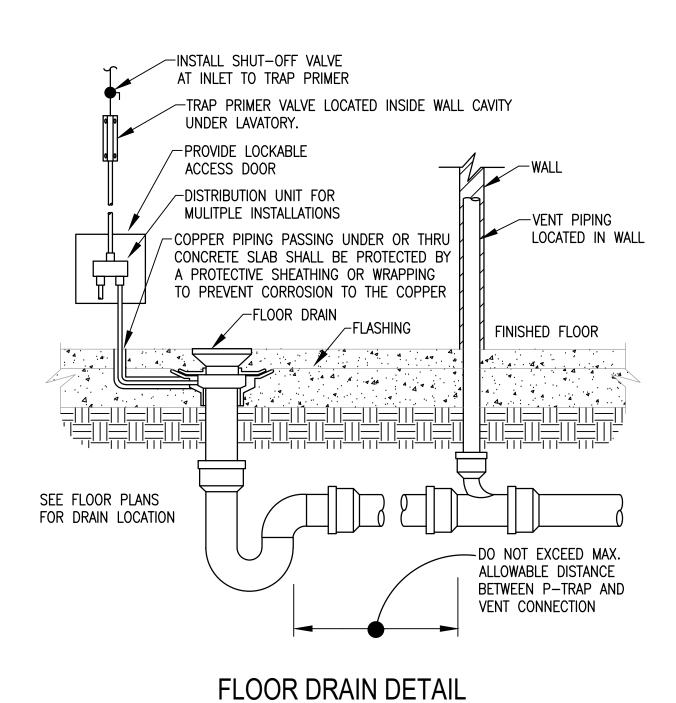

GAS CONNEC	TION SCHEDULE				
EQUIPMENT	LOAD				
RTU-1	180,000 BTUH				
RTU-2	180,000 BTUH				
RTU-3 240,000 BTUH					
RTU-4 240,000 BTUH					
RTU-5 80,000 BTUH					
GF-1	100,000 BTUH				
WH-1	199,000 BTUH				
TOTAL NEW CONNECTED LOAD:	1,219,000 BTUH				
ALL NATURAL GAS PIPING IS SIZED FOR S	SCHEDULE 40 METALLIC PIPE.				
	WITH 1.0 PSI PRESSURE LOSS FOR 205'-0" I CONNECTION AS REQUIRED. CONTRACTOR WITH LOCAL PROVIDER PRIOR TO				

IF 2 PSI INLET PRESSURE IS UNAVAILABLE REFER TO PIPE SIZES INDICATED I

PARENTHESIS ON DRAWING SHEET P1.0.

NONE

	PLUMBING FIXTURE SCHEDULE				_
			UTILIT		
MARK WC	WATER CLOSET (FLOOR MOUNTED ADA., PRESSURE ASSISTED FLUSH TANK, MOTION ACIVATED): KOHLER HIGHLINE K-3519, 12" ROUGH-IN, 1.0 GPF, WITH SLOAN FLUSHMATE PRESSURE ASSIST, LOW CONSUMPTION, VITREOUS CHINA, 17-1/8" HIGH, ELONGATED BOWL FLUSH TANK WATER CLOSET WITH LEFT HAND TRIP LEVER. PROVIDE BEMIS 1055 SSC ELONGATED OPEN FRONT TOILET SEAT, K-5420 BOLT CAPS. FOR RIGHT HAND TRIP LEVER PROVIDE WITH ALTERNATE TANK CONFIGURATION MODEL K-3519-RH. CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING CORRECT TANK SELECTION WITH LATEST ARCHITECTURAL DRAWINGS TO ACCOMMODATE ADA ACCESSIBILITY PRIOR TO ORDERING. RETROFIT WITH INTELLI-FLUSH K-100101 WALL SENSOR, POWERED BY FOUR(4) AA BATTERIES, CHROME FINISH. INTELLI-FLUSH SYSTEM MUST BE ORDERED SEPARATELY FROM FLUSHMATE. CONTACT LORI FELTMATE AT FLUSHMATE FOR ORDERING INFORMATION. PH:(248)446-8159 EMAIL: Lori.Feltmate@Flushmate.com	½"	X	4"	2'
LAV	LAVATORY (ACCESSIBLE, WALL HUNG, MOTION ACTIVATED): KOHLER KINGSTON WALL-MOUNT K-2005, VITREOUS CHINA LAVATORY WITH A ZURN AQUASENSE BATTERY POWERED Z6915-XL FAUCET, POLISHED CHROME FINISH, KOHLER K-23726 DRAIN, KOHLER K-8998 P-TRAP AND KOHLER K-23725 CAST IRON CLEANER. MOUNT FIXTURE WITH FLOOD RIM 34" AFF. FURNISH AND INSTALL WITH ZURN MODEL ZW3870XLT THERMAL MIXING VALVE FOR MAX. 110°F HOT WATER.	½"	1/2"	11/4"	1)/
BS	BREAKROOM SINK: (SINGLE BOWL, S.S., GOOSENECK): PROVIDED BY TRACTOR SUPPLY COMPANY & INSTALLED BY CONTRACTOR.	<i>1</i> ₂ "	1/2"	1½"	11/4
EWC	ELECTRIC WATER COOLER (ACCESSIBLE, MOTION SENSOR, DUAL—HEIGHT): MURDOCK MODEL A172108F-UG-B512-BCD WITH INFRARED SENSOR CONTROL AND WALL MOUNTING BRACKET. 8 GPH, 115/1/60. MOUNT HIGH UNIT AT 42" MAX. FROM FLOOR TO SPOUT OUTLET AND LOW UNIT AT 36" MAXIMUM FROM FLOOR TO SPOUT OUTLET. PROVIDE MCGUIRE 8912 P-TRAP AND MCGUIRE 165 SUPPLY WITH STOP. COORDINATE WITH ELECTRICAL CONTRACTOR TO LOCATE RECEPTACLE BEHIND WATER COOLER CABINET. PROVIDE WITH BOTTLE FILLER. CONTACT BERRY JONES FOR ORDERING INFORMATION. PH: 800-459-7099 EMAIL: berry.jones@hjcinc.com.	<i>½</i> "	Х	11/4"	11/1
MS	MOP SINK: MUSTEE MODEL 63M 24"x24" FIBERGLASS MOP SERVICE BASIN. COMPLETE WITH MODEL 63.401 EXTRUDED BUMPER GUARD, CHICAGO MODEL 897—RCF CHROME PLATED SPOUT WITH VACUUM BREAKER, ¾" HOSE THREAD OUTLET, PAIL HOOK. WALL SUPPORT, INTEGRAL STOPS, MODEL 369 2½" METAL LEVER HANDLES AND 36" LENGTH OF THREADED HOSE. FURNISH AND INSTALL T&S MODEL B—0977 THREADED CONTINUOUS PRESSURE VACUUM BREAKER AND DEMA MODEL 68—6 PRESSURE INDICATING TEE ON FAUCET OUTLET FOR HOSE CONNECTION TO BETCO DISPENSER. VACUUM BREAKER TO BE INSTALLED UPSTREAM OF PRESSURE INDICATING TEE.	½"	½"	3"	11/2
WH-1	WATER HEATER (GAS INSTANTANEOUS, 96% EFFICIENCY, 120V/10, 4 AMPS): A.O. SMITH MODEL 540H OR EQUAL, INTERIOR WALL MOUNTED, GAS, INSTANTANEOUS WATER HEATER, RATED AT 13,000 TO 199,000 BTUH, WITH CAPACITY OF 0.26-9.8 GAL./MIN. WATER HEATER SHALL CONFORM TO IECC 701, 504, AND ASHRAE 90.1. SET TO 120°F OUTLET TEMP. PROVIDE W/ ISOLATION VALVE, CONDENSATE NEUTRALIZER PART #100112163, AND INNOFLUE CONCENTRIC ROOF TERMINATION BY CENTROTHERM OR APPROVED EQUAL. SHALL MEET UL-1738 STANDARDS.	3/4"	3/4"	X)
FD-1	FLOOR DRAIN (3" DIA. OUTLET): ROUND TOP, J.R. SMITH MODEL 2005Y—A—P050—PB WITH CAST IRON BODY AND FLASHING COLLAR, TRAP PRIMER CONNECTION AND POLISHED BRONZE STRAINER. INSTALL WITH TOP FLUSH WITH FINISHED FLOOR.	Х	Х	3"	1,1
TP-1	TRAP PRIMER: JOSAM FIG. NO. 88250, AUTOMATIC TRAP PRIMER, MOUNTED INSIDE WALL CAVITY UNDER LAVATORY. PROVIDE 8" X 8" ACCESS PANEL TO CLEAR LAVATORY ROUGH—IN AND PAINTED TO MATCH WALL. RUN 1/2" COPPER LINE FROM TRAP PRIMER TO ADJACENT FLOOR DRAIN AS SHOWN ON THE CONTRACT DRAWINGS. INLINE FLOOR DRAIN TRAP SEAL MAY BE USED IN LIEU OF TRAP PRIMERS PENDING LOCAL CODE APPROVAL. TRAP SEALS SHALL MEET REQUIREMENTS OF ASSE 1072 AND SHALL BE MADE OF CHEMICALLY RESISTANT ELASTOMER.	½"	X	X)
WHA	WATER HAMMER ARRESTER: JOSAM FIG. NO. 75001 THROUGH 75006, SIZE AS RECOMMENDED BY MANUFACTURER.	Х	Х	Х	>
НВ	HOSE BIBB (METAL WHEEL HANDLE): WOODFORD MODEL 24, ANTI SIPHON, NIDEL MODEL 34HF VACUUM BREAKER. PROVIDE WITH METAL WHEEL HANDLE.	34"	Х	Х	Х
NFHB	HOSE BIBB (NON-FREEZE, KEYED HANDLE): WOODFORD MODEL 67, ¾", AUTOMATIC DRAINING BRASS FINISH, NIDEL MODEL 34HA VACUUM BREAKER. PROVIDE LOOSE TEE KEY FOR EACH HYDRANT.	3/4"	Х	Х)
FS	FLOOR SINK (14"X14"): ZURN MODEL FS12-6-PV3 14"X14" PVC FLOOR SINK WITH 3" PVC HUB CONNECTION. FURNISH WITH SEDIMENT BUCKET JP2370-Y3, HALF-GRATE JP2370-H, AND P-TRAP. FLOOR SINKS SHALL BE INSTALLED 30" ON CENTER FROM CENTERLINE OF MOP SINK.	Х	Х	3"	1,
WASH TUB & WASH TUB ADA	PET WASH TUB: TUB AND ANTI-SIPHON TYPE FAUCET TO BE PROVIDED BY TSC AND INSTALLED BY CONTRACTOR. CONTRACTOR TO FURNISH AND INSTALL WITH ENDURA IN-LINE DRAIN STRAINER, MODEL 393243AW, BELOW TUB IN PLACE OF P-TRAP. STRAINER CLEANOUT SHALL BE INSTALLED IN EASILY ACCESSIBLE LOCATION. TSC TO FURNISH AND CONTRACTOR TO INSTALL SMARTWAY HAIR INTERCEPTOR IN PLACE OF A STRAINER BASKET IN BASIN OF EACH WASH TUB. COORDINATE LEFT HAND / RIGHT HAND CONFIGURATION AS SHOWN ON DRAWINGS WITH TSC. FURNISH COMPLETE WITH TEMPERATURE LIMITING MIXING VALVE.	<i>7</i> 2"	<i>Y</i> ₂ "	1½"	1,1
FD-2	FLOOR DRAIN (4" DIA. OUTLET): ROUND TOP, J.R. SMITH MODEL 2005Y—A—P050—PB WITH CAST IRON BODY AND FLASHING COLLAR, TRAP PRIMER CONNECTION AND POLISHED BRONZE STRAINER. INSTALL WITH TOP FLUSH WITH FINISHED FLOOR.	Х	Х	4"	2
TP-2	TRAP PRIMER: PRECISION PLUMBING PRODUCTS P2—500, AUTOMATIC TRAP PRIMER. RUN 1/2" COPPER LINE FROM TRAP PRIMER TO ADJACENT FLOOR DRAIN AS SHOWN ON THE CONTRACT DRAWINGS. INSTALL PER MANUFACTURER'S RECOMMENDATIONS. INLINE FLOOR DRAIN TRAP SEAL MAY BE USED IN LIEU OF TRAP PRIMERS PENDING LOCAL CODE APPROVAL. TRAP SEALS SHALL MEET REQUIREMENTS OF ASSE 1072 AND SHALL BE MADE OF CHEMICALLY RESISTANT ELASTOMER.	<i>½</i> "	X	Х	
RPBP	REDUCED PRESSURE BACKFLOW PREVENTER: WATTS MODEL 919-QTS, 1¼" REDUCED PRESSURE BACKFLOW PREVENTER WITH A MODEL 919-AG AIR GAP DRAIN. INSTALL UNIT IN HORIZONTAL POSITION WITH CENTERLINE A MAXIMUM OF 4'-6" AFF. REFER TO DETAIL ON DRAWINGS.	11/4"	Х	Х	,
HWRP	HOT WATER RECIRCULATION PUMP (FOR USE AT WATER HEATER): BELL & GOSSETT MODEL PL—30B WITH ¾" CONNECTIONS, RATED @ 1/12 HP, 120—1—60, .5 GPM AT .75 TDH. PROVIDE MAIN CUTOFF SWITCH (MANUAL) FOR PUMP TO CUT OFF POWER AS REQUIRED UNDER ASHRAE STANDARD 9075, PARAGRAPH 7.6. INSTALL & SUPPORT PUMP PER SCHEMATIC ON CONTRACT DRAWINGS AND MANUFACTURER'S RECOMMENDATIONS.	34"	Х	X)
HR	HOSE REEL: REEL CRAFT MODEL GCD83050 OLP. MOUNT FROM STRUCTURE. COORDINATE EXACT LOCATION WITH LATEST TSC FIXTURE PLAN AND TSC PM.	3⁄4"	Х	Х	>

		WASTE & V	WATER F	IXTURE	LOAD
	FIXTURE	FIXTURE/EQUIPMENT	QUANTITY		WA ⁻
	TAG			CW F.U. PER FIXTURE	HW F.U PER FIXTU
-	<u>WC</u>	WATER CLOSET	2	5.0	_
	LAV	LAVATORY	2	1.5	1.5
	<u>BS</u>	BREAK ROOM SINK	1	1.0	1.0
	<u>EWC</u>	ELECT. WATER COOLER	1	0.25	1
	<u>MS</u>	MOP SINK	1	2.25	2.25
	<u>FD-1</u> & <u>FD-2</u>	FLOOR DRAIN	3	-	ı
	<u>WASH_TUB</u>	PET WASHING TUB	2	2.25	2.25
−0" R	<u>FS</u>	FLOOR SINK	2	1	1
'`		TOTALS			
	MAXIMUM WATER	DEMAND AT 24.65 F.U.	= 23 GPM +	25 GPM (H.B	$= 1 \frac{1}{4}$

	DUCED PRESSURE BACKFLOW PREVENTER: TTS MODEL 919—QTS, 1¼" REDUCED PRESSURE BACKFLOW PREVENTER WITH A DEL 919—AG AIR GAP DRAIN. INSTALL UNIT IN HORIZONTAL POSITION TH CENTERLINE A MAXIMUM OF 4'—6" AFF. REFER TO DETAIL ON DRAWINGS.					11/4"	X	X	Х	
E 1 1	HOT WATER RECIRCULATION PUMP (FOR USE AT WATER HEATER): BELL & GOSSETT MODEL PL—30B WITH ¾" CONNECTIONS, RATED @ 1/12 HP, 120—1—60, .5 GPM AT .75 TDH. PROVIDE MAIN CUTOFF SWITCH (MANUAL) FOR PUMP TO CUT OFF POWER AS REQUIRED UNDER ASHRAE STANDARD 9075, PARAGRAPH 7.6. INSTALL & SUPPORT PUMP PER SCHEMATIC ON CONTRACT DRAWINGS AND MANUFACTURER'S RECOMMENDATIONS.							Х		
HR	HOSE REEL: REEL CRAFT MODEL GCD830 LOCATION WITH LATEST TSC				INATE EXACT	3/4"	Х	Х	Х	
										_ _
	WASTE & Y	WATER	FIXTURE	LOAD C	ALCULA	TIONS				
FIXTURE	FIXTURE/EQUIPMENT	QUANTITY	1	WATER			Ì	WASTE		
TAG			CW F.U. PFR FIXTURE	HW F.U. PER FIXTURE		TOTAL F.U.	WASTE PER FIX		OTAL F.U.	
<u>wc</u>	WATER CLOSET	2	5.0		5.0	10.0	4.0		8.0	
LAV	LAVATORY	2	1.5	1.5	2.0	4.0	1.0	一	2.0	
<u>BS</u>	BREAK ROOM SINK	1	1.0	1.0	1.4	1.4	2.0		2.0	
<u>EWC</u>	ELECT. WATER COOLER	1	0.25	-	0.25	0.25	-		-	
<u>MS</u>	MOP SINK	1	2.25	2.25	3.0	3.0	2.0		2.0	
FD-1 & FD-	-2 FLOOR DRAIN	3	_			-	2.0		6.0	
WASH TUB	PET WASHING TUB	2	2.25	2.25	3.0	6.0	2.0		4.0	
<u>FS</u>	FLOOR SINK	2	-	-		_	4.0		4.0	1 11 11
	TOTALS					24.65			28.0	
MAXIMUM WA	TER DEMAND AT 24.65 F.U.	= 23 GPM +	25 GPM (H.B	$\overline{)} = \overline{1} \overline{1/4} \overline{)}$	MIN. WATER MA	IN SUPPLY	,			
	STE DEMAND AT 28.0 F.U. =									E STATE OF THE STA
FIXTURE UNI	TS BASED ON 2015 INTERNA	TIONAL PLUMB	ING CODE							1163 West Main St.
<u> </u>										Franklin, TN 37064 Tel: 615.730.9111 / Fax
										gary@scheltonengineer Project #24-048
										•

st Main St. , TN 37064 .730.9111 / Fax: 615.224.3599 ARCHITECTURE

Suite 120 Nashville, TN 371204rior Architecture

Architecture

2934 Sidco Drive


TRACTOR SUPPLY COMPANY

COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

Job Number: 05.10.2024 Revisions:

Revisions: PLUMBING SCHEDULES AND DETAILS

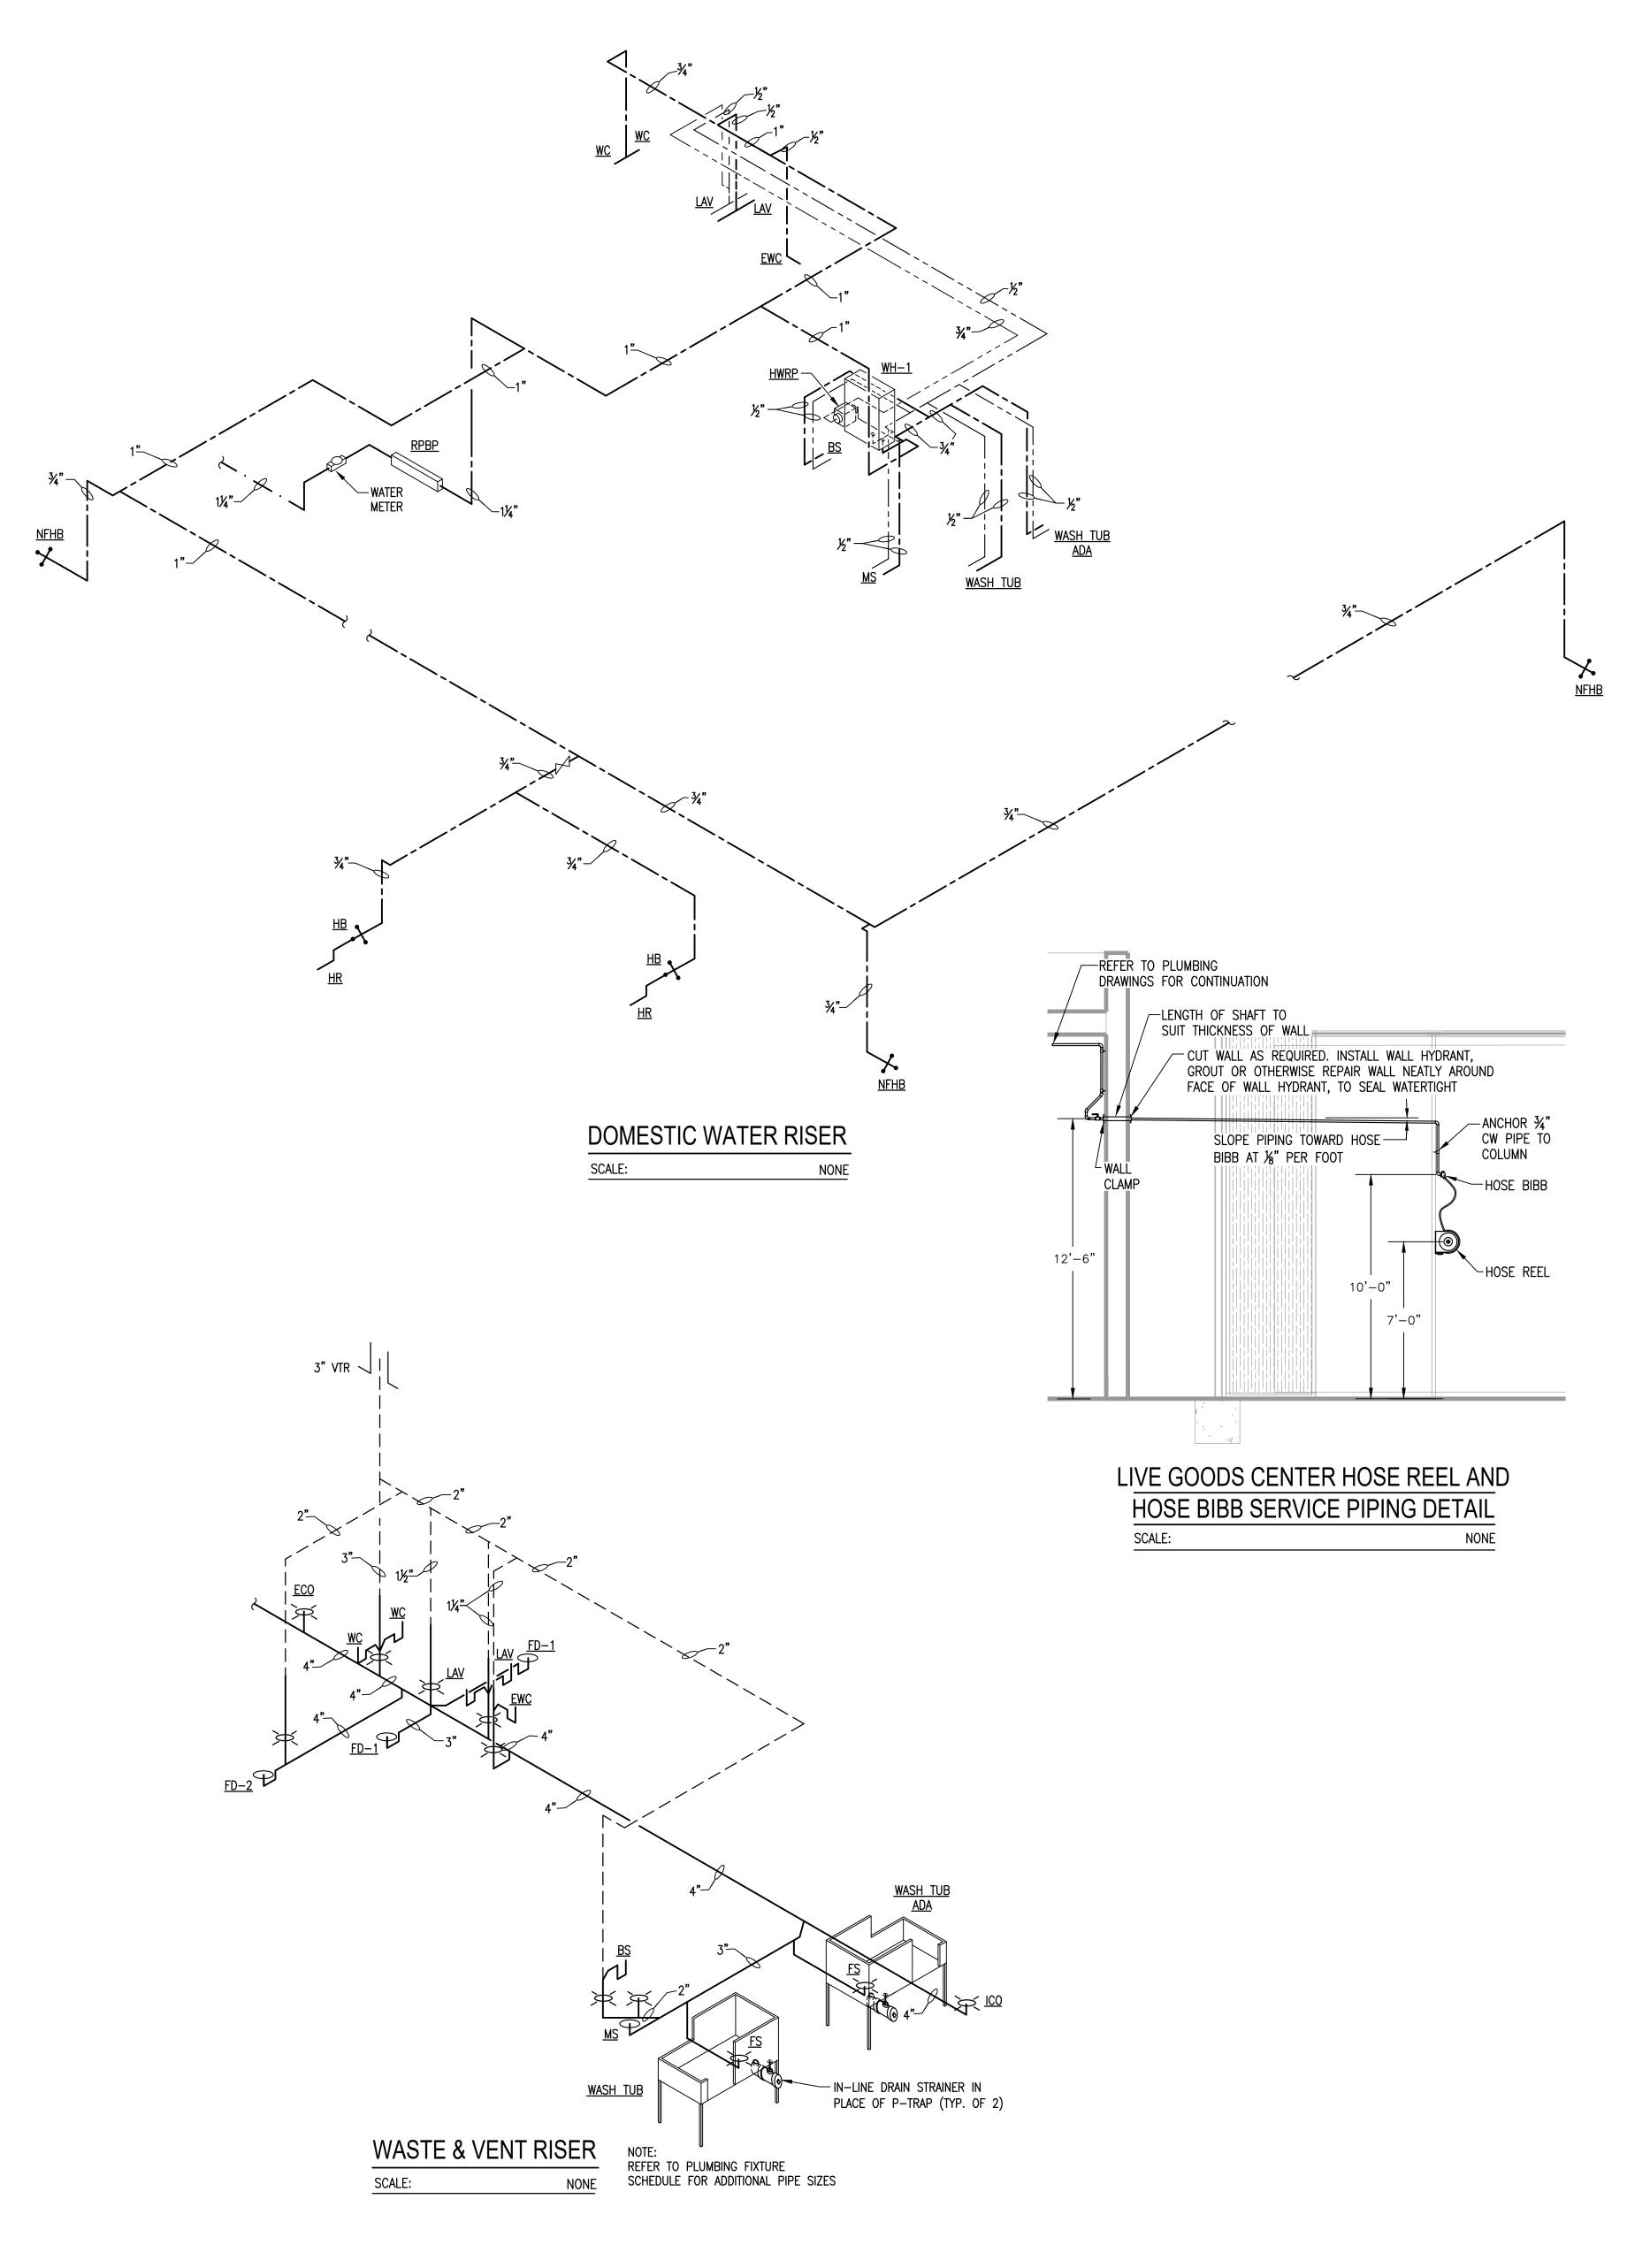

PLUMBING SPECIFICATIONS

PART 1 GENERAL

- COMPLETED INSTALLATION SHALL CONFORM TO ALL APPLICABLE FEDERAL, STATE AND LOCAL CODES AND ORDINANCES. INCLUDING BUT NOT LIMITED TO THE LATEST APPROVED EDITIONS OF THE FOLLOWING:
- STATE BUILDING CODE, INTERNATIONAL BUILDING CODE, INTERNATIONAL PLUMBING CODE, INTERNATIONAL ENERGY CONSERVATION CODE, NFPA-90A, NFPA-101, NFPA-54.
- 2. OBTAIN AND PAY FOR ALL REQUIRED PERMITS, INSPECTION FEES, TAPPING FEES, CONNECTION CHARGES, AND UTILITY COMPANY SERVICE
- 3. INSTALLATION SHALL BE DONE IN A NEAT AND WORKMANLIKE MANNER.
- 4. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO PROVIDE ALL LABOR AND INSTALL ALL MATERIAL CALLED FOR IN THE CONTRACT DOCUMENTS PER LOCAL CODE REQUIREMENT AND THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- 5. THE CONTRACTOR'S INSTALLATION SHALL INCLUDE ALL REQUIRED ROUGH-INS, DUCTWORK, PIPING OR ELECTRICAL WIRING INCLUDING DEVICES (GAGES, VALVES, DISCONNECTS, STARTERS, ETC.) NEEDED FOR ALL SYSTEMS TO BE COMPLETE AND FULLY OPERATIONAL WHETHER OR NOT SHOWN OR NOTED ON THE CONTRACT DOCUMENTS.
- 6. THE CONTRACTOR'S BID SHALL INCLUDE ALL SUCH ITEMS REASONABLY INFERRED OR REQUIRED FOR COMPLETE SYSTEMS. THE CONTRACTOR SHALL NOTIFY THE DESIGN ENGINEER PROMPTLY OF ANY CONFLICT BETWEEN BUILDING CODES AND/OR THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AND THE CONTRACT DOCUMENTS.
- NO DEVIATIONS OR ADJUSTMENTS SHALL BE MADE TO THE CONTRACT DOCUMENTS WITHOUT COORDINATION AND THE APPROVAL OF THE DESIGN ENGINEER. ANY SUCH APPROVED DEVIATIONS OR ADJUSTMENTS TO THE CONTRACT DOCUMENTS SHALL BE MARKED ON A SET OF RECORD DRAWINGS BY THE CONTRACTOR. THE RECORD AS-BUILT DRAWINGS SHALL BE TURNED OVER TO THE DESIGN ENGINEER AT THE COMPLETION

PART 2 PRODUCTS

OF CONSTRUCTION.

- 1. ALL PIPING AND FITTINGS FOR THE DOMESTIC WATER SYSTEM SHALL BE CERTIFIED BY THE UNDERWRITERS LABORATORY TO MEET THE ANSI NSF, 61 SECTION 9 STANDARD.
- 2. ALL PIPING INSIDE THE BUILDING AND BELOW SLAB TO 5'-0" OUTSIDE THE BUILDING SHALL BE ASTMF876 APPROVED CROSSLINKED POLYETHYLENE (PEX) TUBING WITH A MINIMUM CLASS 1006 CHLORINE RESISTANCE RATING, WATTS, ZURNER, OR NIBCO. FITTINGS SHALL BE BARBED CRIMP PIPING OR QUICK CONNECT FITTINGS, WATTS, ZURNER, OR NIBCO. EXPOSED PIPING INSIDE SHALL BE 10' OR 20' STICKS. ROLLS MAY BE USED IN WALLS NOT EXPOSED AND UNDERSLAB. ALL PIPING (PEX) UNDER INTERIOR SLAB SHALL BE SLEEVED. NO FITTINGS SHALL BE PERMITTED UNDER GROUND.
- ALL DOMESTIC WATER PIPING INSIDE THE BUILDING ABOVE SLAB SHALL BE TYPE "L" HARD COPPER. DOMESTIC WATER PIPING BELOW SLAB AND TO 5'-0" OUTSIDE SHALL BE TYPE "K" SOFT SEAMLESS. NO JOINTS SHALL BE ALLOWED BELOW SLAB. COPPER PIPE FITTINGS SHALL BE SWEATED JOINT WROUGHT COPPER SWEEP PATTERN FITTINGS, SOLDERED USING 95-5 LEAD-FREE SOLDER.
- 3. ALL SANITARY WASTE AND VENT PIPING INSIDE AND UNDERSLAB TO 5'-0" OUTSIDE THE BUILDING SHALL BE SCHEDULE 40 PVC, DWV OR SERVICE WEIGHT CAST IRON WITH DRAINAGE FITTINGS.
- 4. JOINT FOR PVC SANITARY WASTE AND VENT PIPING SHALL BE SOLVENT WELD TYPE INSIDE AND UNDERSLAB TO 5'-0" OUTSIDE THE BUILDING. JOINTS FOR CAST IRON PIPE SHALL BE NO-HUB TYPE ABOVE, SLAB ON GRADE AS MANUFACTURED BY CLAMP-ALL OR ANACO HUSKY. CAST IRON SOIL PIPING INSTITUTE NO-HUB. DOUBLE BAND CONNECTORS SHALL NOT BE ALLOWED. JOINTS FOR CAST IRON PIPE BELOW SLAB OR GRADE SHALL BE NEOPRENE PUSH-ON TYPE.
- 5. HANGERS: PIPE SIZES 1/2" TO 1-1/2": ADJUSTABLE WROUGHT STEEL LOOP (COPPER, ELECTROPLATE IF APPLICABLE).
- 6. HANGERS: PIPE SIZES 2" AND UP: ADJUSTABLE WROUGHT STEEL CLEVIS (COPPER, ELECTROPLATE IF APPLICABLE).
- 7. MULTIPLE OR TRAPEZE HANGERS: STEEL CHANNELS WITH WELDED SPACERS AND HANGER RODS.
- 8. PROVIDE STEEL HANGER RODS, THREADED BOTH ENDS, THREADED ONE END, OR CONTINUOUS THREADED AS REQUIRED.
- 9. INSULATE DOMESTIC HOT AND COLD WATER PIPING WITH FIBERGLASS INSULATION WITH MOLDED FIBERGLASS PIPE COVERING AND CONTINUOUS VAPOR AS MANUFACTURED BY MANVILLE CORPORATION, OWENS-CORNING, KNAUF, OR CERTAINTEED.
- INSULATE (PEX) PIPING WITH SELF SEALING ELASTOMERIC RUBBER INSULATION. SEAL ENDS WITH CONTACT ADHESIVE AND TAPE PER MANUFACTURER'S RECOMMENDATIONS.

NOTES:

- 10. INSULATE ALL DOMESTIC HOT WATER PIPING WITH 1" THICK INSULATION. INSULATE ALL DOMESTIC COLD WATER PIPING WITH 1/2" THICK
- 11. INSULATE ALL DOMESTIC WATER PIPING BELOW SLAB AND TO 5'-0" OUTSIDE THE BUILDING WITH 1/2" ARMAFLEX.
- 12. PIPE INSULATION AND COVERINGS SHALL HAVE A RATING OF NO GREATER THAN 25 FLAME SPREAD, NO HIGHER THAN 50 SMOKE
- DEVELOPED, AND NO MORE THAN 50 FUEL CONTRIBUTED. 13. ALL GAS PIPING SHALL BE SCHEDULE 40 BLACK STEEL WITH SCREWED OR WELDED FITTINGS AND GASKET TYPE UNIONS AND FLANGES. ALL GAS

RESISTANT PAINT. PAINT COLOR SHALL BE ORANGE OR YELLOW.

PIPING INSTALLED OUTDOORS SHALL BE COATED WITH A CORROSION

- 14. CONCRETE ANCHORS (WEDGE ANCHORS) SHALL BE ZINC-PLATED CARBON STEEL WEDGE ANCHORS AVAILABLE IN ANCHOR/DRILL SIZES 1/4" TO 3/4" AND LENGTHS OF 1-3/4" THROUGH 12", MEETING U.S. GOVERNMENT G.S.A. SPECIFICATIONS FF-S-325 GROUP II, TYPE 4, CLASS I, FOR FASTENING PLUMBING SYSTEMS TO CONCRETE AND PIPE HANGING. ITW RAMSET/RED HEAD BRAND OR APPROVED EQUAL.
- 15. NATURAL GAS REGULATORS SHALL BE MAXITROL 325 SERIES OR EQUAL.

16. ACCEPTABLE FIXTURE MANUFACTURERS

- A. NO OTHER MANUFACTURER SUBSTITUTIONS SHALL BE ALLOWED WITHOUT PRIOR WRITTEN APPROVAL FROM THE ENGINEER FIVE (5) DAYS BEFORE BIDDING.
- B. CONTRACTOR SHALL PROVIDE FAUCETS AND FITTINGS THAT ARE CERTIFIED BY UNDERWRITERS LABORATORY TO MEET THE ANSI NSF 61, SECTION 9 STANDARD.
- C. FITTINGS: AMERICAN STANDARD, KOHLER, DELTA, MOEN, SYMMONS, LEONARD, CHICAGO FAUCET COMPANY, T&S BRASS, OR POWERS REGULATOR.

PART 3 EXECUTION

1. EXCAVATION, BACKFILLING AND TRENCH WORK SHALL BE DONE IN ACCORDANCE WITH O.S.H.A. AND EXISTING SAFETY STANDARDS.

- A. PROVIDE SHORING AND CLEANING NECESSARY TO KEEP TRENCHES IN WORKING CONDITIONS, INCLUDING PUMPING OUT WATER.
- B. IN MOSTLY ROCK MATERIAL, TRENCHES SHALL BE EXCAVATED TO AT LEAST 6" BELOW THE ELEVATION OF THE BOTTOM OF THE PIPES. AFTER EXCAVATION, TRENCH SHALL THEN BE FILLED TO THE PROPER ELEVATION WITH CRUSHED LIMESTONE. GRAVEL SHALL BE SCOOPED OUT UNDER PIPE BELLS SO THE PIPE RESTS FIRMLY ON THE TRENCH BOTTOM.
- C. IN MOSTLY EARTH OR SAND MATERIAL, THE LAST 6" OF EXCAVATION SHALL BE DONE BY HAND. TRENCH BOTTOM SHALL BE SCOOPED OUT AT PIPE BELLS SO THE PIPE RESTS FIRMLY ON THE TRENCH BOTTOM.
- D. BACKFILLING AND TAMPING SHALL BE CAREFULLY DONE SIMULTANEOUSLY ALONG BOTH SIDES OF THE PIPE USING ROCK FREE EARTH, CRUSHED STONE OR SAND UNTIL THE PIPE IS COVERED TO A DEPTH OF AT LEAST 12". THE REST OF THE FILL UP TO THE TOPSOIL LAYER MAY BE GRAVEL OR ROCK FREE EARTH. ACCEPTABLE SOIL MATERIALS FOR BACKFILL AND FILL SHALL BE FREE OF CLAY, ROCK OR GRAVEL LARGER THAN 2" IN ANY DIMENSION, DEBRIS: WASTE, FROZEN MATERIALS AND OTHER DELETERIOUS MATTER HAVING A PLASTICITY INDEX LESS THAN 30. BACKFILL SHALL BE DONE IN LAYERS OF NOT MORE THAN 8" AND EACH LAYER SHALL BE COMPACTED. THE LAST 12" OF BACKFILL SHALL BE ROCK FREE TOPSOIL.
- E. SURFACE SHALL BE RESTORED TO ITS ORIGINAL CONDITION. EXPOSED HOT AND COLD WATER TRIM IN FINISHED AREAS SHALL BE CHROME FINISHED.
- 3. ALL HORIZONTAL AND VERTICAL PIPING SHALL BE SUPPORTED IN ACCORDANCE WITH APPLICABLE STATE AND LOCAL CODE RECOMMENDATIONS. SUPPORTS SHALL SECURELY HOLD PIPING, PREVENT VIBRATION, COMPENSATE FOR ALL STATIC AND OPERATIONAL CONDITIONS OF THE VARIOUS SYSTEMS AND SHALL NOT BE SUBJECT TO ELECTROLYTIC ACTION. THIS SHALL BE ACCOMPLISHED BY USING THE
- SUMMER SYSTEM, THE POSIFIX, STAKFIX, PIPEFIX OR CHANNEL. 4. WATER HAMMER ARRESTERS SHALL BE INSTALLED ON ALL HOT AND COLD WATER BRANCH LINES CONTAINING SINGLE LEVER FAUCETS, FLUSH VALVES OR QUICK CLOSING VALVES SUCH AS DISHWASHERS, CLOTHES WASHERS, AND OTHER EQUIPMENT, BETWEEN THE LAST TWO FIXTURES.
- SHOCK ABSORBERS SHALL BE MOUNTED IN THEIR VERTICAL POSITION. 5. SANITARY WASTE AND VENT PIPING SHALL BE UNIFORMLY GRADED TO ELEVATIONS SHOWN. IF NO ELEVATIONS ARE GIVEN, SEWERS SHALL BE PITCHED NOT LESS THAN 1/4" PER FOOT FOR ALL PIPING 3" IN DIAMETER AND SMALLER AND 1/8" PER FOOT FOR PIPE LARGER THAN

3" IN DIAMETER.

6. SUPPORT HORIZONTAL PIPING AS FOLLOWS: REFER TO IPC 2009 TABLE 308.5 FOR HANGER SPACING REQUIREMENTS.

MAXIMUM NOMINAL PIPE SIZE (IN.)	HANGER ROD DIAMETER (IN.)
1/2	3/8
3/4 TO 1-1/4	3/8
1-1/2 TO 2	3/8
2-1/2 TO 3	1/2
4	5/8
6	3/4
8 AND UP	7/8


- 7. HANGERS FOR PIPING GREATER THAN 1" SHALL PASS OVER THE INSULATION. PROVIDE SADDLES FOR INSULATED PIPING.
- 8. HANGERS SHALL BE ATTACHED TO STRUCTURAL STEEL WORK BY CLAMPING OR OTHER APPROVED METHODS, EXCEPT THAT STRUCTURAL WORK SHALL NOT BE DRILLED AND PUNCHED.
- 9. INSULATION SHALL BE APPLIED WITH JOINTS TIGHTLY BUTTED. OPEN CRACKS, VOIDS AND DEPRESSIONS SHALL BE FILLED WITH HYDRAULIC SETTING CEMENT AND LAPPING MATCHING THE FINISH SHALL BE PASTED NEATLY OVER JOINTS.
- 10. FITTINGS AND VALVES SHALL BE INSULATED WITH THE SAME TYPE INSULATION AS THE PIPING OR WITH HYDRAULIC SETTING CEMENT, BUILT UP TO THE SAME THICKNESS AS LINES. COVER SHALL BE SAME AS ADJACENT PIPING OR PVC PREFORMED JACKET.
- 11. PROVIDE AND INSTALL A CUT-OFF VALVE, UNION AND FULL SIZE DIRT LEG AT CONNECTION TO EACH GAS-FIRED PIECE OF EQUIPMENT.
- 12. SEAL ALL PENETRATIONS OF RATED PARTITIONS WITH U.L. RATED FIRE BARRIER MATERIAL.
- 13. AIR ADMITTANCE VALVES SHALL NOT BE ALLOWED ON SANITARY WASTE AND VENT SYSTEMS.
- 14. THE SYSTEM TESTS DESCRIBED HEREIN ARE MINIMUM REQUIREMENTS. HOWEVER, ADDITIONAL TESTS AS REQUIRED BY THE AUTHORITY HAVING JURISDICTION SHALL ALSO BE PERFORMED.
- 15. DOMESTIC WATER PIPING SHALL BE TESTED AT 125 PSI. IN ADDITION, PIPING SHALL BE TESTED IN ACCORDANCE WITH APPLICABLE CODE REQUIREMENTS.
- 16. THE DOMESTIC WATER SYSTEM SHALL BE FLUSHED OUT PROGRESSIVELY BY OPENING OUTLETS AND FLOWING WATER UNTIL IT RUNS CLEAR. AFTER PIPE CLEANING IS COMPLETED, THE STRAINERS SHALL BE REMOVED, CLEANED, AND REPLACED. THEN THE ENTIRE DOMESTIC WATER SYSTEM SHALL BE DISINFECTED IN ACCORDANCE WITH THE AUTHORITY HAVING JURISDICTION.
- 17. THE SANITARY WASTE SYSTEM SHALL BE FLUSHED OUT PROGRESSIVELY WITH FLOWING WATER UNTIL IT RUNS CLEAR.
- 18. THE ENTIRE SANITARY WASTE SYSTEM SHALL BE TESTED AGAINST A HEAD PRESSURE OF 10' TSH FOR 8 HOURS WITHOUT LEAKAGE.
- 19. GAS PIPING SHALL BE LEAK TESTED AT 30 PSI FOR 24 HOURS.
- 20. THE CONTRACTOR SHALL SUBMIT TO THE ENGINEER A LETTER STATING THAT THE ABOVE MENTIONED TESTING, CLEANING AND DISINFECTING WAS COMPLETED, AND ALL LEAKS (IF ANY) WERE REPAIRED AND SYSTEM CLEANED AND RETESTED. THE LETTER SHALL BE SIGNED AS WITNESSED BY THE LOCAL AUTHORITY HAVING JURISDICTION. THE GENERAL SUPERINTENDENT OR THE DESIGN ENGINEER.
- 21. FIXTURES SHALL BE MOUNTED RIGID TO WALLS AND FLOOR.
- 22. PROVIDE HEAT TRAPS ON INLET AND OUTLET OF ALL WATER HEATING STORAGE TANKS.

23. DRAIN MANAGEMENT PROGRAM:

- A. ALL DRAINS, VENTS, ETC. MUST BE TAPED OVER DURING CONSTRUCTION TO PREVENT DEBRIS FROM INFILTRATING THE LINES.
- B. GC/DEVELOPER IS REQUIRED TO SUBMIT PHOTOS OF TAPED DRAINS.
- C. GC WILL BE FINED \$150 PER DAY IF PHOTOS ARE NOT SUBMITTED BY THE BEGINNING OF WEEK TWO OF THE PROJECT OR IF ANY DRAIN IS DISCOVERED TO BE UNCOVERED DURING A PM SITE VISIT. FINES WILL TERMINATE ON THE DAY THAT PHOTOGRAPHIC EVIDENCE OF COMPLETION IS SUBMITTED TO AND VERIFIED BY THE TRACTOR SUPPLY PM.
-). GC/DEVELOPER WILL BE REQUIRED TO JET AND CAMERA ANY LINE IN WHICH THE DRAIN IS DISCOVERED TO BE UNCOVERED. RECEIPTS AND VIDEO MUST BE SUBMITTED TO TRACTOR SUPPLY FOR VERIFICATION.
- E. DRAIN MANAGEMENT SIGNAGE WILL BE PROVIDED BY TRACTOR SUPPLY AND INSTALLED BY THE GC/DEVELOPER.
- F. IF SIGNAGE IS NOT INSTALLED AT PUNCH, CLEANING/CAMERA POLICY WILL APPLY.
- G. GC WILL BE FINED \$150 PER DAY IF SIGNAGE IS NOT INSTALLED AT PUNCH. FINES WILL TERMINATE ON THE DAY THAT PHOTOGRAPHIC EVIDENCE OF COMPLETION IS SUBMITTED TO AND VERIFIED BY TRACTOR SUPPLY PM.

-NO HUB PIPE

AS REQUIRED

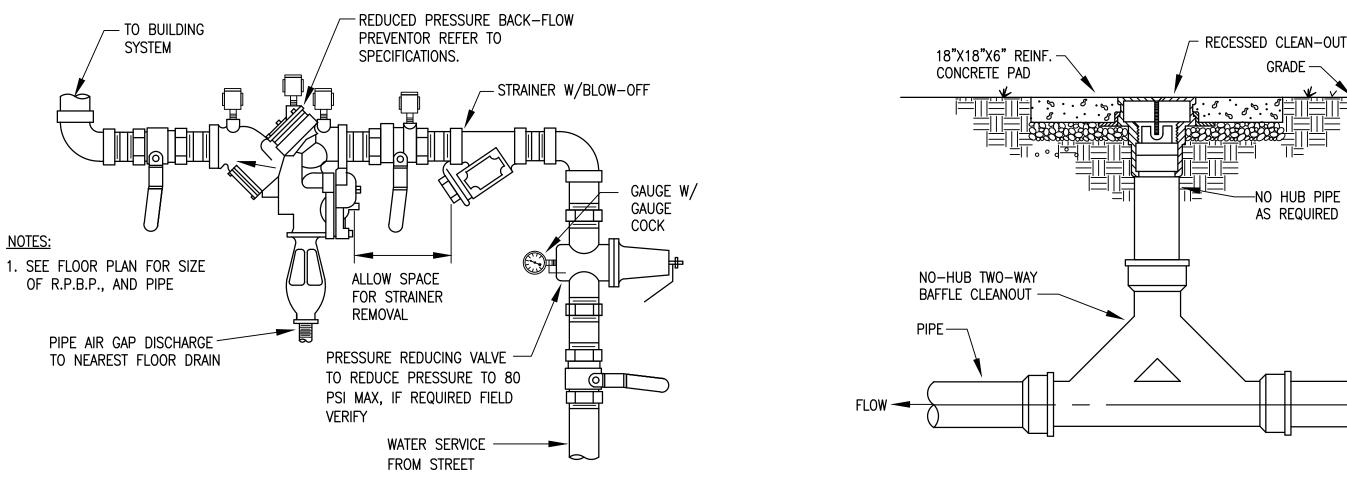

REDUCED PRESSURE BACKFLOW

PREVENTER DETAIL

NONE

EXTERIOR TWO-WAY CLEAN-OUT SCHEMATIC NONE

Schelton 1163 West Main St. Franklin, TN 37064 Tel: 615.730.9111 / Fax: 615.224.3599 gary@scheltonengineering.com Project #24-048

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

ARCHITECTURE

Nashville, TN 3712004rior Architecture

TRACTOR SUPPLY COMPANY

HUDSON,

2934 Sidco Drive

Suite 120

Architecture

Job Number: 05.10.2024

Revisions:

Revisions:

Sheet Number:

PLUMBING RISERS AND SPECIFICATIONS

P3.0

SPRINKLER INTENT INFORMATION					
	SALES AREA	OFFICE AREA AND PET WASH	STOCKROOM AREA		
ZONE CLASSIFICATION **	ORDINARY HAZARD GROUP 2	LIGHT HAZARD	MISCELLANEOUS STORAGE <12', CLASS III COMMODITIES * ORDINARY HAZARD GROUP 2		
DENSITY	.20 GPM/ SQ. FT.	.10 GPM/ SQ. FT.	.20 GPM/ SQ. FT.		
COVERAGE AREA	1500 SQ. FT.	1500 SQ. FT.	1500 SQ. FT.		
COVERAGE PER SPRINKLER	130 SQ. FT.	225 SQ. FT.	130 SQ. FT.		
DISCHARGE TEMPERATURE	165 ° F	165°F	165°F		
MAXIMUM HEAD SPACING	15 FT.	15 FT.	15 FT.		
HOSE STREAM ALLOWANCE	250 GPM	100 GPM	250 GPM		
COMMENTS: * COMMODITY CLASS REDUCED TO CLASS UL BASED ON STORAGE OF LESS THAN 10 PALLET OF CLASS IV COMMODITIES					


COMMODITY CLASS REDUCED TO CLASS III BASED ON STORAGE OF LESS THAN 10 PALLET OF CLASS IV COMMODITIES. 1 ** Zone Classification subject to authority having jurisdiction.


GENERAL NOTES


- 1. TSC TO FURNISH AND CONTRACTOR TO INSTALL MINIMUM OF 11 PORTABLE FIRE EXTINGUISHERS. LOCATIONS SHALL BE DETERMINED BY STORE FIXTURES AND SHELVING TO MAINTAIN A MAXIMUM TRAVEL DISTANCE OF 75'-0".
- 2. SPRINKLER LINES, MAINS, AND BRANCHES SHALL BE AS HIGH AS POSSIBLE IN STOCKROOM.
- 3. TSC IS TO APPROVE ALL SPRINKLER DRAWINGS PRIOR TO INSTALLATION.
- 4. FIRE SPRINKLER CONTRACTOR SHALL BE RESPONSIBLE FOR SUBMITTING FORMAL "DESIGN INTENT" DRAWINGS INCLUDING FULL HYDRAULIC CALCULATIONS, SEALED BY A PROFESSIONAL ENGINEER MEETING ALL STATE AND LOCAL CODE REQUIREMENTS.
- 5. FIRE EXTINGUISHERS SHALL BE UL & ULC RATED AT 2A:10B:C OR BETTER.
- 6. CONTRACTOR TO RAISE SPRINKLER LINES, MAINS, AND BRANCHES AS HIGH AS POSSIBLE IN ALL EXPOSED TO DECK LOCATIONS.

FIRE PROTECTION SPECIFICATIONS


- 1. THE SPRINKLER SYSTEM SHALL CONFORM TO NATIONAL FIRE PROTECTION ASSOCIATION 13 AND ALL APPLICABLE REGULATORY REQUIREMENTS AND BUILDING CODES AS INTERPRETED BY THE AUTHORITY HAVING JURISDICTION IN THE LOCALE OF THE PROJECT. WHERE CONFLICTS EXIST BETWEEN SUCH REGULATORY OR CODE REQUIREMENTS, SUCH CONFLICT SHALL BE IDENTIFIED FOR THE REVIEW OF THE ARCHITECT AND ENGINEER.
- 2. CONTRACTOR SHALL FURNISH AND INSTALL A COMPLETE AND HYDRAULICALLY CALCULATED SPRINKLER SYSTEM AS INDICATED ON FLOOR PLANS. MINIMUM SCOPE OF WORK SHALL INCLUDE PROVIDING NEW PENDANT SPRINKLER HEADS AND/OR RELOCATING EXISTING SPRINKLER HEADS AS REQUIRED IN THE VESTIBULE, SALES AREA, TOILETS, OFFICES, AND BREAKROOM. RELOCATE EXISTING UPRIGHT SPRINKLER HEADS OR PROVIDE NEW SPRINKLER HEADS AS REQUIRED IN THE STOCK ROOM. PROVIDE BRANCH PIPING FOR ALL NEW SPRINKLER HEADS AND ROUTE PIPING TO NEAREST BRANCH MAIN OR CROSS MAIN. PROVIDE SUPPORTS AS REQUIRED BY NFPA 13. FIELD VERIFY EXISTING CONDITIONS.
- 3. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL DEFECTS, REPAIRS AND REPLACEMENTS IN MATERIAL AND WORKMANSHIP FOR A PERIOD OF ONE (1) YEAR AFTER FINAL PAYMENT IS APPROVED.
- 4. SUBMIT FOR APPROVAL THE NUMBER OF SHOP DRAWINGS AND MANUFACTURERS LITERATURE ON ALL MATERIALS AS REQUIRED TO THE ARCHITECT OR OWNER'S REPRESENTATIVE.
- 5. SUBMIT DRAWINGS AND CALCULATIONS TO THE DEPARTMENT OF FIRE PREVENTION OF THE STATE AND LOCAL AUTHORITIES HAVING JURISDICTION.
- 6. CONTRACTOR SHALL VISIT THE SITE AS WELL AS ADJACENT SPACES AND FULLY INFORM HIMSELF CONCERNING ALL CONDITIONS AFFECTING SCOPE OF WORK. VERIFY PIPE SIZES, LOCATION OF EXISTING COMPONENTS, AND SUITABILITY OF THE EXISTING SYSTEMS TO MEET THE HYDRAULIC CALCULATIONS PRIOR TO BID.
- 7. DRAWINGS ARE DIAGRAMMATIC AND INTENDED TO SHOW APPROXIMATE LOCATIONS. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO REVIEW ALL ARCHITECTURAL, CIVIL, STRUCTURAL, ELECTRICAL, AND MECHANICAL DRAWINGS AND COORDINATE WITH OTHER TRADES FOR PIPE ROUTING AND EQUIPMENT PLACEMENT. INSTALL ALL WORK WITHOUT CONFLICT WITH OTHER TRADES AND MAKE MINOR ALTERATIONS AS REQUIRED WITHOUT ADDITIONAL COST TO OWNER.
- 8. THE SPRINKLER SYSTEM SHALL BE INSTALLED BY A FIRE PROTECTION SPRINKLER SYSTEM CONTRACTOR WITH A VALID CERTIFICATE OF REGISTRATION ISSUED BY THE AUTHORITY HAVING JURISDICTION.
- 9. CONTRACTOR SHALL COORDINATE WITH ELECTRICAL CONTRACTOR ALL VOLTAGES, ELECTRICAL LOADS, ETC. OF ELECTRICALLY OPERATED EQUIPMENT PRIOR TO PURCHASING EQUIPMENT. ALL EQUIPMENT SHALL BE U.L. AND NEMA APPROVED.
- 10. MAINTAIN A MINIMUM CLEARANCE OF 3'-0" IN FRONT OF ALL ELECTRICAL PANELS AND 1'-0" ON EITHER SIDE OF ELECTRICAL PANEL TO STRUCTURE.
- 11. ALL HORIZONTAL AND VERTICAL PIPING SHALL BE SUPPORTED IN ACCORDANCE WITH NFPA 13 AND STATE AND LOCAL REQUIREMENTS. SUPPORTS HALL SECURELY HOLD PIPING, PREVENT VIBRATION, COMPENSATE FOR STATIC AND OPERATIONAL CONDITIONS OF THE VARIOUS SYSTEMS, AND SHALL NOT BE SUBJECT TO ELECTROLYTIC ACTION.
- 12. ALL SPRINKLER SYSTEM MATERIALS INSTALLED SHALL BE U.L. LISTED AND FACTORY MUTUAL APPROVED FOR FIRE PROTECTION USE.
- 13. CONTROL VALVES SHALL BE SLOW CLOSING INDICATING VALVES LISTED FOR FIRE PROTECTION USE. EACH CONTROL SHALL HAVE A SUPERVISORY SWITCH.
- 14. SPRINKLER PIPING PENETRATING ONE-HOUR OR GREATER RATED FIRE WALLS SHALL BE SLEEVED AND CAULKED TO MEET U.L. LISTED ASSEMBLY FOR RATING OF WALL.
- 15. CONTRACTOR SHALL FLUSH WATER SYSTEM AFTER INSTALLATION PER REQUIREMENTS OF NFPA 24.
- 16. SPRINKLER HEADS SHALL BE TYCO, RELIABLE, CENTRAL, VIKING OR EQUAL.
- 17. OFFICE AREA AND SIMILAR OCCUPANCIES SHALL HAVE DENSITY OF ADJACENT AREAS IF NOT SEPARATED BY WALLS. IF SEPARATED BY WALLS, THE AREA SHALL BE HYDRAULICALLY BALANCED TO PRODUCE 0.1 G.P.M. PER SQUARE FOOT DENSITY OVER THE MOST REMOTE 1,500 SQ. FT., HEAD COVERAGE 225 SQ. FT./HEAD MAXIMUM, USING 165°F HEADS.
- 18. SALES AREA, VESTIBULE, AND SIMILAR OCCUPANCIES SHALL SHALL BE HYDRAULICALLY BALANCED TO PRODUCE 0.2 GPM PER SQUARE FOOT DENSITY OVER THE MOST REMOTE 1,500 SQ. FT., HEAD COVERAGE 130 SQ. FT./HEAD MAXIMUM, USING 165°F HEADS.
- 19. RECEIVING AREA AND STOCKROOM SHALL BE HYDRAULICALLY BALANCED TO PRODUCE .20 GPM PER SQUARE FOOT DENSITY OVER THE MOST REMOTE 1,500 SQ. FT., HEAD COVERAGE 130 FT./HEAD MAXIMUM, USING 165°F HEADS.
- 20. ALL SPRINKLER HEADS IN AREAS WITH FINISHED CEILING SHALL BE CHROME-PLATED RECESSED PENDANT TYPE WITH TEMPERATURE RATING AS CONDITIONS DICTATE. ASSOCIATED SPRINKLER PIPING SHALL BE ENTIRELY CONCEALED.
- 21. ALL SPRINKLER HEADS IN AREAS WITHOUT FINISHED CEILINGS SHALL BE BRASS UPRIGHT HEADS WITH TEMPERATURE RATING AS CONDITIONS DICTATE. ASSOCIATED SPRINKLER PIPING SHALL BE RUN EXPOSED. DO NOT PAINT HEADS.
- 22. THE SPRINKLER CONTRACTOR SHALL COORDINATE THE LOCATION OF PIPING AND HEADS WITH LIGHT FIXTURES, DIFFUSERS, DUCTWORK, PLUMBING LINES, ETC. AND MAKE MINOR ADJUSTMENTS IN THE SPRINKLER LAYOUT WHERE REQUIRED OR DEEMED NECESSARY BY THE ARCHITECT.
- 23. MODIFICATIONS TO THE SPRINKLER SYSTEM SHALL BE IN ACCORDANCE WITH NFPA 13.

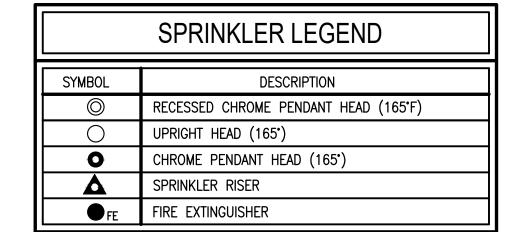


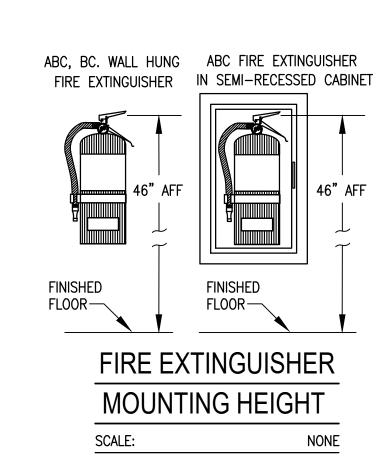

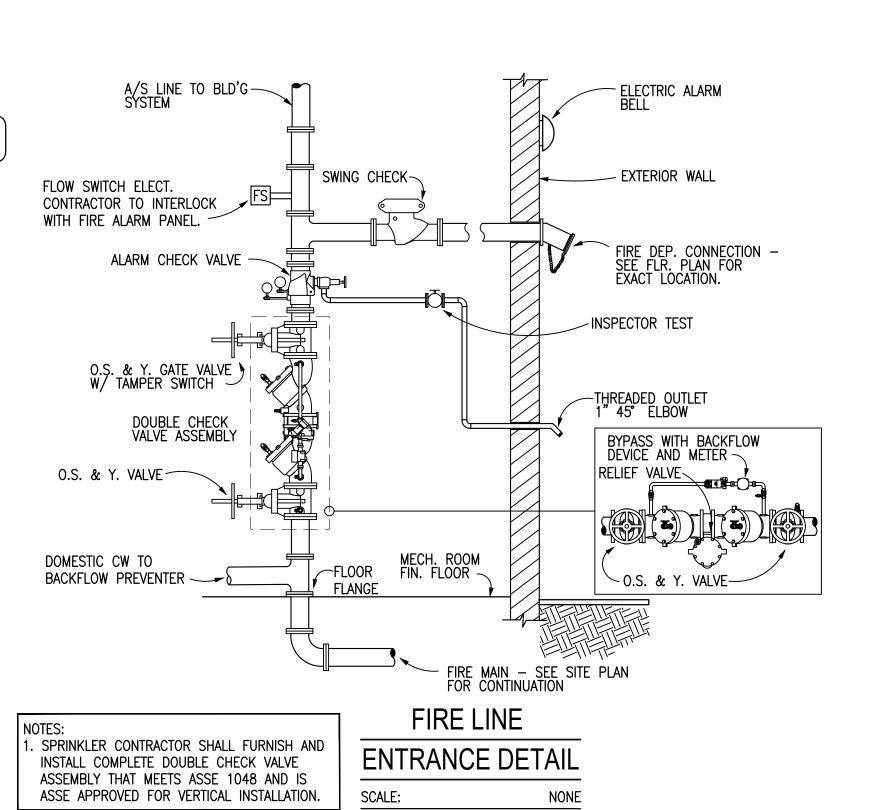

LIVE GOODS CENTER

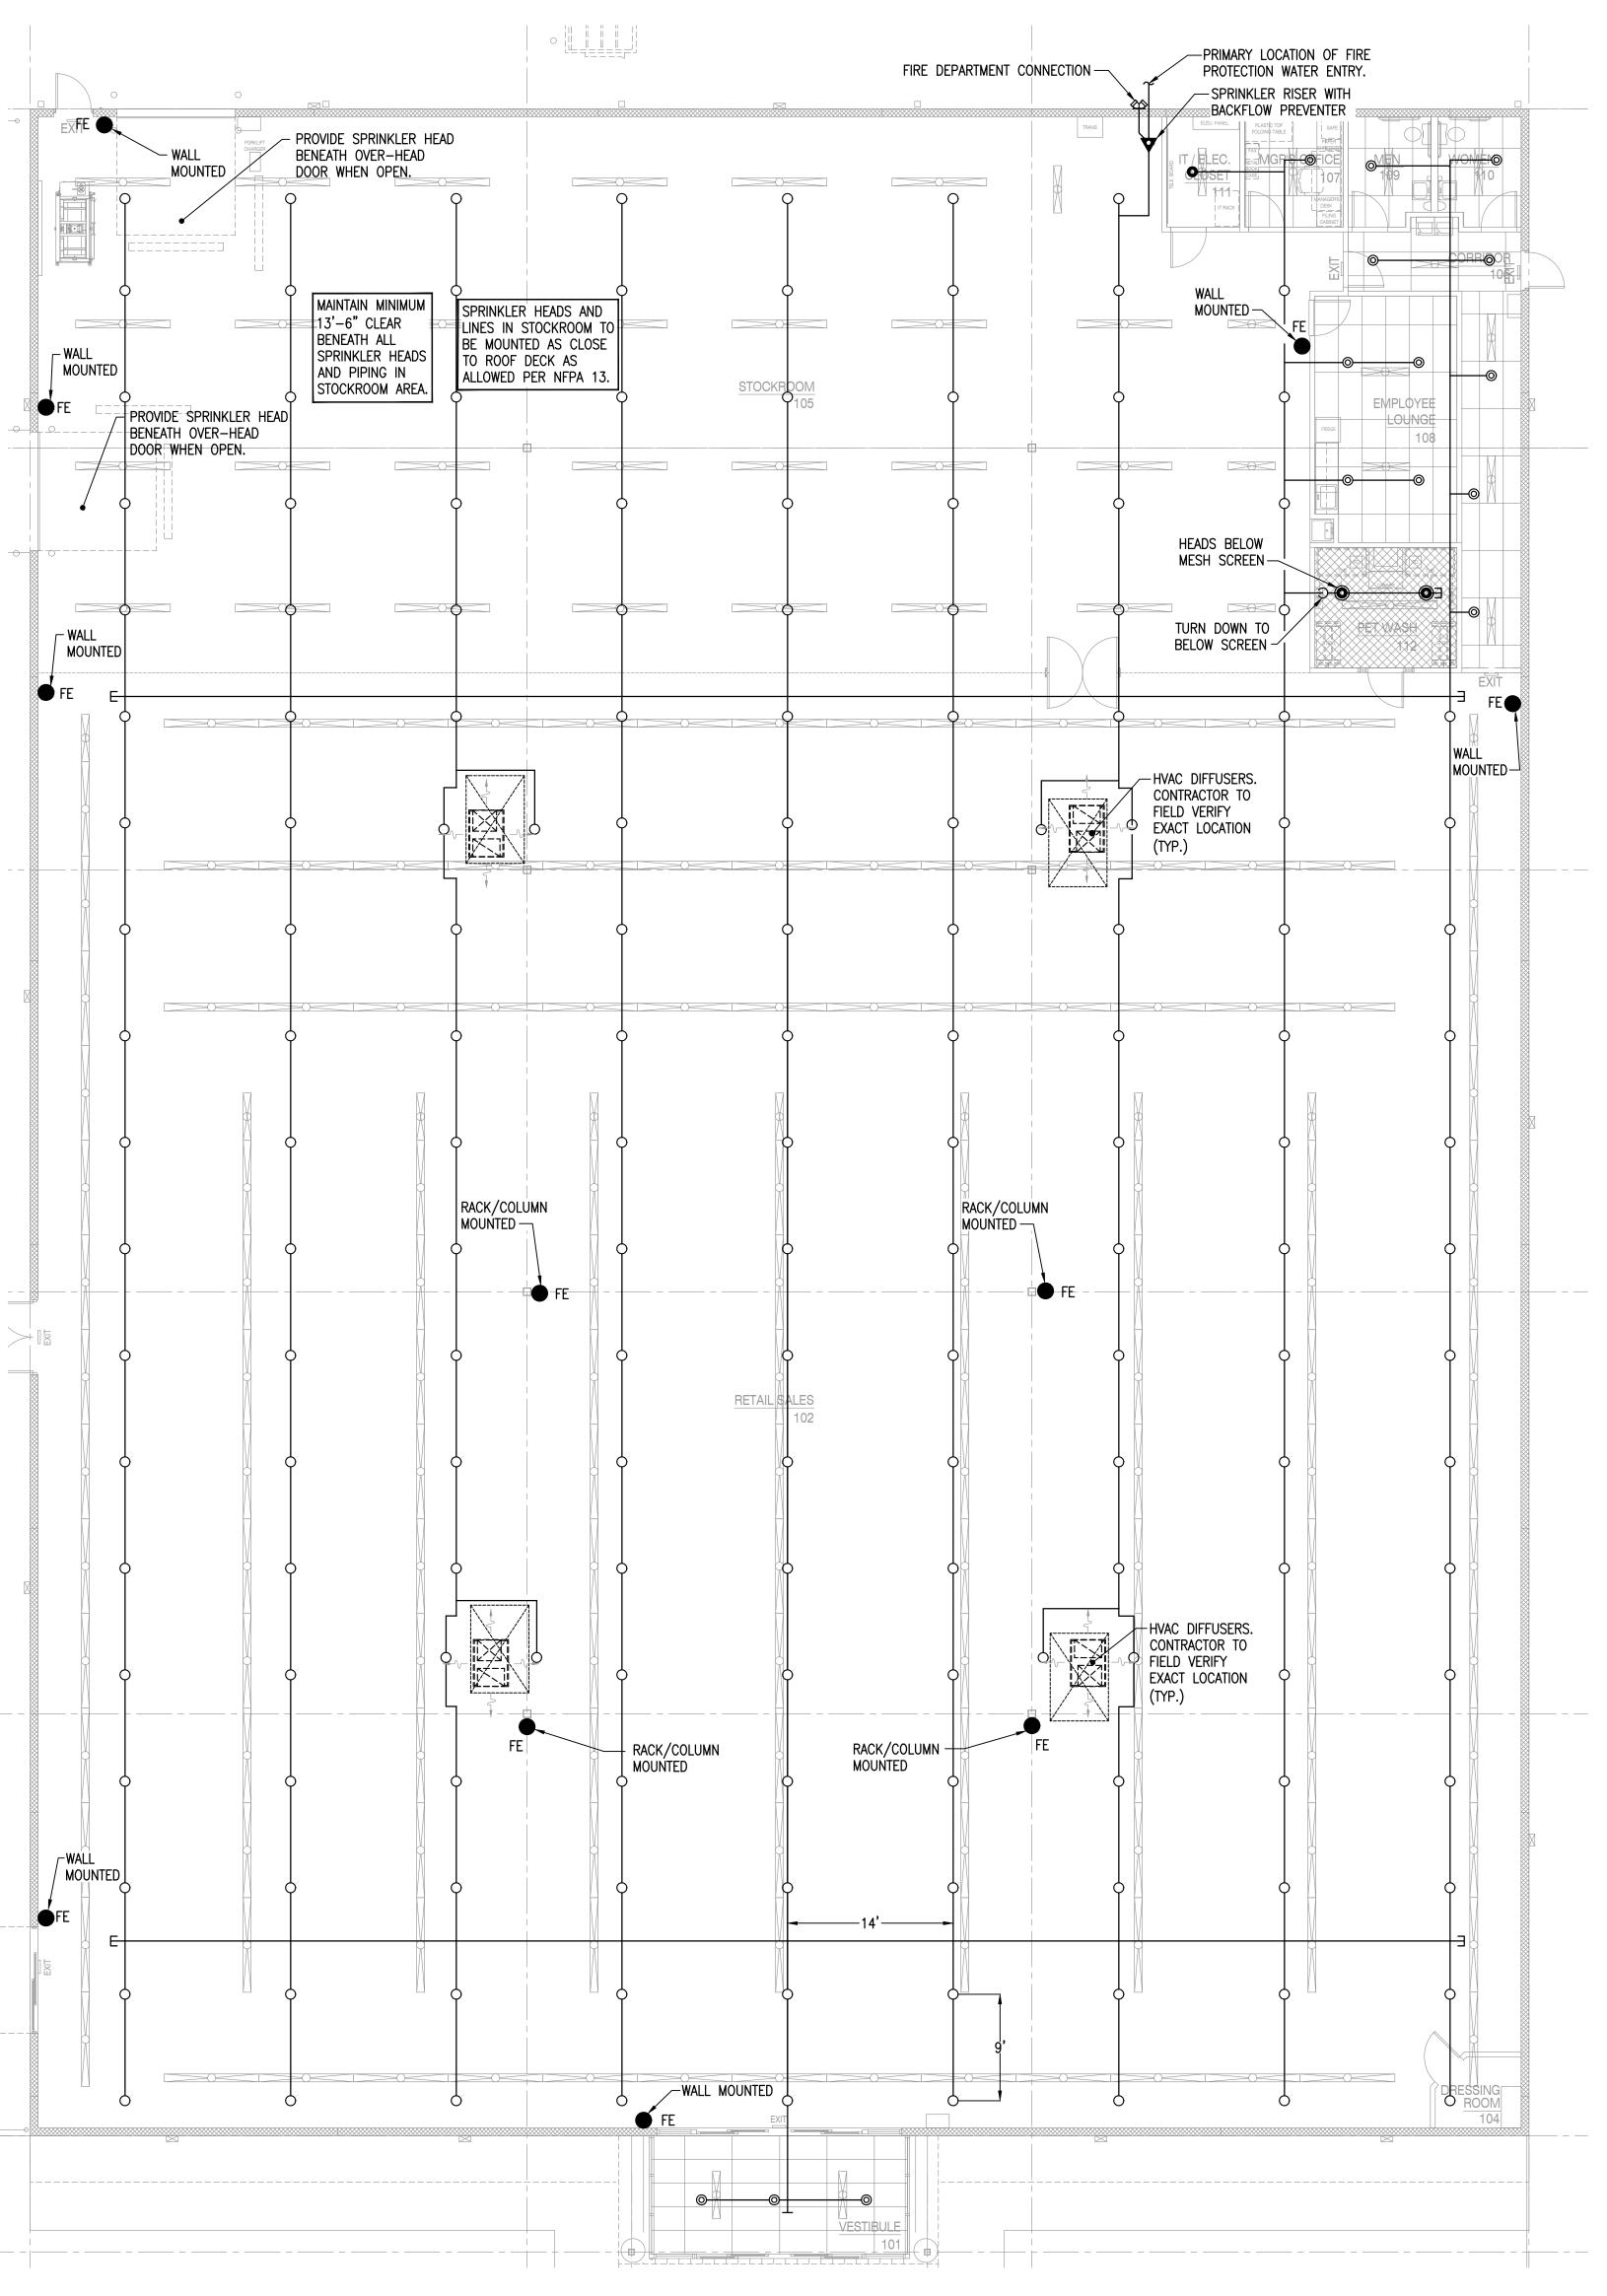







2934 Sidco Drive Suite 120 Nashville, TN 371204rior Architecture



This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

Job Number: 05.10.2024 Revisions: Revisions: FIRE PROTECTION PLAN

SITE PLAN NOTES


1. COORDINATE INSTALLATION OF NEW UNDERGROUND SERVICE WITH LOCAL ELECTRIC UTILITY COMPANY. PROVIDE TRENCHING, CONDUIT, CONDUCTORS, METER BASE, CT ENCLOSURE, CONCRETE PAD, AND OTHER ITEMS AS REQUIRED. INSTALL SERVICE IN ACCORDANCE WITH CURRENT UTILITY COMPANY REQUIREMENTS. SEE RISER DIAGRAM ON SHEET E4.0.

2. COORDINATE INSTALLATION OF TELEPHONE SERVICE CONDUITS WITH LOCAL TELEPHONE COMPANY. INSTALL (2) 2" CONDUITS FROM TELEPHONE SERVICE POINT TO TELEPHONE TERMINAL BOARD.

3. VERIFY LOCATION OF PYLON SIGN WITH OWNER. VERIFY EXACT ELECTRICAL REQUIREMENTS WITH VENDOR. PROVIDE CIRCUIT PER VENDOR'S RECOMMENDATIONS. PROVIDE DISCONNECTING MEANS IF NOT PROVIDED WITH SIGN AND LOCATE PER VENDOR'S RECOMMENDATIONS.


4. 1" CONDUIT WITH PULLSTRING FOR LOW VOLTAGE WIRING FROM FORAGE SHED TO TELEPHONE TERMINAL BOARD. VERIFY WITH TSC REPRESENTATIVE FOR EXACT LOCATION. 5. PROVIDE A 1-1/2" CONDUIT FROM IRRIGATION CONTROLLER TO OUTSIDE OF CURBLINE. COORDINATE EXACT LOCATION WITH GC.

6. CONTRACTOR SHALL INSTALL 1"C WITH PULLSTRING FROM THE TELEPHONE TERMINAL BOARD TO REMOTE PIV, BACKFLOW, OR WATER VALVES THAT THE LOCAL AHJ REQUIRES TO BE MONITORED BY THE FIRE ALARM SYSTEM.

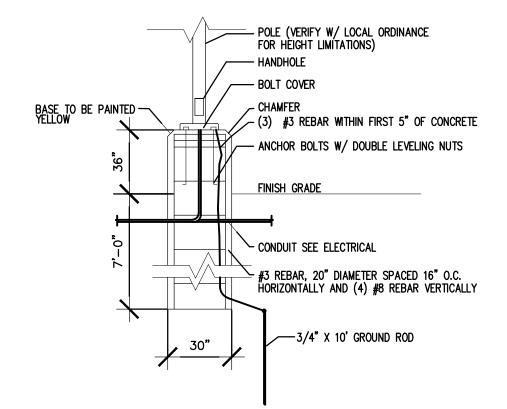

POLE BASE DETAIL

POLE BASE DETAIL PROVIDED FOR SCOPE AND BID PURPOSES.
CONTRACTOR SHALL SUBMIT A POLE BASE DESIGN SUITABLE FOR
LOCAL CONDITIONS AND APPROVED BY A STRUCTURAL ENGINEER.

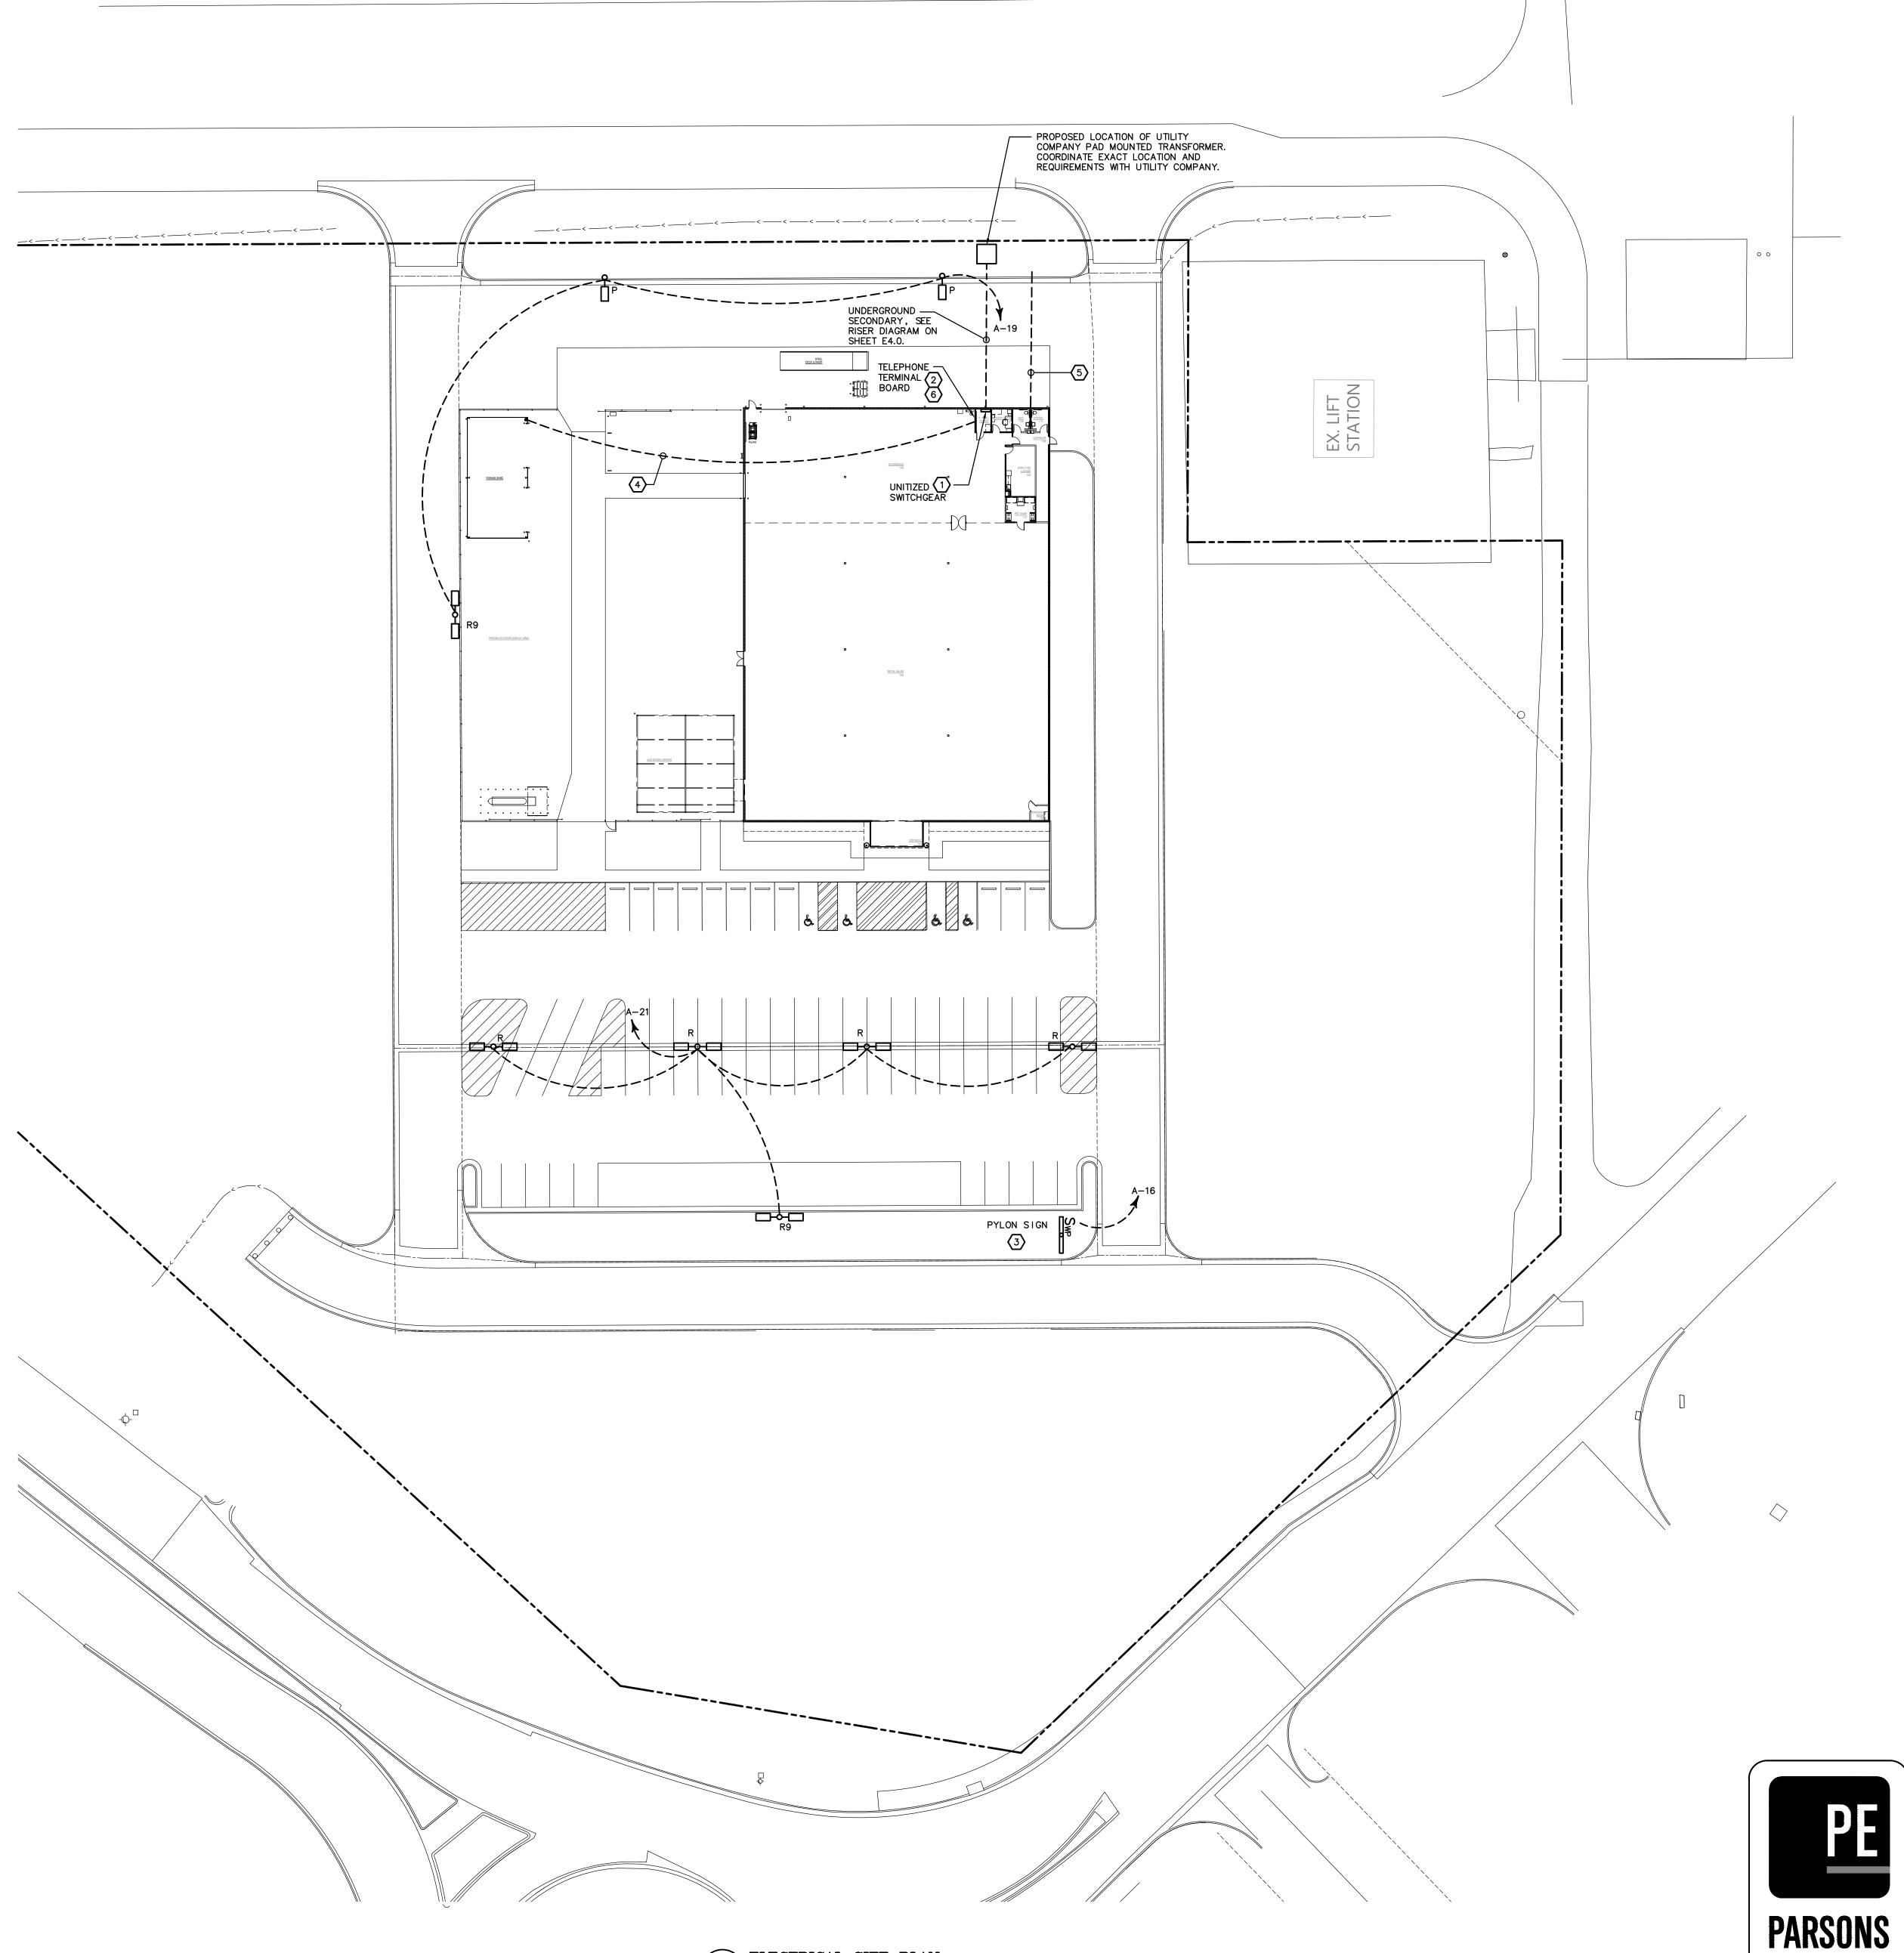


ES1.0 SCALE: 1" = 30'-0"



Architecture 2934 Sidco Drive Planning Suite 120 Nashville, TN 37204 Interior Architecture






TRACTOR SUPPLY COMPANY HUDSON, COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

Job Number: 05.10.2024 Revisions:

ELECTRICAL SITE PLAN

ENGINEERING, INC.
NASHVILLE, TENNESSEE
PARSONSENGINEERING.COM

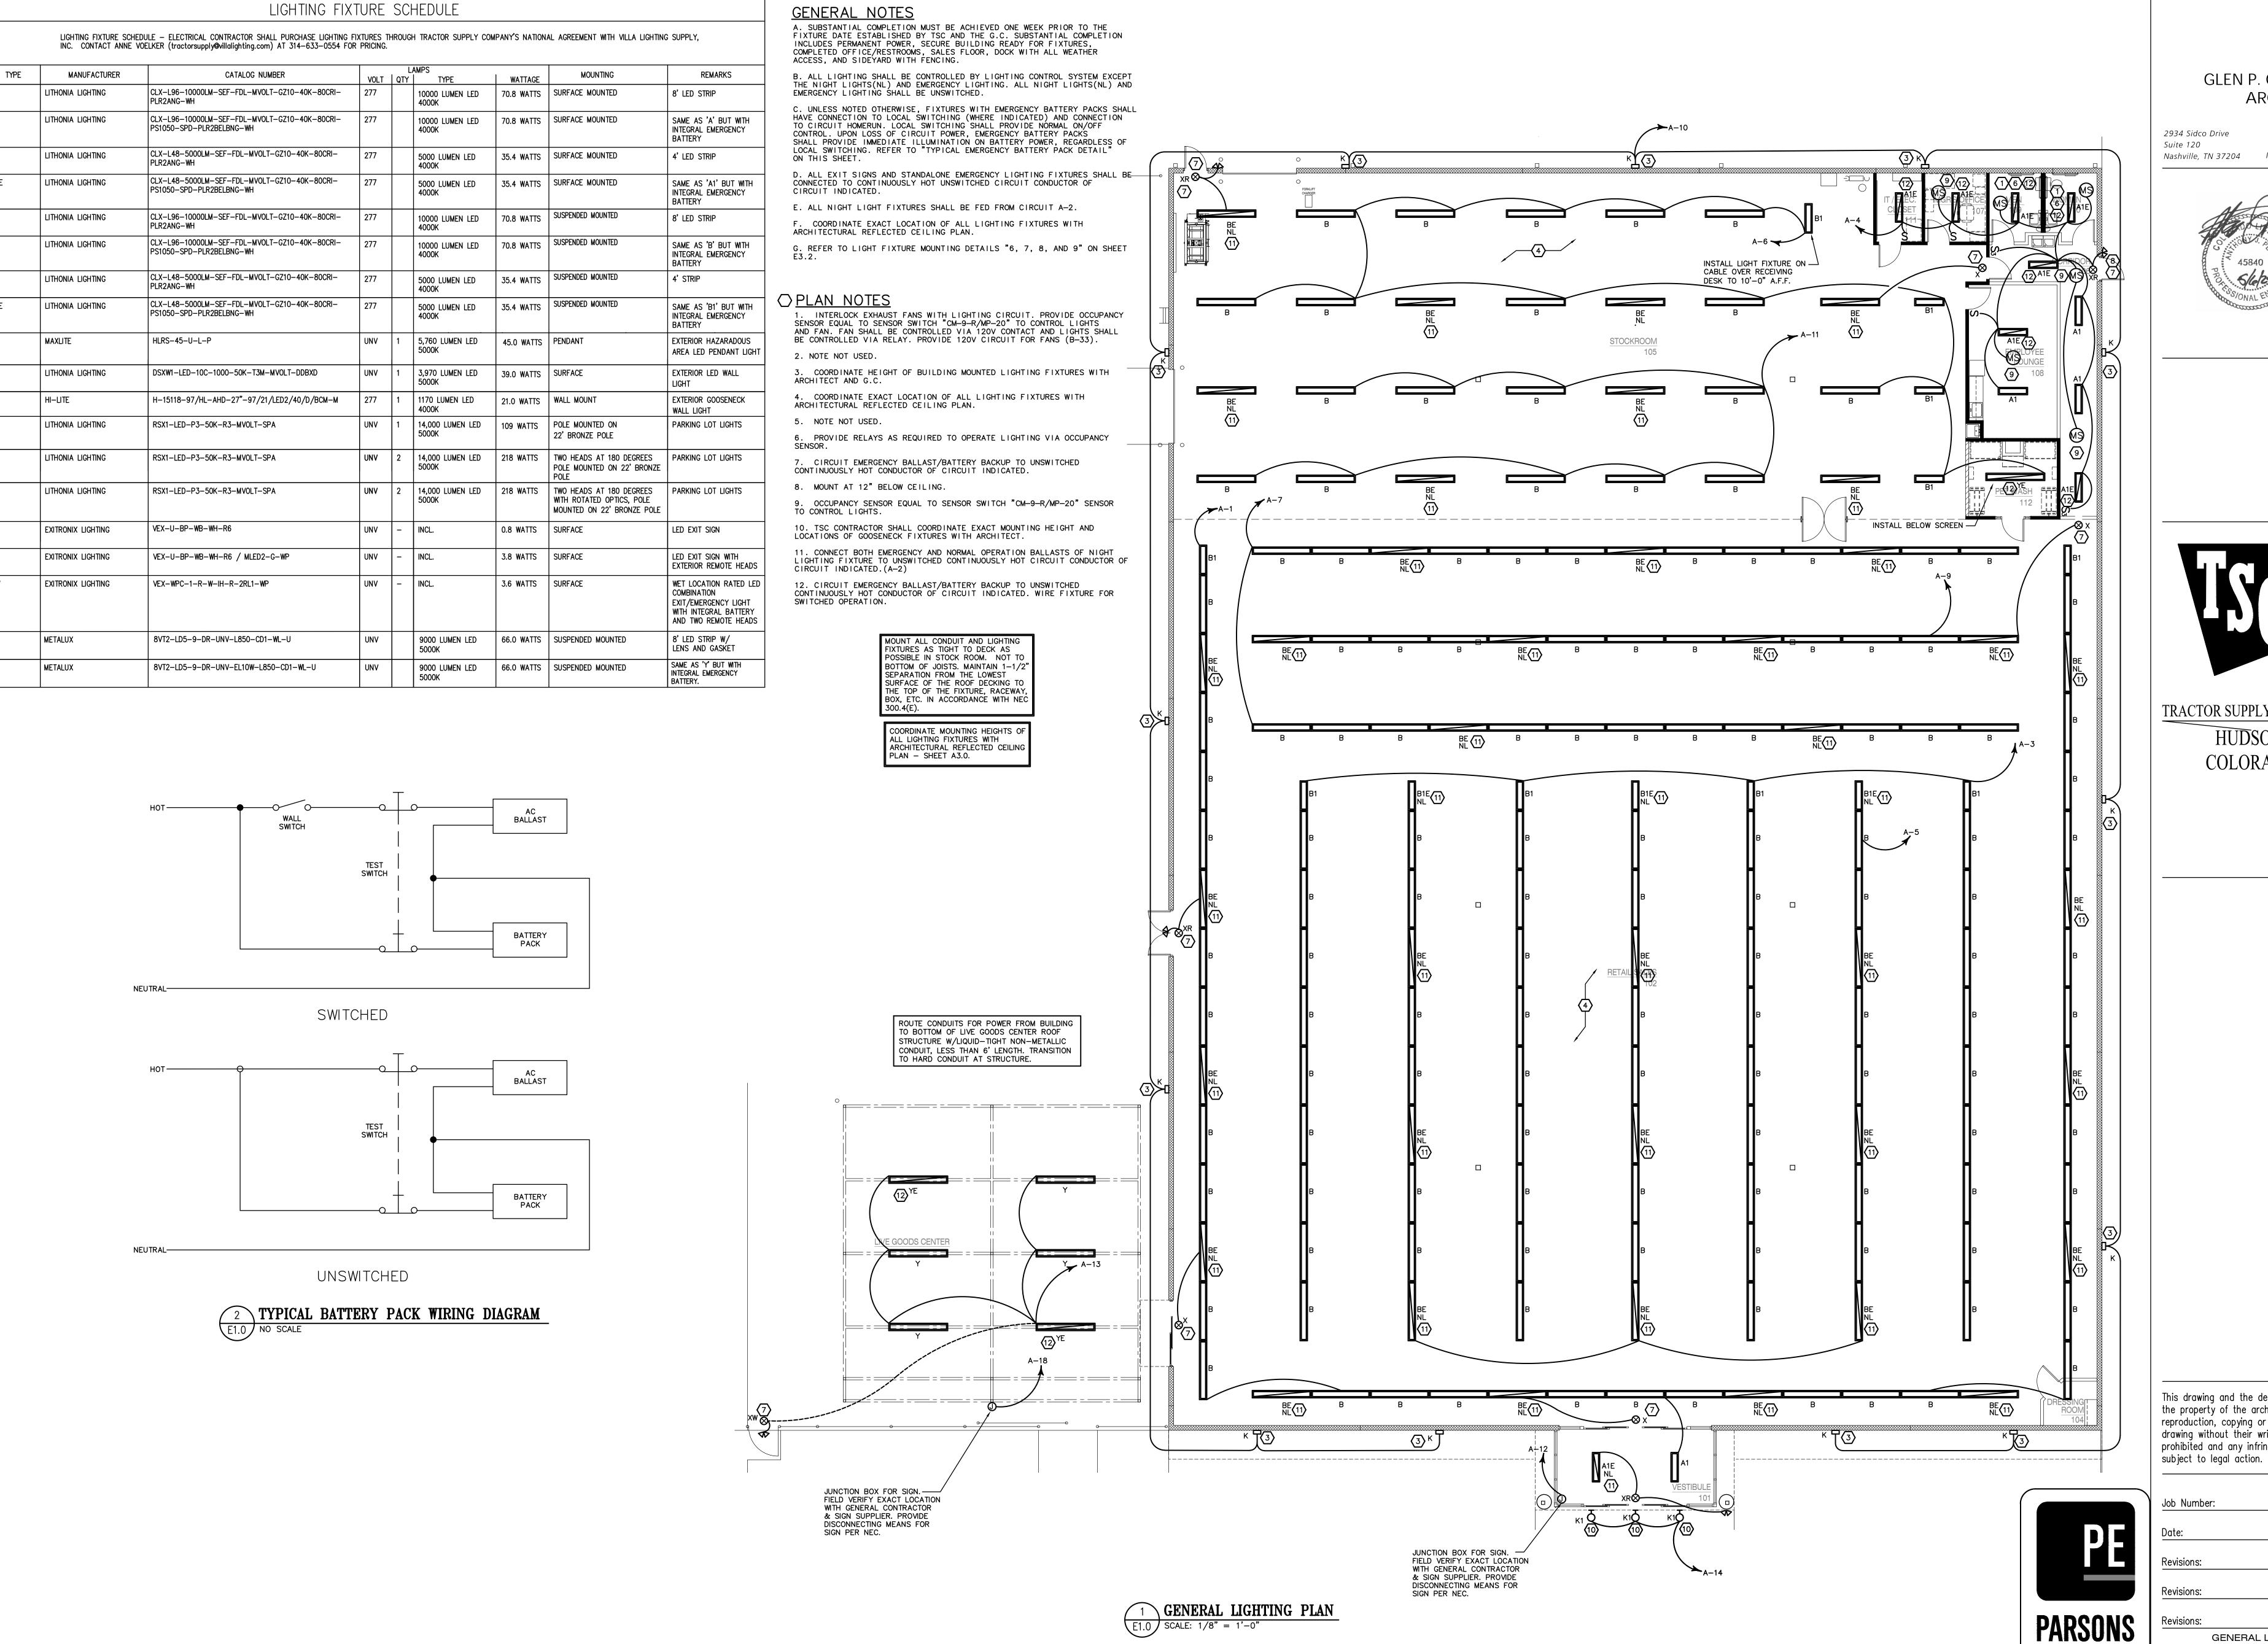



2934 Sidco Drive Suite 120 Nashville, TN 37204 Interior Architecture



TRACTOR SUPPLY COMPANY HUDSON, COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be

lob Number: Date: 05.10.2024 Revisions:

Revisions:

ENGINEERING, INC. NASHVILLE, TENNESSEE PARSONSENGINEERING.COM Revisions: GENERAL LIGHTING PLAN

1. INTERLOCK EXHAUST FANS WITH LIGHTING CIRCUIT. PROVIDE OCCUPANCY SENSOR EQUAL TO SENSOR SWITCH "CM-9-R/MP-20" TO CONTROL LIGHTS AND FAN. FAN SHALL BE CONTROLLED VIA 120V CONTACT AND LIGHTS SHALL BE CONTROLLED VIA RELAY. PROVIDE 120V CIRCUIT FOR FANS (B-33). 2. COORDINATE CONDUIT ROUGH-IN FOR TAMPER AND FLOW CONNECTIONS AS WELL AS ALL OTHER FIRE ALARM DEVICES WITH FIRE ALARM CONTRACTOR.

3. FURNISH AND INSTALL POWER POLES FROM SALES COUNTERTOPS TO CEILING STRUCTURE. SPECIFY RELOC #PP2-L186-HW-B-BLACK OR EQUIVALENT. REFER TO OFFICIAL TSC FIXTURE PLAN LAYOUT SENT FROM TSC TO GC FOR EXACT LOCATIONS. ATTACH POWER POLE TOP TO UNI-STRUT AT BAR JOIST WITH A "U" CLAMP TO THE TOP OF THE POWER POLE AT THE BAR JOIST. LOOSEN THE "U" BOLT USED TO TIGHTEN THE CONNECTION TO THE POWER POLE SO THAT THE POWER POLE IS ABLE TO REMAIN IN POSITION AND THE ROOF CAN FLEX DURING EXPANSION AND CONTRACTION WITHOUT DAMAGING THE POWER POLE. REFER TO DETAILS

4. RECEPTACLE FOR "STORE OPEN" AND "CUB CADET" SIGN MOUNTED IN CEILING WITHIN 6" OF VERTICAL STOREFRONT GLASS.

5. JUNCTION BOX FURNISHED AND INSTALLED FOR THE FIRE PROTECTION SYSTEM ELECTRIC GONG. ELECTRICAL CONTRACTOR TO INSTALL AND WIRE FIRE GONG, COORDINATE WITH FIRE SUPPRESSION CONTRACTOR FOR VOLTAGE. PROVIDE LOW VOLTAGE TRANSFORMER AS REQUIRED.

6. JUNCTION BOX FURNISHED AND INSTALLED BY ELECTRICAL CONTRACTOR FOR POWER DOORS.

. ELECTRICAL CONTRACTOR SHALL PROVIDE AND INSTALL AN EDWARDS 55-4G5 DOOR BELL AND AN EDWARDS 592 TRANSFORMER AT TWO LOCATIONS SHOWN. ELECTRICAL CONTRACTOR SHALL PROVIDE AND INSTALL AN EDWARDS 250 PUSHBUTTON TO CONTROL BOTH DOOR BELLS. PUSHBUTTON SHALL BE INSTALLED IN A WEATHERPROOF ENCLOSURE. TEST TO ASSURE WORKING SYSTEM. MOUNT TRANSFORMER & BELL AT 14'-0" AFF.

8. REFER TO SHEET E4.0 MATRIX AND E3.1 COUNTER DETAILS FOR RECEPTACLE AND DATA OUTLET LOCATIONS AT REGISTER COUNTERS (2) RED RECEPTACLES PER CIRCUIT MAXIMUM. (COORDINATE COUNTER LOCATIONS WITH FIXTURE DRAWINGS AND G.C.) THE OUTLET BOXES WILL BE PRE-INSTALLED IN CASEWORK. 9. (3) DUPLEX RECEPTACLES FURNISHED AND INSTALLED FOR SECURITY.

10. ALL ROOFTOP EQUIPMENT CONNECTIONS SHALL BE MADE THROUGH THE UNIT ROOF CURB. ROOF PENETRATIONS ARE NOT ACCEPTABLE. ALL RTU'S AND AC UNITS SHALL HAVE A 3/4" CONDUIT OR SEAL TIGHT INSTALLED FOR LOW VOLTAGE CABLE.

11. EDWARDS 55-4GB DOOR BELL @ CASH REGISTER & CONNECT TO SYSTEM AS NECESSARY. COORDINATE WITH G.C. FOR EXACT LOCATION OF BELL. 12. ALARM CO. SHALL PROVIDE & INSTALL NECESSARY HOOK-UPS TO FACP. ALARM CO. SHALL ALSO PROVIDE COMPLETE FIRE ALARM SYSTEM AS REQUIRED BY AHJ, ADA,

13. VERIFY A/C UNIT MANUFACTURER AND LOAD REQUIREMENTS. FURNISH AND INSTALL BRANCH CIRCUIT RATED FOR UNIT LOAD.

14. REFER TO CASEWORK ELEVATIONS AND DETAILS ON PLAN E3.1 FOR ADDITIONAL INFORMATION ON REGISTER AND DISPLAY COUNTERS.

15. ALL CONDUIT TO RUN PARALLEL OR PERPENDICULAR TO STRUCTURE. HORIZONTAL CONDUIT SHALL BE NO LOWER THAN 15'-6". NO HORIZONTAL CONDUITS ALLOWED TO BE MOUNTED ON THE SALES WALLS.

16. COORDINATE WITH SECURITY VENDOR FOR THEIR INSTALLATION OF FIRE ALARM AND SECURITY SYSTEMS PANELS. PROVIDE TWO JUNCTION BOXES FOR HARDWIRED POWER CONNECTION. 17. PROVIDE RED RECEPTACLE IN POWER POLE.

18. COORDINATE ALL REQUIREMENTS OF BALER WITH SUPPLIER. COORDINATE EXACT LOCATION WITH TSC FINAL FIXTURE PLAN. E.C. SHALL MAKE FINAL CONNECTION TO BALER. LOCATE DISCONNECT WITHIN TEN FEET OF BALER AND SUCH THAT IT DOES NOT INTERFERE WITH THE FINAL FIXTURE PLAN.

19. PROVIDE OCCUPANCY SENSOR EQUAL TO SENSOR SWITCH "CM-9-R/MP-20" TO CONTROL LIGHTS. SENSOR SHALL BE CENTERED IN ROOM AS MUCH AS POSSIBLE.

20. IF GFI OUTLETS ARE NOT INSTALLED, OUTLETS SHALL BE CIRCUITED TO A GFI BREAKER. LABEL OUTLETS THAT ARE ON THE GFI BREAKER. 21. PROVIDE TYPE "G" LIGHTING FIXTURE AT CANOPY CONTROLLED BY AN EXPLOSION PROOF SWITCH. CONNECT LIGHT TO PROPANE DISPENSING CIRCUIT. SEE DETAIL 2 ON SHEET E3.2. ALL CONDUIT SHALL BE RGS.

22. ELECTRICAL CONDUITS AND BOXES IN THE VICINITY OF THE BANNERS ON THE OUTSIDE FACE OF THE EXTERIOR WALL SHALL BE INSTALLED ABOVE THE LOWER MEMBER OF THE "A" FRAME TO AVOID INTERFERENCE WITH THE BANNERS. COORDINATE EXACT LOCATION WITH FINAL FIXTURE PLAN AND TSC PROJECT MANAGER.

23. J-BOX FOR POWER TO THE SERIES 800 POWER SUPPLY MOUNTED ABOVE THE CEILING IN LINE WITH THE HINGE SIDE OF THE DOOR. PROVIDE A 1/2" CONDUIT FROM THE POWER SUPPLY TO THE ELECTRIC POWER TRANSFER DEVICE (PT-5) OF THE DOOR FRAME, CONCEALED MORTISE MOUNT. PROVIDE AND PULL TWO #18 AWG WIRE FROM THE POWER SUPPLY TO THE POWER TRANSFER DEVICE AND INTO THE DOOR. CONTRACTOR TO COMPLETE WIRING AND CONNECTION OF THE DELAYED RIM EXIT DEVICE AFTER NEW DOOR AND RIM EXIT HARDWARE IS INSTALLED. COORDINATE ALL REQUIREMENTS WITH SUPPLIER/INSTALLER. SEE DETAIL 12/E3.2.

24. PROVIDE A 1-1/2" CONDUIT FROM IRRIGATION CONTROLLER TO OUTSIDE OF CURBLINE. COORDINATE EXACT LOCATION WITH GC.

25. 120 VOLT COMPRESSOR OUTLET LOCATED IN THE ASSEMBLY AREA. VERIFY FINAL LOCATION WITH THE TSC FINAL FIXTURE PLAN.

26. LOCATE WP/GFI OUTLET 14" AS MEASURED FROM INSIDE CORNER OF WALL. EXPOSED CONDUIT FOR ELECTRICAL OUTLET SHALL BE ROUTED WITHIN 18" OF INTERIOR BUILDING CORNER.

27. EXTERIOR OUTLET TO BE FLUSH MOUNTED IN WALL AT 36" AFF.

TSC CONSTRUCTION MANAGER PRIOR TO ROUGH-IN.

NFPA 58 6.13.4 AND 6.13.5.

28. BULK PROPANE NOTE: LOCATION FOR CONDUIT PENETRATION THROUGH GRADE FROM BUILDING TO PROPANE GAS DISPENSING SYSTEM. ALL CONDUIT FOR BULK PROPANE SHALL BE RGS. VERIFY WITH TSC PROJECT MANAGER IF SCP CAN NOT BE FOLLOWED. REFERENCE DETAILS 2,3,4,5/E3.2. 29. BULK PROPANE NOTE: BOLLARD MOUNTED PROPANE DISPENSING SYSTEM EMERGENCY STOP PUSHBUTTON IN WEATHER PROOF JUNCTION BOX. MOUNT EMERGENCY STOP BUTTON AT 4'-6" AFG. CONTRACTOR SHALL PROVIDE SIGN AT PUSHBUTTON TO IDENTIFY AS "PROPANE - CONTAINER LIQUID VALVE EMERGENCY SHUTOFF". COORDINATE EXACT MOUNTING LOCATION OF PUSHBUTTON WITH ARCHITECT. PUSHBUTTON SHALL BE INSTALLED A MINIMUM OF 25'-0" FOR DISPENSER BUT NO MORE THAN 100'-0" FROM DISPENSER AND MUST BE WITHIN SITE OF THE DISPENSER. REFERENCE DETAIL 1/E3.2 FOR CONTROL DIAGRAM. PUSHBUTTON SHALL BE INSTALLED AND LABELED PER

30. VERIFY EXACT LOCATION OF RECEPTACLE WITH FINAL FIXTURE PLAN. RECEPTACLES SHOWN AT +100" SHALL BE INSTALLED AT 100" ABOVE FINISHED FLOOR TO

31. CONTRACTOR SHALL ROUTE CONDUIT FOR ELECTRICAL DEVICES LOCATED BELOW 96" AFF RECESSED IN THE WALL. CONDUIT MAY BE ROUTED EXPOSED ABOVE 96"AFF. PAINT TO MATCH WALL.

32. SPRING AND JAMB MOUNTING PADS TO BE FURNISHED AND INSTALLED BY GENERAL CONTRACTOR. FACTORY WIRED OPERATORS AND CONTROLS FOR OVERHEAD DOOR TO BE FURNISHED AND INSTALLED BY DH PACE (LOW-VOLTAGE ONLY). ALL CONDUIT RACEWAYS, DISCONNECTS, ELECTRICAL BOXES, WIRING, AND CONNECTIONS ARE BY ELECTRICAL CONTRACTOR. DH PACE WILL LANS AND TERMINATE WIRING FOR LOW-VOLTAGE EQUIPMENT.

33. QUADRAPLEX RECEPTACLE WALL MOUNTED AT 100" ABOVE FINISHED FLOOR FOR CORDLESS PHONE REPEATER. COORDINATE EXACT MOUNTING HEIGHT AND LOCATION WITH

34. PROVIDE AND INSTALL (1) EXPLOSION PROOF JUNCTION BOX AT THE DISPENSING UNIT. JUNCTION BOX TO BE. COOPER CROUSE HINDS MODEL # GUAW26. INSTALL SUCH THAT BOX IS IN A VERTICAL POSITION SO THE MAXIMUM WIDTH IS 4-1/4". COORDINATE EXACT LOCATIONS AND REQUIREMENTS WITH PROPANE DISPENSING VENDOR PRIOR TO ROUGH-IN. COORDINATE LOCATION OF CONDUIT ENTRIES WITH PROPANE DISPENSING VENDOR PRIOR TO ORDERING. JUNCTION BOX MUST BE CLASS 1, DIVISION 1 RATED,

MEET ALL DIVISION REQUIREMENTS PER NFPA, AND MUST PASS ELECTRICAL INSPECTION. 35. CONDUITS SHALL NOT BE RUN EXPOSED OR SURFACE MOUNTED INSIDE THE DRESSING ROOM. ANY CONDUIT FOR EXTERIOR DEVICES SHALL BE RUN CONCEALED IN THE WALL. INTERIOR DRESSING ROOM WALLS TO BE CLEAR OF CONDUIT AND JUNCTION BOXES BELOW 96" ABOVE FINISHED FLOOR.

37. ALL CONDUITS INSTALLED IN THE STOCKROOM AREA SHALL BE INSTALLED AS TIGHT TO ROOF DECK AS ALLOWED BY CODE.

38. PROVIDE 120V-24V TRANSFORMER AS NEEDED FOR VAV DAMPER. COORDINATE EXACT REQUIREMENTS FOR VAV DAMPER WITH MECHANICAL PLANS/MECHANICAL

39. "CHICK DAYS" OUTLET. INSTALL OUTLET TO BOTTOM OF JOIST AT DIMENSIONED LOCATION. VERIFY EXACT LOCATION WITH TSC FINAL FIXTURE PLAN. INSTALL CONTRACTOR PROVIDED POWER REEL CONNECTED TO OUTLET. POWER REEL SHALL BE HUBBELL #HBLC40123TT. 40. J-BOX FOR CONNECTION TO HAND DRYER. COORDINATE EXACT LOCATION AND

41. QUADRAPLEX RECEPTACLE WALL MOUNTED AT 108" ABOVE FINISHED FLOOR FOR EAS. COORDINATE EXACT MOUNTING HEIGHT AND LOCATION WITH TSC CONSTRUCTION MANAGER PRIOR TO ROUGH-IN.

42. PROVIDE ELECTRICAL DROP FOR LED LIGHTING ASSOCIATED WITH FIXTURING. PROVIDE DUPLEX RECEPTACLE INSTALLED ON END OF CONDUIT DROP. RECEPTACLE SHALL BE INSTALLED AT TOP OF FIXTURE. HEIGHTS MAY VARY. COORDINATE EXACT LOCATION AND REQUIREMENTS WITH TSC PROJECT MANAGER AND FINAL FIXTURE PLAN. 43. POWER AND DATA TO FRONT COUNTER TO BE ROUTED IN SURFACE RACEWAY FROM REAR COUNTER. ALL POWER AND DATA TO SERVICE COUNTER AREA TO BE ROUTED IN TWO CHANNEL POWER POLE DESCRIBED IN NOTE #3.

44. RECEPTACLE FOR FLOOR SCRUBBER. PROVIDE LABEL ABOVE RECEPTACLE STATING "OUTLET FOR FLOOR SCRUBBER ONLY". IN RETROFIT STORES LOCATE 18"AFF AND 36" FROM SIDE OF MOP SINK ON SIDE MOST CLEAR OF OTHER ITEMS. COORDINATE LOCATION WITH FINAL FIXTURE PLAN PRIOR TO ROUGH-IN. RECEPTACLE TO BE SURFACE MOUNTED ON THE PLYWOOD.

45. PROVIDE POWER FOR SLIDING GATE AS REQUIRED. COORDINATE EXACT REQUIREMENTS WITH GATE VENDOR. THE REAR GATE IS TO BE CONTROLLED BY AN INDUCTIVE LOOP DETECTOR AND HAVE A POST MOUNTED KEYPAD FOR MANUAL OVERRIDE. PROVIDE CONTROL WIRING AS REQUIRED PER VENDOR RECOMMENDATIONS.

47. PROVIDE 3/4"C STUB FROM BUILDING INTO LIVE GOODS CENTER STRUCTURE BELOW EAVE FOR LOW VOLTAGE/SECURITY WIRING. ROUT CONDUITS OVERHEAD TO BOTTOM OF LIVE GOODS CENTER ROOF STRUCTURE W/ LIQUID-TIGHT NON-METALLIC CONDUIT, LESS THAN 6' LENGTH, TERMINATE W/ CLAMP AT UNDERSIDE OF STRUCTURE.

46. PROVIDE WP DUPLEX RECEPTACLE W/ WEATHER PROOF WHILE-IN-USE COVER IN CAST BOX MOUNTED TO SHADE STRUCTURE POST FOR MOBILE POS SYSTEM.

48. RECEPTACLE FOR CHAINSAW POG. VERIFY EXACT LOCATION AND MOUNTING HEIGHT WITH TSC CONSTRUCTION MANAGER AND FINAL FIXTURE PLAN. 49. QUADRAPLEX RECEPTACLE MOUNTED AT 9'-6" AFF ON TV MOUNTING BRACKET. RECEPTACLE TO BE INSTALLED ON THE INSIDE OF ONE OF THE STEEL BRACKETS,

CONTRACTOR SHALL RUN MC CABLE ON THE OUTSIDE OF THE STEEL SUSPENSION POLE AND SECURE TO THE POLE. LEAVE 16" OF SLACK MC CABLE COILED AT THE BAR JOIST FOR POSSIBLE FUTURE RELOCATION. COORDINATE EXACT LOCATION WITH FINAL FIXTURE PLAN AND TSC CONSTRUCTION MANAGER.


50. TWO POWER POLES MOUNTED BACK TO BACK. ONE FOR POWER WIRING AND ONE FOR LOW VOLTAGE WIRING. SECURE POWER POLES TO TOP OF COUNTER ON RIGHT CORNER BEHIND TSC COMPUTER. VERIFY EXACT LOCATION WITH TSC PROJECT MANAGER AND FINAL FIXTURE PLAN. 51. REFER TO ARCHITECTURAL ELEVATIONS OF STOREFRONT FOR EXACT PLACEMENT OF DEVICES ON FRONT WALL.

SYSTEM, SEALS SHALL BE RATED FOR CLASS 1, DIVISION 1 HAZARDOUS ENVIRONMENT.

52. PROVIDE BUCK-BOOST TRANSFORMER TO PROVIDE 240V AT PROPANE DISPENSER. BUCK-BOOST TRANSFORMER SHALL BE FEDERAL PACIFIC #K1XGF12-0.5 OR APPROVED EQUAL. MOUNT BUCK BOOST TRANSFORMER ADJACENT TO ELECTRICAL PANEL. 240V MUST BE PROVIDED AT THE PROPANE DISPENSER.

53. <u>BULK PROPANE VENDOR NOTE:</u> INSTALL CONDUIT SEALS FOR CLASS 1, DIVISION 2 HAZARDOUS ENVIRONMENT ON BOTH ENDS OF ANY CONDUIT THAT ROUTES BENEATH THE CLASS 1, DIVISION 2 BOUNDARY OF THE PROPANE DISPENSING SYSTEM WITHIN TEN FEET OF EMERGENCE OF CONDUIT FROM BELOW GRADE. CLASS 1, DIVISION 2 HAZARDOUS BOUNDARY EXTENDS FROM FIVE FEET OF DISPENSING SYSTEM TO 20 FEET OF DISPENSING SYSTEM. FOR CONDUITS ROUTING WITHIN FIVE FEET OF DISPENSING

.....

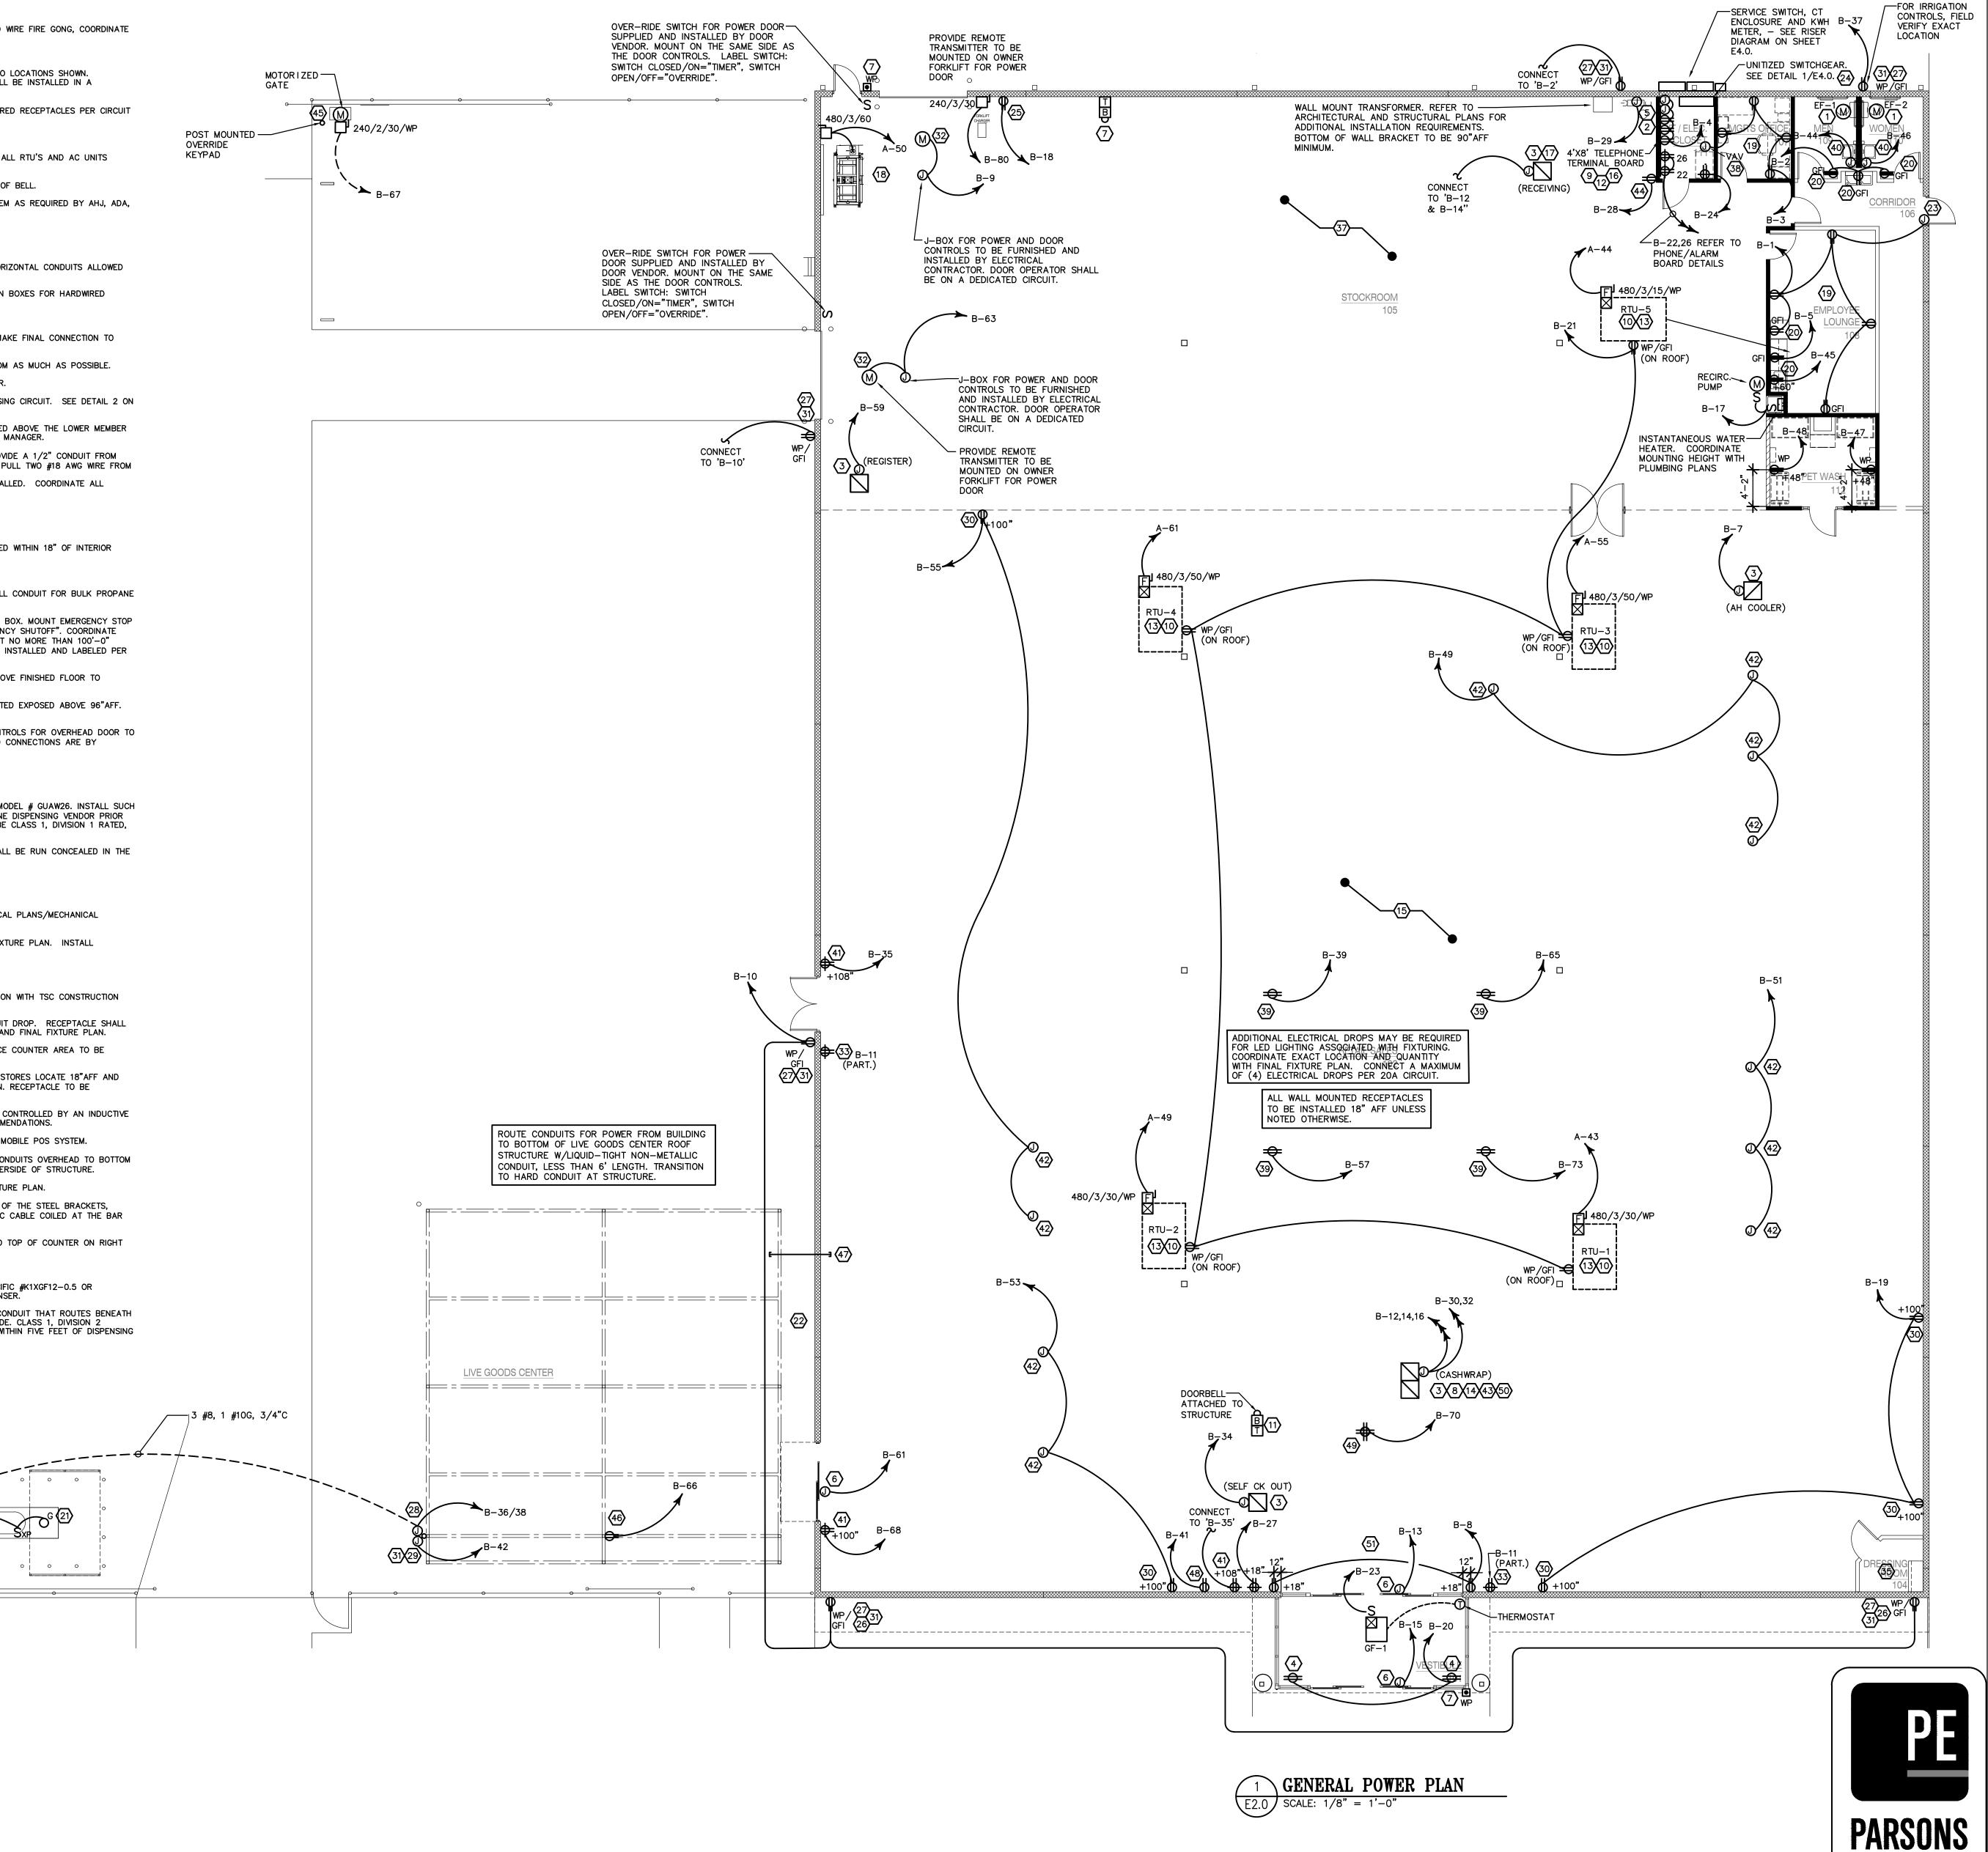



2934 Sidco Drive Architecture Suite 120 Nashville, TN 37204 Interior Architecture






TRACTOR SUPPLY COMPANY


This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

lob Number: 05.10.2024 Revisions:

GENERAL POWER PLAN

ENGINEERING, INC. NASHVILLE, TENNESSEE PARSONSENGINEERING.COM

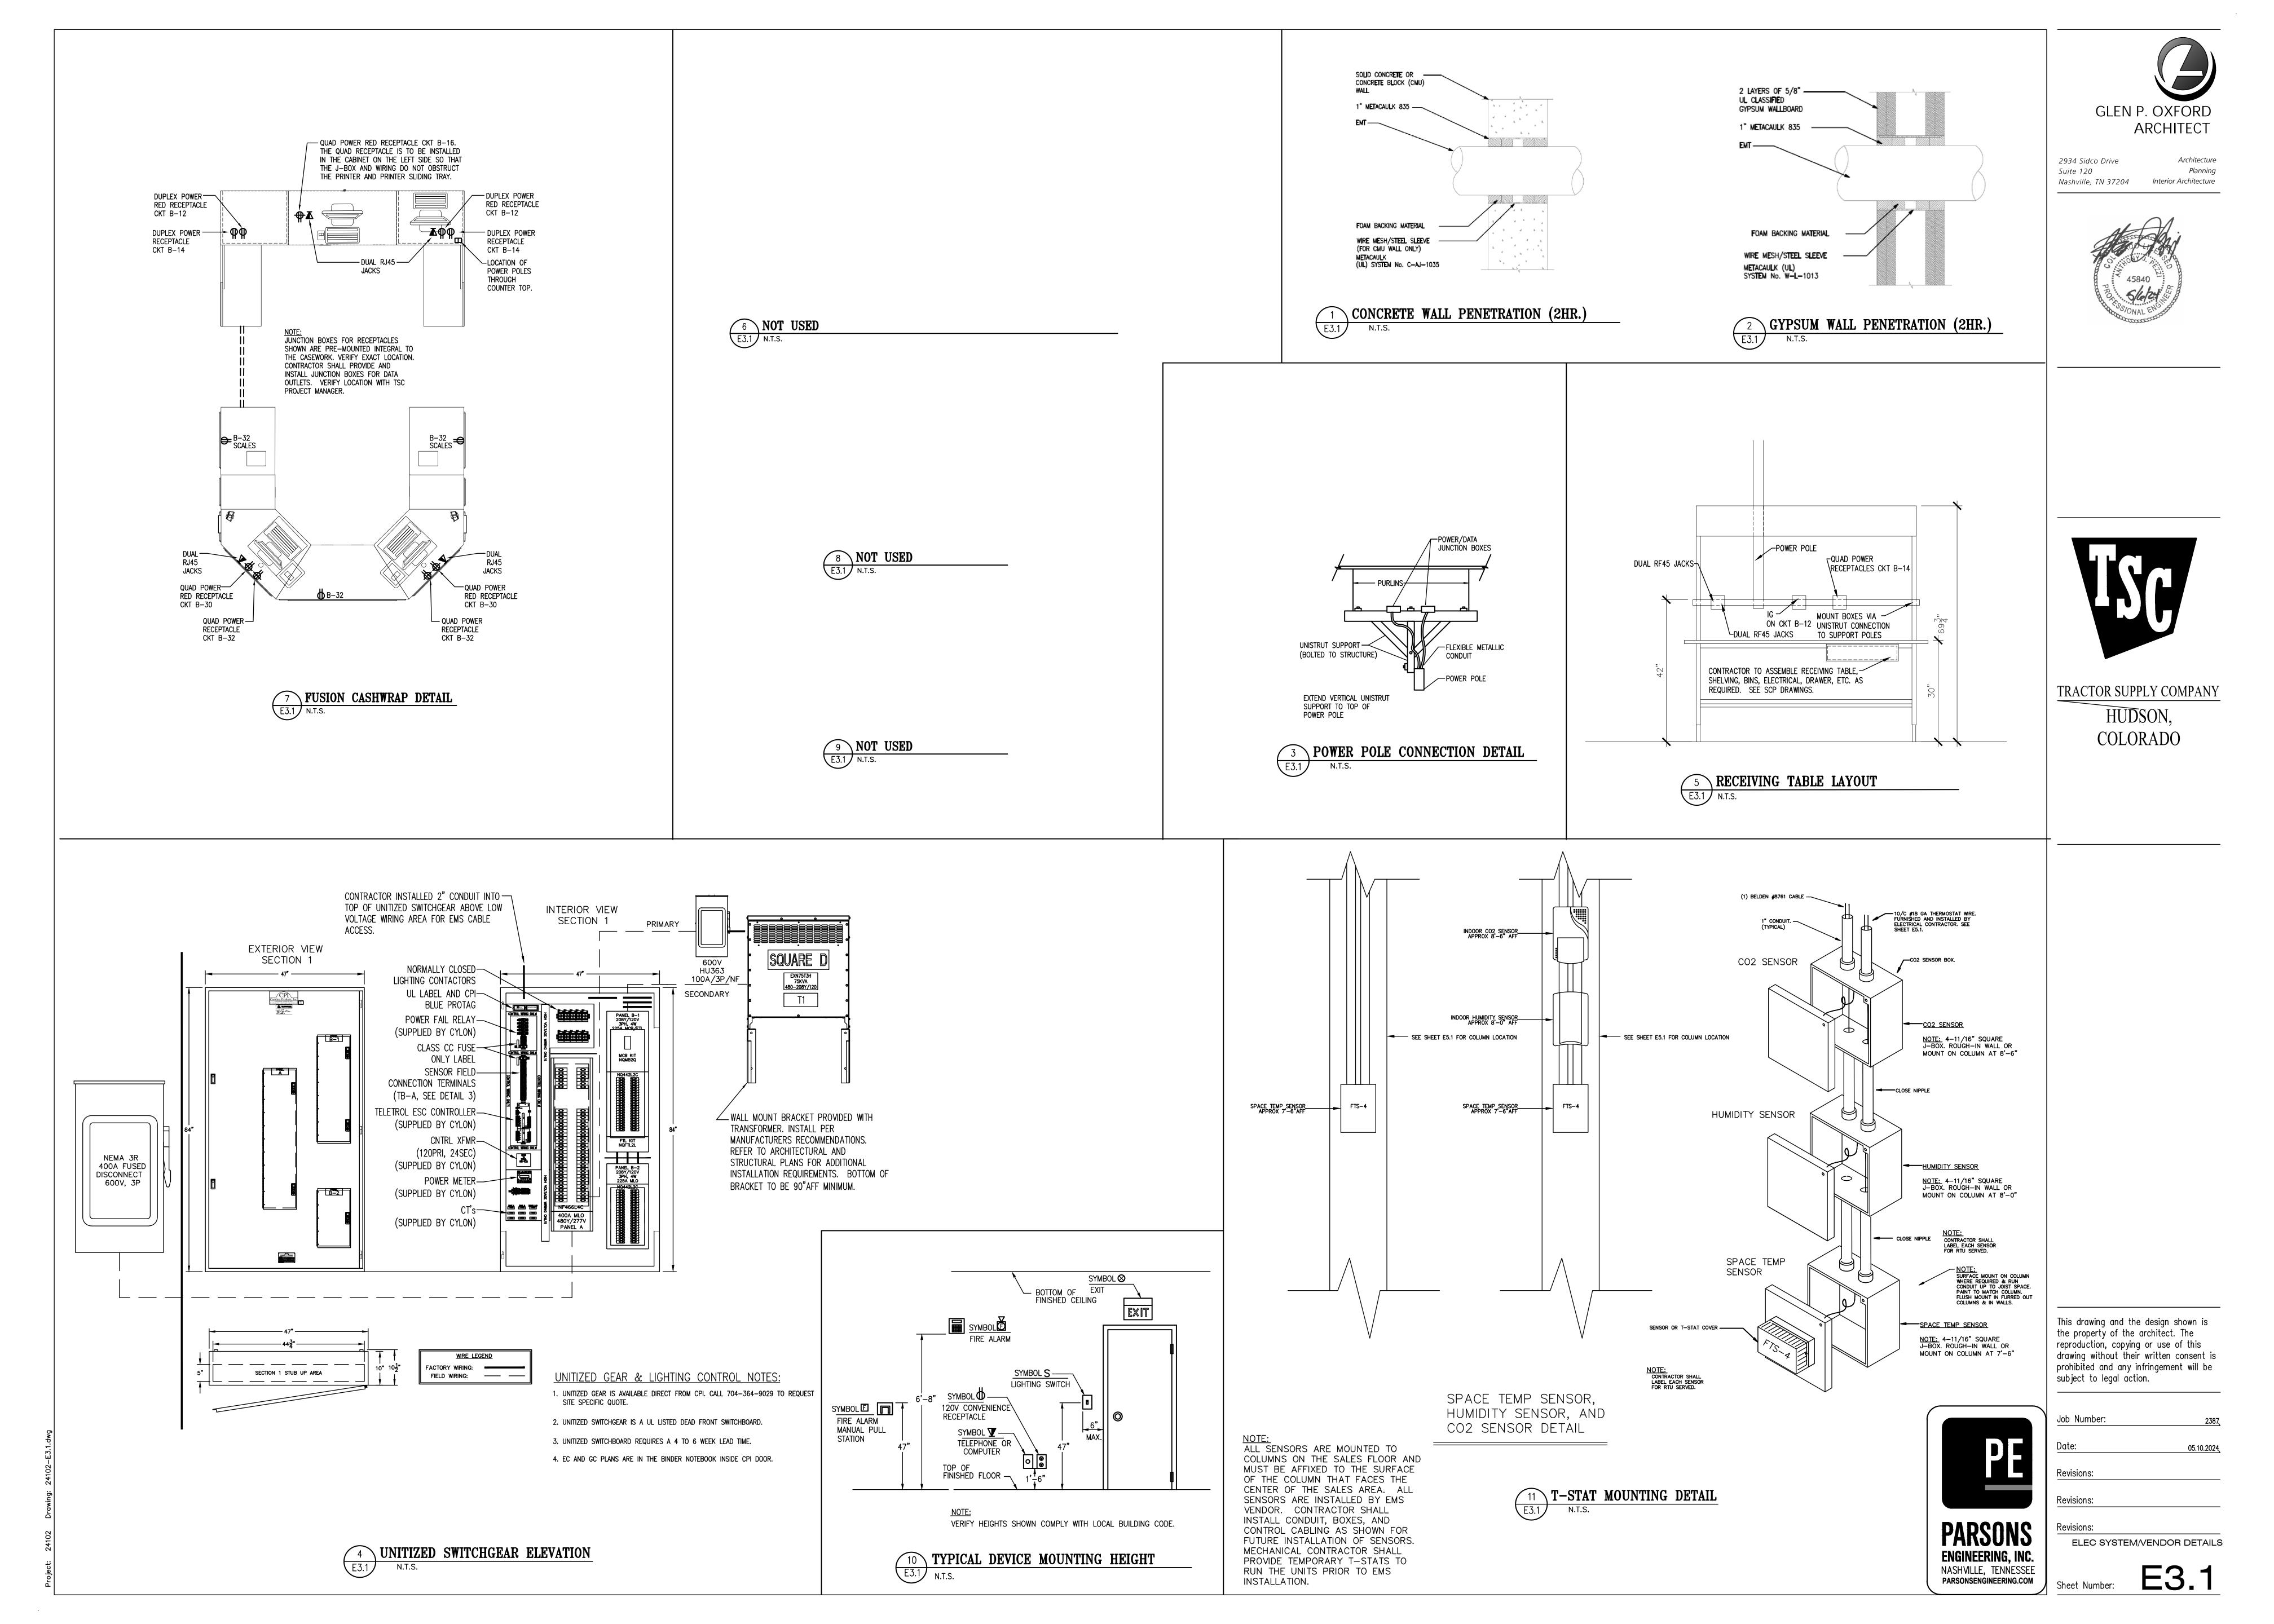

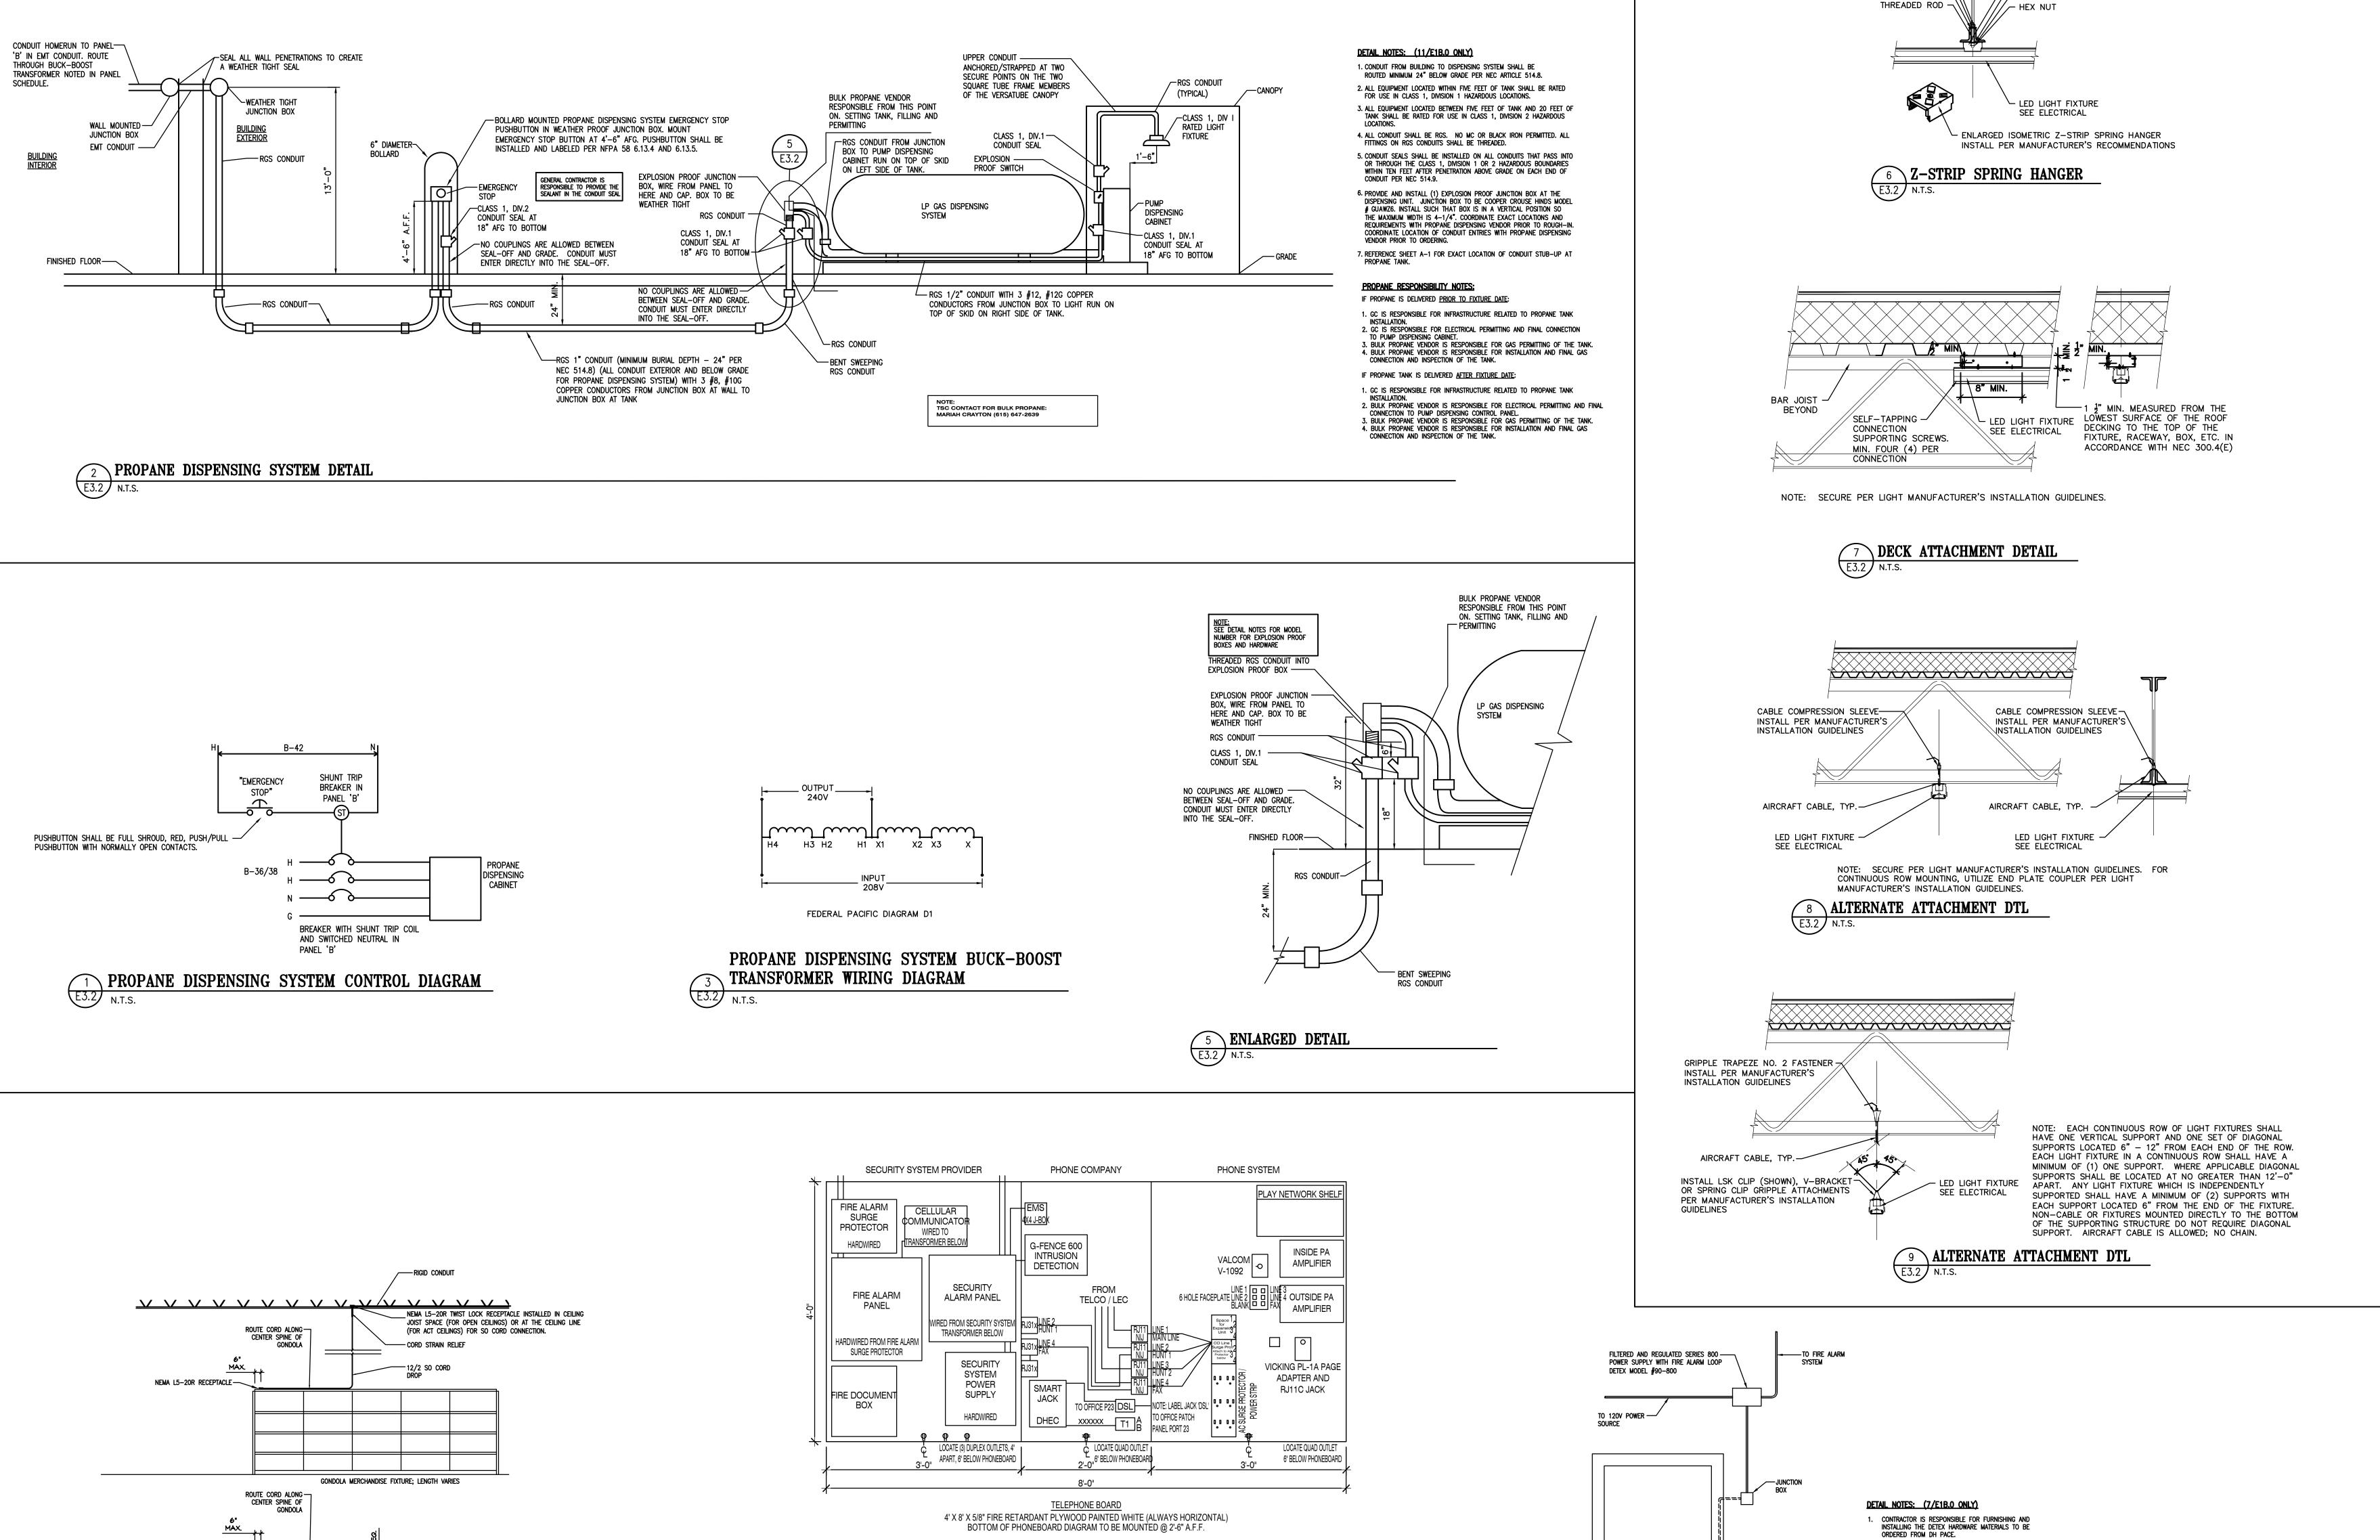

BOTTOM OF PHONEBOARD DIAGRAM TO BE MOUNTED @ 2'-6" A.F.F.

GENERAL CONTRACTOR TO ACQUIRE MOST CURRENT PHONE BOARD TEMPLATE FROM PLAN

EXPRESS TO ENSURE THE MOST UP TO DATE VERSION IS USED.

4' X 8' PHONE BOARD

11 TELEPHONE BOARD DETAIL

SEE SHEET A1.0 / A5.0 FOR

PROPER LOCATIONS

 \bigoplus

DELAYED EGRESS PANIC DEVICE -

DETEX MODEL #V40xEE

GONDOLA MERCHANDISE FIXTURE;

19"-84"

19"-84"

10 ELECTRICAL DROP DETAIL

E3.2 NO SCALE

PALLETS

ARCHITECT

2934 Sidco Drive Architecture Planning Suite 120 Nashville, TN 37204 Interior Architecture

HEX NUT -

2. CONTRACTOR IS RESPONSIBLE FOR INSTALLING THE V40xEE DELAYED EGRESS PANIC DEVICE.

3. CONTRACTOR IS RESPONSIBLE FOR INSTALLING THE

90-800 24VDC FILTERED POWER SUPPLY (24V

TRANSFORMER MOUNTED ABOVE CEILING LINE).

4. CONTRACTOR WIRES THE DELAYED EGRESS PANIC DEVICE THROUGH THE PT-5 POWER TRANSFER DEVICE MOUNTED ON THE JAMB LEG OF THE DOOR AND UP TO THE POWER SUPPLY TRANSFORMER.

5. FIRE ALARM VENDOR MAKES CONNECTION FROM THE FIRE LOOP CONTACTORS ON THE 90-800 POWER SUPPLY TO THE FIRE ALARM PANEL.

MODEL #PT-5

DETEX EXIT DEVICE DETAIL

NO SCALE

LOCK WASHER -\

FLAT WASHER -\

Z-STRIP SPRING HANGER

/_ FLAT WASHER

/_ LOCK WASHER



TRACTOR SUPPLY COMPANY

HUDSON,

COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

Job Number: Date: 05.10.2024 Revisions: Revisions:

Revisions: ELEC SYSTEM/VENDOR DETAILS

ENGINEERING, INC. NASHVILLE, TENNESSEE PARSONSENGINEERING.COM

PART 1 GENERAL 1.01 REFERENCE STANDARDS

- A. NFPA 70 NATIONAL ELECTRICAL CODE
- B. NFPA 101 LIFE SAFETY CODE
- C. ALL OTHER APPLICABLE STATE AND LOCAL CODES.
- 1.02 SUBMITTALS

A. SHOP DRAWINGS:

SUBMIT FOR APPROVAL, PRIOR TO INSTALLATION, SIX COPIES OF COMPLETE DESCRIPTIVE DATA ON ALL EQUIPMENT AND SYSTEMS AS REQUIRED BY OTHER SECTIONS OF THIS SPECIFICATION. CLEARLY INDICATE ALL PROPOSED SUBSTITUTIONS AND DEVIATIONS FROM DRAWINGS AND SPECIFICATIONS.

CHECK ALL SUBMITTALS FOR CLEARANCES AND COORDINATION WITH OTHER

SUBMITTALS SHALL BE CERTIFIED, BY THE CONTRACTOR'S APPROVAL STAMP, THAT ALL CONDITIONS HAVE BEEN CHECKED AND THAT NO CONFLICTS EXIST.

B. RECORD DRAWINGS

TO THE OWNER, RECORD DRAWINGS SHOWING FIELD CHANGES

1.03 COORDINATION

A. UTILITY COMPANIES

COORDINATE WITH UTILITY COMPANIES FOR SPECIFIC REQUIREMENTS FOR ELECTRICAL POWER AND TELEPHONE SERVICE.

2. INSTALL ELECTRICAL SERVICE IN ACCORDANCE WITH CURRENT UTILITY

COMPANY REQUIREMENTS. B. OTHER TRADES

COORDINATE WITH MECHANICAL DRAWINGS FOR POWER AND CONTROL REQUIREMENTS FOR THE SPECIFIC EQUIPMENT TO BE INSTALLED AND FOR EQUIPMENT SUCH AS STARTERS AND DISCONNECT SWITCHES THAT MAY BE FURNISHED WITH THE EQUIPMENT.

C. OWNER FURNISHED EQUIPMENT

COORDINATE WITH VENDOR'S OF OWNER FURNISHED EQUIPMENT FOR POWER REQUIREMENTS PRIOR TO ROUGH-IN. COORDINATION SHALL INCLUDE BUT NOT BE LIMITED TO OVERCURRENT PROTECTION TYPE AND SIZE, WIRE SIZE, NEMA CONFIGURATION OF ASSOCIATED RECEPTACLES, ETC.

1.04 WORK INCLUDED

THE WORK OF THIS SECTION INCLUDES FURNISHING OF LABOR AND MATERIALS AS REQUIRED FOR INSTALLATION OF A NEW ELECTRICAL DISTRIBUTION SYSTEM INCLUDING SERVICE, FEEDERS, PANELBOARDS, BRANCH CIRCUITS, LIGHTING, AND CONNECTIONS TO ALL EQUIPMENT REQUIRING ELECTRICAL POWER.

B. INSTALLATION OF CONDUIT FOR TELEPHONE AND DATA WIRING.

C. INSTALLATION OF SEISMIC RESTRAINT SYSTEMS FOR ELECTRICAL COMPONENTS IN SEISMIC REGIONS. 1.05 DRAWINGS

A. THE DRAWINGS ARE PARTLY DIAGRAMMATIC AND DO NOT SHOW IN DETAIL ALL REQUIRED FEATURES OF THE WORK NOR CONCEALED CONDITIONS. THEY SHALL BE SUPPLEMENTED BY THE CONTRACTOR'S KNOWLEDGE AND EXPERIENCE.

PART 2 PRODUCTS 2.01 GENERAL

A. ALL ELECTRICAL EQUIPMENT INSTALLED SHALL BEAR THE UL LABEL EXCEPT WHERE UL DOES NOT LABEL SUCH EQUIPMENT. 2.02 GUARANTEE

A. FURNISH A WRITTEN GUARANTEE THAT ALL EQUIPMENT FURNISHED AND INSTALLED WILL BE FREE OF DEFECTS OF MATERIAL AND WORKMANSHIP FOR A PERIOD OF 1 YEAR FROM DATE OF ACCEPTANCE OF THE WORK BY THE OWNER. PROMPTLY REPLACE AND REPAIR ALL DEFECTIVE EQUIPMENT AND ALL OTHER EQUIPMENT DAMAGED THEREBY AT NO ADDITIONAL COST TO THE OWNER.

EXECUTION 3.01 GENERAL

STANDARDS LISTED ABOVE.

A. VISIT PROJECT SITE BEFORE SUBMISSION OF BID AND BECOME FAMILIAR WITH EXISTING CONDITIONS AND LOCATIONS OF EXISTING UTILITIES. B. THE ENTIRE INSTALLATION SHALL BE MADE IN A NEAT MANNER BY PERSONS

SKILLED IN THE ELECTRICAL TRADE AND SHALL BE IN ACCORDANCE WITH THE REFERENCE

MAKE POWER CONNECTIONS TO AIR CONDITIONING EQUIPMENT AND OWNER FURNISHED EQUIPMENT. FURNISH AND INSTALL ALL ASSOCIATED RECEPTACLES AND DISCONNECT SWITCHES. FUSE SIZES FOR DISCONNECT SWITCHES SHALL BE AS RECOMMENDED BY THE EQUIPMENT MANUFACTURER.

D. FURNISH AND INSTALL CONDUIT AND WIRE FOR AIR CONDITIONING CONTROL EQUIPMENT. SEE MECHANICAL DRAWINGS FOR LOCATIONS AND REQUIREMENTS.

E. PROVIDE SEISMIC RESTRAINT SYSTEMS TO MEET TOTAL DESIGN LATERAL FORCE REQUIREMENTS FOR SUPPORT AND RESTRAINT OF PIPING, CONDUIT, CABLE TRAYS, LIGHTING FIXTURES AND OTHER SIMILAR SYSTEMS AND EQUIPMENT AS REQUIRED BY THE ENFORCED EDITION SECTION 16500 THE INTERNATIONAL BUILDING CODE, ASCE-7, AND LOCAL AUTHORITIES. RESTRAINT SELECTION AND INSTALLATION DETAILS SHALL BE APPROVED BY A LICENSED ENGINEER EXPERIENCED IN SEISMIC RESTRAINT DESIGN.

A. ALL SYSTEMS AND EQUIPMENT INSTALLED SHALL BE COMPLETELY TESTED AND SHALL BE LEFT IN GOOD WORKING ORDER.

BASIC ELECTRICAL MATERIALS AND METHODS

PART 1 GENERAL

NOT APPLICABLE

2.01 RACEWAYS A. RIGID STEEL CONDUIT

B. ELECTRICAL METALLIC TUBING

C. POLYVINYLCHLORIDE CONDUIT

2.02 WIRES AND CABLES

SERVICE AND FEEDERS: COPPER, 600 VOLT, TYPE THHN OR THWN INSULATION OR ALUMINUM CONDUCTOR, 600 VOLT, TYPE XHHW-2 INSULATION. SIZES INDICATED ON DRAWINGS ARE FOR COPPER. ALUMINUM CONDUCTORS SHALL BE SIZED TO HAVE AMPACITY EQUAL TO COPPER CONDUCTORS INDICATED ON DRAWINGS.

B. BRANCH CIRCUIT WIRES: COPPER CONDUCTOR, 600 VOLT, TYPE THHN OR THWN

BRANCH CIRCUIT CABLES: COPPER CONDUCTOR, 600 VOLT, TYPE MC WITH INSULATED EQUIPMENT GROUNDING CONDUCTOR.

D. CONTROL CIRCUIT CABLES: COPPER CONDUCTOR, NO.14 AWG, TYPE THHN, OR AS REQUIRED BY EQUIPMENT MANUFACTURER.

2.03 JUNCTION BOXES — PROVIDE STEEL BOXES FOR INTERIOR APPLICATIONS AND CAST TYPE BOXES FOR OUTDOOR APPLICATIONS. 2.04 WIRING DEVICES

A. WALL SWITCHES: AC GENERAL USE SNAP SWITCH WITH TOGGLE HANDLE, SPECIFICATION GRADE, 20 AMPERES, 120-277 VOLTS.

B. WALL DIMMER SWITCHES, APPROPRIATE FOR LED APPLICATIONS.

WALL OCCUPANCY SENSORS TO BE DUAL TECHNOLOGY (PASSIVE INFRARED AND ULTRASONIC). COMBINATION DIMMING TYPE WHERE INDICATED.

CEILING MOUNTED OCCUPANCY SENSORS, DUAL TECHNOLOGY (PASSIVE INFRARED AND ULTRASONIC) TYPE. CORRIDOR APPLICATION SENSORS TO BE PASSIVE INFARED TYPE. PROVIDE POWER PACKS AND/OR RELAYS AND ADDITIONAL SENSORS WHERE REQUIRED BY VENDOR.

E. RECEPTACLES: TYPE 5-15R. UNLESS INDICATED OTHERWISE. SPECIFICATION GRADE. DUPLEX RECEPTACLES ON DEDICATED CIRCUITS SHALL BE NEMA TYPE 5-20R. STED TAMPER RESISTANT RECEPTACLES SHALL BE PROVIDED IN THOSE AREAS DESIGNATED PER NEC 406.12. OUTDOOR RECEPTACLES SHALL BE WEATHER RESISTANT. DEVICE COLOR TO BE SELECTED BY ARCHITECT

F. COVERPLATES

1. INDOOR: NYLON, COLOR TO BE SELECTED BY ARCHITECT.

2. OUTDOOR & INDOOR WET LOCATIONS: PAINTED, CAST ALUMINUM, EXTRA DUTY RATED, WEATHERPROOF WHILE IN USE TYPE. 2.05 IDENTIFICATION

A. PROVIDE LAMINATED PLASTIC TAGS FOR ALL PANELBOARDS AND DISCONNECT SWITCHES. TAGS SHALL COMPLETELY IDENTIFY EQUIPMENT MARKED OR CONTROLLED.

PART 3 EXECUTION

3.01 RACEWAYS

A. ALL RACEWAYS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' B. PERMITTED USAGE

1. ALL INTERIOR RACEWAYS SHALL BE GALVANIZED ELECTRICAL METALLIC

RACEWAYS UNDERGROUND, EXPOSED TO EXTERIOR, OR CAST IN CONCRETE SHALL BE GALVANIZED RIGID STEEL CONDUIT (RGS) OR SCHEDULE 40 PVC.

IN LONG RACEWAYS FURNISH AND INSTALL THE PROPER NUMBER AND SIZE PULL BOXES TO FACILITATE INSTALLATION OF CONDUCTORS.

INSTALL SEPARATE GROUNDING CONDUCTOR IN EACH RACEWAY 3. PROVIDE RIGID GALVANIZED STEEL ELBOWS AND VERTICAL SECTIONS FOR RUNS OF PVC CONDUIT ENTERING GROUND OR FLOOR IN UNPROTECTED LOCATIONS.

3.02 WIRES AND CABLES CONDUCTORS SHOWN ON DRAWINGS AS SIZED FOR COPPER UNLESS NOTED OTHERWISE. WHEN USING ALUMINUM, SIZE FOR EQUAL OR GREATER AMPACITY,

AND RESIZE CONDUIT AS REQUIRED B. ALL POWER WIRING SHALL BE INSTALLED IN CONDUIT EXCEPT AS PERMITTED

C. BRANCH CIRCUITS RUN CONCEALED IN WALLS OR CEILINGS AND RATED AT 20

AMPS MAY BE TYPE MC CABLE LOW VOLTAGE CONTROL AND SIGNAL CABLE MAY BE RUN OPEN WHEN CONCEALED ABOVE ACCESSIBLE CEILINGS. CABLES AND CABLE SUPPORTS INSTALLED IN AIR PLENUMS MUST BE PLENUM RATED. OPEN WIRING SHALL BE SUPPORTED FROM STRUCTURE.

SERVICE AND DISTRIBUTION SECTION 16400

GENERAL

1.01 SUBMITTALS

INSTALLATION:

A. UNITIZED SWITCHGEAR B. DISCONNECT SWITCHES

C. TRANSFORMERS

D. FUSES PART 2 PRODUCTS

2.01 UNITIZED SWITCHGEAR

A. UNITIZED SWITCHGEAR SHALL CONTAIN BREAKERS AS DESCRIBED ON THE PANEL SCHEDULES. UNITIZED SWITCHGEAR SHALL BE RATED FOR THE SHORT CIRCUIT INTERRUPTING CAPACITY INDICATED AND SERIES COMBINATION RATINGS MUST BE UL RECOGNIZED. UNITIZED SWITCHGEAR SHALL BE PURCHASED FROM NATIONAL ACCOUNT VENDOR LISTED ON THE PLANS.

2.02 DISCONNECT SWITCHES

FUSIBLE OR NONFUSIBLE QUICK-MAKE, QUICK-BREAK, LOAD INTERRUPTER ENCLOSED KNIFE SWITCH WITH EXTERNALLY OPERABLE HANDLE INTERLOCKED TO PREVENT OPENING FRONT COVER WITH SWITCH IN "ON" POSITION. APPROVED MANUFACTURERS ARE CUTLER-HAMMER, GENERAL ELECTRIC, SIEMENS, AND SQUARE D.

2.03 TRANSFORMERS(DOE EFFICIENT DRY-TYPE) AIR COOLED, 480 VOLT DELTA PRIMARY, 208/120 VOLT WYE SECONDARY, KVA

SIZE AS INDICATED, 150 DEGREES C RISE, WITH TWO 2-1/2% TAPS ABOVE NORMAL VOLTAGE AND TWO 2-1/2% TAPS BELOW NORMAL VOLTAGE. ACCEPTABLE MANUFACTURERS ARE EATON-CUTLER HAMMER, ABB-GENERAL ELECTRIC, SIEMENS, AND SQUARE D. 2.04 FUSES

A. FUSES RATED ABOVE 600 AMPS SHALL BE UL CLASS L EQUAL TO BUSSMAN LOW-PEAK KRP-C. FUSES RATED AT 600 AMPS AND BELOW SHALL BE UL CLASS RK1 EQUAL TO BUSSMAN LOW-PEAK LPN-RK (250 VOLT) OR LPS-RK (600 VOLT)

EXECUTION

3.01 GENERAL

A. MAINTAIN CODE REQUIRED WORKING CLEARANCES AROUND ALL ELECTRICAL EQUIPMENT. COORDINATE INSTALLATION WITH ARCHITECTURAL FEATURES, PIPING LOCATIONS, AND DUCTWORK.

ELECTRICAL EQUIPMENT SUCH AS SWITCHBOARDS, PANELBOARDS, DISCONNECT ENCLOSED CIRCUIT BREAKERS, INDUSTRIAL CONTROL PANELS, METER SOCKET ENCLOSURES AND MOTOR CONTROL CENTERS, THAT ARE LIKELY TO REQUIRE EXAMINATION, ADJUSTMENT SERVICING, OR MAINTENANCE WHILE ENERGIZED SHALL BE FIELD MARKED TO WARN QUALIFIED PERSONS OF POTENTIAL ELECTRIC ARC HAZARDS PER NEC 110.16. THE MARKING SHALL BE LOCATED AS TO BE CLEARLY VISIBLE TO QUALIFIED PERSONS BEFORE EXAMINATION, ADJUSTMENT, SERVICING, OR MAINTENANCE OF THE EQUIPMENT

3.02 UNITIZED SWITHCGEAR/PANELBOARDS A. INSTALL NEW UNITIZED SWITCHGEAR/PANELBOARDS AS INDICATED.

ALL PANELS SHALL HAVE ENGRAVED PLASTIC LABELS AND TYPEWRITTEN DIRECTORIES. DIRECTORIES SHALL DESCRIBE LOAD FOR EACH BRANCH CIRCUIT

3.03 TRANSFORMERS A. MOUNT TRANSFORMERS ON VIBRATION ISOLATORS. GROUND NEUTRAL OF SECONDARY SIDE TO COLD WATER PIPE AND BUILDING STEEL

WHERE TRANSFORMERS ARE SHOWN MOUNTED ABOVE FLOOR, PROVIDE STRUCTURAL SUPPORTS AS REQUIRED. VERIFY CAPACITY OF WALL OR STRUCTURE TO SUPPORT SUSPENDED TRANSFORMERS.

C. PROVIDE MINIMUM 6" SPACE BEHIND AND BESIDE TRANSFORMER FOR AIR CIRCULATION/VENTILATION.

LIGHTING

END OF ELECTRICAL SPECIFICATIONS

1.01 SUBMITTALS

A. LIGHTING FIXTURES

2.01 GENERAL

PROVIDE LIGHTING FIXTURES AS SPECIFIED ON LIGHTING FIXTURE SCHEDULE OF SIZES, TYPES, RATINGS, AND WITH FEATURES INDICATED. FIXTURES SHALL BE PURCHASED FROM NATIONAL ACCOUNT VENDOR LISTED ON LIGHTING FIXTURES SCHEDULE. SUBSTITUTIONS ARE NOT ALLOWED.

B. FIXTURES SHALL BE COMPLETE WITH LAMPS, BALLASTS, DRIVERS, AND ALL PARTS, HARDWARE, AND ACCESSORIES FOR INSTALLATION AND PROPER OPERATION. 2.02 EMERGENCY LIGHTING BATTERY UNITS

A. MINIMUM 1500 LUMENS FOR 90 MINUTES WHETHER INTEGRAL OR REMOTE. PART 3 EXECUTION

A. INSTALL FIXTURES AS INDICATED ON DRAWINGS. REFER TO REFLECTED CEILING PLAN FOR EXACT LOCATIONS.

ELECTRICAL LEGEND

MOUNTING HEIGHTS MEASURED TO Ø

CONDUIT RUN CONCEALED IN WALL, CEILING, OR FLOOR

CONDUIT RUN, CONCEALED IN FLOOR OR UNDERGROUND HOMERUN TO PANEL INDICATED

RECEPTACLE, DUPLEX, 120V, 15A. UNO, @ 18" AFF TO BOTTOM

RECEPTACLE, DUPLEX, 120V, 15A. UNO, SMH RECEPTACLE, QUADRAPLEX, 120V, 15A. UNO, @ 18" AFF TO BOTTOM

RECEPTACLE, QUADRAPLEX, 120V, 15A. UNO, SMH

RECEPTACLE, SINGLE, 250V, AMPS AS NOTED, @ 8" AFF TO BOTTOM


RECEPTACLE, DUPLEX, 120V, 15A. UNO, CEILING MOUNTED

JUNCTION BOX, SIZE AS REQUIRED SWITCH, SINGLE POLE, 120/277V, 20A, 48" AFF TO BOTTOM

 S_3 SWITCH, THREE WAY, 120/277V, 20A, 45" AFF TO BOTTOM MOTION SENSOR SWITCH

PHONE/DATA OUTLET, 4x4 BOX W/1"C TO ABOVE CL'G - SMH

₩ PHONE/DATA OUTLET, 4x4 BOX W/1"C TO ABOVE CL'G - @ 52" AFF TO BOTTOM PHONE/DATA OUTLET, 4x4 BOX W/1"C TO ABOVE CL'G — @ 15" AFF TO BOTTOM

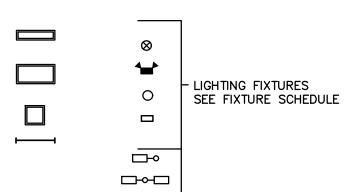

DISCONNECT SWITCH, NON-FUSED, DESCRIBED BY: VOLTAGE RATING/NO. OF POLES/SWITCH SIZE IN AMPS

DISCONNECT SWITCH, FUSED, DESCRIBED BY: VOLTAGE RATING/NO. OF POLES/FUSE SIZE IN AMPS SM SWITCH, MOTOR STARTING, MANUAL, SIZE AS REQUIRED

MOTOR STARTER, MAGNETIC, SIZE AS REQUIRED MOTOR, SEE PANEL SCHEDULE FOR SIZE AND SERVICE

ABBREVIATIONS:

AFF ABOVE FINISHED FLOOR AFG ABOVE FINISHED GRADE

BRKR BREAKER **©** CENTERLINE

CL'G CEILING

EF EXHAUST FAN GFI GROUND FAULT INTERRUPTER


MTD MOUNTED

RTU ROOF TOP UNIT SMH SPECIAL MOUNTING HEIGHT

(4" ¢ ABOVE CASEWORK/BACKSPLASH OR 45" ¢ AFF IF NO CASEWORK/BACKSPLASH) UNO UNLESS NOTED OTHERWISE

WH WATER HEATER WP WEATHERPROOF

SERVICE COUNTER

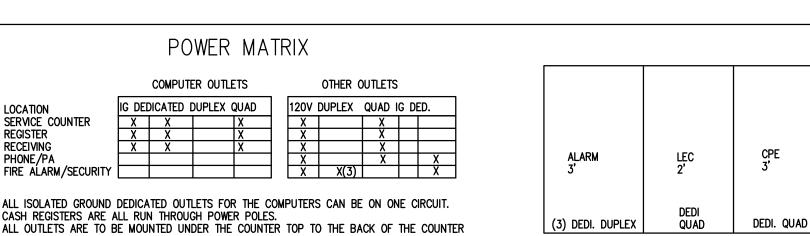

GENERAL ELECTRICAL NOTES

EXISTING CONDITION AND LOCATIONS OF UTILITIES.

TERMINAL TO ELECTRICAL SERVICE GROUNDING ELECTRODE

COMPANY REQUIREMENTS

TELEPHONE TERMINAL BOARD.

DISCONNECT SWITCHES, AND STARTERS.

WITH DISCONNECTING MEANS.

SHALL BE UNSWITCHED.

AND CEILING RATINGS.

PANEL SCHEDULE NOTES

GFI CIRCUIT BREAKER

PROVIDE HANDLE TIE - POLES IN ()

COMPRESSORS INTO THIS CIRCUIT.

VIA RELAYS IN UNITIZED SWITCHGEAR

EQUAL. MOUNT ADJACENT TO PANËL.

BREAKER WITH SHUNT TRIP

PROVIDE RED RECEPTACLE FOR OUTLETS ON THIS

PROVIDE LOCK-ON/OFF DEVICE FOR CIRCUIT

LZ-X CIRCUIT TO BE CONTROLLED BY LIGHTING CONTROLS

PROVIDE BUCK-BOOST TRANSFORMER FOR 240V

OPERATION. FEDERAL PACIFIC #K1XGF16-0.5 OR

CIRCUIT TO IDENTIFY CIRCUITS FOR COMPUTER LOADS ONLY. DO NOT PLUG REFRIGERATORS OR

CIRCUIT OVERCURRENT DEVICE

1. VISIT PROJECT SITE BEFORE SUBMISSION OF BID AND BECOME FAMILIAR WITH

2. COORDINATE INSTALLATION OF NEW SERVICE WITH LOCAL ELECTRIC UTILITY

ITEMS AS REQUIRED. INSTALL SERVICE IN ACCORDANCE WITH CURRENT UTILITY

4. FURNISH AND INSTALL A 4'X 8'X 3/4" PLYWOOD TELEPHONE TERMINAL

NEAREST ACCESSIBLE CEILING WITH AN INSULATED BUSHING ON EACH END.

SUPPLIED WITH CONTROL POWER TRANSFORMERS. INSTALL AND CONNECT ALL

REQUIREMENTS FOR MECHANICAL EQUIPMENT AND FOR STARTERS, DISCONNECT

VERIFY ELECTRICAL POWER REQUIREMENTS FOR ALL EQUIPMENT. PROVIDE

CONTROL DEVICES IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS

BOARD, PAINTED WHITE. FURNISH AND INSTALL GROUNDING TERMINAL STRIP ON

BACKBOARD (SQUARE D #PK18GTA OR EQUIVALENT). FURNISH AND INSTALL 1 #6

5. INSTALL 1" CONDUIT FROM EACH TELEPHONE AND/OR DATA OUTLET TO ABOVE

6. PROVIDE CONTROL POWER SOURCE FOR ALL STARTERS AND CONTROL PANELS NOT

CIRCUITS AND FUSES SIZED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.

COPPER GROUNDING CONDUCTOR IN 1/2" CONDUIT FROM BACKBOARD GROUNDING

COMPANY. PROVIDE TRENCHING, CONDUIT, METER BASE, CONCRETE PAD, AND OTHER

S. COORDINATE INSTALLATION OF TELEPHONE SERVICE CONDUIT WITH LOCAL ELEPHONE COMPANY. INSTALL (2) 2" CONDUITS FROM TELEPHONE SERVICE POINT TO

ALL OUTLETS ARE TO BE MOUNTED UNDER THE COUNTER TOP TO THE BACK OF THE COUNTER PHONE BOARD SHALL BE A 4'X8' AREA LAID OUT ON THE PLYWOOD WALL OR ON A PIECE OF PLYWOOD. OUTLETS CAN BE SURFACED MOUNTED. BUT CONDUIT MUST BE RUN DOWN THE EDGES OF EACH SECTION. THE 120V DUPLEX IS A CONVENIENCE OUTLET RUN FROM ANY NON—DEDICATED CIRCUIT. EACH OUTLET IS TO BE CLEARLY LABELI "DEDICATED CPE", "DEDICATED TSC ALARMS" OR "CONVENIENCE OUTLET". ALL OUTLETS

COMPUTER OUTLETS

G DEDICATED DUPLEX QUAD

CASH REGISTERS ARE ALL RUN THROUGH POWER POLES.

THAT ARE MOUNTED WITHIN 6 FEET OF SINK SHALL BE GFI PROVIDE (3) DUPLEX RECEPTACLES AT THE ALARM/SECURITY SECTION OF THE PHONE BOARD. MOUNT 4" APART MINIMUM, 6" BELOW THE PHONE BOARD FOR CORD AND PLUG CONNECTIONS TO THE VENDOR SUPPLIED SECURITY SYSTEM EQUIPMENT. ALL THREE RECEPTACLES SHALL BE POWERED FROM ONE 120 VOLT DEDICATED CIRCUIT. PROVIDE TWO SURFACE MOUNTED JUNCTION BOXES adjacent to the dedicated duplex receptacles for hardwired power connections to the FIRE ALARM EQUIPMENT PANEL, DUCT MONITOR AND THE TWO FIRE ALARM SYSTEM POWER SUPPLIES CONTRACTOR SHALL WIRE FROM THE JUNCTION BOXES WITH TYPE MC CABLE. CONNECT TWO DEVICES

CONTROLLER VIA CONTACTORS.

THE SALES FLOOR COLUMNS.

. FURNISH AND INSTALL 4' X 8' X 3/4 " PLYWOOD TELEPHONE EQUIPMENT BACKBOARD. PAINTED WHITE. FURNISH AND INSTALL GROUNDING TERMINAL STRIP ON BACKBOARD (SQUARE D #PK18GTA OR EQUIVALENT). FURNISH AND INSTALL 1 #6 COPPER GROUNDING CONDUCTOR IN 1/2 " FROM BACKBOARD GROUNDING TERMINAL TO ELECTRIC SERVICE GROUNDING

2. FURNISH AND INSTALL GROUNDING ELECTRODE AND GROUNDING ELECTRODE CONDUCTOR FOR SERVICE ENTRANCE PANELBOARD. CONNECTIONS AND BONDING JUMPERS SHALL BE INSTALLED IN ACCORDANCE WITH NEC ART. 250. REFER TO DETAIL 2/E4.0 ON THIS SHEET

3. FURNISH AND INSTALL TWO 2" SCHEDULE 40 PVC CONDUITS FOR TELECOMMUNICATIONS SERVICE ENTRY RACEWAYS. RACEWAYS SHALL EXTEND FROM TELEPHONE EQUIPMENT BACKBOARD LOCATION TO SERVICE PROVIDER'S SPECIFIED POINT-OF-SERVICE. COORDINATE WITH LOCAL TELECOMMUNICATIONS SERVICE PROVIDER.

4. LIGHTING CIRCUITS SHALL BE CONTROLLED AS INDICATED IN PANEL

MECHANICAL CONTRACTOR. THERMOSTATS TO BE LOCATED ON

SCHEDULES (DENOTED LZ-1A&B, LZ-2, ETC.) BY LIGHTING

5. COORDINATE CONNECTIONS TO THERMOSTATS WITH

OTHER ITEMS AS REQUIRED. INSTALL SERVICE IN ACCORDANCE WITH CURRENT UTILITY COMPANY REQUIREMENTS. 7. CONTACTORS FOR CONTROL OF SALES FLOOR GENERAL LIGHTING. 8. NOTE NOT USED. 9. 2 SETS EACH WITH [4-#250KCMIL, #1G, 3-1/2"C] ALUMINUM TO SERVICE DISCONNECT

10. 3#2, #6G; 1-1/4°C COPPER TO TRANSFORMER.

11. 4#4/0, #4G; 2-1/2"C COPPER TO PANEL B FROM TRANSFORMER. ROUTE CONDUIT ABOVE IT ROOM AND NOT DOWN EXTERIOR WALL ADJACENT TO IT ROOM. 13. SERVICE EQUIPMENT SHALL BE LEGIBLY MARKED IN THE FIELD WITH MAXIMUM AVAILABLE FAULT

CURRENT. CONTRACTOR SHALL REQUEST THE MAXIMUM AVAILABLE FAULT CURRENT AT THE TRANSFORMER AND PROVIDE THIS INFORMATION ALONG WITH THE DISTANCE OF THE SECONDARY CONDUCTORS TO THE ELECTRICAL ENGINEER. THE ELECTRICAL ENGINEER WILL CALCULATE THE MAXIMUM AVAILABLE FAULT CURRENT AT THE SERVICE EQUIPMENT AND GIVE RESULTS TO CONTRACTOR FOR MARKING.

6. COORDINATE INSTALLATION OF NEW UNDERGROUND SERVICE WITH LOCAL ELECTRIC UTILITY COMPANY.

PROVIDE TRENCHING, CONDUIT, CONDUCTORS, METER BASE, CT ENCLOSURE, CONCRETE PAD, AND

14. SERVICE ENTRANCE: 2 SETS EACH WITH [4-#250KCMIL, 3-1/2"C] ALUMINUM TO UTILITY TRANSFORMER. 15. SERVICE DISCONNECT, 480V, 3 POLE, FUSED @400A, S.E. RATED, NEMA 3R, 100K AIC.

16. DISCONNECT, 480V, 3 POLE, NON-FUSED, 100A. 17. WALL MOUNT 10'-0" AFF PER DETAIL 4 ON E3.1 UNLESS REQUIRED TO BE FLOOR MOUNTED BY THE AHJ.

TRANSFORMER T-1-480-208Y/120V,3ø,4W - PUBLIC UTILITY APPROVED CT POWER DISTRIBUTION CENTER — ALARM/ | TELEPHONE | FNCLOSURE AND KWH METER WITH RIGHT SIDE HINGES FOR QUIPMENT AS REQUIRED BY UTILITY SECURITY ACCESS DOOR BOARD COMPANY 1 PANEL REFER TO SITE PLAN FOR -- TELEPHONE APPROXIMATE DISTANCE **ENTRANCE**


> THE CONTRACTOR SHALL COORDINATE THE SYSTEM VOLTAGE AND ALL ASSOCIATED COSTS TO BRING SERVICE AS INDICATED TO BUILDING. CONTRACTOR SHALL INCLUDE

TRACTOR SUPPLY LIGHTING & HEATING SCHEDULE

PYLON/BUILDING SIGN BUILDING LIGHTS BUSINESS EMPLOYEE HEATING LIGHTS LIGHTS T: 30 AM | 68 DEGREES 74 DEGREES SAME TEMPS PHOTOCELL (ALWAYS NT 8:00 AM|AT 8:00 AM|AT 10:00 AM 8:30 PM | 8:30 PM | 62 DEGREES | 80 DEGREES | SAME TEMP AT 9:00 PM AT 9:00 PM AT 6:00 PM CONTROL ZONE THE SYSTEM CAN BE OVERRIDDEN BY THE OVERRIDE SWITCH IN CASE THE STORE IS OPEN EARLIER CONTROL ZONE OR LATER THAN NORMAL STORE HOURS.


LZ-X DENOTES LIGHTING CONTROL ZONE VIA CONTACTOR IN THE UNITIZED SWITCHGEAR. GC REPONSIBLE FOR PROGRAMMING ALL THERMOSTATS AND LIGHTING CONTROLS. LIGHTSTAT TME THERMOSTAT MODEL TME-DGC. SEE MECHANICAL PLANS FOR MORE INFORMATION.


> BIDDING MECHANICAL AND ELECTRICAL CONTRACTORS SHALL COORDINATE WITH GC PRIOR TO BID ON ALL WORK AS IT RELATES TO THE PROGRAMMING OF NON-EMS THERMOSTATS AND LIGHT TIMERS.

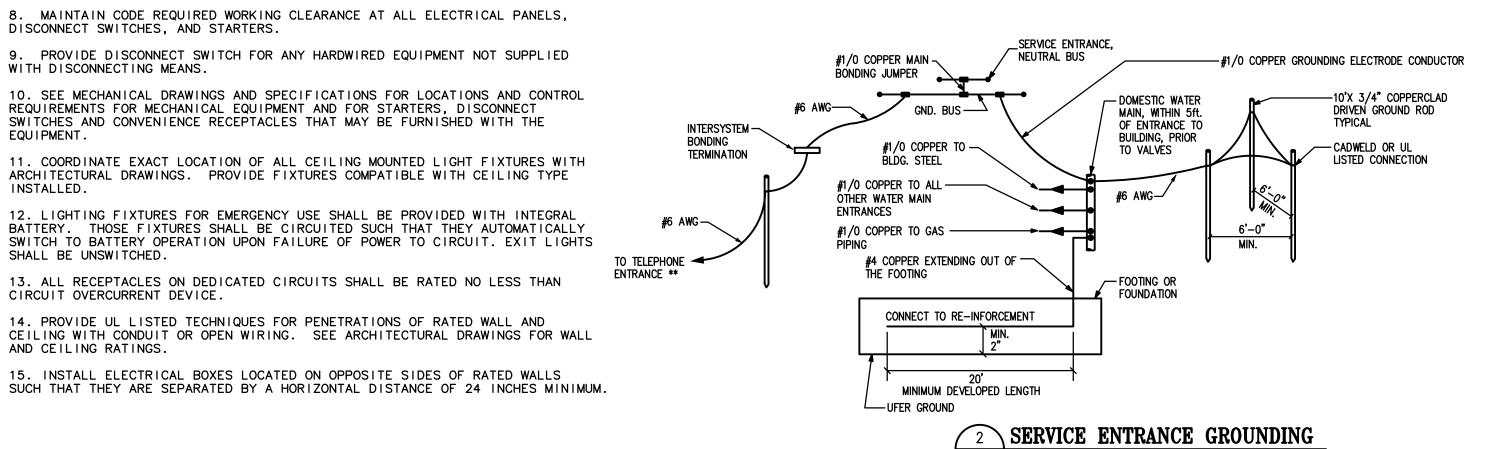


NOTE: ALL GROUNDING ELECTRODE CONDUCTORS SHALL BE SIZED IN ACCORDANCE WITH NEC 250.66. ALL METAL CONDUIT SHALL BE BONDED TO TERMINATING BOXES.

> ** SEPERATE GROUND ROD REQUIRED ONLY II TELEPHONE SERVICE BOARD IS GREATER THAN 20 FEET FROM ELECTRICAL SERVICE

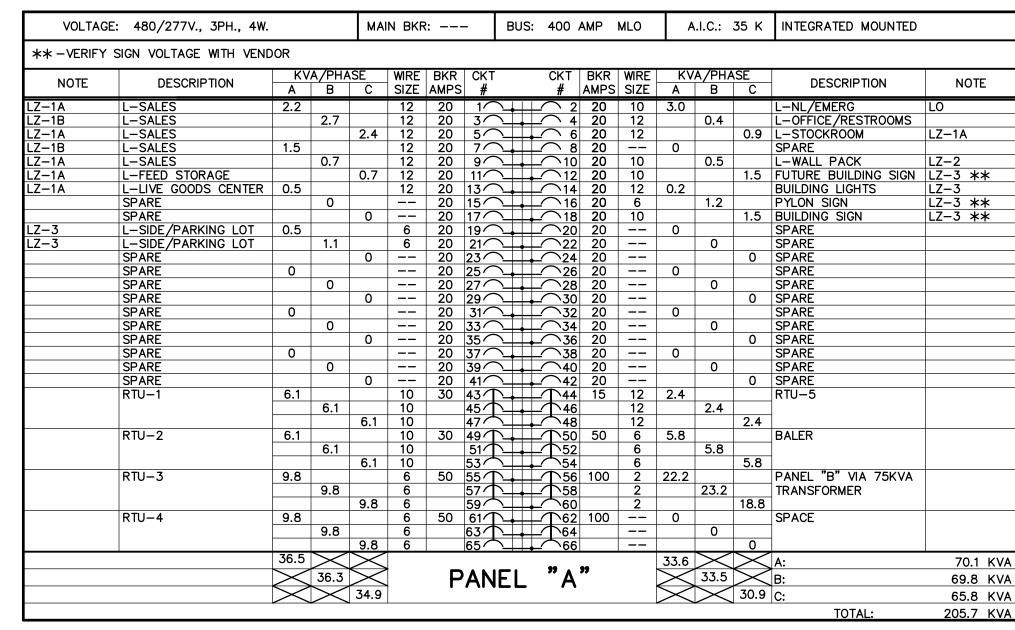

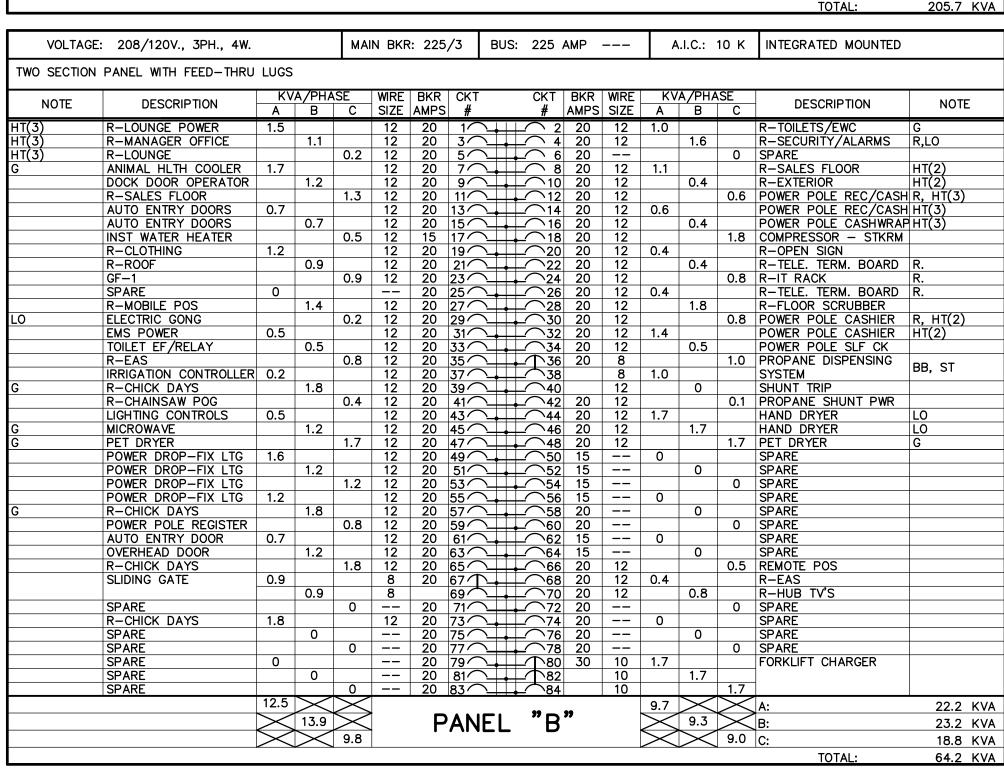

ELECTRICAL CONTRACTOR TO INSTALL AND WIRE FIRE GONG, COORDINATE WITH FIRE SUPPRESSION CONTRACTOR FOR VOLTAGE. PROVIDE LOW VOLTAGE TRANSFORMER AS REQUIRED.

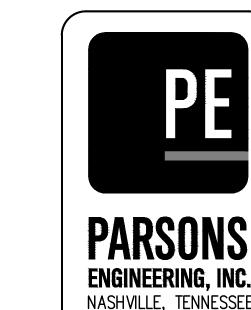

PARSONSENGINEERING.COM



2934 Sidco Drive Architecture Planning Suite 120 Interior Architecture Nashville, TN 37204



TRACTOR SUPPLY COMPANY

HUDSON.


This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

ob Number: 05.10.2024 Revisions: Revisions:

Revisions: **ELEC LEGEND & DETAILS**


NOTE: NOTE:

ALL COSTS IN BID AND SHALL COORDINATE ALL ELECTRICAL EQUIPMENT AND EQUIPMENT PROVIDED BY OTHER TRADES REQUIRING ELECTRICAL ROUGH-IN WITH SERVICE VOLTAGE USED PRIOR TO BID. CONTRACTOR SHALL ESTABLISH SERVICE IN CONTRACTOR'S NAME AND TRANSFER SERVICE TO TSC UP ON TURN OVER TO TSC.

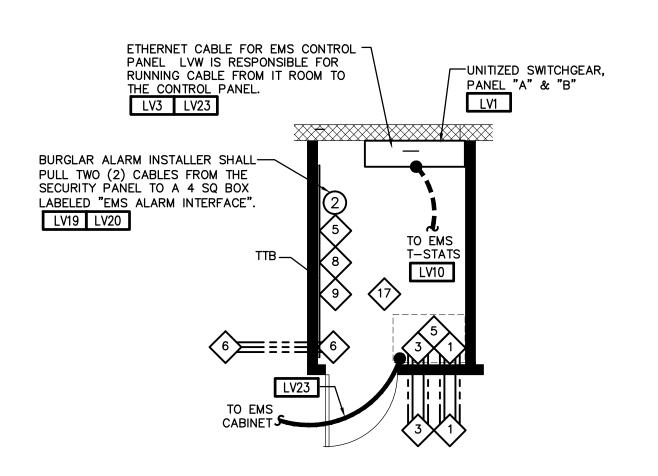

► ENLARGED PLAN - IT ROOM

SEE SHEET E5.1 FOR NOTES ASSOCIATED WITH THIS SHEET.

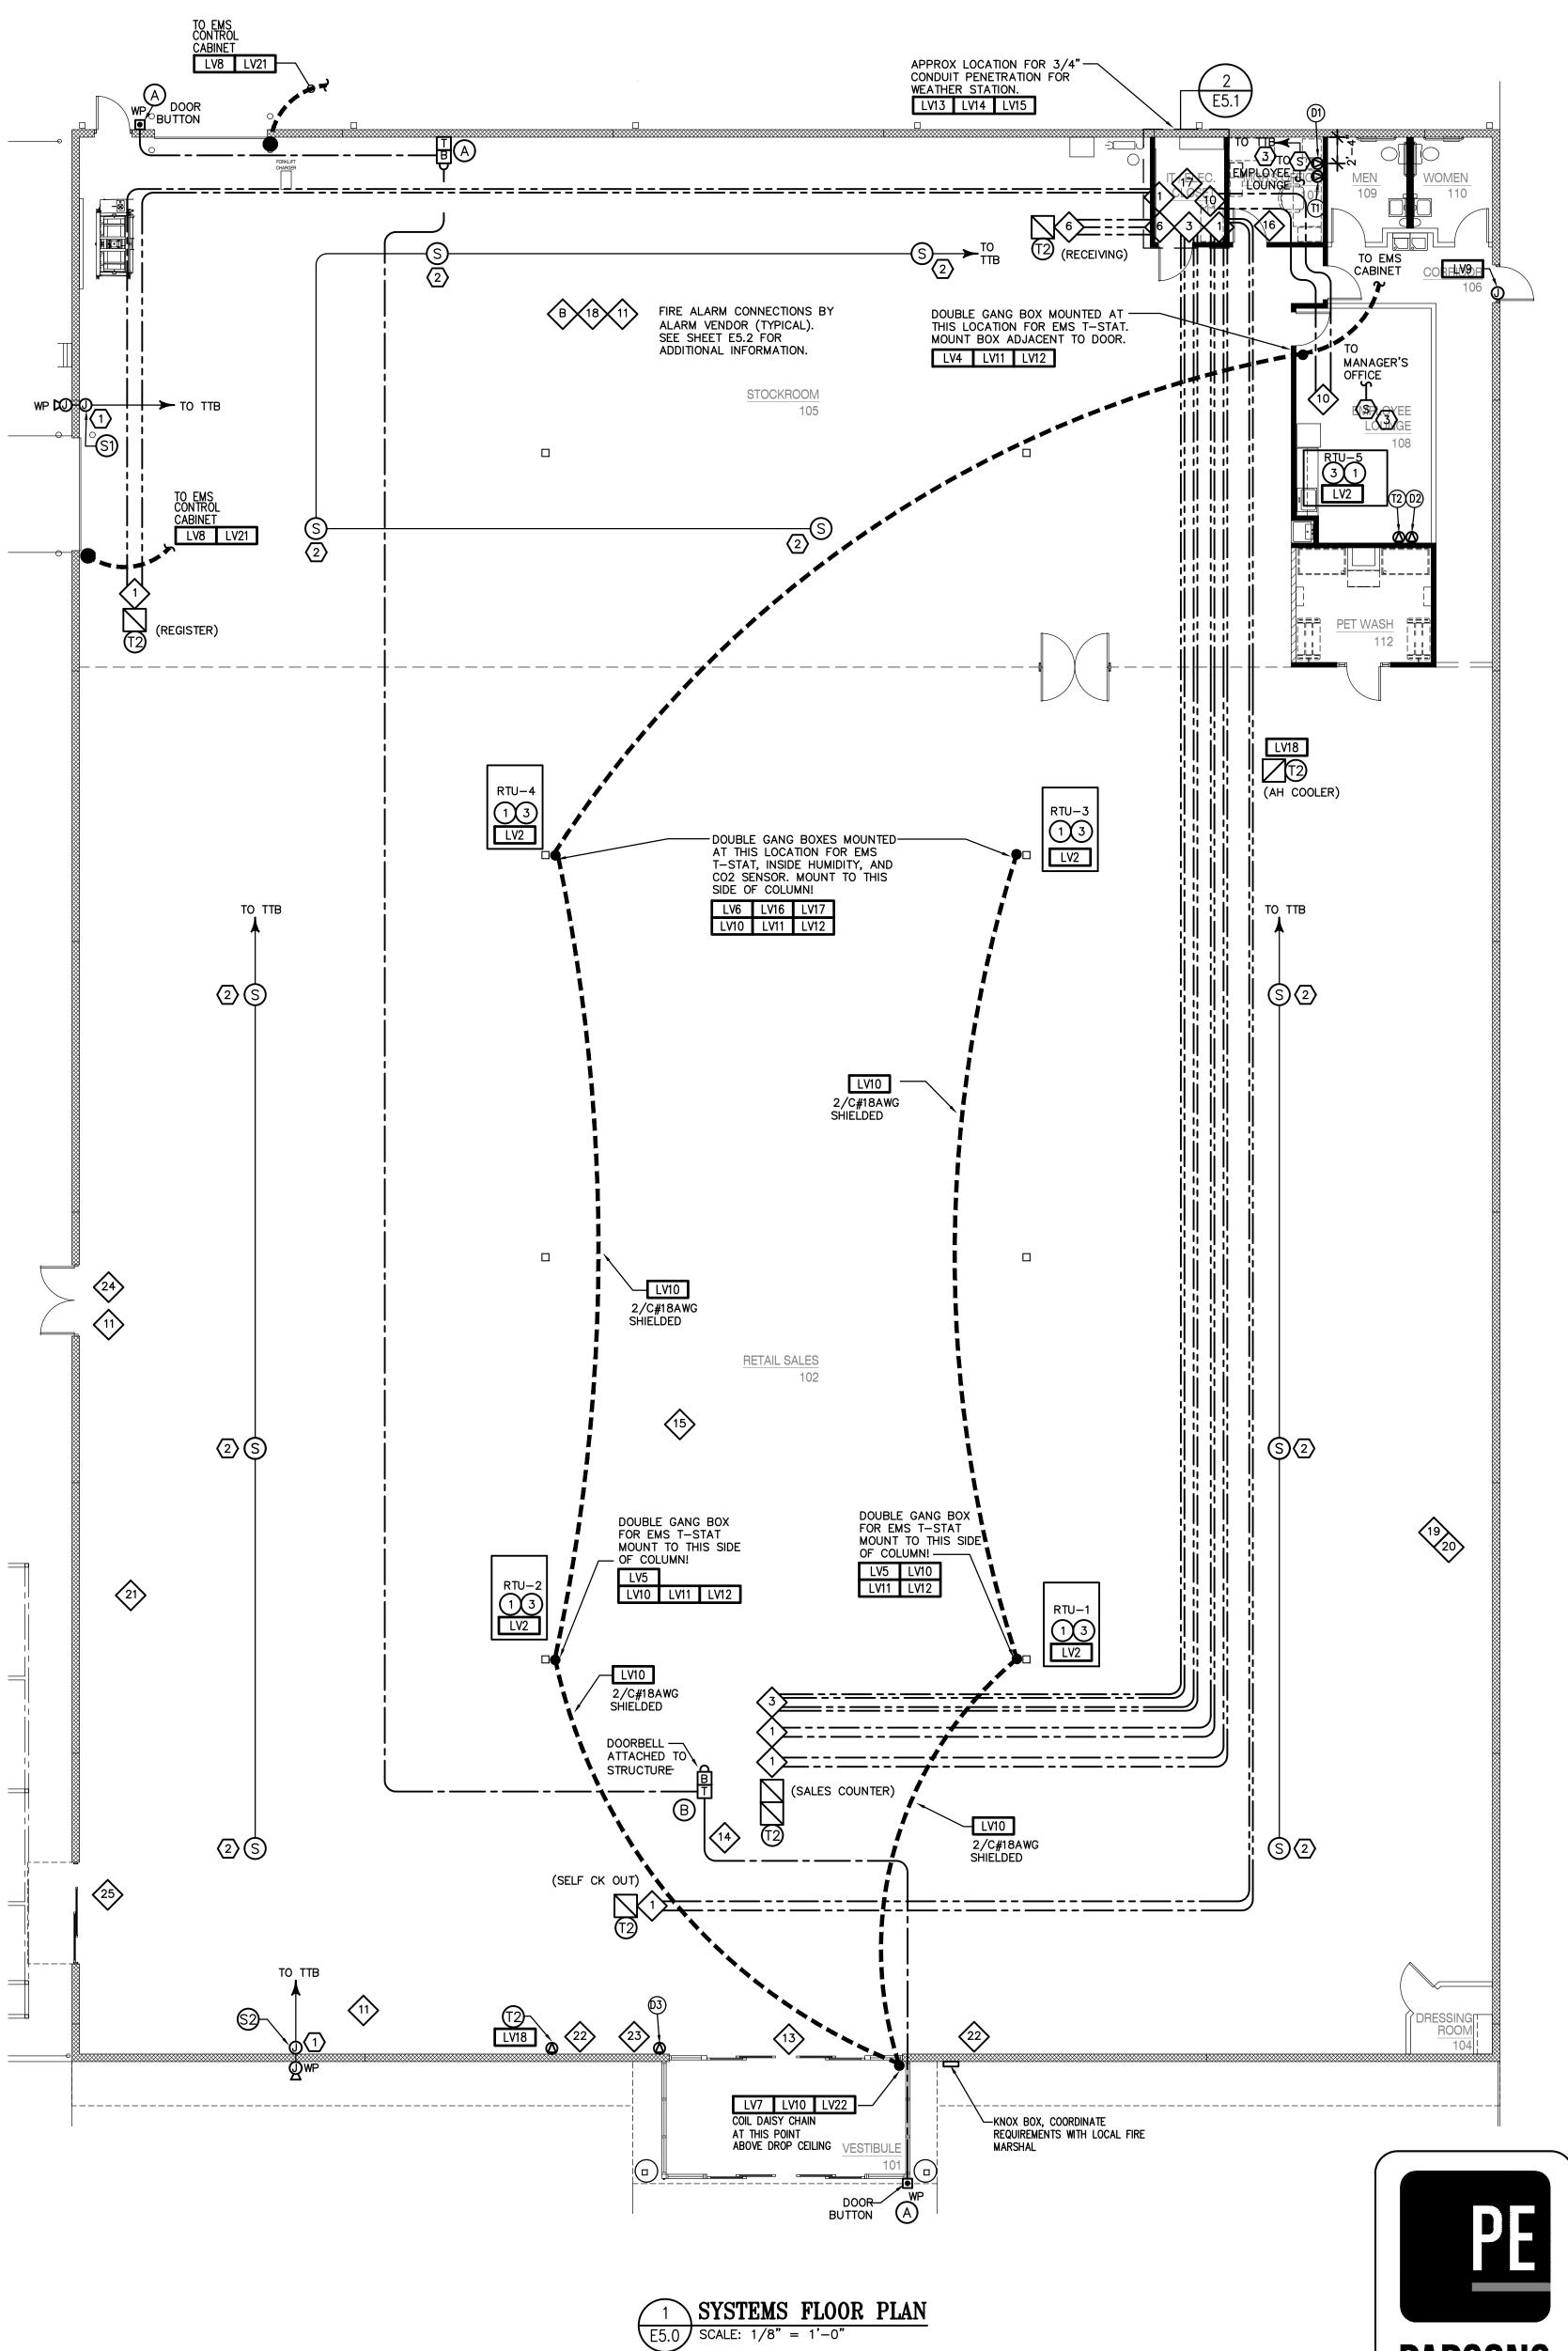



2934 Sidco Drive Architecture
Suite 120 Planning
Nashville, TN 37204 Interior Architecture



RACTOR SUPPLY COMPANY

TRACTOR SUPPLY COMPANY
HUDSON,
COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

Job Number: 2387,

Date: 05.10.2024

Revisions:

Revisions:

Revisions:

PARSONS

ENGINEERING, INC.
NASHVILLE, TENNESSEE
PARSONSENGINEERING.COM

SYSTEMS FLOOR PLAN

t Number: E5.0

Cable Specifications: ALL cable must be jac

ALL cable must be jacketed in a fire—retardant material, shielded (unless otherwise noted) and WHITE in color. In the event that a specific cable is not available, Contractor may substitute for a cable with more conductors (i.e. 2 conductor can be substituted with 3 conductor of the same ratings).

Maximum cable length shall not exceed 330 feet.

Do not route cables over or touching a fluorescent light. Cross over fluorescent lights perpendicular to the length of the fixture.

lights perpendicular to the length of the fixture.

All cables shall be supported from the ceiling joist above. Do not lay cables on the grid of a drop ceiling.

Type
one twisted pair — 18ga — shielded — plenum rated — white jacket

having to route the cables past substantial line voltage wire.

Preface: This store will be wired for a future EMS system This contractor shall price in the base bid wiring.

LV1 G.C. shall install a 2" EMT conduit into the top of the future EMS section of the unitized switchboard

(hereafter referred to as the EMS cabinet) so as to provide EMS cable access to the panel without

- LV2 G.C. shall provide a 3/4" (inch) trade size rigid conduit or seal tight from the RTU control panel stubbed into the TSC space for low voltage wiring access.
- LV3 Tractor Supply shall provide EMS jack in one of 6— up boxes in the IT CLOSET and an orange patch, with white boot, cable connected to port 23 on the 2960 switch and run to port #46 on the patch
- LV4 G.C. shall install a recessed single gang switch box in corridor next to manager's office see mechanical drawings for exact placement. This box should be mounted 60" AFF. This box is for installation of the RTU5 thermostat / future EMS control thermostat.
- G.C. shall install a double gang switch box (4 11 with the appropriate adapter plates) on the column closest to each sales floor RTU 1 and 2 for the purpose of installing the Thermostat /future EMS thermostat (see LV6 for specifics about RTU 3 and 4). If HVAC is needed to condition the building prior to the installation of the LVW by the TSC LVW vendor, the G.C. is to make HVAC units operable using temporary bi-metal thermostats to be hung in return air duct. This allows for conditioning of the building temporarily until the TSC LVW vendor installs permanent LVW per the timing and action calendar contained within the set of plans. Once the LVW vendor installs the LVW, the G.C. is responsible to remove the temporary bi-metal thermostats and make final connections of the thermostats to the newly installed LVW as mentioned above.
- G.C. shall install 3 double gang switch boxes (4 11 with the appropriate adapter plates) on the column closest to RTU 3 and 4. These 3 boxes shall be mounted vertically; one above the other, separated by no less than 6" with the bottom box mounted at a height of approximately 7' 6" AFF and MUST be mounted to the surface of the column that faces the center of the building so as to shield the sensor from direct supply air. A quantity of (2) 1" (inch) conduits shall be installed above & between the boxes so as to provide a path for continuous wire pull from the overhead into the bottom most box. These boxes are for (from top to bottom) the installation of the CO2 sensor, the humidity sensor, and the RTU thermostat / future EMS thermostat in the bottom box each of which requires a dedicated double gang box. "Doubling up" the sensors in a 2 gang box is not acceptable.
- LV7 G.C. shall install a single gang box and a 3/4" EMT conduit for the vestibule Unit Heater and the greenhouse's Unit Heater. The conduits shall be installed from the ceiling deck to each unit heater's thermostat designated mounting location in the vestibule and stockroom. G.C. is to make each unit heater operate using the thermostats provided with the unit heaters and installed wiring.
- LV8 G.C. shall install a 3/4" EMT conduit from the ceiling deck to 12" (inches) AFF so as to provide future EMS cable access for routing the LV cable from above the dock door to the finished floor. The conduit is to be installed directly adjacent to the dock door, within 2" (inches) of the rollup door track.
- J-box for power to the series 800 power supply mounted above the ceiling in line with the hinge side of the door. Provide a 1/2" conduit from the power supply to the electric power transfer device (PT-5) of the door frame, concealed mortise mount. Provide and pull two #18 AWG wire from the power supply to the power transfer device and into the door. Contractor to complete wiring and connection of the delayed rim exit device after new door and rim exit hardware is installed. Coordinate all requirements with supplier/installer. See detail 12/E3.2.
- LV10 LVW vendor shall install a total of (1) 18/2 SHIELDED plenum cable. The cable shall be pulled continuous from the future "EMS Cabinet" in the electrical switchgear to each Unit Heater's & RTU's thermostat gang boxes location (see LV5 and LV6 for specifics) in turn (Daisy Chain) starting with the Unit Heater / RTU thermostat mounting location closest to the electrical room. The wire shall be pulled into the RTU's designated gang box, leaving a 5' coil. Label both un-spliced ends of this cable pull as "TStat COMM"
- LV11 LVW vendor shall install a total of (1) 18/10 NON—SHIELDED plenum cable. The cable shall be pulled from each RTU's control cabinet to the RTU specific thermostat gang box, leaving a 5' coil at both ends. Label both ends of this cable "RTUx CONTROL", where x is the RTU #.
- LV12 LVW vendor shall install a total of (1) 18/10 NON—SHIELDED plenum cable. The cable shall be pulled from each RTU's supply hard air duct, just below ceiling, to the corresponding RTUs thermostat gang box, leaving a 10' coil at both ends. Label both ends of this cable "RTUx SUPPLY", where x is the RTU #.
- LV13 LVW vendor shall install a total of (1) 18/10 NON—SHIELDED plenum cable. The cable shall be pulled from the EMS cabinet to the future "WeatherStation", leaving a 5' coil at both ends. Label both ends of this cable "OA TEMP".
- LV14 LVW vendor shall install a total of (1) 18/10 NON—SHIELDED plenum cable. The cable shall be pulled from the EMS cabinet to the future "WeatherStation", leaving a 5' coil at both ends. Label both ends of this cable "OA HUMID".
- LVW vendor shall install a total of (1) 18/10 NON—SHIELDED plenum cable. The cable shall be pulled from the EMS cabinet to the future "WeatherStation", leaving a 5' coil at both ends. Label both ends of this cable "OUTDOOR LIGHT LEVEL".
- For each indoor humidity sensor specified, the LVW vendor shall install a total of (1) 18/4 NON—SHIELDED plenum cables. The cables shall be pulled from the EMS cabinet to the top single gang box installed as per note LV6, leaving a 5' coil at both ends. Label both ends of this cable "INSIDE HUMID #1" and, if installed, "INSIDE HUMID #2".
- LV17 LVW vendor shall install a total of (1) 18/2 NON—SHIELDED plenum cable. The cables shall be pulled from the EMS cabinet to the next to the top single gang box installed as per note LV6, leaving a 5' coil at both ends. Label both ends of this cable "CO2".
- LVV vendor shall install a total of (1) 18/2 NON—SHIELDED plenum cable in 1/2" conduit. The cable shall be pulled from the EMS cabinet to the vaccine case, leaving a 5' coil at both ends. Label both ends of this cable "VACCINE TEMP". Coordinate with the GC to determine the exact location. NOTE: IN THE EVENT THAT THE FINAL LOCATION OF THE ANIMAL HEALTH CASE IS UNKNOWN, LEAVE A 50' COIL OF CABLE IN THE APPROXIMATE LOCATION.
- LV19 LVW vendor shall install a total of (1) 18/4 NON—SHIELDED plenum cable. The cables shall be pulled from the EMS cabinet to the alarm installer's junction box labeled "EMS/SI ALARM INTERFACE" (located on the telephone board, beside the security alarm panel), leaving a 5' coil of each at both ends. Label both ends of each these cables "OCCUPANCY" and "ALL LIGHTS ON" respectively. If the security system installer has not installed this junction box, install and label these cables leaving a 15' loop of each at the ceiling joist on the vicinity of the building security system equipment.
- ALARM VENDOR shall install a total of two twisted pair, 18ga plenum cables (Windy City # 002320—S or equivalent). The cables shall be pulled from the Security Panel to the junction box labeled "EMS/SI ALARM INTERFACE" (located on the telephone board, at the designated location beside the security alarm panel). ALARM VENDOR to terminate this wiring to the appropriate security system "ARM/DISARM" and "ALARM" outputs to the corresponding terminals within the "EMS/SI Alarm interface" junction box (installed by the LVW vendor). If the LVW Vendor has not installed this junction box, ALARM VENDOR to install and label their cables leaving a 5' loop at the designated location of the EMS/SI ALARM interface" on the telephone backboard.
- LV21 LVW vendor shall install a total of (1) 18/2 NON—SHIELDED plenum cable. The cable shall be pulled from the EMS cabinet through the EMT conduit installed for dock door monitoring, leaving a 5' coil at both ends. Label both ends of this cable "DOCK DOOR". This is used for future EMS monitoring and is in addition to the cabling required for the security system door monitoring. This EMS cable should be pulled down through the conduit that is installed to monitor the dock door via the EMS (see LV8). Coordinate with the GC to determine the exact location. NOTE: IN THE EVENT THAT THE FINAL LOCATION OF THE DOCK DOOR EMS CONDUIT IS UNKNOWN, LEAVE A 50' COIL OF CABLE ABOVE THE DOCK DOOR.
- LV22 LVW Vendor to install a total of (1) 18/4 NON—SHIELDED plenum cable for each unit heater. The cable shall be pulled from each Unit Heater's control cabinet to the Unit Heater's specific thermostat gang box, leaving a 5' coil at both ends. Label both ends of this cable "UH Control". Note: In the event that the location of the unit heater is unknown, leave a 50' coil of cable at this location.
- LV23 LVW VENDOR to provide a CAT5 cable run from the patch panel in the IT CLOSET to the future EMS cabinet location.

PUBLIC ADDRESS SYSTEM:

GENERAL NOTES:

- A. TSC SHALL FURNISH & INSTALL THE PUBLIC ADDRESS SYSTEM
 B. LVW VENDOR SHALL PROVIDE ALL SPEAKER WRING. SPEAKER WIRING SHALL BE
- 18AWG / 2 CONDUCTOR WITH WHITE JACKETS.
 C. ALL CABLES ROUTED EXPOSED IN CEILING JOIST SHALL BE RUN PERPENDICULAR AND PARALLEL TO THE CEILING JOIST ORIGINATING FROM TELEPHONE BOARD.
 D. PUBLIC ADDRESS SYSTEM DEVICES SHOWN FOR REFERENCE ONLY. GENERAL
- CONTRACTOR SHALL FURNISH AND INSTALL JUNCTION BOXES AND RACEWAYS PER THE PUBLIC ADDRESS SYSTEM VENDOR RECOMMENDATIONS. PUBLIC ADDRESS SYSTEM DEVICES FURNISHED AND INSTALLED BY THE SYSTEM VENDOR.

 E. LVW VENDOR SHALL BE RESPONSIBLE FOR DETERMINING IF CABLES SHALL BE PLENUM RATED TO MEET CODES.
- PUBLIC ADDRESS SPEAKER CABLE— (S1) (S2)

 1. PROVIDE A BLACK 4" X 4" WEATHERPROOF JUNCTION BOX AT THE EXTERIOR SPEAKER LOCATION MOUNTED 13'-0" AFF OR ABOVE THE AWNING. PROVIDE A
- INTERIOR WALL. COORDINATE EXACT MOUNTING HEIGHTS AND LOCATIONS WITH THE ARCHITECTURAL DRAWINGS PRIOR TO ROUGH—IN.

 2. PROVIDE JUNCTION BOX AND CONDUIT (1" EMT) FROM EXTERIOR SPEAKER

 TO THE PETALL SALES INTERIOR WALL.
- TO THE RETAIL SALES INTERIOR WALL.

 KEYED NOTES:

JUNCTION BOX ON WALL WITH 1" CONDUIT STUBBED OUTSIDE FOR SPEAKER MOUNTING. COORDINATE EXACT REQUIREMENTS WITH PUBLIC ADDRESS SYSTEM PRIOR TO ROUGH—IN. ROUTE ONE TWO CONDUCTOR #18 AWG SPEAKER WIRE FROM JUNCTION BOX TO TELEPHONE BOARD. COIL 6 FEET OF SPEAKER WIRE OUTSIDE OF BUILDING AT PROPOSED SPEAKER LOCATION. PROVIDE 20 FEET OF CABLE AT THE CEILING ABOVE THE TELEPHONE BOARD. COIL 15 FEET OF CABLE AND SUSPEND 10 FEET AFF. TYPICAL OF 2 LOCATIONS.

- LOCATION IN BAR JOIST FOR PUBLIC ADDRESS SPEAKER. ROUTE ONE TWO CONDUCTOR #18 AWG SPEAKER WIRE BETWEEN LOCATIONS LEAVING SIX FEET OF COILED WIRING AT EACH LOCATION FOR CONNECTION OF SPEAKERS. COORDINATE EXACT REQUIREMENTS WITH PUBLIC ADDRESS SYSTEM PRIOR TO ROUGH—IN. HOME RUN SPEAKER CABLE FROM LAST DEVICE LOCATION AS SHOWN AND PROVIDE 20 FEET OF CABLE AT THE CEILING ABOVE THE
- TELEPHONE BOARD. COIL 15 FEET OF CABLE AND SUSPEND AT 10 FEET AFF.

 LOCATION IN SUSPENDED CEILING FOR PUBLIC ADDRESS SPEAKER. ROUTE ONE TWO CONDUCTOR #18 AWG SPEAKER WIRE BETWEEN LOCATIONS LEAVING SIX FEET OF COILED WIRING AT EACH LOCATION FOR CONNECTION OF SPEAKERS. COORDINATE EXACT LOCATION AND REQUIREMENTS WITH ARCHITECTURAL REFLECTED CEILING PLAN AND THE PUBLIC ADDRESS SYSTEM INSTALLER PRIOR TO ROUGH—IN. HOME RUN SPEAKER CABLE FROM LAST DEVICE AS SHOWN AND PROVIDE 20 FEET OF CABLE AT THE CEILING ABOVE THE TELEPHONE BOARD. COIL 15 FEET OF CABLE AND SUSPEND AT 10 FEET AFF.

LOW VOLTAGE DOOR BELL SYSTEM:

GENERAL NOTES:

- A. ALL LOW VOLTAGE WIRING BY LVW VENDOR (DOOR BELL, ETC.)

 SHALL BE 18AWG / 2 CONDUCTOR WITH WHITE TEFLON JACKET IN

 CONDUIT TO CEILING AND EXPOSED ALONG CEILING STRUCTURE.

 B. ALL CABLES ROUTED EXPOSED IN CEILING JOIST SHALL BE RUN PERPENDICULAR
- AND PARALLEL TO THE CEILING JOIST.

 C. GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING IF CABLES SHALL BE PLENUM RATED TO MEET CODES.

KEYED NOTES:

- A ELECTRICAL CONTRACTOR SHALL PROVIDE AND INSTALL AN EDWARDS 55–4G5 DOOR BELL AND AN EDWARDS 592 TRANSFORMER AT TWO LOCATIONS SHOWN. ELECTRICAL CONTRACTOR SHALL PROVIDE AND INSTALL AN EDWARDS 250 PUSHBUTTON TO CONTROL BOTH DOOR BELLS. PUSHBUTTON SHALL BE INSTALLED IN A WEATHERPROOF ENCLOSURE. TEST TO ASSURE WORKING SYSTEM. MOUNT TRANSFORMER & BELL AT 14'-0" AFF.
- B EDWARDS 55-4G5 DOOR BELL @ CASH REGISTER & CONNECT TO SYSTEM AS NECESSARY. COORDINATE WITH G.C. FOR EXACT LOCATION OF BELL.

PUBLIC ADDRESS SYSTEM LEGEND

- OPEN BARJOIST MOUNTED SPEAKER
- S CEILING BARJOIST MOUNTED SPEAKER
- J PUBLIC ADDRESS SYSTEM JUNCTION BOX
- WP EXTERIOR WEATHERPROOF PUBLIC ADDRESS SYSTEM JUNCTION BOX.

LOW VOLTAGE WIRING SYSTEM LEGEND

 PUBLIC ADDRESS (PA) SYSTEM WIRIN
 DATA/TELEPHONE SYSTEM WIRING
 EMS SYSTEM WIRING
EMS SYSTEM WIRING

B ALL CONDUITS INSTALLED IN THE STOCKROOM AREA SHALL BE INSTALLED AS TIGHT TO ROOF DECK AS ALLOWED BY CODE.

DATA SYSTEM:

GENERAL NOTES:

- GENERAL NOTES:

 A. TSC SHALL FURNISH & INSTALL ALL POS, PA & PHONE SYSTEMS. GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR FURNISHING AND INSTALLING ALL
- BACKBOXES AND CONDUITS. LVW VENDOR RESPONSIBLE FOR WIRING.

 B. LVW VENDOR SHALL PROVIDE ALL DATA AND TELEPHONE WIRING WITH WHITE JACKETS. ALL PHONE AND DATA CABLE MUST BE CATSE CERTIFIED, NO EXCEPTIONS.
- C. ALL CABLES ROUTED EXPOSED IN CEILING JOIST SHALL BE RUN PERPENDICULAR AND PARALLEL TO THE CEILING JOIST.
 D. LVW VENDOR SHALL BE RESPONSIBLE FOR DETERMINING IF CABLES SHALL BE PLENUM RATED TO MEET CODES.
- E. ROUTE CAT5E CABLES TO IT ROOM TO CEILING SPACE ABOVE THE RED POWER RECEPTACLE (CIRCUIT B-24). REFERENCE DRAWING E2.0 FOR RECEPTACLE LOCATION. REFER TO KEYED NOTE '5' BELOW.

 TELEPHONE CABLE- (T1) (T2)
- 1. PROVIDE STANDARD OUTLET BOXES AT ALL TELEPHONE LOCATIONS WITH 3/4" CONDUIT (WITH PULL WIRE) TO ACCESSIBLE CEILING AREA OR TO BAR JOIST. DATA CABLE—D1 D2 D3
- PROVIDE STANDARD OUTLET BOXES AT ALL DATA LOCATIONS WITH 3/4" INCH
 CONDUIT (WITH PULL WIRE) TO ACCESSIBLE CEILING AREA OR TO BAR JOIST.

KEYED NOTES:

- LVW VENDOR SHALL ROUTE TWO CAT5E CABLES FROM REGISTER TO THE IT ROOM. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE AS REQUIRED FOR EACH ADDITIONAL REGISTER. PROVIDE LABELS FOR EACH CABLE ON BOTH ENDS. LABEL CABLES 'REG1A' AND 'REG1B' FOR REGISTER ONE AND 'REG2A' AND 'REG2B' FOR REGISTER 2. LABEL ADDITIONAL REGISTER CABLES 'REG3A' AND 'REG3B', ETC. AS REQUIRED FOR ADDITIONAL REGISTERS.
- NOTE NOT USED.
 - 3 LVW VENDOR SHALL ROUTE FOUR CAT5E CABLES FROM SERVICE DESK TO THE IT ROOM. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE LABELS FOR EACH CABLE ON BOTH ENDS. LABEL CABLES 'SDA', 'SDB', 'SDC', 'SDD'.
 - 5 LVW VENDOR SHALL ROUTE CAT5E CABLES TO IT ROOM TO CEILING SPACE ABOVE THE RED POWER RECEPTACLE (CIRCUIT B-24). REFERENCE DRAWING E2.0 FOR RECEPTACLE LOCATION. REFER TO GENERAL NOTE 'E' ABOVE.
 - 6 LVW VENDOR SHALL ROUTE THREE CATSE CABLES FROM RECEIVING DESK TO THE IT ROOM. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE LABELS FOR EACH CABLE ON BOTH ENDS. LABEL CABLES 'RDA'. 'RDB'. 'RDC'.
 - 7) NOTE NOT USED.

 8 LVW VENDOR SHALL ROUTE THREE CATSE CABLES FROM IT ROOM ABOVE
 - 8 LVW VENDOR SHALL ROUTE THREE CATSE CABLES FROM IT ROOM ABOVE THE RED POWER RECEPTACLE (CIRCUIT B-24) TO THE TELEPHONE BOARD. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE AS REQUIRED FOR EACH ADDITIONAL REGISTER. PROVIDE LABELS FOR EACH CABLE ON BOTH ENDS. LABEL CABLES 'DSL', 'T1A' AND 'T1B'.
 - 9 LVW VENDOR SHALL ROUTE THREE CAT5E CABLES FROM THE IT ROOM AT THE DATA WALL OUTLET TO THE TELEPHONE BOARD. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE LABELS FOR EACH CABLE ON BOTH ENDS. LABEL CABLES 'DIAL TONE', 'FAX', AND 'MUSIC ON HOLD'.
 - LVW VENDOR SHALL ROUTE TWO CAT5E CABLES FROM THE BREAKROOM AT THE CEILING ABOVE THE POWER OUTLET TO THE IT ROOM ABOVE THE RED POWER RECEPTACLE. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE LABELS FOR EACH CABLE ON BOTH ENDS. LABEL CABLES
 - LVW SHALL ROUTE SIX CAT5E DATA CABLES (TWO PER ACCESS POINT)
 BACK TO IT ROOM. SEE ACCESS POINT SITE SPECIFIC MAP PROVIDED BY

TSC FOR EXACT LOCATION OF EACH ACCESS POINT. 12 NOTE NOT USED.

- LVW VENDOR SHALL ROUTE CAT5E CABLE FROM MAIN ENTRANCE TO THE IT CLOSET. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE LABEL AT BOTH ENDS. LABEL CAM1.
- LVW VENDOR SHALL ROUTE CAT5E CABLE FROM REAR OF REGISTER BAYS TO THE IT CLOSET. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE LABEL AT BOTH ENDS. LABEL CAM2.
- LVW VENDOR SHALL ROUTE CATSE CABLE FROM POD AREA CENTERED ON TOOLS TO THE IT CLOSET. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE LABEL AT BOTH ENDS. LABEL CAM3.
- LVW VENDOR SHALL ROUTE CATSE CABLE FROM MANAGERS OFFICE TO THE IT CLOSET. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF.
- LVW VENDOR SHALL ROUTE CATSE CABLE FROM IT CLOSET TO THE IT CLOSET. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEETOF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE LABEL AT BOTH ENDS. LABEL CAM5.

PROVIDE LABEL AT BOTH ENDS. LABEL CAM4.

- LVW VENDOR SHALL ROUTE CAT5E CABLE FROM RECEIVING AREA TO THE IT CLOSET. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE LABEL AT BOTH ENDS. LABEL CAM6.
- LVW VENDOR SHALL ROUTE CATSE CABLE FROM THE 90 DEGREE CORNER OF BOOTS TO THE IT CLOSET. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE LABEL AT BOTH ENDS. LABEL CAM8.
- LVW VENDOR SHALL ROUTE 16/2 CABLE FOR PUBLIC VIEW MONITOR FROM THE 90 DEGREE CORNER OF BOOTS TO THE IT CLOSET. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE LABEL AT BOTH ENDS. LABEL PVM1.
- LVW VENDOR SHALL ROUTE CAT5E CABLE FROM AREA BETWEEN SIDE LOT ENTRANCE AND FRONT OF BUILDING TO THE IT CLOSET. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE LABEL AT BOTH ENDS. LABEL CAM9.
- LVW VENDOR SHALL ROUTE CATSE CABLE FROM SIDE OF VESTIBULE THAT WILL DISPLAY POWER EQUIPMENT TO THE IT CLOSET. VERIFY LOCATION ON SITE, PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE LABEL AT BOTH ENDS. LABEL CAM10.
- LVW VENDOR SHALL ROUTE CATSE CABLE FOR EAS FROM ENTRANCE TO THE IT CLOSET. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE LABEL AT BOTH ENDS. LABEL EAS1.
- LVW VENDOR SHALL ROUTE CATSE CABLE FOR EAS FROM SIDE LOT ENTRANCE TO THE IT CLOSET. PROVIDE 20 FEET OF CABLE AT BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND SUSPEND AT 10 FEET AFF. PROVIDE LABEL AT BOTH ENDS. LABEL EAS2.
- LVW VENDOR SHALL ROUTE CAT5E CABLE FOR EAS FROM LIVE GOODS
 CENTER ENTRANCE TO THE IT CLOSET. PROVIDE 20 FEET OF CABLE AT
 BOTH ENDS AT THE CEILING. COIL 15 FEET OF CABLE AT EACH END AND
 SUSPEND AT 10 FEET AFF. PROVIDE LABEL AT BOTH ENDS. LABEL EAS3.
- (1) ALL ROOFTOP EQUIPMENT CONNECTIONS SHALL BE MADE THROUGH THE UNIT ROOF CURB. ROOF PENETRATIONS ARE NOT ACCEPTABLE.

ACTIVATION OF GENERAL ALARM. CONTROLLER TO BE

FURNISHED BY CONTRACTOR. RELAY MODULE TO BE LOCATED WITHIN THREE FEET OF CONTROLLER.

2 FIRE ALARM CONTROL PANEL TO BE MOUNTED ON TELEPHONE BOARD. REFERENCE DETAIL 1/E4.0. CONNECT TO DEDICATED 120 VOLT POWER CIRCUIT.
 3 TO HVAC/FAN CONTROLLER FOR SHUTDOWN OF UNIT UPON

LVW RESPONSIBILITY AND TIMING PLAN

LATEST - Q4 2023

ACTION	BY WHO	WHEN	SPECIAL NOTES
STORE ADDED TO SOS	TSC REAL ESTATE	1ST MONDAY OF EACH MONTH	
CODES AND BUILDING TYPE (CONTACT TSC PM AS NECESSARY) RESEARCHED, BA AND FA PLANS COMPLETED	JCI/ADT	WITHIN 30 DAYS AFTER ADDED TO THE SOS	PLEASE BE SURE TO VERIFY HVAC SYSTEMS (GROUND MOUNT VS. ROOF MOUNT, ETC) SECURITY SYSTEMS CONTRACTOR TO IDENTIF' EXIST. HVAC UNITS BY LL PER THE CHECKLIST
SECURITY SYSTEMS CONTRACTOR COMPLETES PLANS SENDS TO RICH WOOD AND TSC PM	JCI/ADT	ON 30TH DAY AFTER ADDED TO SOS	
PLANS FORWARDED TO LL AND/OR HIS ARCHITECT IF KNOWN	TSC PM	31 DAYS	
TSC TO REVIEW LL PLANS FOR ACCURACY	TSC PM	WHEN SENT BY LL PRIOR TO CONSTRUCTION START	
LL TO COMPLETE ALL LYW SOW PER PLANS USING TSC VENDOR	MERCURY TECH	NO LESS THAN 2 WEEKS PRIOR TO FD FROM 2 WEEKS	
SECURITY SYSTEMS CONTRACTOR TO INSTALL THEIR EQUIPMENT AND MAKE TERMINATIONS	JCI/ADT	STARTING APPROXIMATELY 3 WEEKS FROM FD TO BE DONE LAST AS LVW VENDOR COMPLETES NO LATER THAN 2 WEEKS PRIOR TO FD.	
INSTALLATION OF PA SYSTEM, PHONE SYSTEM, SPEAKERS, OUTSIDE HORNS, PHONES, PATCH PANEL, AP'S W/ ANTENNAS	STAN KOLIC / MERCURY TECH	MONDAY AND TUESDAY BEFORE FD	
INSTALLATION OF POS SYSTEMS AT ALL LOCATIONS AND TESTING OF AP SYSTEM	STAN KOLIC / AGILYSIS	TUESDAY BEFORE FD	

ON DEVELOPER OWNED PROJECTS, DEVELOPER IS RESPONSIBLE FOR 100 % OF COST OF LVW VENDOR AND WIRING.



2934 Sidco Drive Architecture
Suite 120 Planning
Nashville, TN 37204 Interior Architecture



HUDSON,
COLORADO

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent prohibited and any infringement will b



drawing without their written consent is prohibited and any infringement will be subject to legal action.

Job Number: 238

Date: 05.10.2024

Revisions:

Revisions:

isions:
SYSTEMS FLOOR NOTES

umber: **E5.**1